


Scale For Microfitting


Inches

J:\WCHIT\77025 - Ethel\WMCADD\06_Civil\LINE 19.dwg May 07, 2015 - 3:32pm mcdonnell
COPYRIGHT © 2015 BURNS & MCDONNELL ENGINEERING COMPANY, INC.

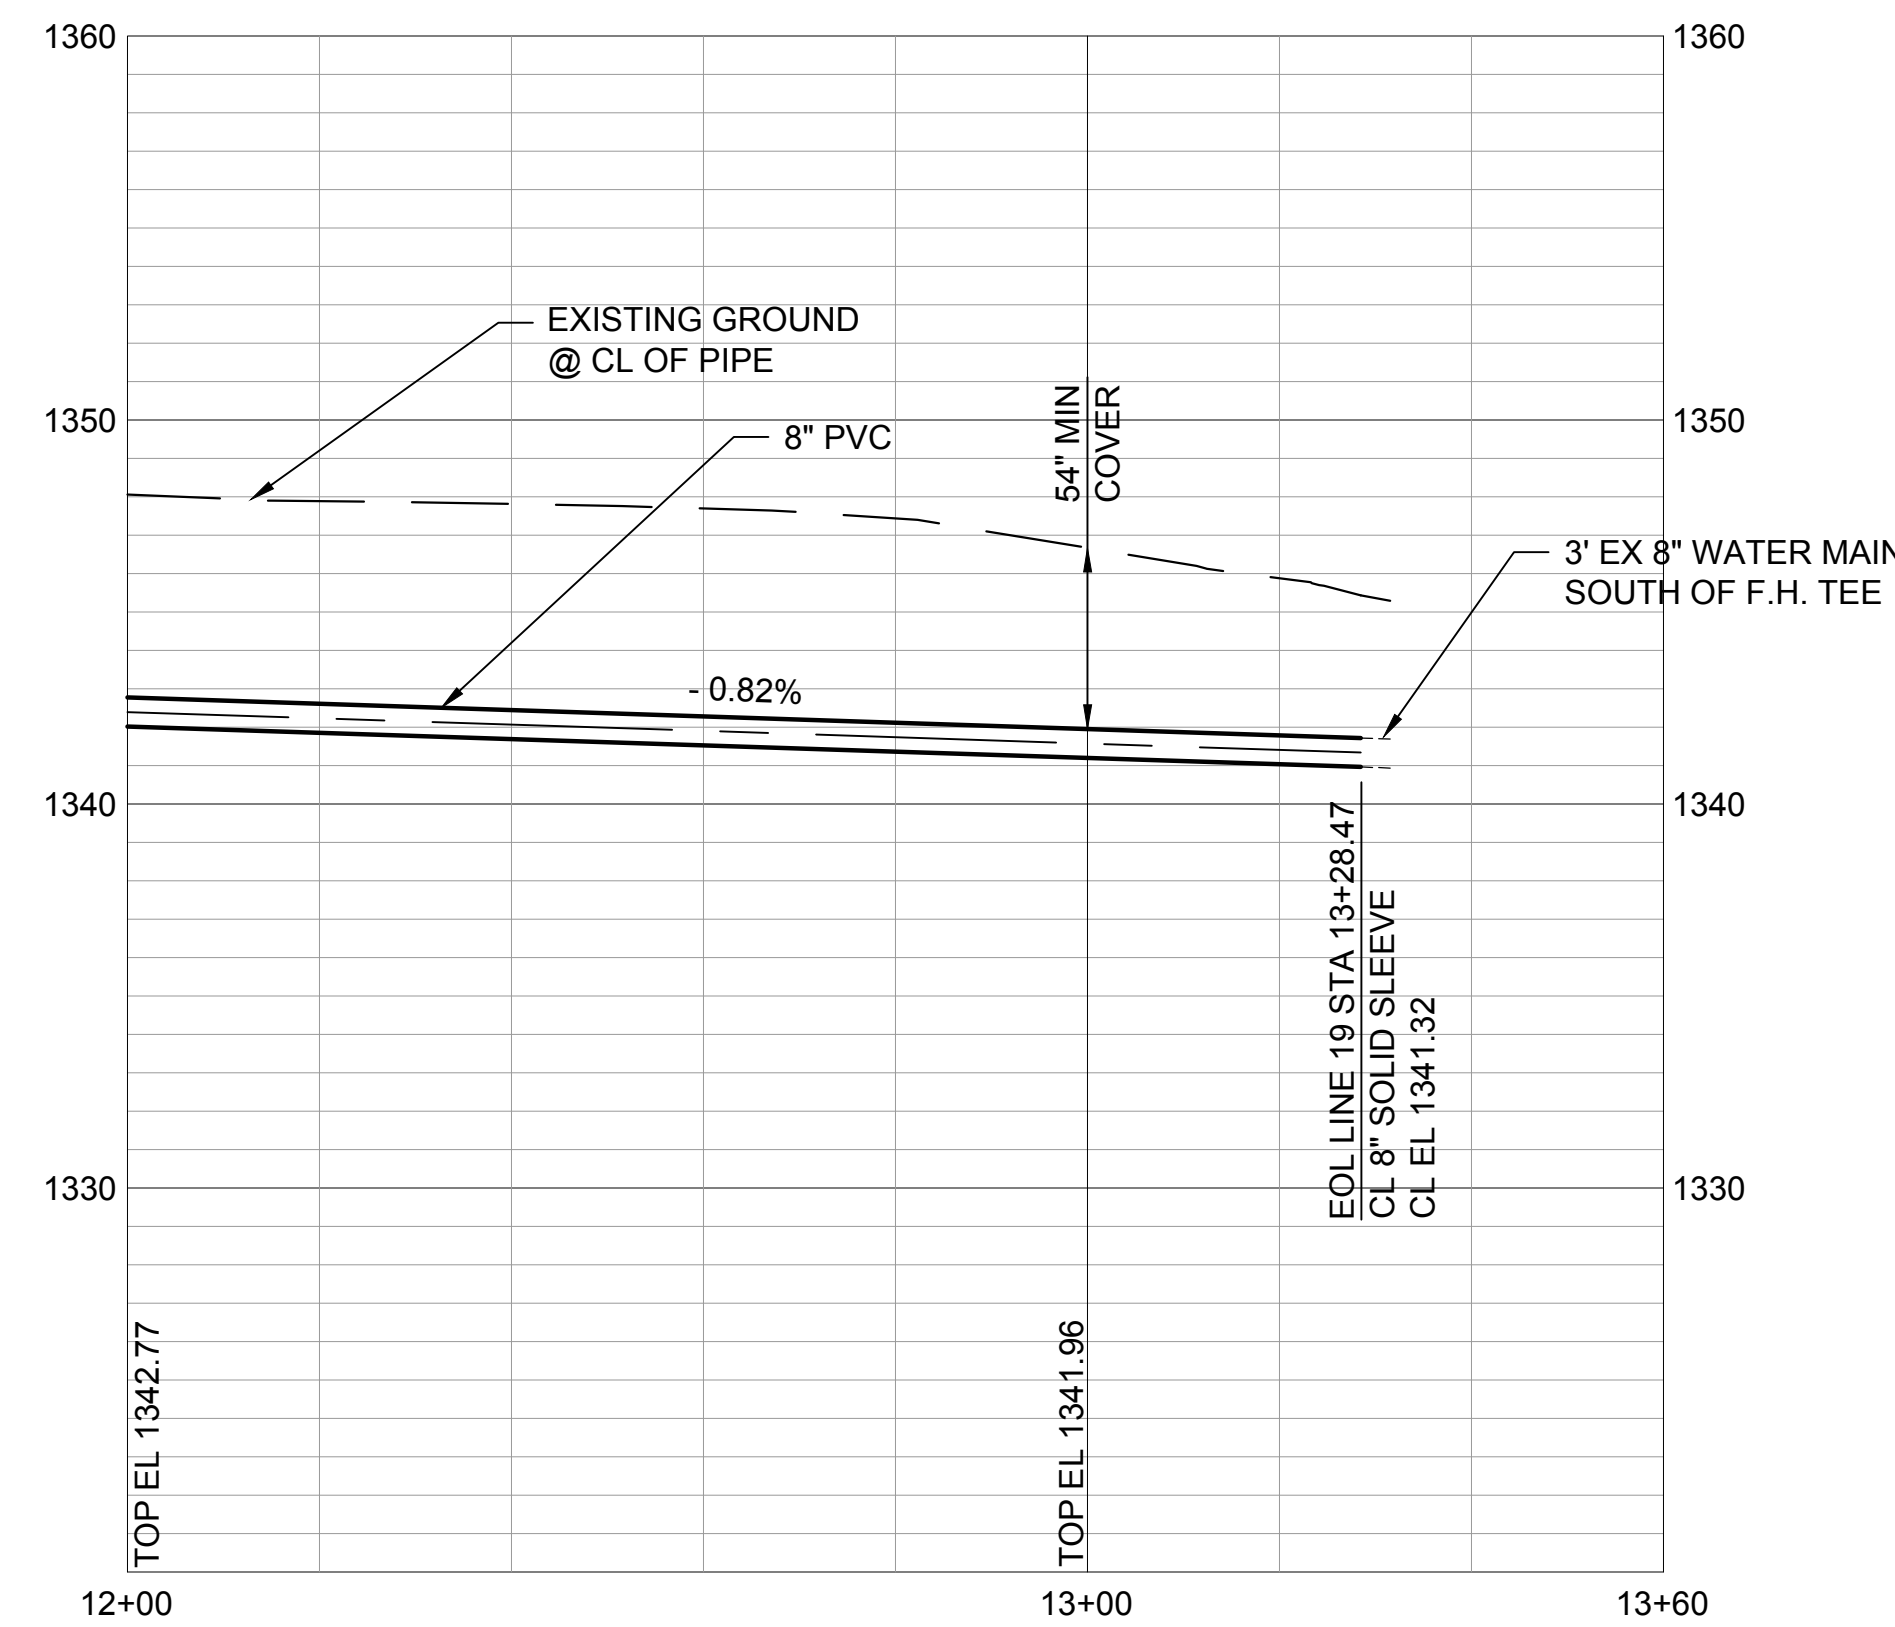

NOTE:

1. REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
2. INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
3. FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
4. CONTRACTOR SHALL VERIFY METER LOCATION.
5. CONTRACTOR SHALL VERIFY WATER METER CONNECTION AND PROPERTY ADDRESS AND TRANSFER TO NEW MAIN IF SERVICE IS CONNECTED TO EXISTING WATERMAIN ON N ERIE AVE.
6. PER CITY, AS-BUILT PLANS CALL FOR 3' OF 8" PIPE SOUTH OF EX FHA. CONTRACTOR SHALL FIELD VERIFY AND PROVIDE ALL APPURTENANCES TO CONNECT TO EXISTING MAIN.

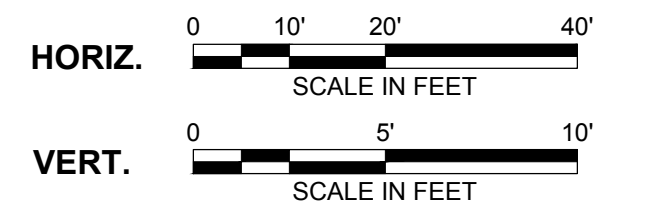

no.	date	by	ckd	description
-----	------	----	-----	-------------

Burns & McDonnell
SINCE 1898

9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 19 - N ERIE AVENUE**

project	77025	contract	448-90612
drawing	C050 - 0		rev.
sheet	57	of	101 sheets
file	LINE 19.dwg		

This document has been digitally signed.
05/08/15 9:52 AM

Name
Discipline
License No.