


LINE 20A



NOTE:

1. REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
2. INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
3. FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.

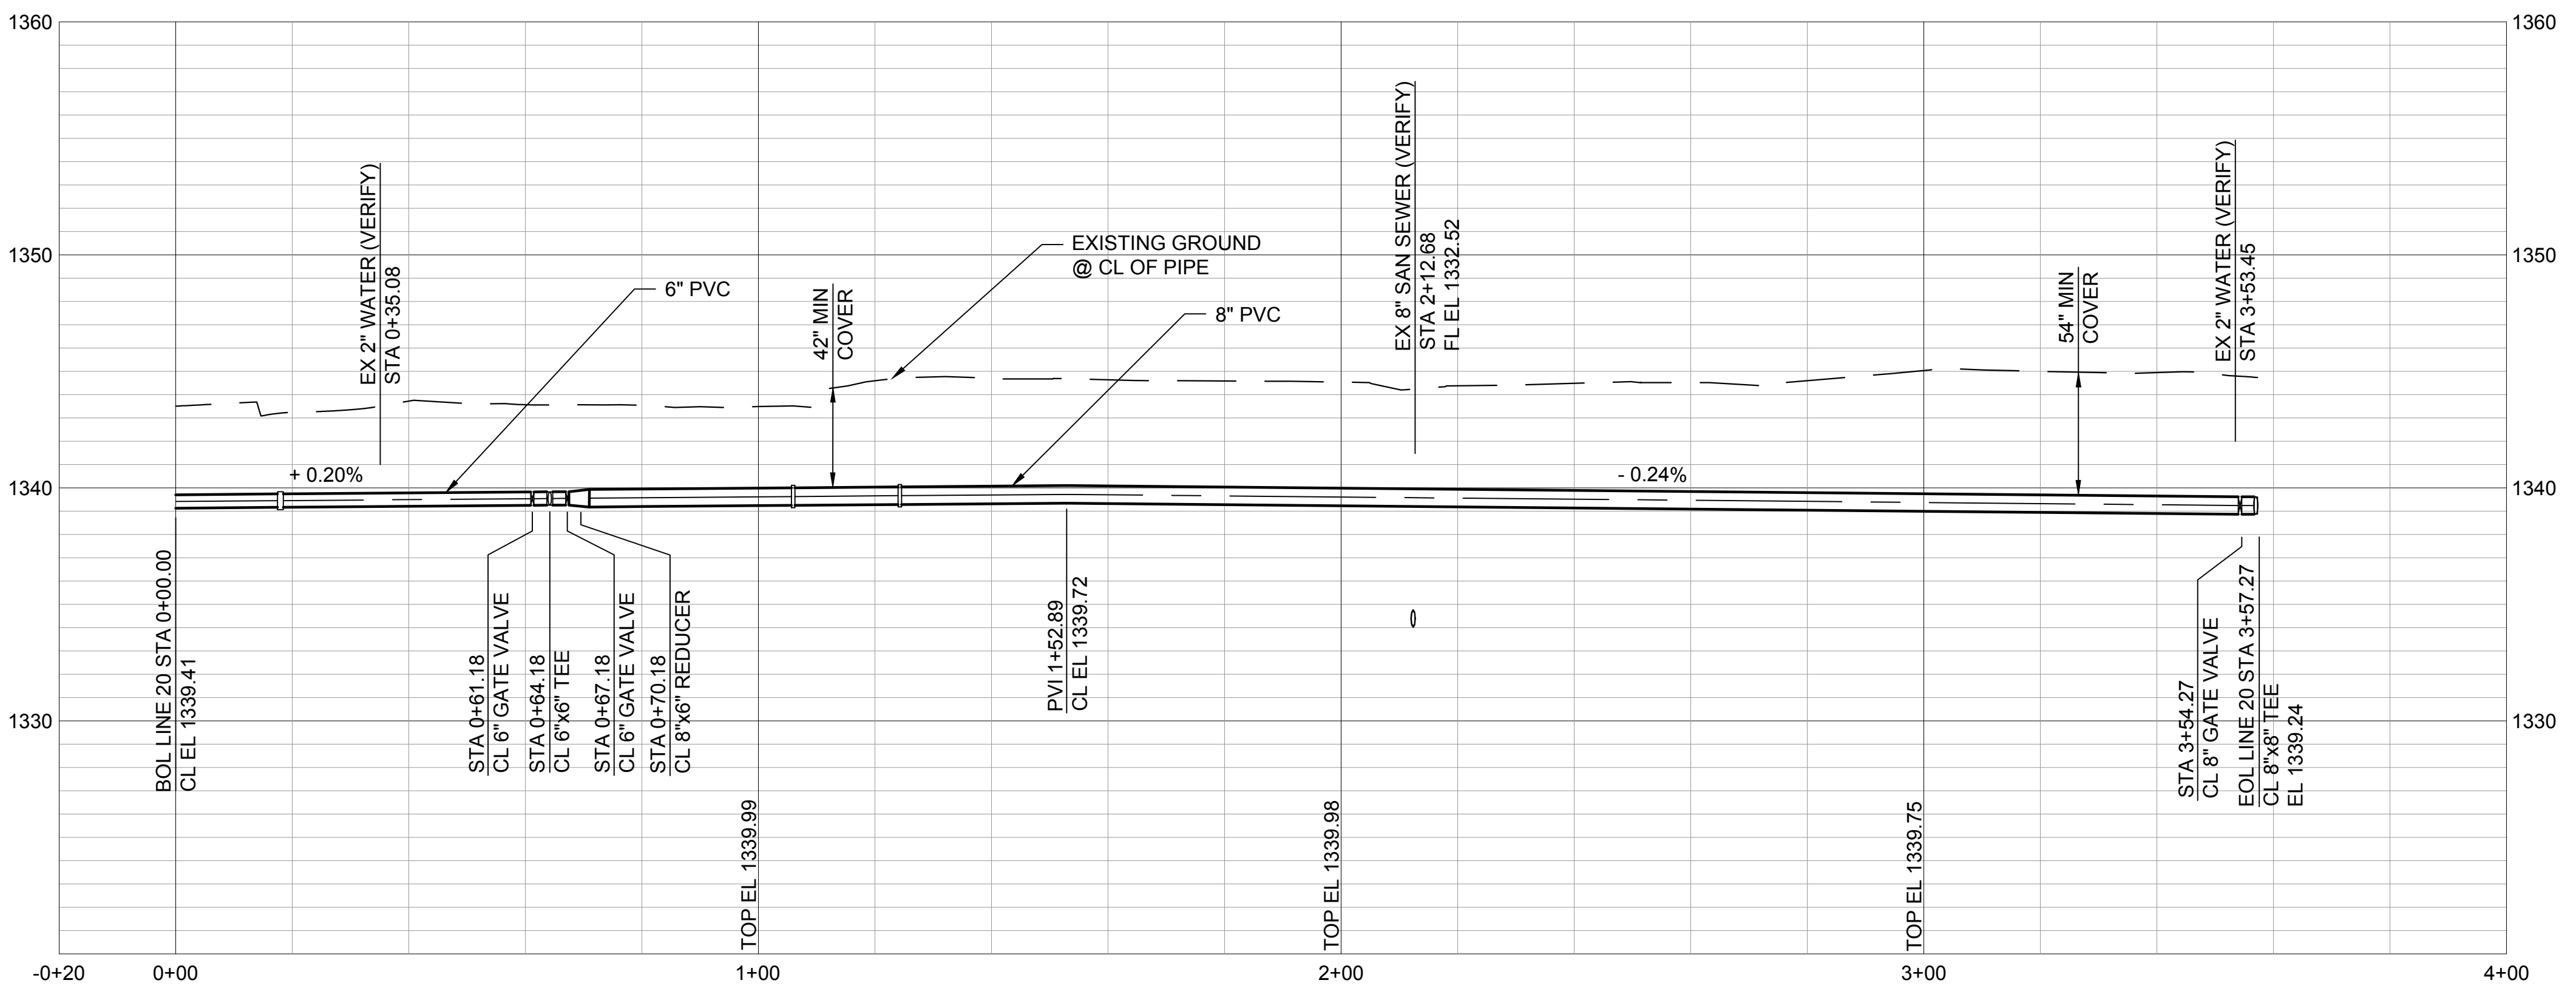

This document has been digitally signed.
05/08/15 9:52 AM

Name
Discipline
License No.



9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT**
LINE 20/ 20A - E 26TH STREET N
(VOLUTSIA TO ERIE)

project	77025	contract	448-90612
drawing	rev. C051 - 0		
sheet	58	of	101 sheets
file	LINE 20.dwg		

Scale For Microfitting

Inches

J:\WCHIT\77025 - Ethel WMA\CADD\06_Civil\LINE 20.dwg May 07, 2015 - 3:35pm mclanette
COPYRIGHT © 2015 BURNS & MCDONNELL ENGINEERING COMPANY, INC.