


Scale For Microfitting
Millimeters
Inches



no.	date	by	ckd	description
-----	------	----	-----	-------------

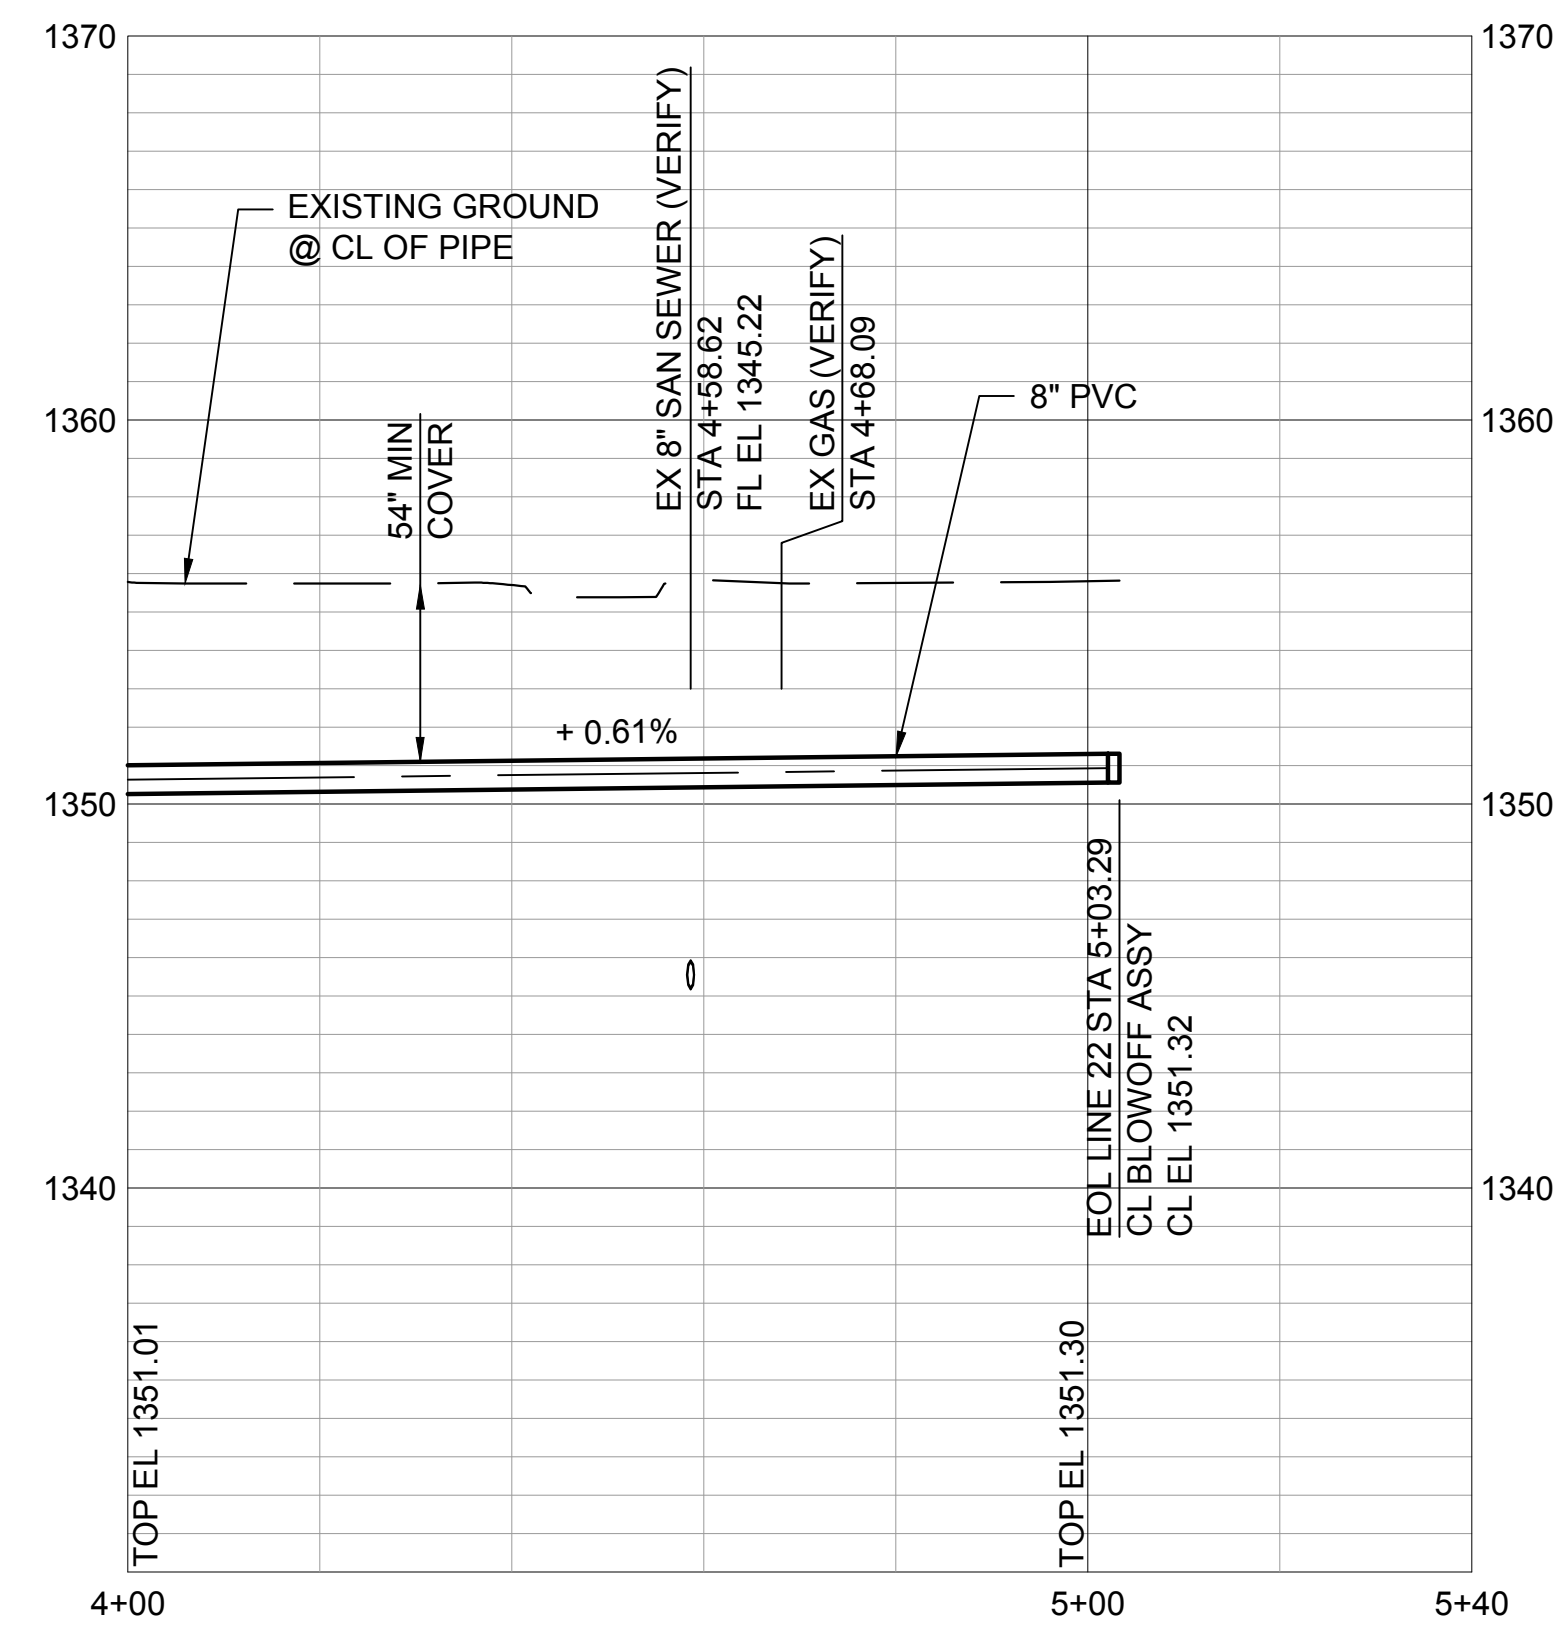

- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATER MAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATER MAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR SHALL POT HOLE EX WATER MAIN EVERY 250' PRIOR TO DIRECTIONAL DRILLING TO VERIFY LOCATION OF WATER MAIN ALONG LINE 22 (N LORRAINE ST).



9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 22 - N LORRAINE AVENUE**

project	77025	contract	448-90612
drawing	C057 - 0		rev. 0
sheet	64	of	101 sheets
file	LINE 22.dwg		



This document has been digitally signed.
05/08/15 9:53 AM

Name
Discipline
License No.