


Scale For Microfitting
Millimeters

Inches



- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR SHALL VERIFY METER LOCATION.

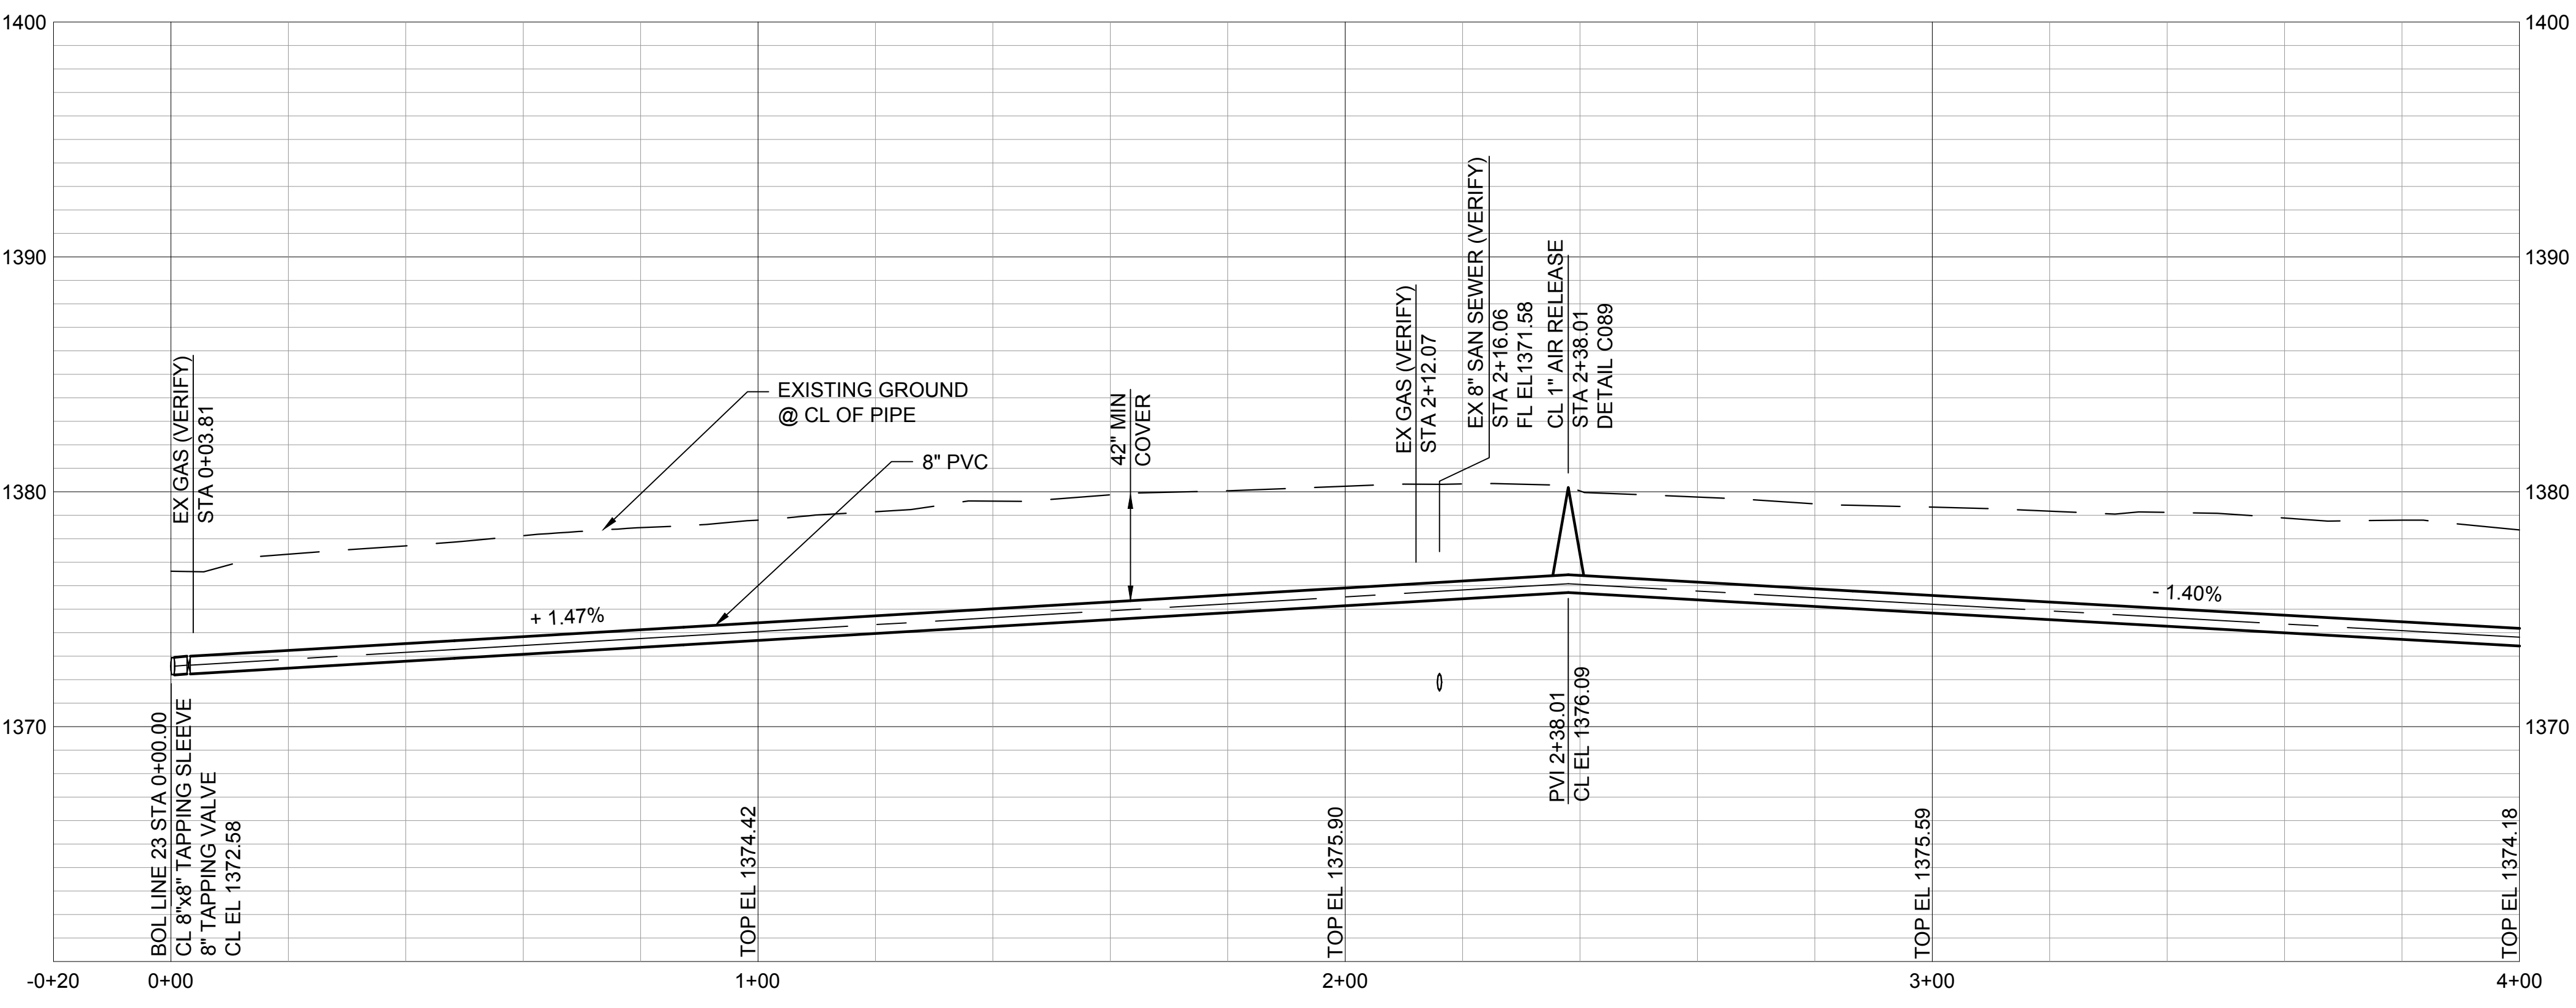

J:\WCHIT\77025 - Ethel\WMRCADD\06 Civil\LINE 23.dwg May 07, 2015 - 3:43pm mcdamette
COPYRIGHT © 2015 BURNS & MCDONNELL ENGINEERING COMPANY, INC.

Burns & McDonnell
SINCE 1898

9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date APRIL 24, 2014	detailed M. CHARRETTE
designed J. MCNIFF	checked S. WILSON



This document has been digitally signed.
05/08/15 9:53 AM

Name
Discipline
License No.

**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT**
LINE 23 - E 22ND STREET N
(BLUFF TO BELMONT)

project 77025	contract 448-90612
drawing C058	rev. 0
sheet 65 of 101 sheets	file LINE 23.dwg