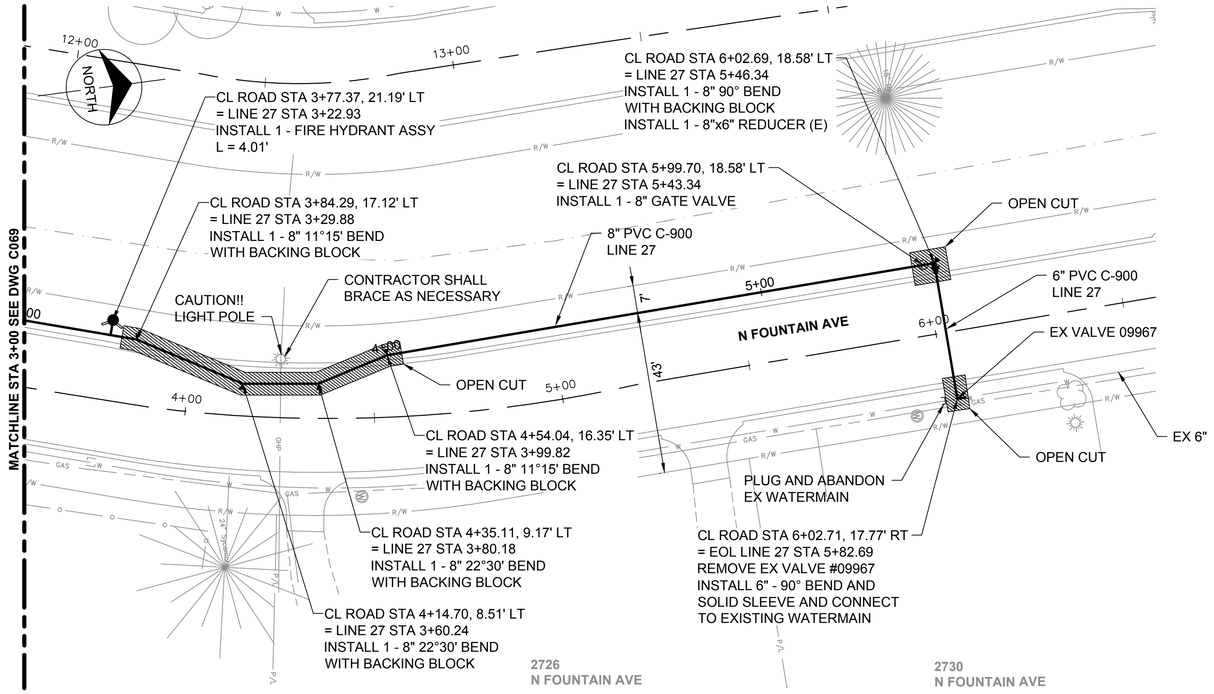

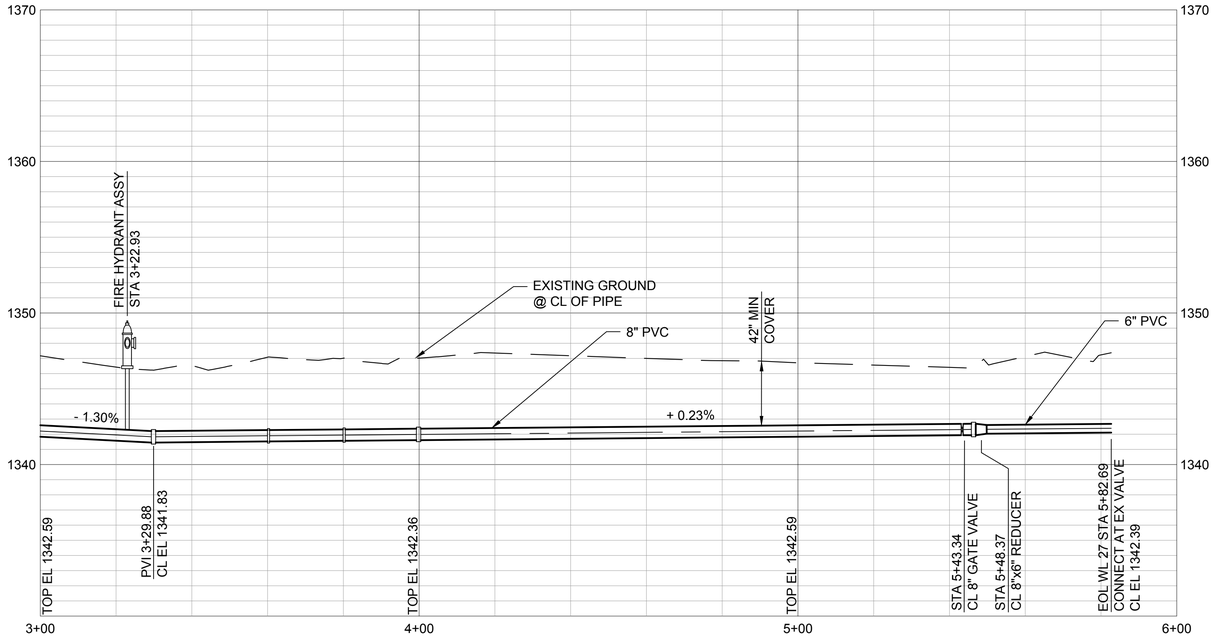

NOTE:

1. REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
2. INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
3. FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.

no.	date	by	ckd	description

HORIZ. 0 10' 20' 40' SCALE IN FEET

VERT. 0 5' 10' SCALE IN FEET

Burns & McDonnell SINCE 1898
9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	detailed
APRIL 24, 2014	M. CHARRETTE
designed	checked
J. MCNIFF	S. WILSON

City of Wichita, Kansas

ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 27 - N FOUNTAIN AVENUE
(EAST)

project	contract
77025	448-90612

drawing C070 – 0 rev.

sheet 77 of 100 sheets

file LINE 27.dwg

JULIE ANN MCNIFF LICENSED 21158 KANSAS PROFESSIONAL ENGINEER

This document has been digitally signed.
05/08/15 9:54 AM

Name
Discipline
License No.

Scale For Microfilming
Millimeters
Inches

J:\WICHITA\77025 - Ethel WMR\CADD\06_Civil\LINE 27.dwg May 07, 2015 - 4:01pm mcharrette
COPYRIGHT © 2015 BURNS & McDONNELL ENGINEERING COMPANY, INC.