



no.	date	by	ckd	description
-----	------	----	-----	-------------

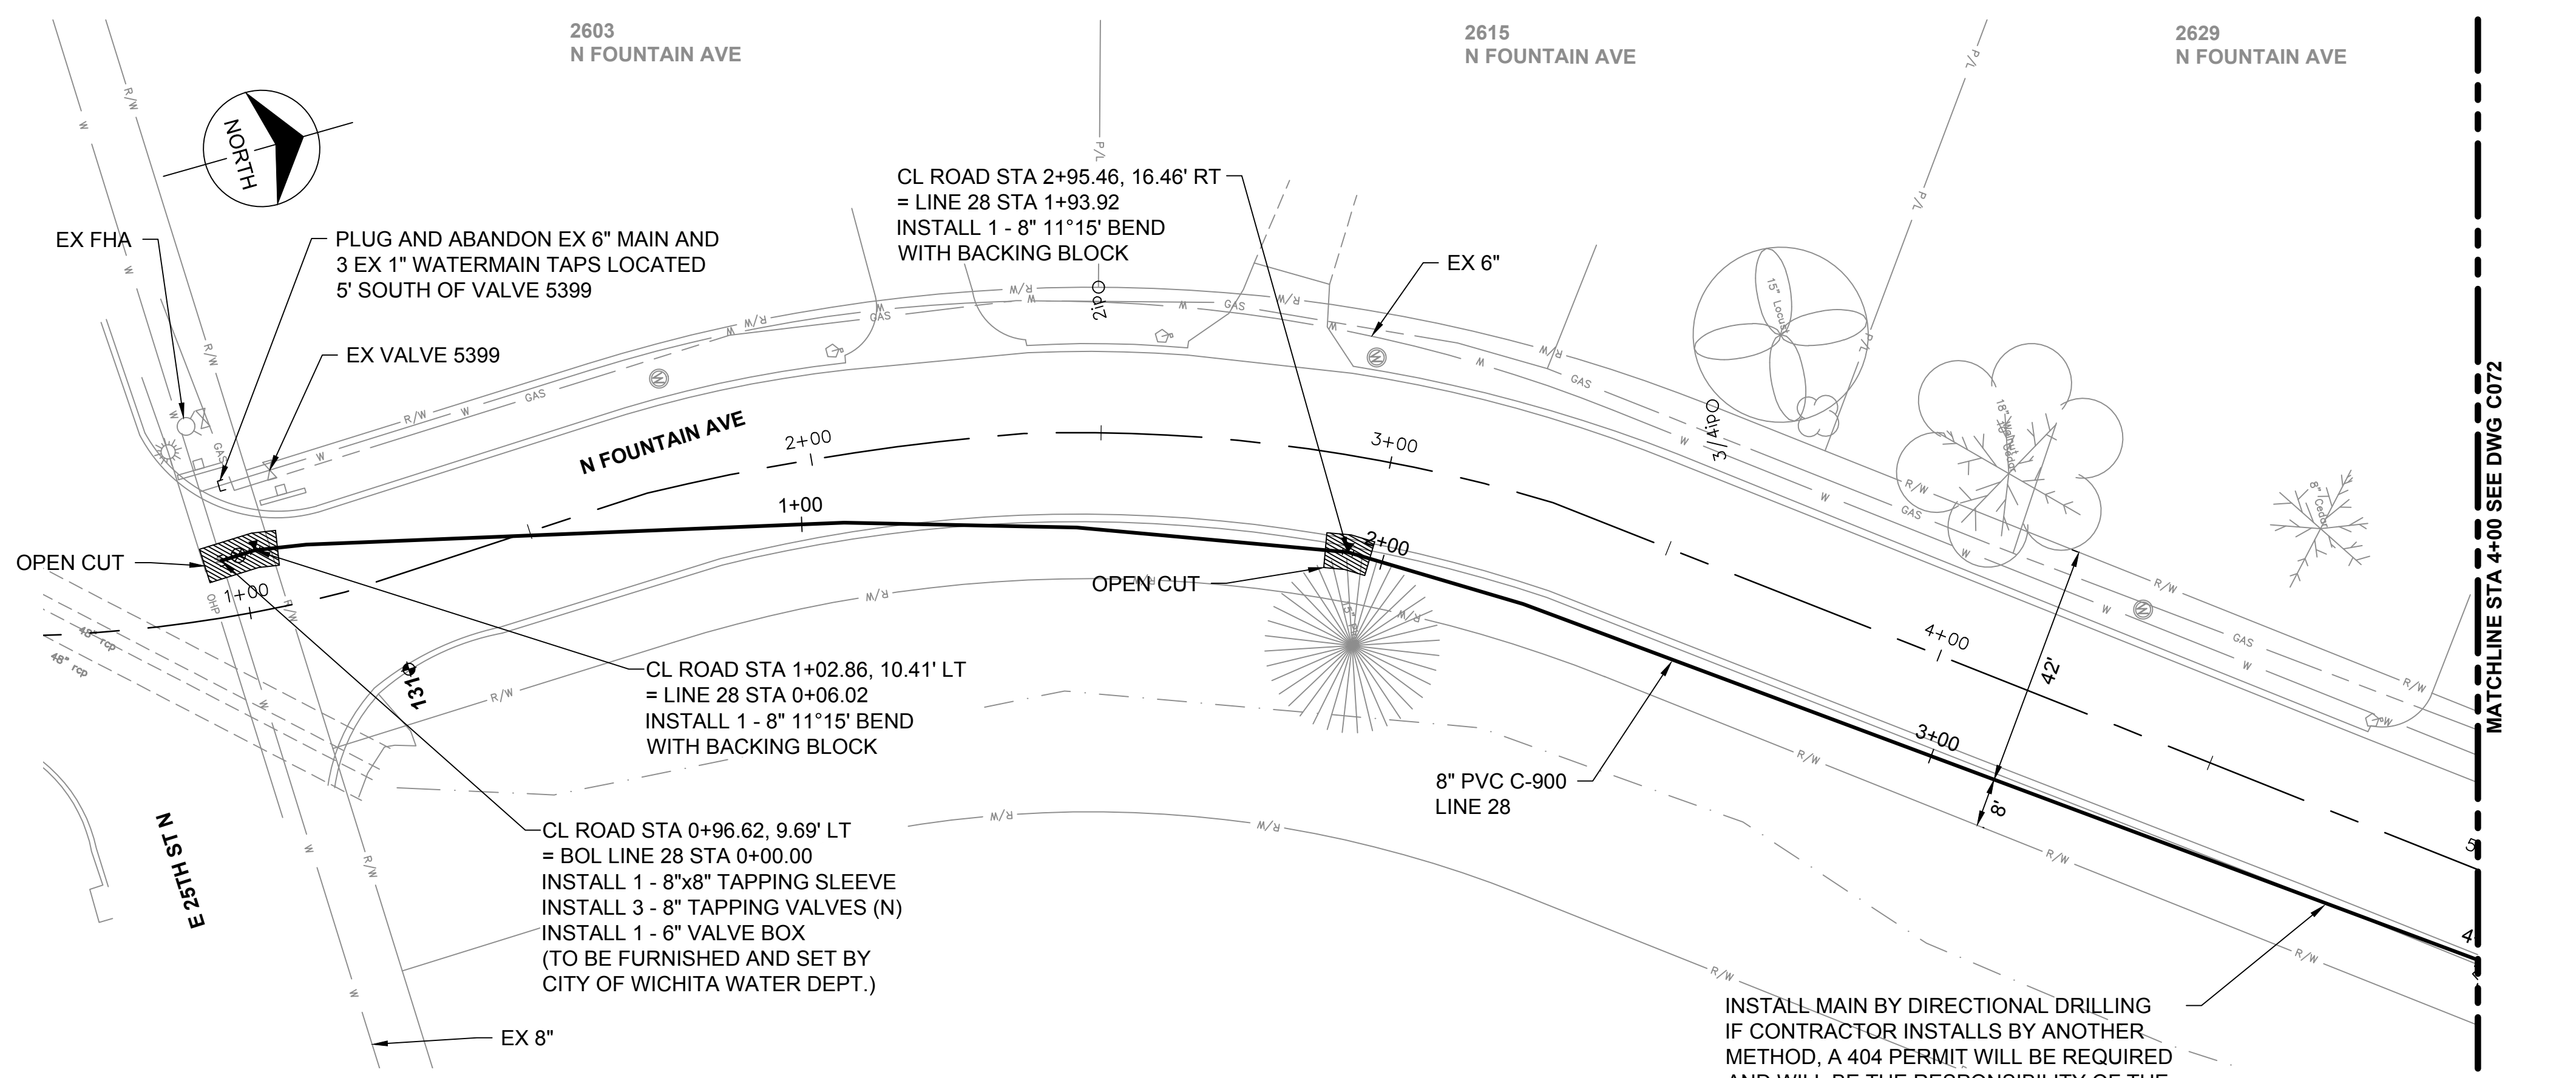



INSTALL MAIN BY DIRECTIONAL DRILLING IF CONTRACTOR INSTALLS BY ANOTHER METHOD, A 404 PERMIT WILL BE REQUIRED AND WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ACQUIRE AT NO ADDITIONAL COST TO THE OWNER

MATCHLINE STA 4+00 SEE DWG C072

Scale For Microfitting  
Millimeters  
Inches

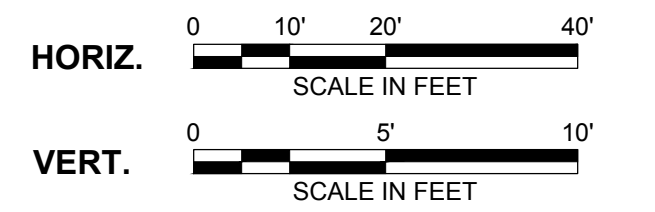

- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
  - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
  - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.

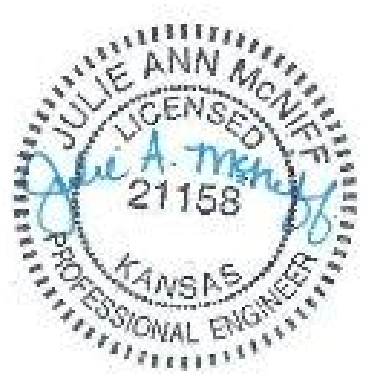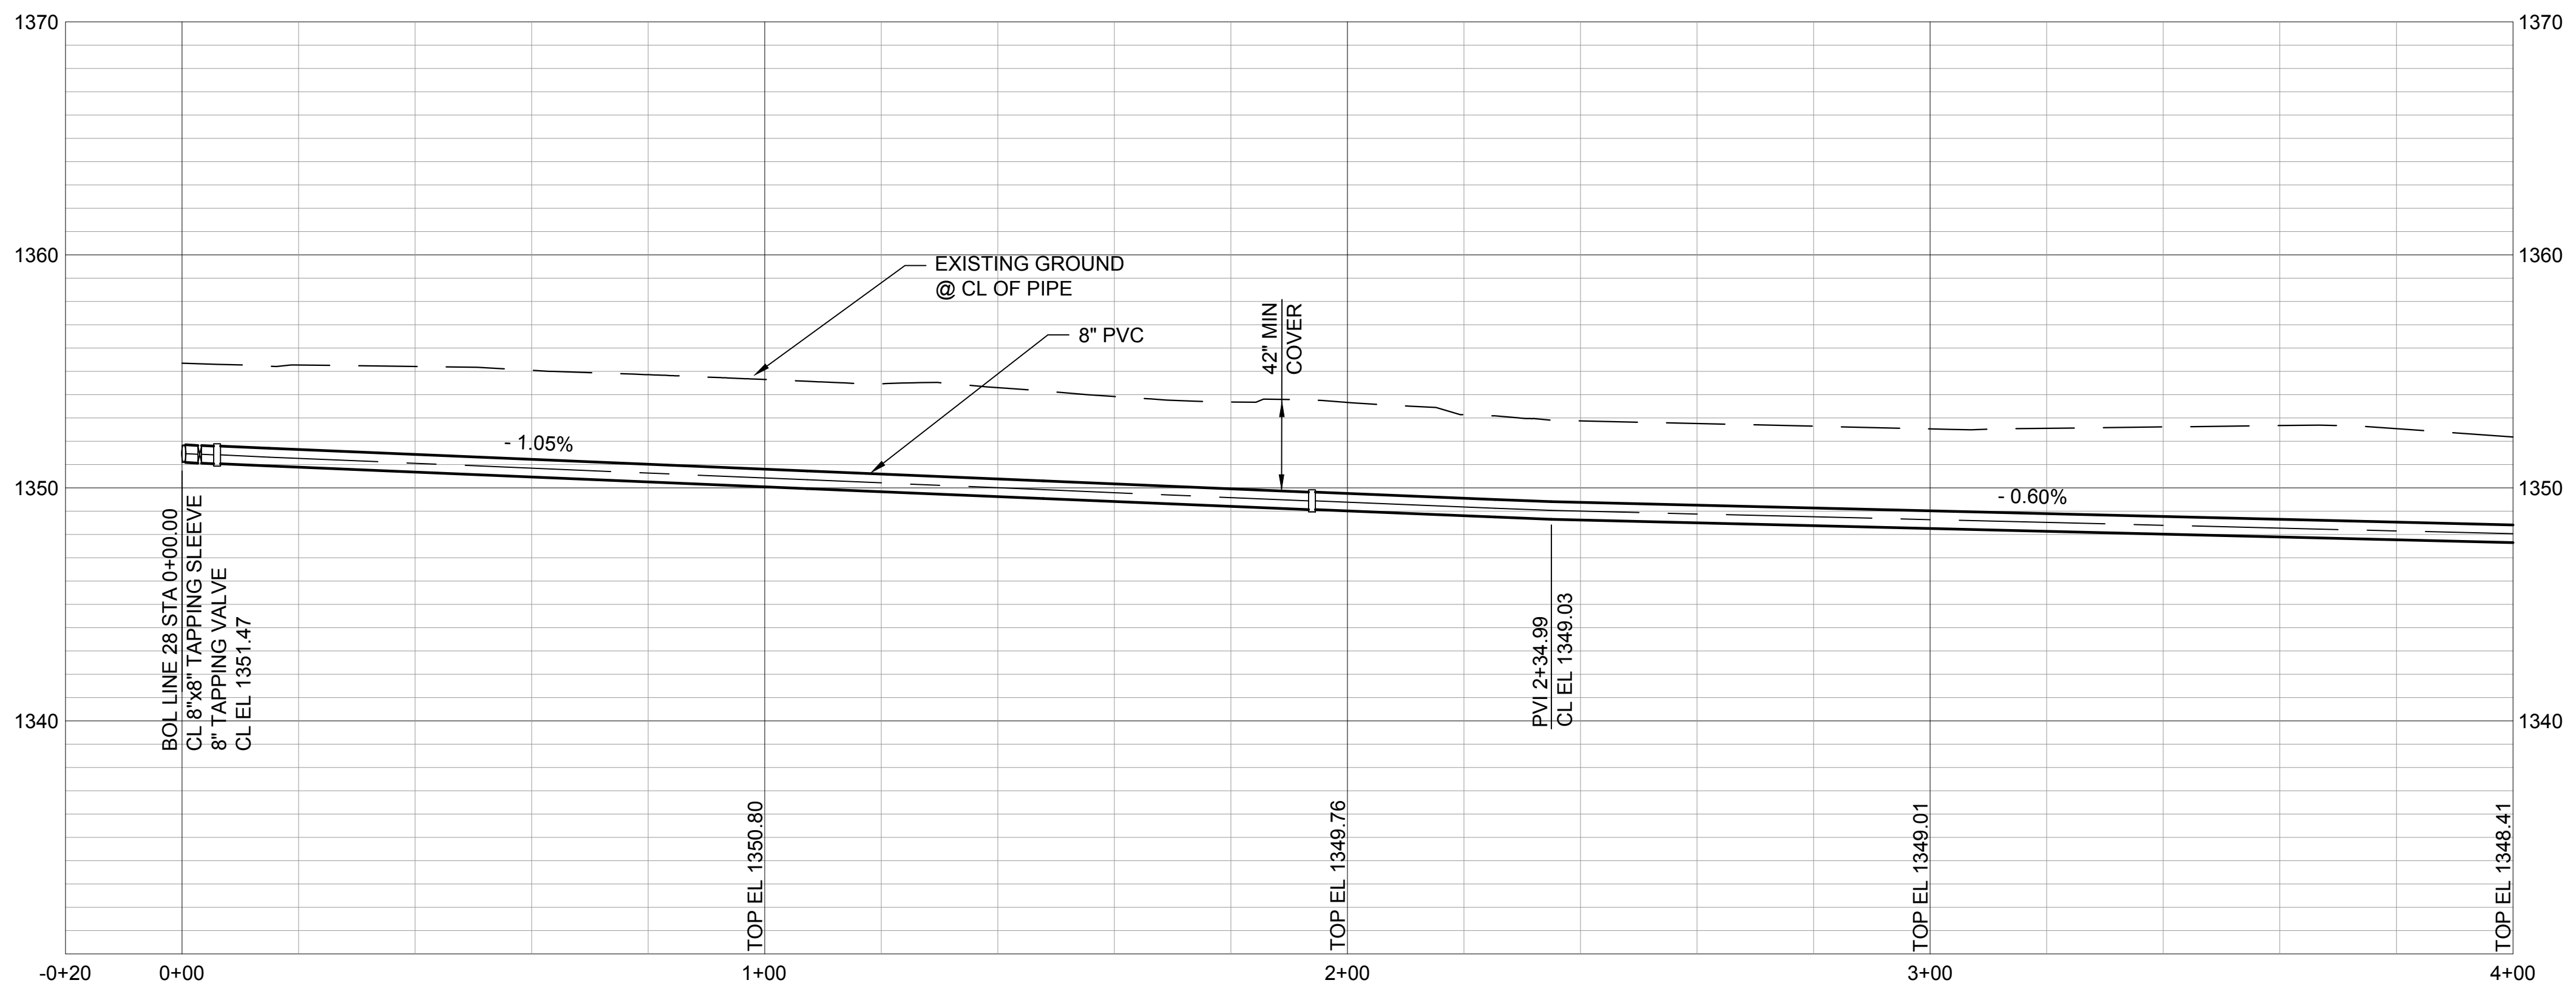

This document has been digitally signed.  
05/08/15 9:54 AM

Name  
Discipline  
License No.



9400 WARD PARKWAY  
KANSAS CITY, MO 64114  
816-333-9400  
LICENSEE NO. 000165

date APRIL 24, 2014	detailed M. CHARRETTE
designed J. MCNIFF	checked S. WILSON



**ETHEL NEIGHBORHOOD  
WATER MAIN REPLACEMENT  
LINE 28 - N FOUNTAIN AVENUE  
(WEST)**

project 77025	contract 448-90612
drawing <b>C071 - 0</b>	
sheet 78	of 101 sheets
file LINE 28.dwg	