



Scale For Microfitting  
Millimeters

Inches

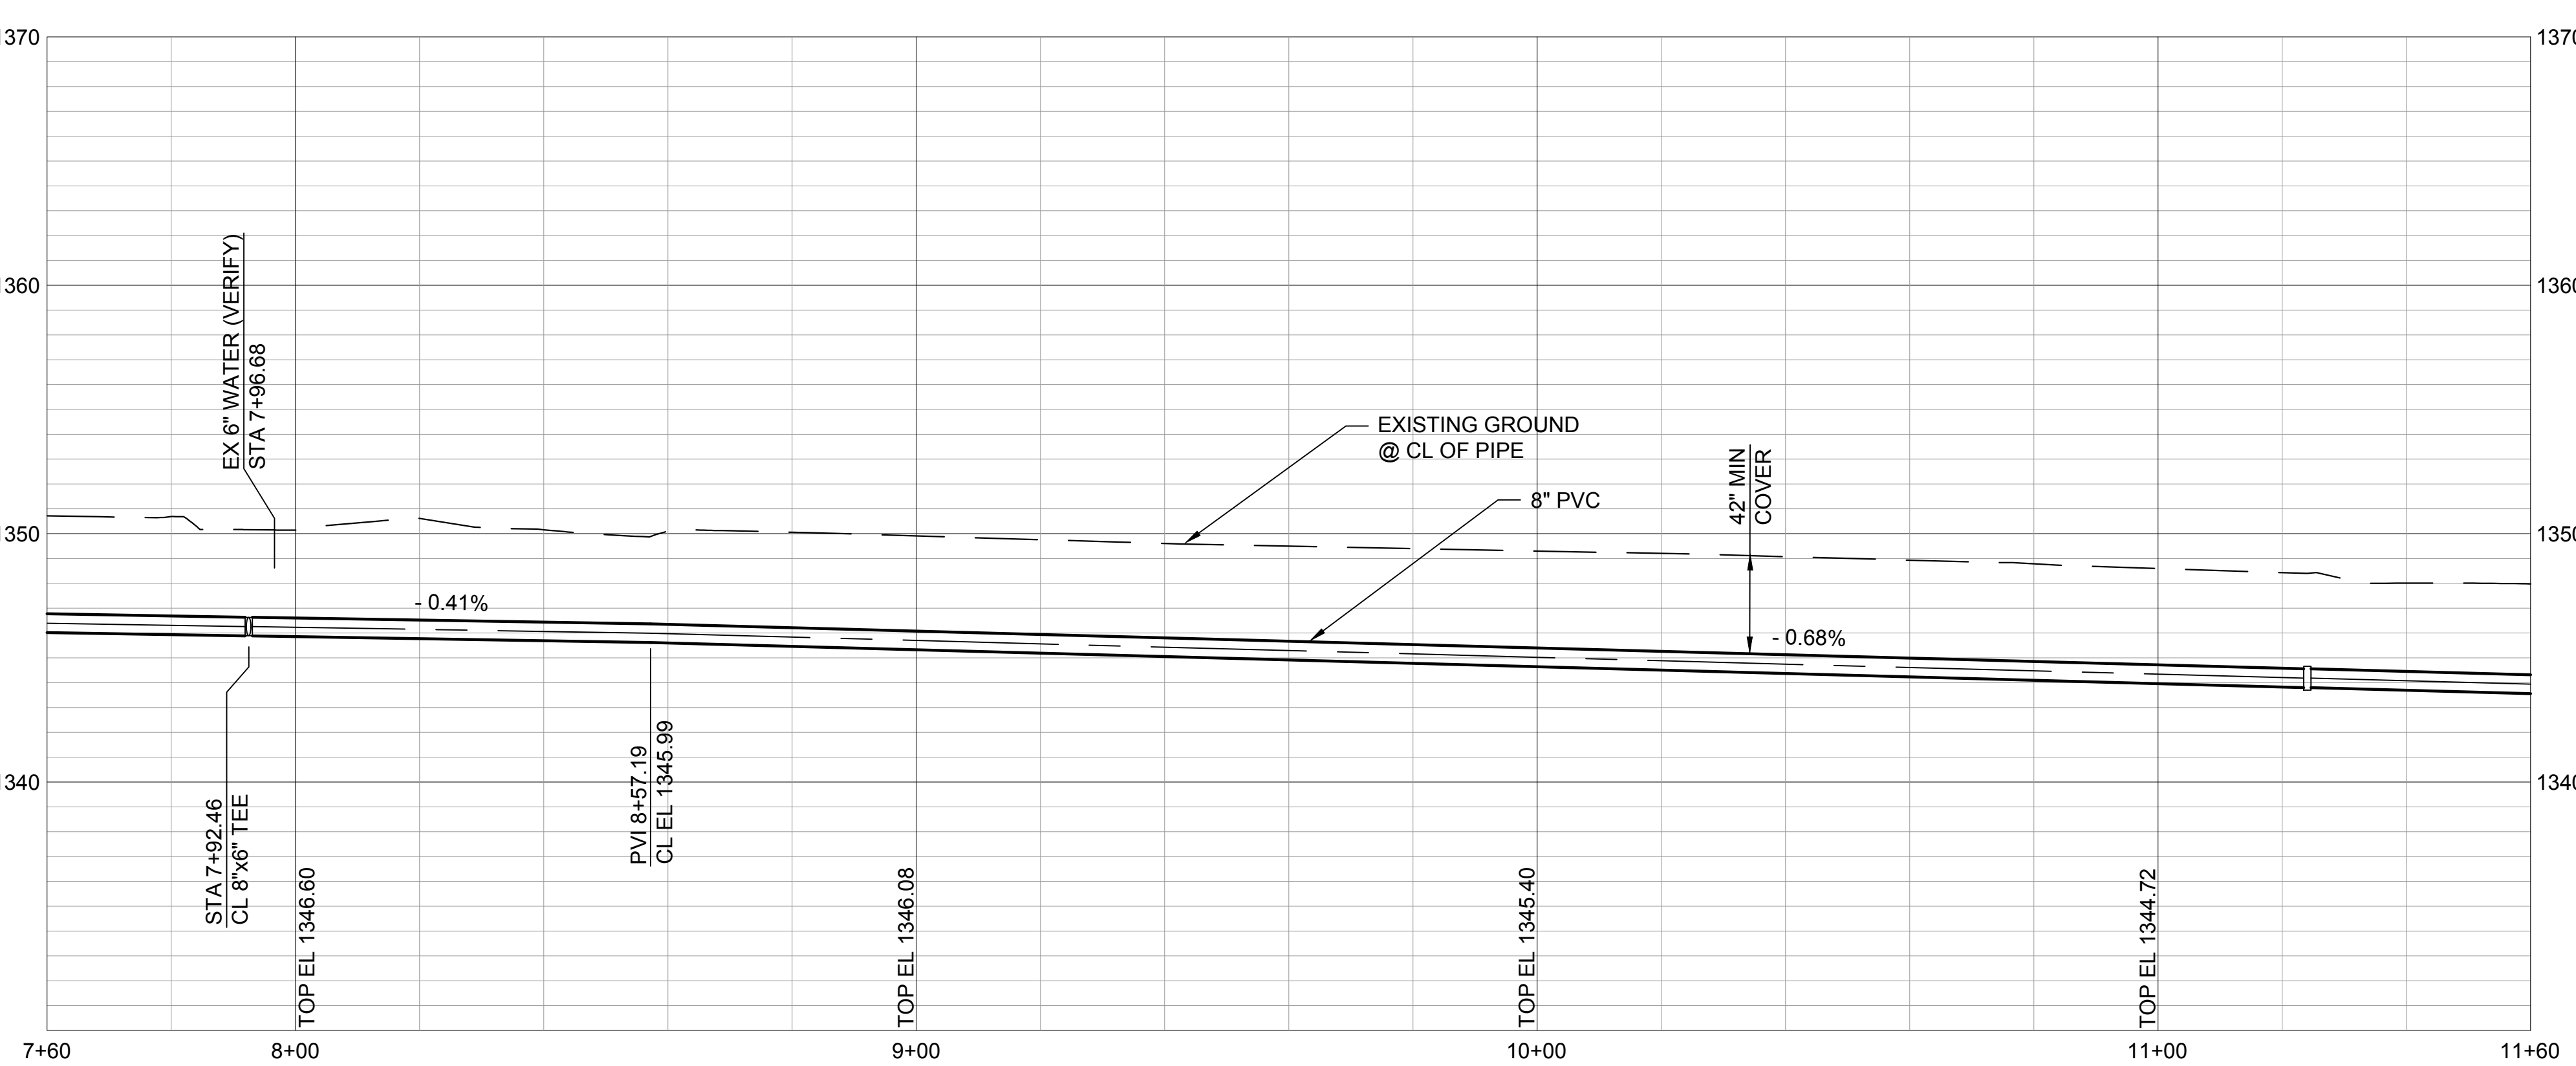

- NOTE:**
1. REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
  2. INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
  3. FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
  4. CONTRACTOR SHALL VERIFY METER LOCATION FOR 2709 N FOUNTAIN AVE.

no.	date	by	ckd	description
-----	------	----	-----	-------------

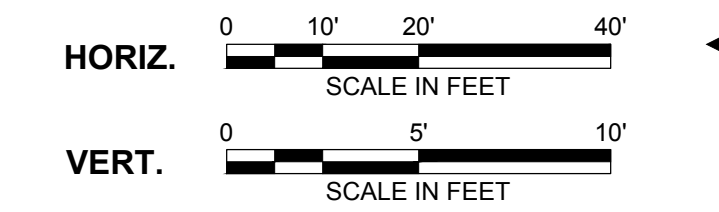

**Burns & McDonnell**  
SINCE 1898

9400 WARD PARKWAY  
KANSAS CITY, MO 64114  
816-333-9400  
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD  
WATER MAIN REPLACEMENT  
LINE 28 - N FOUNTAIN AVENUE  
(WEST)**

project	77025	contract	448-90612
drawing	rev. <b>C073 - 0</b>		
sheet	80	of	101 sheets
file	LINE 28.dwg		

This document has been digitally signed.  
05/08/15 9:54 AM

Name  
Discipline  
License No.