

Scale For Microfitting
Millimeters
Inches


no.	date	by	ckd	description

HORIZ. 0 10' 20' 40'


SCALE IN FEET

VERT. 0 5' 10'

SCALE IN FEET

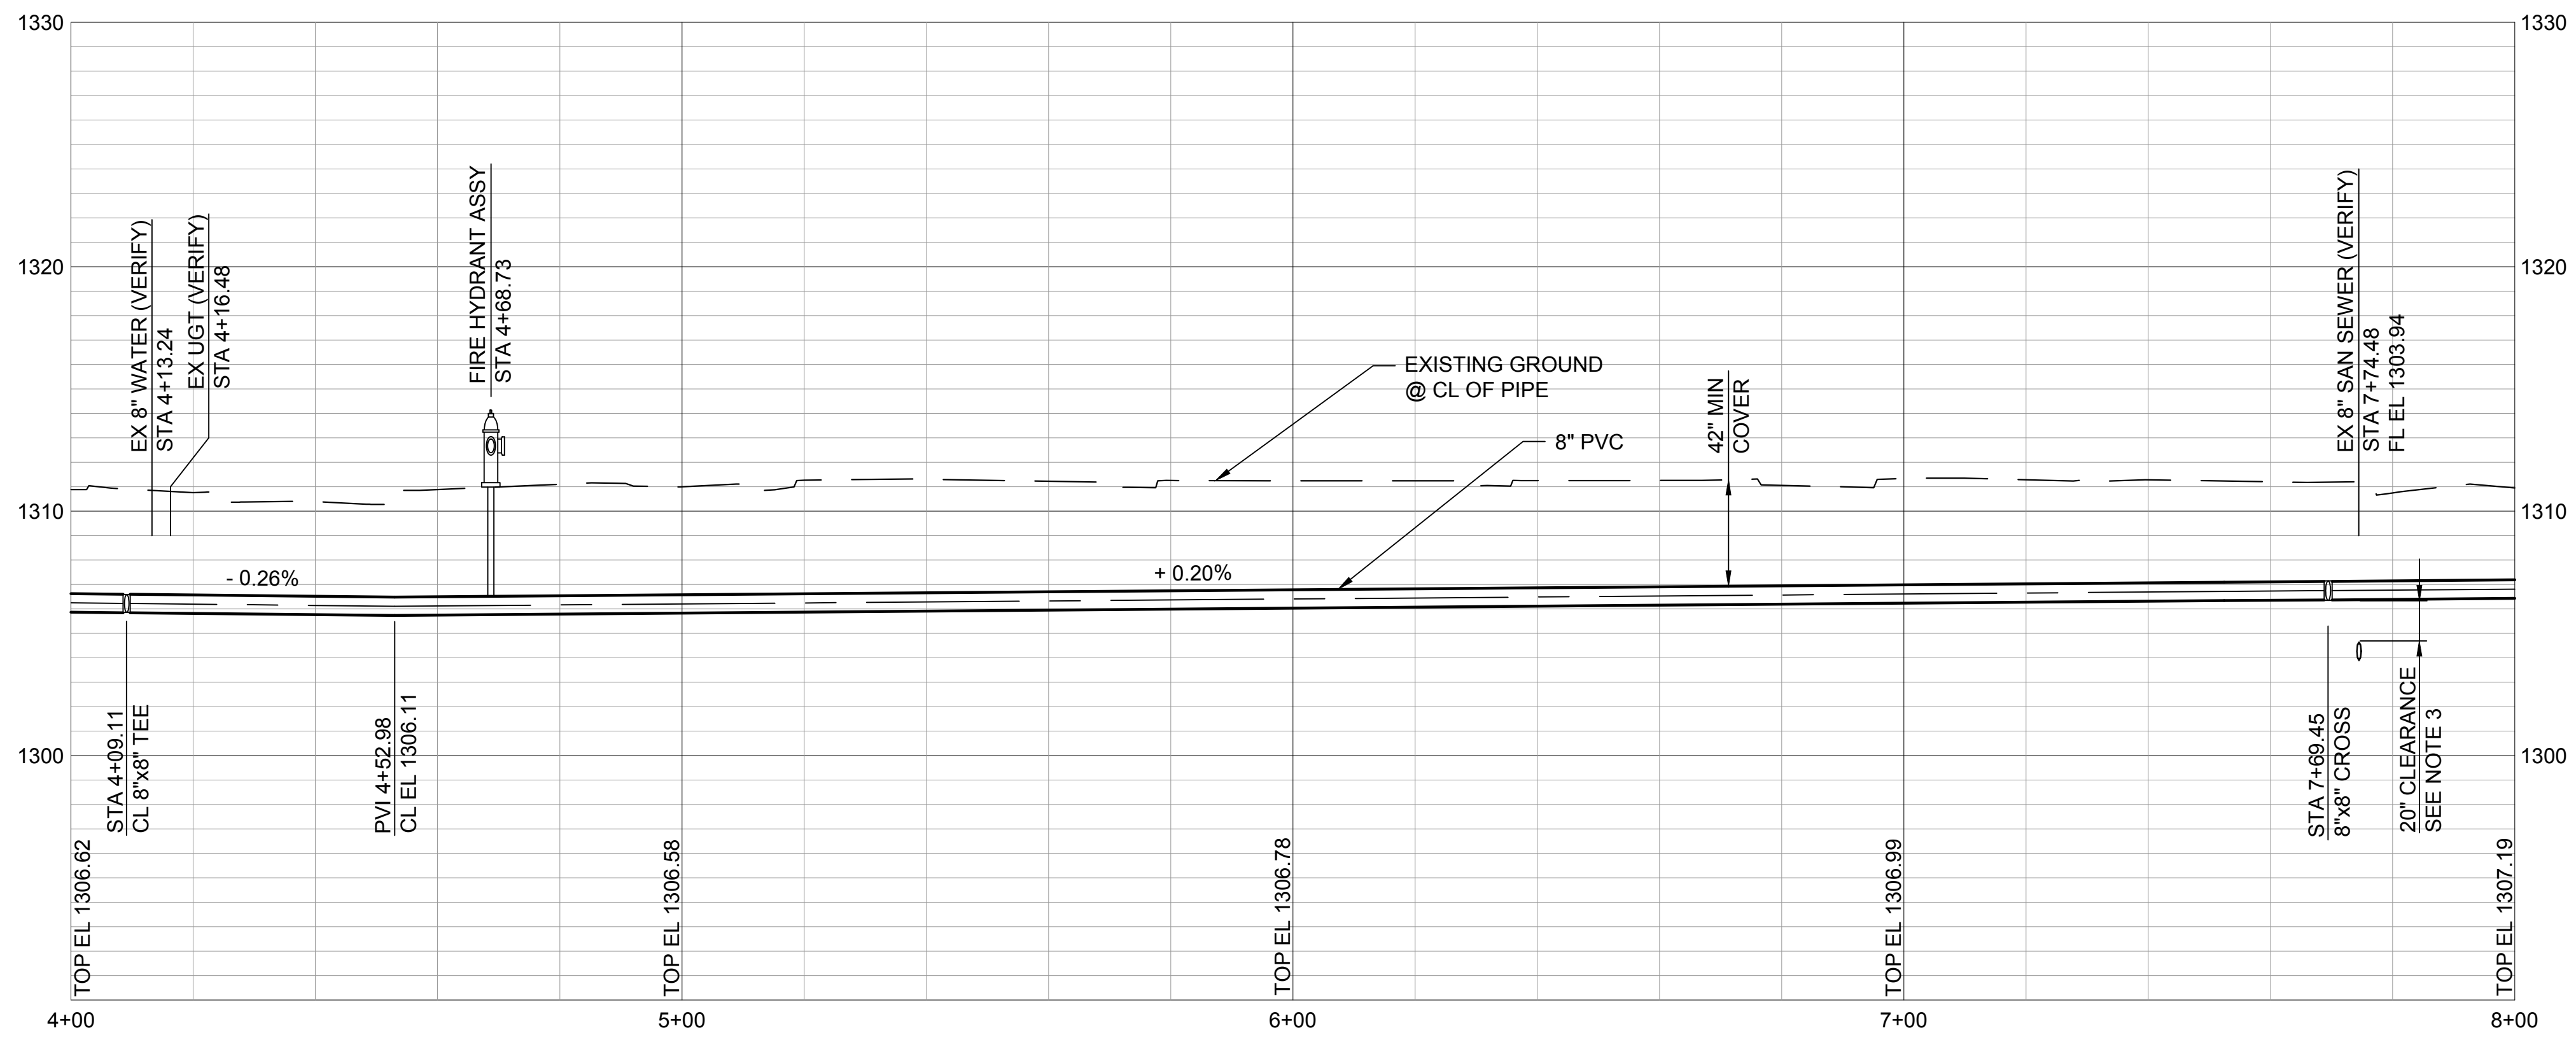

- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR SHALL VERIFY METER LOCATION NOT PICKED UP BY SURVEY.




9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date APRIL 24, 2014	detailed M. CHARRETTE
designed J. MCNIFF	checked S. WILSON



This document has been digitally signed.
05/08/15 9:38 AM

Name
Discipline
License No.



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT**
LINE 1 - N KANSAS AVENUE
(21ST TO 24TH)

project 77025	contract 448-90612	
drawing C002 - 0		
sheet 09	of 101	sheets
file LINE 1.dwg		