
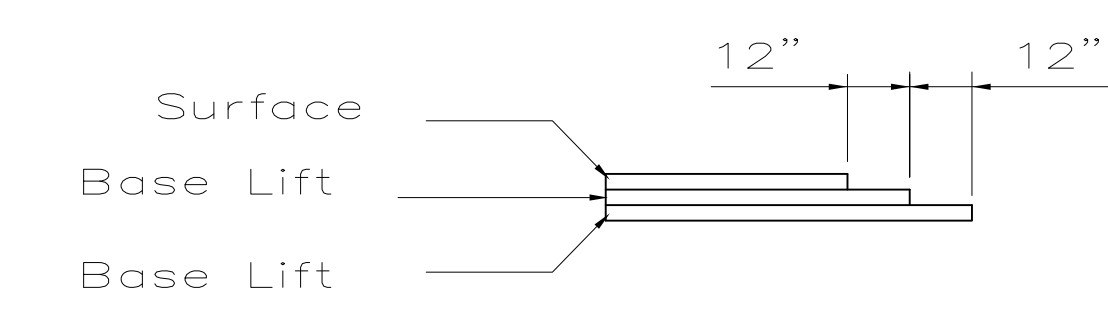
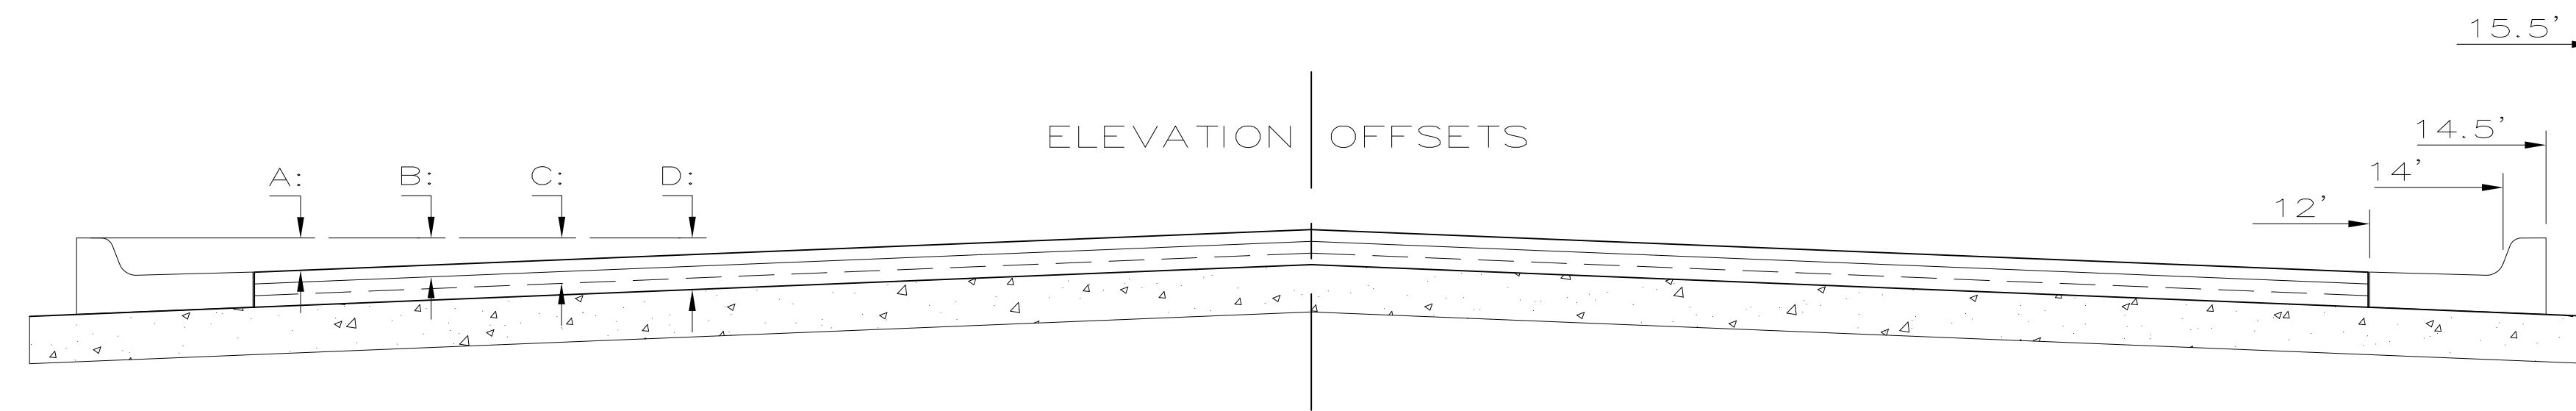


# TYPICAL 7" PAVEMENT W/ REINFORCED CRUSHED ROCK BASE

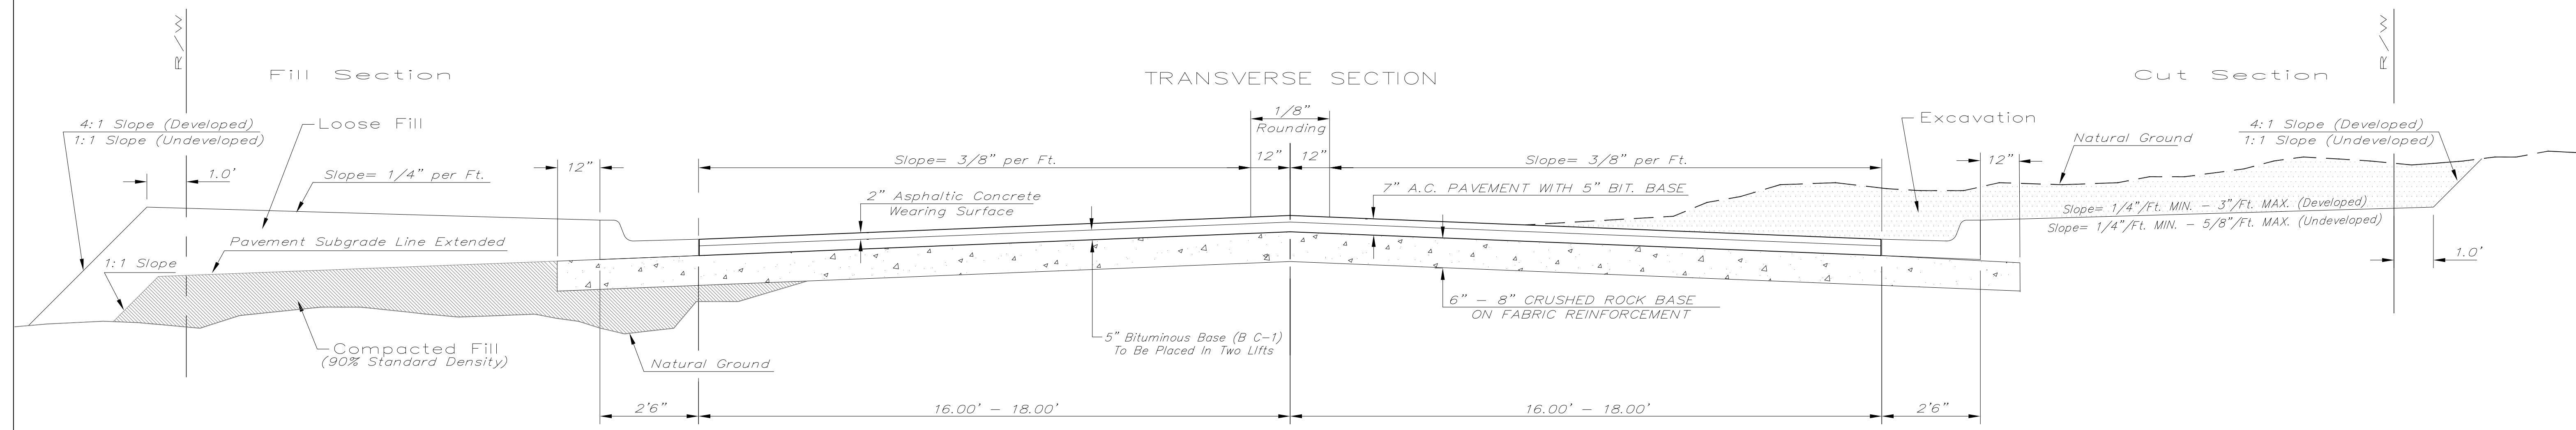

Transverse construction joints shall be constructed in flexible base pavements at locations where pavement joins existing flexible base pavement as shown by the detail. All costs associated with the construction of the transverse joint shall be included in the bid price for Square Yards 7" ASPHALTIC CONCRETE (5" BITUMINOUS BASE).

## General Notes

FABRIC BASE REINFORCEMENT SHALL BE B X 1100 GEOGRID AS MANUFACTURED BY TENSAR CORPORATION OR APPROVED EQUAL. FABRIC BASE REINFORCEMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CRUSHED ROCK SHALL BE UNIFORMLY GRADED FROM 1-1/2" MAXIMUM SIZE TO NOT MORE THAN 10% PASSING A NO. 200 SIEVE. ROCK QUALITY SHALL BE THE SAME AS SPECIFIED FOR COARSE AGGREGATE FOR CONCRETE MIXES.

ROCK BASE IS TO BE COMPACTED AND SMOOTHED WITH A STEEL FACED ROLLER PRIOR TO PLACEMENT OF ASPHALT. TACK COAT WILL NOT BE APPLIED TO ROCK BASE.

A TACK COAT OF EMULSIFIED ASPHALT (SC-1H OR CSS-1H) SHALL BE APPLIED AT AN APPROXIMATE RATE OF 0.05 GALLONS PER SQUARE YARD BETWEEN EACH LIFT OF ASPHALTIC MATERIAL.

BITUMINOUS BASE AND ASPHALTIC CONCRETE WEARING SURFACE SHALL BE PLACED WITH A LAYDOWN MACHINE HAVING AUTOMATIC CONTROLS FOR LINE AND GRADE.

CONSTRUCTION JOINTS IN EACH LIFT SHALL BE STAGGERED A MINIMUM DISTANCE OF ONE (1) FOOT FROM JOINTS IN PRECEDING LIFTS AND PLACED SO THAT A JOINT WILL BE CONSTRUCTED ON THE CENTERLINE OF THE TOP LIFT.

THE ASPHALTIC CONCRETE PAVEMENT BETWEEN THE COMBINED CURB AND GUTTER SHALL BE PAID AS SQUARE YARDS OF 7" ASPHALTIC CONCRETE (5" BITUMINOUS BASE.)

Type II - Combined Curb & Gutter (6 5/8")

	Distance from Back of Curb toward Center Line														
	12" beyond	Back of Curb	2.5	4.5	6.5	8.5	10.5	12.5	14.5	15.5	17.5	17.5	18.5	18.5	20.5
A: Top of Curbs to Top of Surface Lift	-	-	0.50	0.44	0.38	0.31	0.25	0.19	0.13	0.09	0.03	0.04	0.00	0.01	-0.05
B: Top of Curbs to Top of Upper Base Lift	-	-	0.67	0.60	0.54	0.48	0.42	0.35	0.29	0.26	0.20	0.20	0.17	0.17	0.11
C: Top of Curbs to Top of Lower Base Lift	-	-	0.83	0.77	0.71	0.65	0.58	0.52	0.46	0.43	0.36	0.36	0.33	0.33	0.28
D: Top of Curbs to Top of Rock Base	1.19	1.16	1.08	1.02	0.96	0.90	0.83	0.77	0.71	0.68	0.61	0.61	0.58	0.58	0.53

CL of 35' pavement      CL of 37' CL of 41' pavement pavement

Type I - Combined Curb & Gutter (6")

	Distance from Back of Curb toward Center Line														
	12" beyond	Back of Curb	2.5	4.5	6.5	8.5	10.5	12.5	14.5	15.5	17.5	17.5	18.5	18.5	20.5
A: Top of Curbs to Top of Surface Lift	-	-	0.35	0.29	0.23	0.17	0.10	0.04	-0.02	-0.05	-0.11	-0.10	-0.15	-0.14	-0.20
B: Top of Curbs to Top of Upper Base Lift	-	-	0.52	0.46	0.40	0.33	0.27	0.21	0.15	0.11	0.05	0.05	0.02	0.02	-0.04
C: Top of Curbs to Top of Lower Base Lift	-	-	0.69	0.63	0.56	0.50	0.44	0.38	0.31	0.28	0.22	0.22	0.19	0.19	0.13
D: Top of Curbs to Top of Subgrade	1.05	1.02	0.94	0.88	0.81	0.75	0.69	0.63	0.56	0.53	0.47	0.47	0.44	0.44	0.38

CL of 35' pavement      CL of 37' CL of 41' pavement pavement

**7" ASPHALTIC CONCRETE ON REINFORCED CRUSHED ROCK BASE**

CITY ENGINEER  
**GARY JANZEN, P.E.**

PROJECT NUMBER	OCA NUMBER	DATE
		03/2002
CITY ENGINEER'S OFFICE		SHEET
CITY HALL - SEVENTH FLOOR 455 NORTH MAIN STREET WICHITA, KANSAS 67202-1620 (316) 268-4501		2.0

PUBLIC WORKS & UTILITIES ENGINEERING DIVISION