

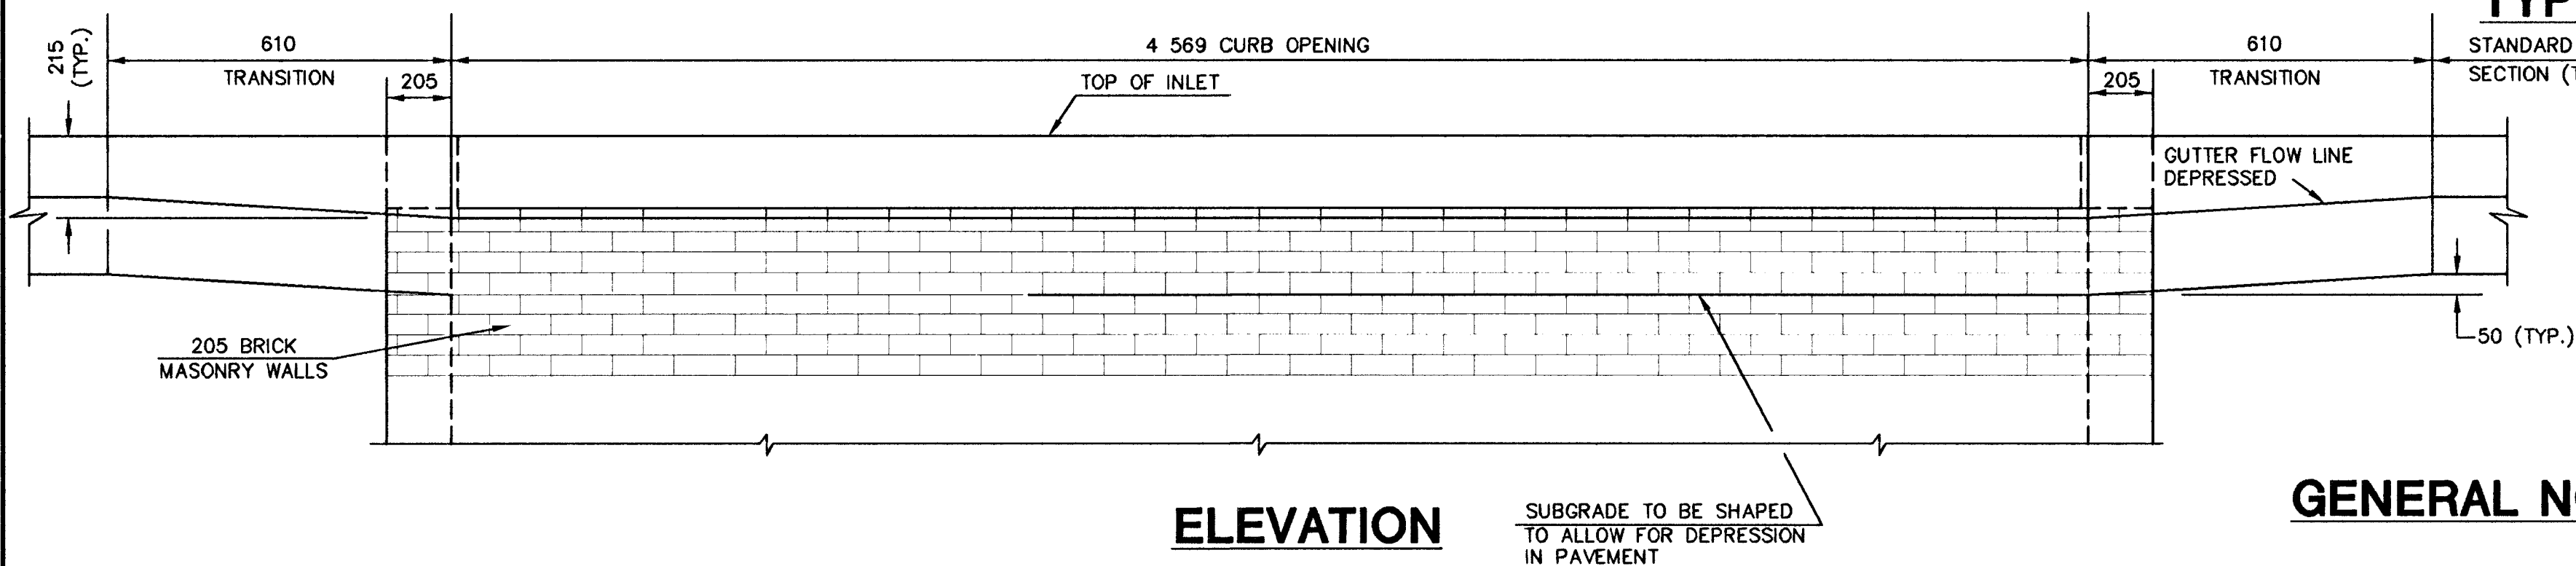
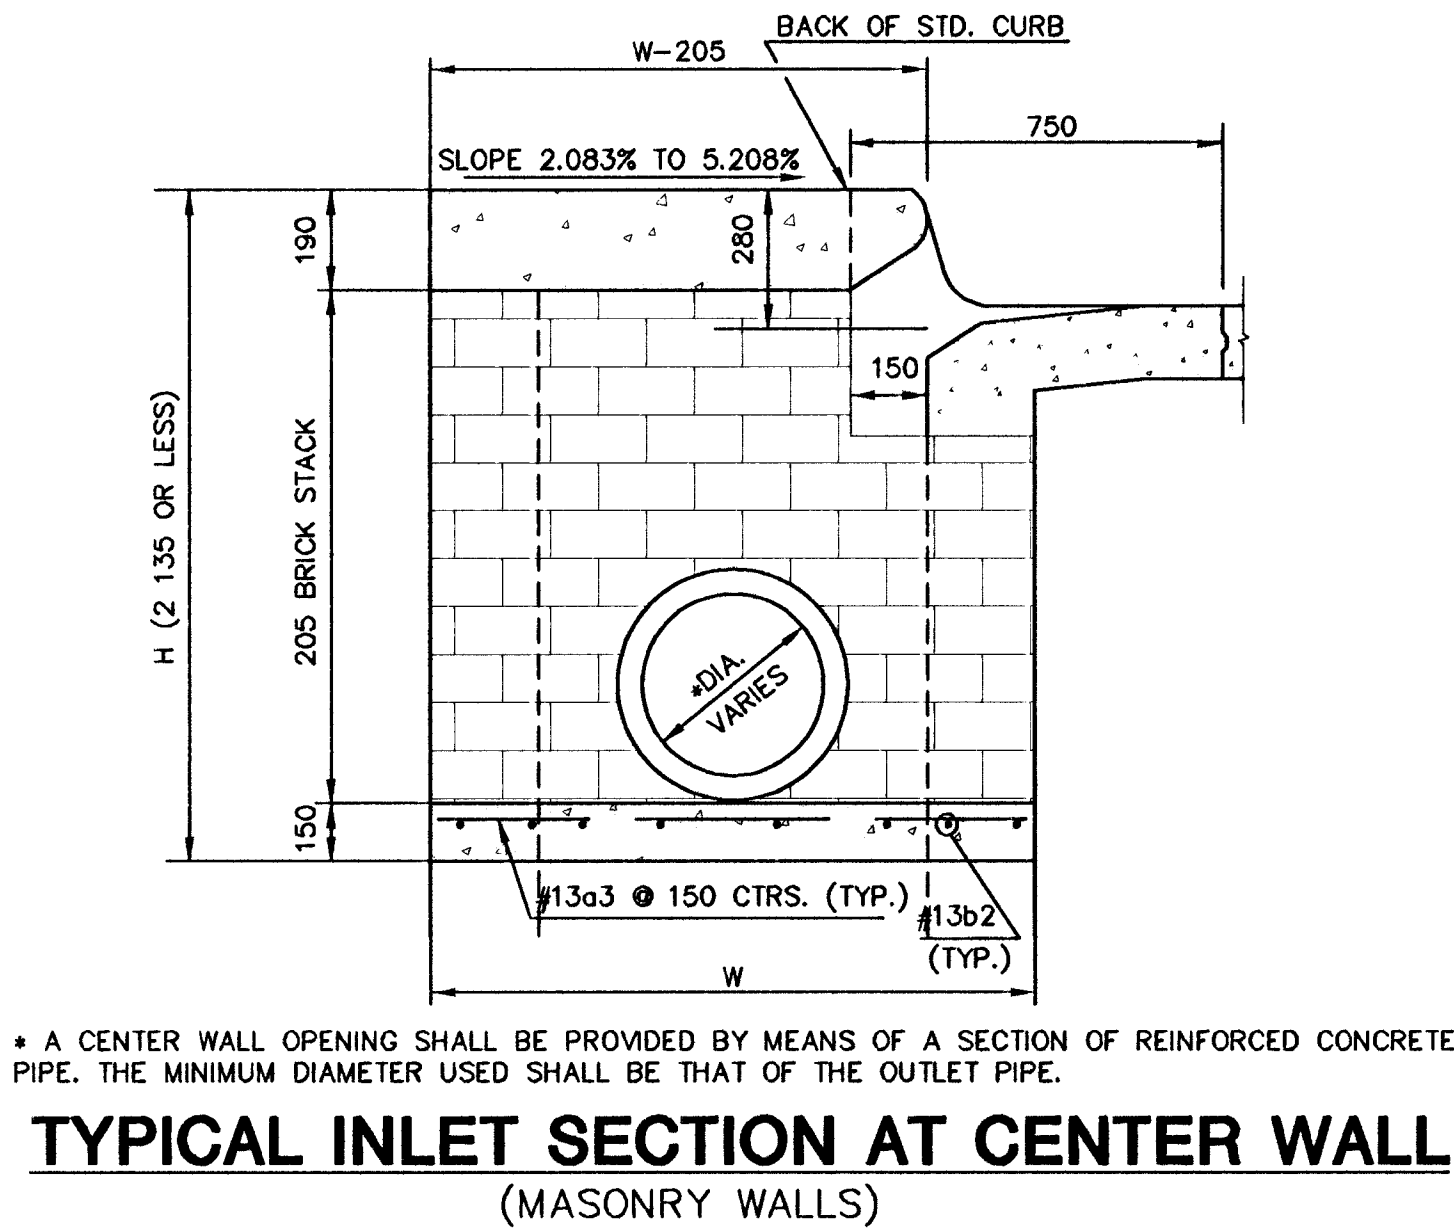
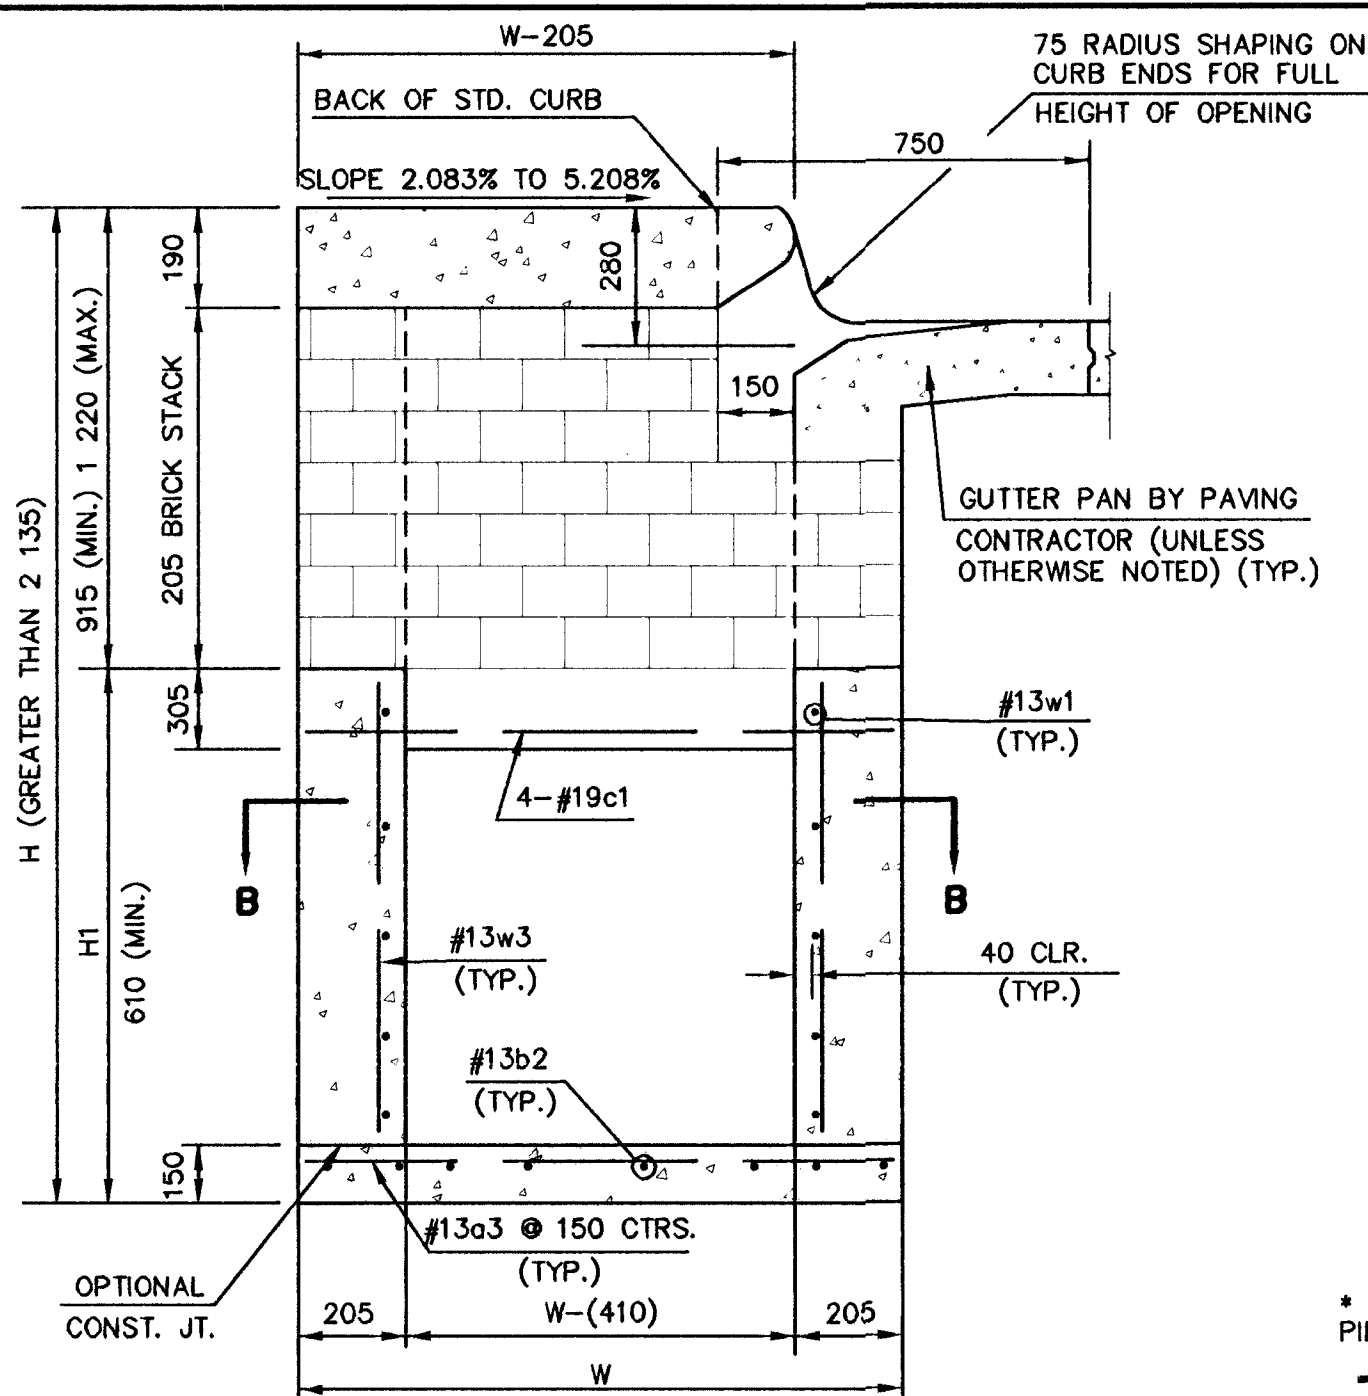
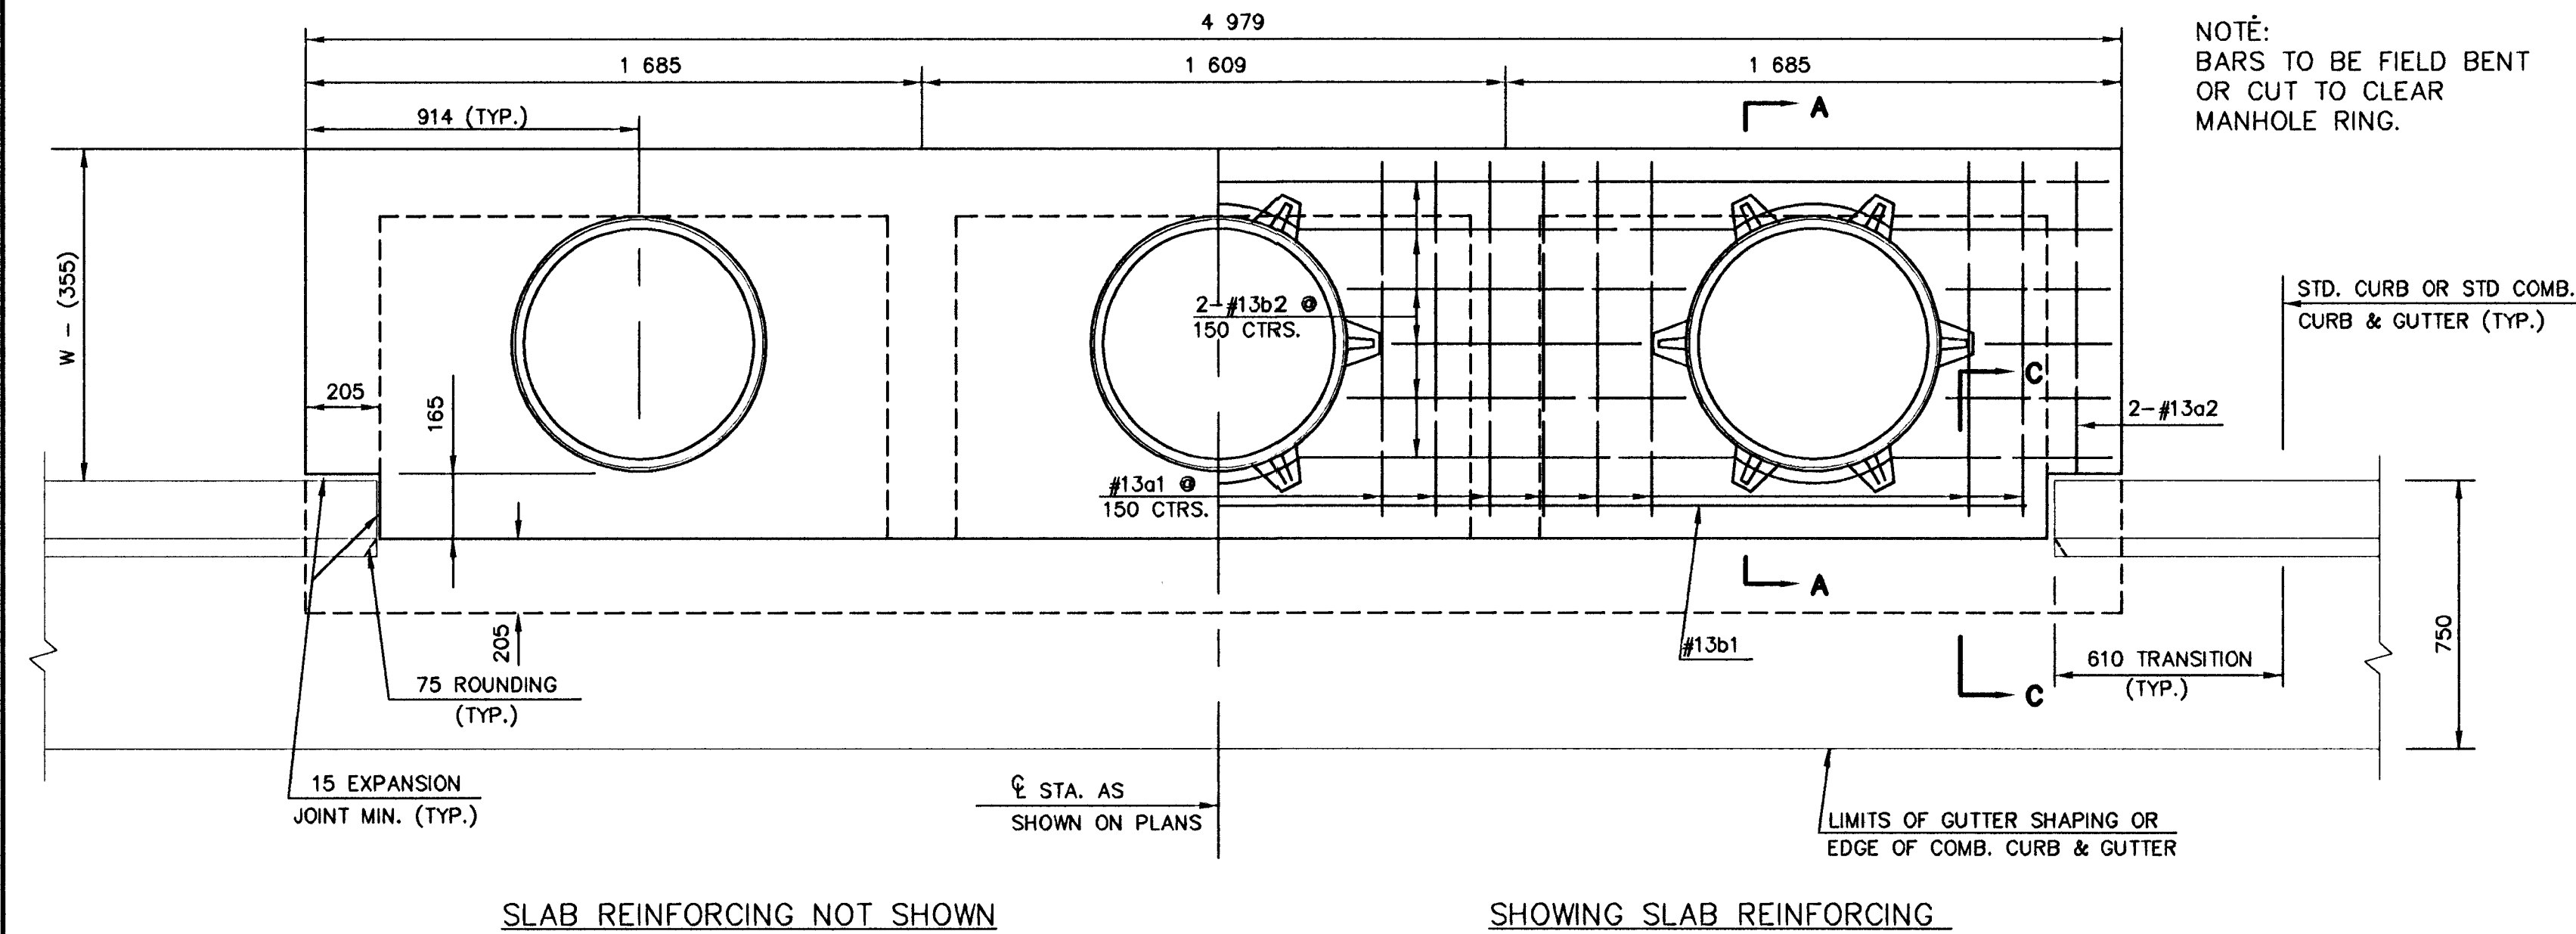
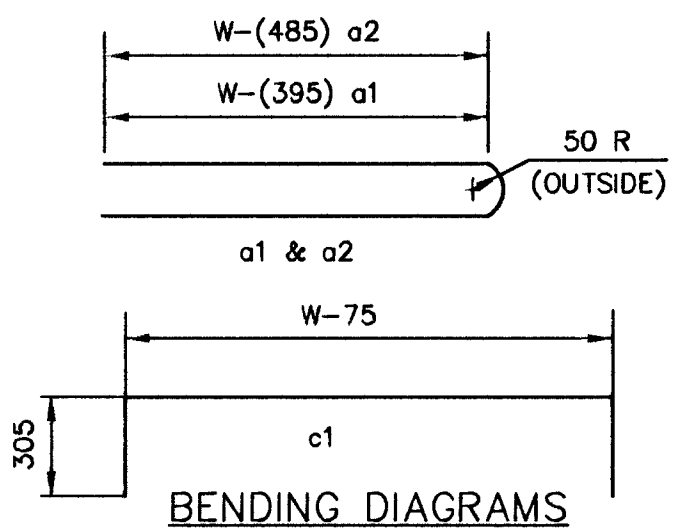
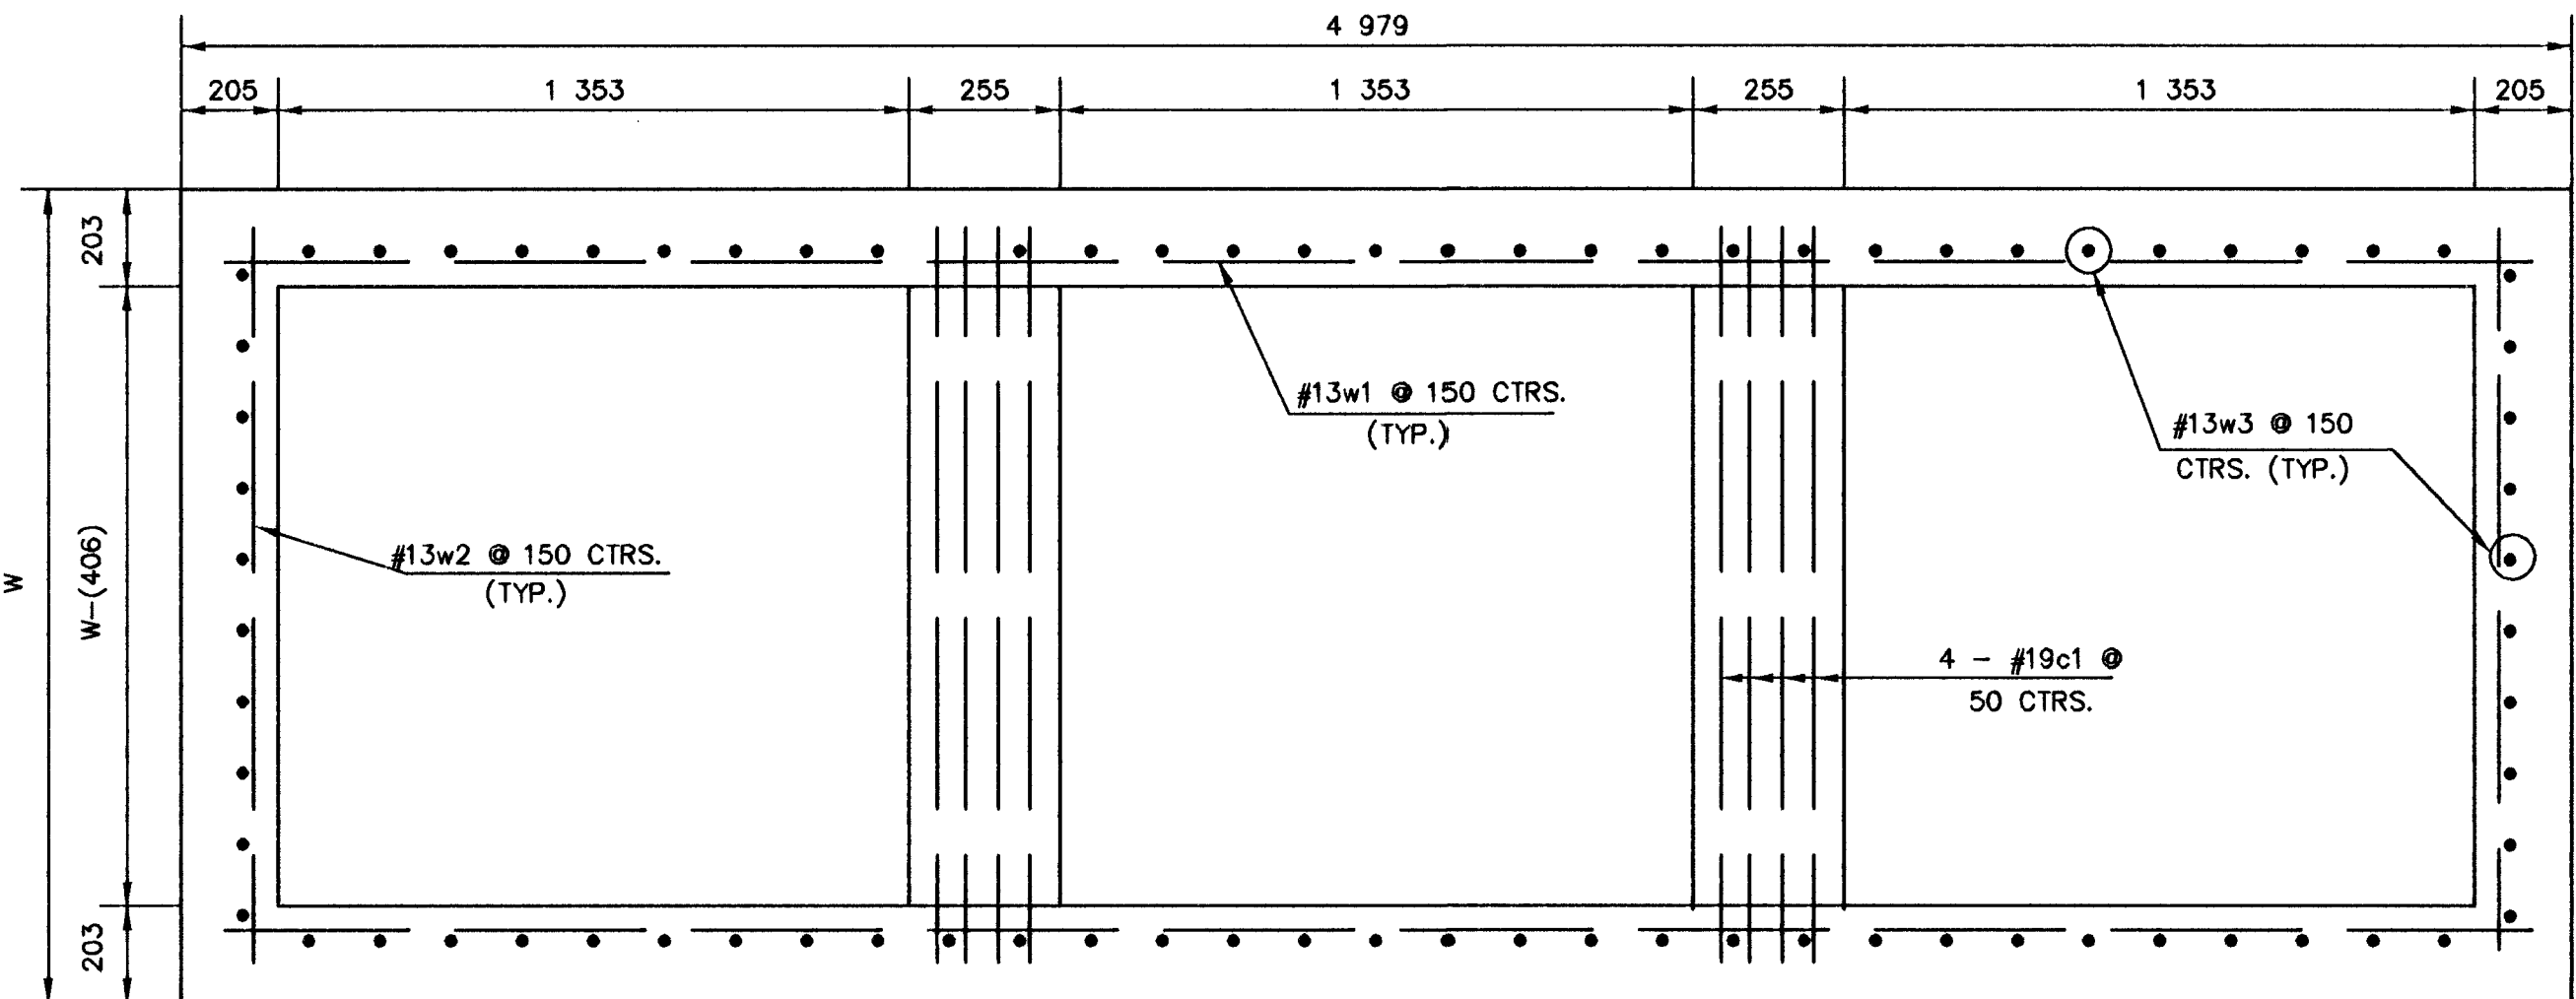


FHWA REG NO	STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
7	KANSAS	87N-0116-01	1999	40	110

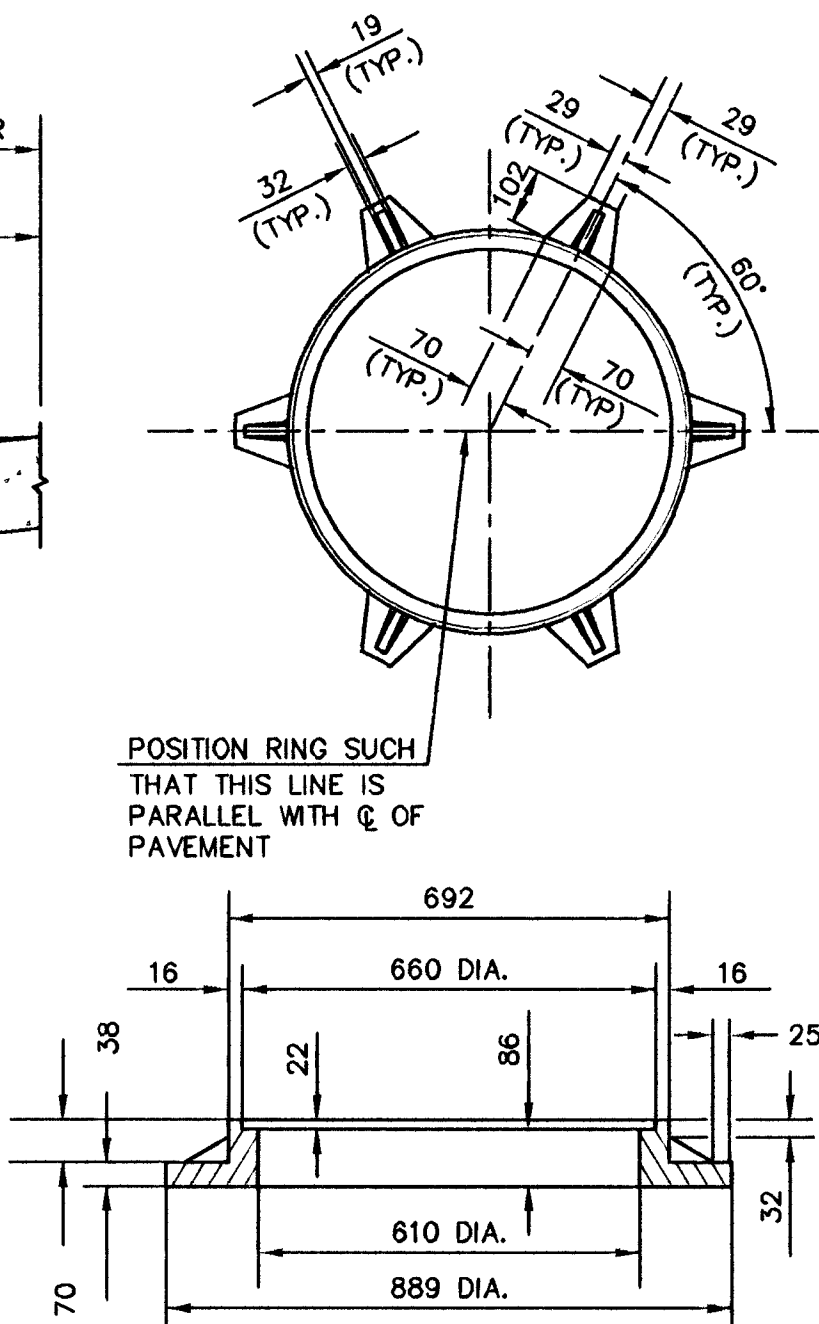


GENERAL NOTES

- CONCRETE SHALL BE C.O.W. STANDARD PAVING MIX. ALL EXPOSED EDGES SHALL BE FINISHED WITH AN EDGING TOOL. REINFORCING BARS SHALL BE FIELD BENT OR CUT TO CLEAR PIPES. ALL BARS ARE #13 BARS AT 150 mm SPACING AND SHALL HAVE A MINIMUM CLEARANCE OF 40 mm UNLESS OTHERWISE NOTED. FLOORS OF INLET SHALL BE SHAPED WITH 8 SACK SAND MIX CONCRETE TO INCREASE HYDRAULIC EFFICIENCY SUCH THAT THE INLET WILL BE SELF CLEANING BETWEEN ALL INLET AND/OR OUTFALL PIPE(S). THE CONTRACTOR WILL BE REQUIRED TO CONSTRUCT 205 mm BRICK MASONRY WALLS BETWEEN THE CONCRETE INLET BASE AND TOP ON THIS INLET WHEN H = 2 135 mm OR LESS AND W = 1 930 mm OR LESS.
- THE ENDS OF ALL PIPES INSTALLED IN INLETS SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF THE INLET WALL.

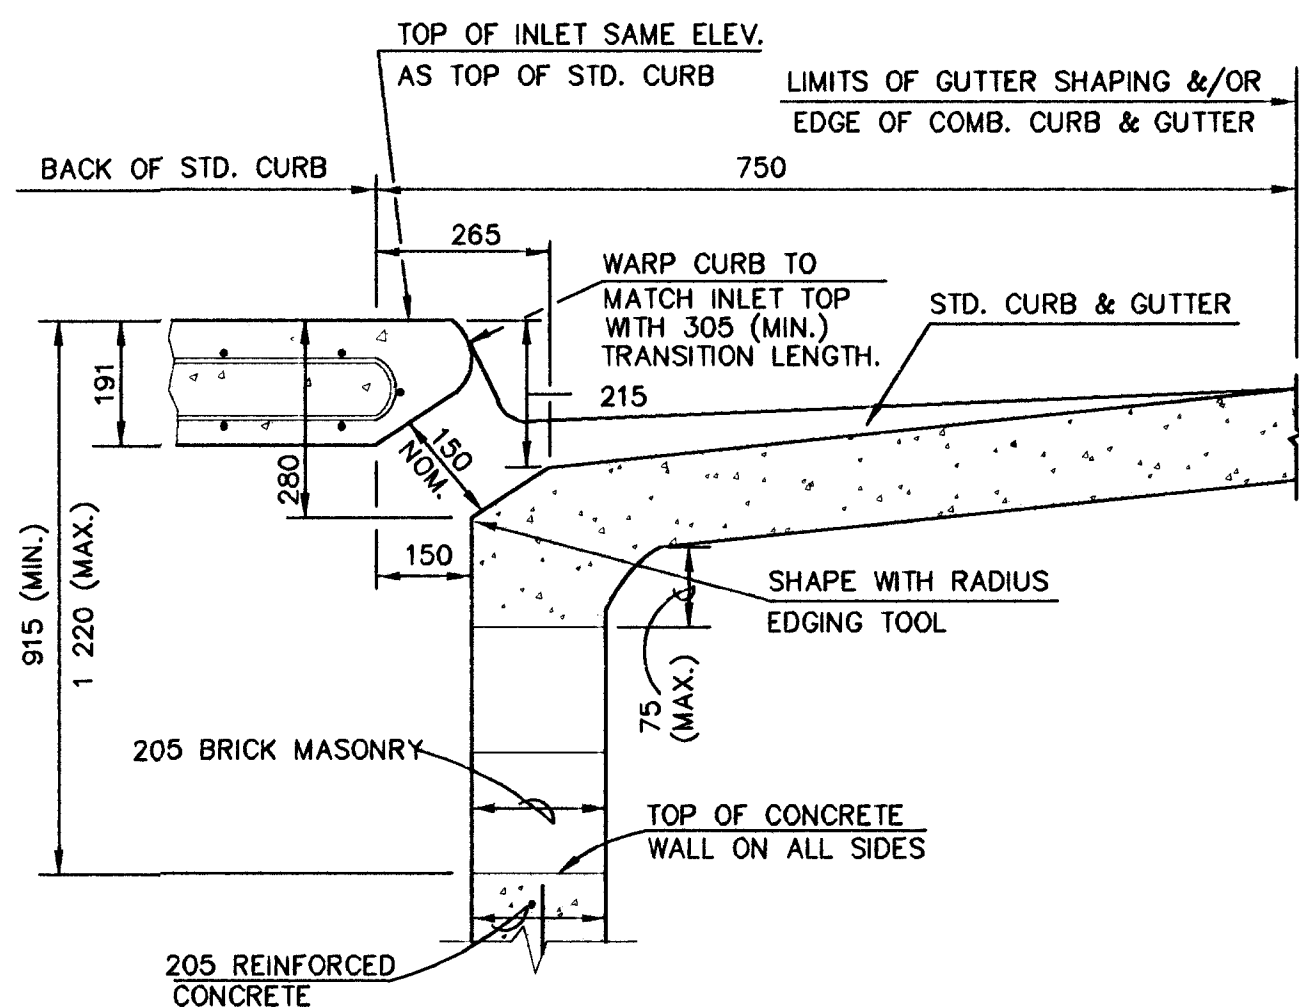

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	m ³ CONC.
1 321	1 116 x 3 454 x 190	530 & SMALLER	± 0.63
1 626	1 421 x 3 454 x 190	600 & 750	± 0.83
1 930	1 725 x 3 454 x 190	900 & 1 050	± 1.03
2 235	2 030 x 3 454 x 190	1 200 & 1 350	± 1.23
2 540	2 335 x 3 454 x 190	1 500 & 1 675	± 1.43

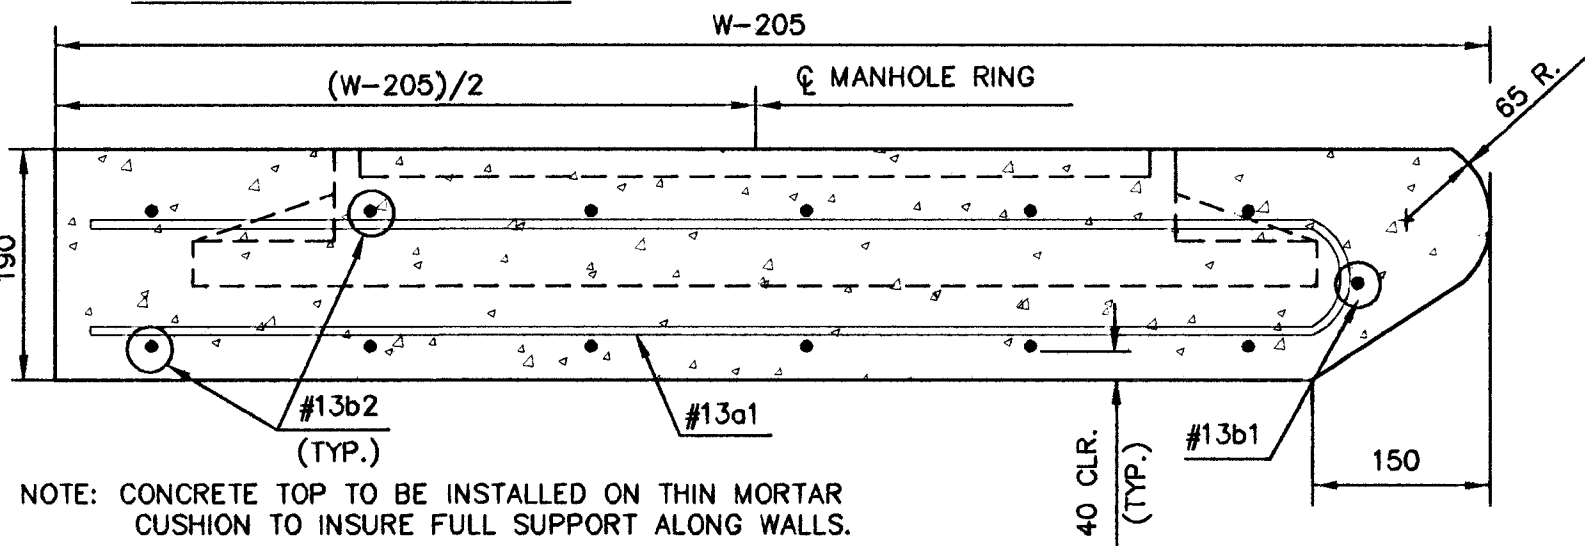

SLAB AND FLOOR REINFORCING											
		W=1 321		W=1 626		W=1 930		W=2 235		W=2 540	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
a1	#13	20	2 015	20	2 625	20	3 230	20	3 840	20	4 450
a2	#13	2	1 830	2	2 440	2	3 050	2	3 660	2	4 265
a3	#13	33	1 245	33	1 550	33	1 855	33	2 160	33	2 465
b1	#13	1	4 495	1	4 495	1	4 495	1	4 495	1	4 495
++b2	#13	18	4 900	24	4 900	30	4 900	36	4 900	42	4 900

WALL REINFORCING											
		W=1 321		W=1 626		W=1 930		W=2 235		W=2 540	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
c1	#19	8	1 855	8	2 160	8	2 465	8	2 770	8	3 075
w1	#13	①	4 900	①	4 900	①	4 900	①	4 900	①	4 900
w2	#13	①	1 245	①	1 550	①	1 855	①	2 160	①	2 465
w3	#13	②	③	②	③	②	③	②	③	②	③

•• FIELD BEND OR CUT REINFORCING AS REQUIRED FOR CLEARANCE

① $2 \left(\frac{H_1 - 200}{150} + 1 \right)$

② $62 + 2 \left(\frac{W - 410}{150} + 1 \right)$

③ H1-(230)

REVISED: 12-21-1984

STANDARD TYPE 1 CURB INLET			
INLET OPENING=152 x 4 573			
OCTOBER, 1984			
CITY OF WICHITA, KANSAS			
Design BER	Checked by	Checked by	
KJS MWB			
Drawn by	Date	Date	Job No.