SCALE:
HORIZONTAL: 1" = 20'
VERTICAL: 1" = 5'

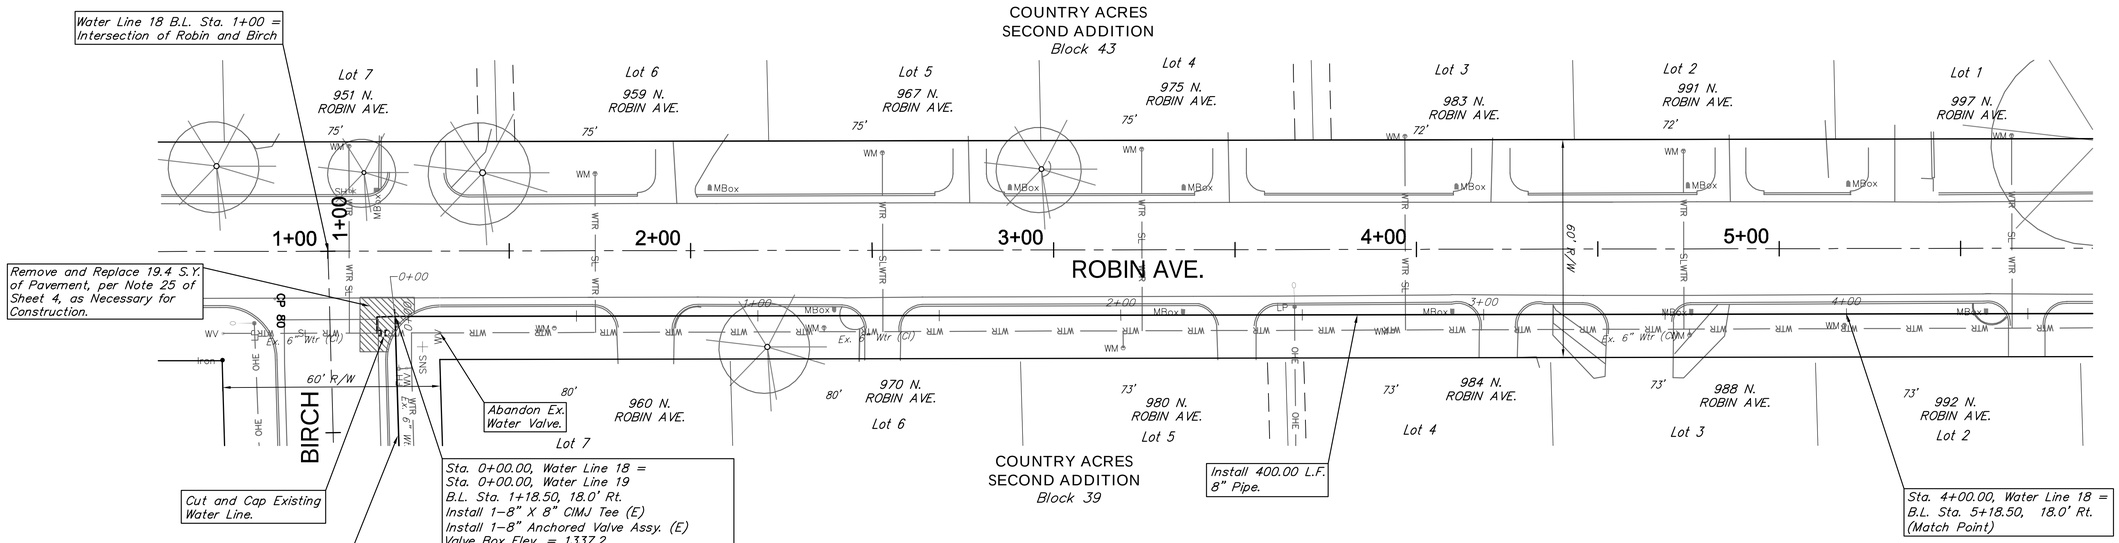

Sta. 0+00.00, Water Line 18 =
Sta. 0+00.00, Water Line 19
B.L. Sta. 1+18.50, 18.0' Rt.
Install 1-8" X 8" CIMJ Tee (E)
Install 1-8" Anchored Valve Assy. (E)
Valve Box Elev. = 1337.2
Install 1-8" X 6" CIMJ Reducer (S)
Install 5.00 L.F. 6" DICL Pipe (S)
Install 1-6" 90° CIMJ Bend (E)
Install 4.51 L.F. 6" DICL Pipe (E)
Tap Ex. 6" Water Line.
Install 1-6" X 6" Tapping Sleeve (E) & 6" Tapping Valve with Valve Box to be Furnished & Installed by the City of Wichita.
Valve Box Elev. = 1337.1

Location of Existing Line is Based on Record Information from the City. The Contractor Shall Excavate the Ex. Water and to Verify Size and Location PRIOR to Beginning Construction. This Work Shall be Considered SUBSIDIARY to the Water Line Installation.

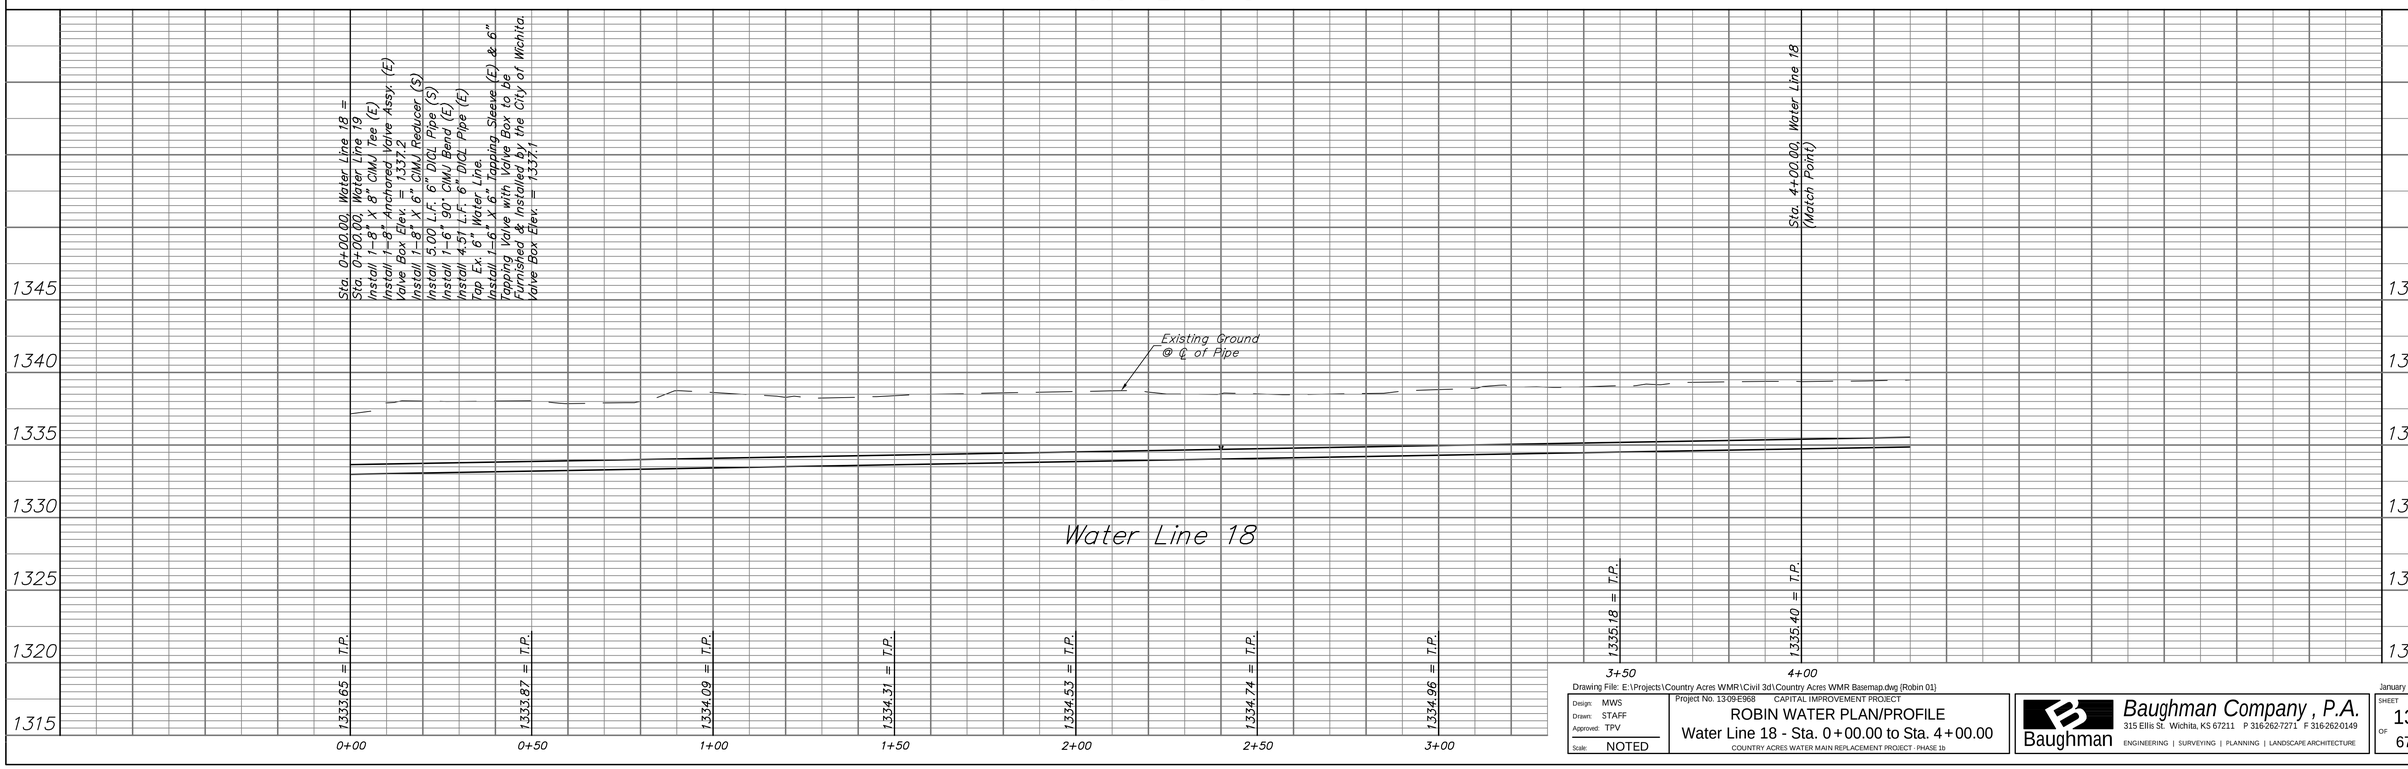

Drawing File: E:\Projects\Country Acres WMR\Civil 3d\Country Acres WMR Basemap.dwg [Robin 01]

Design:	MWS
Drawn:	STAFF
Approved:	TPV
Scale:	NOTED

Project No. 13-09-E968 CAPITAL IMPROVEMENT PROJECT

ROBIN WATER PLAN/PROFILE

Water Line 18 - Sta. 0+00.00 to Sta. 4+00.00

COUNTRY ACRES WATER MAIN REPLACEMENT PROJECT - PHASE 1b

Baughman Company, P.A.
315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149
ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

January 2016

SHEET 13 OF 67