


GENERAL NOTES:

1. ALL CIRCUITS INDICATED ON DRAWINGS SHALL BE 20A, 120V CIRCUITS WITH (2)-#12'S AND (1)-#12 G. IN 1" CONDUIT UNLESS OTHERWISE SHOWN.
2. LABEL ALL SNAP SWITCH COVERPLATES WITH THE PANEL AND CIRCUIT NUMBER.
3. REFER TO RELATED ARCHITECTURAL DRAWINGS FOR RELATED INFORMATION.
4. WALL MOUNTING HEIGHTS TO CENTERLINE OF DEVICE UNLESS OTHERWISE NOTED.
5. A GROUND CONDUCTOR SIZED PER N.E.C. ARTICLE 250 IS REQUIRED IN ALL POWER, RECEPTACLE, AND LIGHTING CIRCUITS. GROUND CONDUCTORS ARE NOT SHOWN ON DRAWINGS.
6. ALL CONDUITS FOR STREET LIGHTING CIRCUITS SHALL BE 2" AND PROVIDED WITH PULLWIRES. VERIFY ALL REQUIREMENTS WITH LOCAL UTILITY COMPANY.
7. ALL STREET LIGHTS, POLES, CONDUCTORS, INSTALLATION AND "SCREW IN" POLE BASE SHALL BE BY LOCAL UTILITY COMPANY. "SCREW IN" POLE BASE INSTALLATION AND ALL ASSOCIATED CONDUITS AND INSTALLATION TO BE BY ELECTRICAL CONTRACTOR. VERIFY ALL REQUIREMENTS PRIOR TO BID.

PLAN NOTES:

- 1 EXISTING STREET LIGHT, POLE AND POLE BASE TO BE REMOVED COMPLETE.
- 2 ELECTRICAL CONTRACTOR TO INSTALL NEW "SCREW IN" BASE IN LOCATION SHOWN. NEW "SCREW IN" BASE TO BE PROVIDED BY UTILITY COMPANY AND INSTALLED BY ELECTRICAL CONTRACTOR. VERIFY EXACT LOCATION PRIOR TO ROUGH-IN.
- 3 EXISTING STREET LIGHT AND POLE TO BE REMOVED COMPLETE.
- 4 EXISTING POLE AND BASE TO BE REMOVED COMPLETE.
- 5 NEW TRAFFIC SIGNAL CONTROLLER, DISCONNECT SWITCH AND METER. VERIFY EXACT LOCATION PRIOR TO ROUGH-IN.
- 6 NEW MILBANK PEDESTAL FOR IRRIGATION AND ARTWORK POWER. SEE DETAIL A/E2 FOR ADDITIONAL INFORMATION. VERIFY EXACT LOCATION PRIOR TO ROUGH-IN.
- 7 EXISTING POLE TO REMAIN. ROUTE CONDUIT UP POLE AND PROVIDE CONDUIT WITH WEATHER HEAD PER UTILITY COMPANY STANDARDS.
- 8 NEW 3" CONDUIT WITH PULLWIRE FOR PRIMARY ELECTRICAL SERVICE TO UTILITY COMPANY TERMINAL CABINET. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 9 NEW 3" CONDUIT WITH PULLWIRE FOR PRIMARY ELECTRICAL SERVICE TO TRAFFIC SIGNAL CONTROLLER FROM UTILITY COMPANY TERMINAL CABINET. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 10 NEW 3" CONDUIT WITH PULLWIRE FOR PRIMARY ELECTRICAL SERVICE TO MILBANK PEDESTAL FROM UTILITY COMPANY TERMINAL CABINET. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 11 NEW 2" CONDUIT WITH PULLWIRE FOR PRIMARY ELECTRICAL SERVICE TO STREET LIGHTING FROM UTILITY COMPANY TERMINAL CABINET. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 12 NEW IN-GRADE MULTI-USE PULLBOX BY OTHERS, FOR TRAFFIC SIGNAL/STREET LIGHTING CIRCUITING.
- 13 NEW 2" CONDUIT WITH PULLWIRE FOR STREET LIGHTING CIRCUITING. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 14 EXISTING TRAFFIC SIGNAL CONTROLLER, DISCONNECT AND METER TO BE REMOVED COMPLETE.
- 15 NEW 1" CONDUIT WITH PULLWIRE FOR FUTURE ARTWORK. TERMINATE AT QUAZITE BOX AS SHOWN. VERIFY ALL REQUIREMENTS PRIOR TO ROUGH-IN.
- 16 CONTRACTOR TO ROUTE CONDUIT TO CLEAR PLANTING BEDS.
- 17 QUAZITE BOX PROVIDED BY ELECTRICAL CONTRACTOR. ELECTRICAL CONTRACTOR TO SIZE QUAZITE BOX FOR FUTURE. REFER TO CIVIL PLANS FOR MORE INFORMATION.

A DOUGLAS AVE AND HYDRAULIC SITE PLAN
 SCALE: 1" = 20'-0"
 NORTH

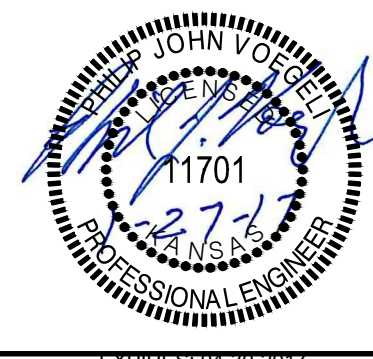

Integrated Consulting Engineers, Inc.
 349 South Hydraulic • Wichita, KS 67211
 316.264.3588 • 316.264.3948 • www.icengr.com

13113.00-015
 Design: PV
 Drawn: CK
 Approved: PV
 Scale: NOTED
 Drawing File: L:\ICE - Archives\2013\13113.00 - 015 - Douglas Street Lighting\Electrical Files\13113.00 - E3.dwg
 Project No. 11-07-E650 CAPITAL IMPROVEMENT PROJECT
Douglas Paving
 Sta. 23 + 75.00 to 29 + 50.00
 DOUGLAS - WASHINGTON TO GROVE

Baughman Company, P.A.
 315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149
 ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

JANUARY, 2017
 SHEET **E2.0**
 OF 3