



EXISTING TYPE 1-A INLETS
(Reinforced Concrete Walls)

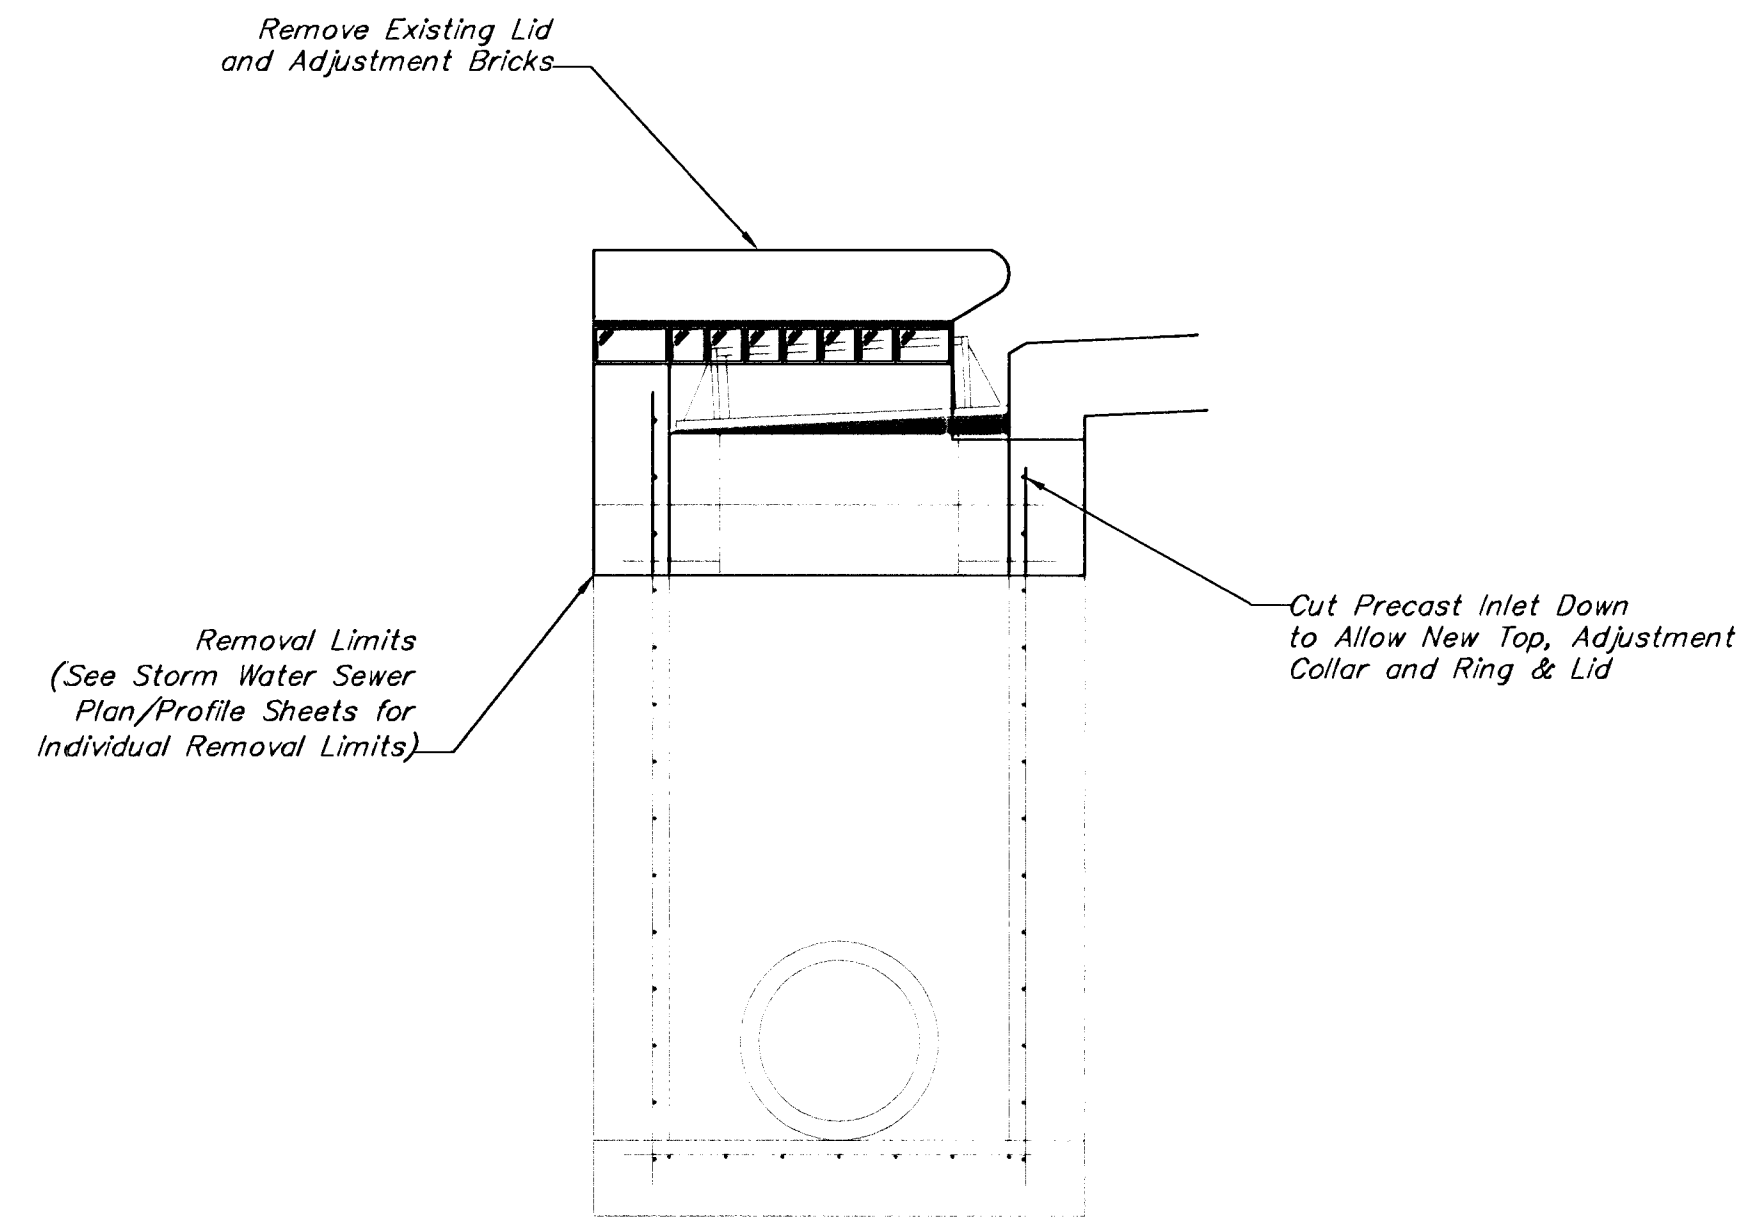

MINIMUM REMOVAL LIMITS
(Reinforced Concrete Walls)

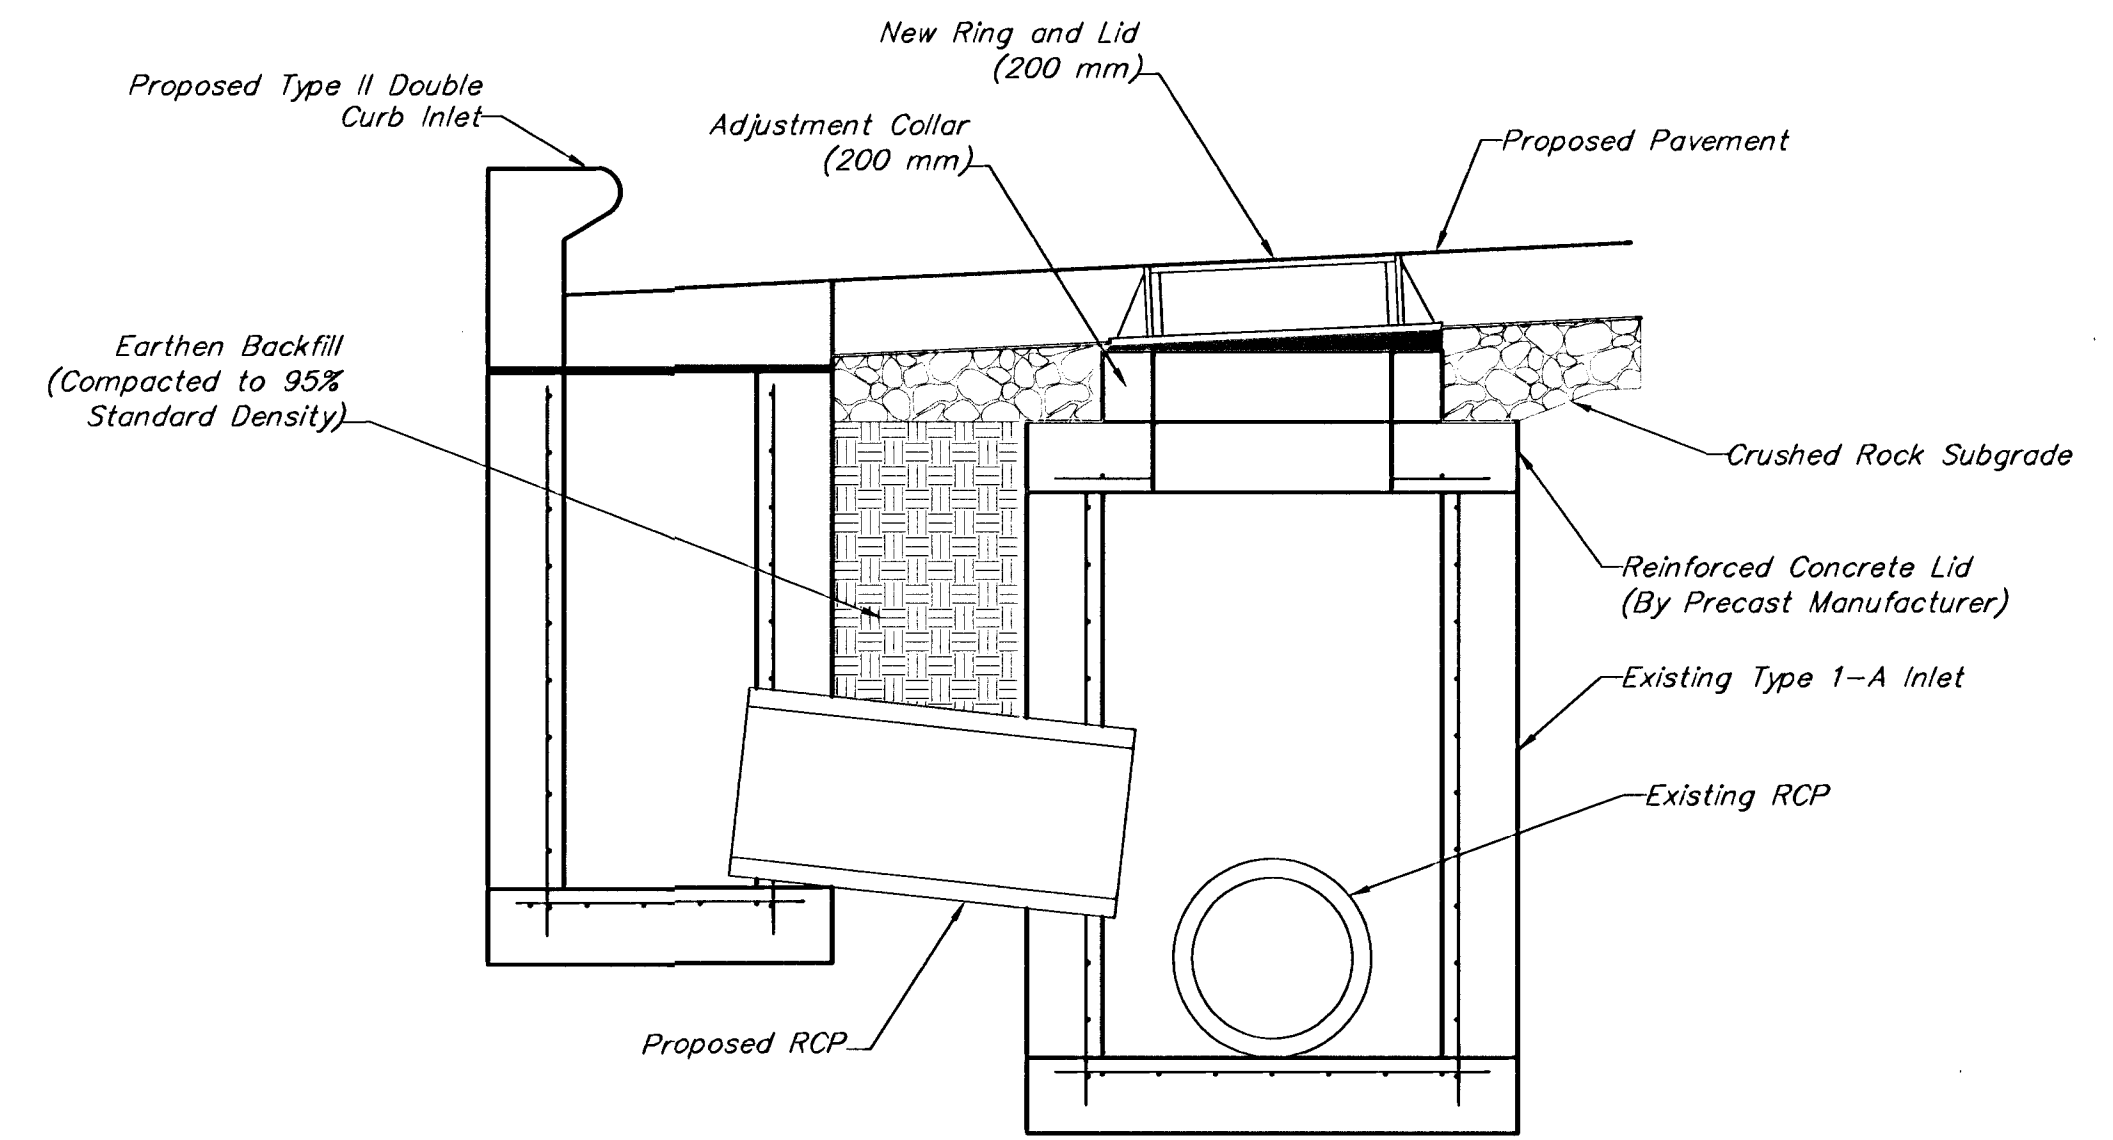


TYPE II INLETS WITH TYPE 1-A CONVERSIONS TO MANHOLES

GENERAL NOTES:

All Type 1-A inlets shall be free of major structural defects before they are converted to manholes.

The precast concrete lid shall be sized by the Precast Manufacturer's Engineer.

The removal of the top part of the existing Type 1-A's shall be performed by the least destructive method possible so as not to crack the remaining structure. Removal method shall be approved by the Engineer before construction starts.

 <p>THE CITY OF WICHITA</p> <p>CITY ENGINEER'S OFFICE CITY HALL - SEVENTH FLOOR 455 NORTH MAIN STREET WICHITA, KANSAS 67202 (316) 268-4501 (316) 268-4114 FAX</p>	STANDARD TYPE 1-A INLET CONVERSION to SQUARE MANHOLE	
	NEIL D. CABLE P.E. - CITY ENGINEER	
	PROJECT NUMBER 472-83685	OCA # 706852
	DATE MAR 96	SHEET 38 OF 92