

CONSULTANTS:


**45TH & HILLSIDE
 INTERSECTION IMPROVEMENT**
 WICHITA, KANSAS


| REVISIONS: | MARK | DATE | DESCRIPTION |
|------------|------|------|-------------|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

PROJ NO: 87 N-0616-01
 SCALE: N/A
 DATE: 10/9/2017
 DESIGNED BY: TAU
 DRAWN BY: TAU
 CHECKED BY: MDB


SHEET TITLE:
**TYPICAL SECTIONS
 HILLSIDE AVENUE**

SHEET NO.
8

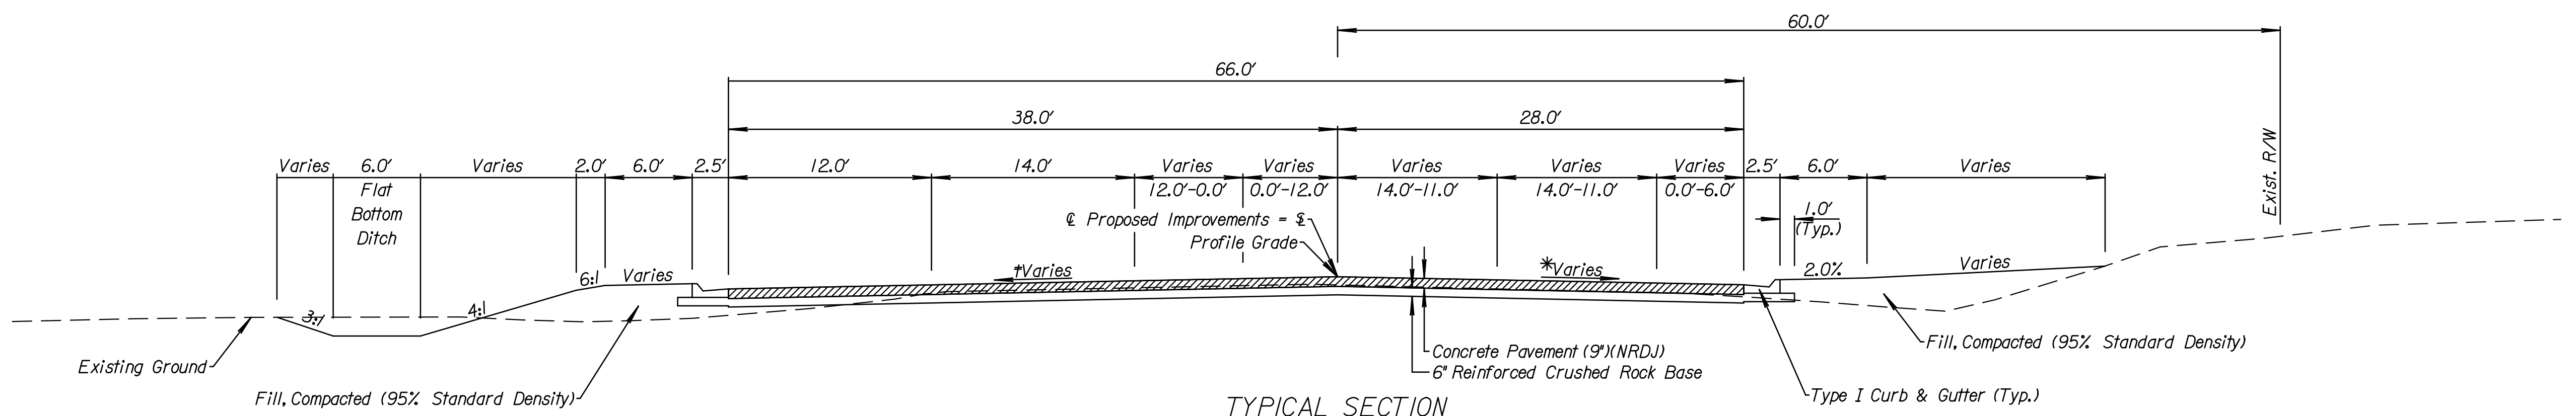

TYPICAL SECTION

Sta. 127+47.47 to Sta. 129+84.35
 Const. 10.0' Mountable Concrete Median Nose (See Plan Sheets) - Sta. 129+74.35 to Sta. 129+84.35
 †Cross Slope Varies - Sta. 129+62.15 to Sta. 129+84.35 (See Cross Sections) - 2.0% Min. & 2.6% Max.
 *Cross Slope Varies - Sta. 129+62.15 to Sta. 129+84.35 (See Cross Sections) - 2.0% Min. & 3.2% Max.

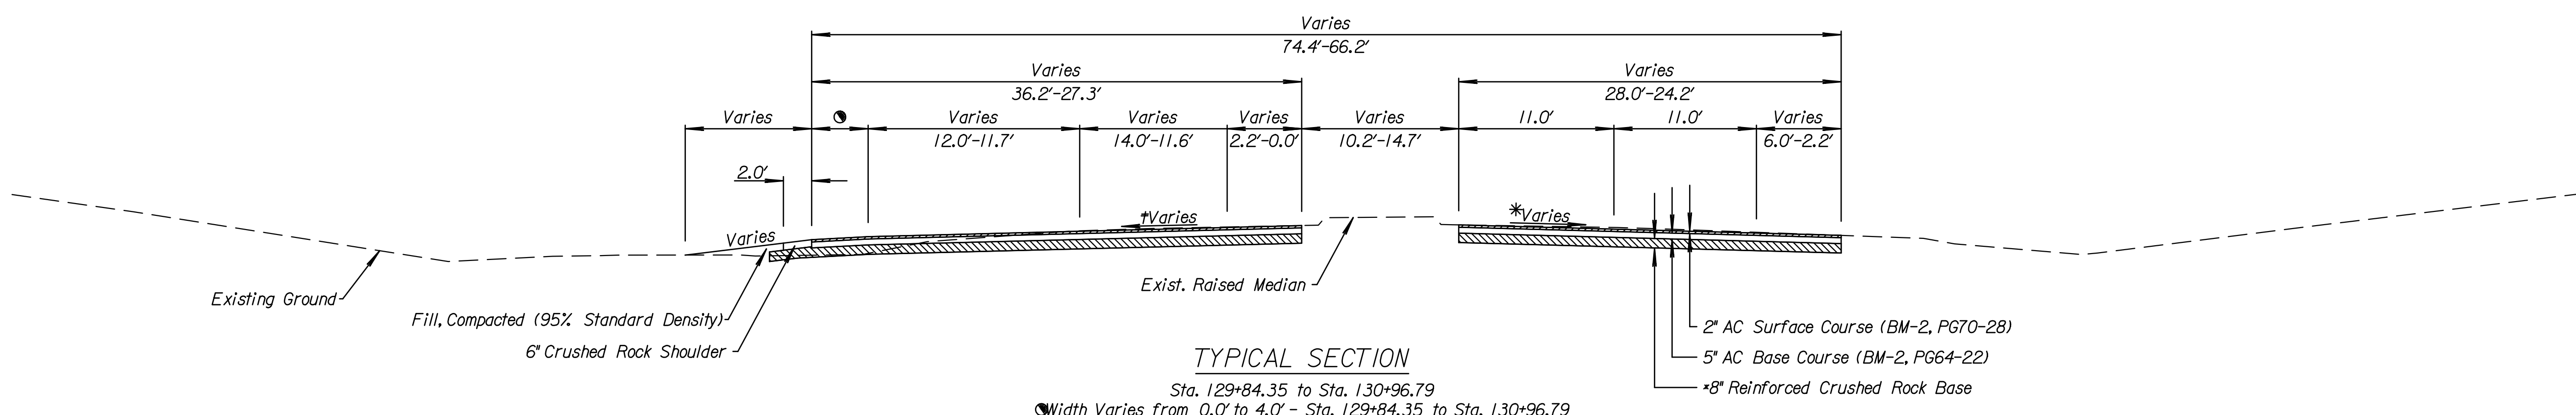

TYPICAL SECTION

Sta. 129+84.35 to Sta. 130+96.79
 †Width Varies from 0.0' to 4.0' - Sta. 129+84.35 to Sta. 130+96.79
 †Cross Slope Varies - Sta. 129+84.35 to Sta. 130+96.79 (See Cross Sections) - 2.2% Min. & 3.4% Max.
 *Cross Slope Varies - Sta. 129+84.35 to Sta. 130+96.79 (See Cross Sections) - 0.1% Min. & 3.2% Max.

Note:
 *Reinforced Crushed Rock Base Shall be Reinforced with approved geogrid. Geogrid is SUBSIDIARY to Reinforced Crushed Rock Base Bid Item

The Sections Shown are Typical. See Plans and Cross Sections for Variations

For Median Nose Detail, See Sheet 60