

FHWA REGION NO.	STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
7	KANSAS		19	55	118

GENERAL NOTES

Use Class A Concrete throughout. All exposed edges shall be finished with an edging tool. At the contractor's option Class A Concrete (AE) or mix used in concrete pavement may be used throughout.

In general, pipes will enter and leave manhole at various positions. Where possible bend bars around pipes.

Floor of manhole shall be shaped as shown in various "EXAMPLES" with unreinforced Class "A" Concrete. Manhole opening and steps, where used, shall be placed to afford easy access to top of shaped invert. Top reinforcing bars shall be adjusted accordingly.


All castings shall be gray iron and shall comply with the KDOT Standard Specifications. No deductions in concrete quantities shall be made for pipe openings or additions to concrete quantities shall be made for shaping floor of manholes.

The top of the manhole shall be sloped slightly to approximately fit the ground line or other condition as directed by the Engineer.


Dimensions and masses of cast iron as shown on this sheet are minimum. Larger dimensions and/or heavier masses of cast iron may be used.

The Contractor has the option of using precast manholes, as approved by the Engineer.


Steps shall be installed in all manholes when specified in the plans or when "H" is equal to or greater than 1 800 mm. Steps shall comply with the requirements of the KDOT Standard Specification.

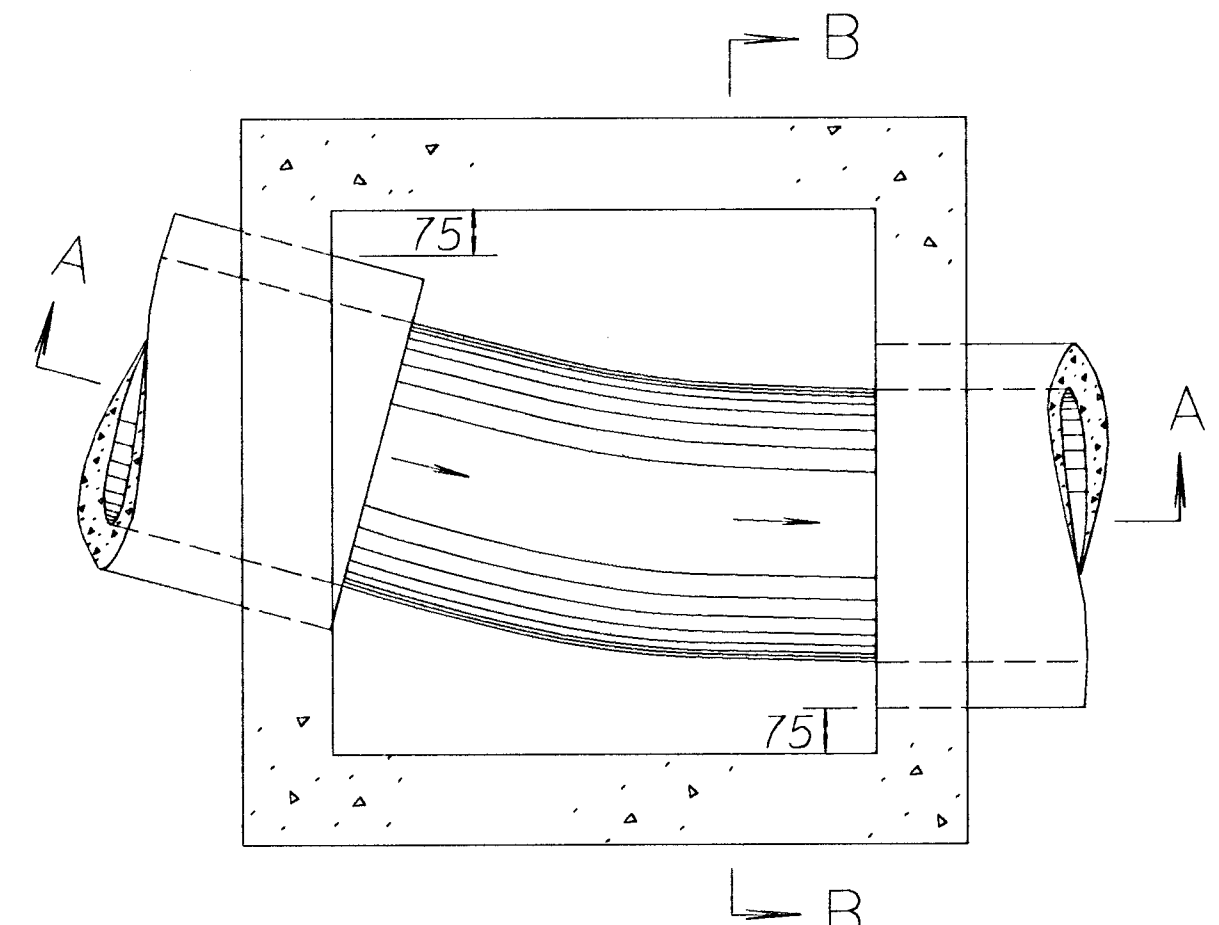


PLAN - FLOOR (Example I)

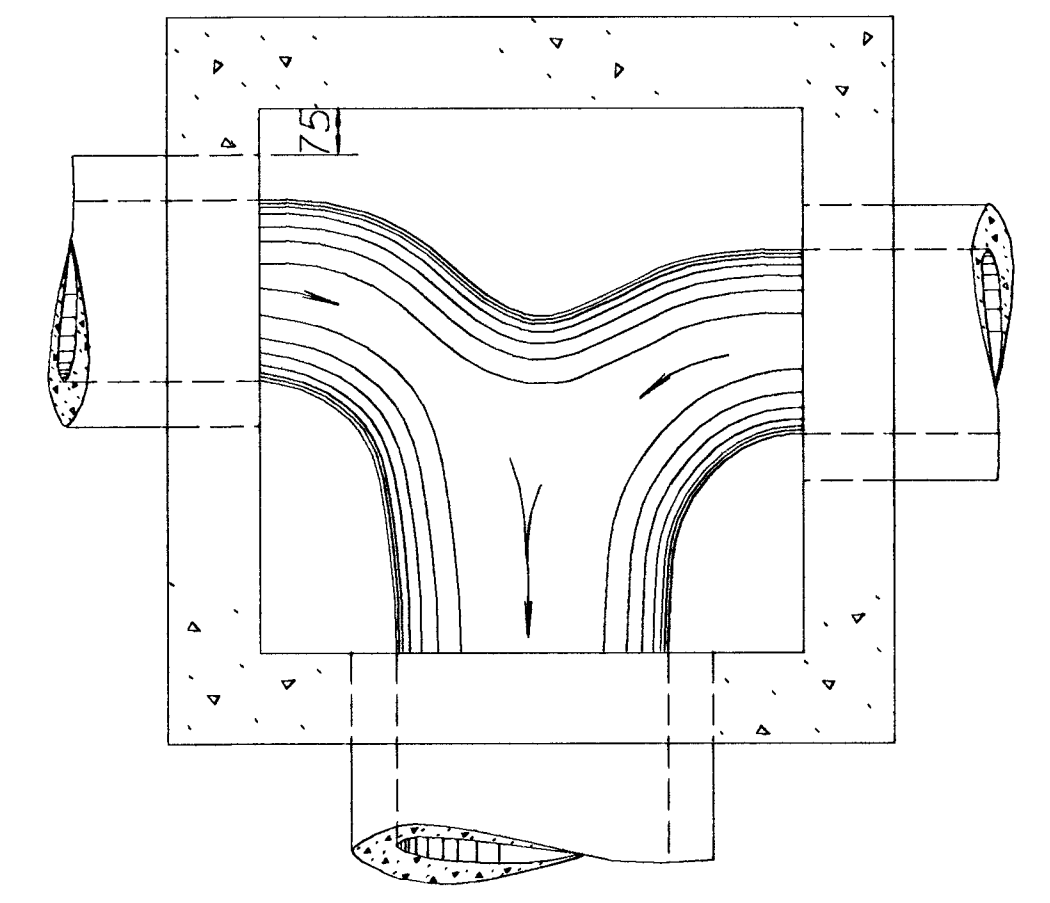


PLAN - FLOOR (Example III)

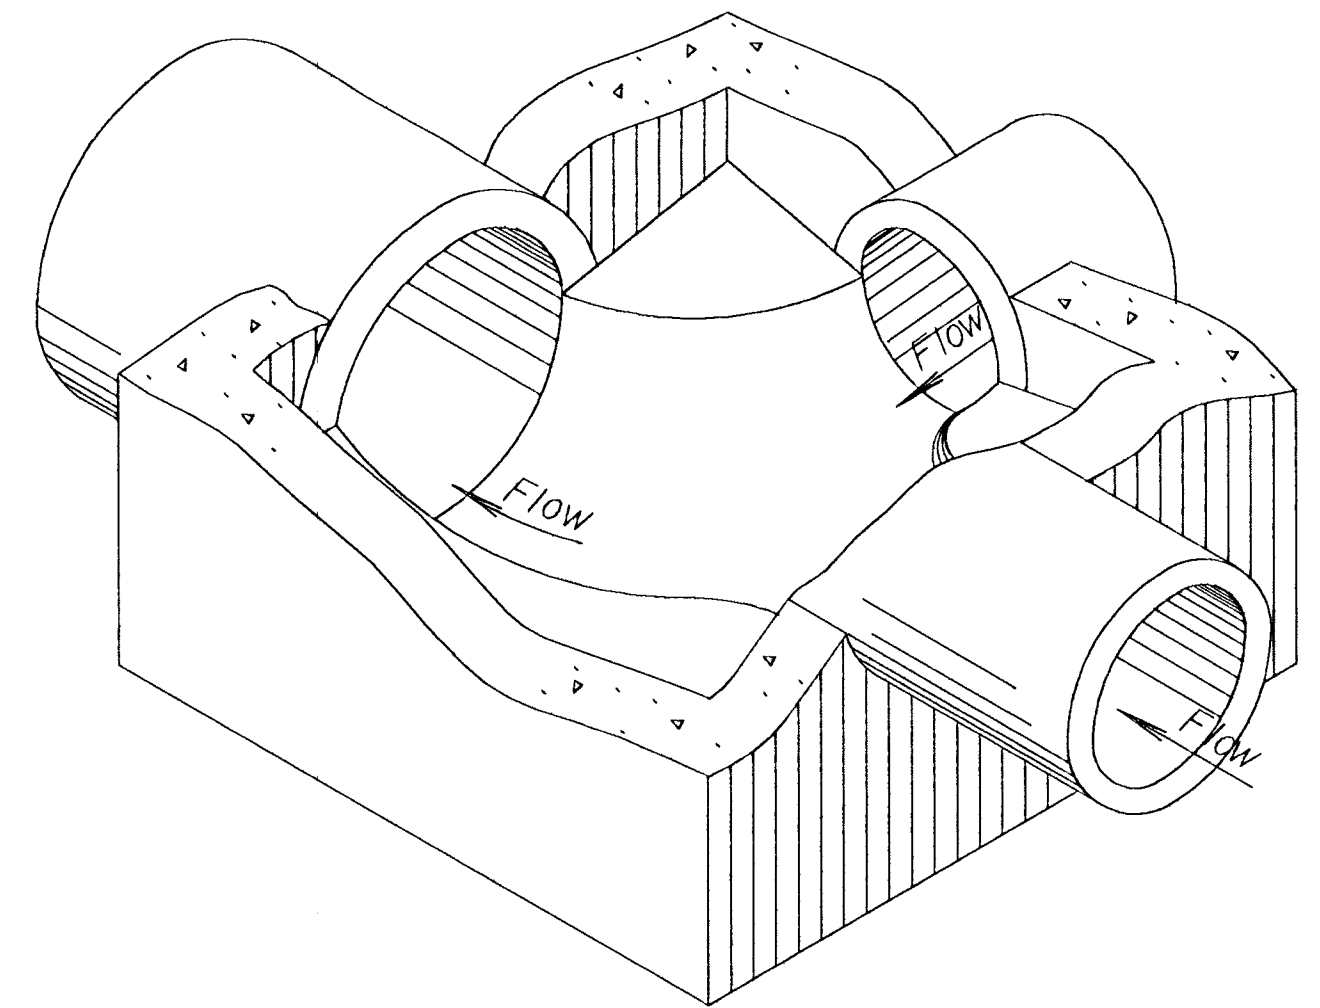


ISOMETRIC VIEW (Example IV)

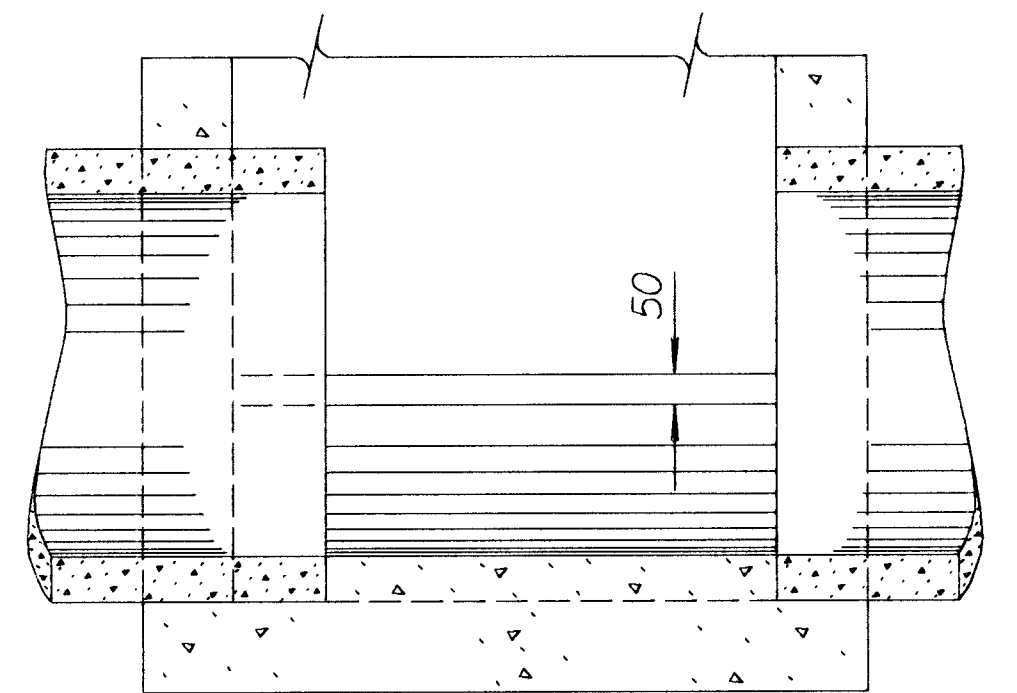


SECTION A-A (Example I)

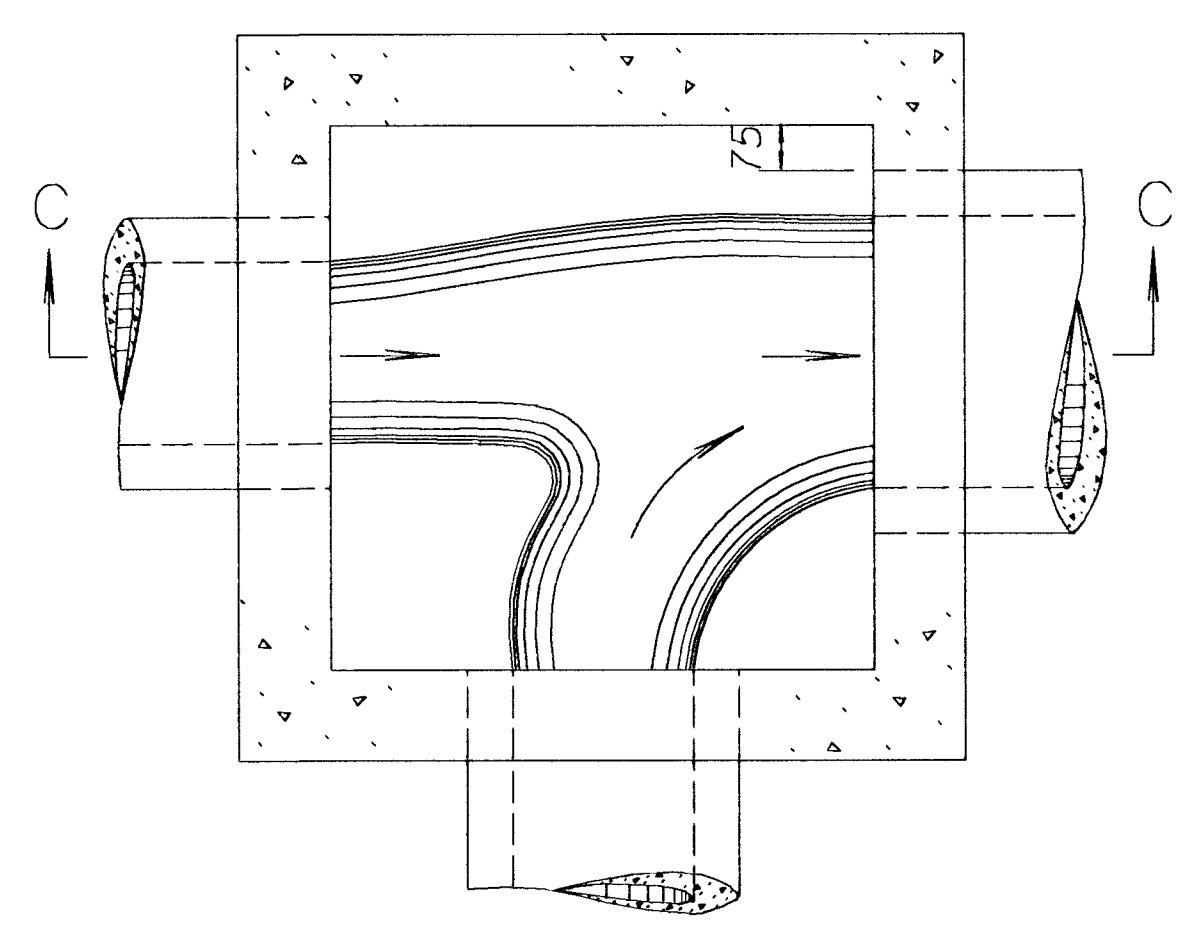


PLAN - FLOOR (Example IV)

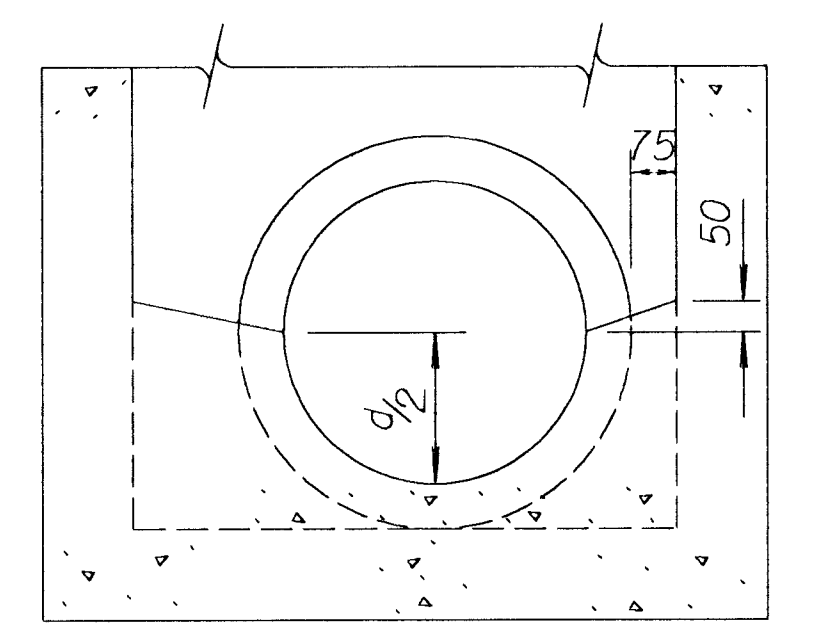


SECTION B-B (Example I)

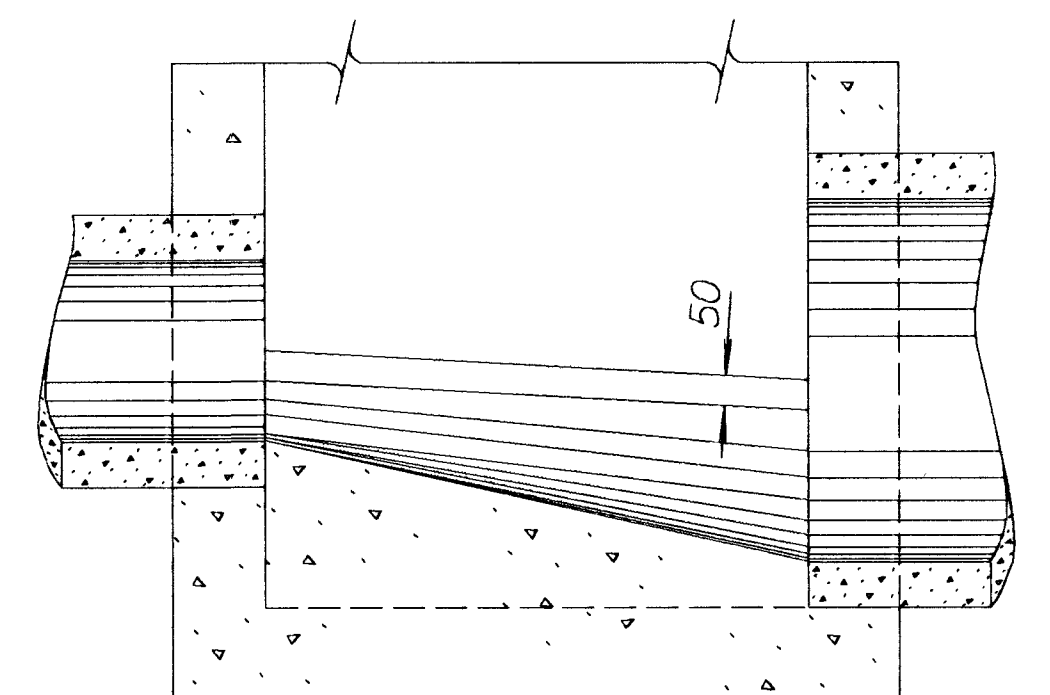

SECTION C-C (Example IV)

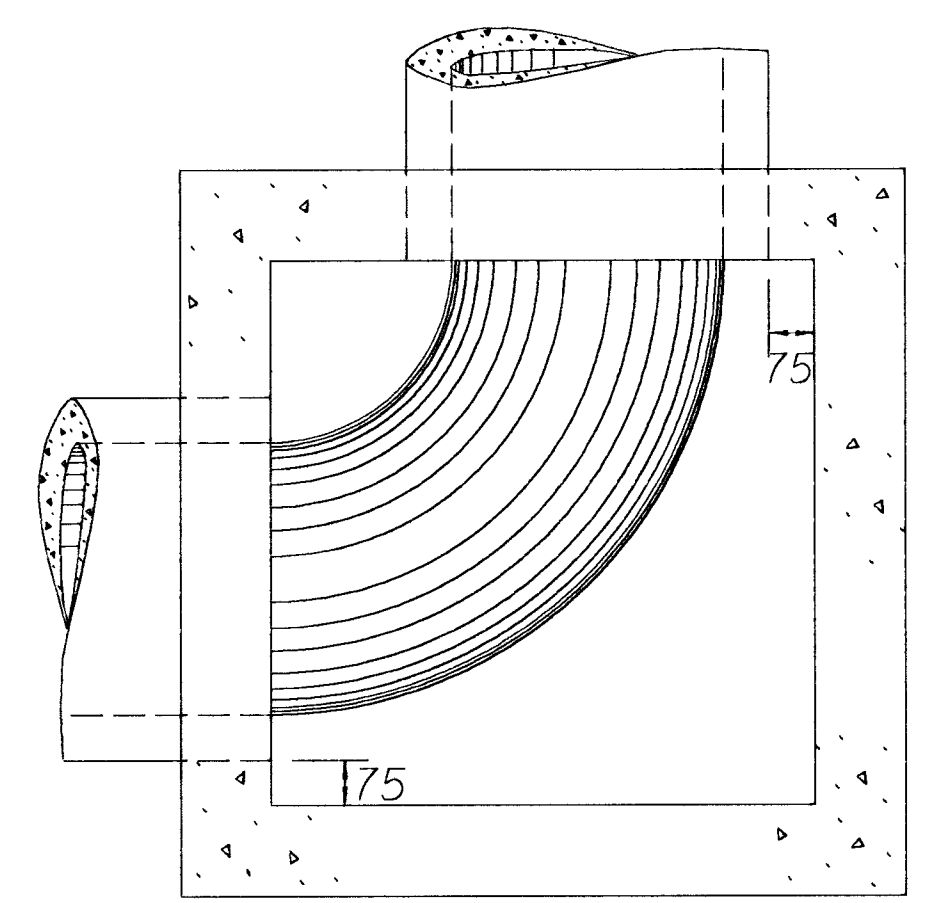


PLAN - FLOOR (Example II)

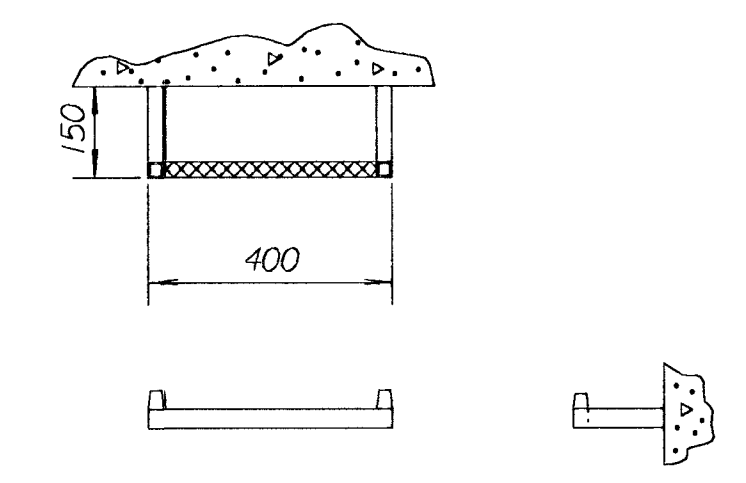


STEP DETAILS

Floor of manhole shall be shaped as shown in the examples to increase hydraulic efficiency.

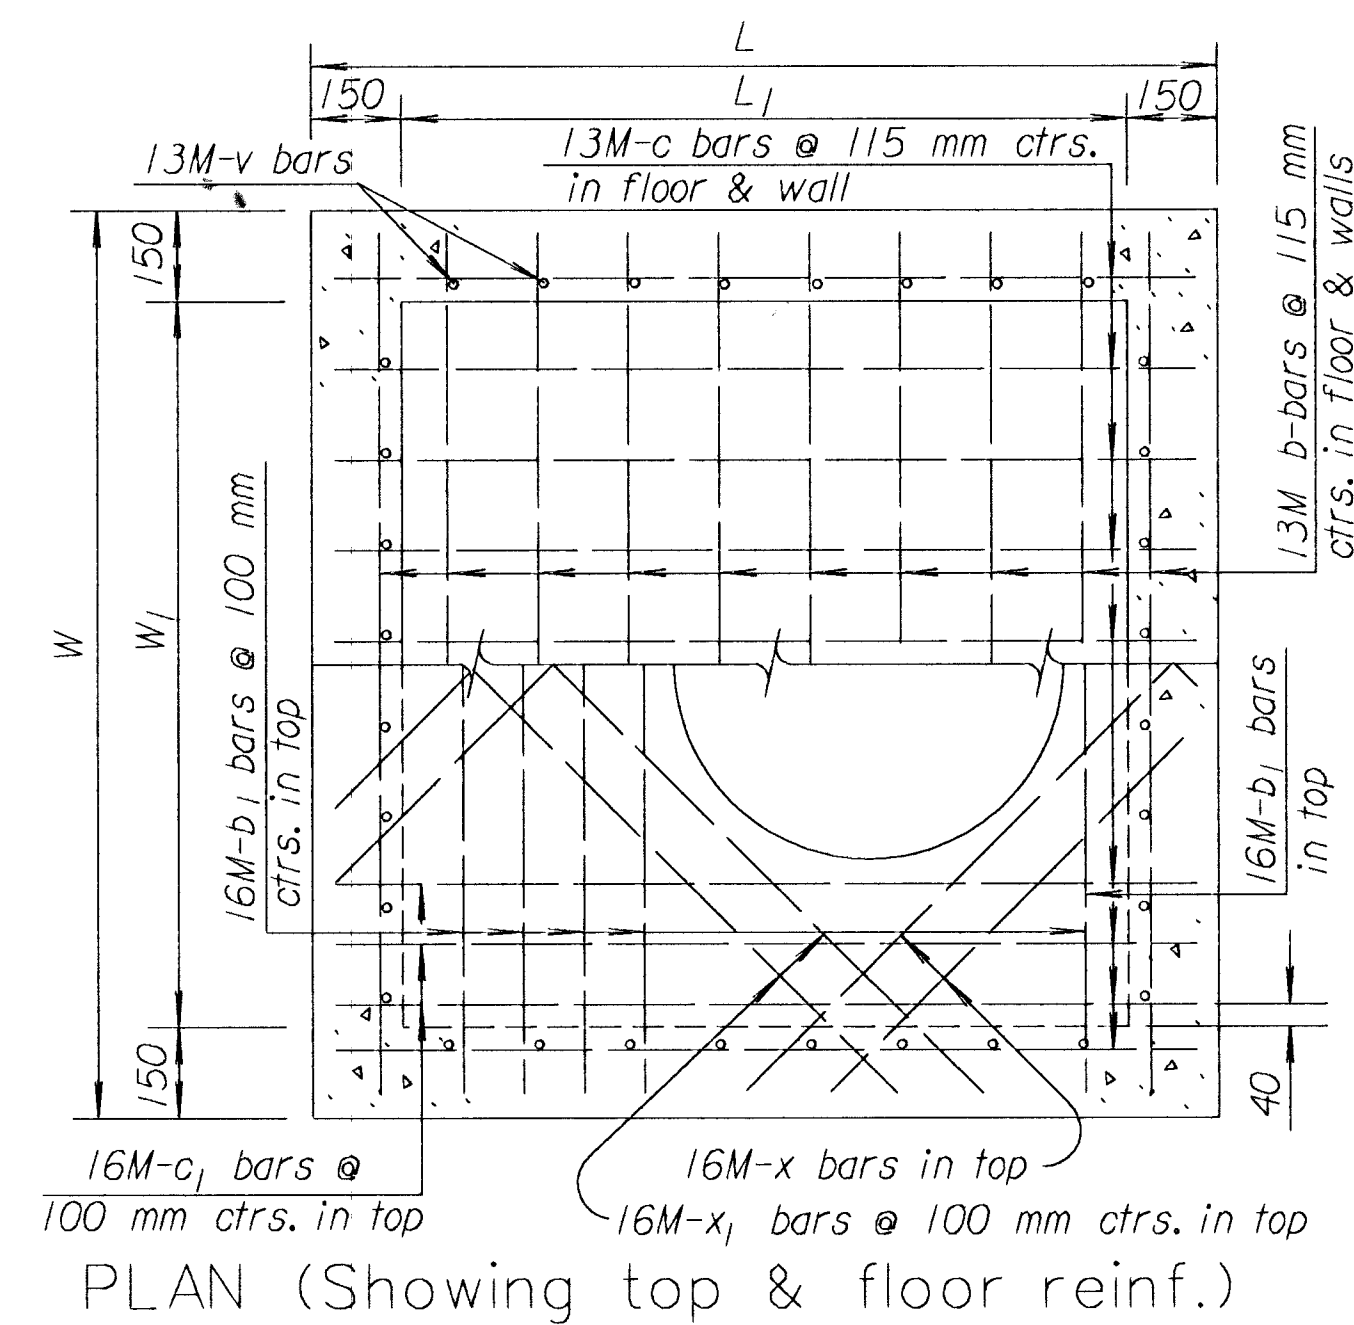


PLAN (Showing top & floor reinf.)

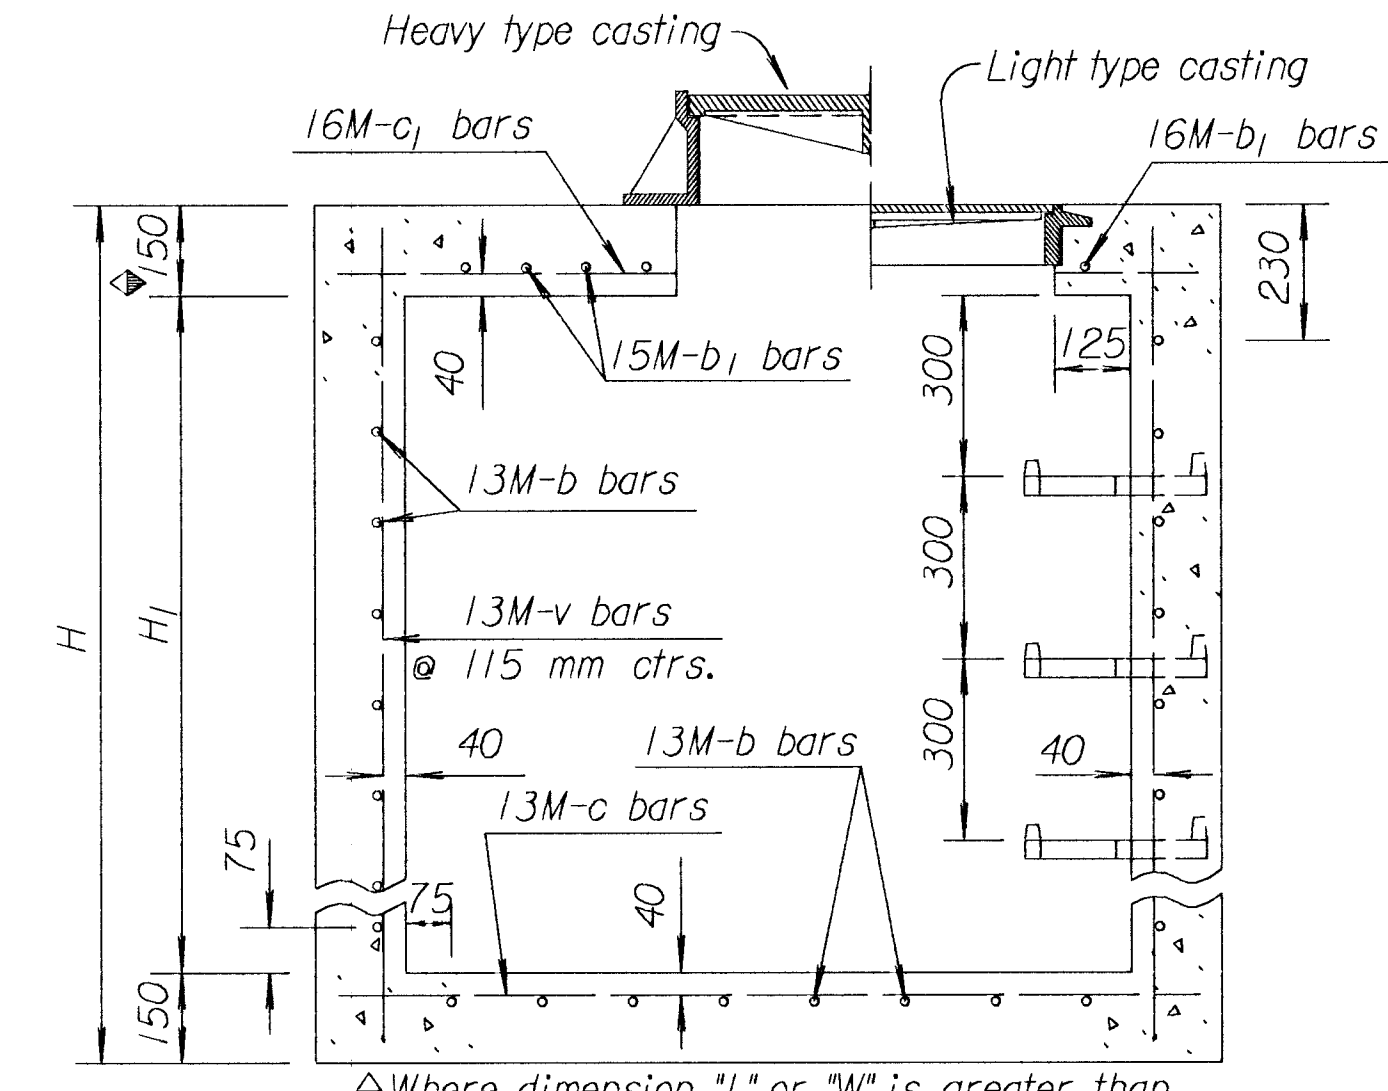


SECTION (Exclusive of floor shaping)


Where dimension "L" or "W" is greater than 1 800 mm use 200 mm slab thickness.

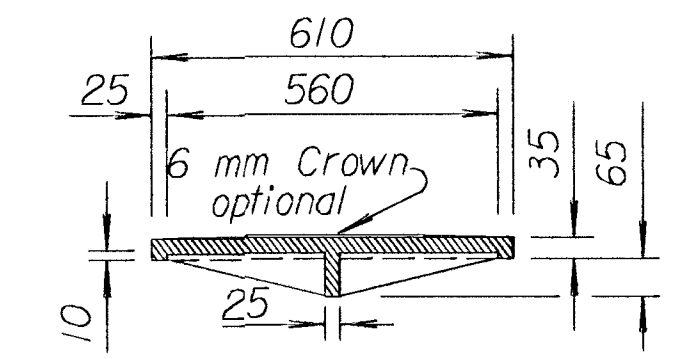



MANHOLE COVER TYPE A & B (Mass=61 kg; without 6 mm Crown= 57 kg)

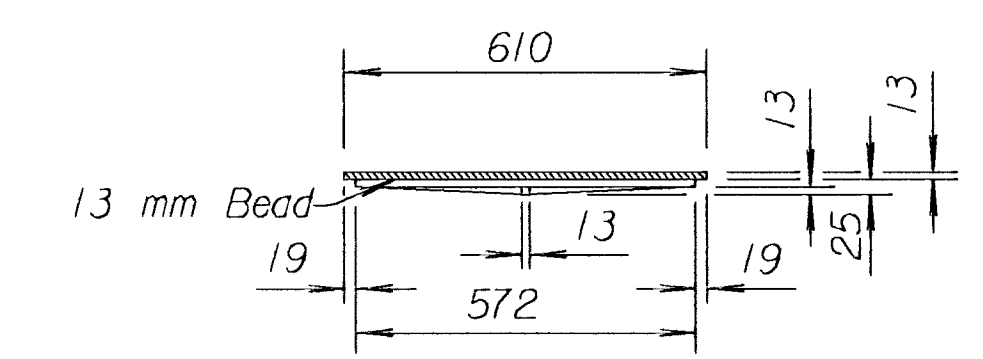


MANHOLE COVER TYPE C (Mass= 29 kg)

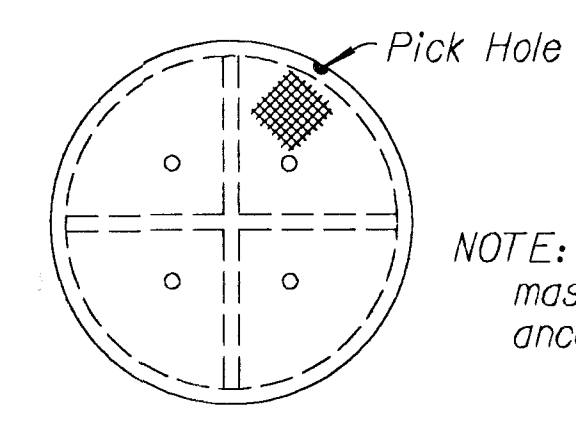


NOTE: All manhole castings are cast iron. Mass of castings includes no allowance for fillets and overruns.

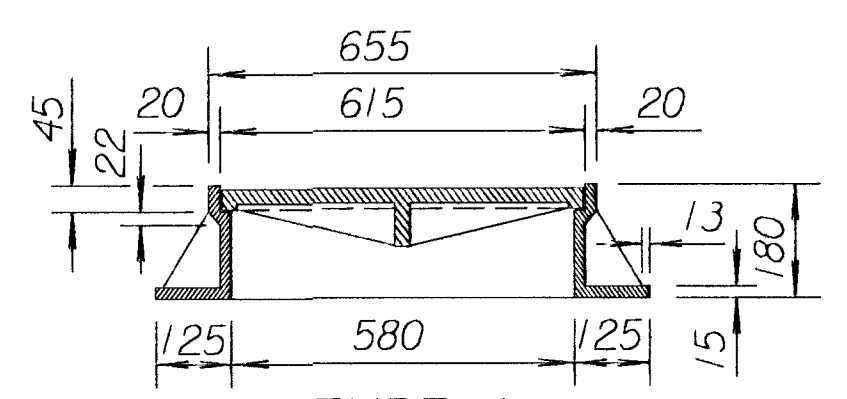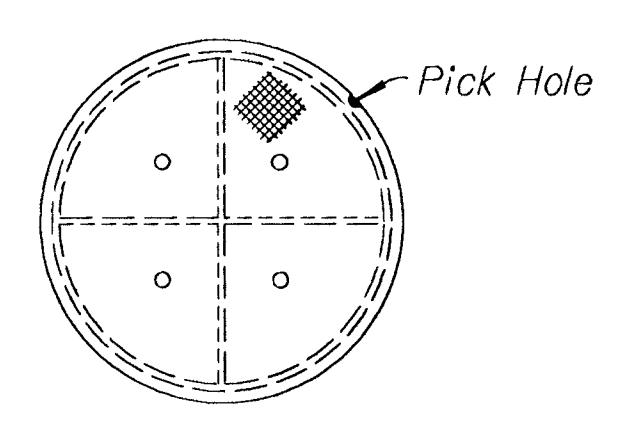


TYPE A

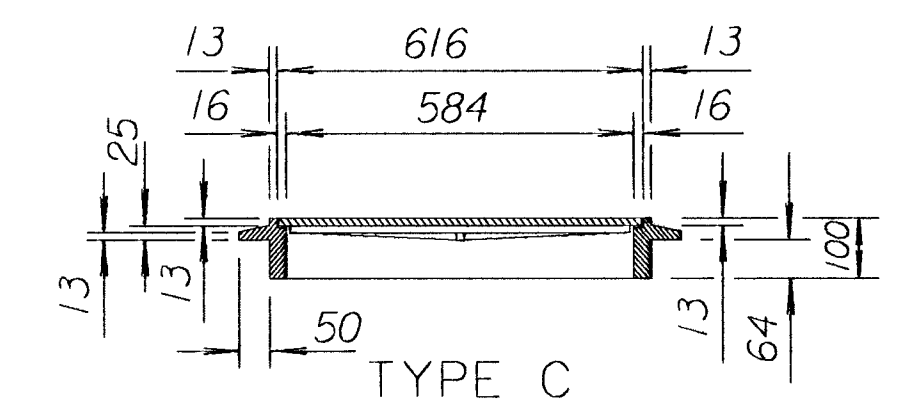

TYPE C

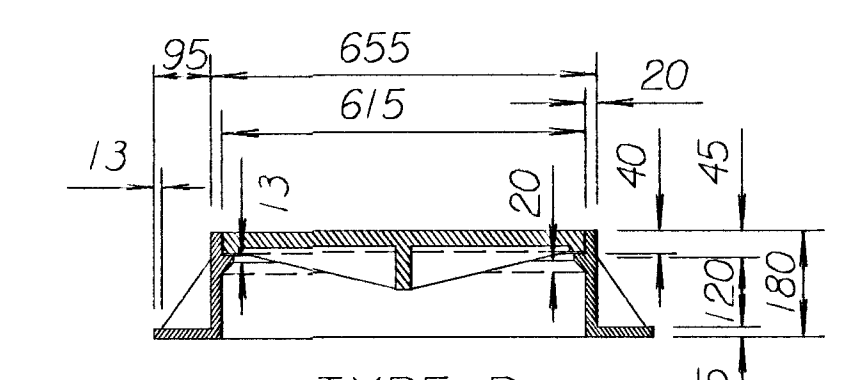

TYPE B

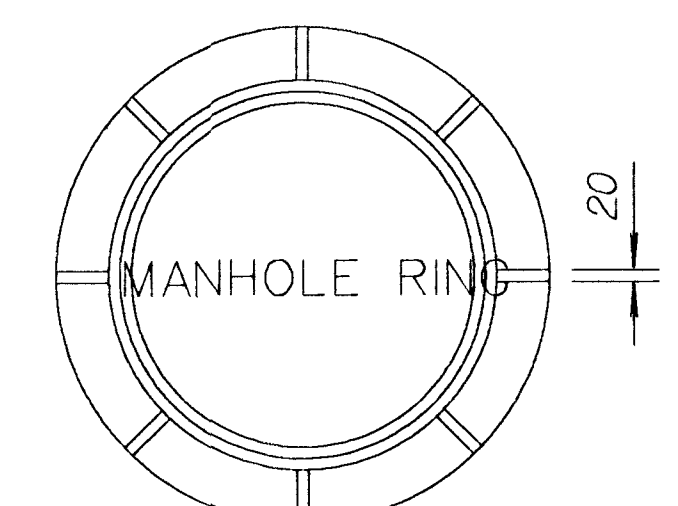

MANHOLE RING

(Type A Ring= 87 kg, Type B Ring= 90 kg)

HEAVY TYPE MANHOLE COVER AND RING

Note: Either Type A or Type B may be used.

*LIGHT TYPE MANHOLE COVER & RING

*Rings with four equally spaced lugs will be permitted.

3					
2					
1					
NO.	DATE	REVISIONS	BY	APP'D	

KANSAS DEPARTMENT OF TRANSPORTATION					
REINFORCED CONCRETE MANHOLE					
RD730 SI					
FHWA APPROVAL	1-10-95	APP'D. James O. Brewer			
DESIGNED	TRACED	QUANTITIES	BOWSER		
DESIGN CK.	DETAIL CK.	QUAN. CK.	TRACE CK. Seitz		

Drawn By: \$\$\$\$ USERNAME \$\$\$ Plotted: \$\$\$\$SYTIME\$\$\$\$
File: \$\$\$\$ DOWNSPEC \$\$\$

\\VETIVE\PROJECTS\KANSAS\RD730\15-2000-1510-25