


STA. 15+08.01, LINE 1=  
STA. 10+00.00, LINE 3=  
ST. STA. 20+53.03, 40.0' LT.  
16"x8" TEE  
MATCH POINT

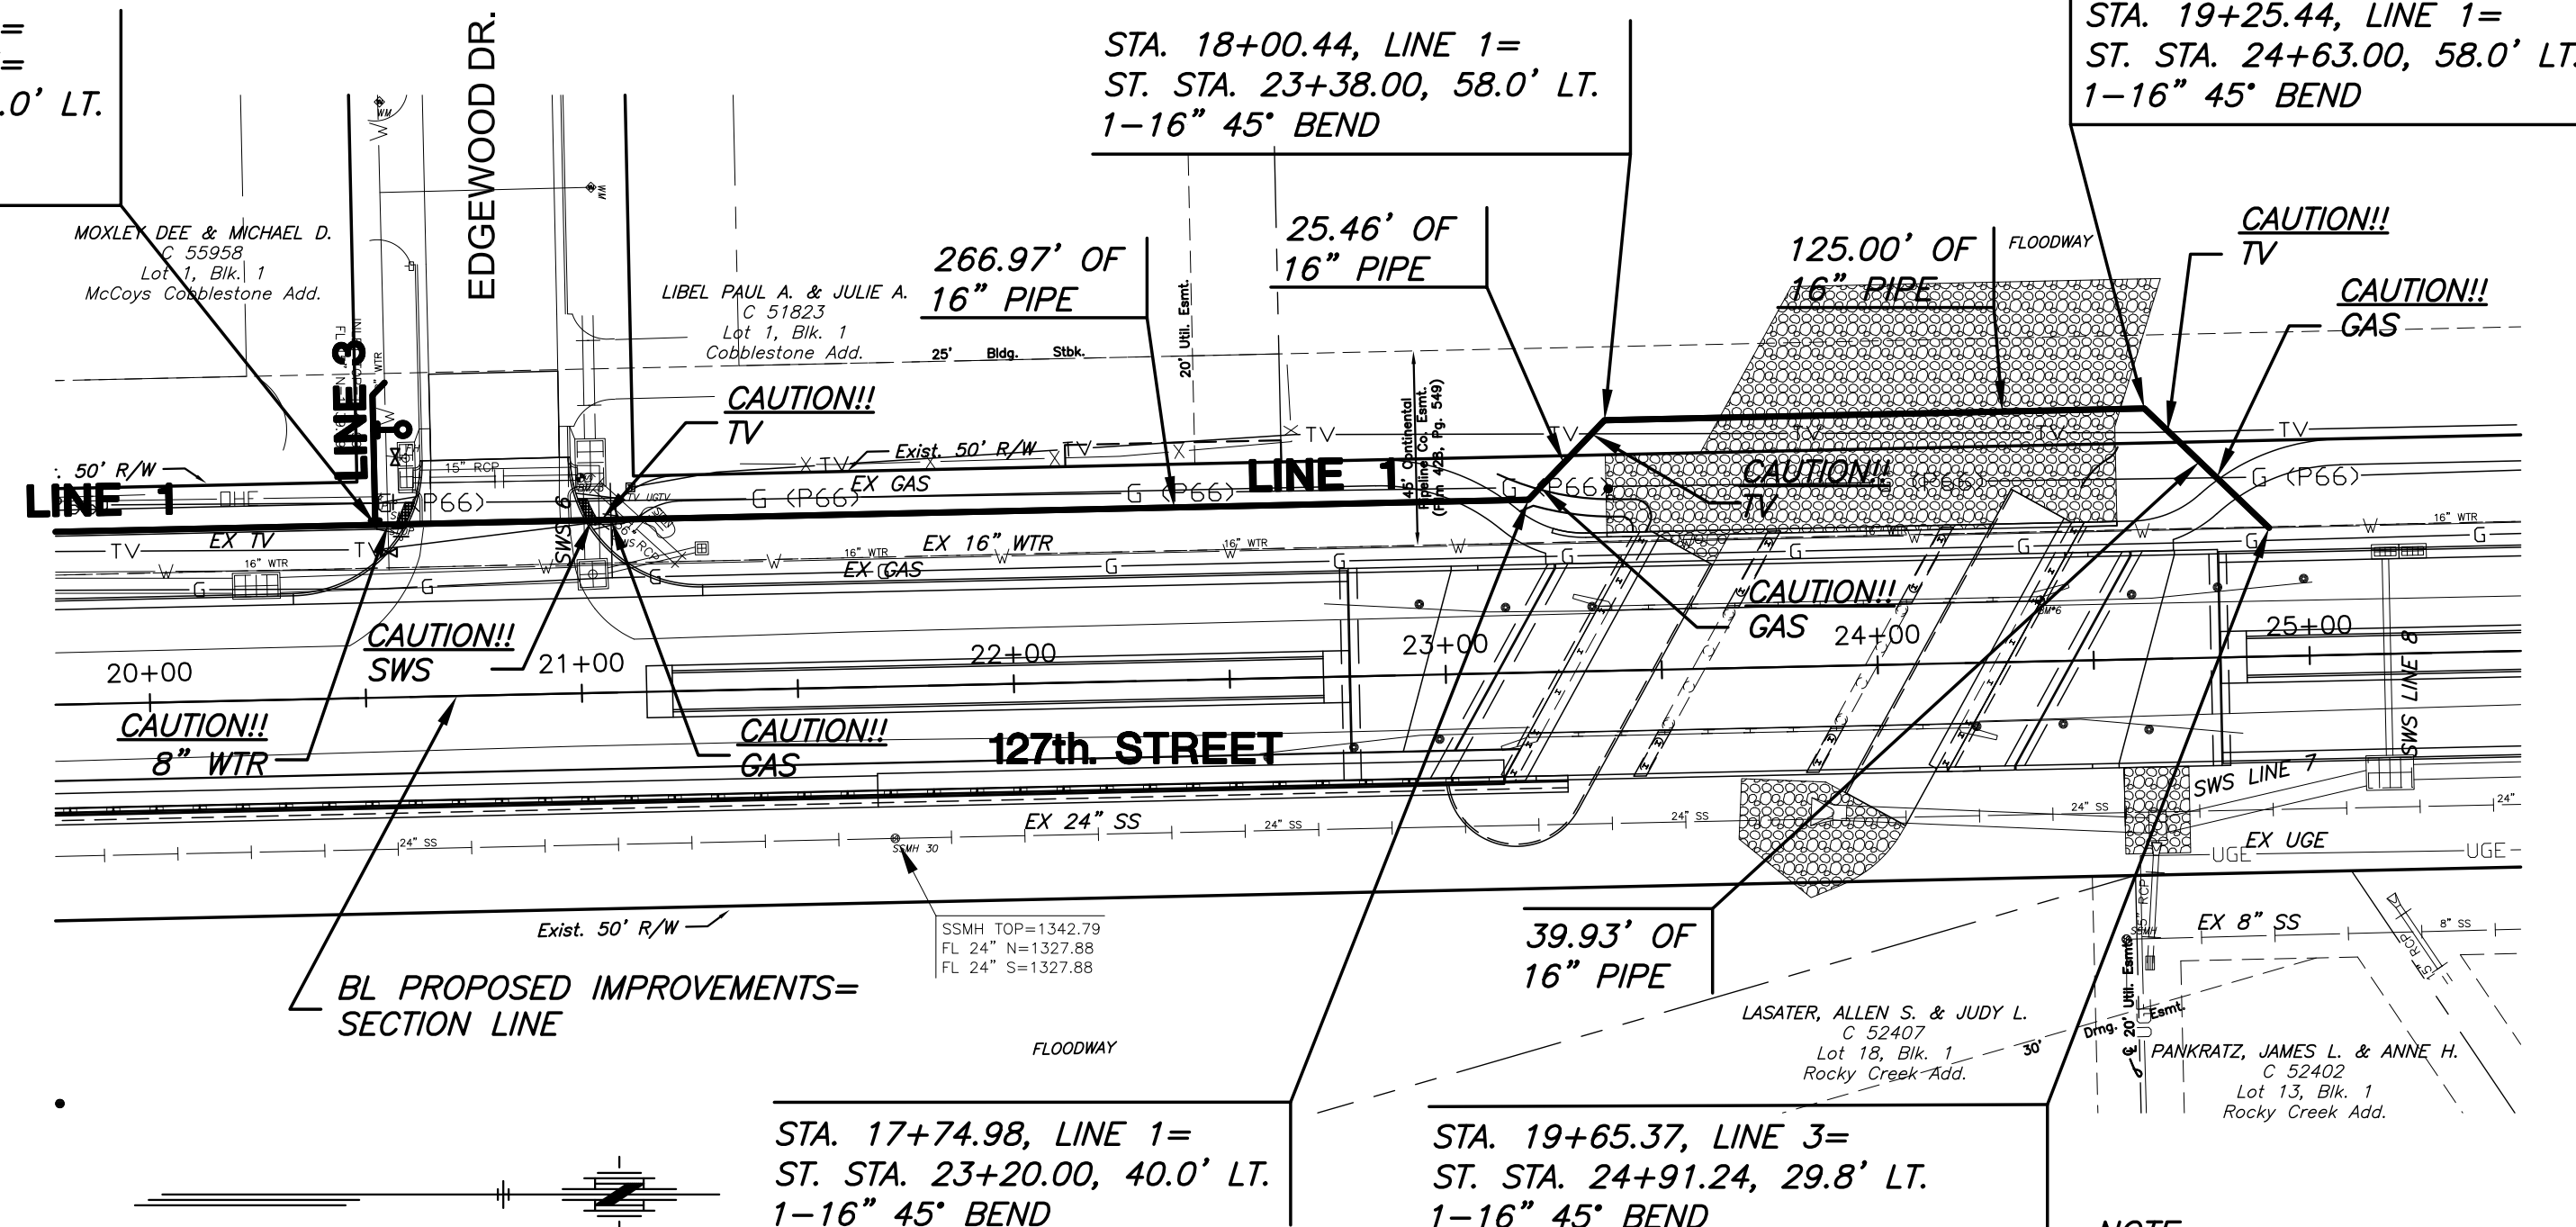

STA. 17+74.98, LINE 1=  
ST. STA. 23+20.00, 40.0' LT.  
1-16" 45° BEND


STA. 19+65.37, LINE 3=  
ST. STA. 24+91.24, 29.8' LT.  
1-16" 45° BEND  
1-16" ANCH. VALVE ASSY. (N)  
ON EXISTING 16" PIPE (N)  
ABANDON 16" PIPE (S)

**NOTE:**  
The plan and profile for the portion of Line 1 to be installed trenchless shall generally conform to the alignments shown on this sheet. The contractor shall take note of physical obstructions, above and below ground utilities, right-of-way and the proposed and existing ground elevations. Contractor shall provide as-built plan and profile information to the city after installation of the pipe.


STA. 10+00.00, LINE 3=  
STA. 15+08.01, LINE 1=  
ST. STA. 20+53.03, 40.0' LT.  
16"x8" TEE

STA. 10+21.94, LINE 3=  
ST. STA. 20+53.03, 61.9' LT.  
1- FIRE HYDRANT ASSY. (N)  
L=7.0'  
VALVE BOX EL=1343.20  
BURY LINE EL=1343.41

STA. 10+30.00, LINE 3=  
ST. STA. 20+53.03, 70.0' LT.  
1-8" 45° BEND

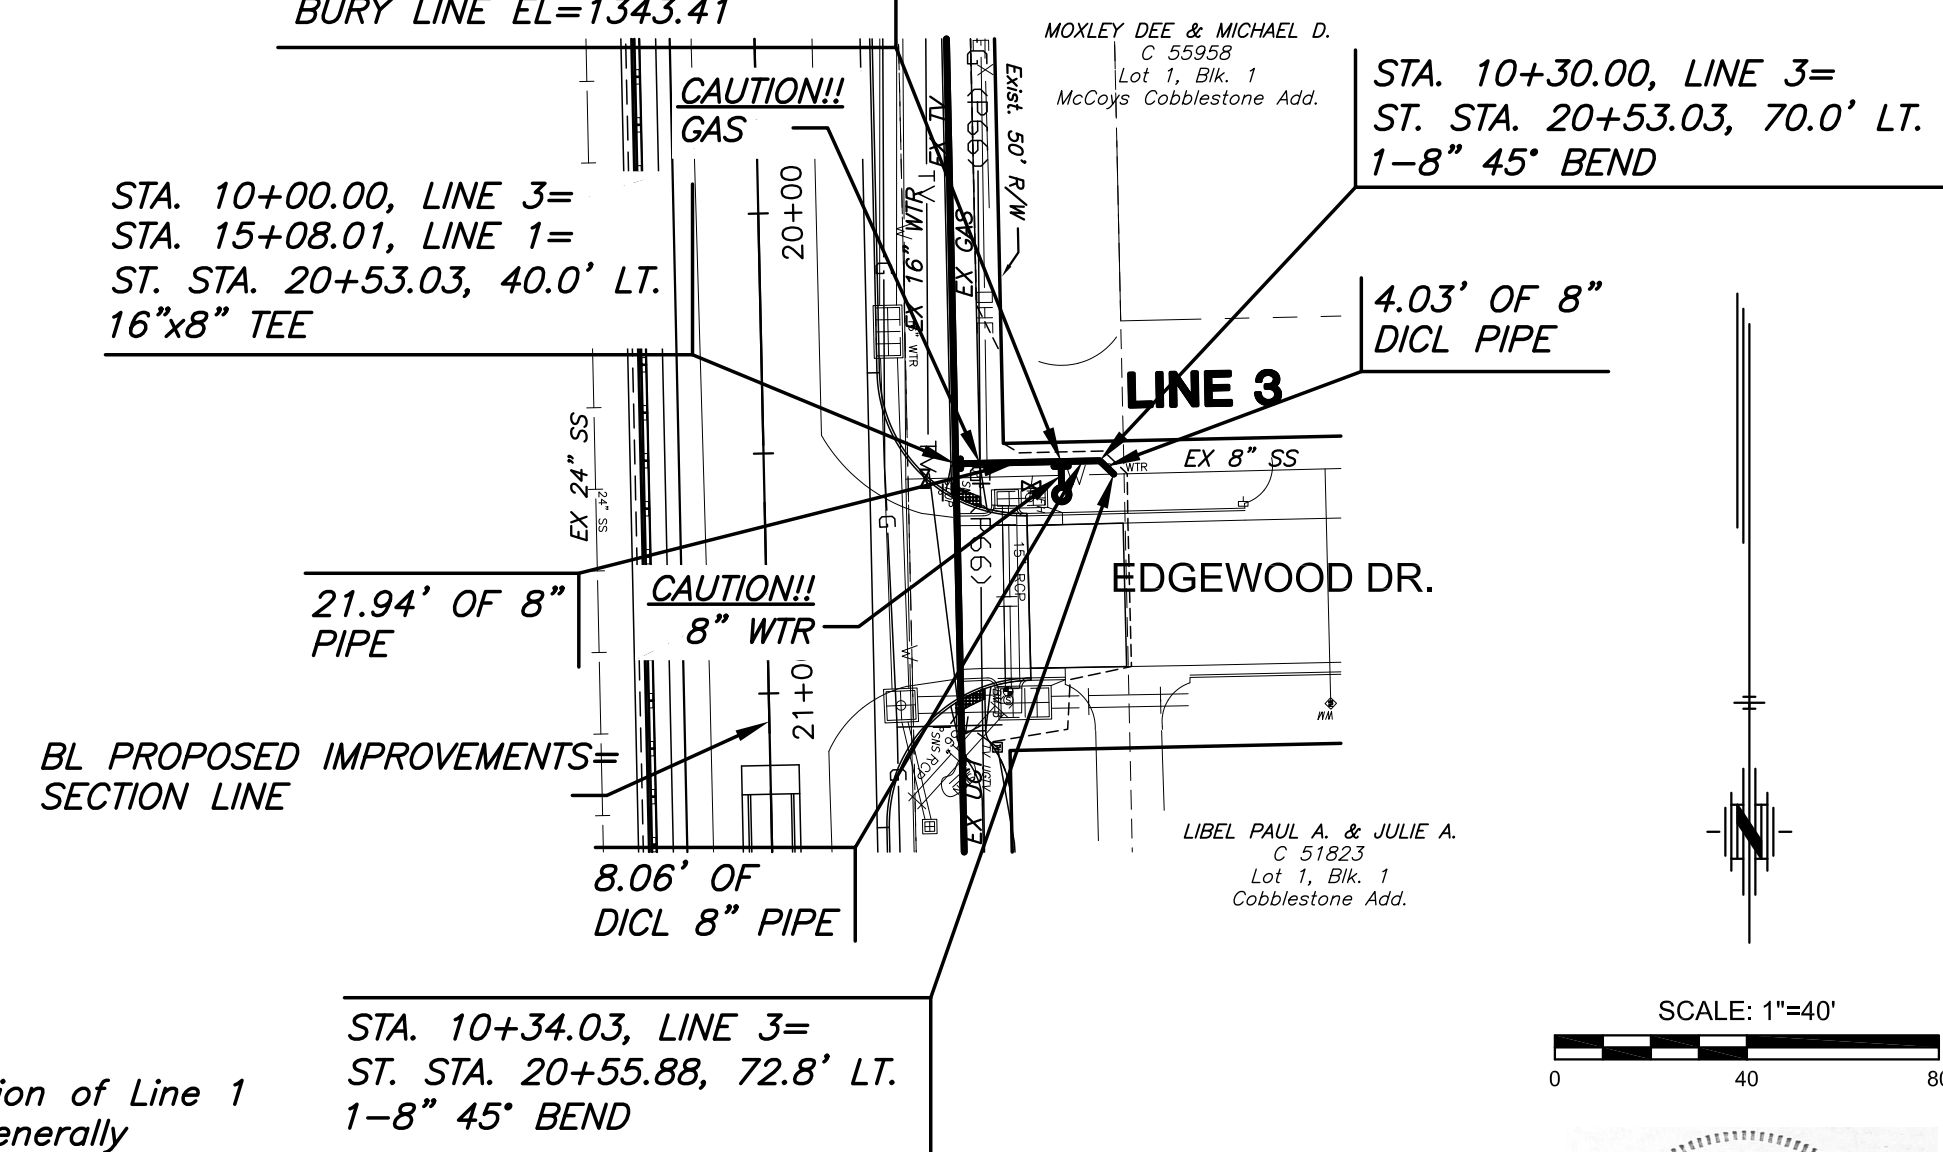

SCALE: 1"=40'

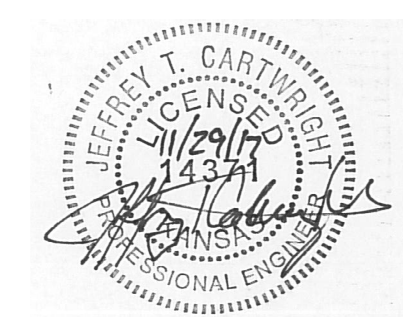


**NOTE:**  
CONTRACTOR TO VERIFY LOCATION AND ELEVATION OF EXISTING WATER LINE PRIOR TO CONSTRUCTION.

**PLAN LINE 1 (CONT.)**

**PLAN LINE 3**


**PROFILE LINE 1 (CONT.)**

SCALE: HORIZ. 1"=40'  
SCALE: VERT. 1"=5'

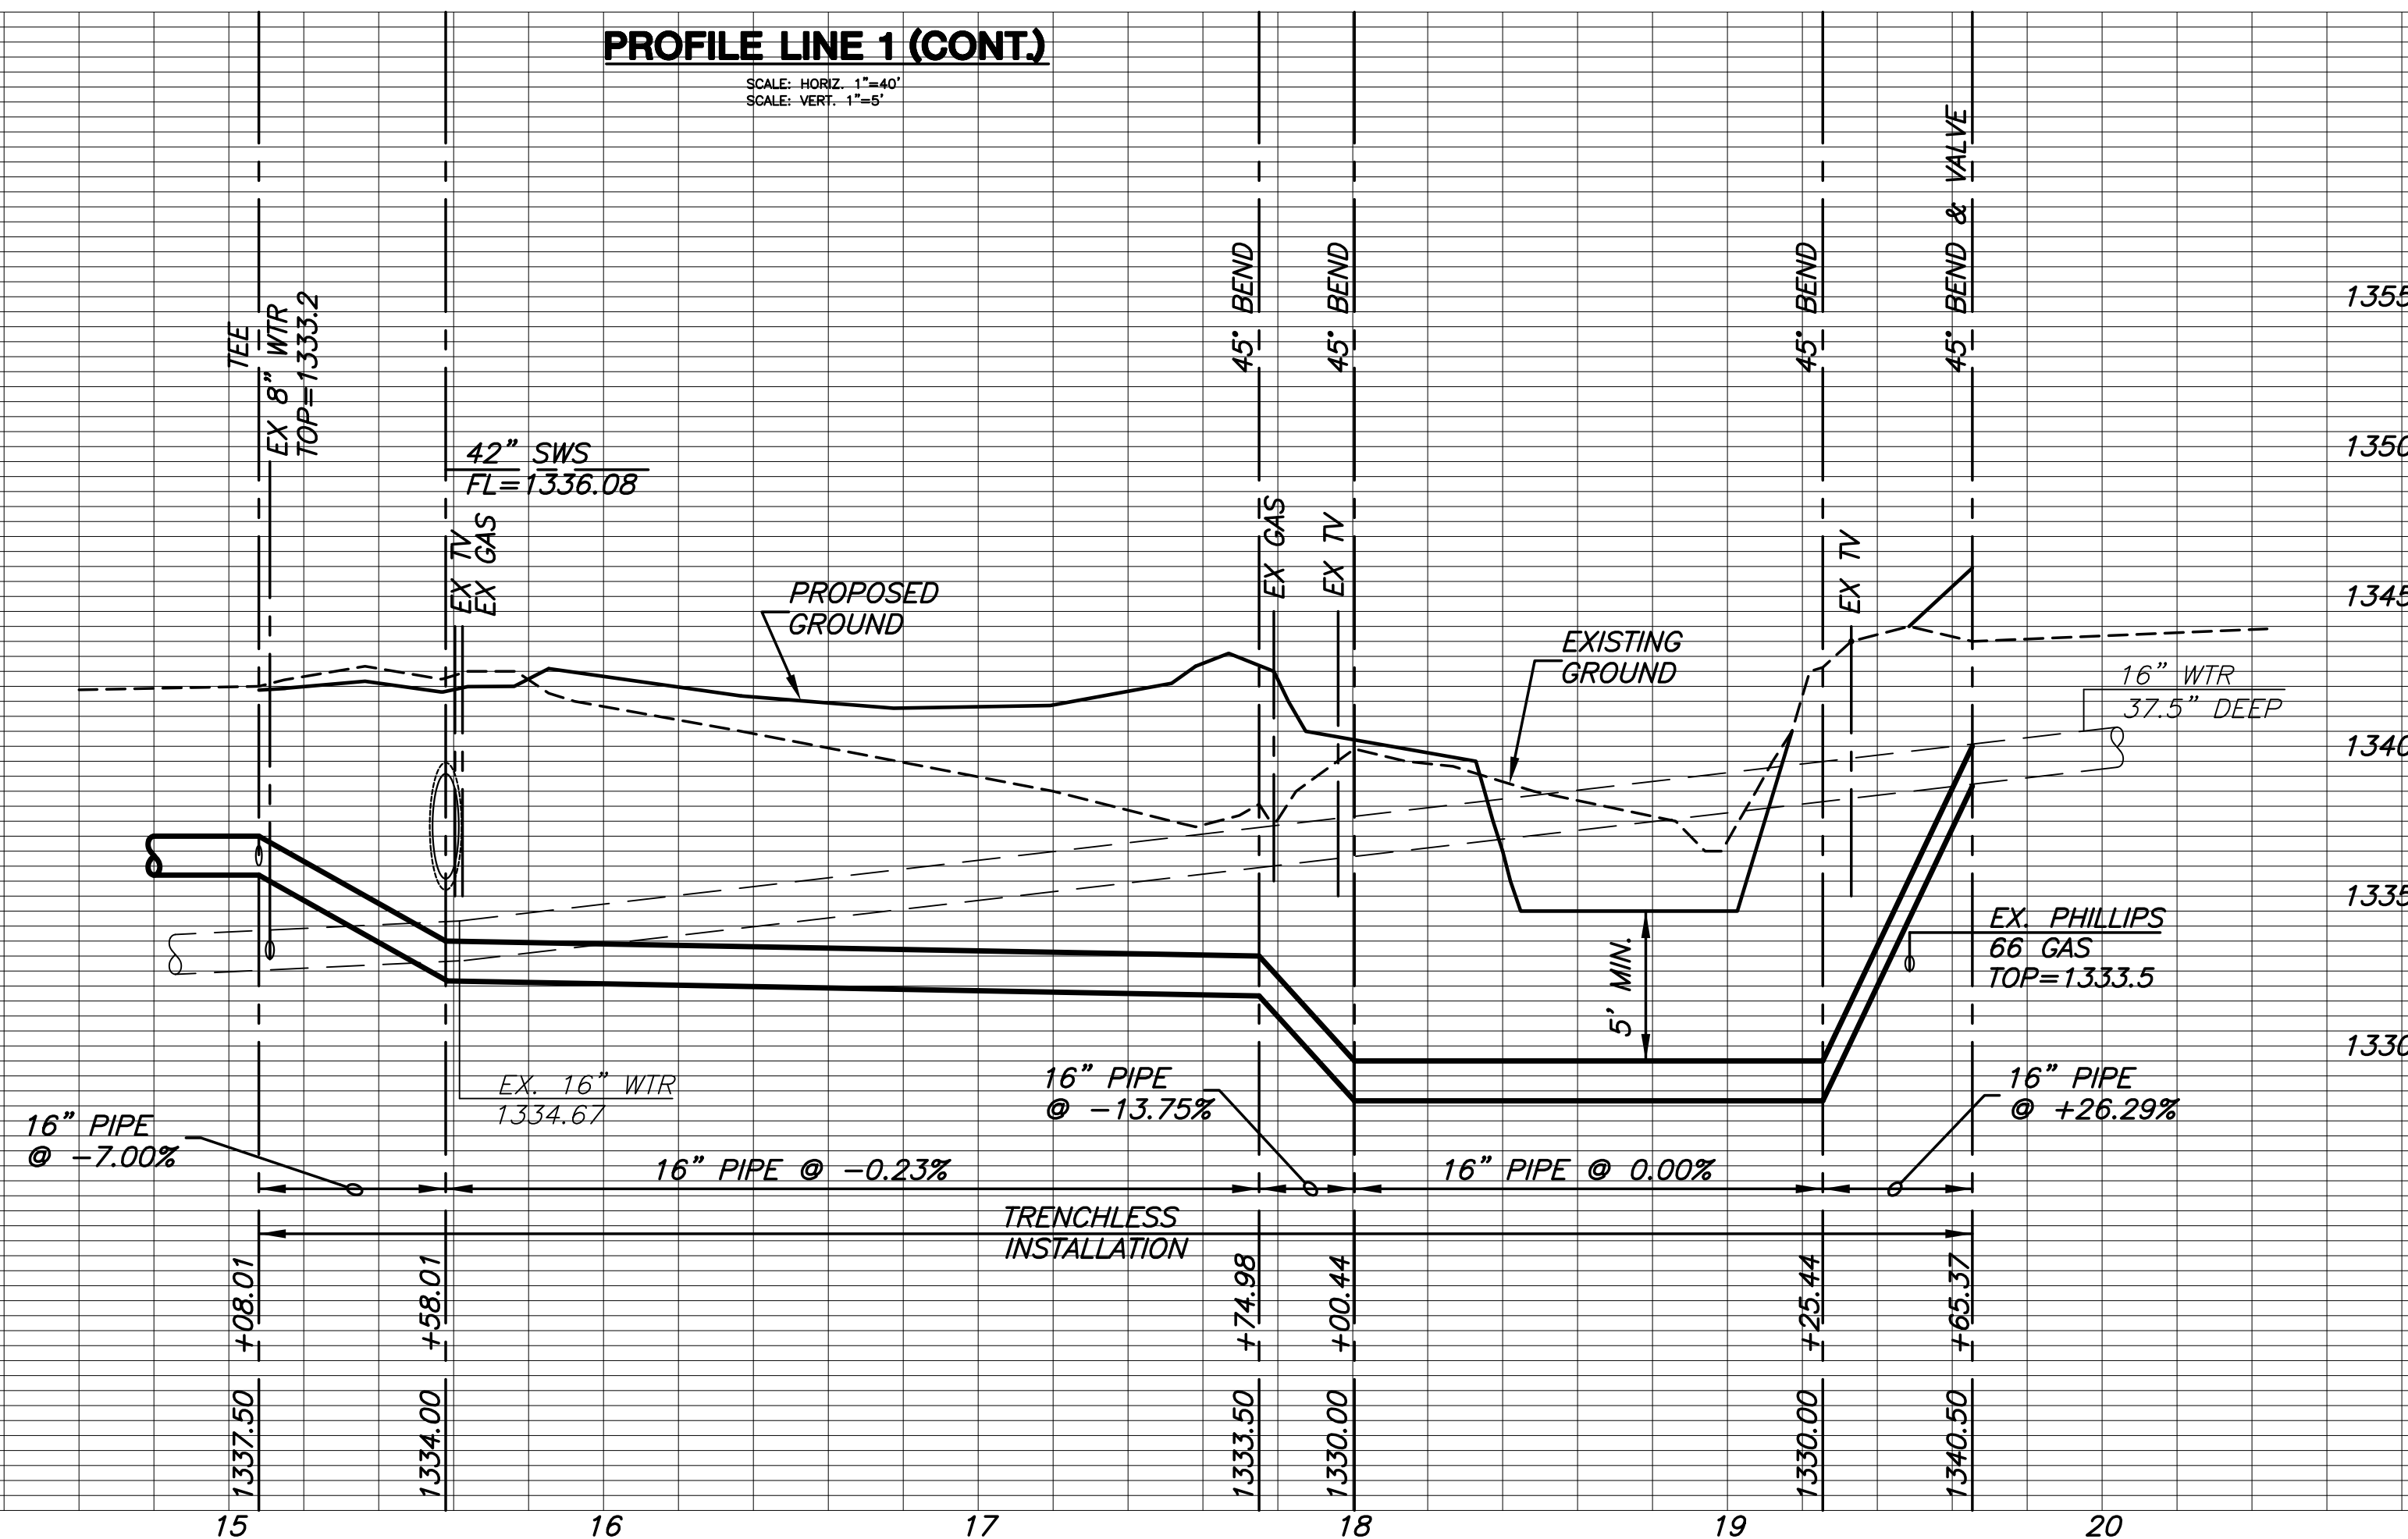

**PROFILE LINE 3**

SCALE: HORIZ. 1"=40'  
SCALE: VERT. 1"=5'

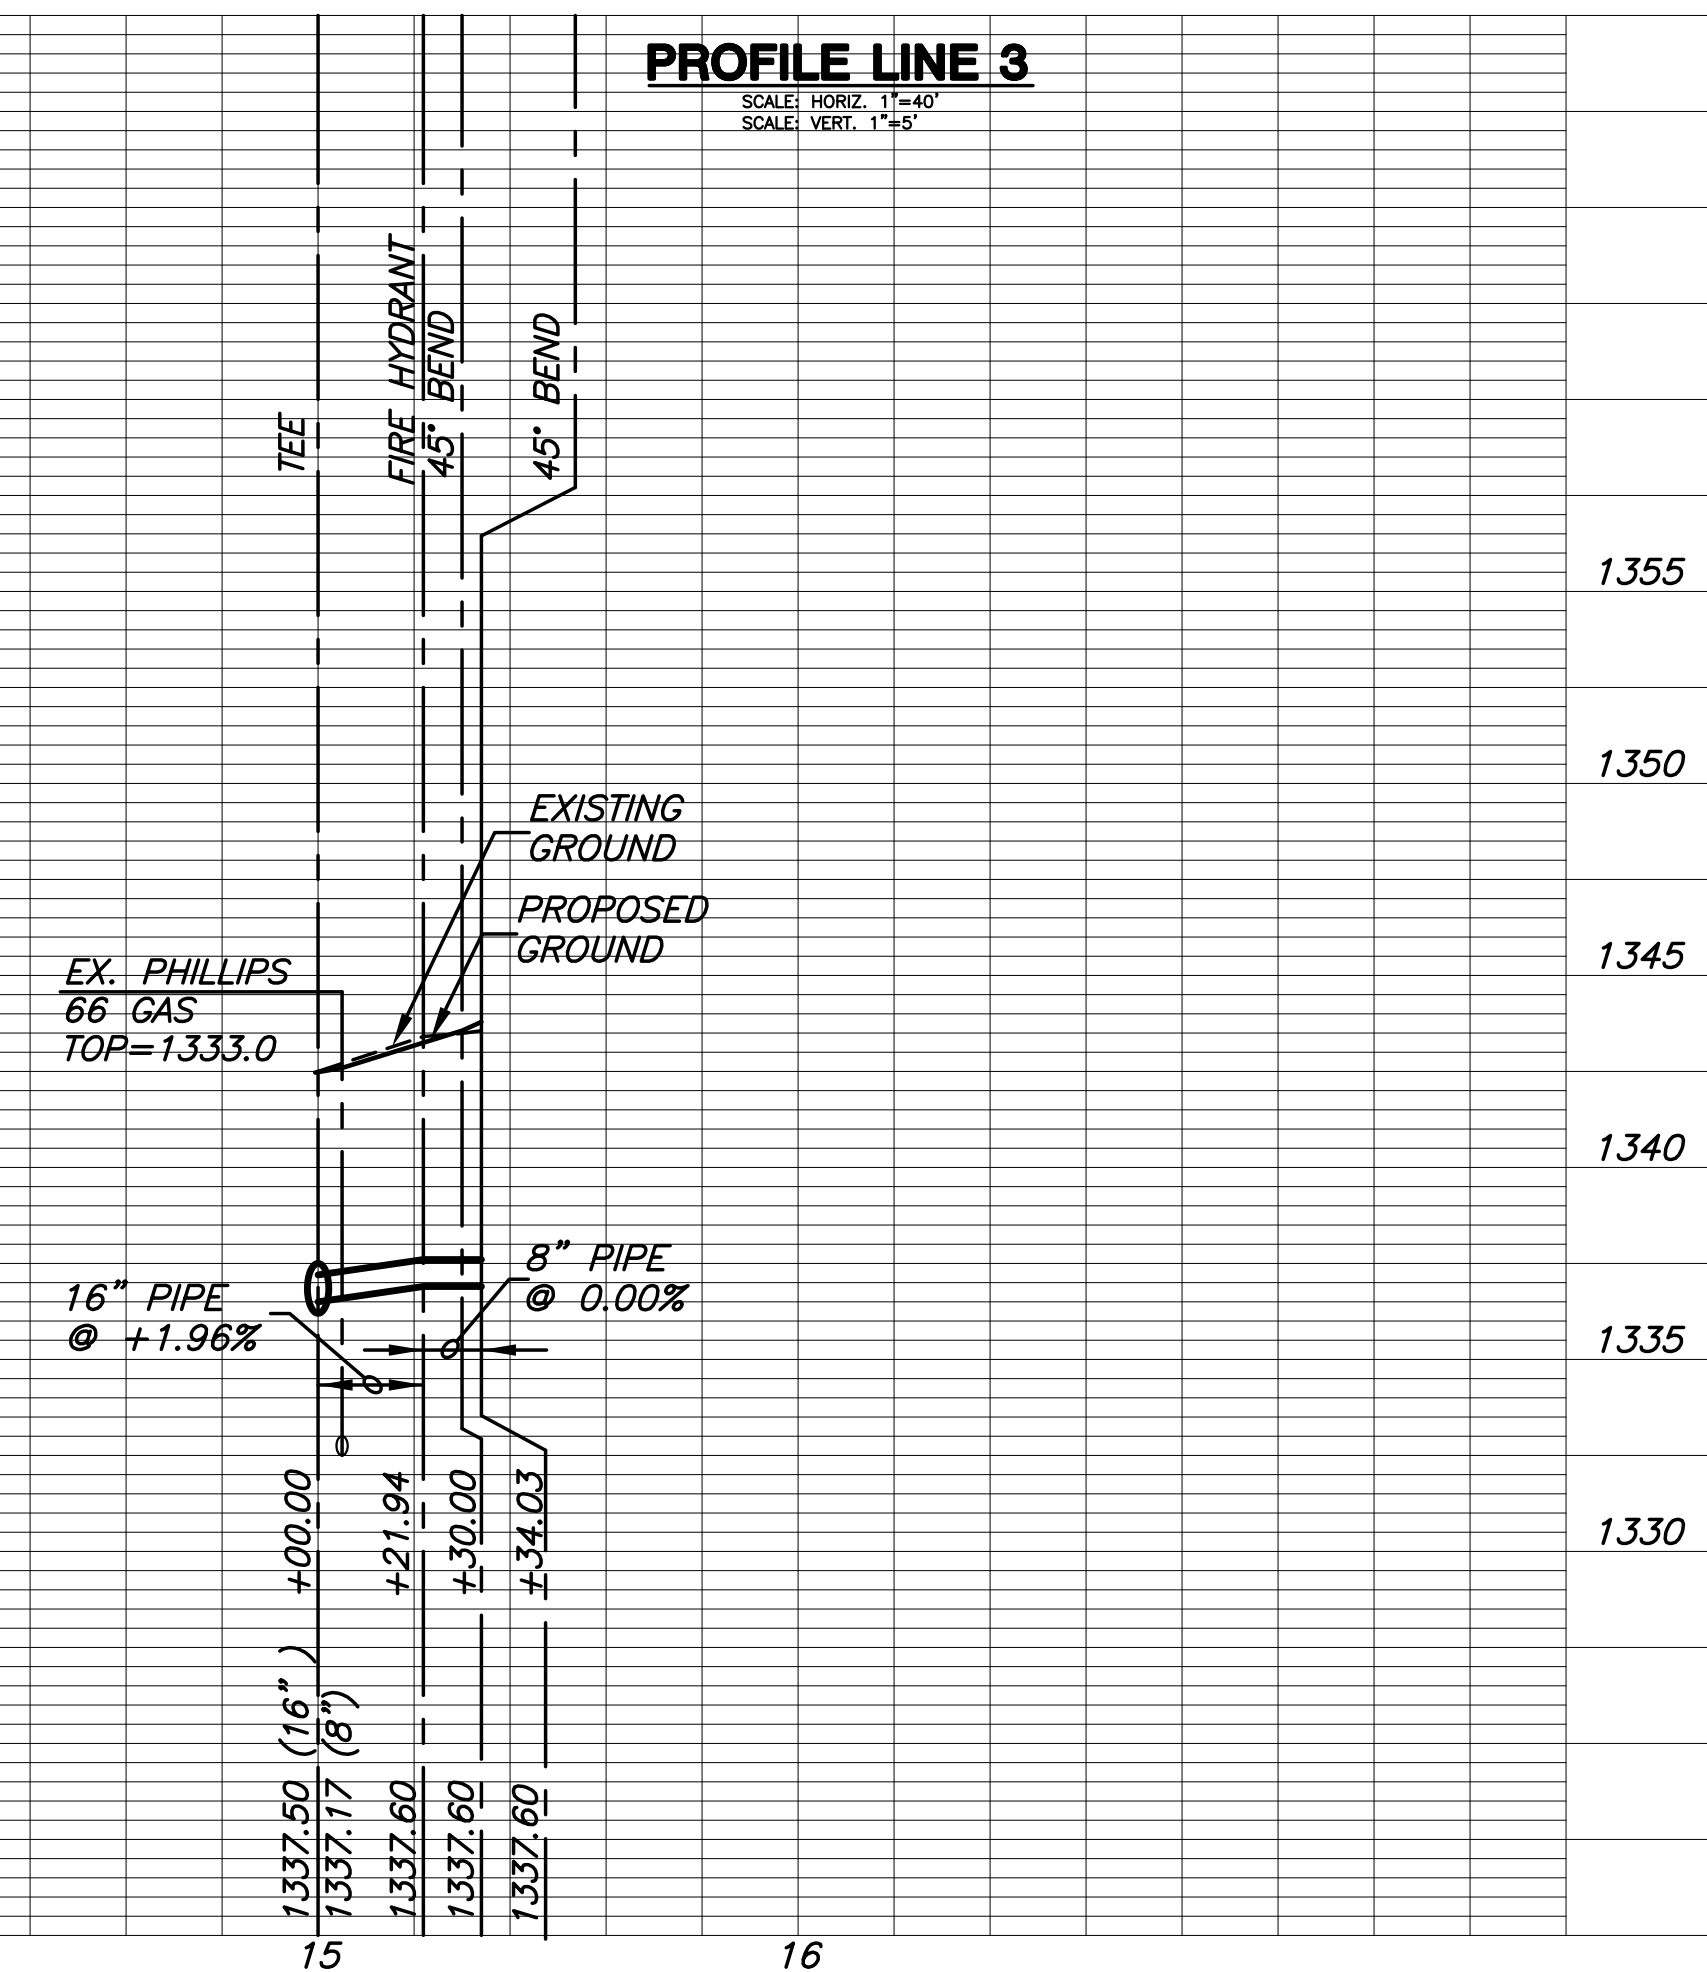

©2017 MKEC Engineering All Rights Reserved  
www.mkec.com  
These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

**WATER LINES 1 CONT. & 3**

PROJECT NO.	472-85158	
DATE	11/29/17	
SCALE	AS SHOWN	
DESIGNED	DRAWN	CHECKED
JTC	DM	JRA

NO.	REVISION	DATE