


FED. AID NO. CMQ-NO19(901)


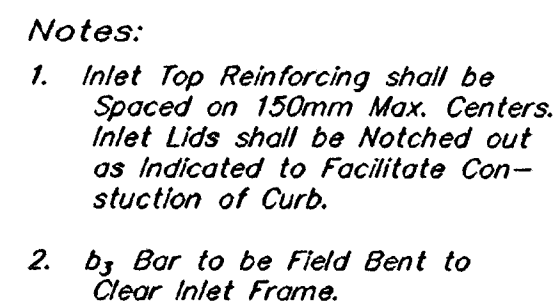


STEEL SCHEDULE

Note: a₁ Bars to be Placed Approx. 50mm Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS

1. *Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.*
2. *Contractor shall have the option of constructing 200mm brick masonry walls between the concrete inlet base and top on this inlet when W=1900mm and H=2100mm or less.*
3. *Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.*
4. *The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.*



*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.



HWS
Consulting Group Inc

Omaha Office
10844 Old Mill Rd., Ste 1
Omaha, NE 68154
Phone: (402) 333-5792
Fax: (402) 333-2248

Designed By:	BWE	Checked By:	RJK
Drawn By:	HS, TS	Date:	3-25-2002
		Job No.	55-70-2003