



FHWA REG NO.	STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
7	KANSAS	87 N-0199-01	2002	111	158

FED. AID NO. CMQ-NO19(901)

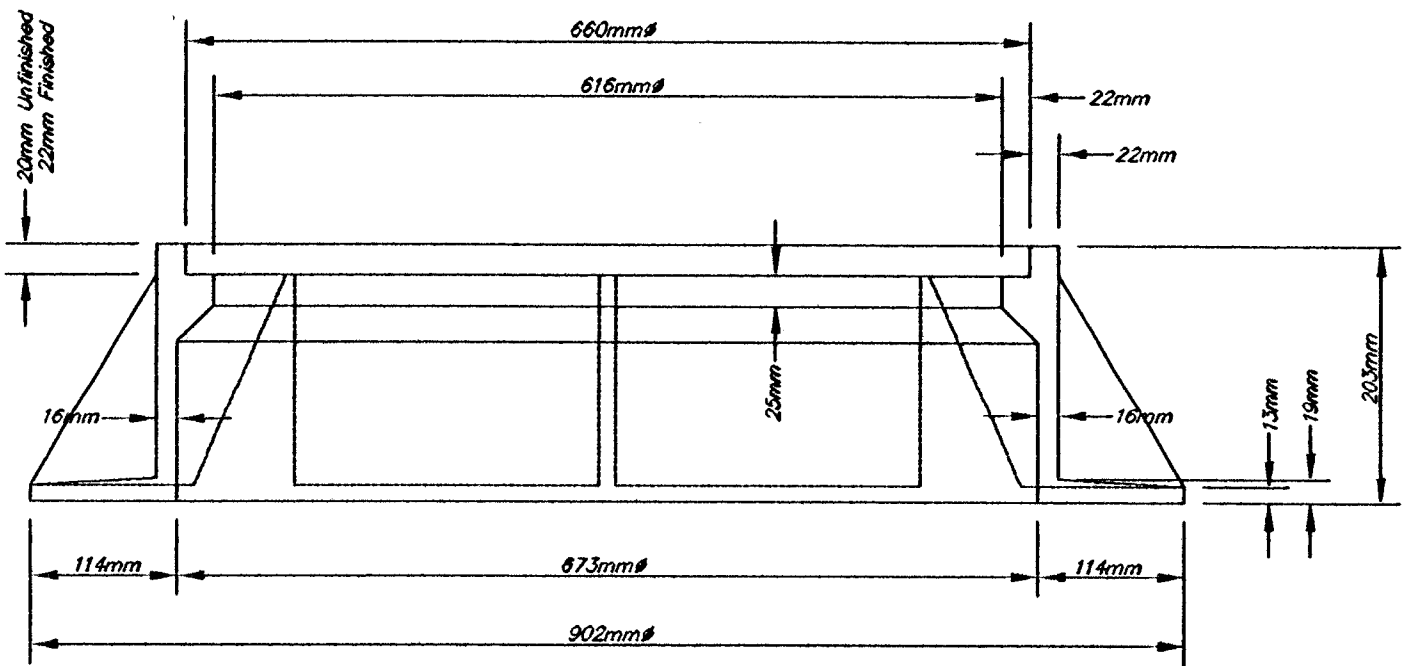

STANDARD MANHOLE FRAME SECTION
Weight = 109kg

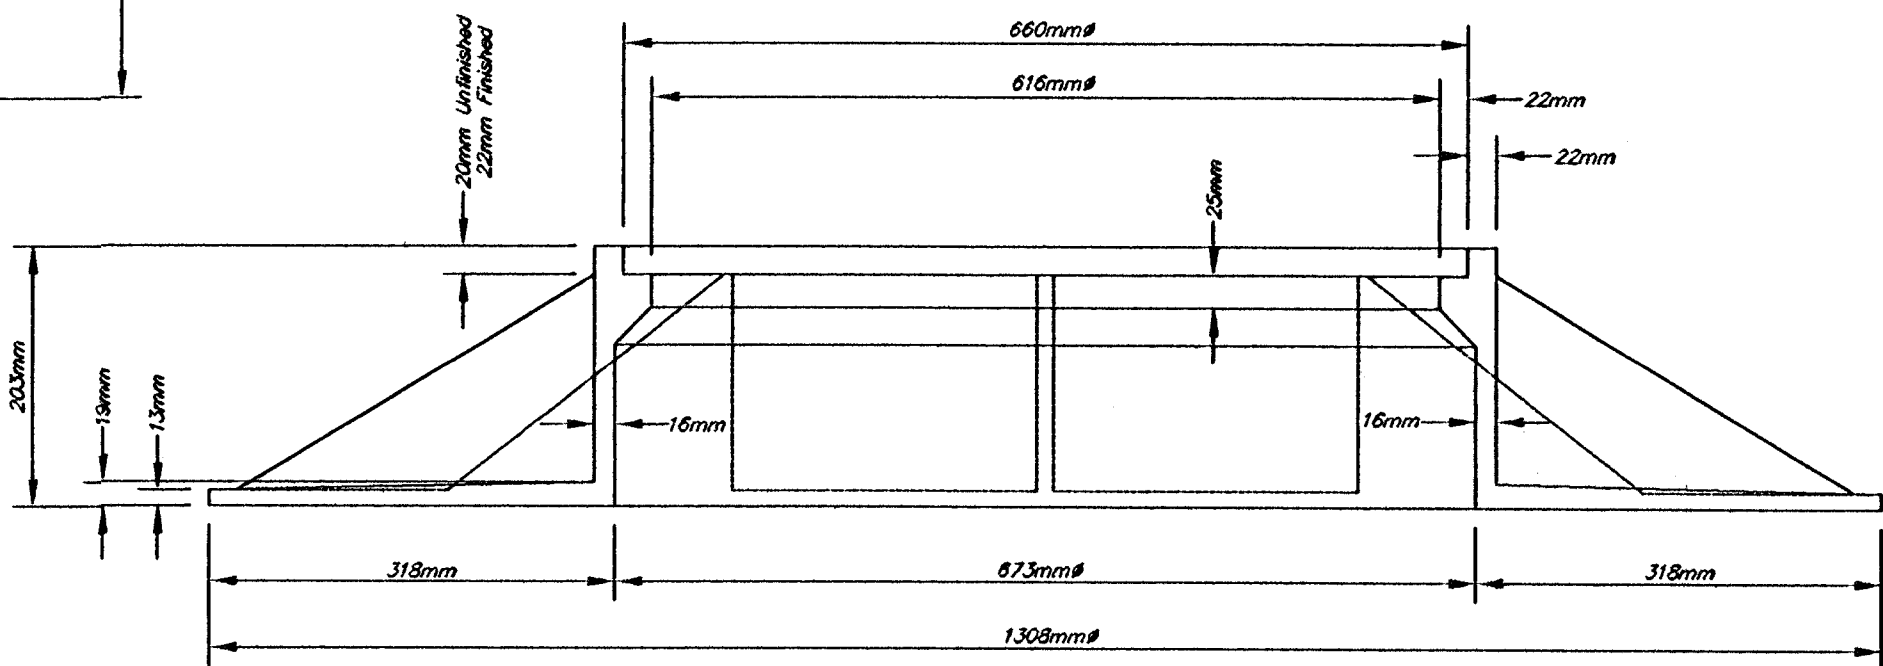


WIDE FLANGE MANHOLE FRAME SECTION
Weight = 320kg


GENERAL NOTES:

- MORTAR USED IN MASONRY CONSTRUCTION SHALL BE CITY OF WICHITA "B SACK" MIX. CONCRETE USED IN MANHOLE WALLS AND BASES SHALL CONFORM TO THE REQUIREMENTS FOR CONCRETE PAVEMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS, USING CITY CONCRETE PAVEMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACED AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.
- THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF-CLEANING, USING 8 SACK SAND MIX CONCRETE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE. MANHOLE FLOORS SHALL HAVE SLOPES OF 250 MILLIMETERS PER METER IN THE AREAS OUTSIDE OF THE FLOW CHANNELS, SLOPED TOWARD THE FLOW CHANNELS.
- MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWING.
- THE ENDS OF ALL PIPES IN MANHOLES SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF MANHOLE WALL.


REINFORCED CONCRETE MANHOLE			
HWS Consulting Group Inc.		Omaha Office 10344 Old Mill Rd., Ste 1 Omaha, NE 68154 Phone: (402) 333-5792 Fax: (402) 333-2248	
Designed By:	EWE	Checked By:	RJK
Drawn By:	HS, TS	Date:	3-25-2002
		Job No.	55-70-2003

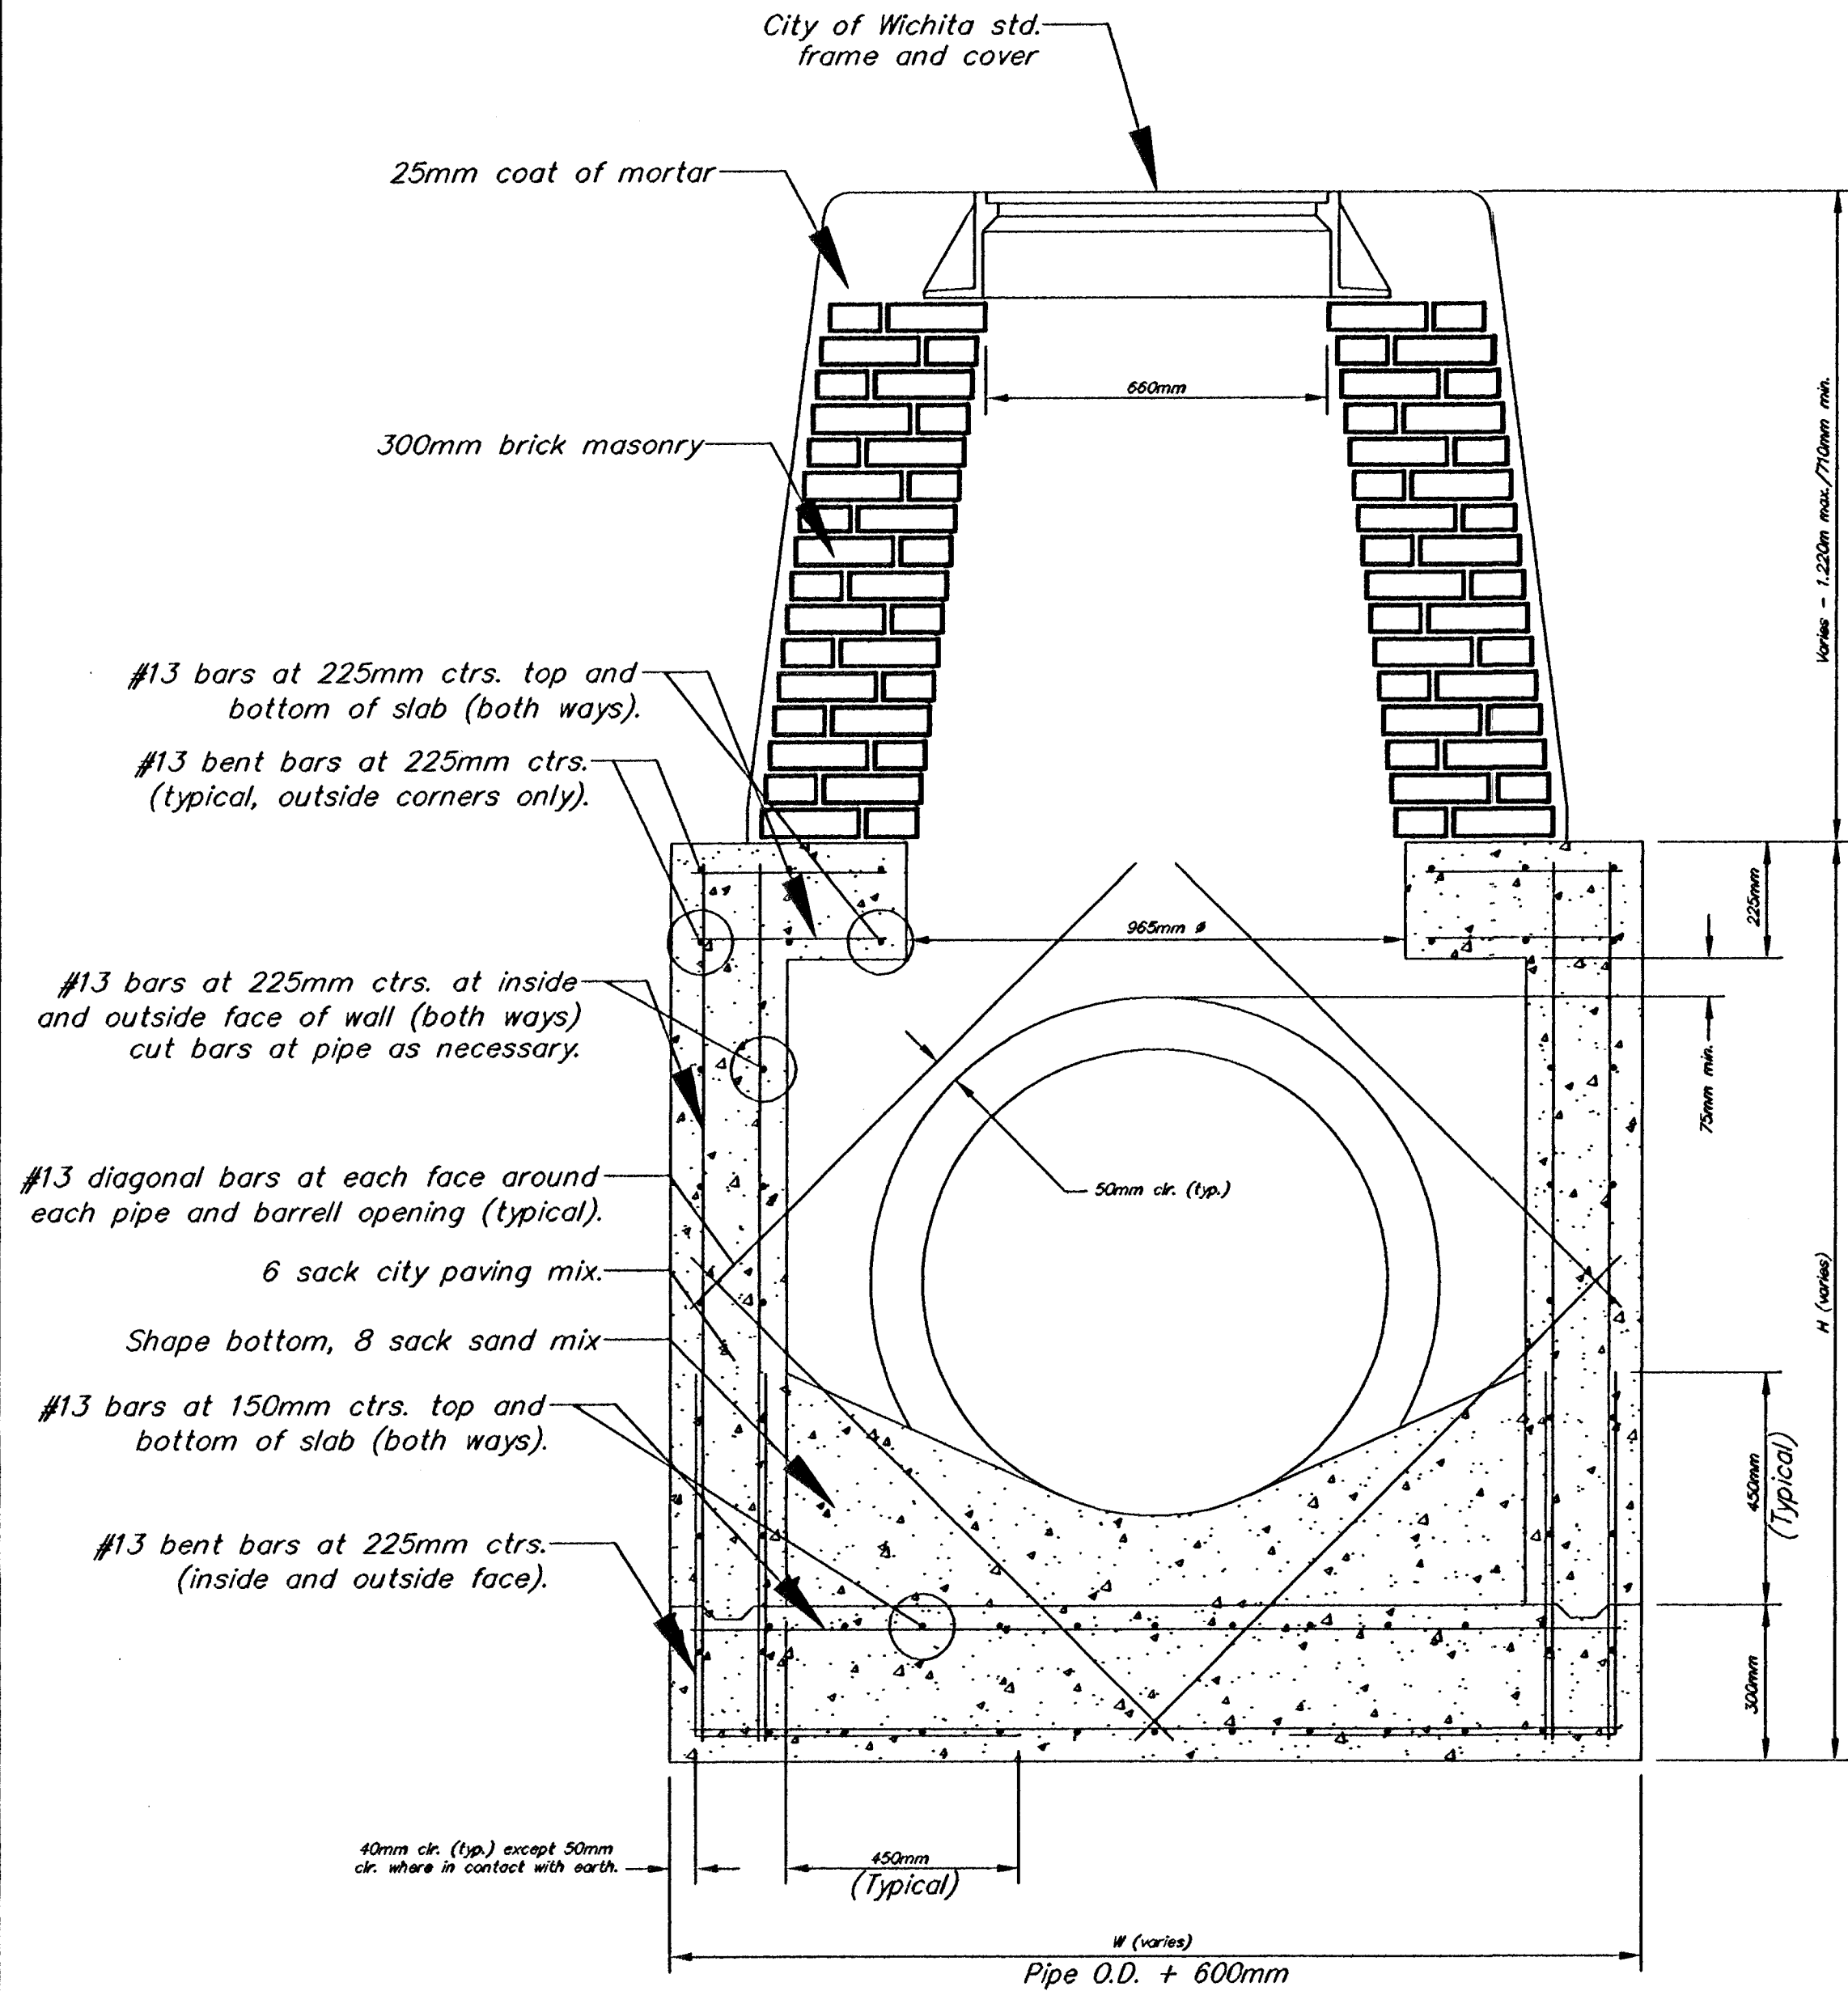


REINFORCED CONCRETE MANHOLE
STACK HEIGHT - 710MM TO 1.220M

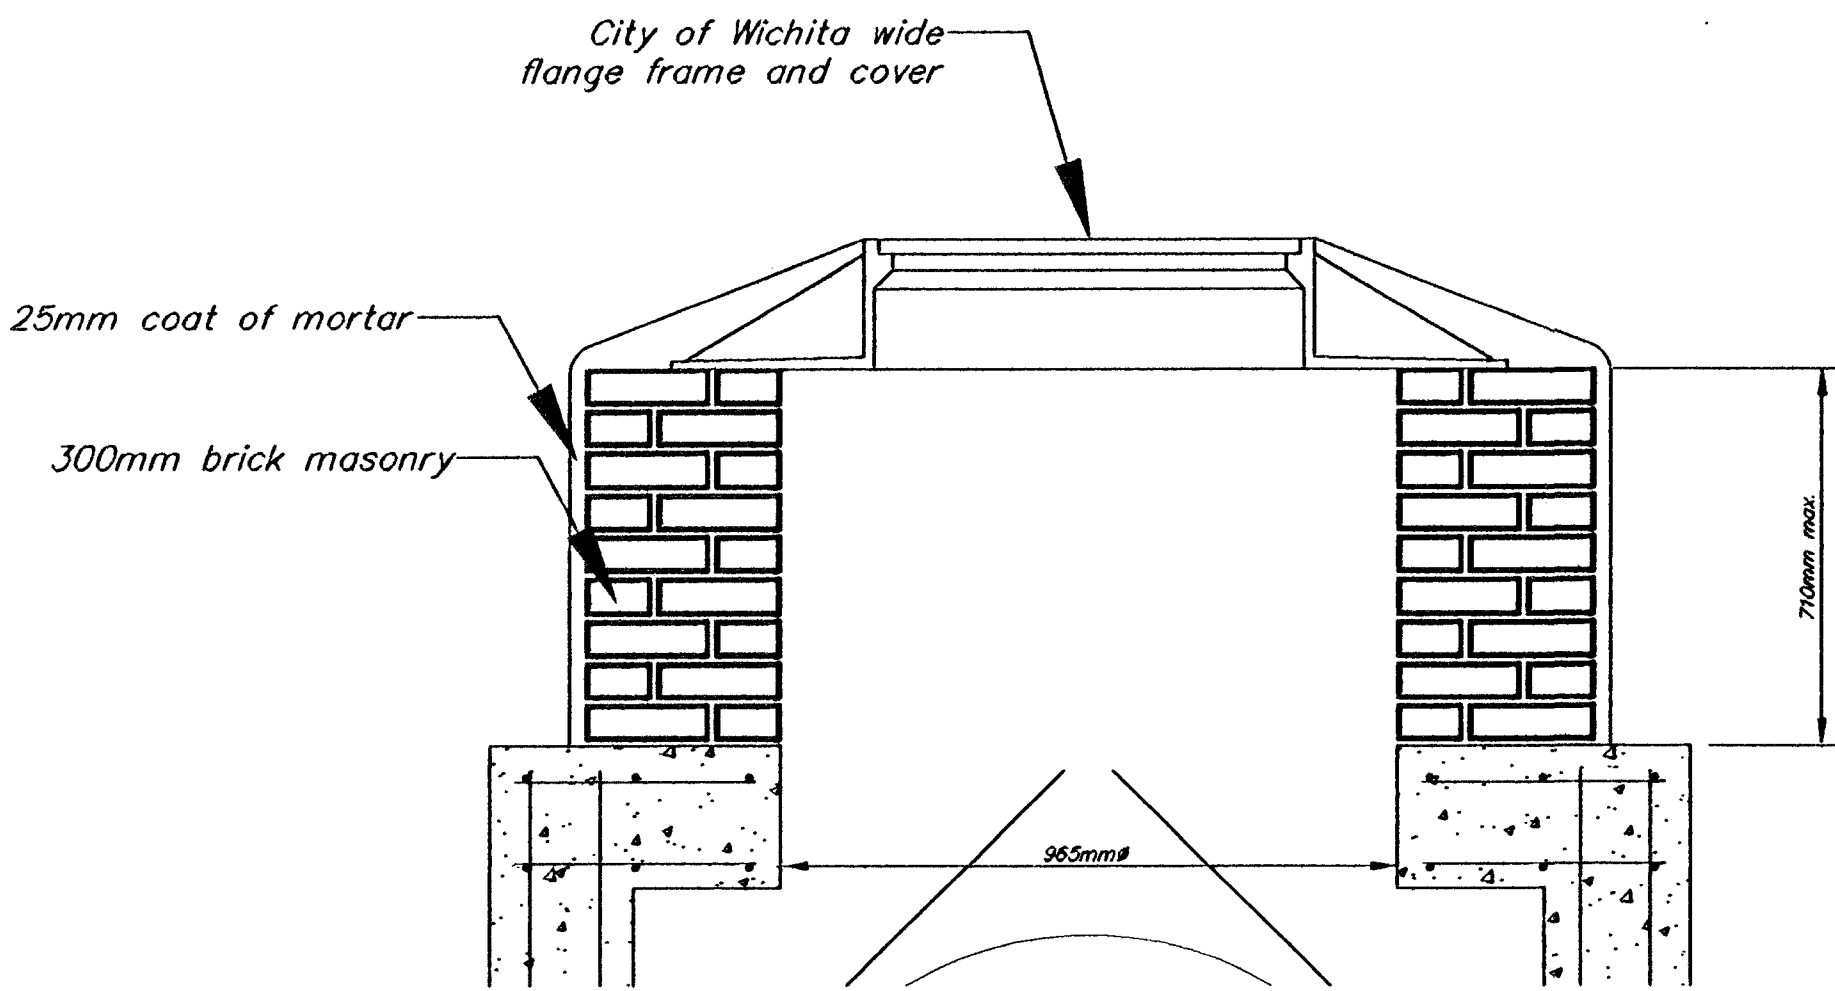

STACK HEIGHT LESS THAN 710MM

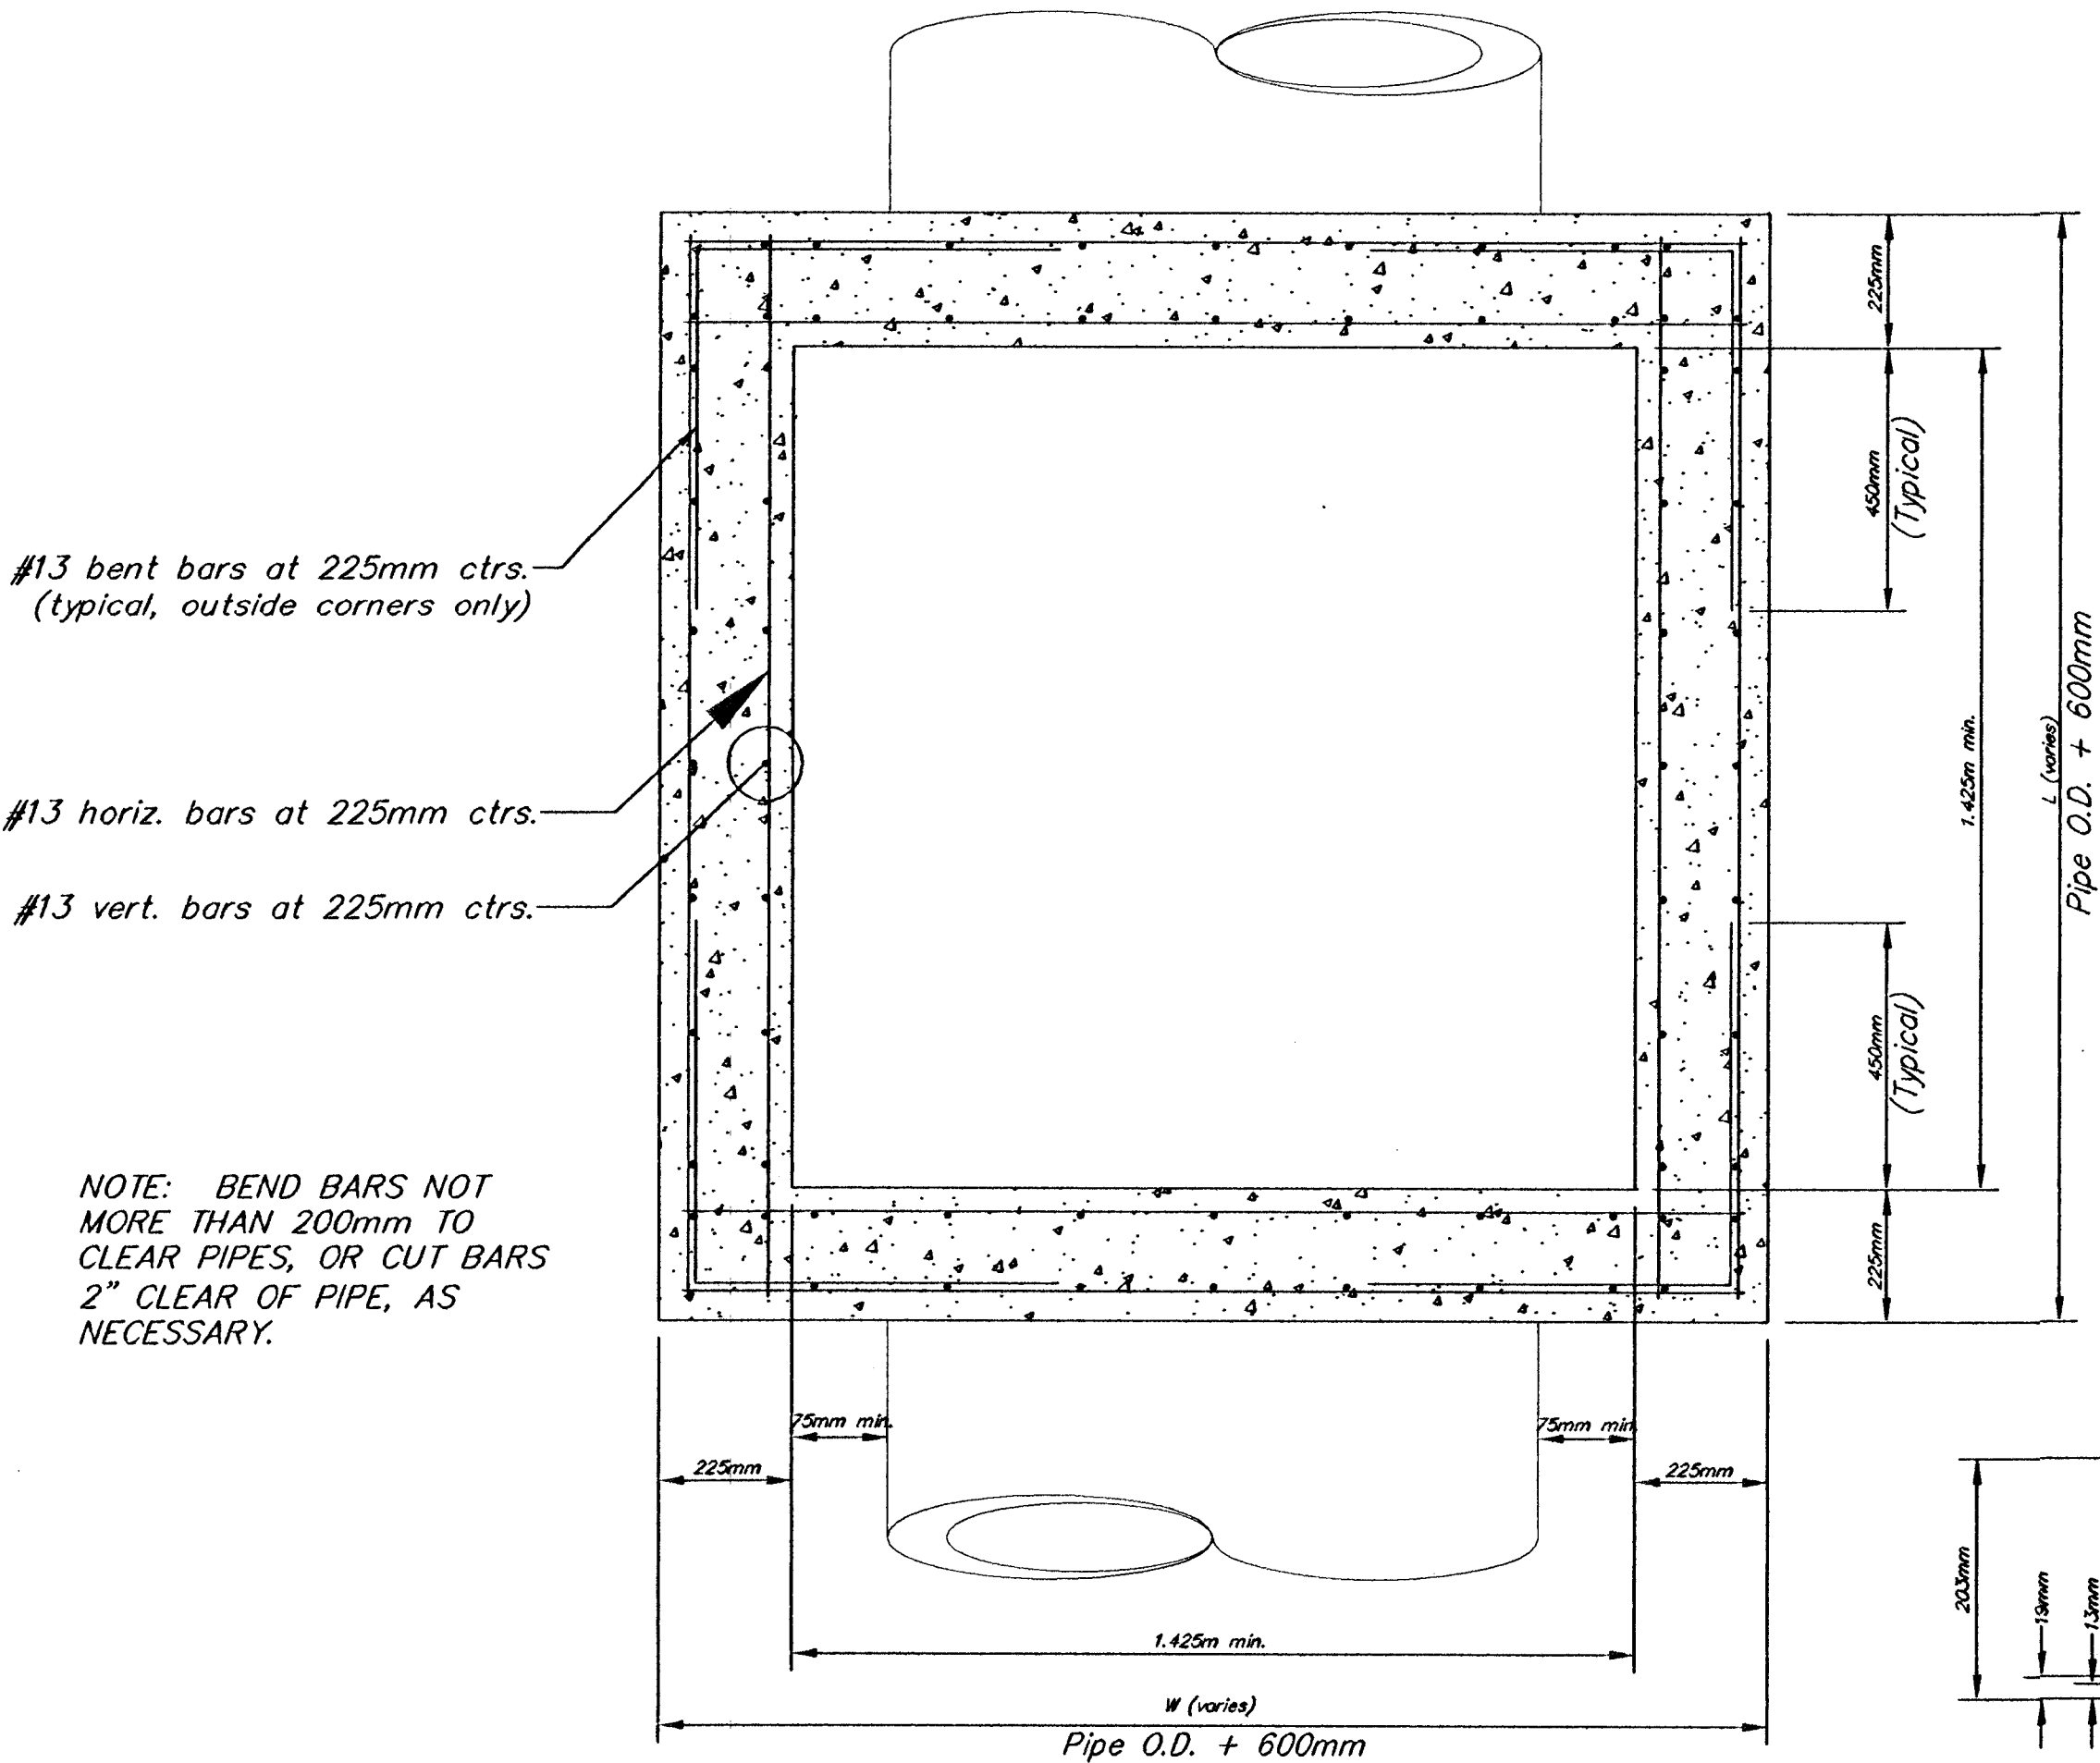

SECTION B-B

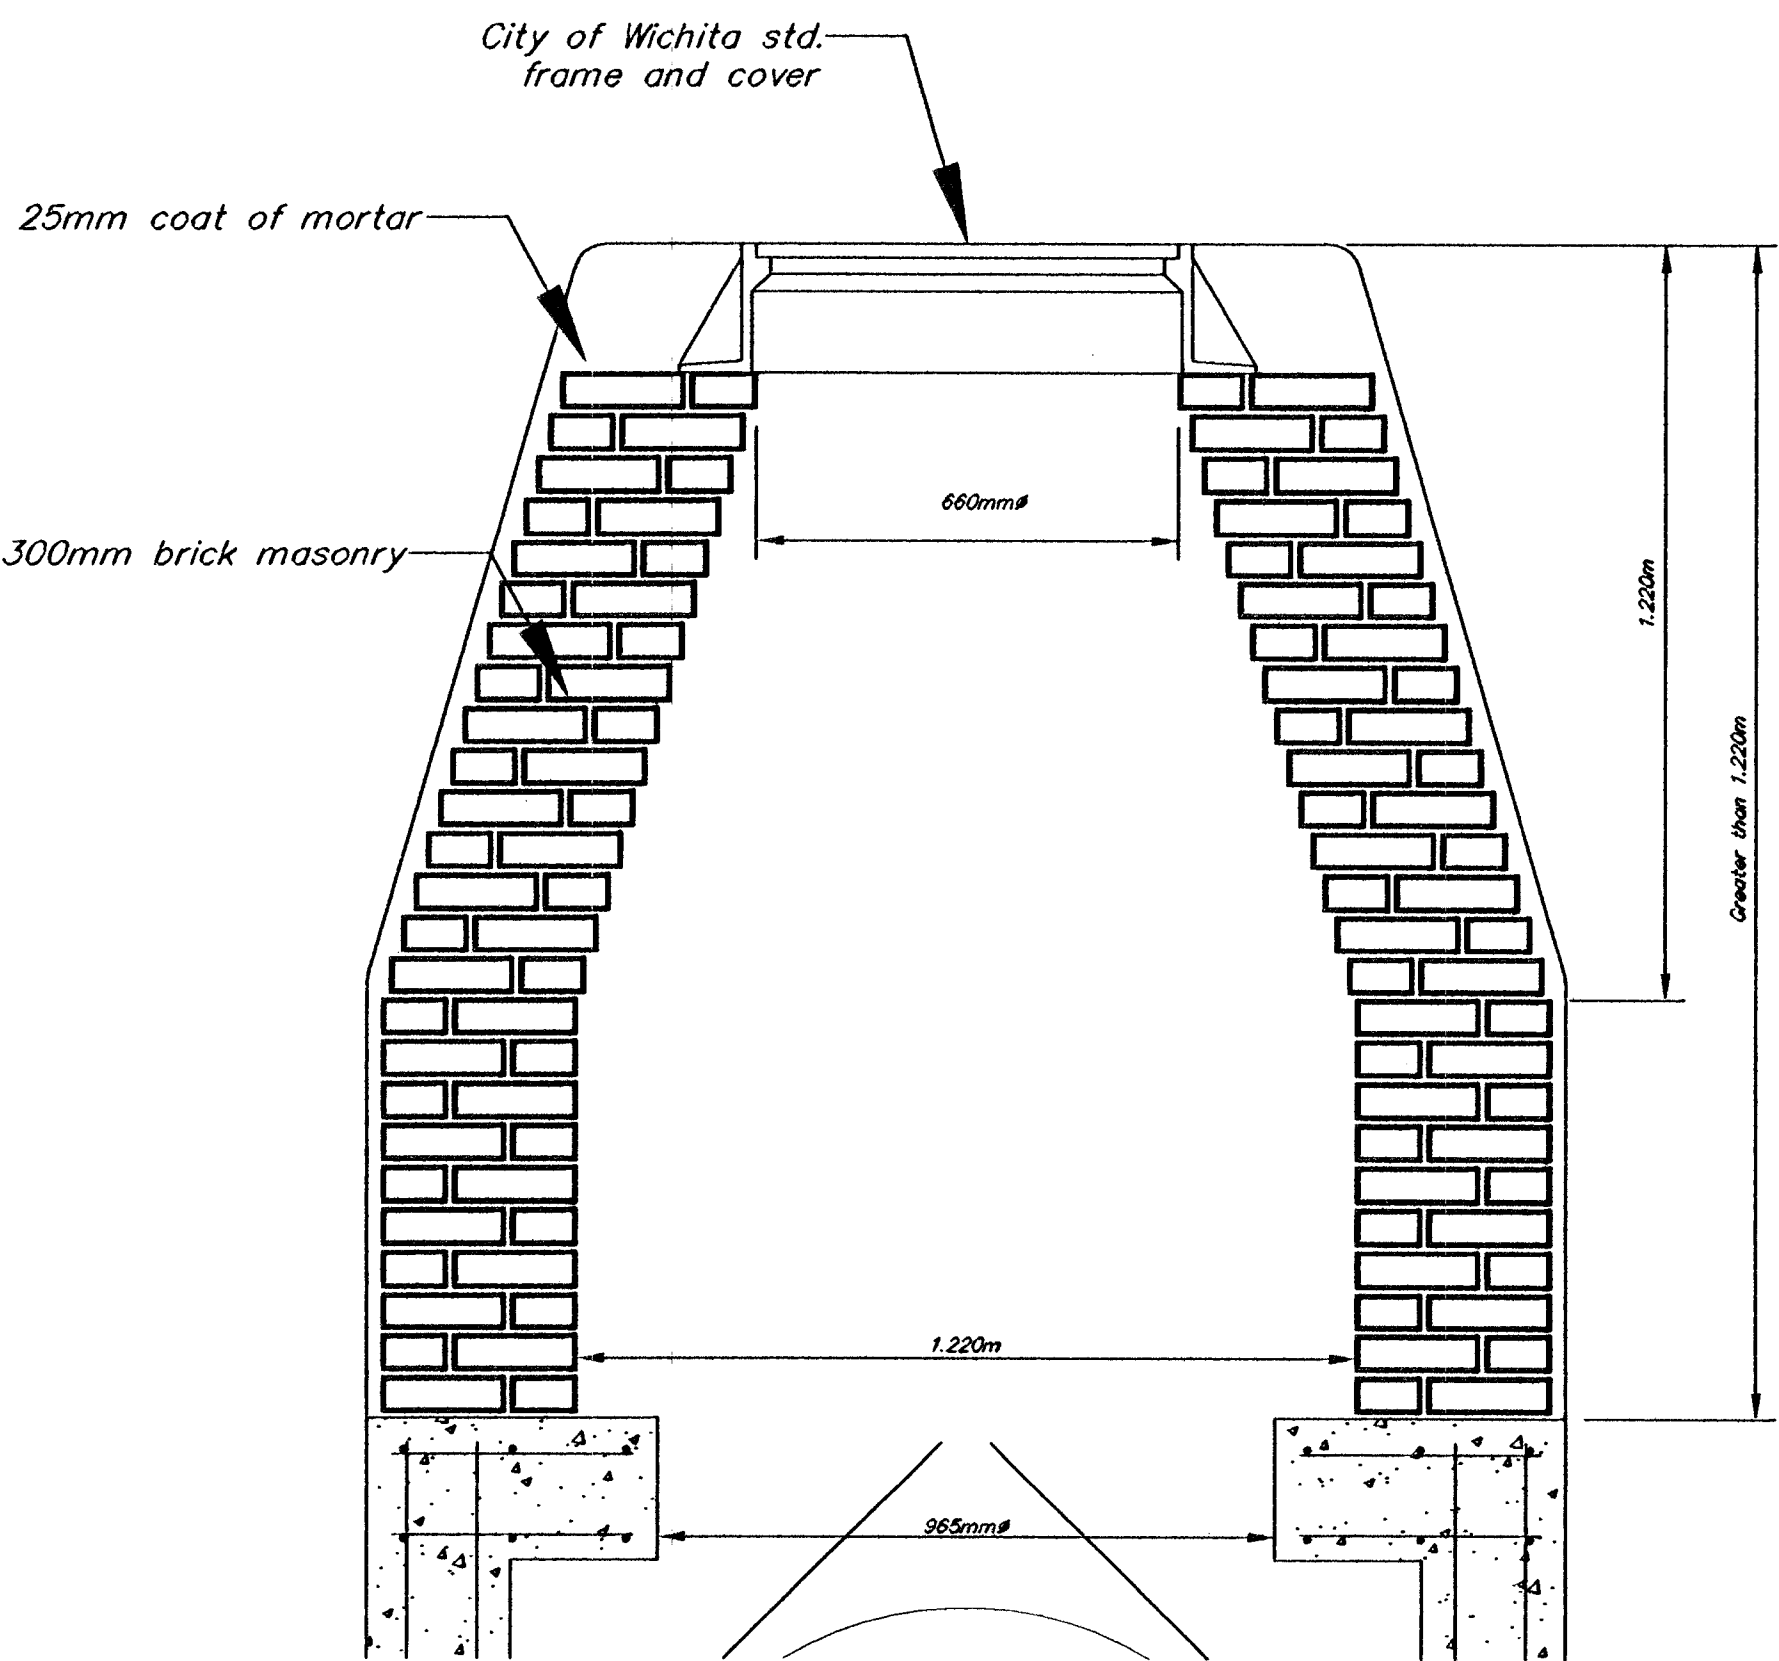

STACK HEIGHT GREATER THAN 1.220M