


NOTE:
 1. CONTRACTOR TO VERIFY LOCATION AND ELEVATION OF EXISTING WATER LINE AND ALL OTHER UTILITIES PRIOR TO CONSTRUCTION.
 2. CONTRACTOR SHALL USE SHORTER LENGTHS OF PIPE WHEN INSTALLING HORIZONTAL RADIUSES THAT EXCEED MAXIMUM ALLOWED DEFLECTION.

**PLAN WTR LINE 1
 PROFILE WTR LINE 1**

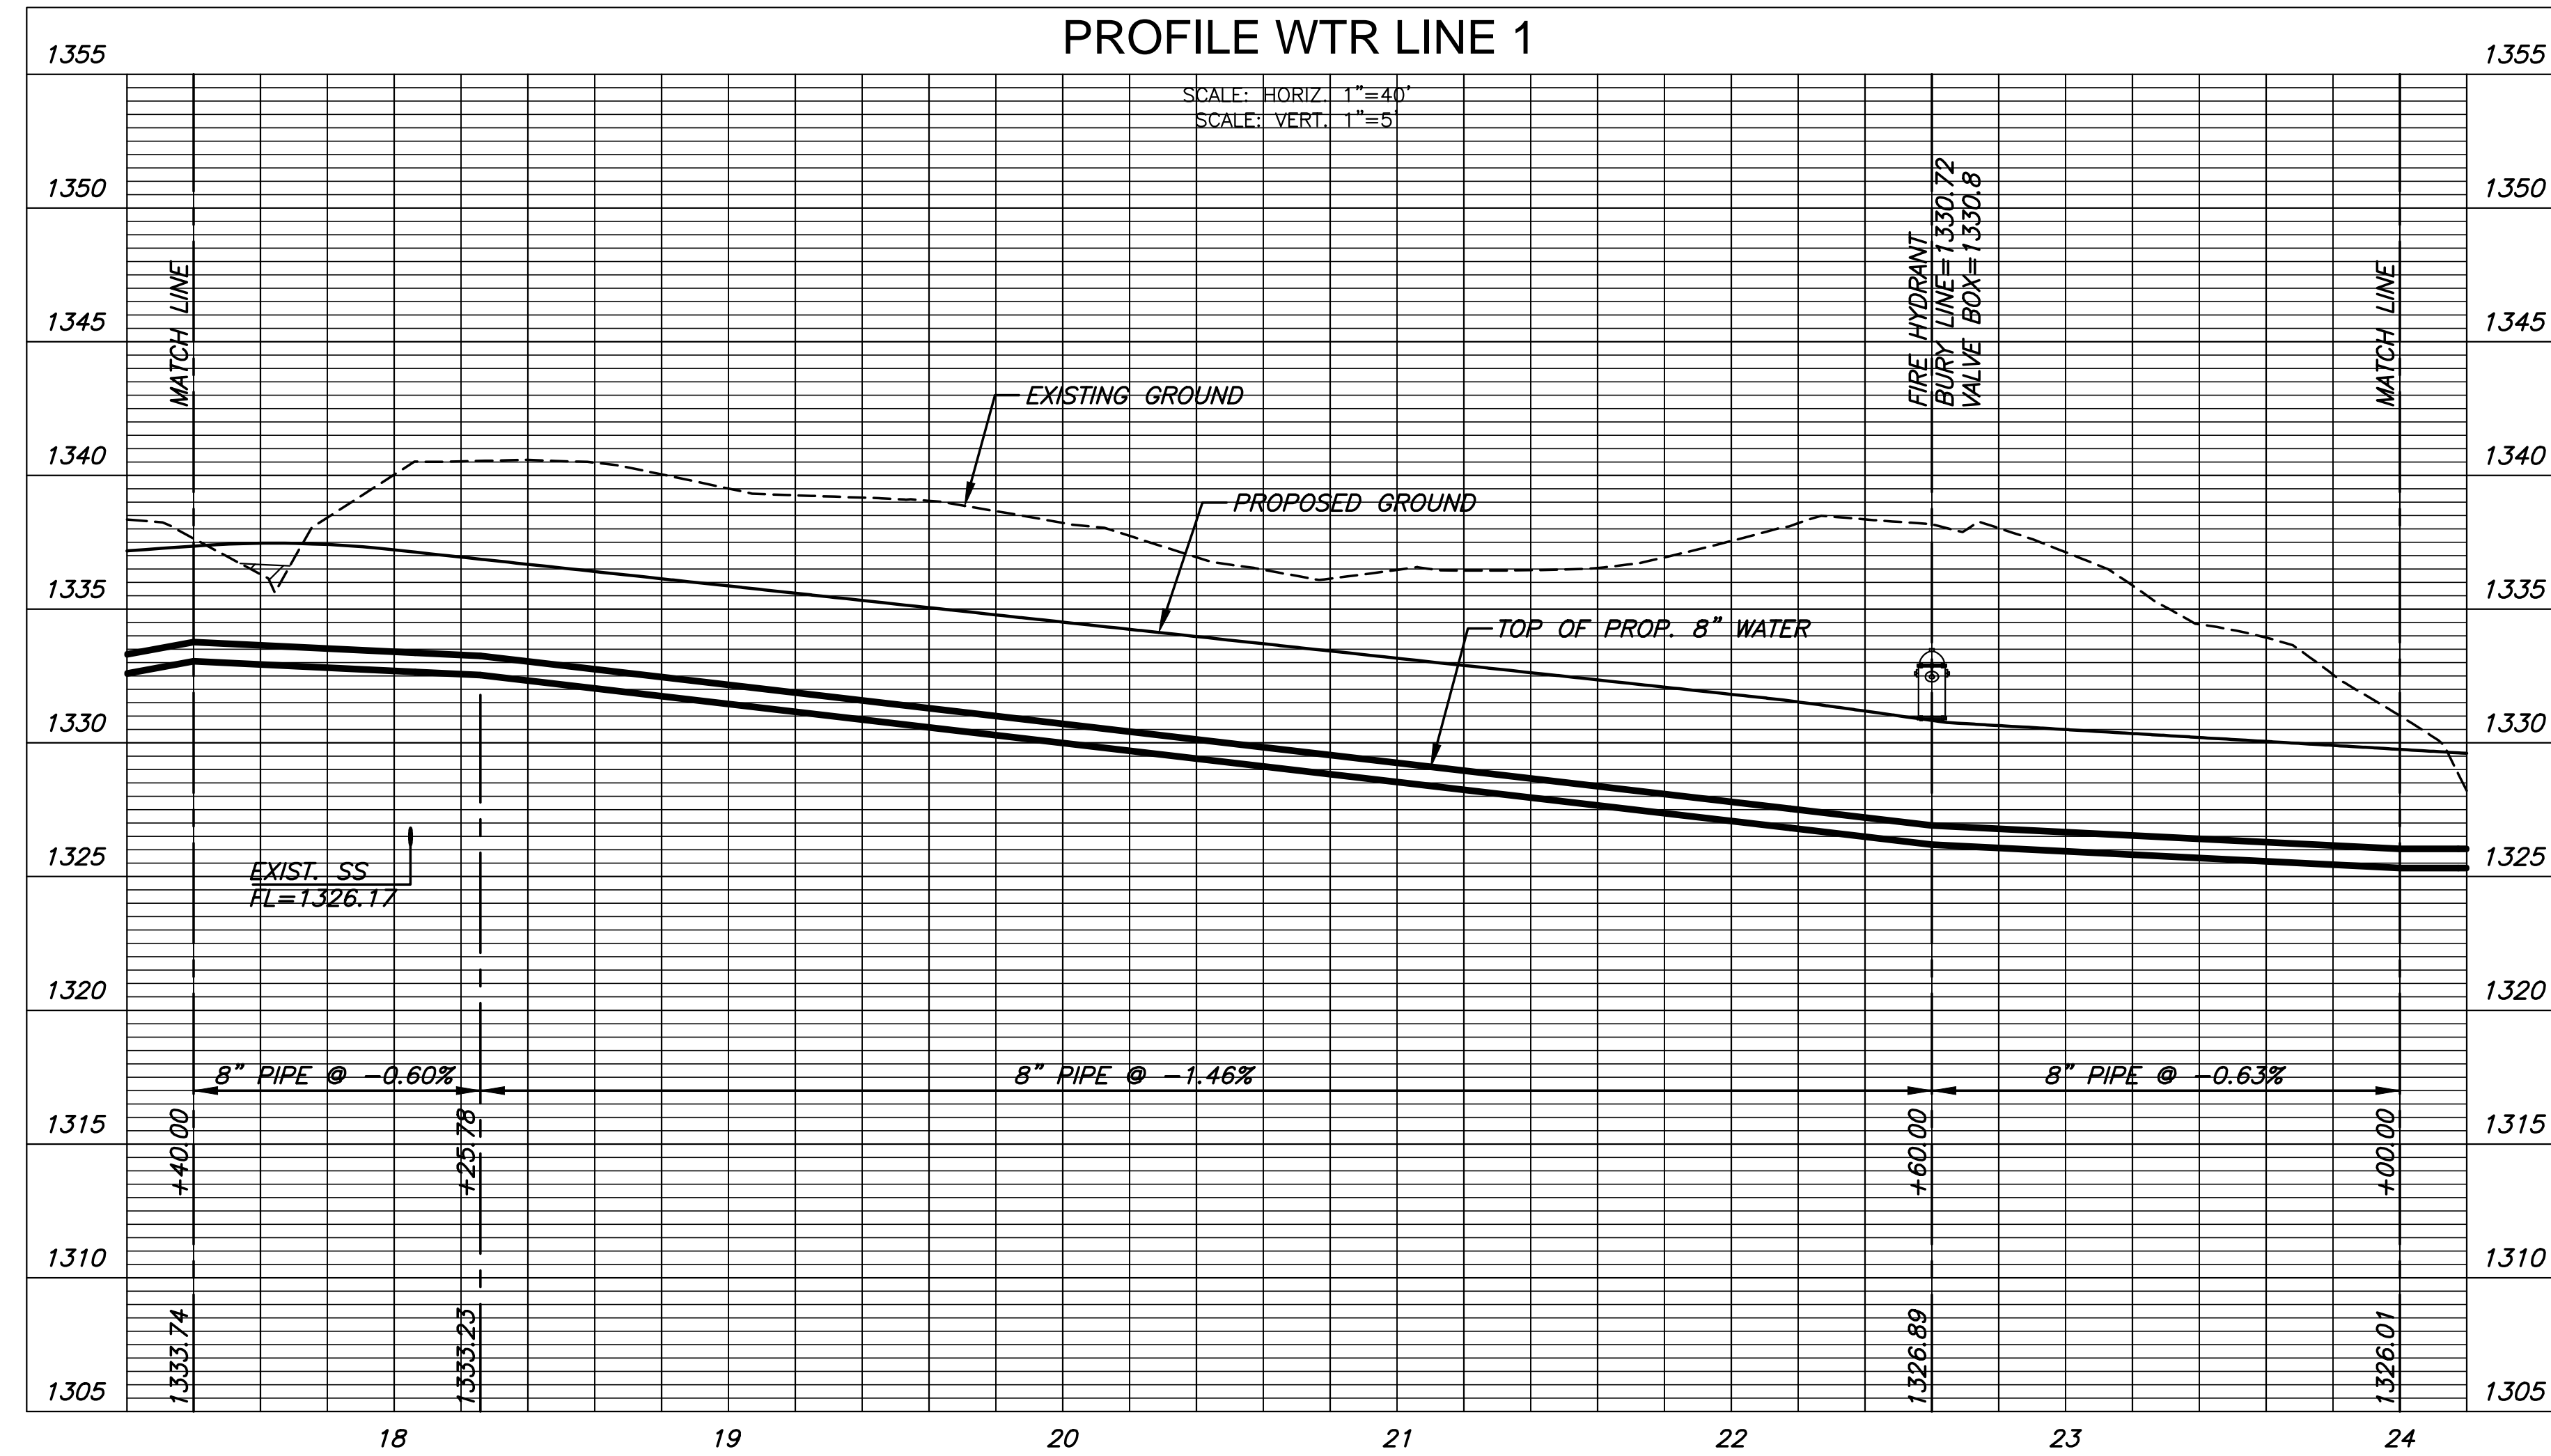

WATER DISTRIBUTION PLANS FOR
AUBURN LAKES ADDITION
 PHASE 1

©2018 MKEC Engineering All Rights Reserved www.mkec.com
 These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

WATER LINE 1

PROJECT NO.	448-90888	
DATE	MAY 2018	
SCALE	1" = 40'	
DESIGNED	DRAWN	CHECKED
DFL	JWC	GJA

NO.	REVISION	DATE

SHEET NO.
04 OF 22