


**TYPICAL SECTION**  
 @ 1 Sta. 24+45.41 to @ 1 Sta. 27+54.91  
 Glengate Court

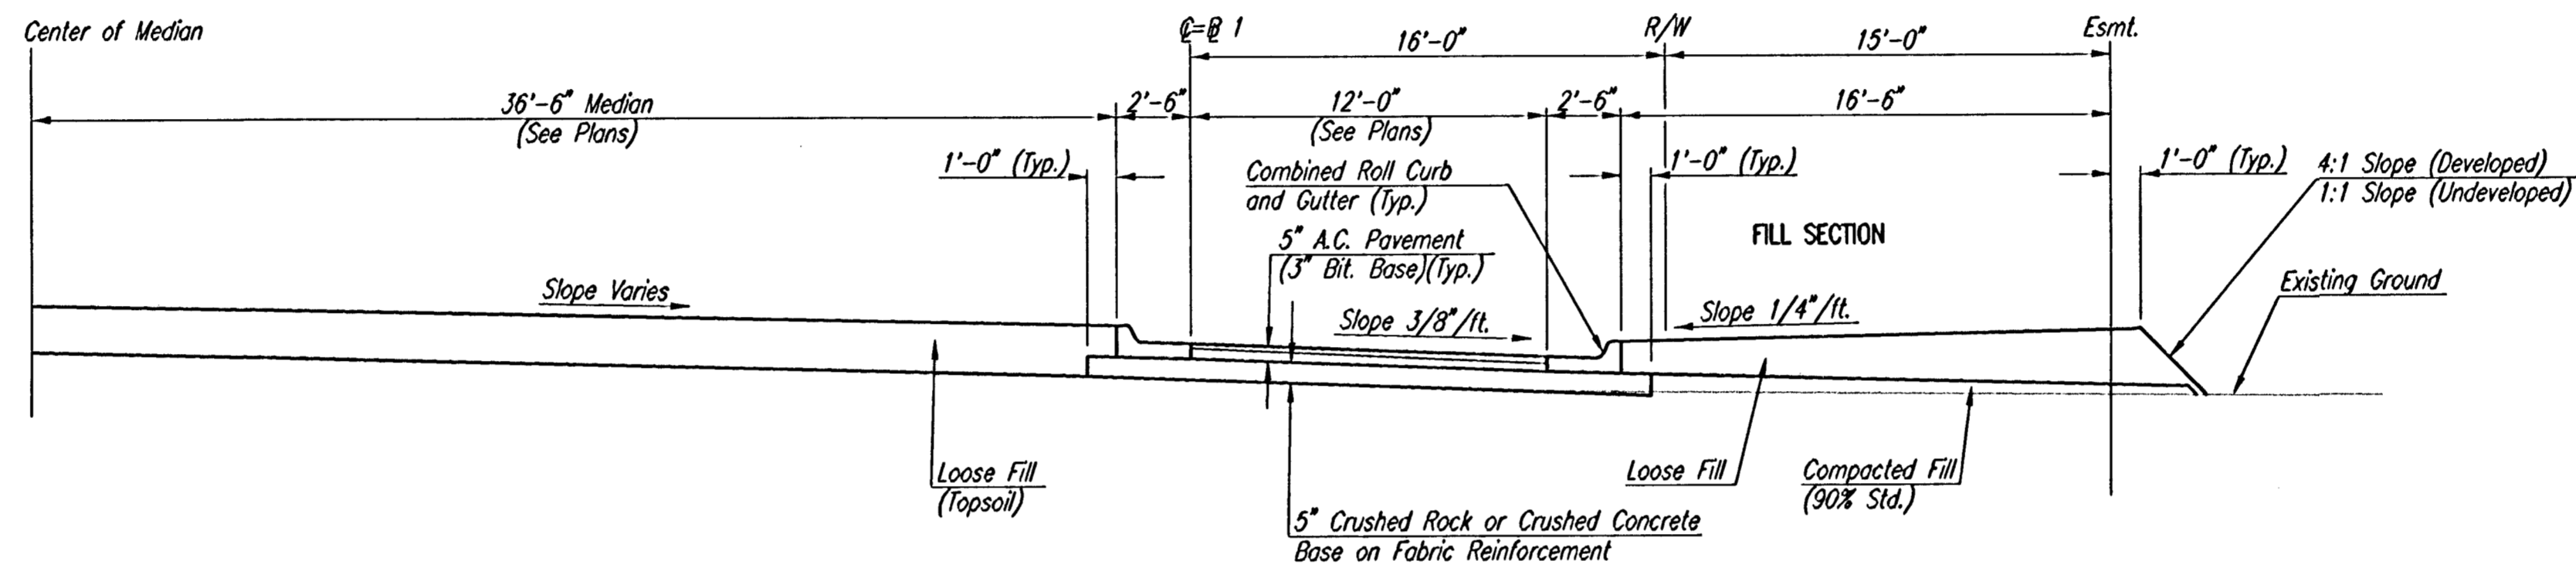

**TYPICAL SECTION**  
 @ 1 Sta. 28+29.70 to @ 1 Sta. 30+11.89  
 Glengate Court

**GENERAL NOTES**

FABRIC BASE REINFORCEMENT SHALL BE B X 1100 GEOGRID AS MANUFACTURED BY TENSAR CORPORATION OR APPROVED EQUAL. FABRIC BASE REINFORCEMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

ROCK BASE IS TO BE COMPACTED AND SMOOTHED WITH A STEEL FACED ROLLER PRIOR TO PLACEMENT OF ASPHALT. TACK COAT WILL NOT BE APPLIED TO ROCK BASE.

A TACK COAT OF EMULSIFIED ASPHALT (SC-1H OR CSS-1H) SHALL BE PLACED AT AN APPROXIMATE RATE OF 0.05 GALLONS PER SQUARE YARD BETWEEN EACH LIFT OF ASPHALTIC MATERIAL.


BITUMINOUS BASE AND ASPHALTIC CONCRETE WEARING SURFACE SHALL BE PLACED WITH A LAYDOWN MACHINE HAVING AUTOMATIC CONTROLS FOR LINE AND GRADE.

CONSTRUCTION JOINTS IN EACH LIFT SHALL BE STAGGERED A MINIMUM DISTANCE OF ONE (1) FOOT FROM JOINTS IN PRECEDING LIFTS AND PLACED SO THAT A JOINT WILL BE CONSTRUCTED ON THE CENTERLINE OF THE TOP LIFT.


THE ASPHALTIC CONCRETE PAVEMENT BETWEEN THE COMBINED CURB AND GUTTER SHALL BE PAID AS SQUARE YARDS OF 5" ASPHALTIC CONCRETE (3" BITUMINOUS BASE).

CRUSHED ROCK GRADATION REQUIREMENTS	
PERCENT OF AGGREGATE RETAINED	
2-1/2"	0
3/4"	20-60
1/4"	50-80
#40	80-94
#200	90-98

ROCK QUALITY SHALL CONFORM TO THE REQUIREMENTS SPECIFIED BY THE KDOT 1990 EDITION STANDARD SPECIFICATION SUBSECTION 1102 FOR DURABILITY CLASS I

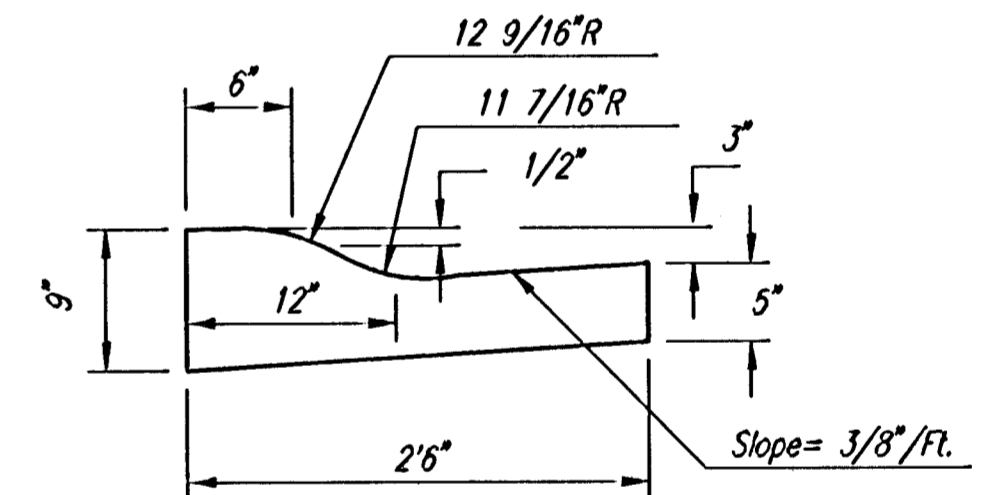

**COMBINED ROLL TYPE CURB & GUTTER**  
 (3 5/8")

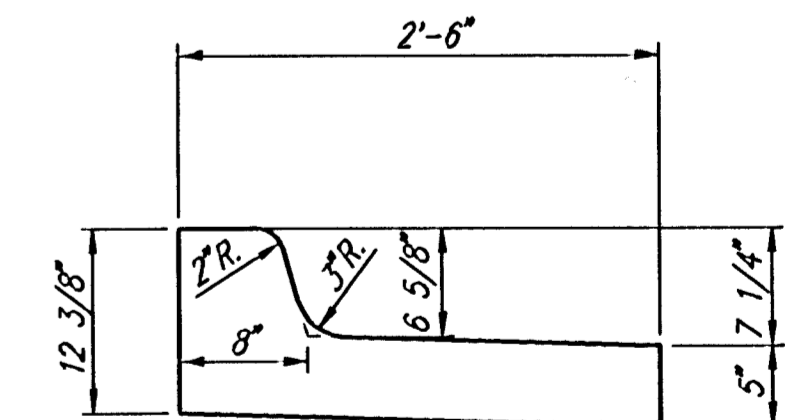

**MEDIAN COMBINED CURB & GUTTER**

Sheet 10 of 20 - 2006 04/15 PM by BJS  
 Plot Scale: 1/4" = 1'-0" - 2006 12/16/04 PM by BJS  
 01/2006 06/27/00 06572-000-C-17-51P

	No.	Revision	By	Date
	OAK CREEK 3RD			
	<b>TYPICAL PAVEMENT SECTIONS</b>			
	<b>Professional Engineering Consultants, P.A.</b> 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	BDB, BMM	Job No.	35-06572-000	Sheet 7 of 45
Drawn by	BJS, TAT	Date	February 2006	