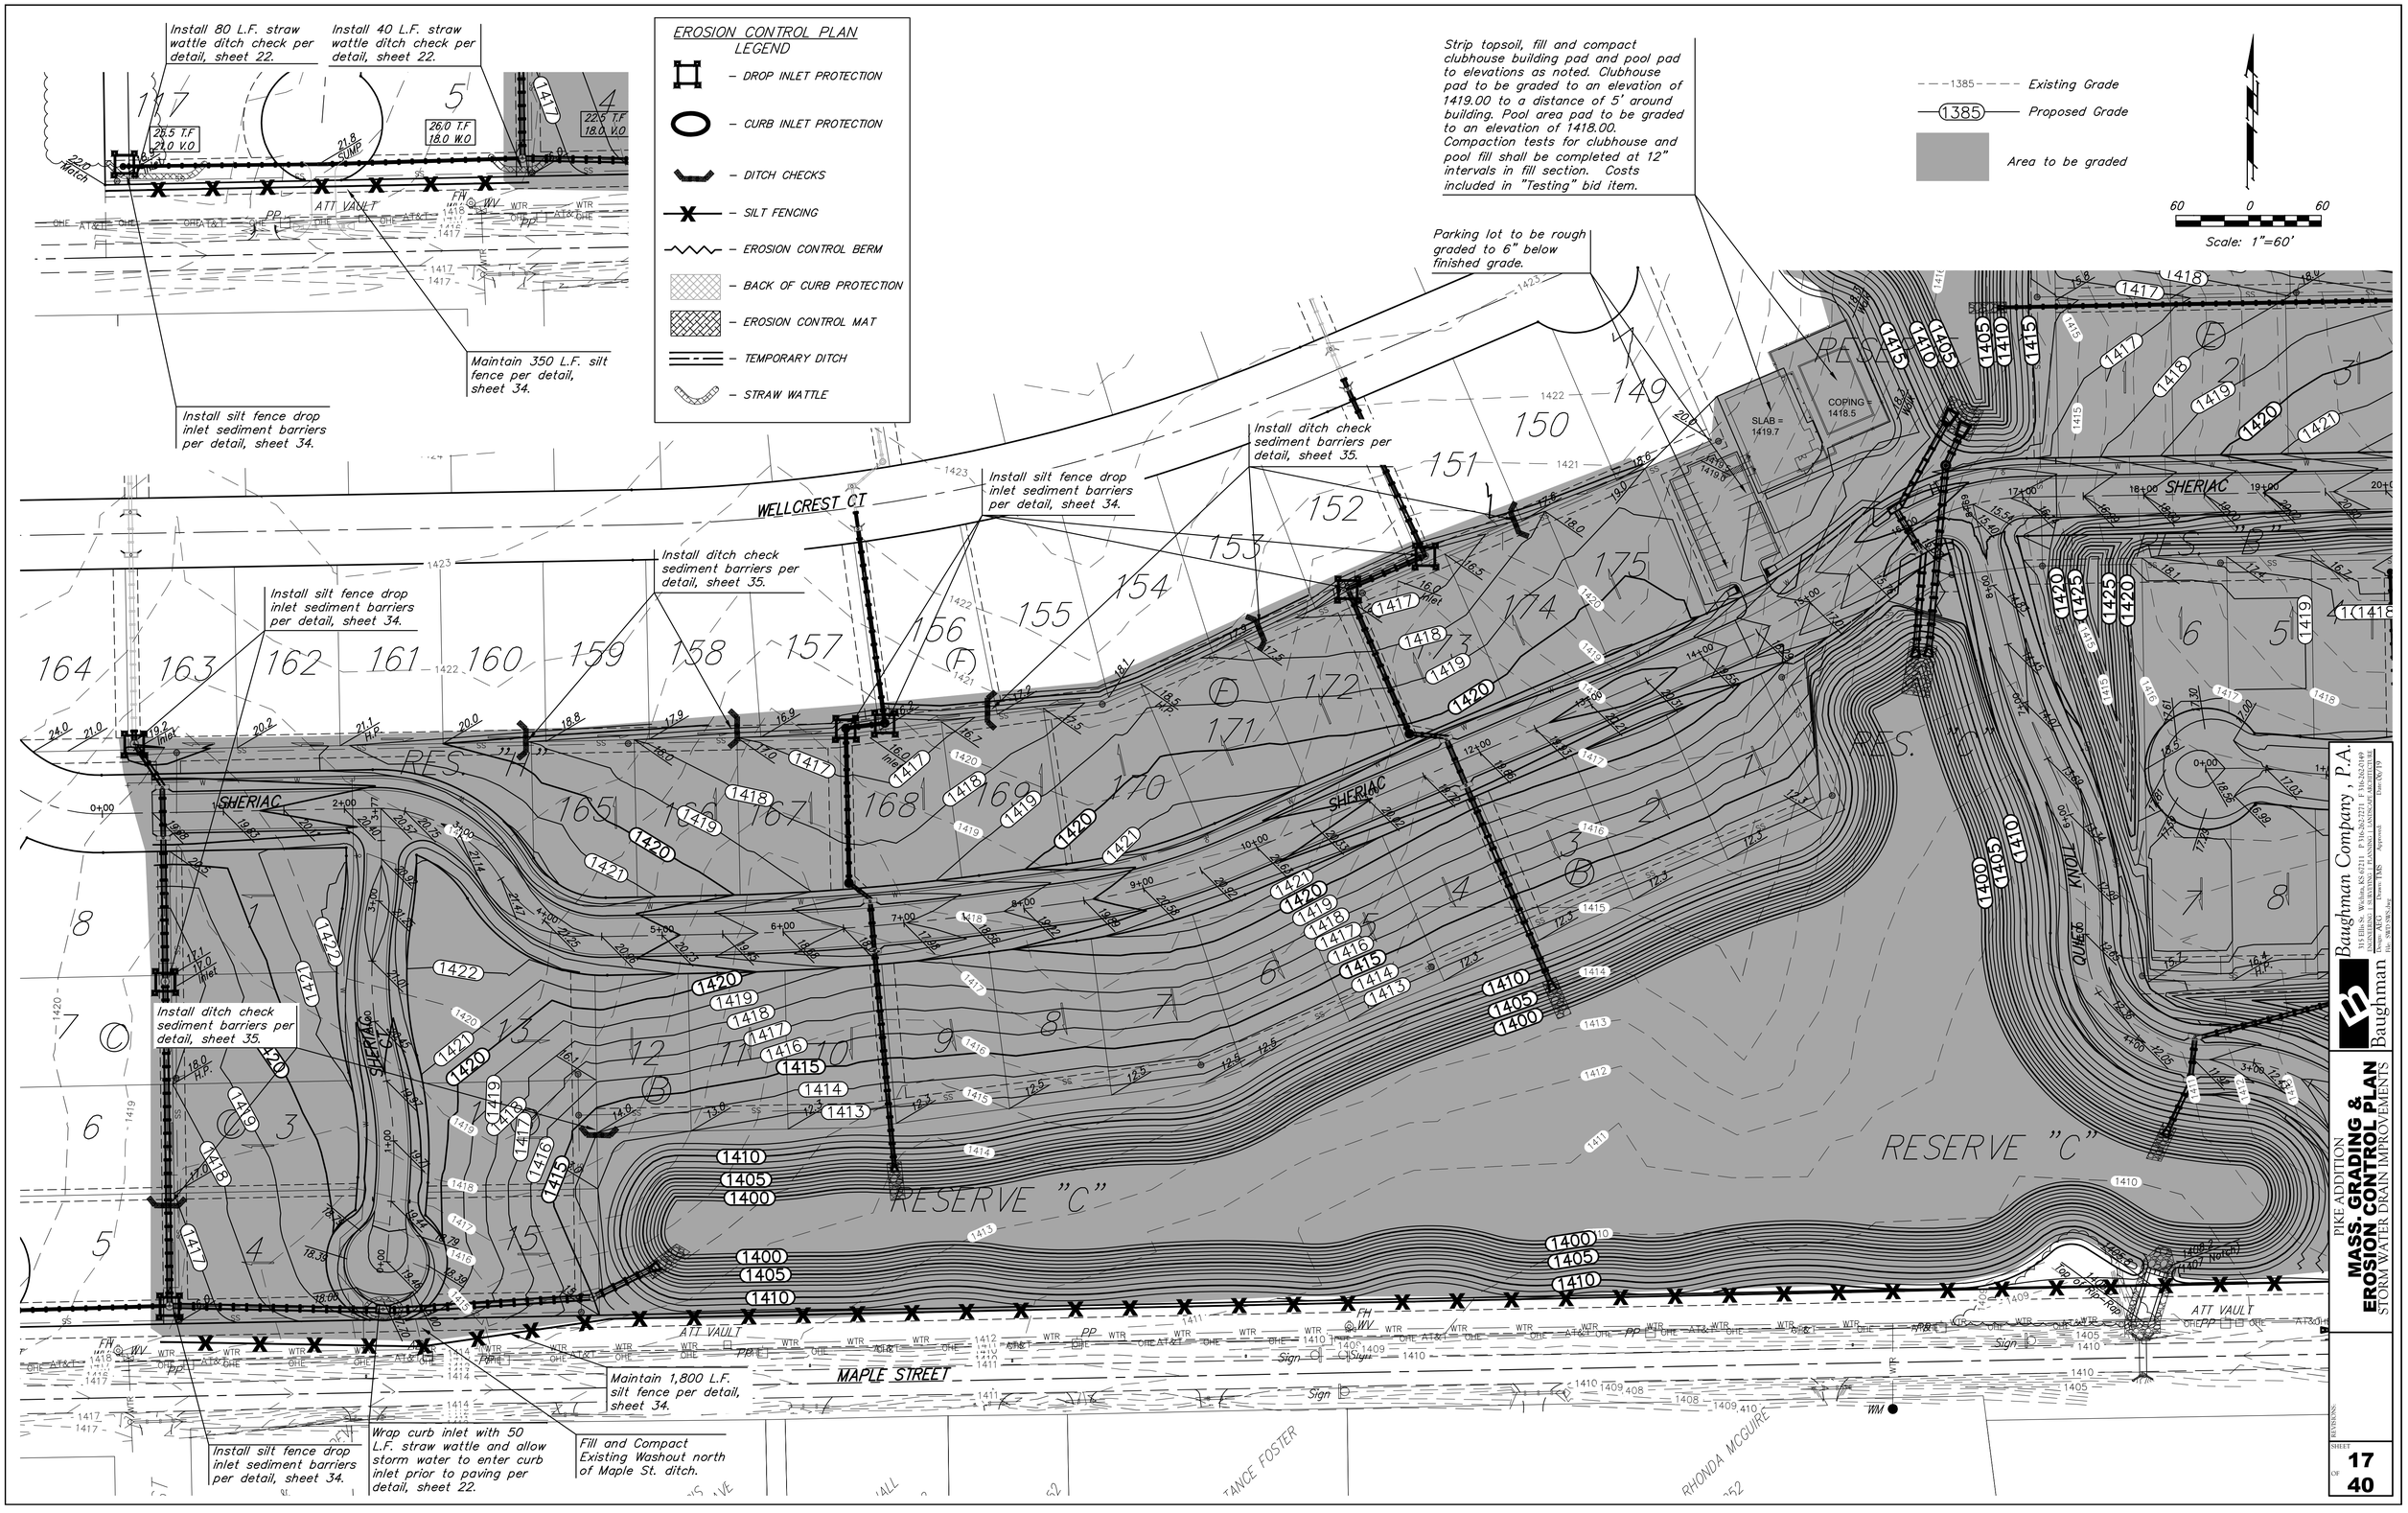
Install 80 L.F. straw wattle ditch check per detail, sheet 22.
Install 40 L.F. straw wattle ditch check per detail, sheet 22.
Maintain 350 L.F. silt fence per detail, sheet 34.
Install silt fence drop inlet sediment barriers per detail, sheet 34.
EROSION CONTROL PLAN LEGEND
DROP INLET PROTECTION
CURB INLET PROTECTION
DITCH CHECKS
SILT FENCING
EROSION CONTROL BERM
BACK OF CURB PROTECTION
EROSION CONTROL MAT
TEMPORARY DITCH
STRAW WATTLE
Strip topsoil, fill and compact clubhouse building pad and pool pad to elevations as noted. Clubhouse pad to be graded to an elevation of 1419.00 to a distance of 5' around building. Pool area pad to be graded to an elevation of 1418.00. Compaction tests for clubhouse and pool fill shall be completed at 12" intervals in fill section. Costs included in "Testing" bid item.
Parking lot to be rough graded to 6" below finished grade.
Existing Grade
Proposed Grade
Area to be graded
Scale: 1"=60'
Install ditch check sediment barriers per detail, sheet 35.
Install silt fence drop inlet sediment barriers per detail, sheet 34.
WELLCREST CT
SHERIAC
MAPLE STREET
RESERVE "C"
RES.
ATT VAULT
Maintain 1,800 L.F. silt fence per detail, sheet 34.
Wrap curb inlet with 50 L.F. straw wattle and allow storm water to enter curb inlet prior to paving per detail, sheet 22.
Fill and Compact Existing Washout north of Maple St. ditch.
Baughman Company, P.A.
PIKE ADDITION
MASS GRADING & EROSION CONTROL PLAN
STORM WATER DRAIN IMPROVEMENTS
SHEET 17 OF 40