




ARCHITECTS - PLANNERS - LANDSCAPE ARCHITECTS
 125 S. WASHINGTON WICHITA, KANSAS 67202
 P.O. BOX 988 WICHITA, KANSAS 67201
 TEL. 366-2424 FAX 366-2424

McCullough VAN SICKLE & PERRY


WEST DOUGLAS STREETSCAPE
 ARKANSAS RIVER TO SENECA
 WICHITA, KANSAS

PROJECT NO. 472 83608 OCA: 706846
 MVP PROJECT NO. 101008
 DATE: August 7, 2002
 REVISED: August 30, 2002



SHEET
 CV 3.6

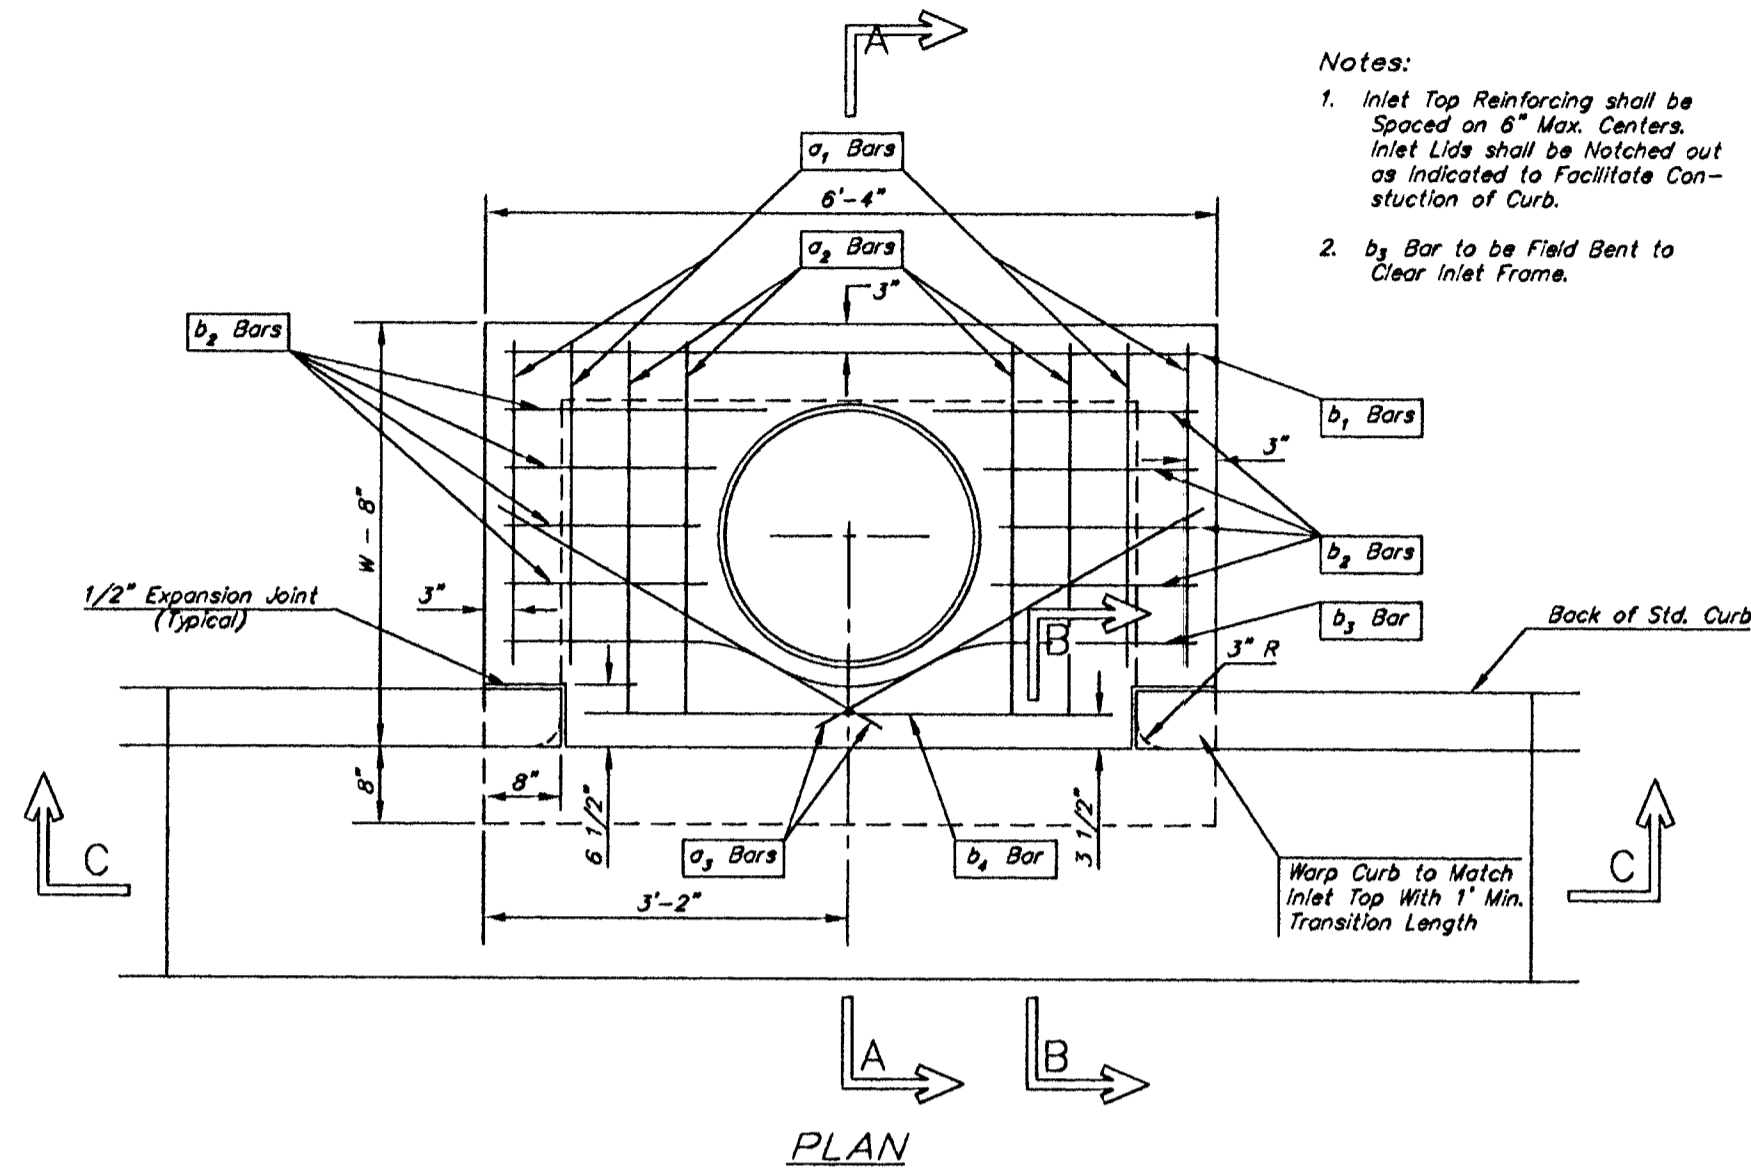

Notes:
 1. Inlet Top Reinforcing shall be Spaced on 6" Max. Centers. Inlet Lids shall be Notched out as Indicated to Facilitate Construction of Curb.
 2. b₂ Bar to be Flaid Bent to Clear Inlet Frame.

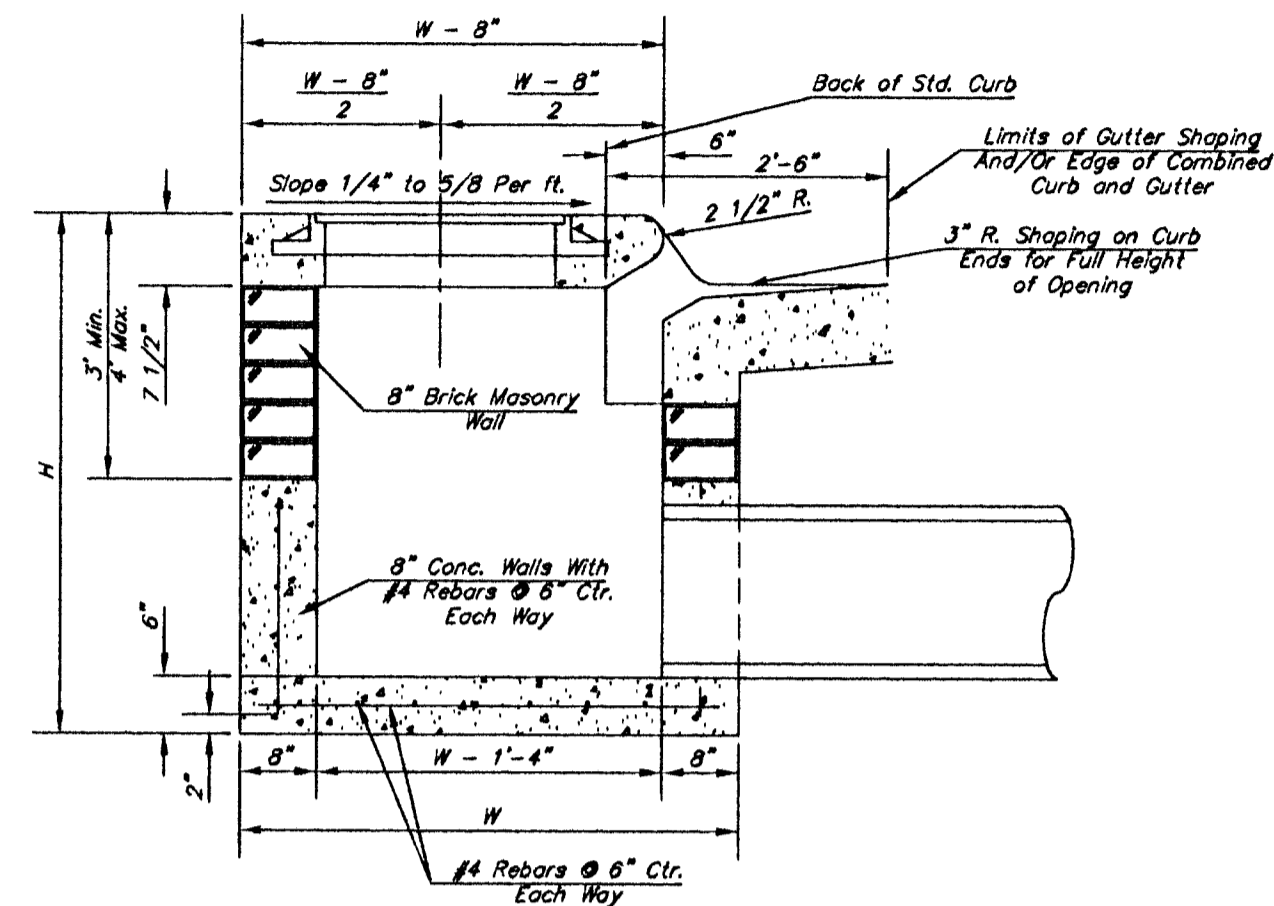


SECTION A-A

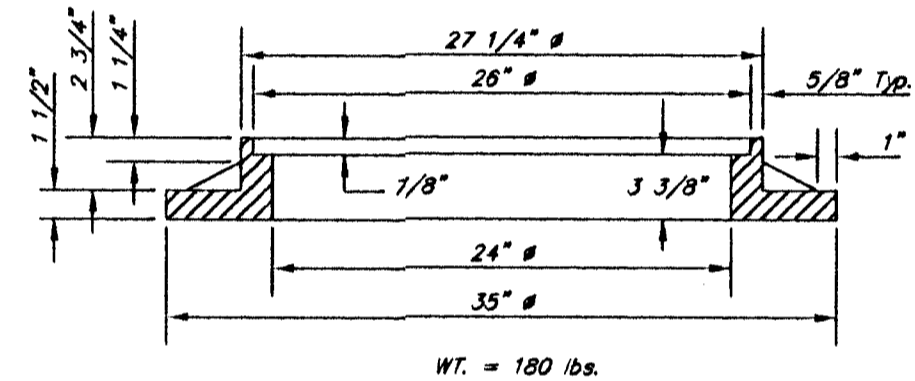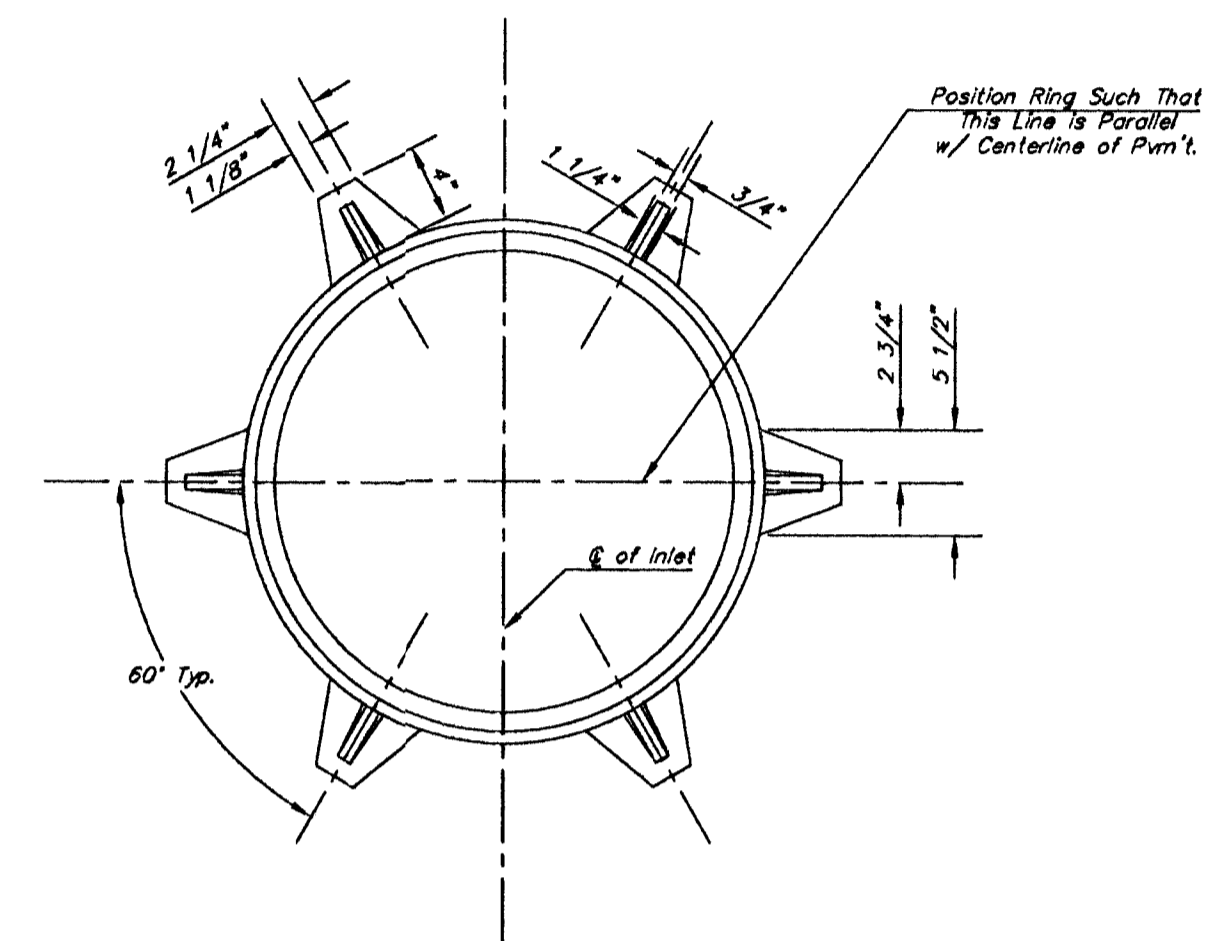


MANHOLE RING AND COVER


*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

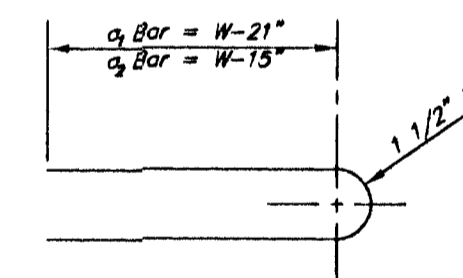

BENDING DIAGRAM

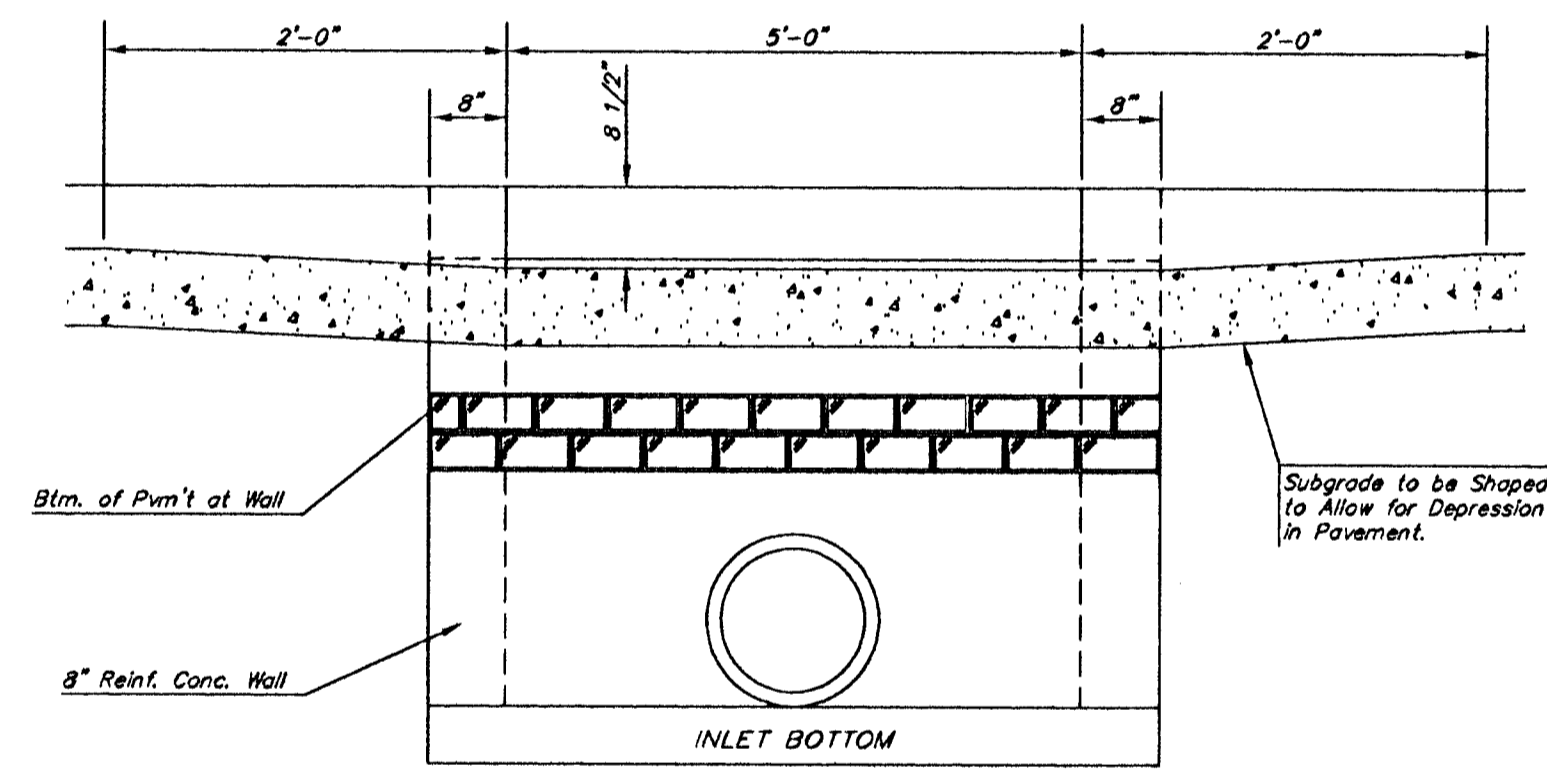

SECTION C-C

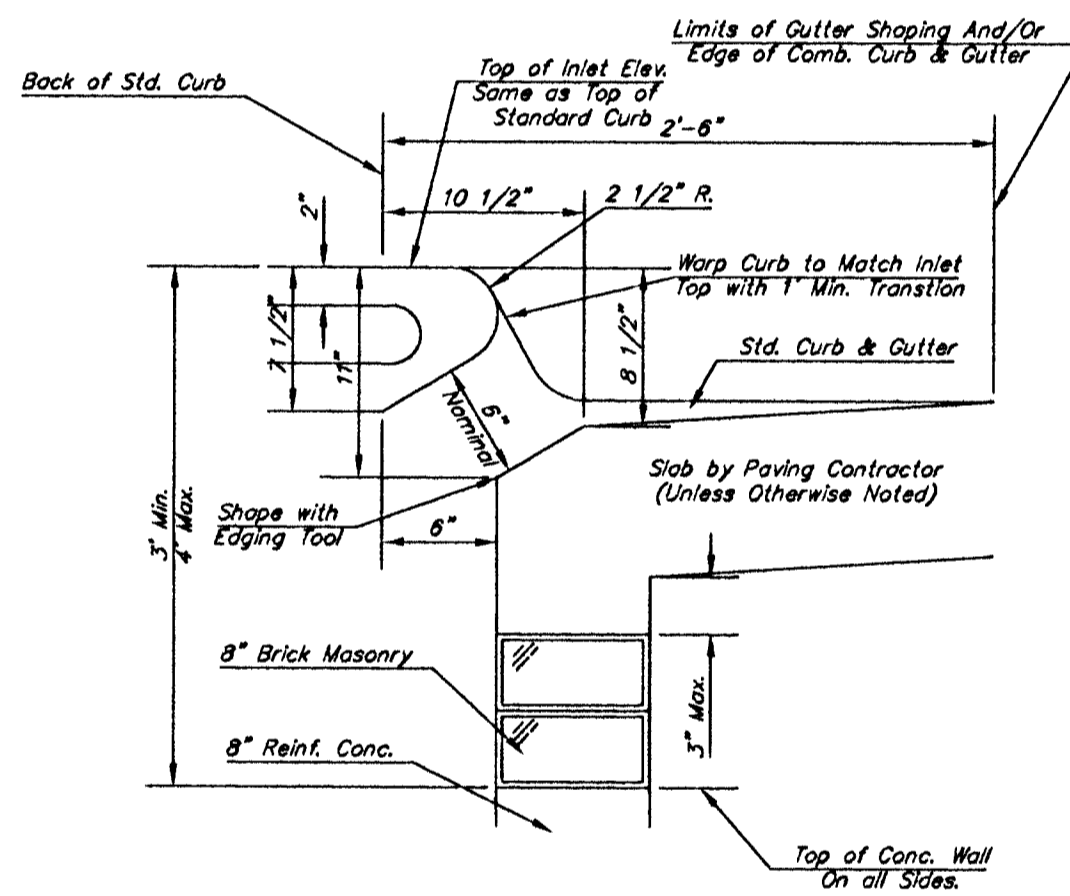

SECTION B-B

STEEL SCHEDULE

BAR NUMBER	a ₁	a ₂	a ₃	b ₁	b ₂	b ₃	b ₄	b ₅	b ₆	b ₇	b ₈	b ₉	b ₁₀	b ₁₁	b ₁₂	WT. Lbs.
SIZE	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	
LENGTH	W-4'-4"	5'-7"	6'-7"	4'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	60±				
	W-5'-4"	7'-7"	8'-7"	5'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	81±				
	W-6'-4"	9'-7"	10'-7"	6'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	101±				
	W-7'-4"	11'-7"	12'-7"	7'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	121±				
	W-8'-4"	13'-7"	14'-7"	8'-0"	6'-1"	1'-9"	6'-2"	4'-8"	141±							


Note: a₂ Bars to be Placed Approx. 2" Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS

W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8" 8'-4" 7 1/2"	21" & SMALLER	0.386
5'-4"	4'-8" 8'-4" 7 1/2"	24" & 30"	0.516
6'-4"	5'-8" 8'-4" 7 1/2"	36" & 42"	0.646
7'-4"	6'-8" 8'-4" 7 1/2"	48" & 54"	0.776
8'-4"	7'-8" 8'-4" 7 1/2"	60" & 66"	0.906

GENERAL NOTES

- Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.
- Contractor shall have the option of constructing 8" brick masonry walls between the concrete inlet base and top on this inlet when W=6'-4" and H=7'-0" or less.
- Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
- The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

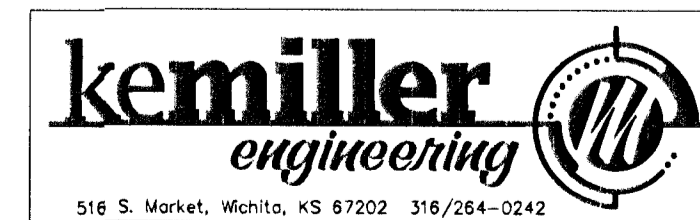

516 S. Market, Wichita, KS 67202 316/264-0242



Type 1 Inlet Single