

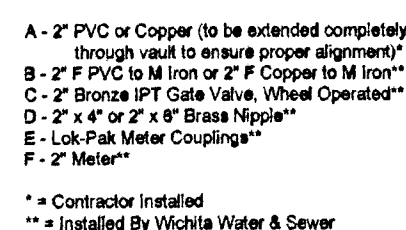
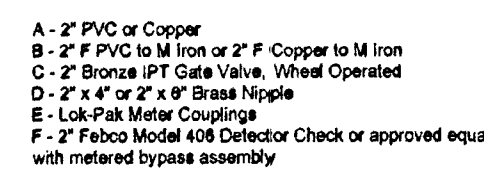


11. Additional Notes For Fire Services:



- A. A post indicator valve (PIV) is an option for the outlet valve and may be requested by the architect or owner. The PIV is not required by City of Wichita ordinance.
- B. When Siemens connections are required by the Wichita Fire Department, refer to the current City Code Section 11-10.
- C. If due to any reason the completed vault retains ground or drainage water in excess of 4" in depth from the floor of the vault, the property owner shall be responsible for providing and installing an appropriate automatic sump pump or approved equal, as well as any other apparatuses required to make such system function as intended.
- D. The property owner shall be responsible for completing an "Application for Private Fire Protection" prior to final acceptance of the project.

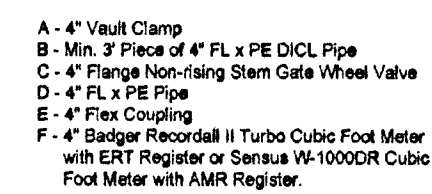

2"DS

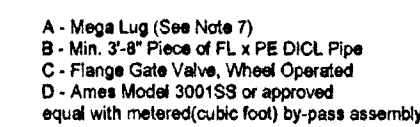

4"DS

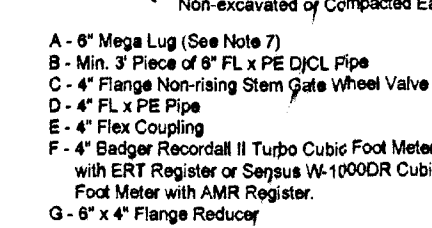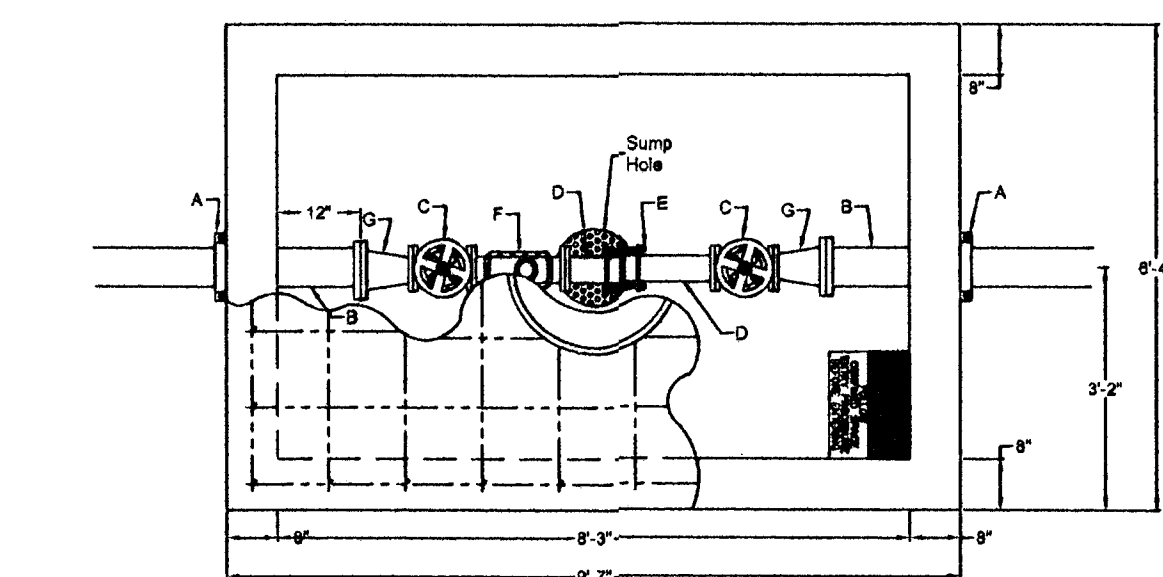

6" DS w/ 4" meter

PROJECT NO. 448 89643
MWV PROJECT NO.101008
DATE: August 7, 2002
REVISED:

SHEET

CV 7.2

ARCHITECTS • PLANNERS LANDSCAPE ARCHITECTS
125 S. WASHINGTON WICHITA, KANSAS 67202
P.O. BOX 3546 WICHITA, KANSAS 67201
PH. 316.262.0431 FAX 316.262.5465

VAULT DETAILS

kemiller
engineering

516 S. Market, Wichita, KS 67202 316/264-0242

