


FABRIC BASE REINFORCEMENT SHALL BE 8 X 1100 AS MANUFACTURED BY TENSAR CORPORATION OR APPROVED EQUAL. FABRIC BASE REINFORCEMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CRUSHED ROCK SHALL BE UNIFORMLY GRADED.

PER CENT OF AGGREGATE RETAINED	
2-1/2"	0
3/4"	20 to 80
# 4	50 to 87
# 20	80 to 94
# 200	90 to 98


ROCK QUALITY SHALL CONFORM TO THE REQUIREMENTS SPECIFIED BY K.D.O.T. 1990 EDITION STANDARD SPECIFICATION SUBSECTION 1102 FOR DURABILITY CLASS 1.

ROCK BASE IS TO BE COMPACTED AND SMOOTHED WITH A STEEL FACED ROLLER PRIOR TO PLACEMENT OF ASPHALT. TACK COAT WILL NOT BE APPLIED TO ROCK BASE.

REINFORCED CRUSHED ROCK BASE WILL BE PAID FOR AT THE SQUARE YARD PRICE FOR 4" THICKNESS.

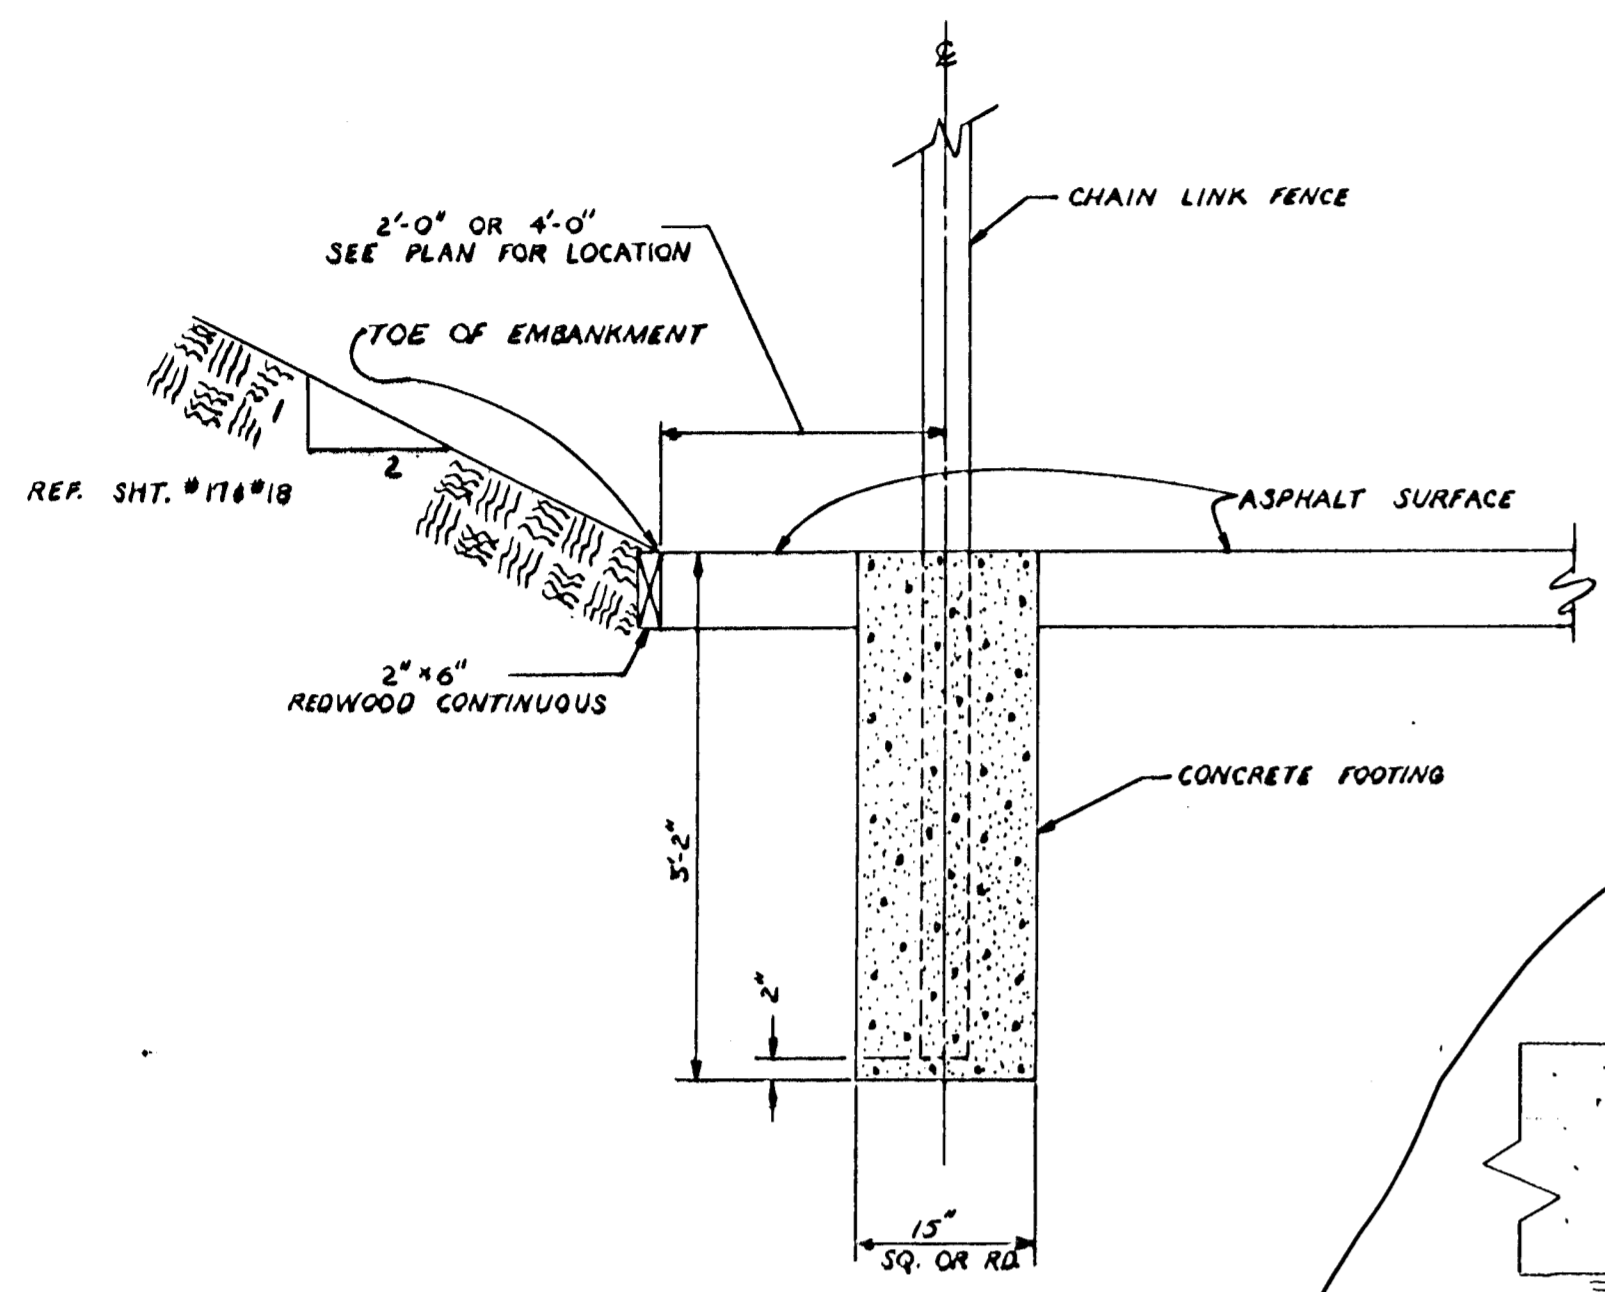


SECTION C-C

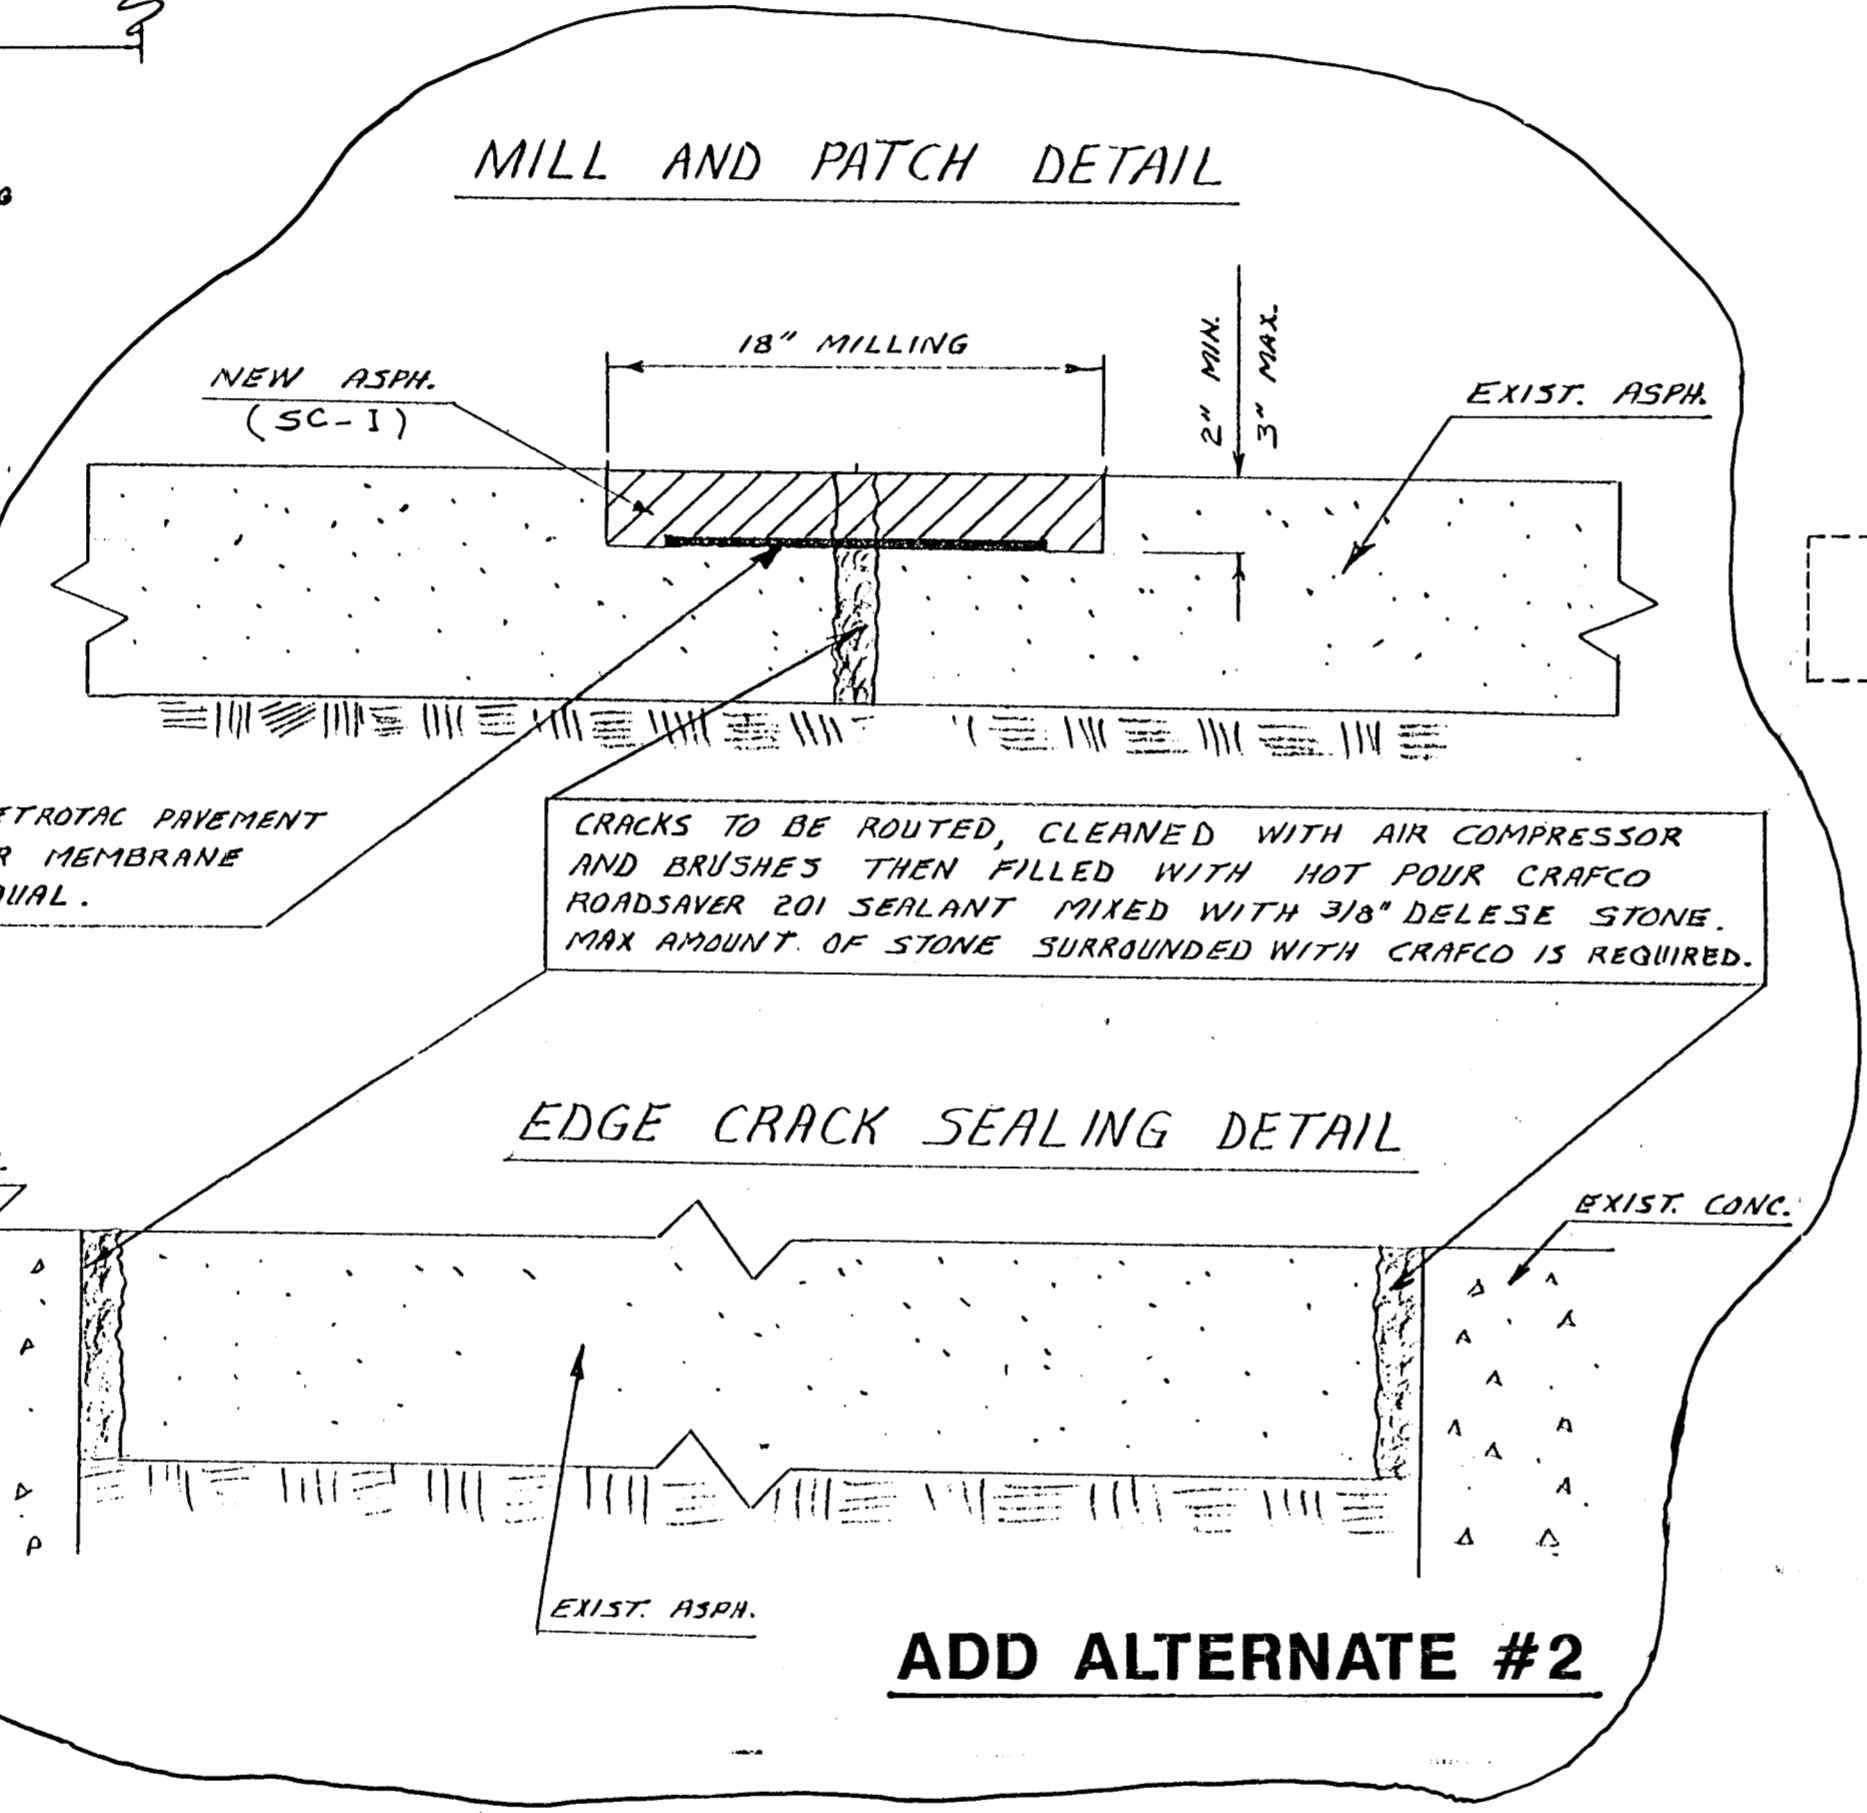


MILL AND PATCH DETAIL

EDGE CRACK SEALING DETAIL


ADD ALTERNATE #2

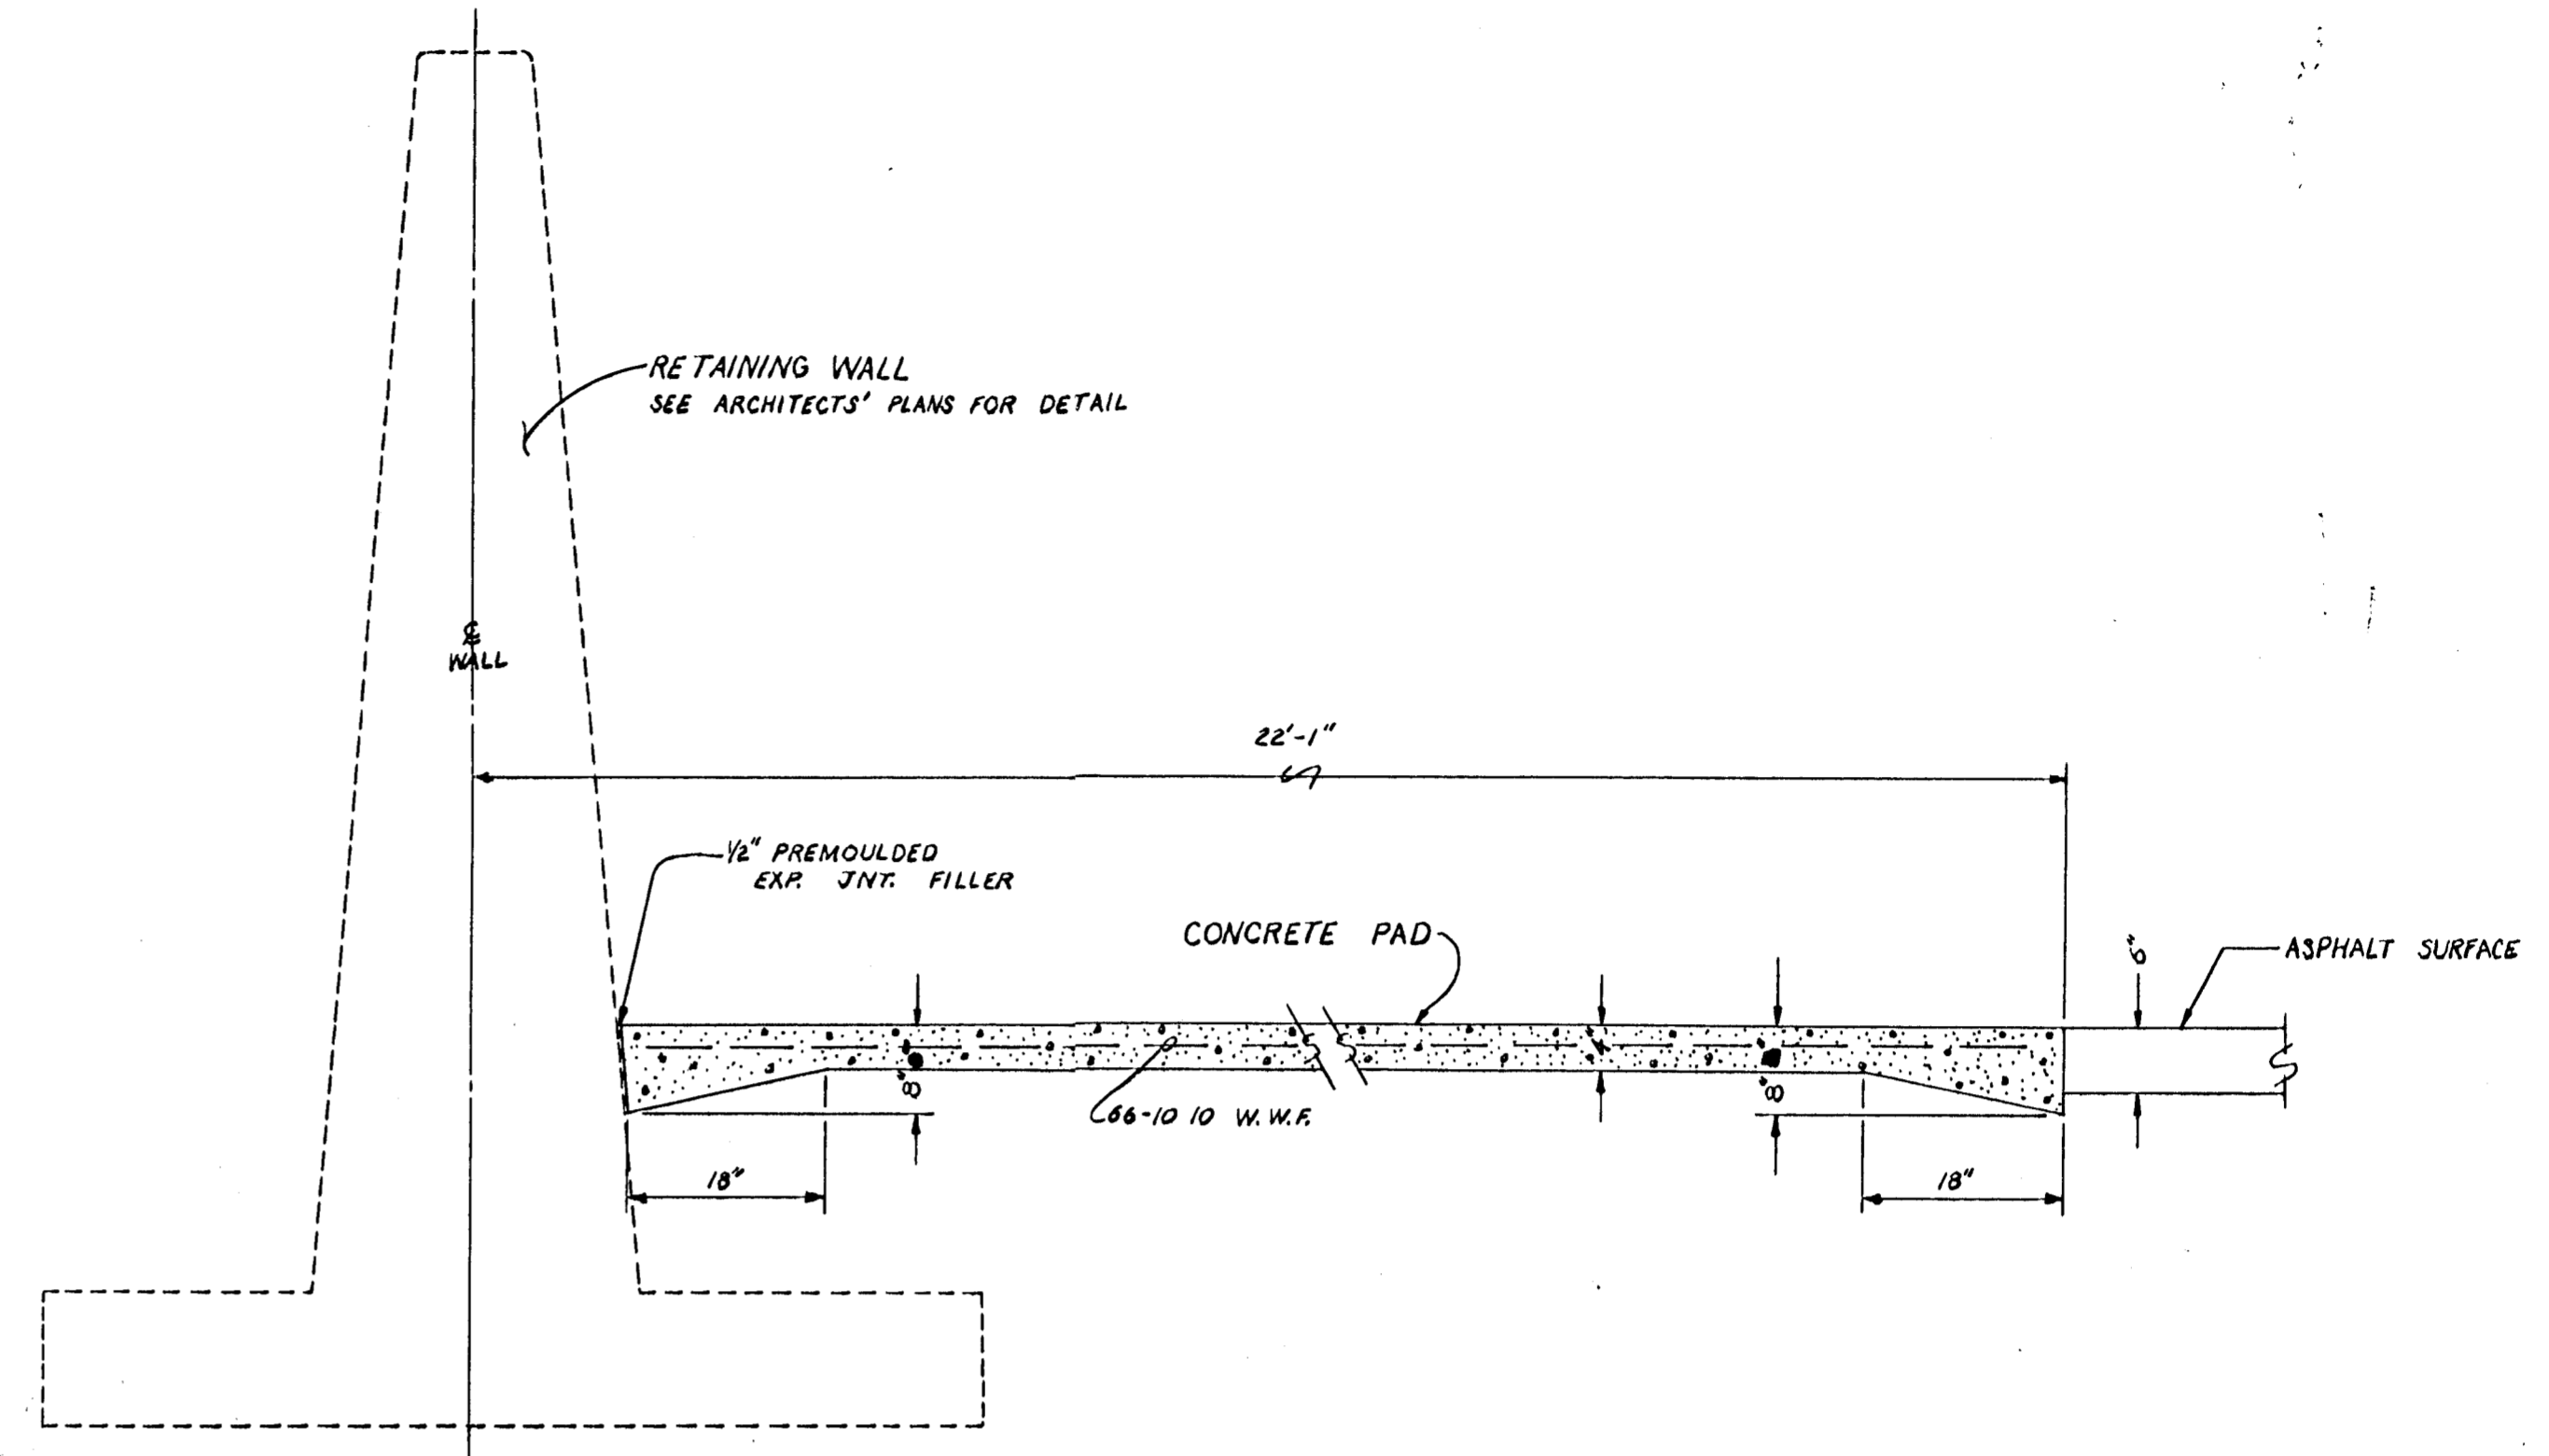

SECTION D-D

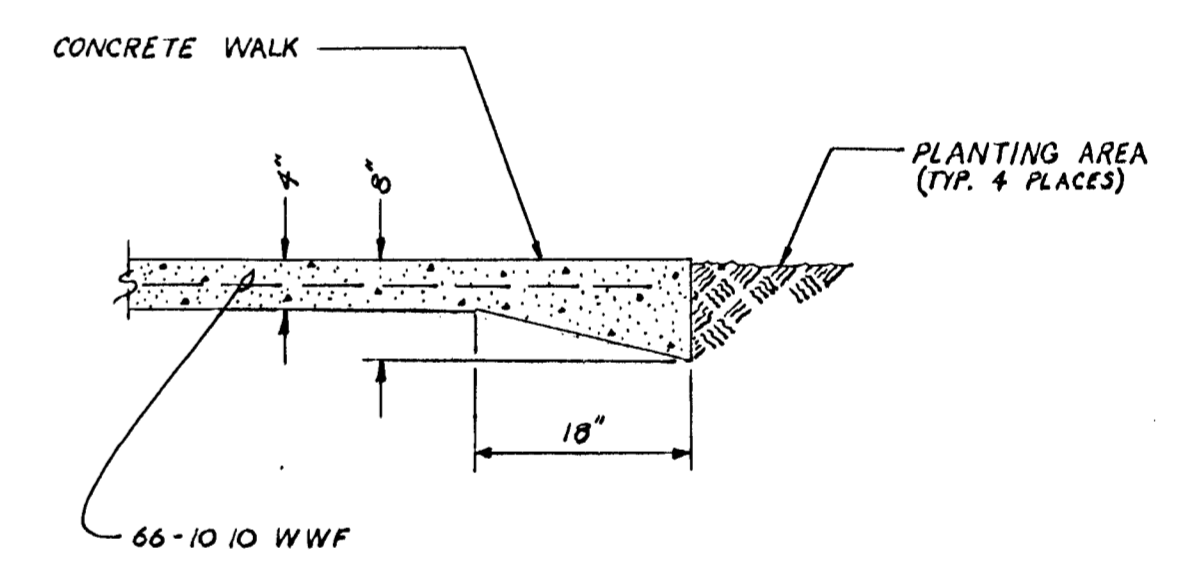


SECTION G-G

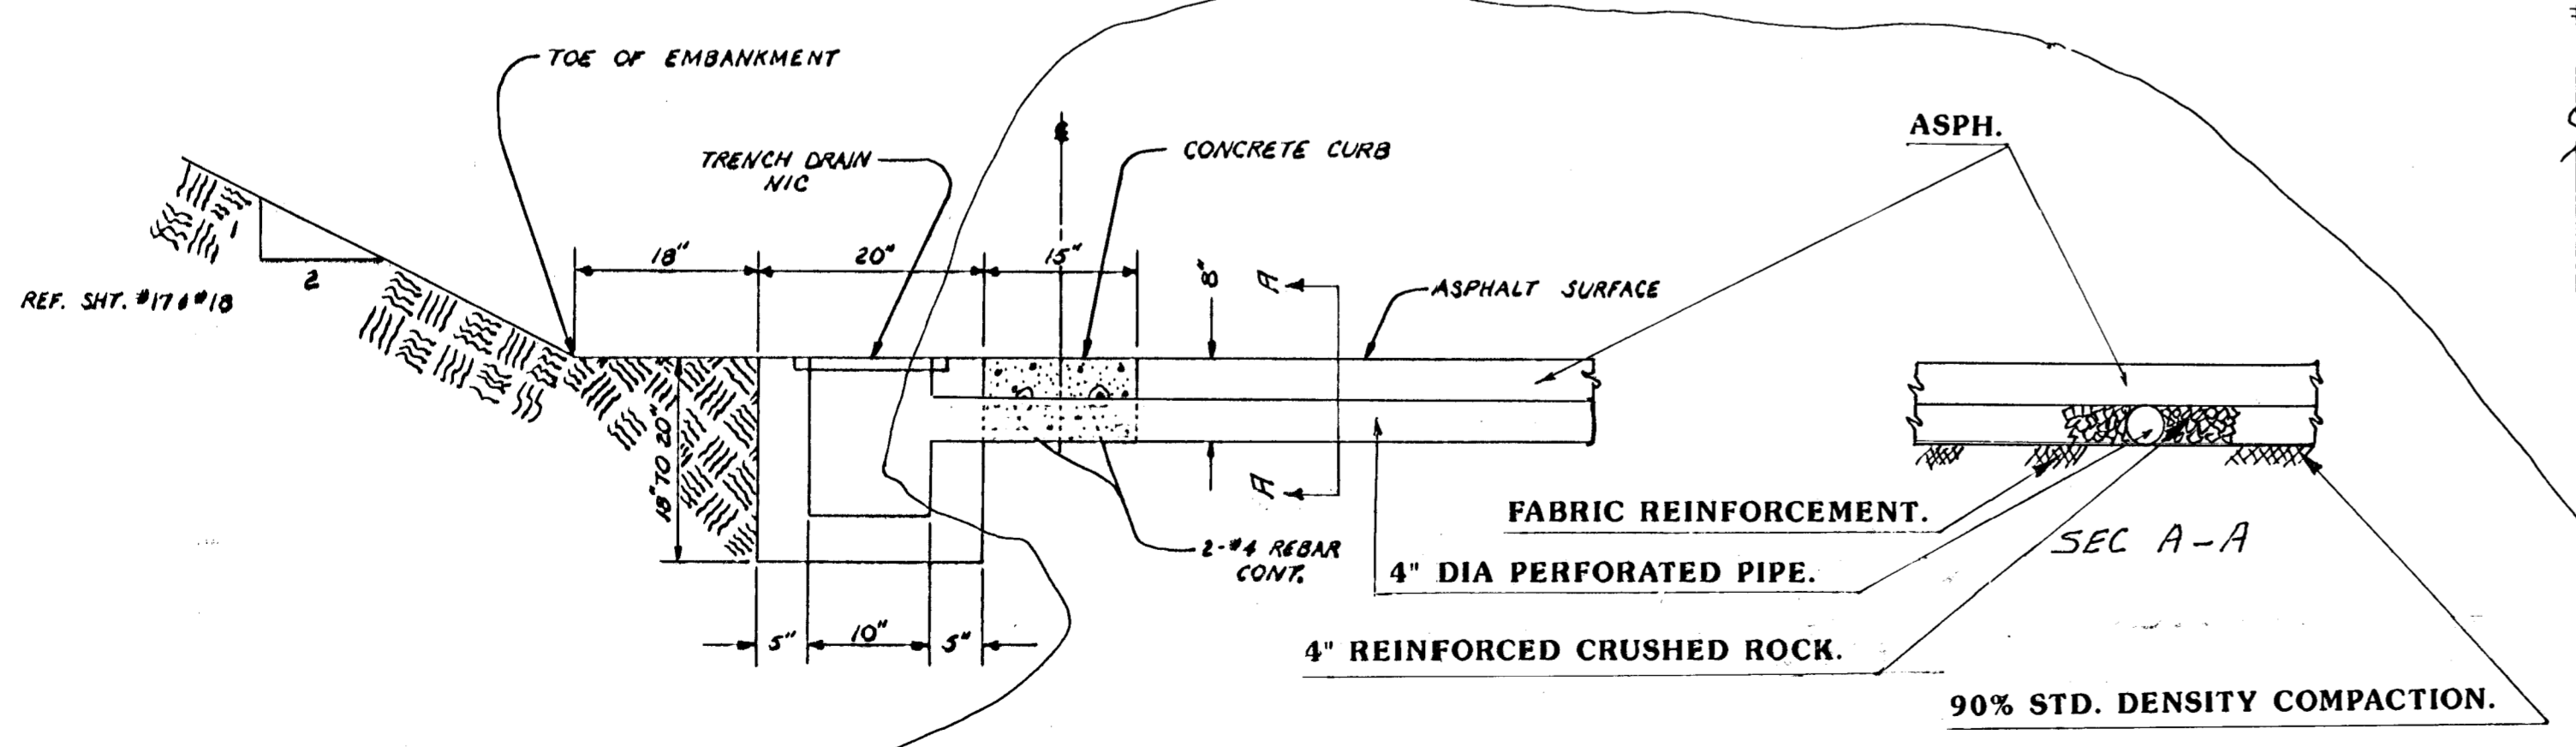

SECTION F-F
NO SCALE

BASE BID AND ADD ALTERNATE #1

DRILL 4" DIA. HOLE INTO THE SIDE OF THE TRENCH DRAIN AT 3 SUMP LOCATIONS. INSTALL 8' OF 4" DIA. PVC PERFORATED PIPE (SDR-35). ABOVE COST IS SUBSIDIARY TO THE BID ITEM PIPE INSTALLED.

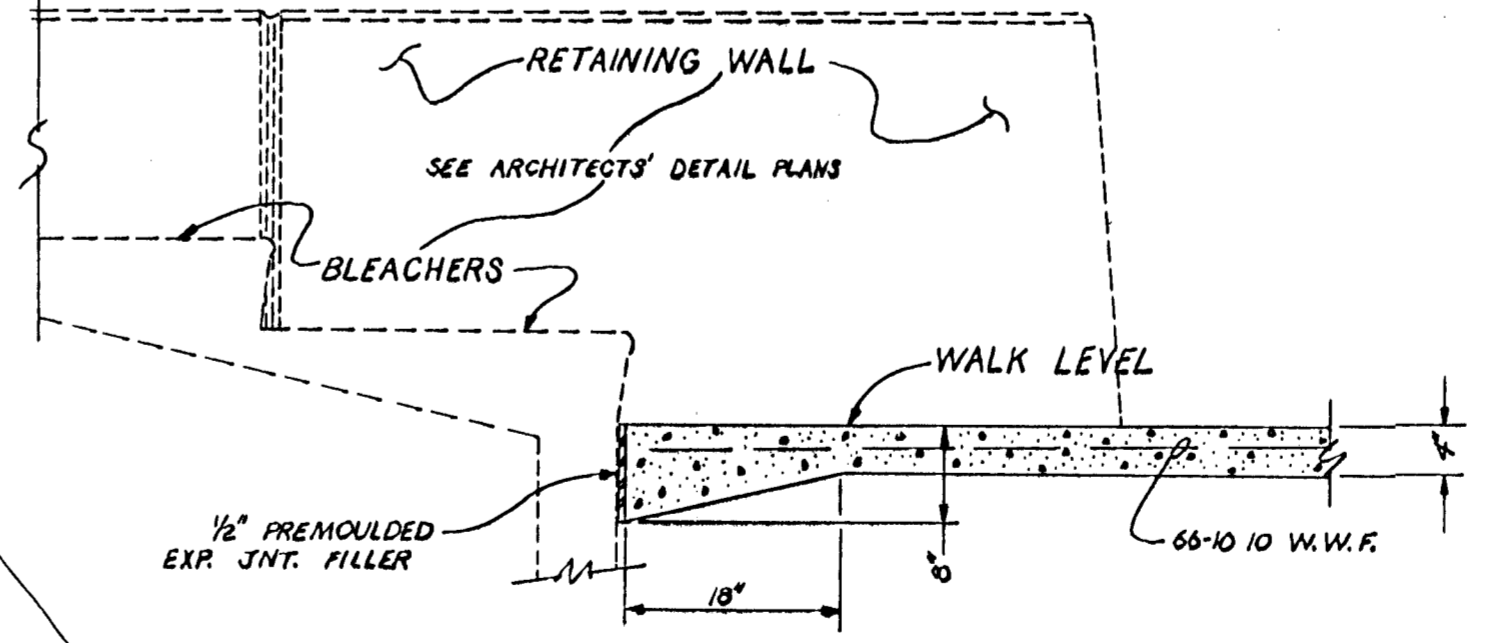

SECTION E-E

DETAILS				
SOUTH RIVERSIDE PARK				
PROJ. NO. 472-82869				
BOARD OF PARK COMMISSIONERS WICHITA, KANSAS				
DATE	DRAWN	SCALE	SHEET	
5-29-75	T.W.J.	3/4" = 1'-0"	5	OF 6