
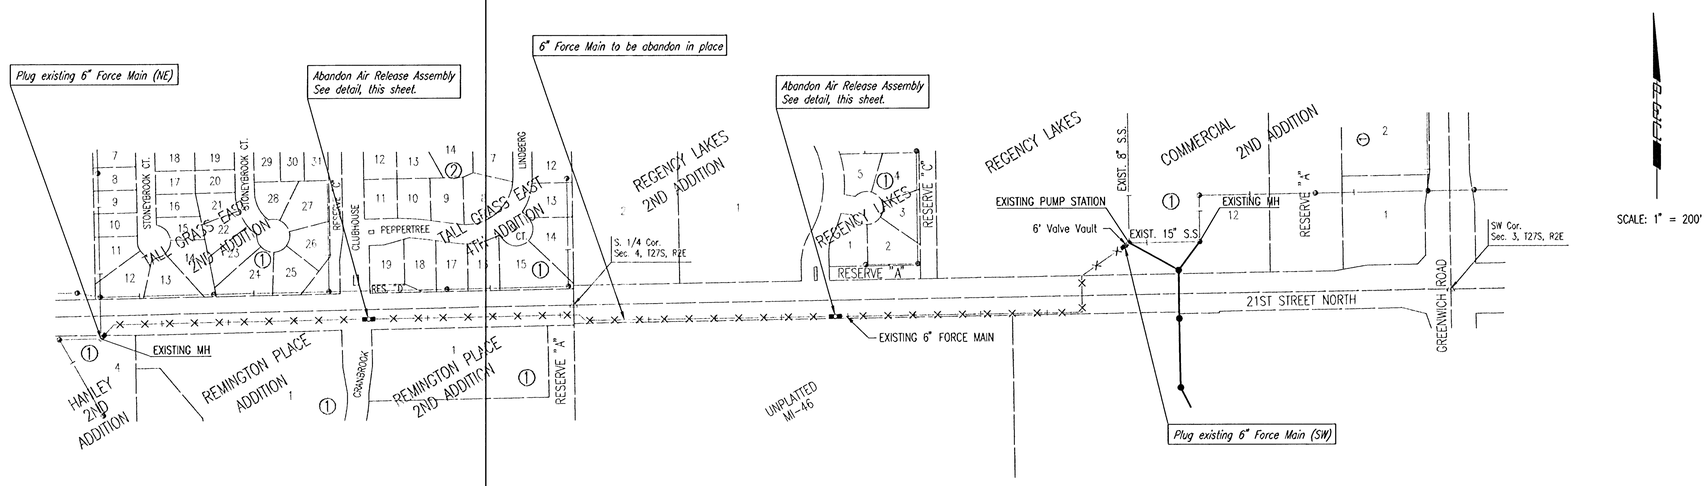



SCALE: 1" = 200'

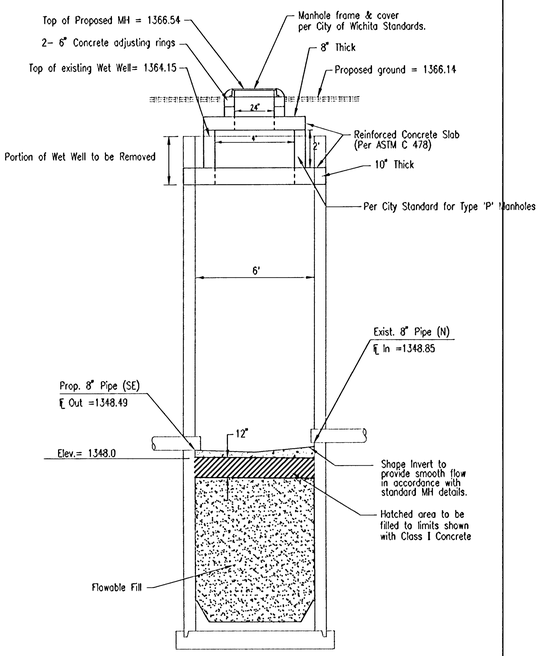

WET WELL CONVERSION

N.T.S.

NOTE: CONTRACTOR SHALL CLEAN WET WELL AND DISPOSE OF SOLIDS AND OTHER MATERIALS IN A MANNER AS APPROVED BY THE ENGINEER PRIOR TO FILLING WET WELL WITH FLOWABLE FILL.

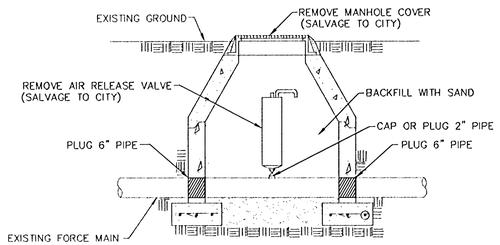

Contractor shall remove the Air Release Valve, miscellaneous piping and the top portion of the Air Release Vault (to be a minimum of 4' below finish grade), including frame and cover, adjusting rings, and cone, then backfill Vault with sand to 2' below grade. The remaining 2' shall be backfilled and compacted to 95% of ASTM D-698 with approved soil. All materials other than those specifically called out to be salvaged shall be disposed of by the Contractor properly.

AIR RELEASE VALVE ABANDONMENT

N.T.S.

NOTE: ALL LABOR AND MATERIALS NECESSARY TO COMPLETE THE WORK SHOWN ON THIS SHEET SHALL BE CONSIDERED SUBSIDIARY TO THE LUMP SUM PRICE BID FOR "PUMP STATION ABANDONMENT/REMOVAL".

RICHARD D. KRUEGER 13944 JULY 13, 2005 KANSAS PROFESSIONAL ENGINEER

No.	Revision	By	Date

MAIN 16 OF THE
FOUR MILE CREEK SEWER

FORCE MAIN ABANDONMENT AND MISCELLANEOUS DETAILS

JAMES L. ARMOUR, P.E.- CITY ENGINEER
CITY OF WICHITA PROJECT NO. 468-83803

Professional Engineering Consultants, P.A.
303 S. TOPEKA • WICHITA, KANSAS 67202
316-262-2691 • FAX 316-262-3003

Designed by	MDK	Job No.	04219-002	Sht. 16 of 26
Drawn by	JGA	Date	MAY 2004	

DSNR: OPER: JAG SCALE: 1=200.00
G:\2004\04219\002\Sabandonment 05-24-2005 03:17:36 pm