

Notes:
 The downspout boot/shoe shall be considered **SUBSIDIARY** to the bid item, "Pipe, SWS 8"

All work, labor, and material necessary to install the downspout boot/shoe and connect the pipe to the proposed inlet shall be considered **SUBSIDIARY** to the bid item, "Pipe, SWS 8"


The 8" pipe shall be PVC unless otherwise noted on the plans. Material other than PVC shall be submitted and approved by the Engineer.

The Contractor shall not damage any part of the existing side of the building structure upon installation. The Contractor is responsible for any damage to the existing building upon installation and shall repair the exterior to its original state.

The downspout boot/shoe is required to have a cleanout hole for easy access to clean out the line.

Shop drawings shall be submitted for approval prior to the downspout boot/shoe being installed. The materials used shall meet the City of Wichita Specifications and approved material lists.

Minimum slope for the 8" pipe needs to be 1.0% to maintain cleanout velocity into the inlet.

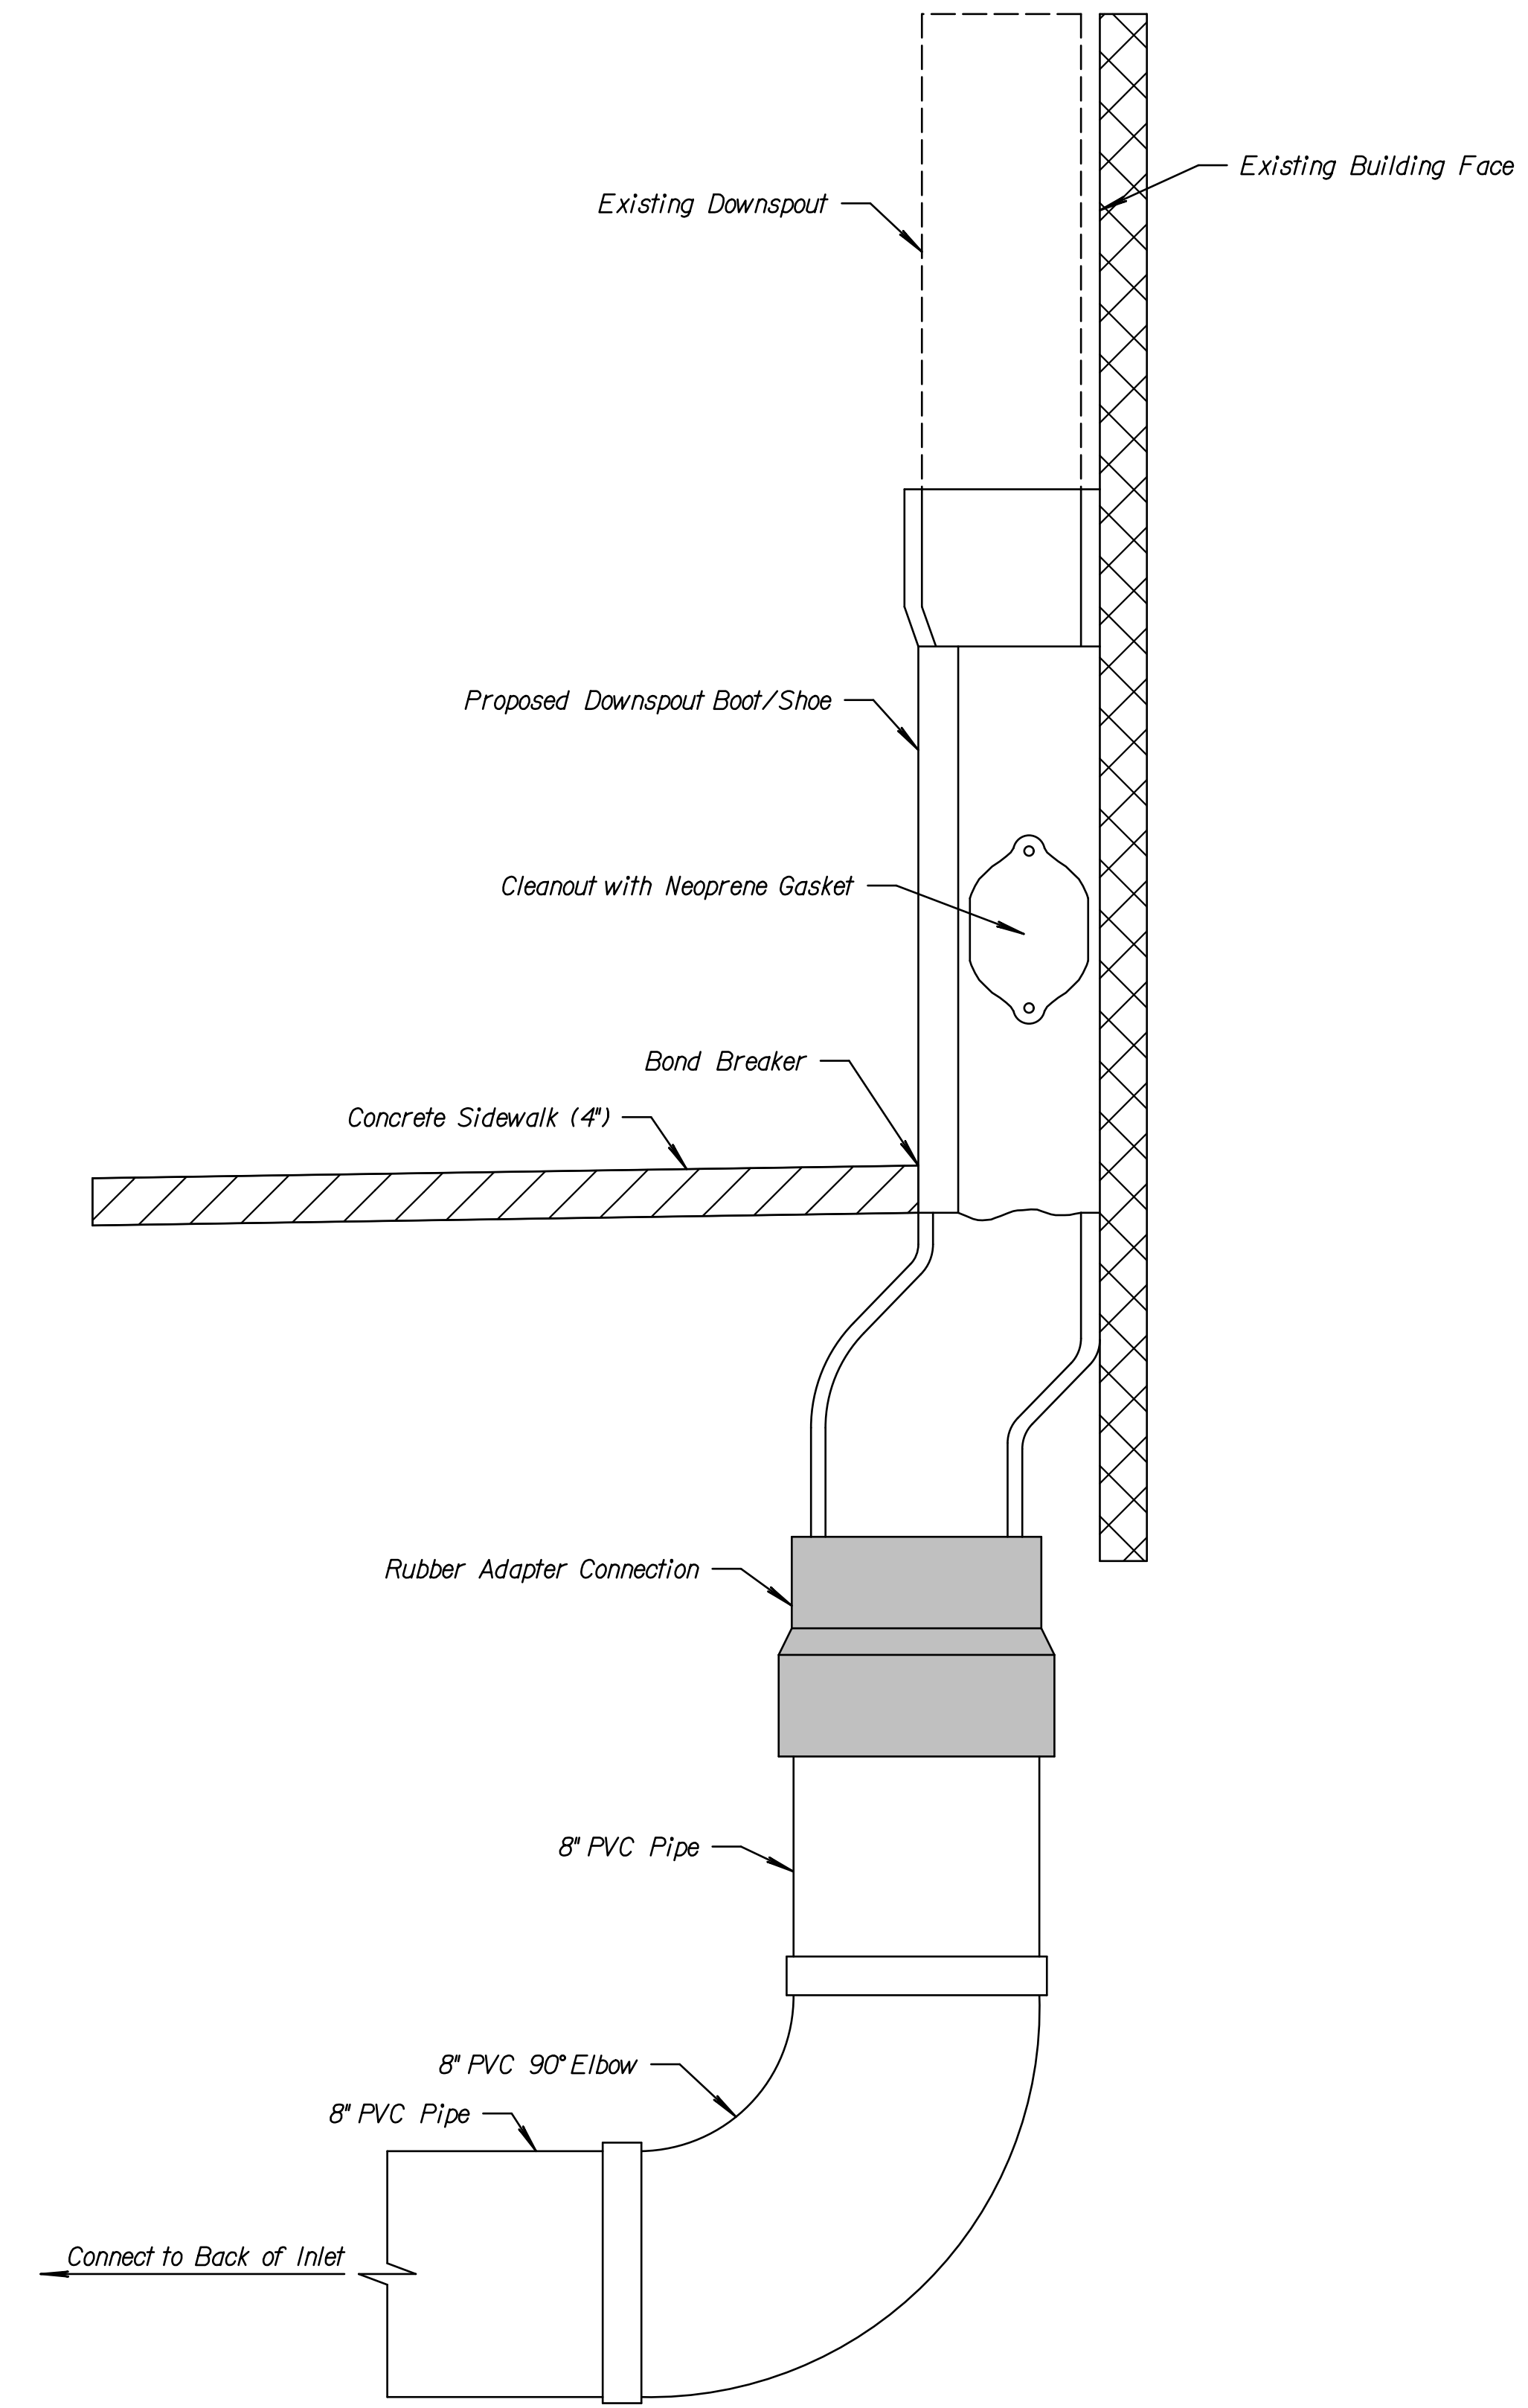

DOWNSPOUT BOOT/SHOE DETAIL
 N.T.S.

CONSULTANTS:

COMMERCE STREET & ST. FRANCIS
 AVENUE IMPROVEMENTS
 FROM WATERMAN TO KELLOGG

WICHITA, KANSAS



REVISIONS:	MARK	DATE	DESCRIPTION

PROJ NO: 472-2021
 SCALE: N.T.S.
 DATE: 2/21/2024
 DESIGNED BY: TAU
 DRAWN BY: TAU
 CHECKED BY: MDB

SHEET TITLE:
**DOWNSPOUT
 BOOT/SHOE
 DETAIL**

SHEET NO.
50
 SHEET 50 OF 163