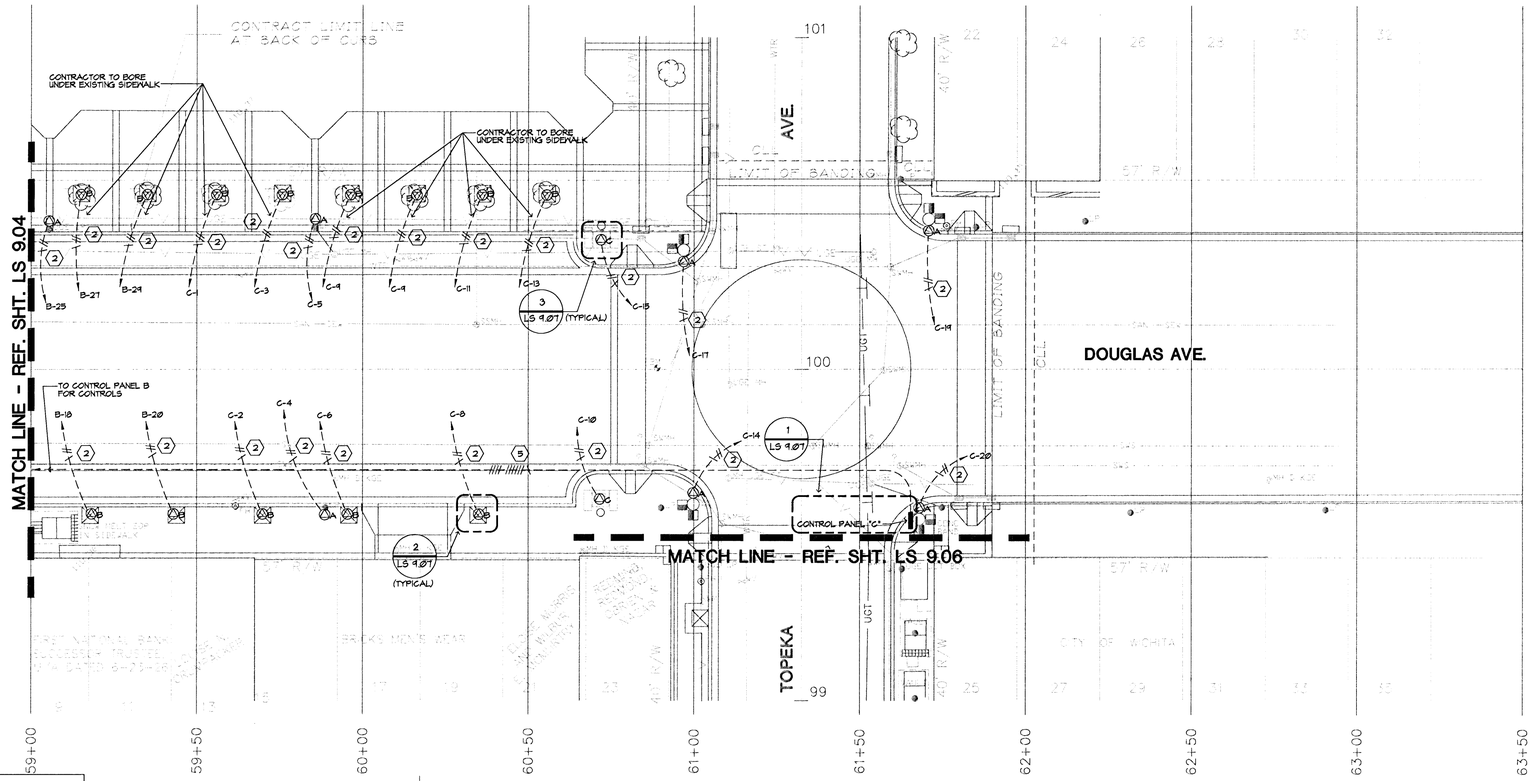

GENERAL LEGEND

- PROPERTY LINE
- CLL — CONTRACT LIMIT LINE
- CENTER LINE
- WTR, UGT, GAS, SWS, UGE — EXISTING UTILITY LINES
- EDGE OF BASEMENT

DETAIL REFERENCE

1 / LS 9.07 — 1 = DETAIL NO., LS 9.07 = SHEET NO.

EXISTING VAULTS

SCALE: 1"=20'

PARTIAL DOUGLAS AVE. POWER PLAN

NOTES:

1. BRANCH CIRCUITS ARE INDICATED AS ONE CIRCUIT HOME RUNS FOR CLARITY ONLY. CONTRACTOR MAY GROUP SINGLE POLE BRANCH CIRCUITS IN MULTIPLE CIRCUIT HOME RUNS. (3 CIRCUIT MAXIMUM) A GROUND CONDUCTOR SIZED PER N.E.C. ARTICLE 250 IS REQUIRED IN ALL POWER, RECEPTACLE, AND LIGHTING CIRCUITS.

JOHN VOEGELI 11701 5-12-99 KANSAS PROFESSIONAL ENGINEER

Stefan, Voegeli & Associates Inc.
Electrical Engineering and Design
349 S. Hydraulic
Wichita, Ks. 67211-1908
(316) 264-3061
FAX: (316) 264-3642

MID-KANSAS ENGINEERING CONSULTANTS, INC.
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

STREETSCAPES
PROJECT NAME

DOUGLAS AVE. @ 59+00 TO 62+00
SHEET TITLE

SVA	SVA	SVA
DESIGN BY:	DRAWN BY:	CHECKED BY:
MAY 1998	92010	LS 9.05
DATE	JOB NO.	SHEET/OF

98003-014

S.V.A. DWG. NAME: 80035E004.DWG; DATE: 05/12/99; TIME: 16:11