

GENERAL NOTES:


1. Utility service lines, poles, valve boxes, meters and etc. are to be adjusted as necessary by others prior to construction unless the plans specifically call for their adjustment by the Contractor. Existing utilities and their location, as shown on the plans, represent the best information obtainable for design. The Contractor will be required to work around existing utilities within the right-of-way which do not conflict with proposed construction.
2. A saw cut of at least one-half the depth of existing surface courses or one-fourth the depth of the existing total pavement thickness shall be provided at locations where proposed construction abuts an existing surface course or pavement for which partial removal of that surface or pavement is required. Sawed joint to facilitate removal within three (3) feet of existing joints will not be permitted and for such instances the limits of removal shall extend to the existing joint. Such saw cuts will not be paid for directly and this cost shall be considered as subsidiary to the project costs.
3. Rubble from the removal of miscellaneous structures and excess excavation which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations that, in the opinion of the Engineer, will leave an unsightly appearance will not be approved.
- All suble excavation shall be wasted on low lying lots within the addition before any material is disposed of off site.
- All disposal sites must be approved by the Kansas Department of Health and Environment. Material either stockpiled or disposed of in a flood plain would require a Kansas State Board of Agriculture permit. Any material dumped in waters of the United States or wetlands is subject to U.S. Corps. of Engineers permitting regulations. Any material buried or stockpiled beyond approved construction limits would require additional archaeological investigations unless buried in a previously approved borrow location.
4. Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in direct conflict with proposed new construction shall be saved and protected from damage.
5. The Contractor shall be responsible for preserving property irons. The Contractor will be required to reestablish any property irons which are damaged or destroyed by his construction operations. Such irons shall be reestablished by a licensed land surveyor in accordance with state laws.
6. Trees are to be removed as needed. The cost is subsidiary to site clearing costs.
7. All disturbed areas within street right-of-ways shall be seeded with temporary rye grass within 14 days of disturbance at a rate of 250 lbs. per acre.

EARTHWORK SUMMARY

Pond Excavation	53,460 C.Y.
Pond Loose Fill	7,704 C.Y.
Waste	45,756 C.Y.

STORM WATER DRAIN NO. 178
EQUESTRIAN ESTATES - PHASE 1
TO
THE CITY OF WICHITA, KANSAS

MICHAEL E. LINDEBAK, P.E. - CITY ENGINEER
PROJECT NO. 468-83320
OCA NO. 751305

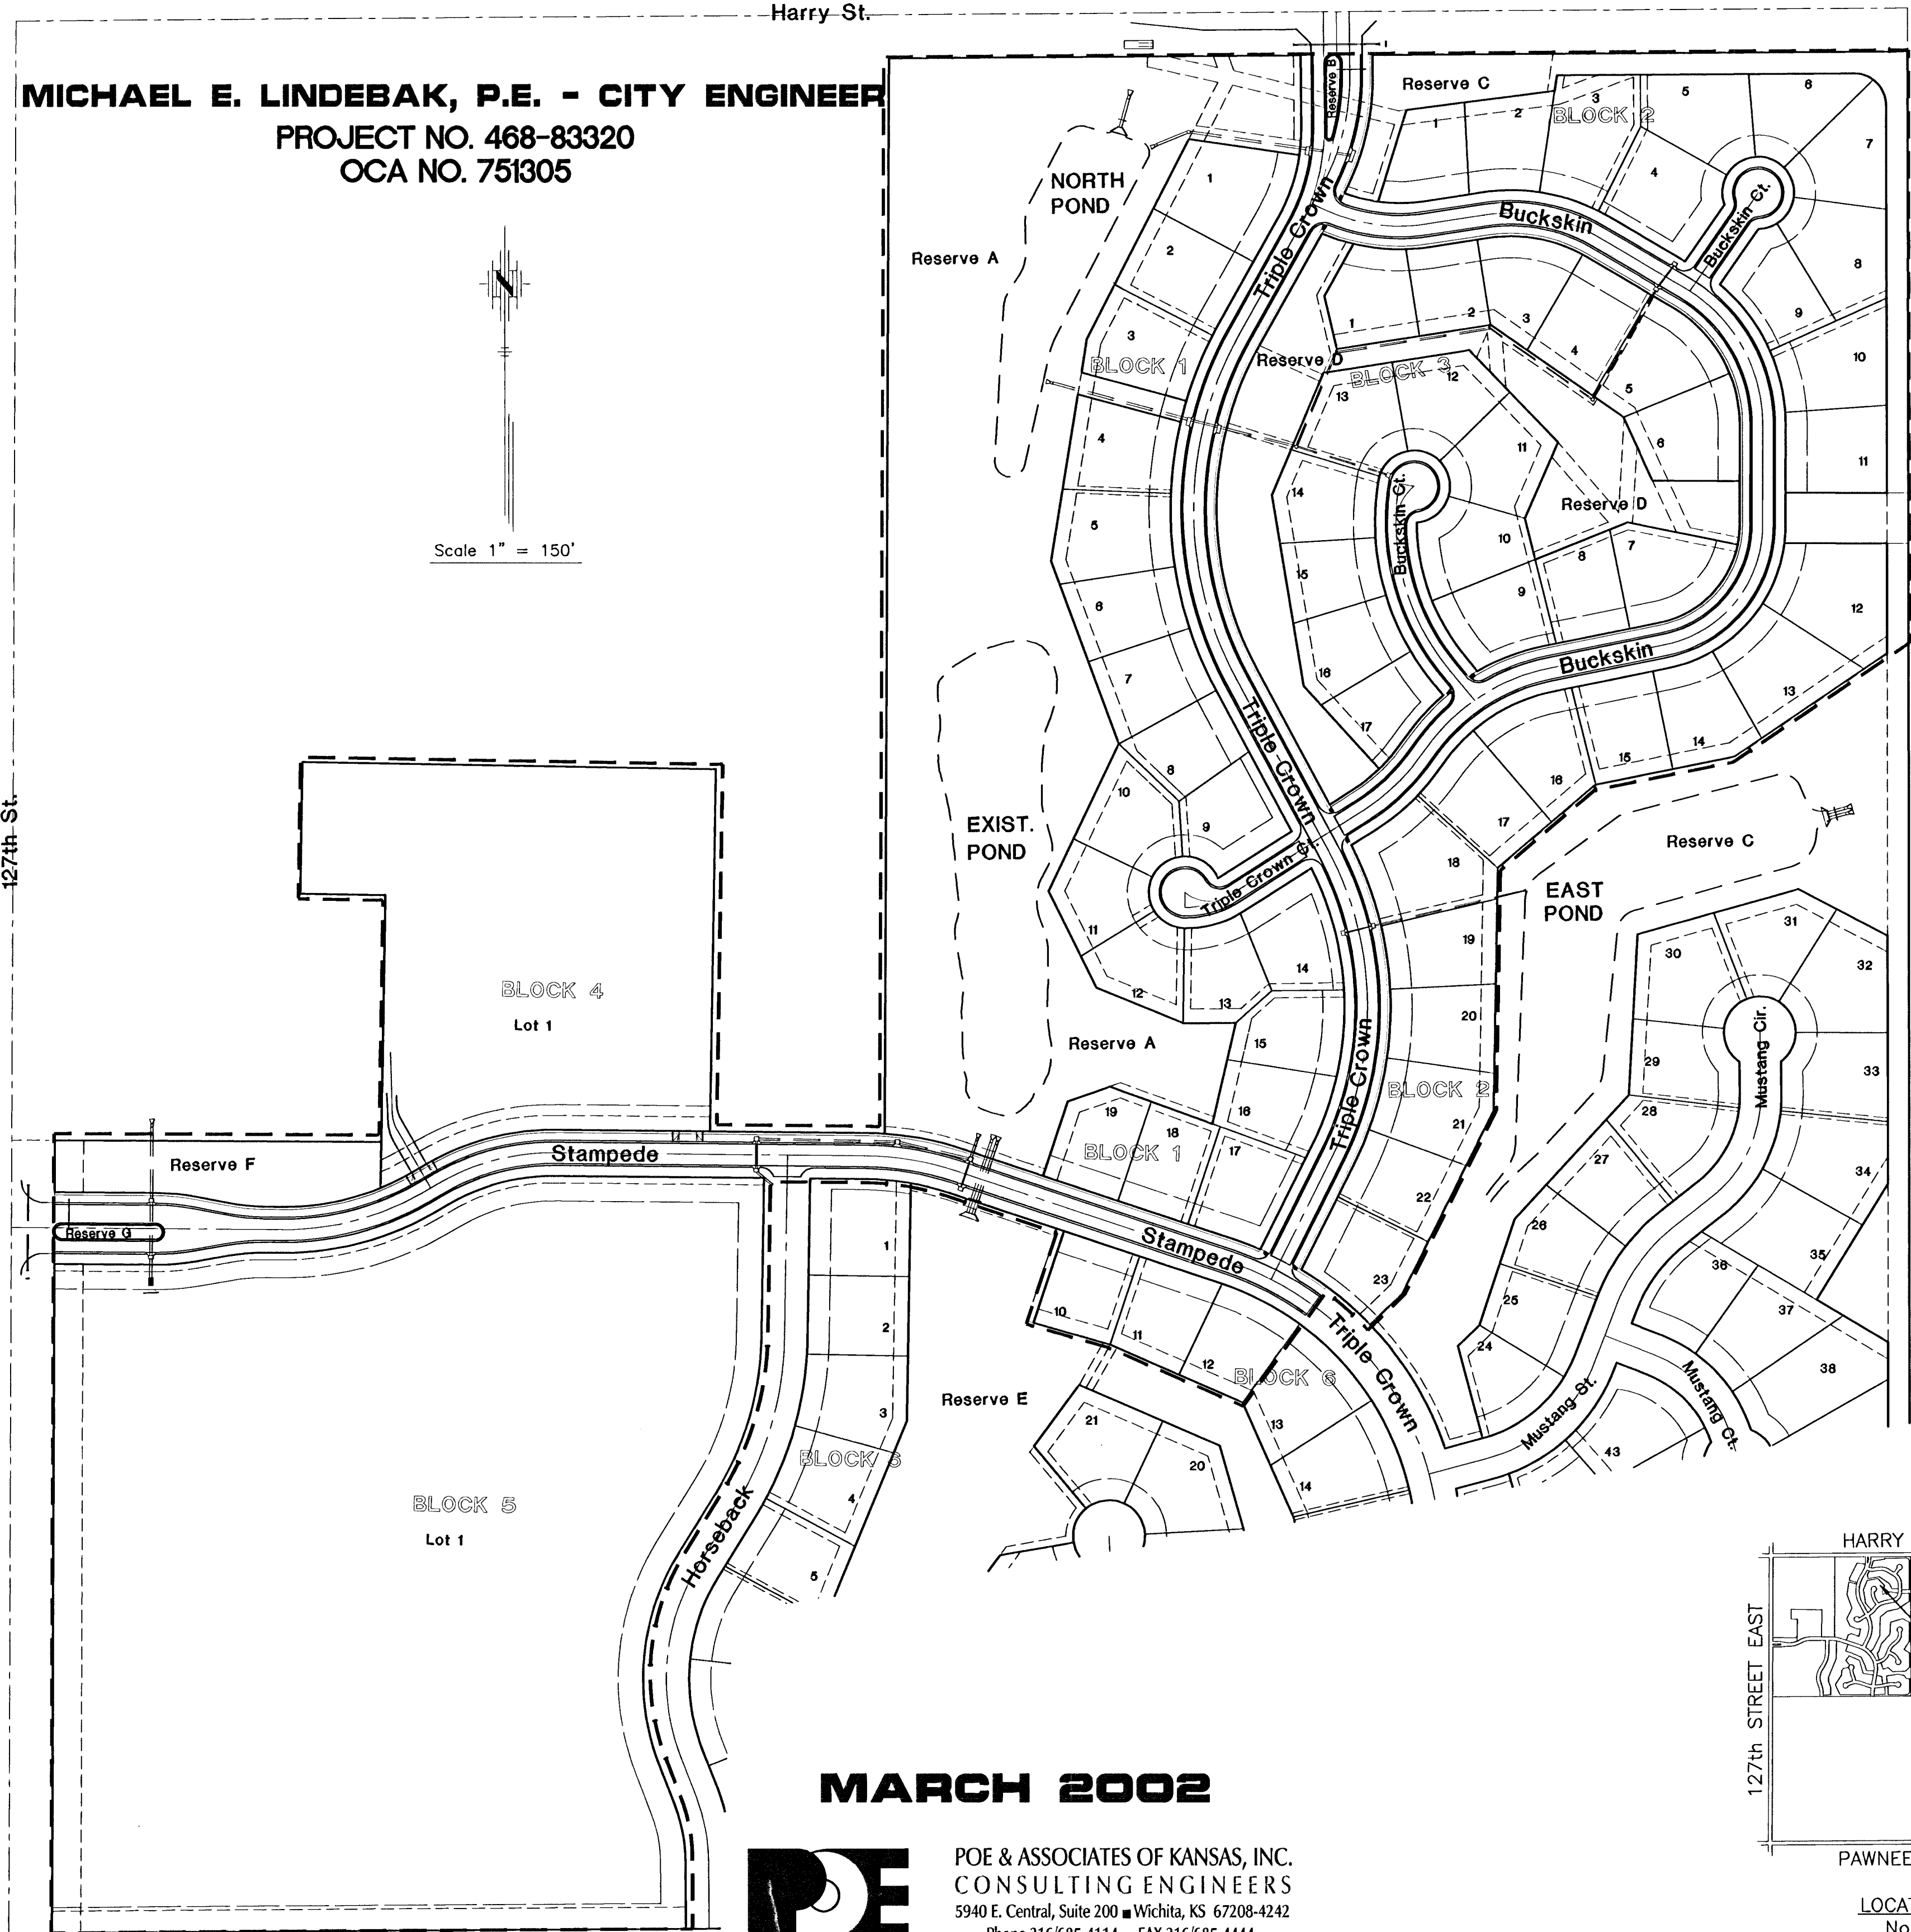

MARCH 2002



POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 ■ Wichita, KS 67208-4242
Phone 316/685-4114 ■ FAX 316/685-4444

INDEX

TITLE SHEET	SHEET 1
POND OUTLET STRUCTURES	SHEET 2
NORTH DAM PROFILE	SHEET 3
EAST DAM PROFILE	SHEET 4
EMERGENCY SPILLWAY PROFILES	SHEET 5
POND NOTES/COLLAR DETAILS	SHEET 6
POND GRADING PLANS	SHEET 7-9
HEADWALL DETAILS	SHEET 10
WINGWALL DETAILS	SHEET 11-12
SOIL SAVER DETAILS	SHEET 13
SOIL EROSION BMP DETAILS	SHEET 14-15
COORDINATE POINTS LIST	SHEET 16
LOT GRADING PLAN	SHEET 17
STORM WATER POLLUTION PREVENTION PLAN	SHEET 18
EQUESTRIAN ESTATES PLAT	SHEET 19-20


BOOKED
11-7-02
MCS
C-232







BENCH MARKS

(U.S.G.S. Datum)

- Railroad spike in power pole, approximately 25' south and 30' east of W 1/4 Corner, Section 35-27-2E. Elev. 1349.65
- Square on south hub guard of RCBC just west of NW Corner of Section 35-27-2E. Elev. 1311.90

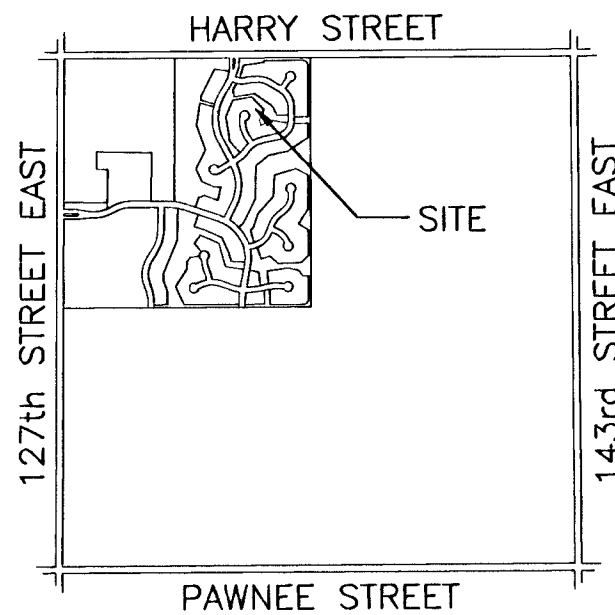


LOCATION MAP
No Scale

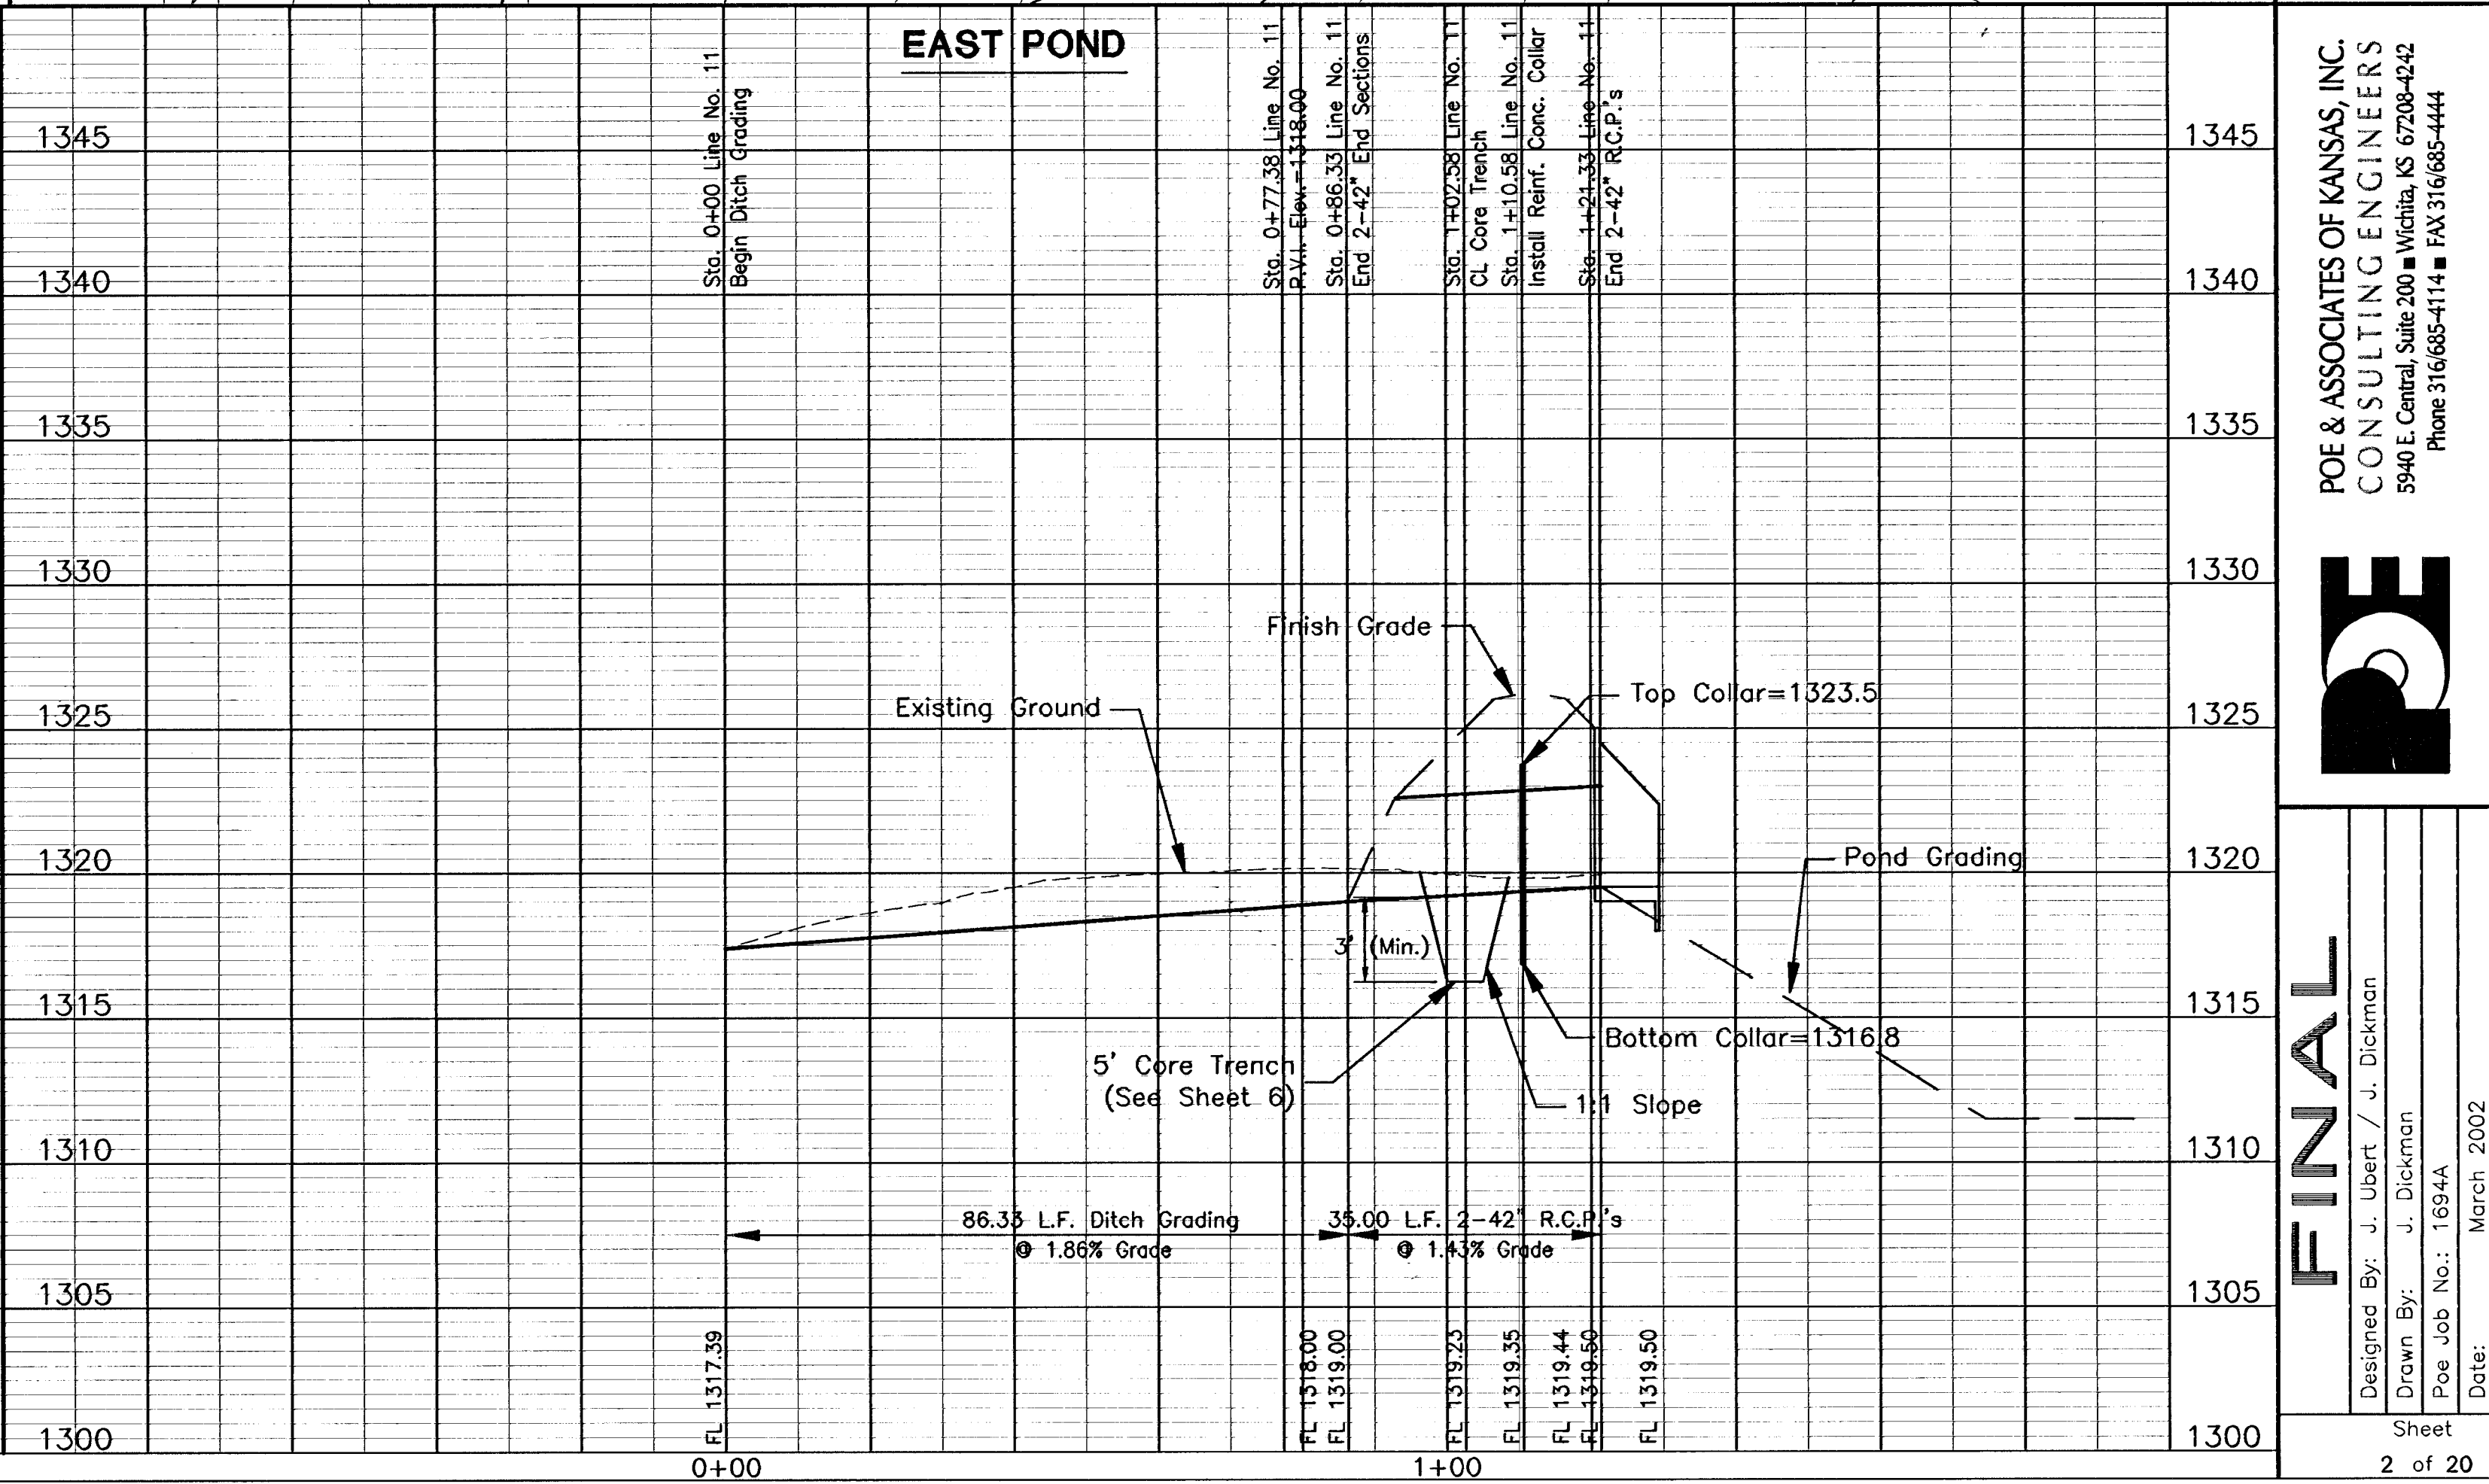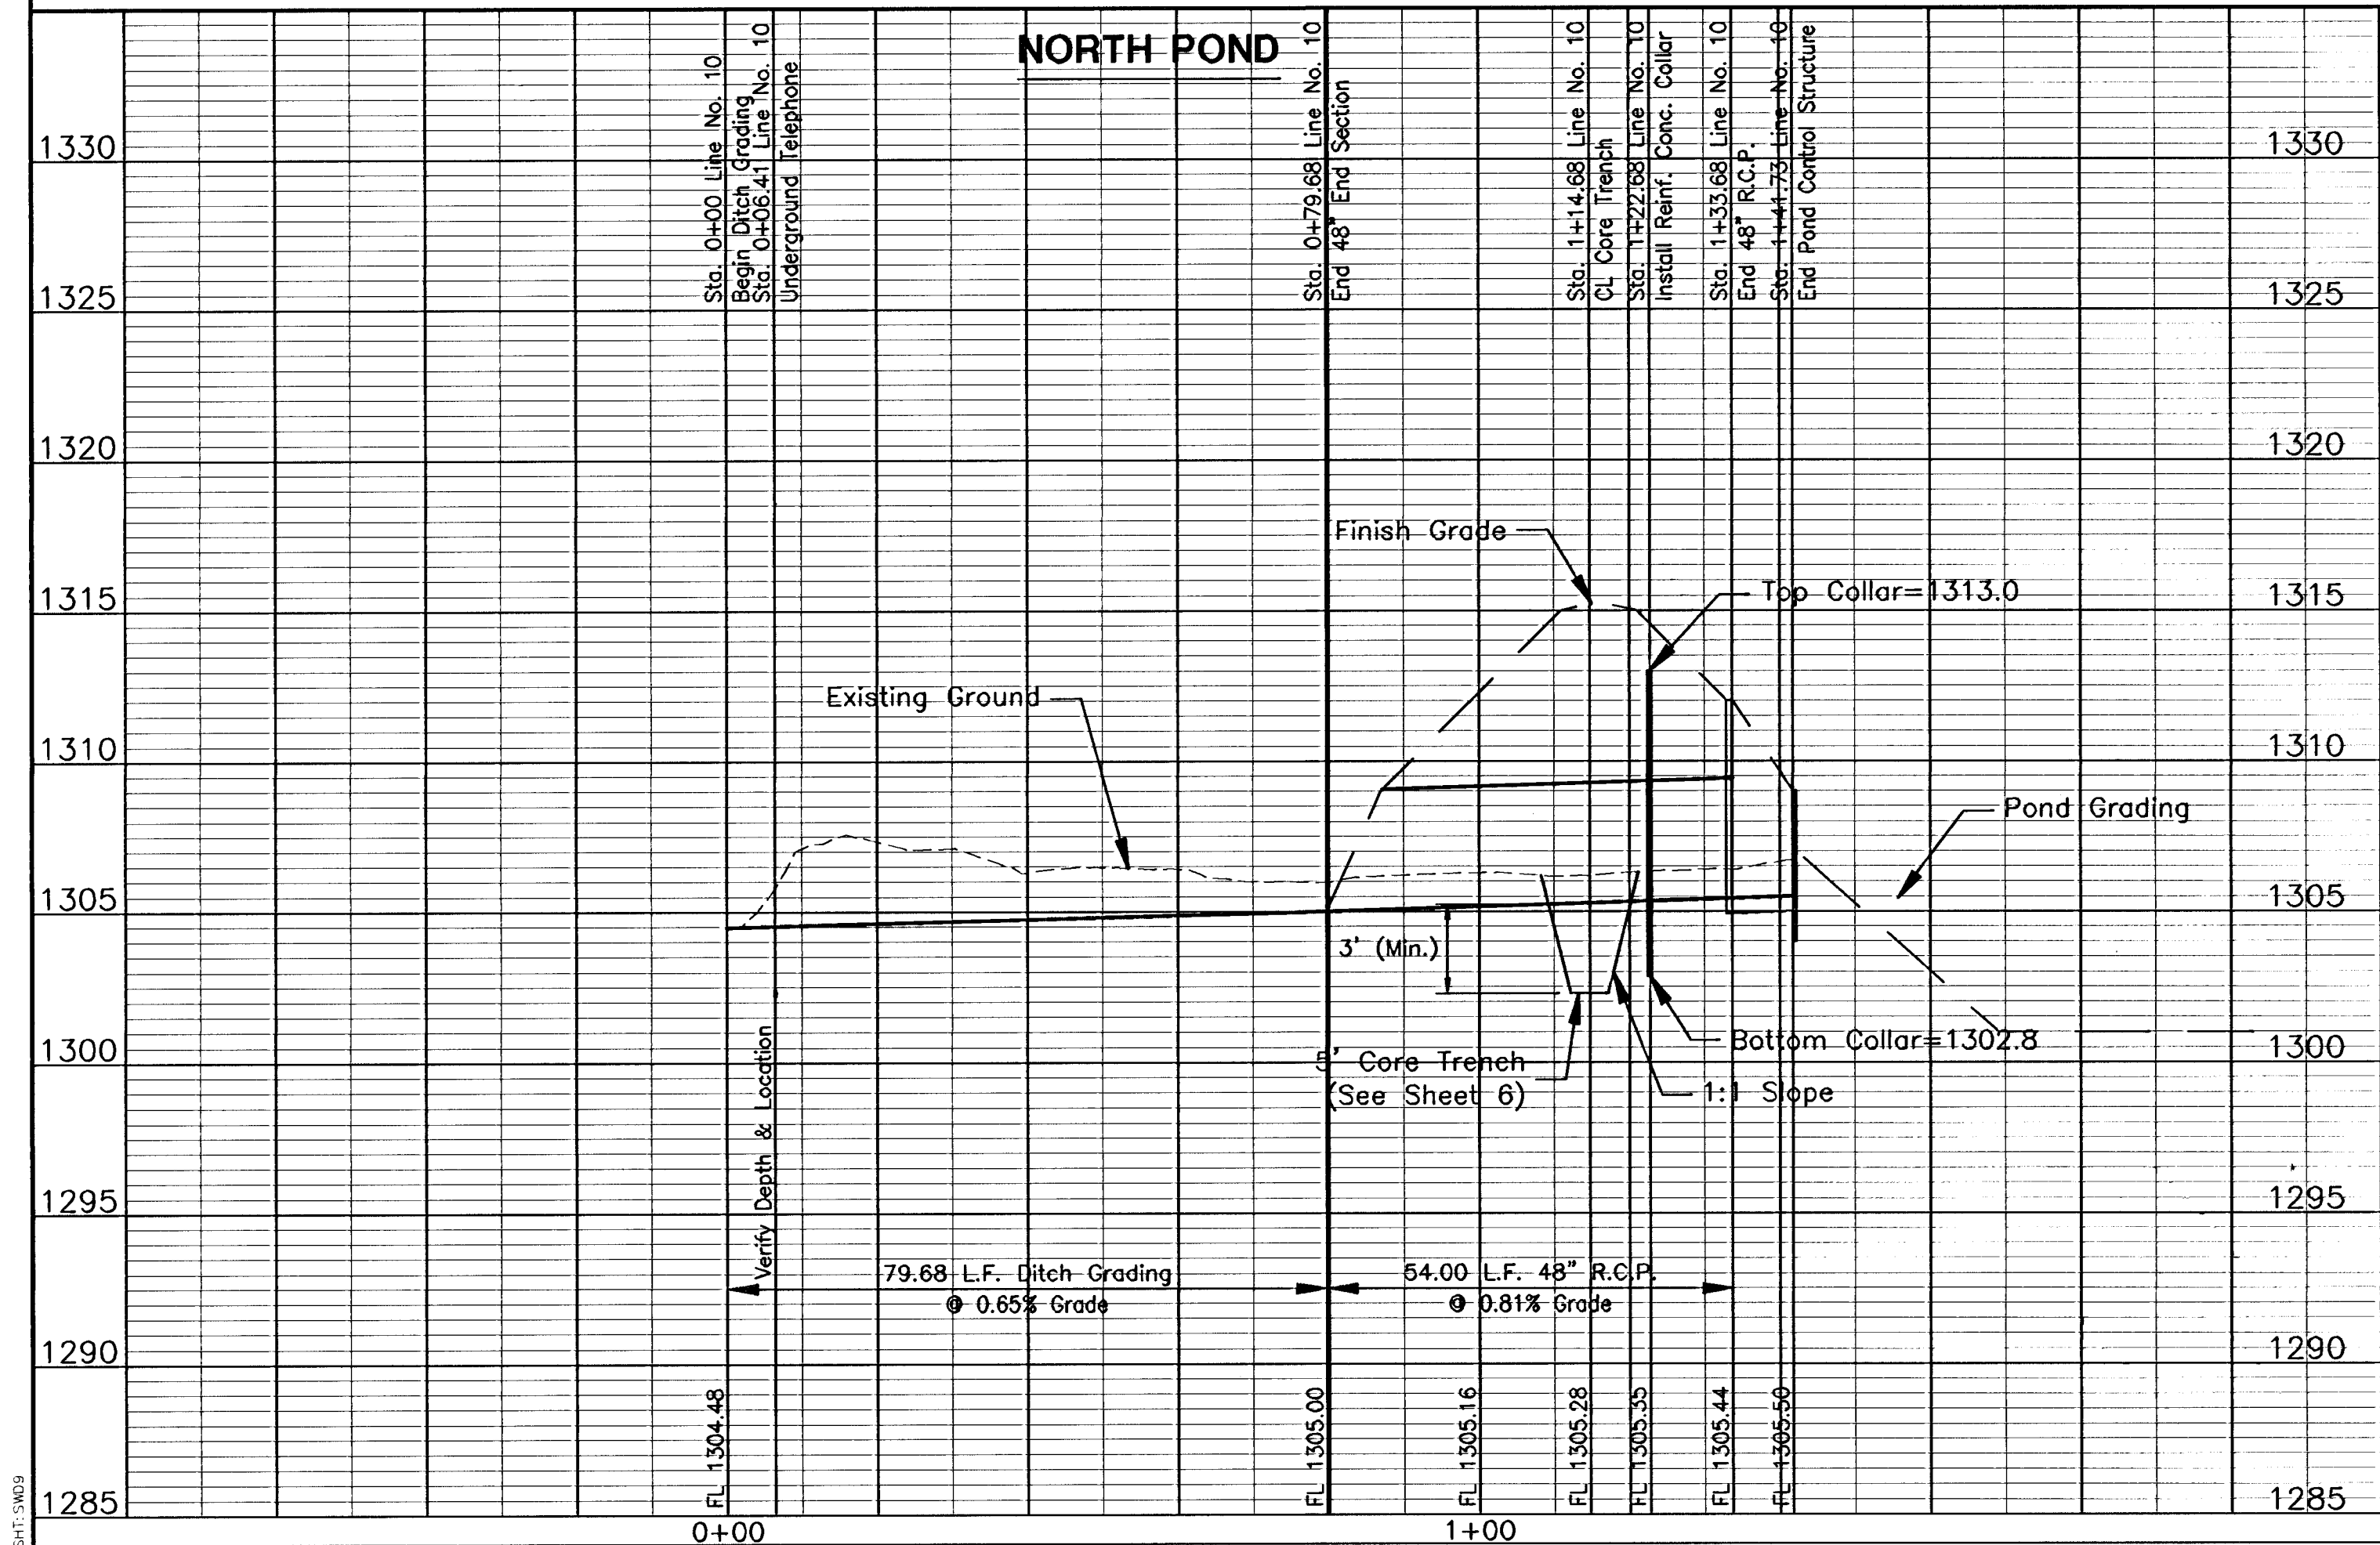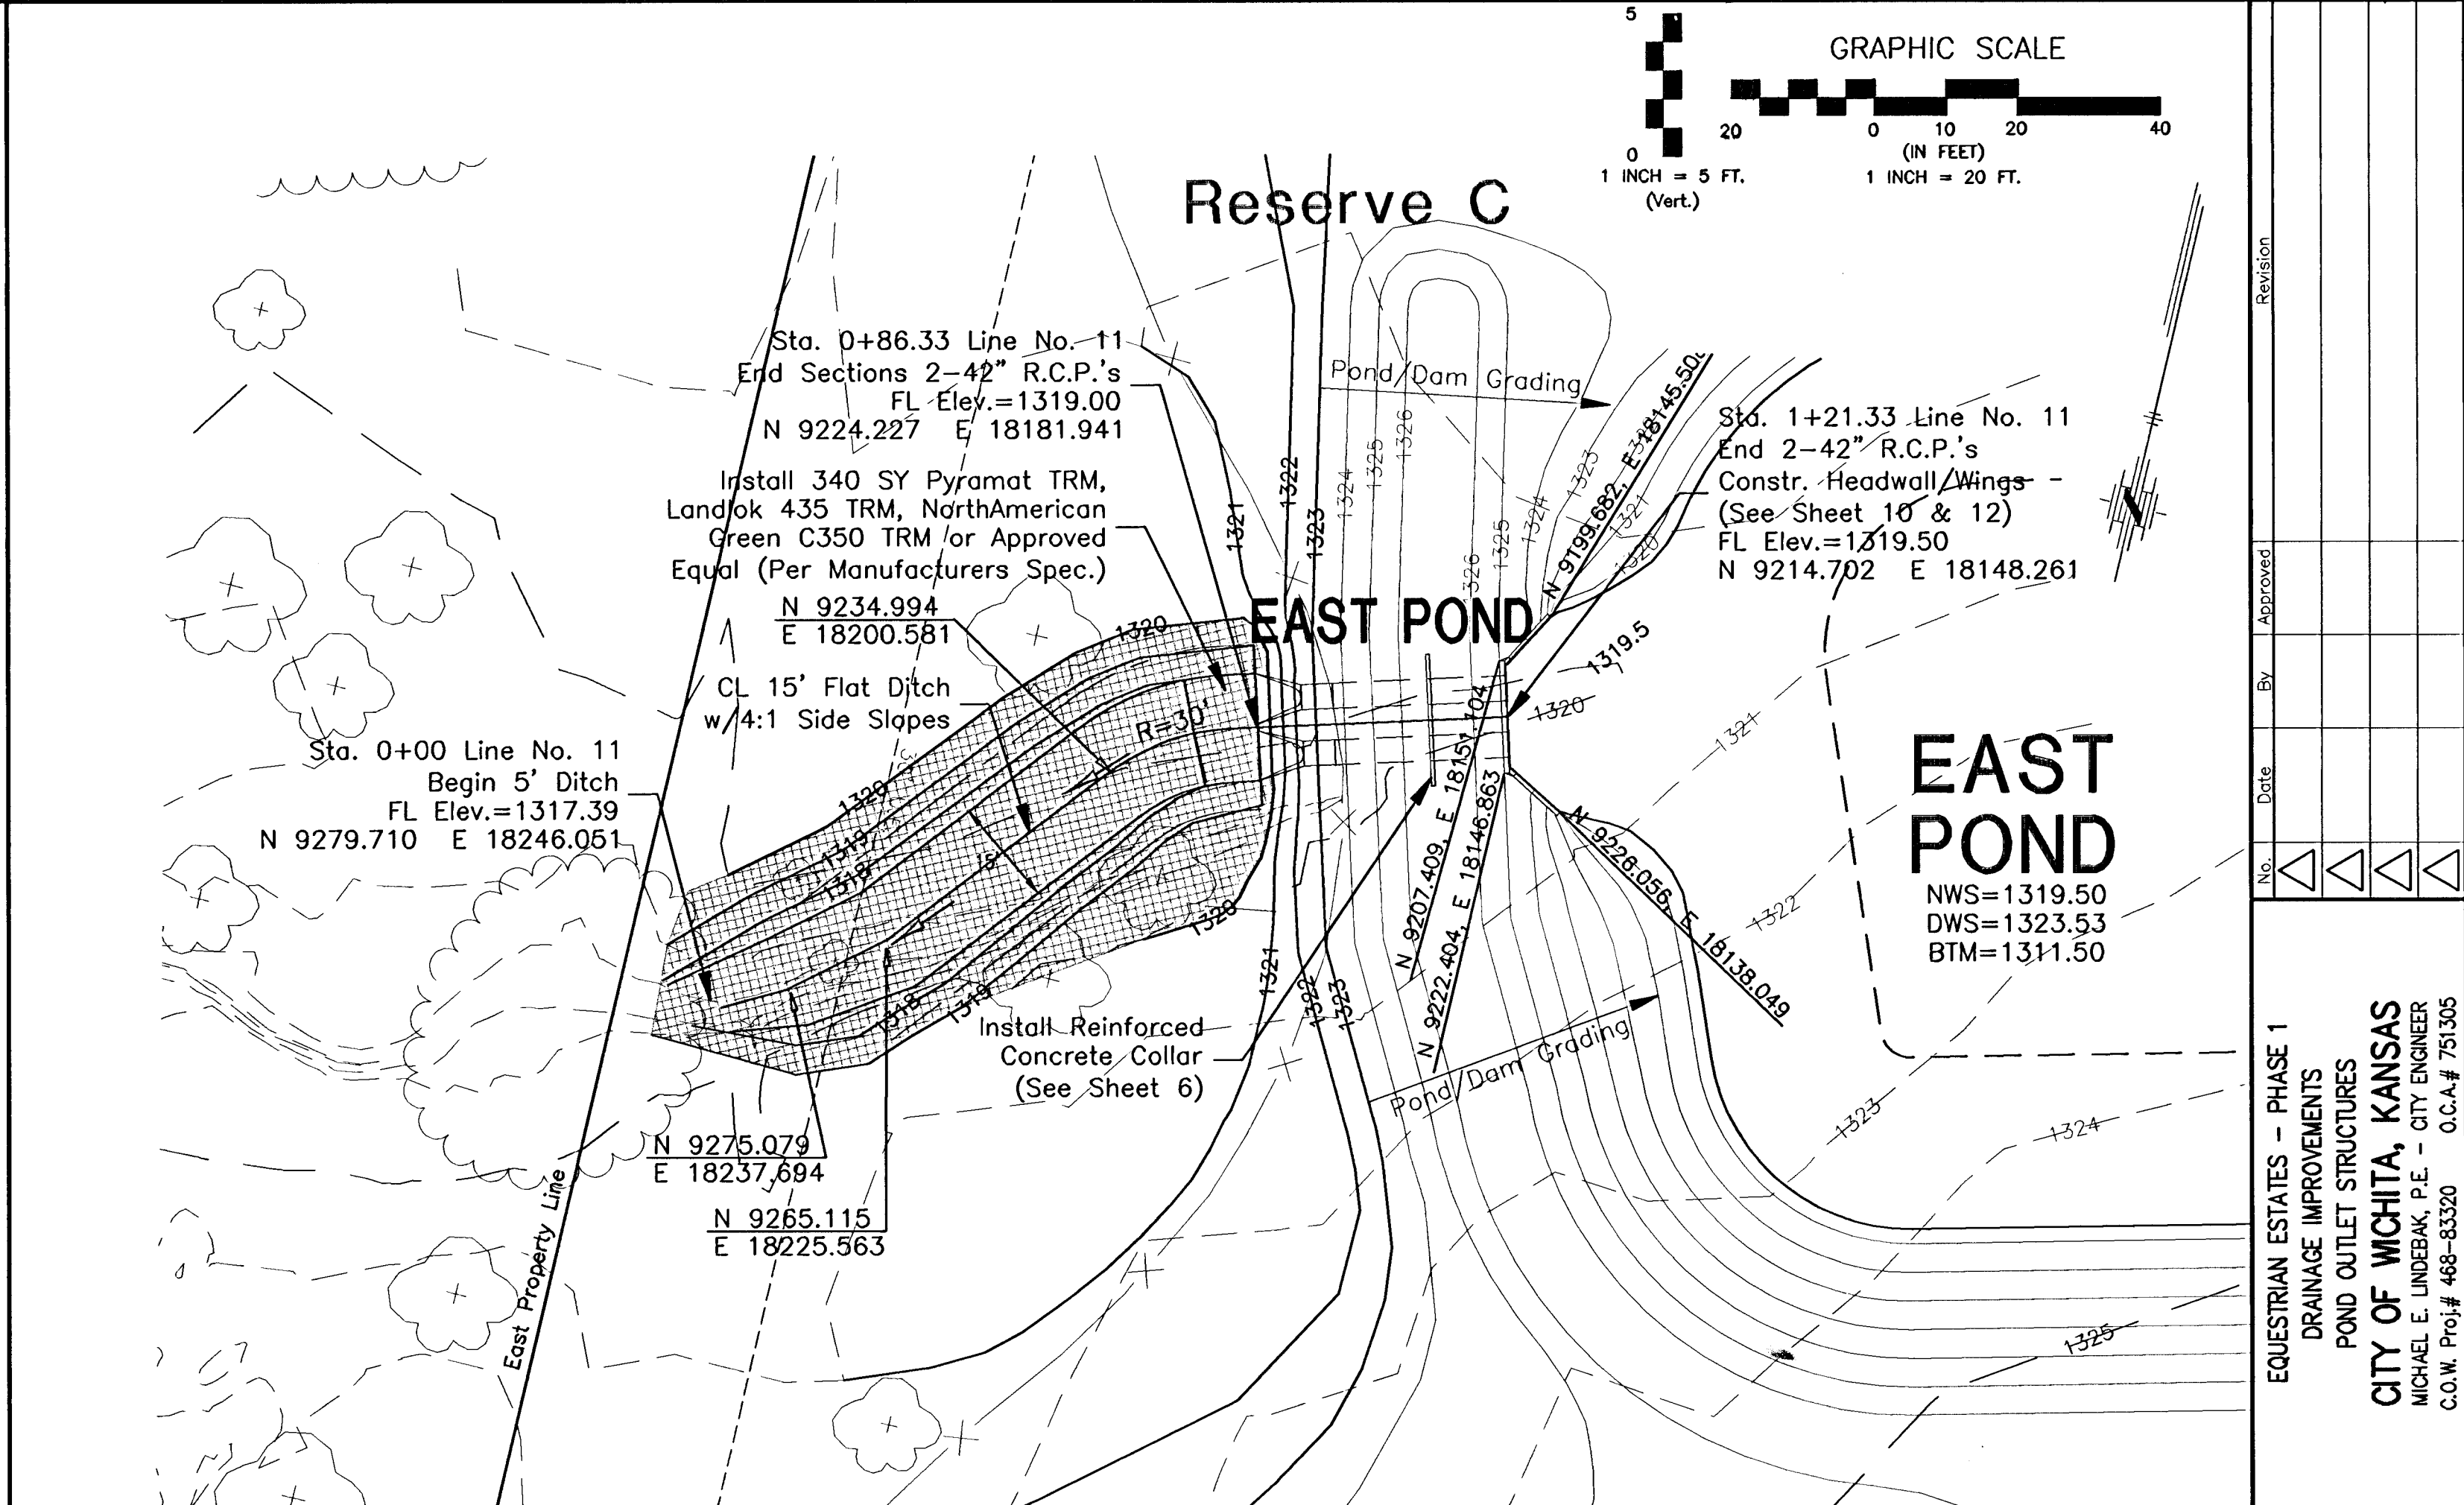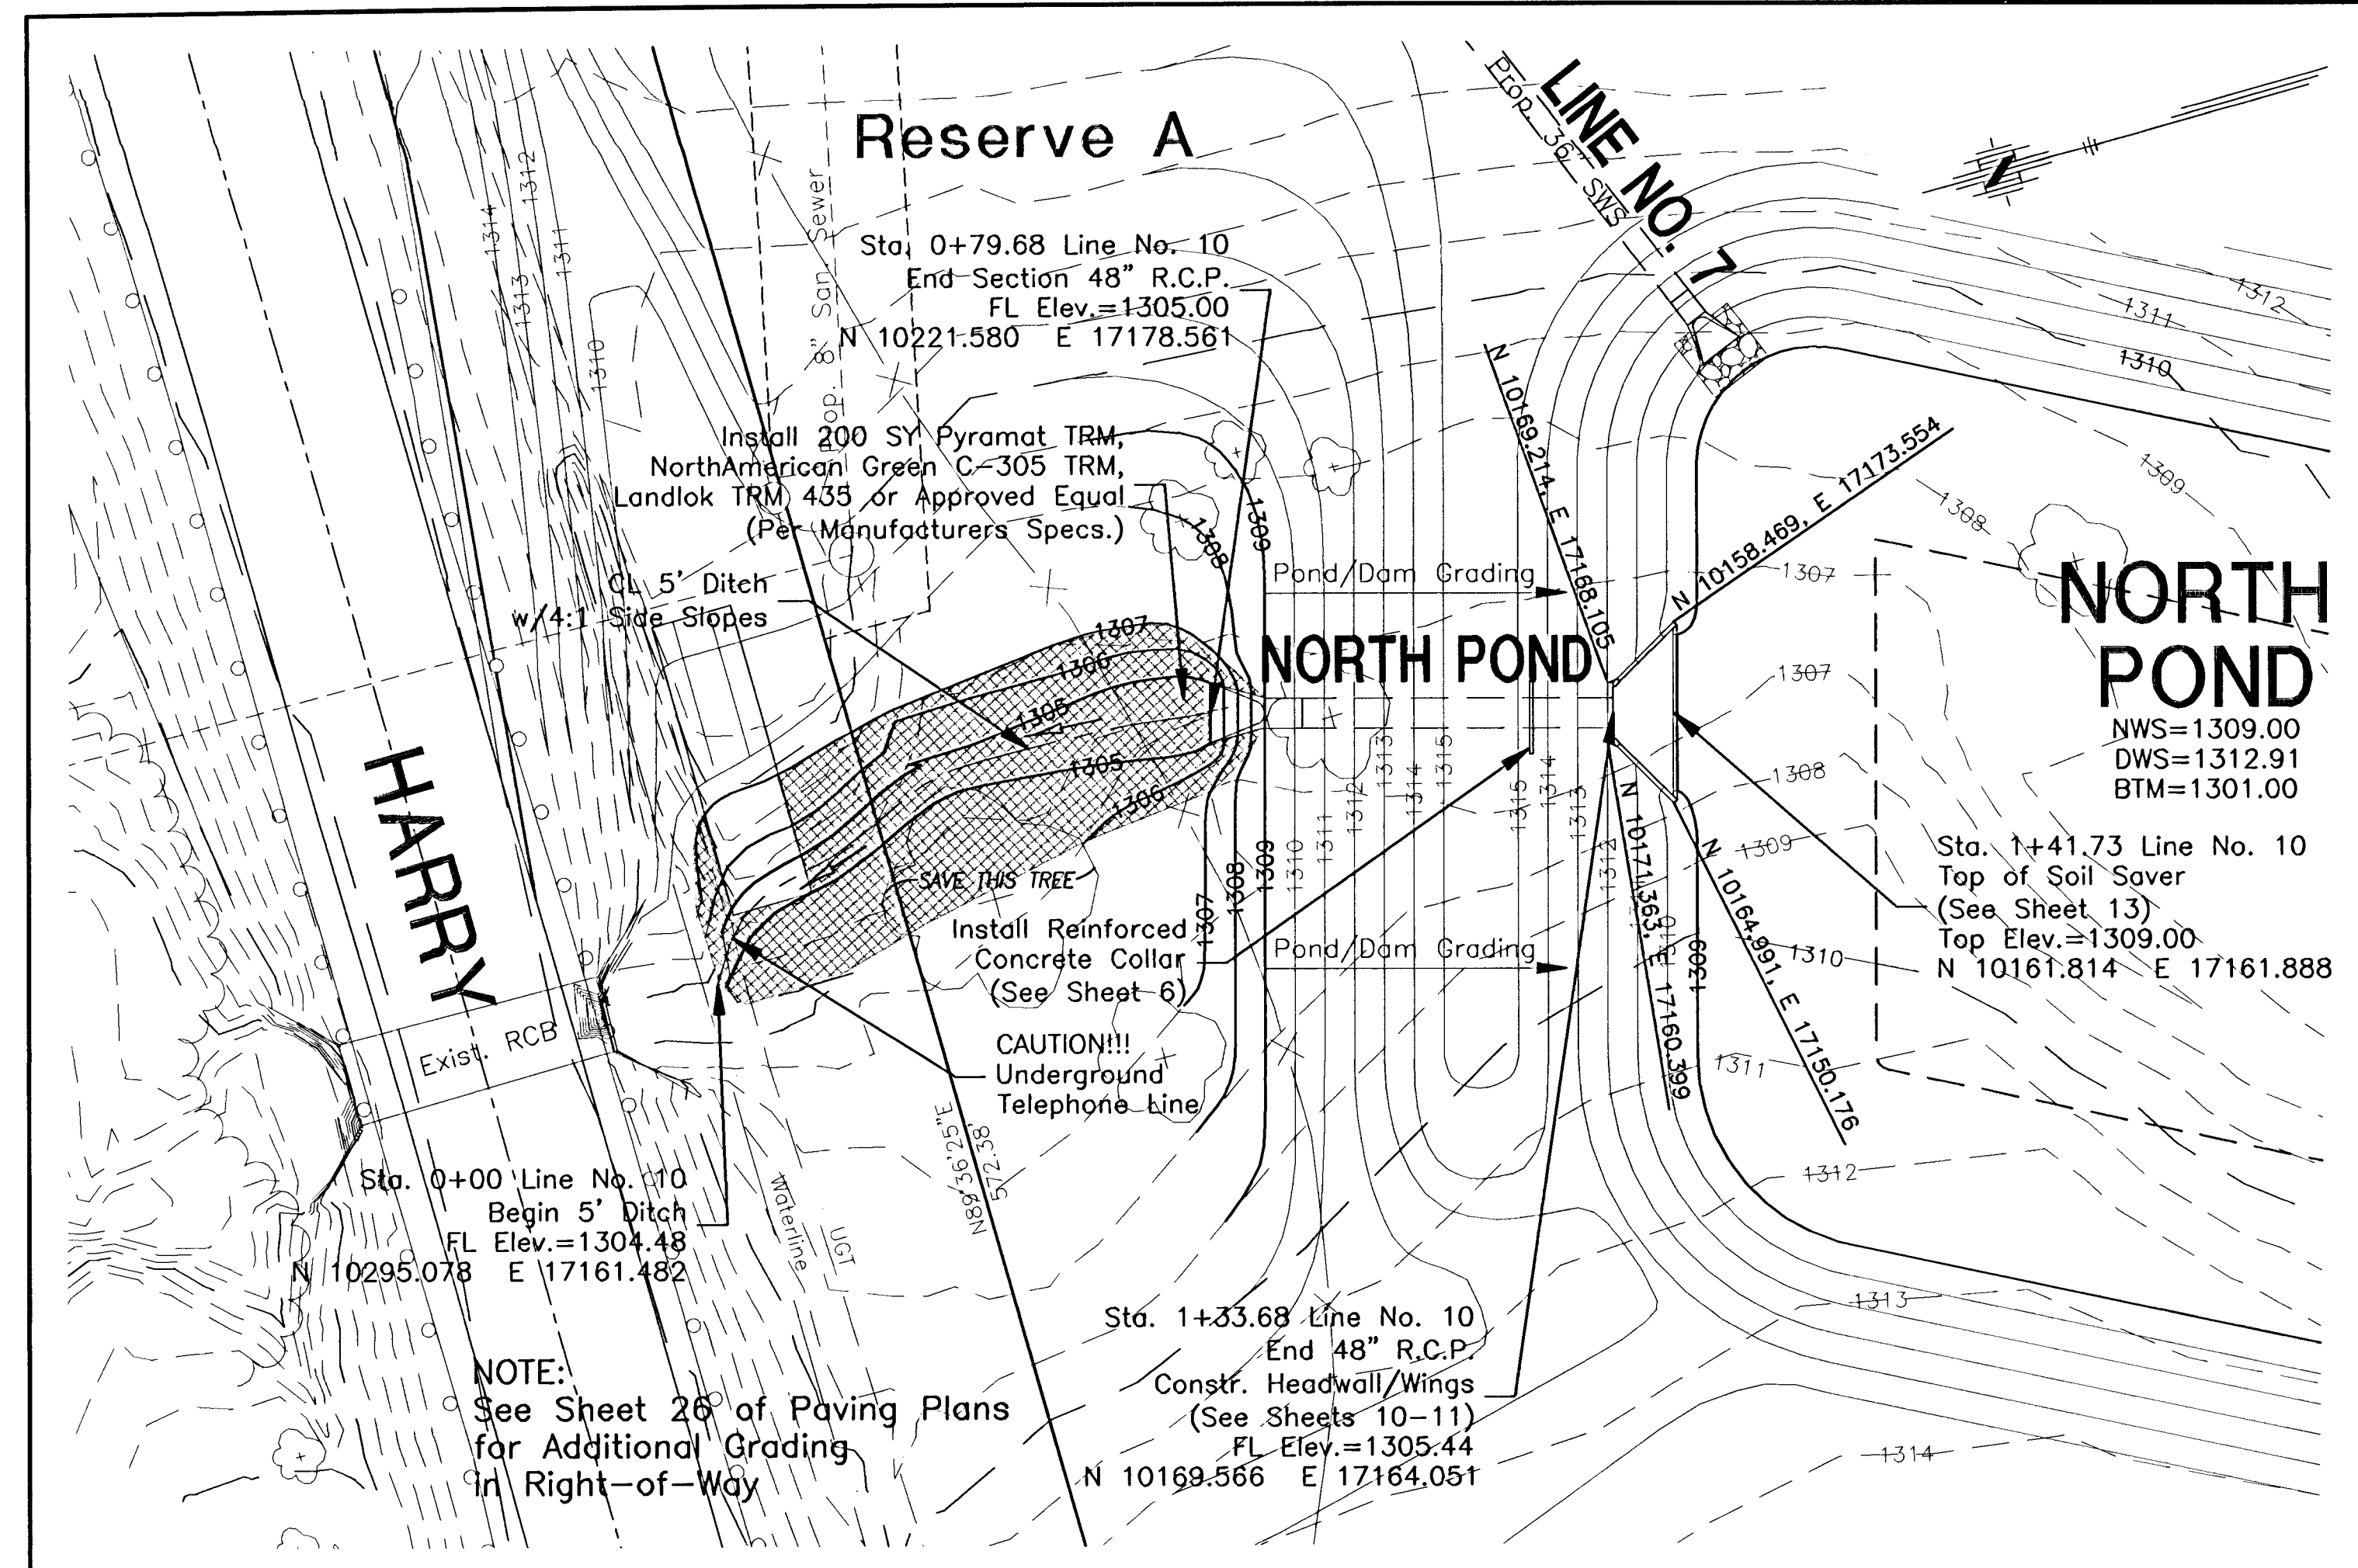

FINAL

POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E Central, Suite 200 ■ Wichita, KS 67209-0242
Phone 316.685-4114 ■ FAX 316.685-4444

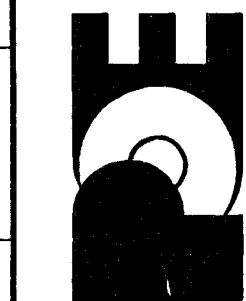



Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Poe Job No.: 1694A
Date: March 2002

Sheet
2 of 20

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
POND OUTLET STRUCTURES
CITY OF WICHITA, KANSAS
MICHAEL E. LINDEBAK, P.E. - CITY ENGINEER
C.O.W. Proj# 488-83320 O.C.A.# 75105






Revision	No.	Date	By	Approved
	1			

G:\APPS\DC\AP\656\BASE-PND.dwg WED Mar 25 10:45:39 2002 Bernard Kulja - POE & ASSOCIATES OF KANSAS INC.

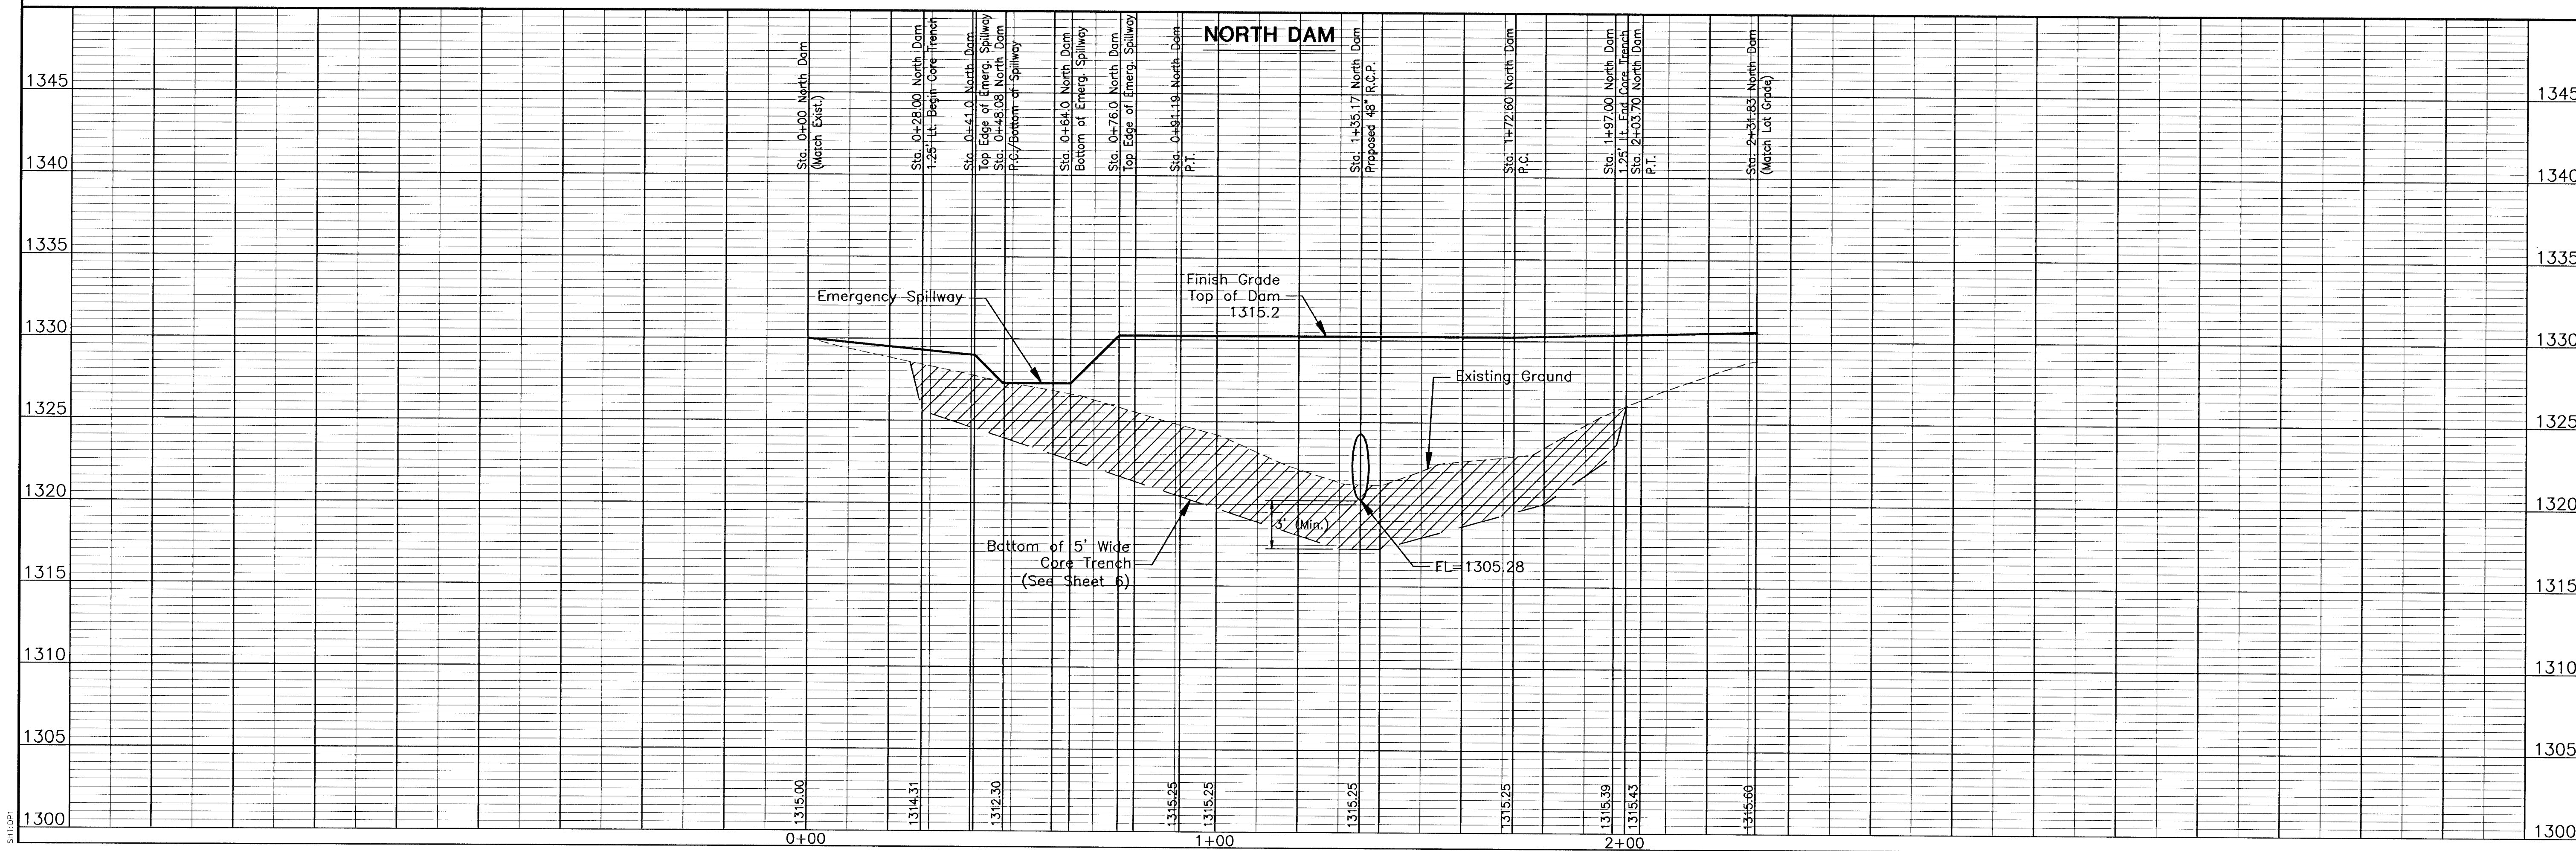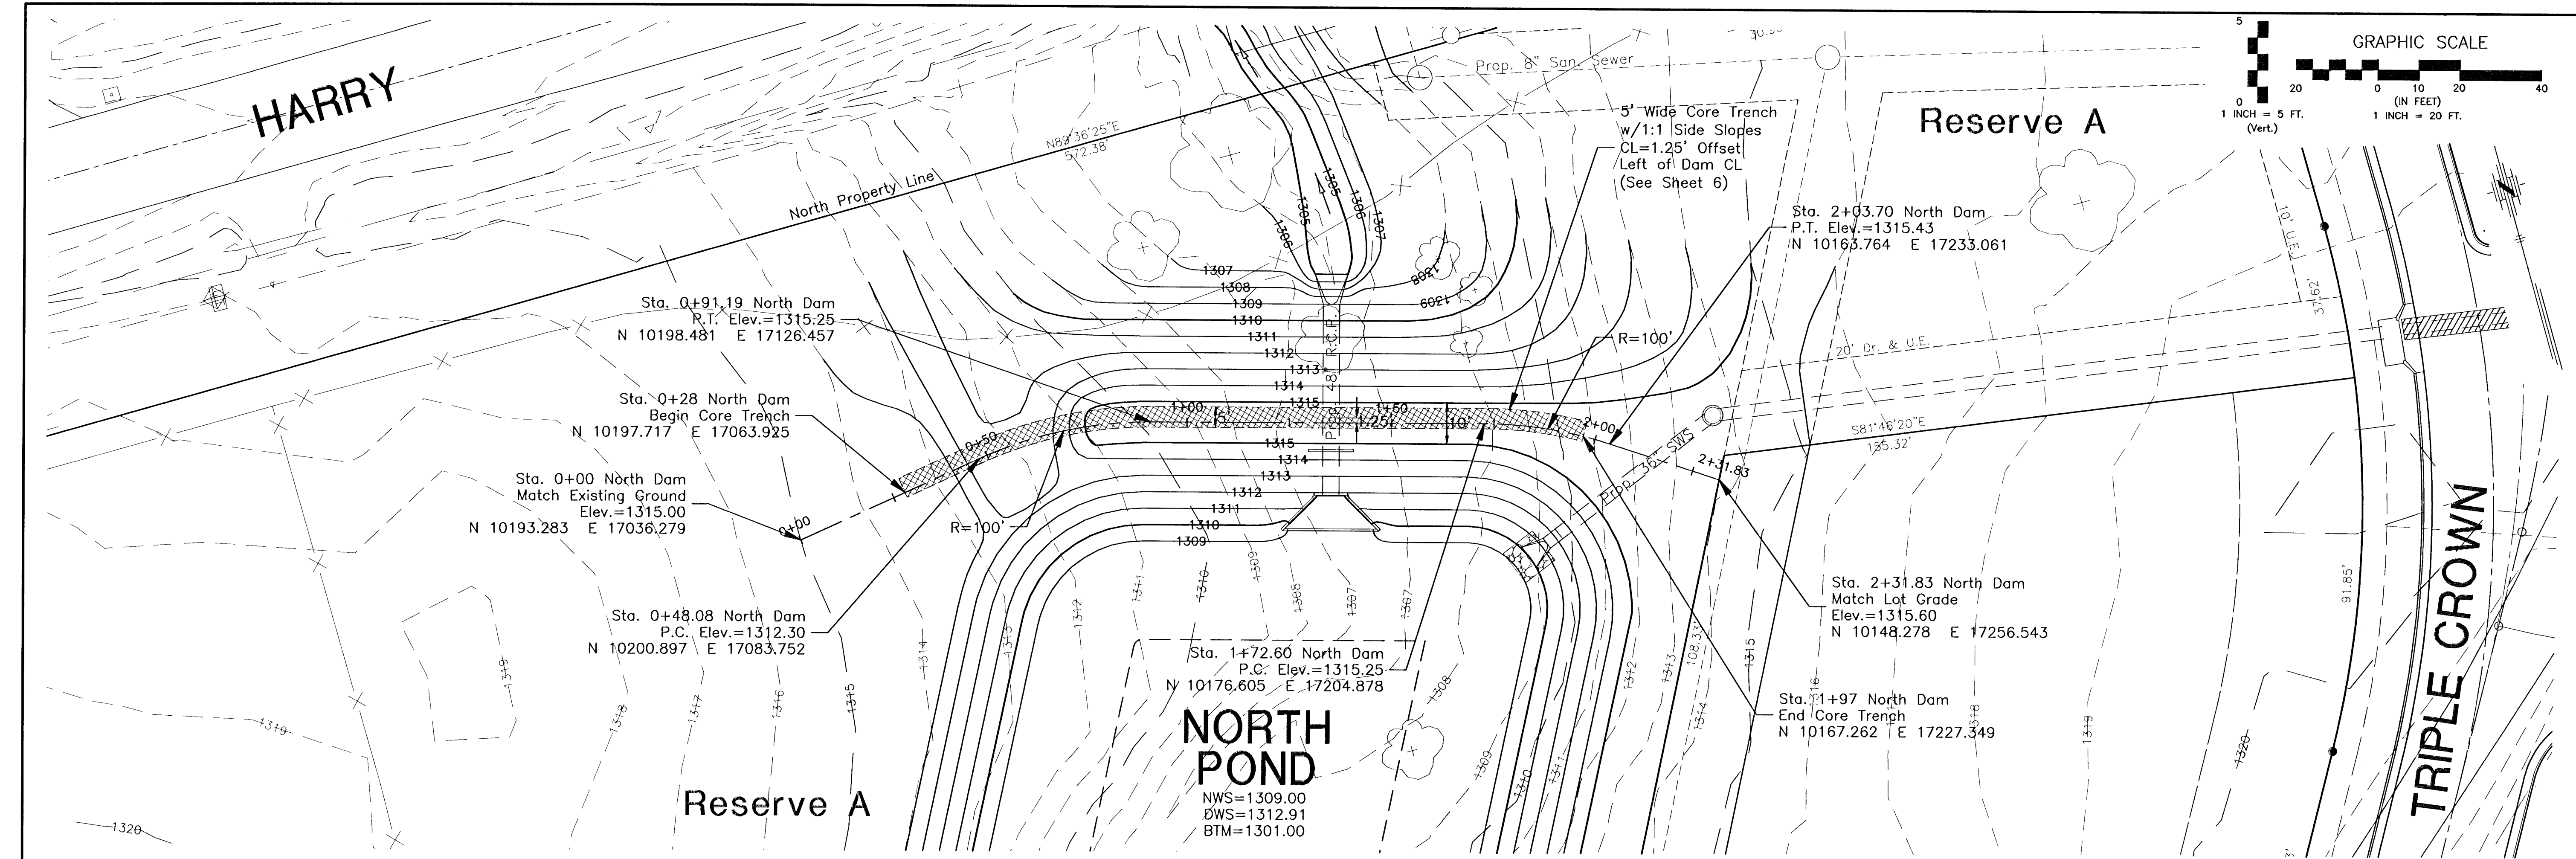

EQUESTRIAN ESTATES - PHASE 1 DRAINAGE IMPROVEMENTS NORTH DAM PROFILE				POE & ASSOCIATES OF KANSAS, INC. CONSULTING ENGINEERS 5940 E. Central Suite 200 • Wichita, KS 67208-4242 Phone 316/685-4114 • FAX 316/685-4444			
No.	Date	By	Approved	CITY OF WICHITA, KANSAS MICHAEL E. LINDBAK, P.E. - CITY ENGINEER C.O.W. Proj# 468-83320 O.C.A.# 75305			
1				FINAL			
2							
Designed By: J. Ubert / J. Dickman				Sheet			
Drawn By: J. Dickman				3 of 20			
Poe Job No.: 1594A							
Date: March 2002							

6: \\APPS\DC\A\1654\BASE-PNO.dwg Mon Mar 25 10:48:49 2002 Bernard Kulla - POE & ASSOCIATES OF KANSAS INC.

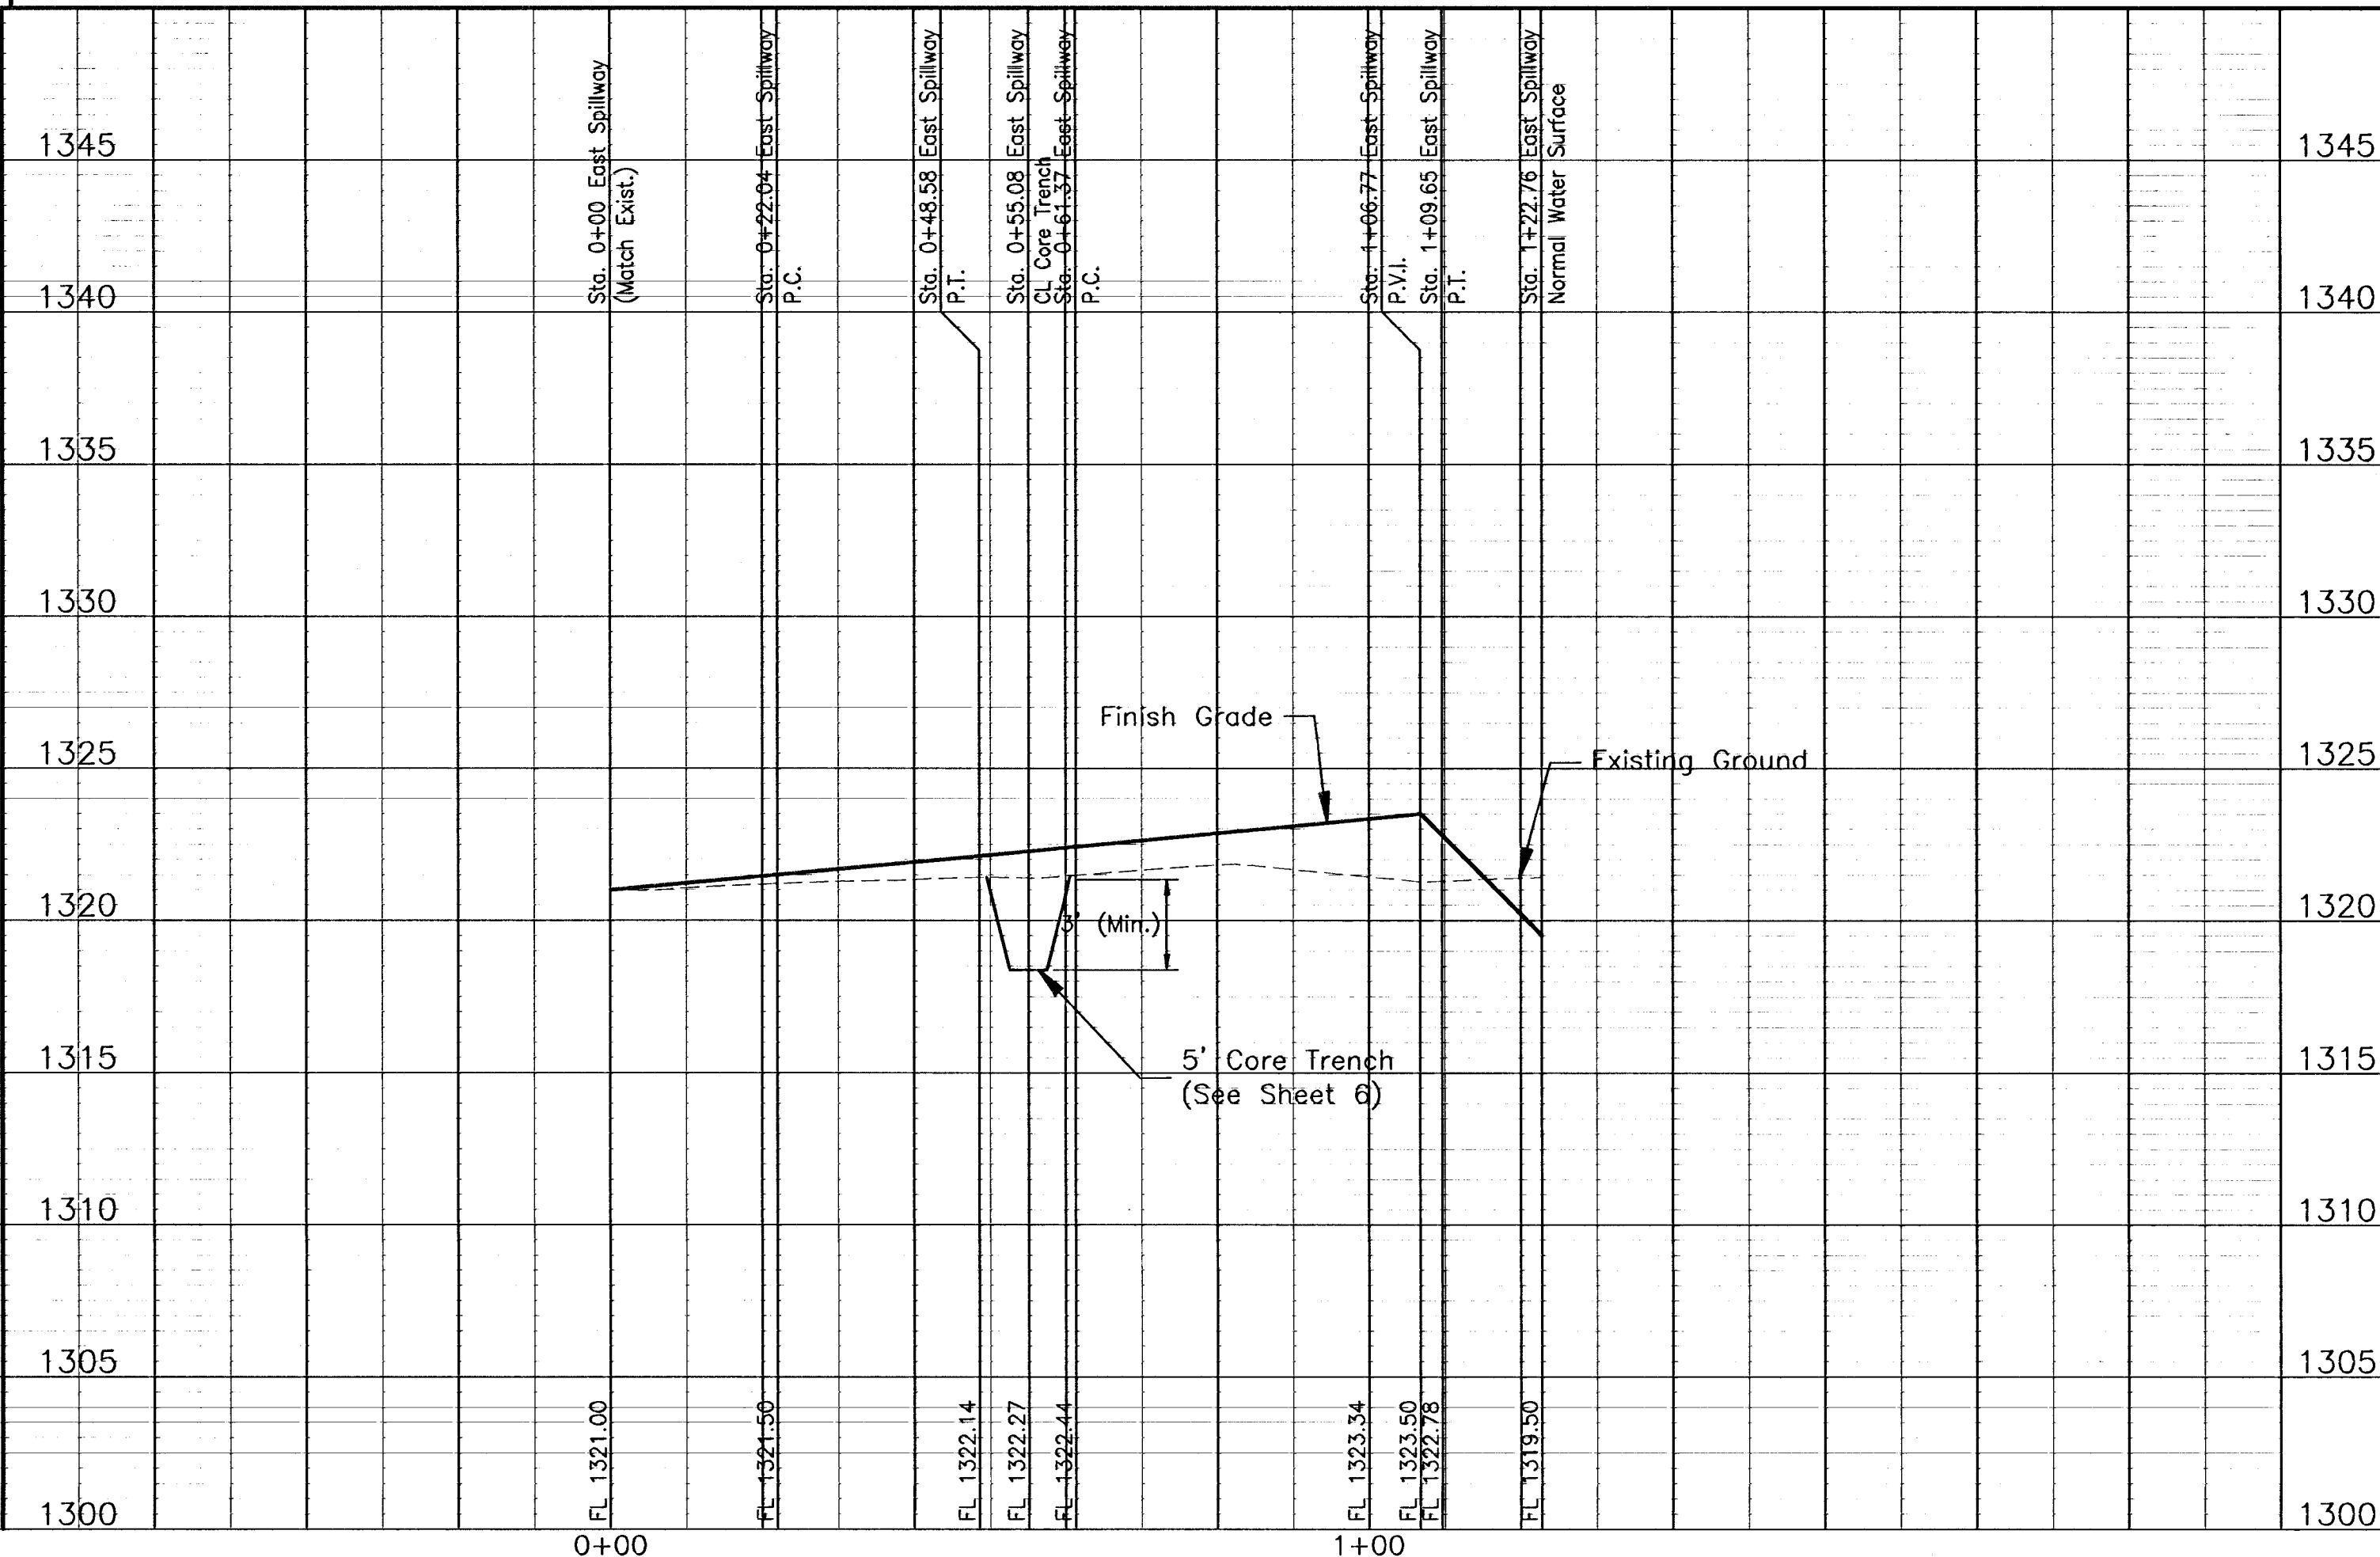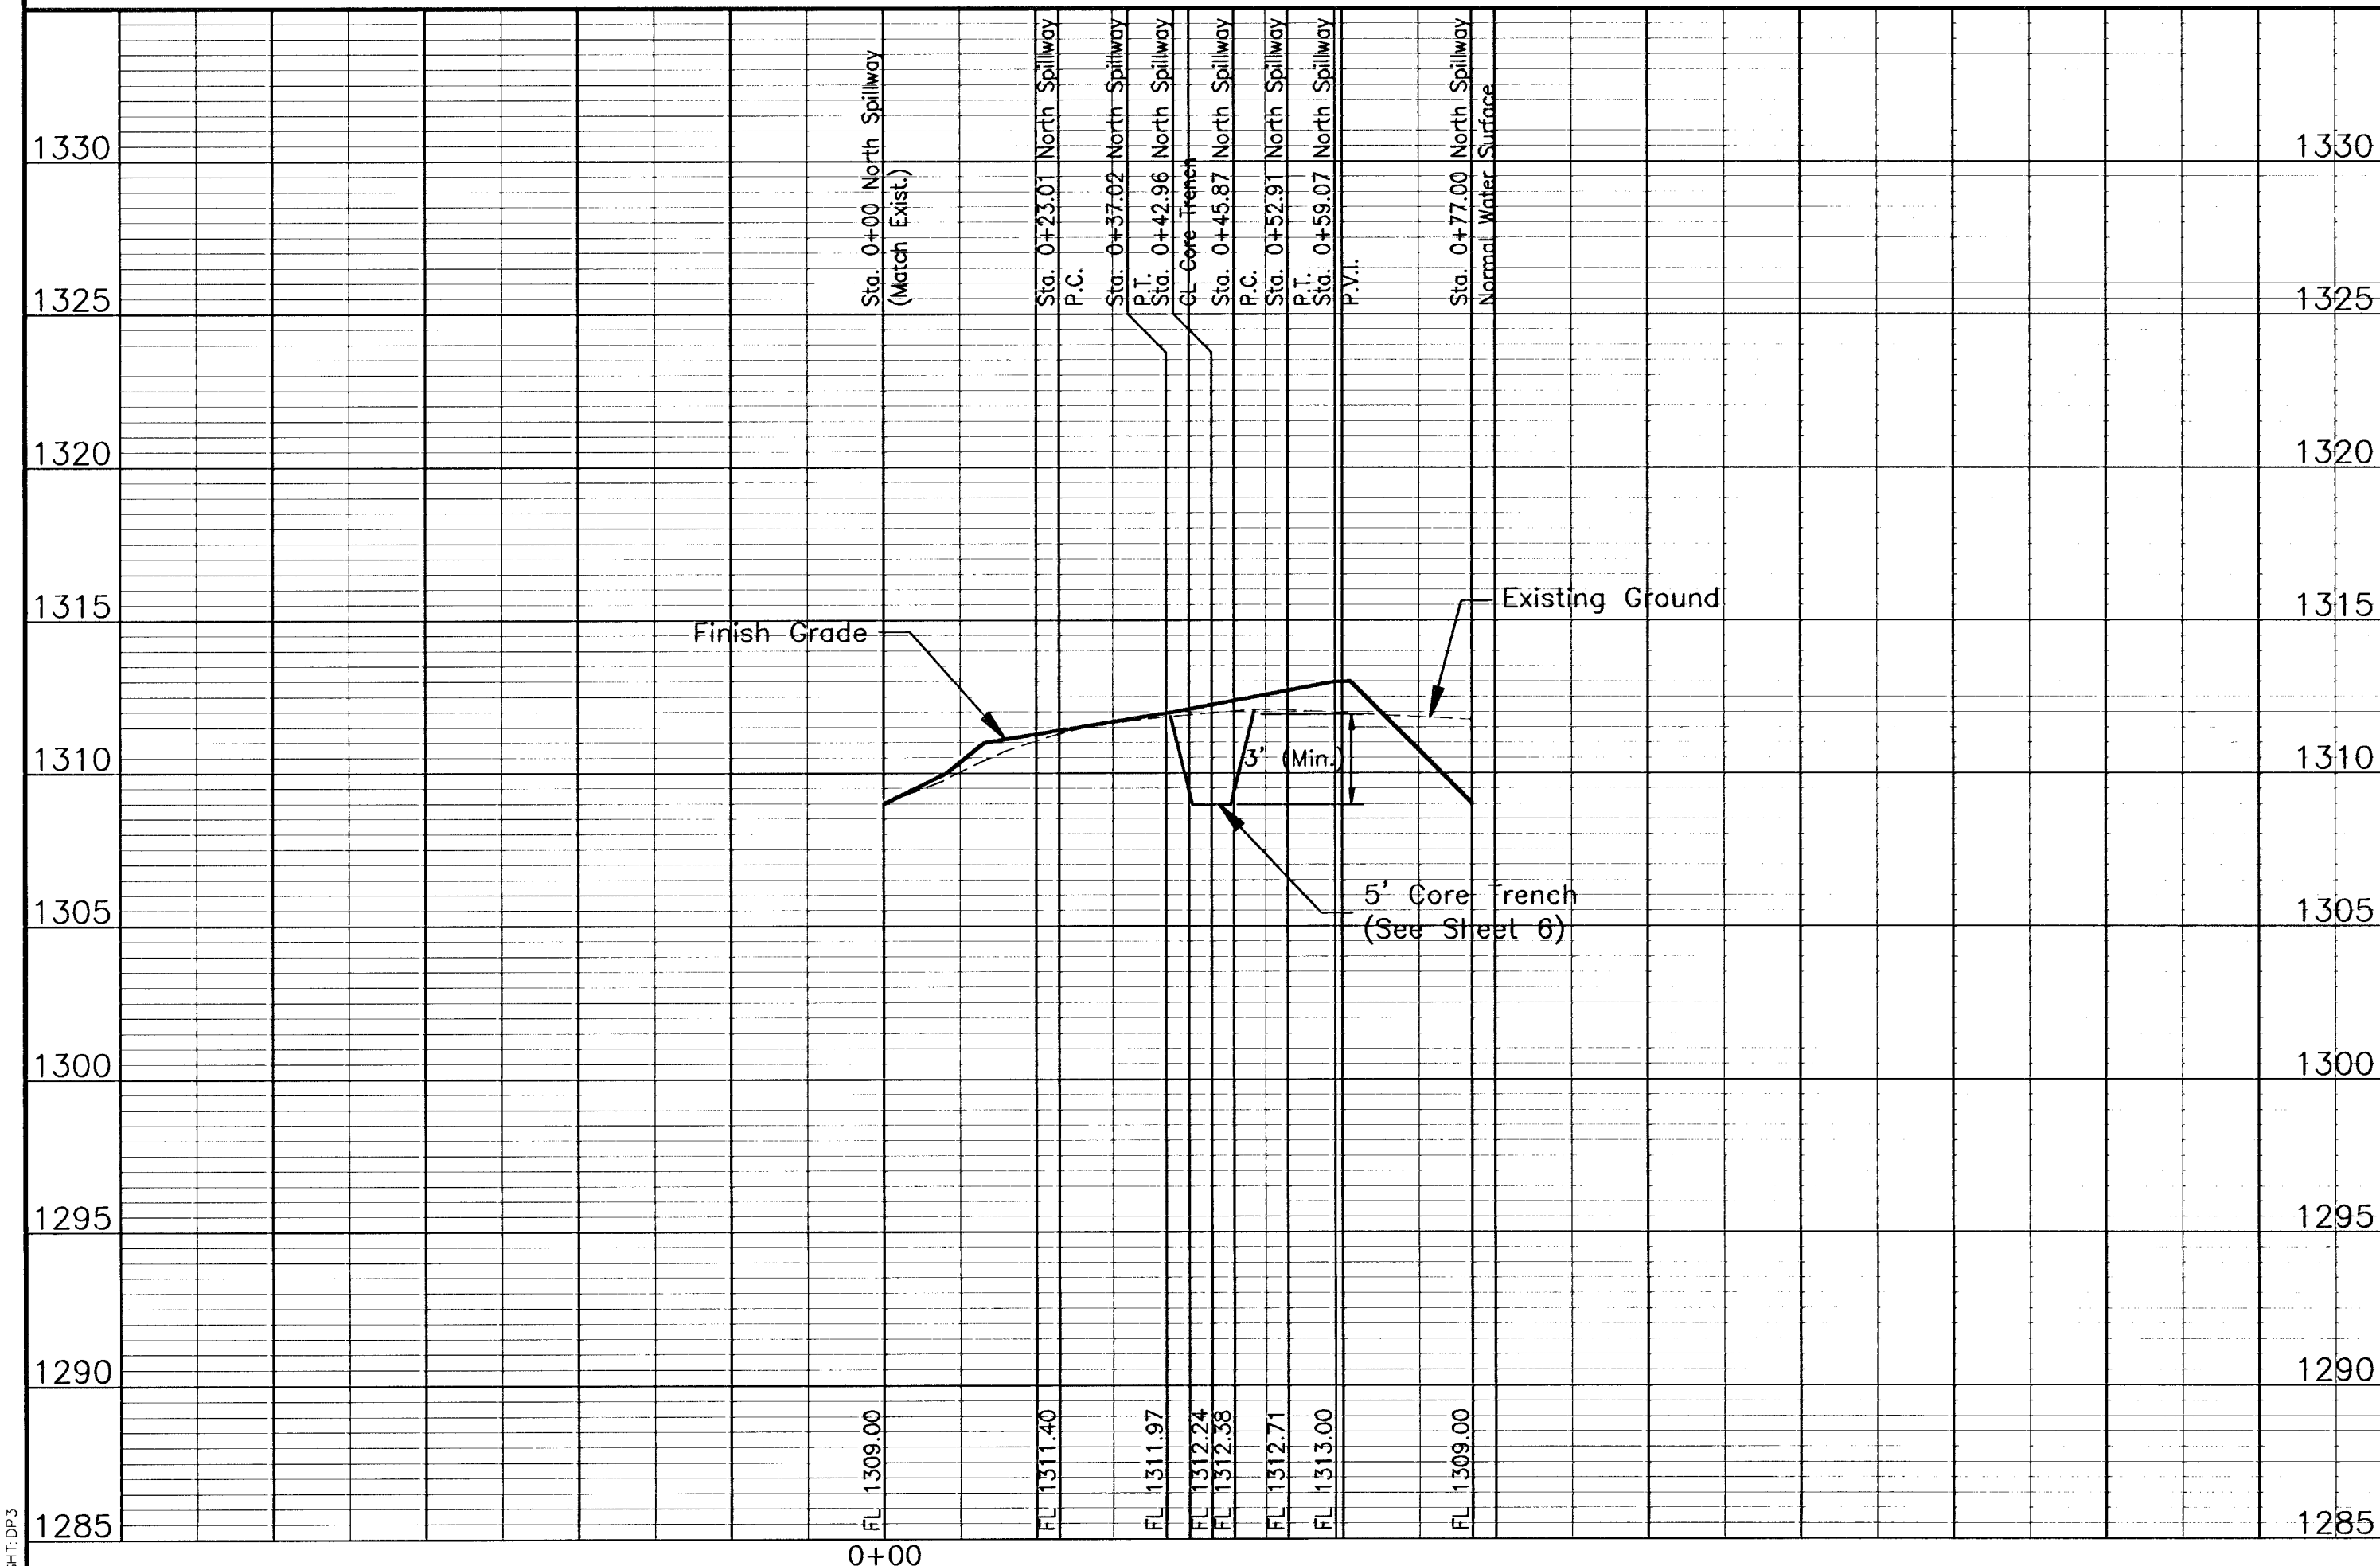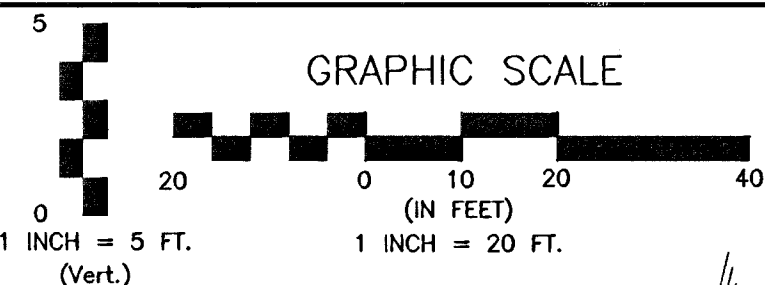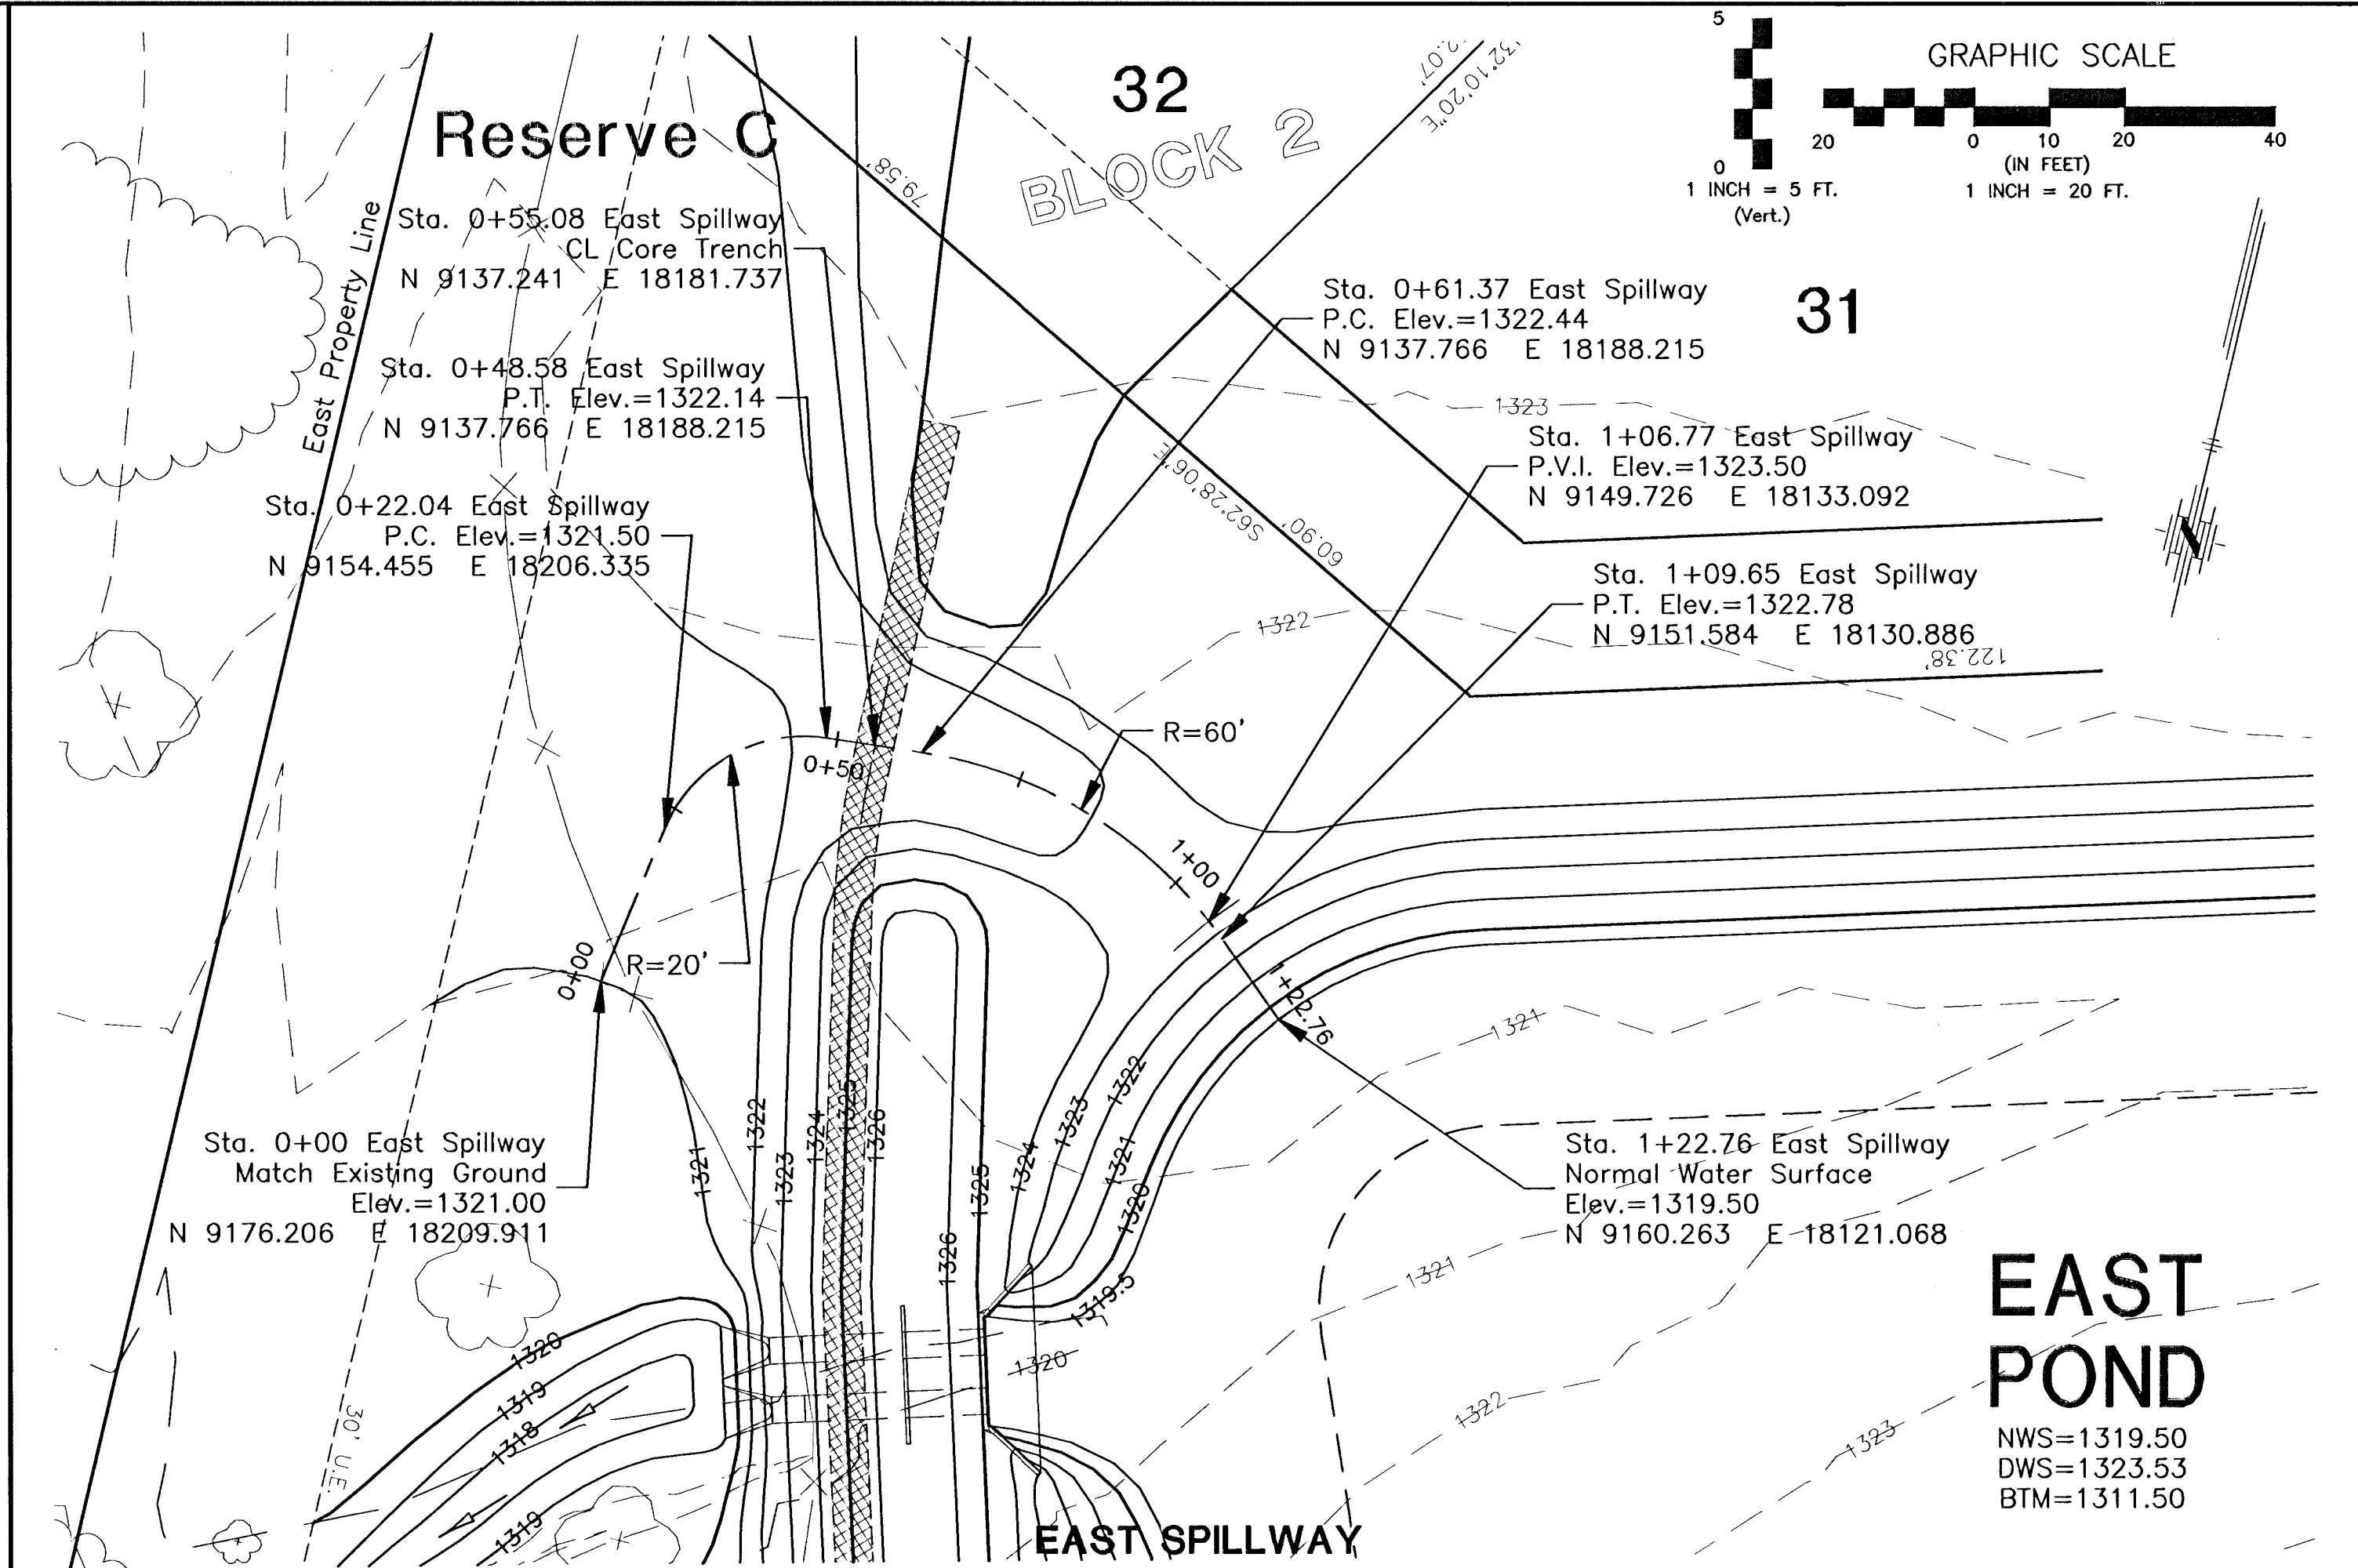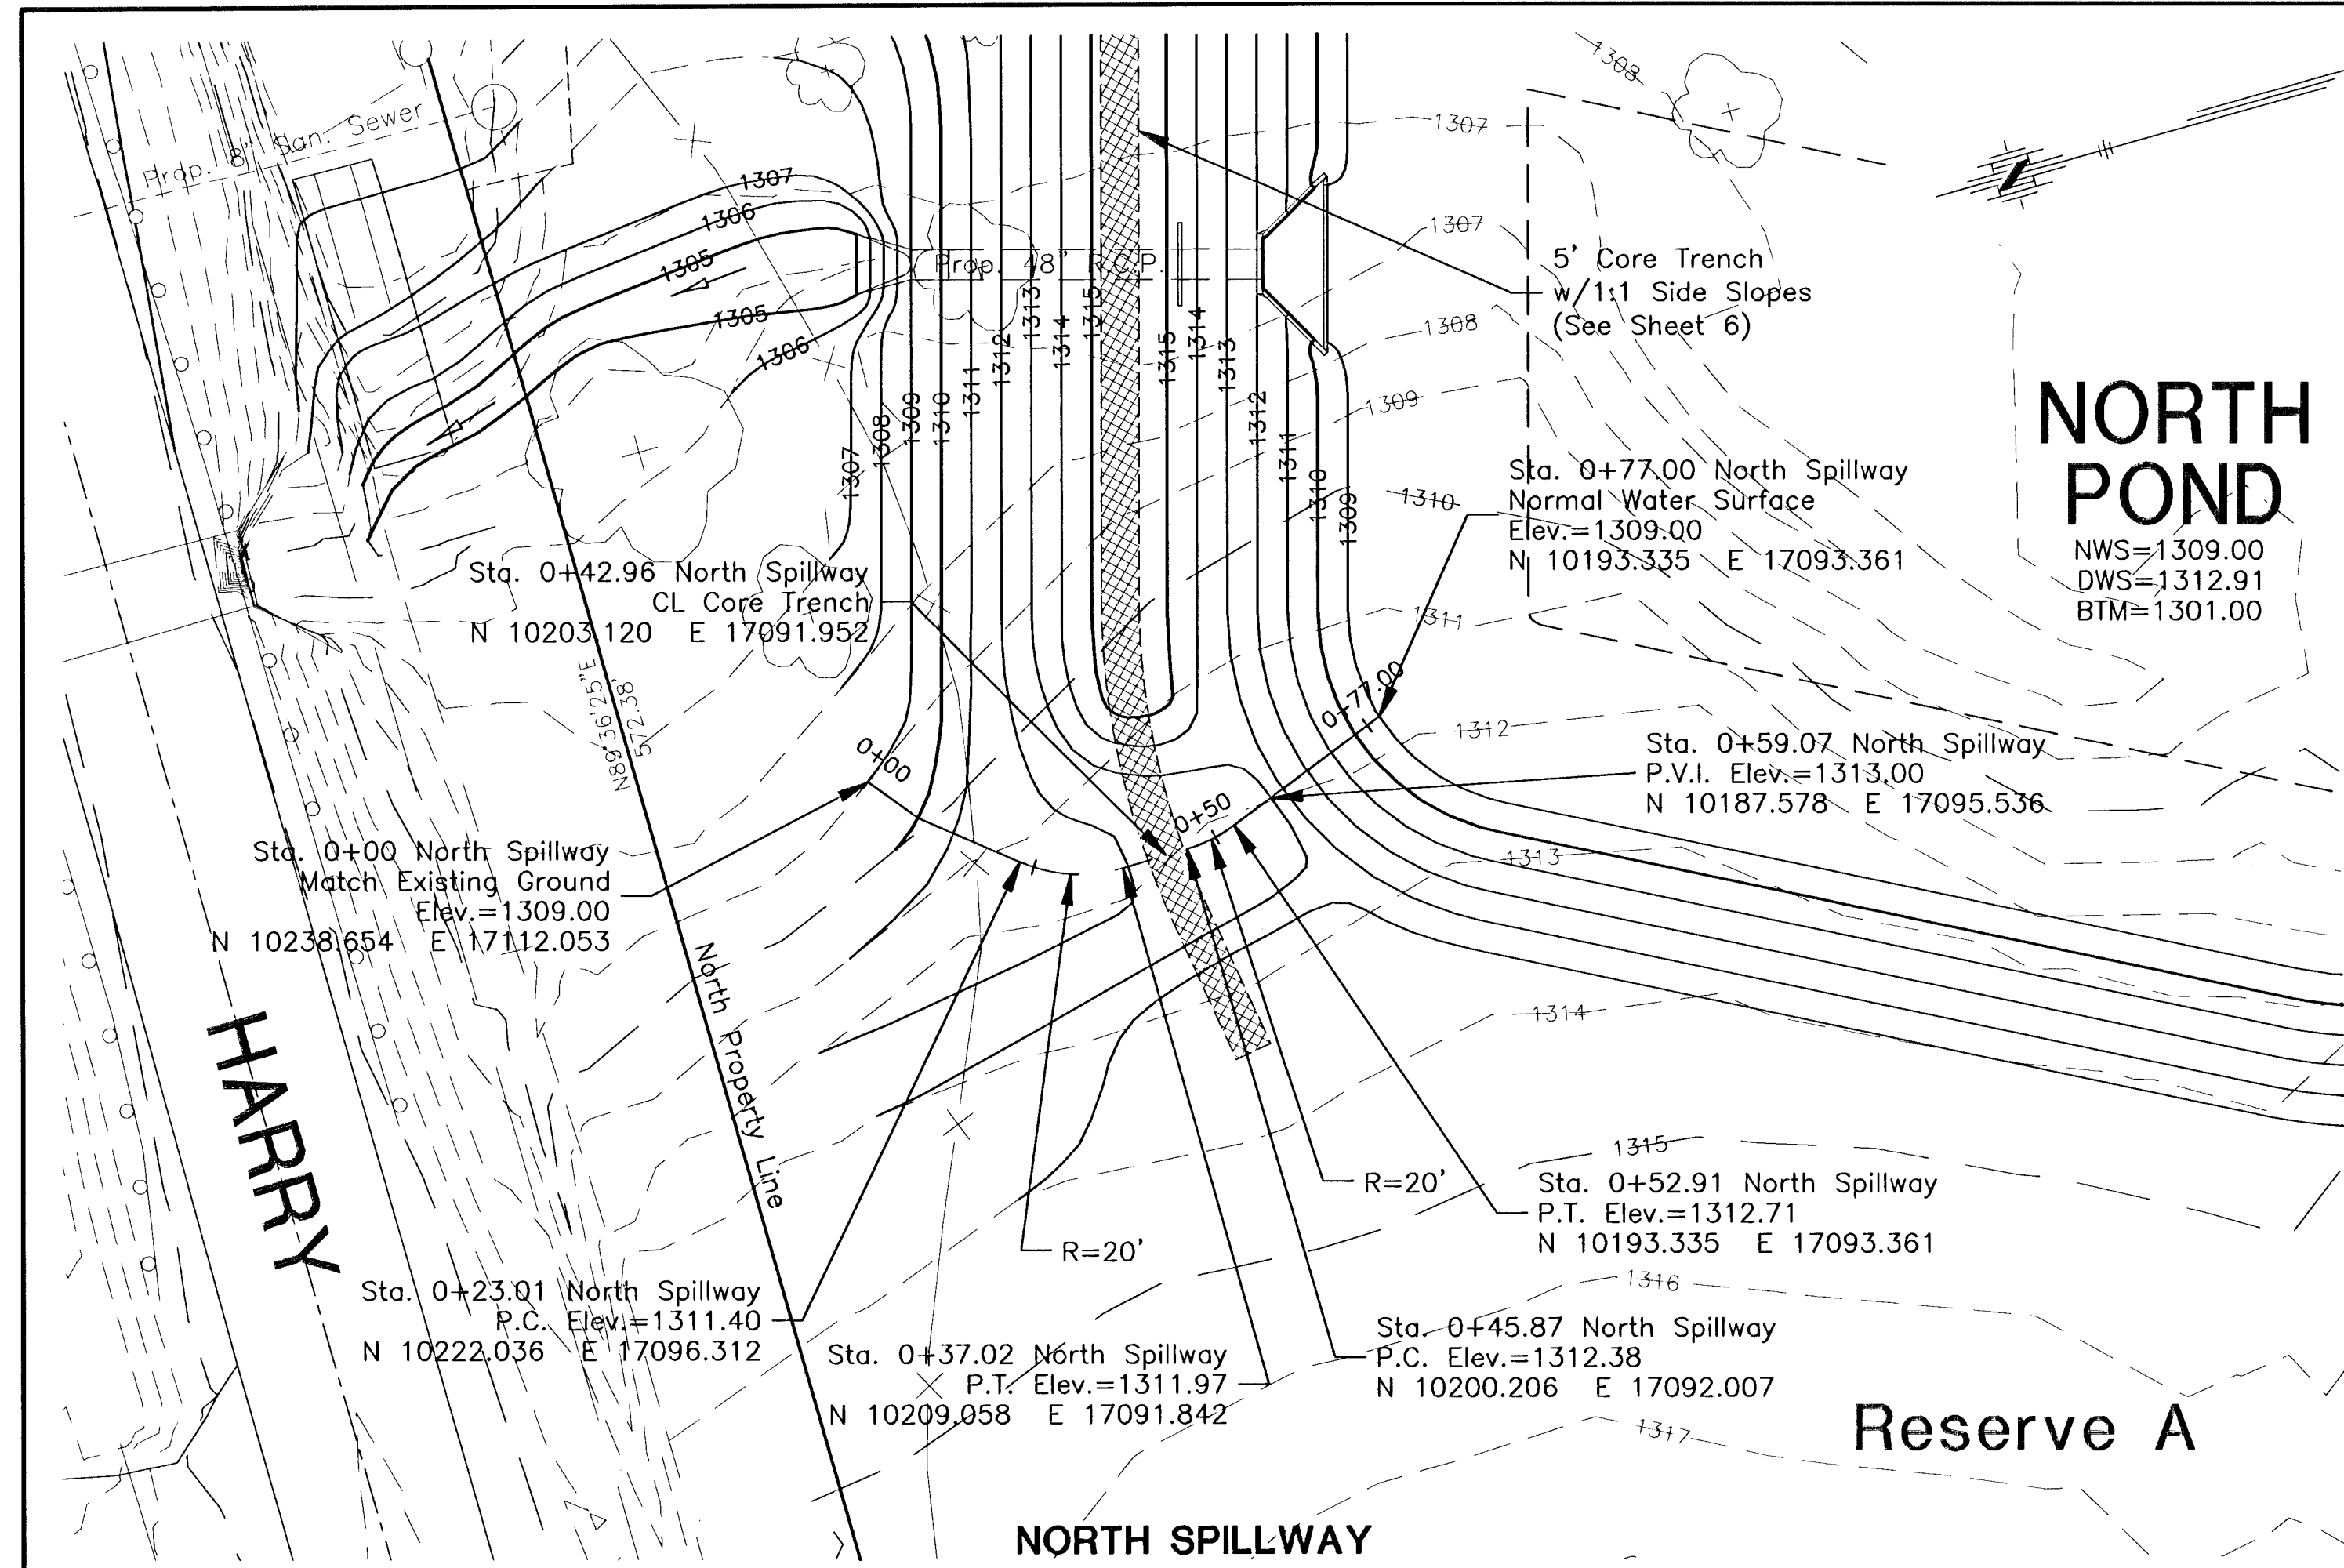

EQUSTRIAN ESTATES - PHASE 1 DRAINAGE IMPROVEMENTS EMERGENCY SPILLWAY PROFILES CITY OF WICHITA, KANSAS MICHAEL E. LINDBERGH, P.E. - CITY ENGINEER C.O.W. Proj# 468-83320 O.C.A.# 751305	
Revision	By
1	Approved
2	By
3	By
4	By
5	By
6	By
7	By
8	By
9	By
10	By
11	By
12	By
13	By
14	By
15	By
16	By
17	By
18	By
19	By
20	By
21	By
22	By
23	By
24	By
25	By
26	By
27	By
28	By
29	By
30	By
31	By
32	By
33	By
34	By
35	By
36	By
37	By
38	By
39	By
40	By
41	By
42	By
43	By
44	By
45	By
46	By
47	By
48	By
49	By
50	By
51	By
52	By
53	By
54	By
55	By
56	By
57	By
58	By
59	By
60	By
61	By
62	By
63	By
64	By
65	By
66	By
67	By
68	By
69	By
70	By
71	By
72	By
73	By
74	By
75	By
76	By
77	By
78	By
79	By
80	By
81	By
82	By
83	By
84	By
85	By
86	By
87	By
88	By
89	By
90	By
91	By
92	By
93	By
94	By
95	By
96	By
97	By
98	By
99	By
100	By

POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 • Wichita, KS 67208-4242
Phone 316/665-4114 • FAX 316/665-4444

FINAL

Designed By: J. J. Dickman
Drawn By: J. J. Dickman
Poe Job No.: 1694A
Date: March 2002

Sheet
5 of 20

GENERAL NOTES

CORE TRENCH

The core trench shall be constructed along the proposed dam centerline over the entire length of the dam. The core trench shall be excavated to a depth of at least 3 feet below the bottom of the concrete box and the natural grade along the dam alignment. The core trench should have a width of about 5 feet.

The core trench shall be backfilled with cohesive soils having a plasticity index greater than 25 (such as the on-site fat clays in the reservoir area) and placed and compacted as recommended below. Granular soils and low plasticity clays are not considered suitable for the core trench.

SITE PREPARATION

The contractor shall strip the organic topsoil in the dam embankment area. After performing all cuts and excavations required, the exposed subgrade soils in the proposed dam and core trench areas should be proofrolled to locate zones that are soft or unstable. Proofrolling should be conducted with a loaded, tandem-axle dump truck, scraper, or other heavy, rubber-tired, construction vehicle weighing at least 25 tons. The proofrolling should consist of several overlapping passes over an area in mutually perpendicular directions. The subgrade in areas where excessive rutting or pumping occurs during proofrolling should be removed and replaced with suitable fill, as described below, if it cannot be satisfactorily densified in place.

After proofrolling the subgrade and prior to placing new fill, we recommend the exposed soils be scarified to a depth of about 9 inches. The subgrade moisture should be adjusted to meet the recommendations presented in the "Engineered Fill" section of this report and the subgrade compacted to at least 95% of their maximum dry density (by ASTM D-698). Fill materials could then be constructed on the compacted subgrade.

ENGINEERED FILL


All new fill should consist of approved, on-site or off-site soils that are free of organics and deleterious materials. The soils should be constructed in maximum lifts not exceeding 9 inches in loose thickness and compacted to at least 95%, of their maximum dry density as determined by the standard Proctor procedure, ASTM D-698.

The moisture content at which the soils should be compacted is given as follows:


- Cohesive soils with a plasticity index (PI) greater than or equal to 30 (typical of the on-site soils) should be placed at a moisture content of at least 2% above their optimum moisture content (ASTM D-698).
- Cohesive soils with a PI less than 30 should be placed at a moisture content above their optimum moisture content.
- Granular soils should be placed at workable moisture content.

2-42" COLLAR RE-BAR SCHEDULE				
Mark	Shape	No.	Length	Weight
E		1	37'-0"	25.46
F		12	7'-9"	63.98
G		4	21'-6"	59.17
H1		14	3'-8"	35.32
H2		6	2'-4"	9.63
I		12	1'-10"	15.14
Total Rebar		209		Lbs.
Concrete		2.91		C.Y.


All Concrete Reinforcement to be #4 bars.

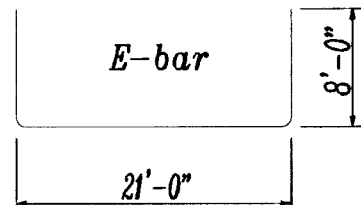


BENDING DIAGRAM

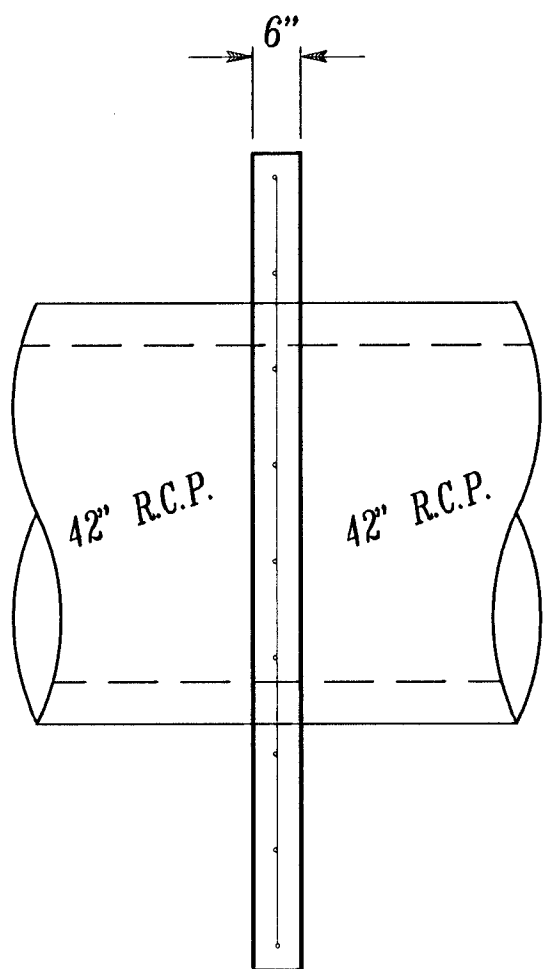

SECTION

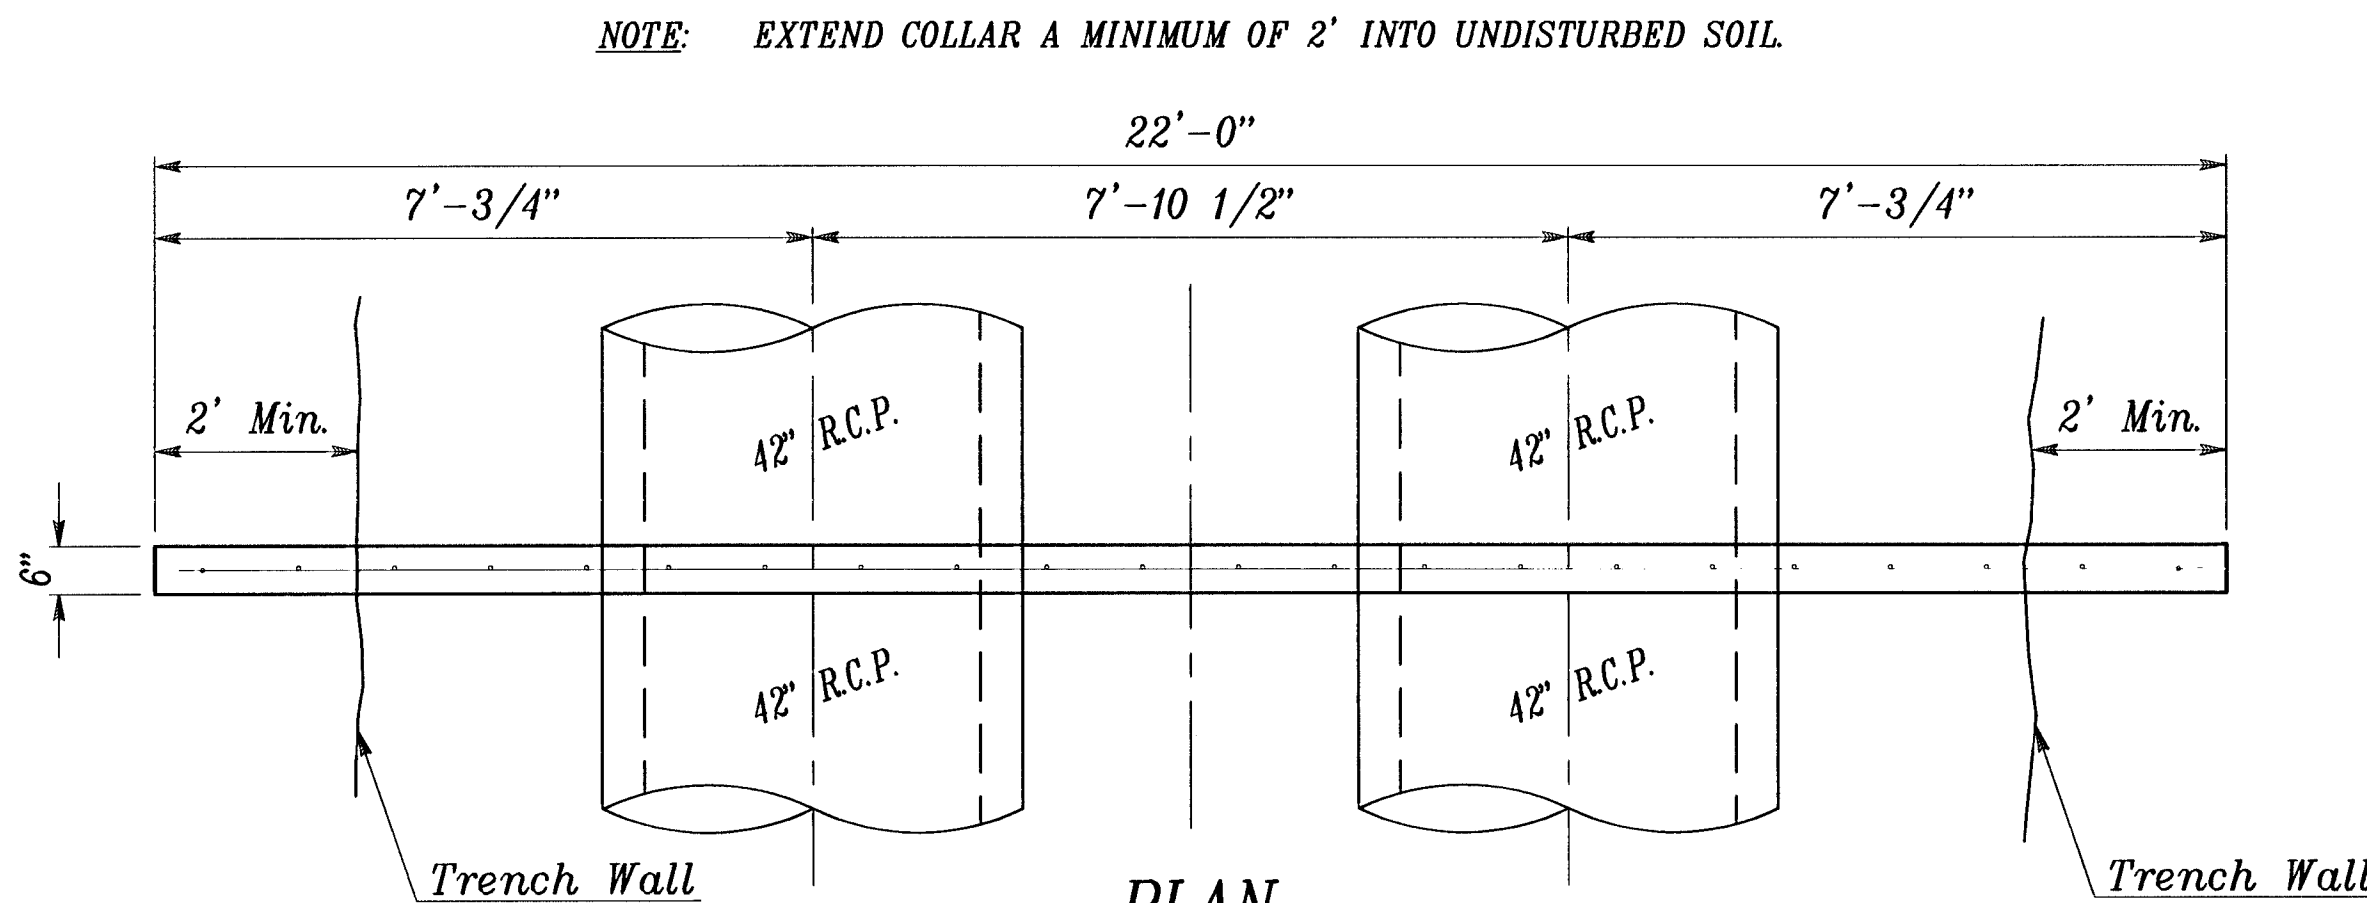

PLAN

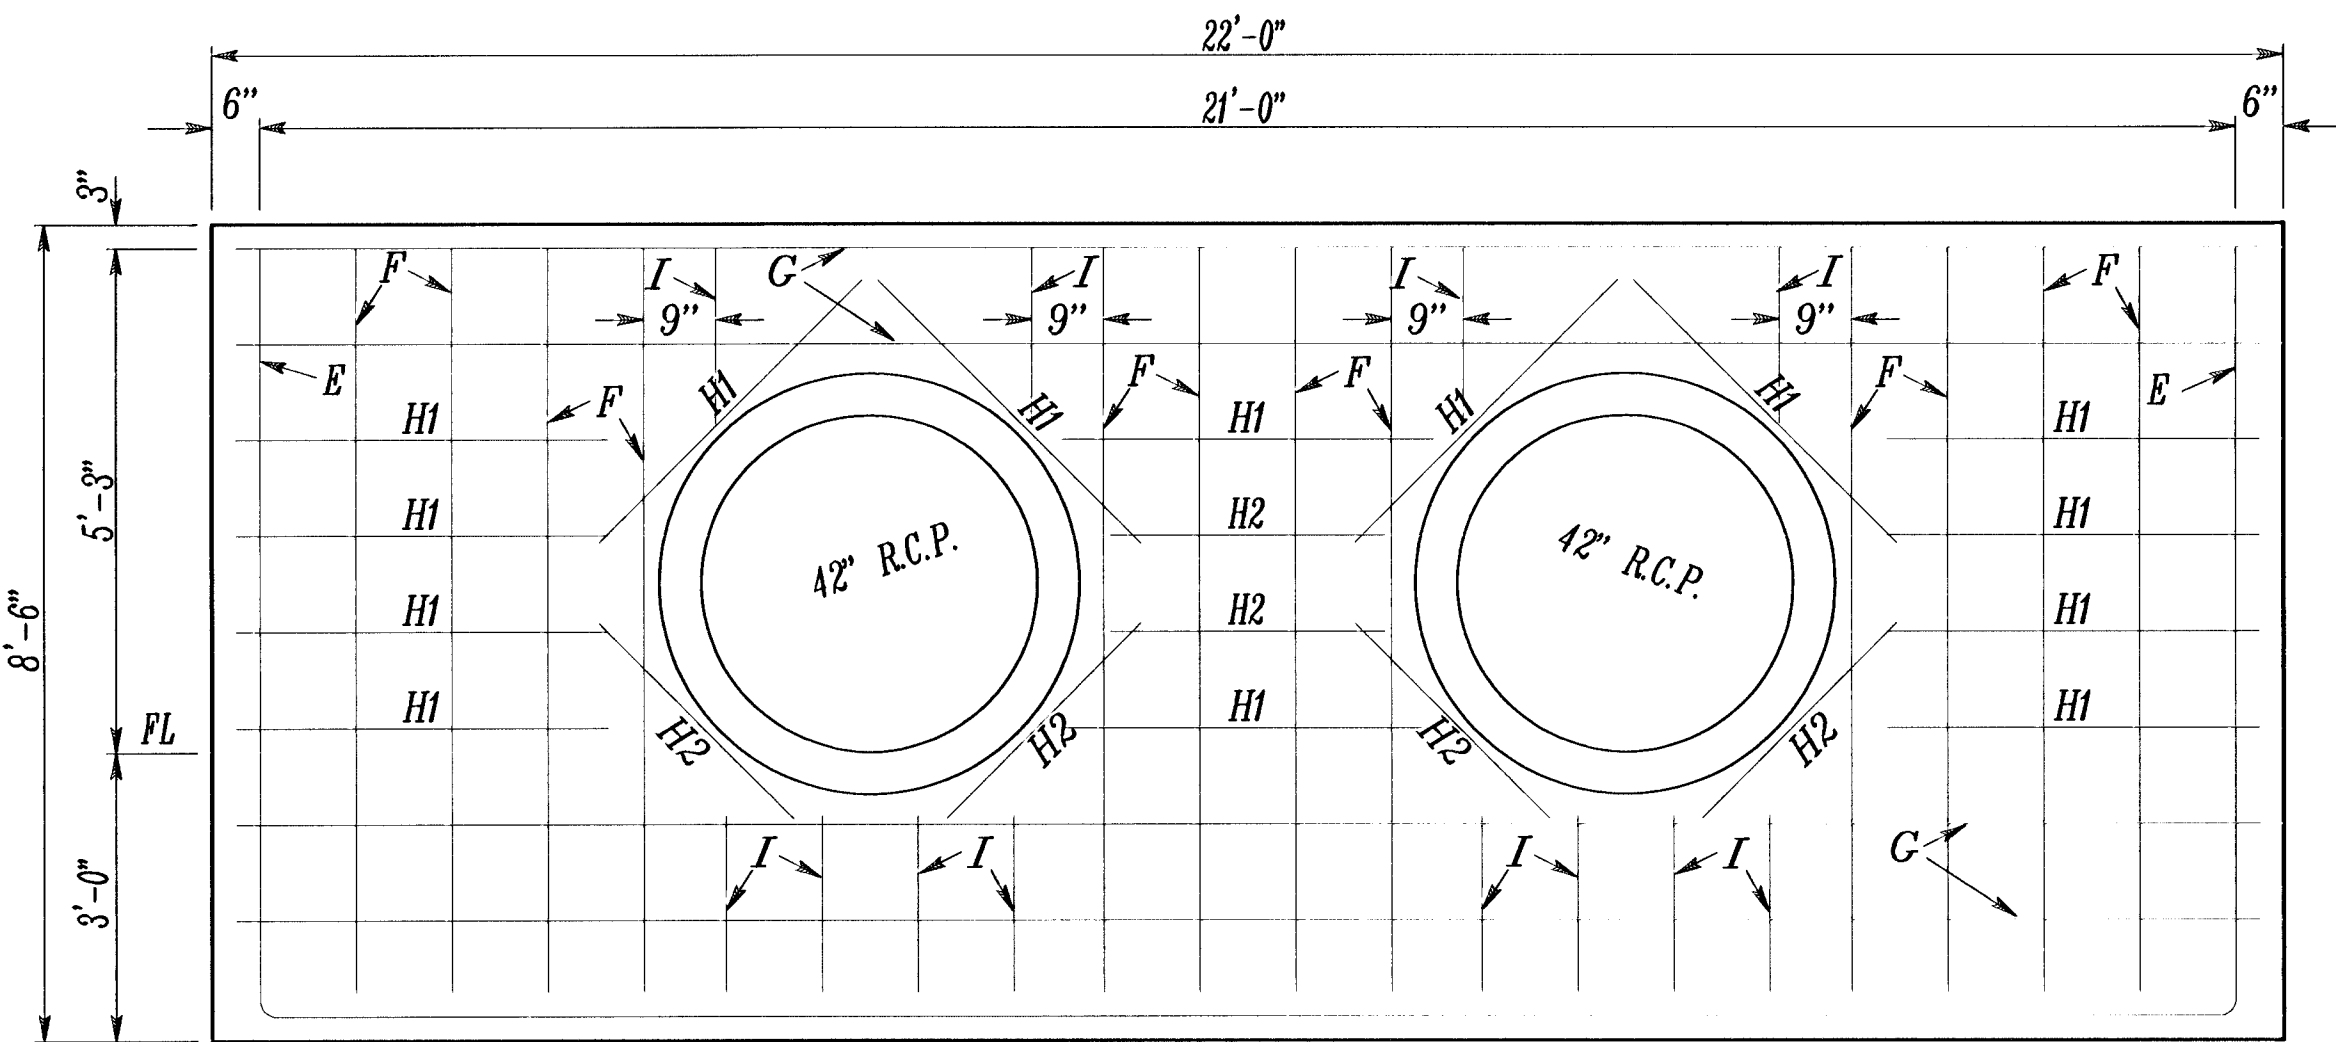


FRONT


NOTE: ALL REINFORCING STEEL SHALL BE SPACED 12" UNLESS OTHERWISE NOTED

48" COLLAR RE-BAR SCHEDULE				
Mark	Shape	No.	Length	Weight
O		1	31'-0"	21.33
P		10	8'-9"	60.20
Q		5	13'-6"	46.44
R1		10	4'-1"	20.09
R2		6	2'-8"	11.01
S		6	1'-10"	7.57
T		4	4'-10"	13.30
Total Rebar		180		Lbs.
Concrete		2.11		C.Y.


All Concrete Reinforcement to be #4 bars.

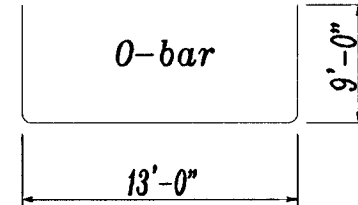


BENDING DIAGRAM

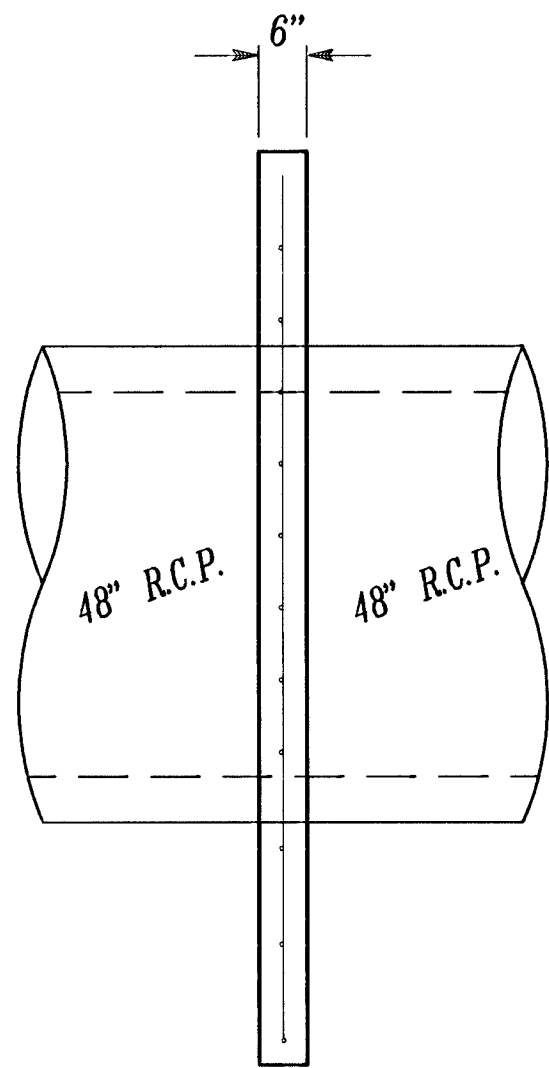

SECTION

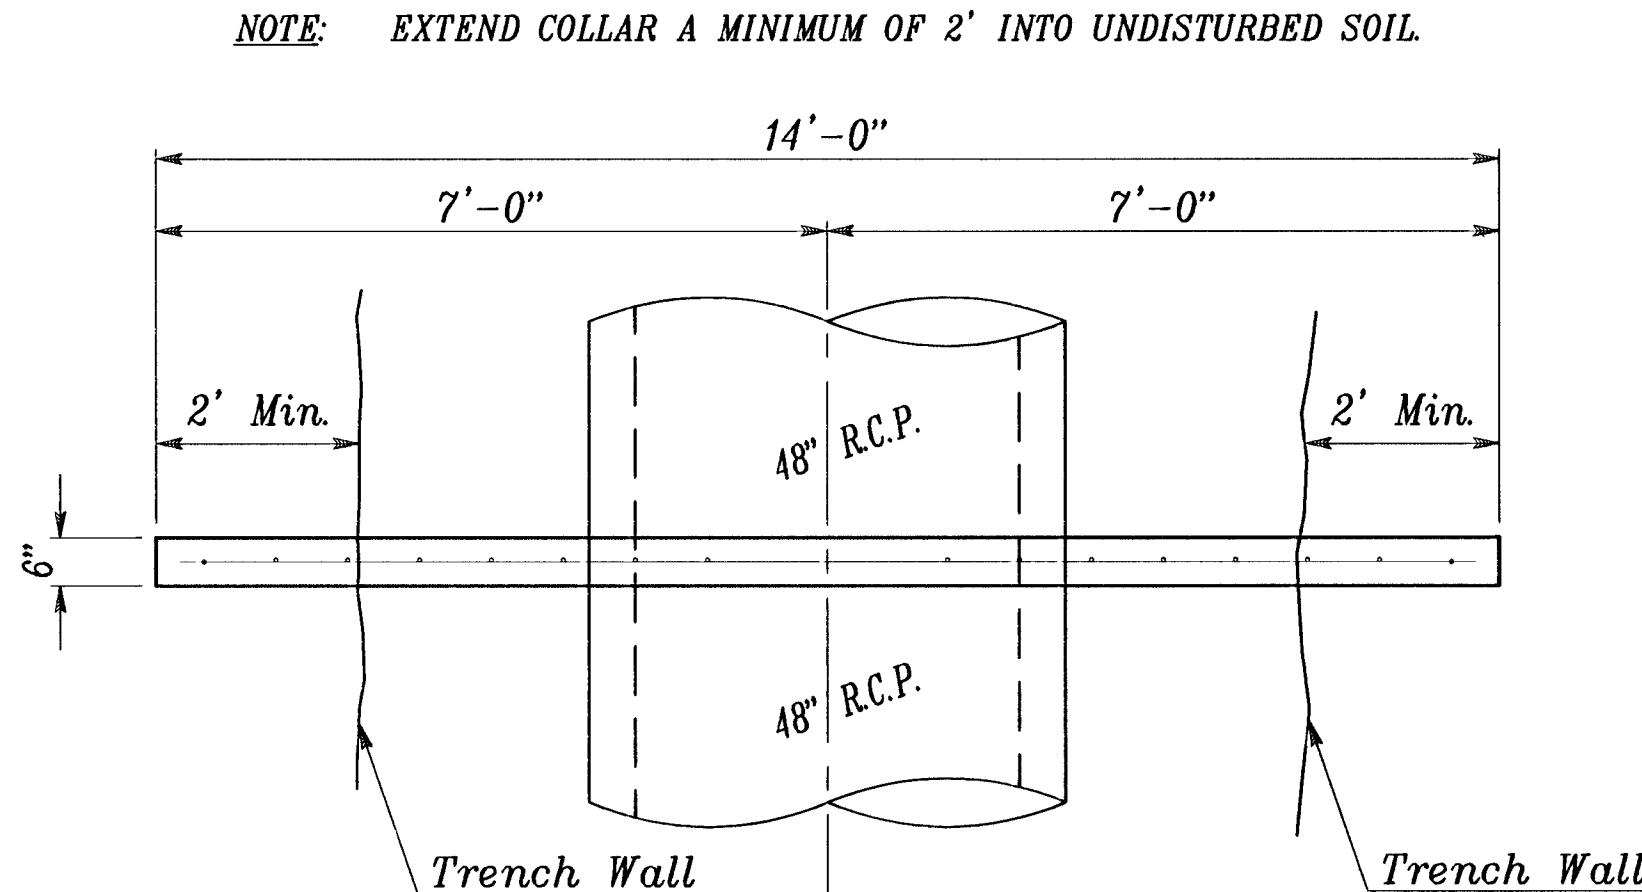

PLAN

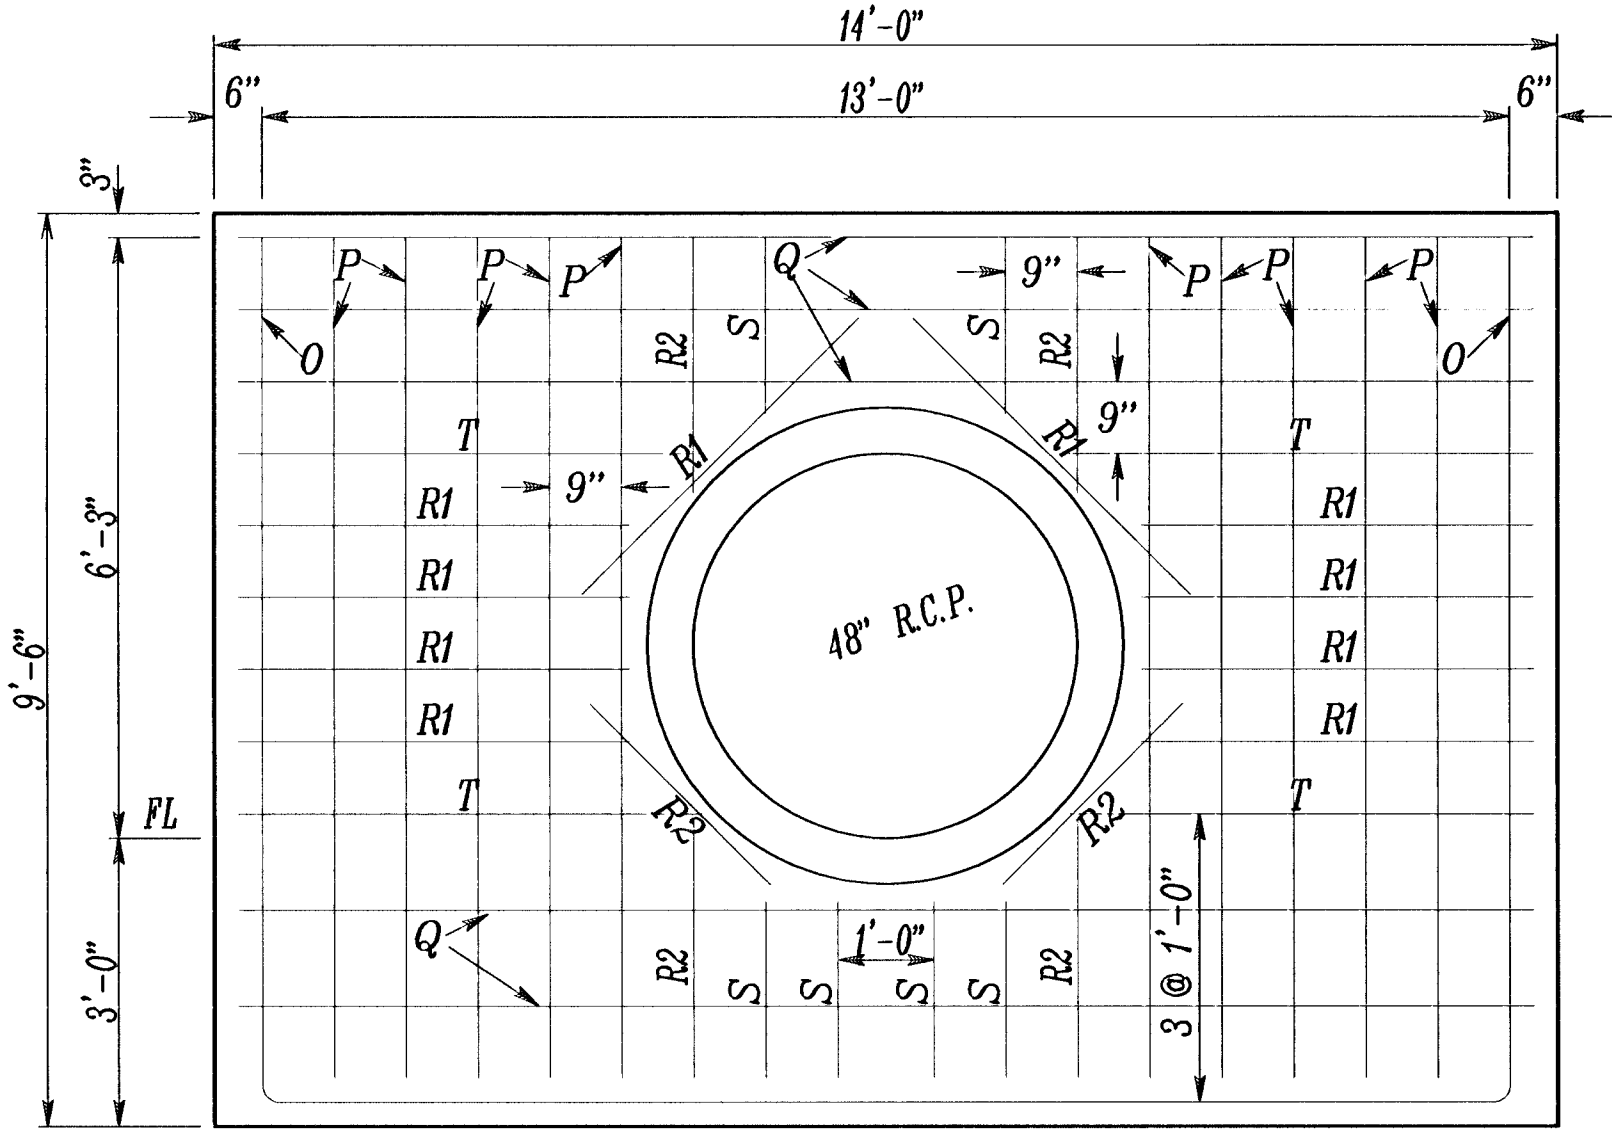

FRONT

NOTE: ALL REINFORCING STEEL SHALL BE SPACED 9" UNLESS OTHERWISE NOTED

CONCRETE COLLAR NOTES

CONCRETE: BEVEL ALL EXPOSED EDGES WITH A 3/4" TRIANGULAR MOLDING OR FINISH WITH AN APPROVED EDGING TOOL. CONCRETE SHALL BE AS PER CITY OF WICHITA STANDARD SPECIFICATIONS FOR CONCRETE PAVING MIX EXCEPT THAT IT SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4,000 P.S.I. ALL PIPES SHALL BE FLUSH CUT PRIOR TO BEING CAST INTO THE HEADWALL.

REINFORCING STEEL: ALL DIMENSIONS RELATIVE TO REINFORCING STEEL ARE TO CENTERLINE OF BAR UNLESS OTHERWISE NOTED. ALL CLEARANCES SHALL BE 2" UNLESS OTHERWISE NOTED. ALL REINFORCING STEEL SHALL CONFORM TO A.S.T.M. DESIGNATION A615 GRADE 60 AND SHALL BE EPOXY COATED.

PAYMENT: A DEDUCTION IN CONCRETE QUANTITIES HAS BEEN MADE FOR THE PIPE OPENINGS. THE "2- 42" HEADWALL/COLLAR (REINFORCED CONCRETE) OR "48" HEADWALL/COLLAR (REINFORCED CONCRETE)" SHALL BE PAID FOR AT THE UNIT PRICE BID PER EACH IN PLACE INCLUDING CONCRETE, REINFORCING STEEL, EXCAVATION AND ALL OTHER MISCELLANEOUS MATERIALS, LABOR, TOOLS, EQUIPMENT AND INCIDENTALS NECESSARY TO COMPLETE THE WORK. QUANTITIES SHOWN ARE FOR INFORMATION ONLY.

2-42" COLLAR/
48" COLLAR DETAIL

FINAL

Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Poe Job No.: 16944
Date: March 2002

Sheet
6 of 20

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS

POND NOTES/COLLAR DETAILS




CITY OF WICHITA, KANSAS

MICHAEL E. UNDEBAK, P.E. - CITY ENGINEER


C.O.W. Project # 468-83320 O.C.A. # 751305

NOTE:


ALL POND SLOPES AND PARKWAY AREAS SHALL RECEIVE TEMPORARY SEEDING AT A RATE OF 200 LBS/ACRE WITHIN 14 DAYS OF DISTURBANCE. ALL POND PARKWAY AREAS AND SLOPES ABOVE ELEVATION 1319.50.0 SHALL RECEIVE PERMANENT KANSAS PREMIUM BLEND FESCUE SEEDING DURING FALL PLANTING SEASON (AUGUST 15 - SEPTEMBER 30).

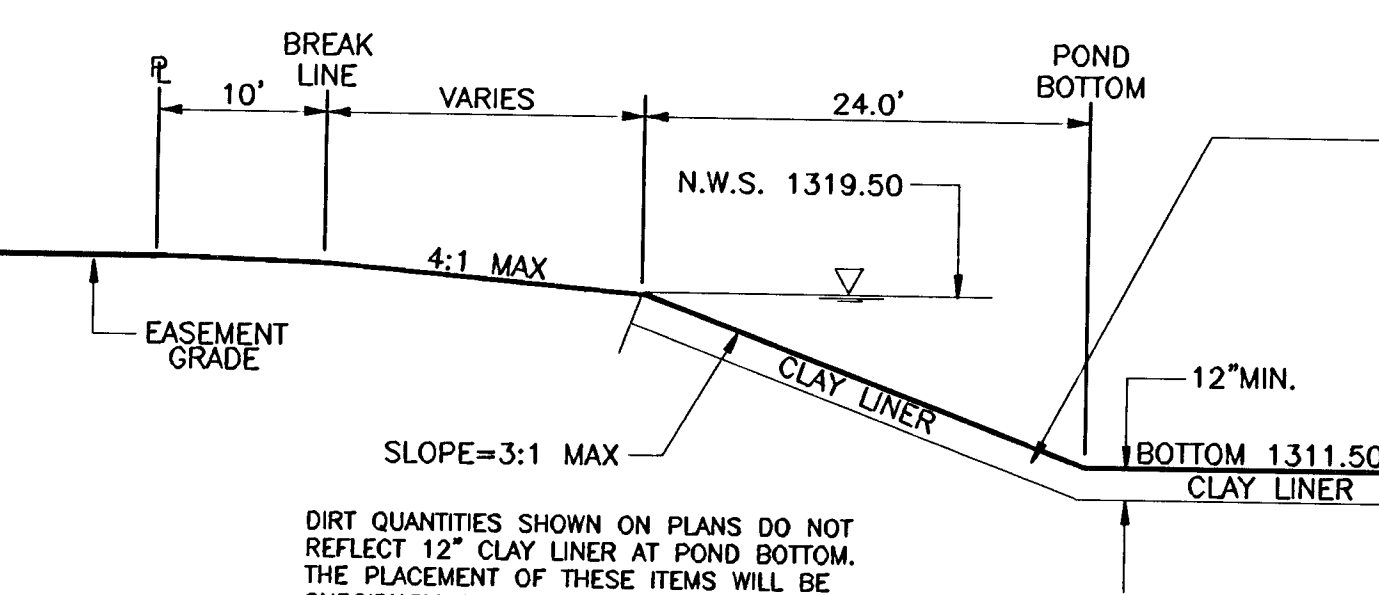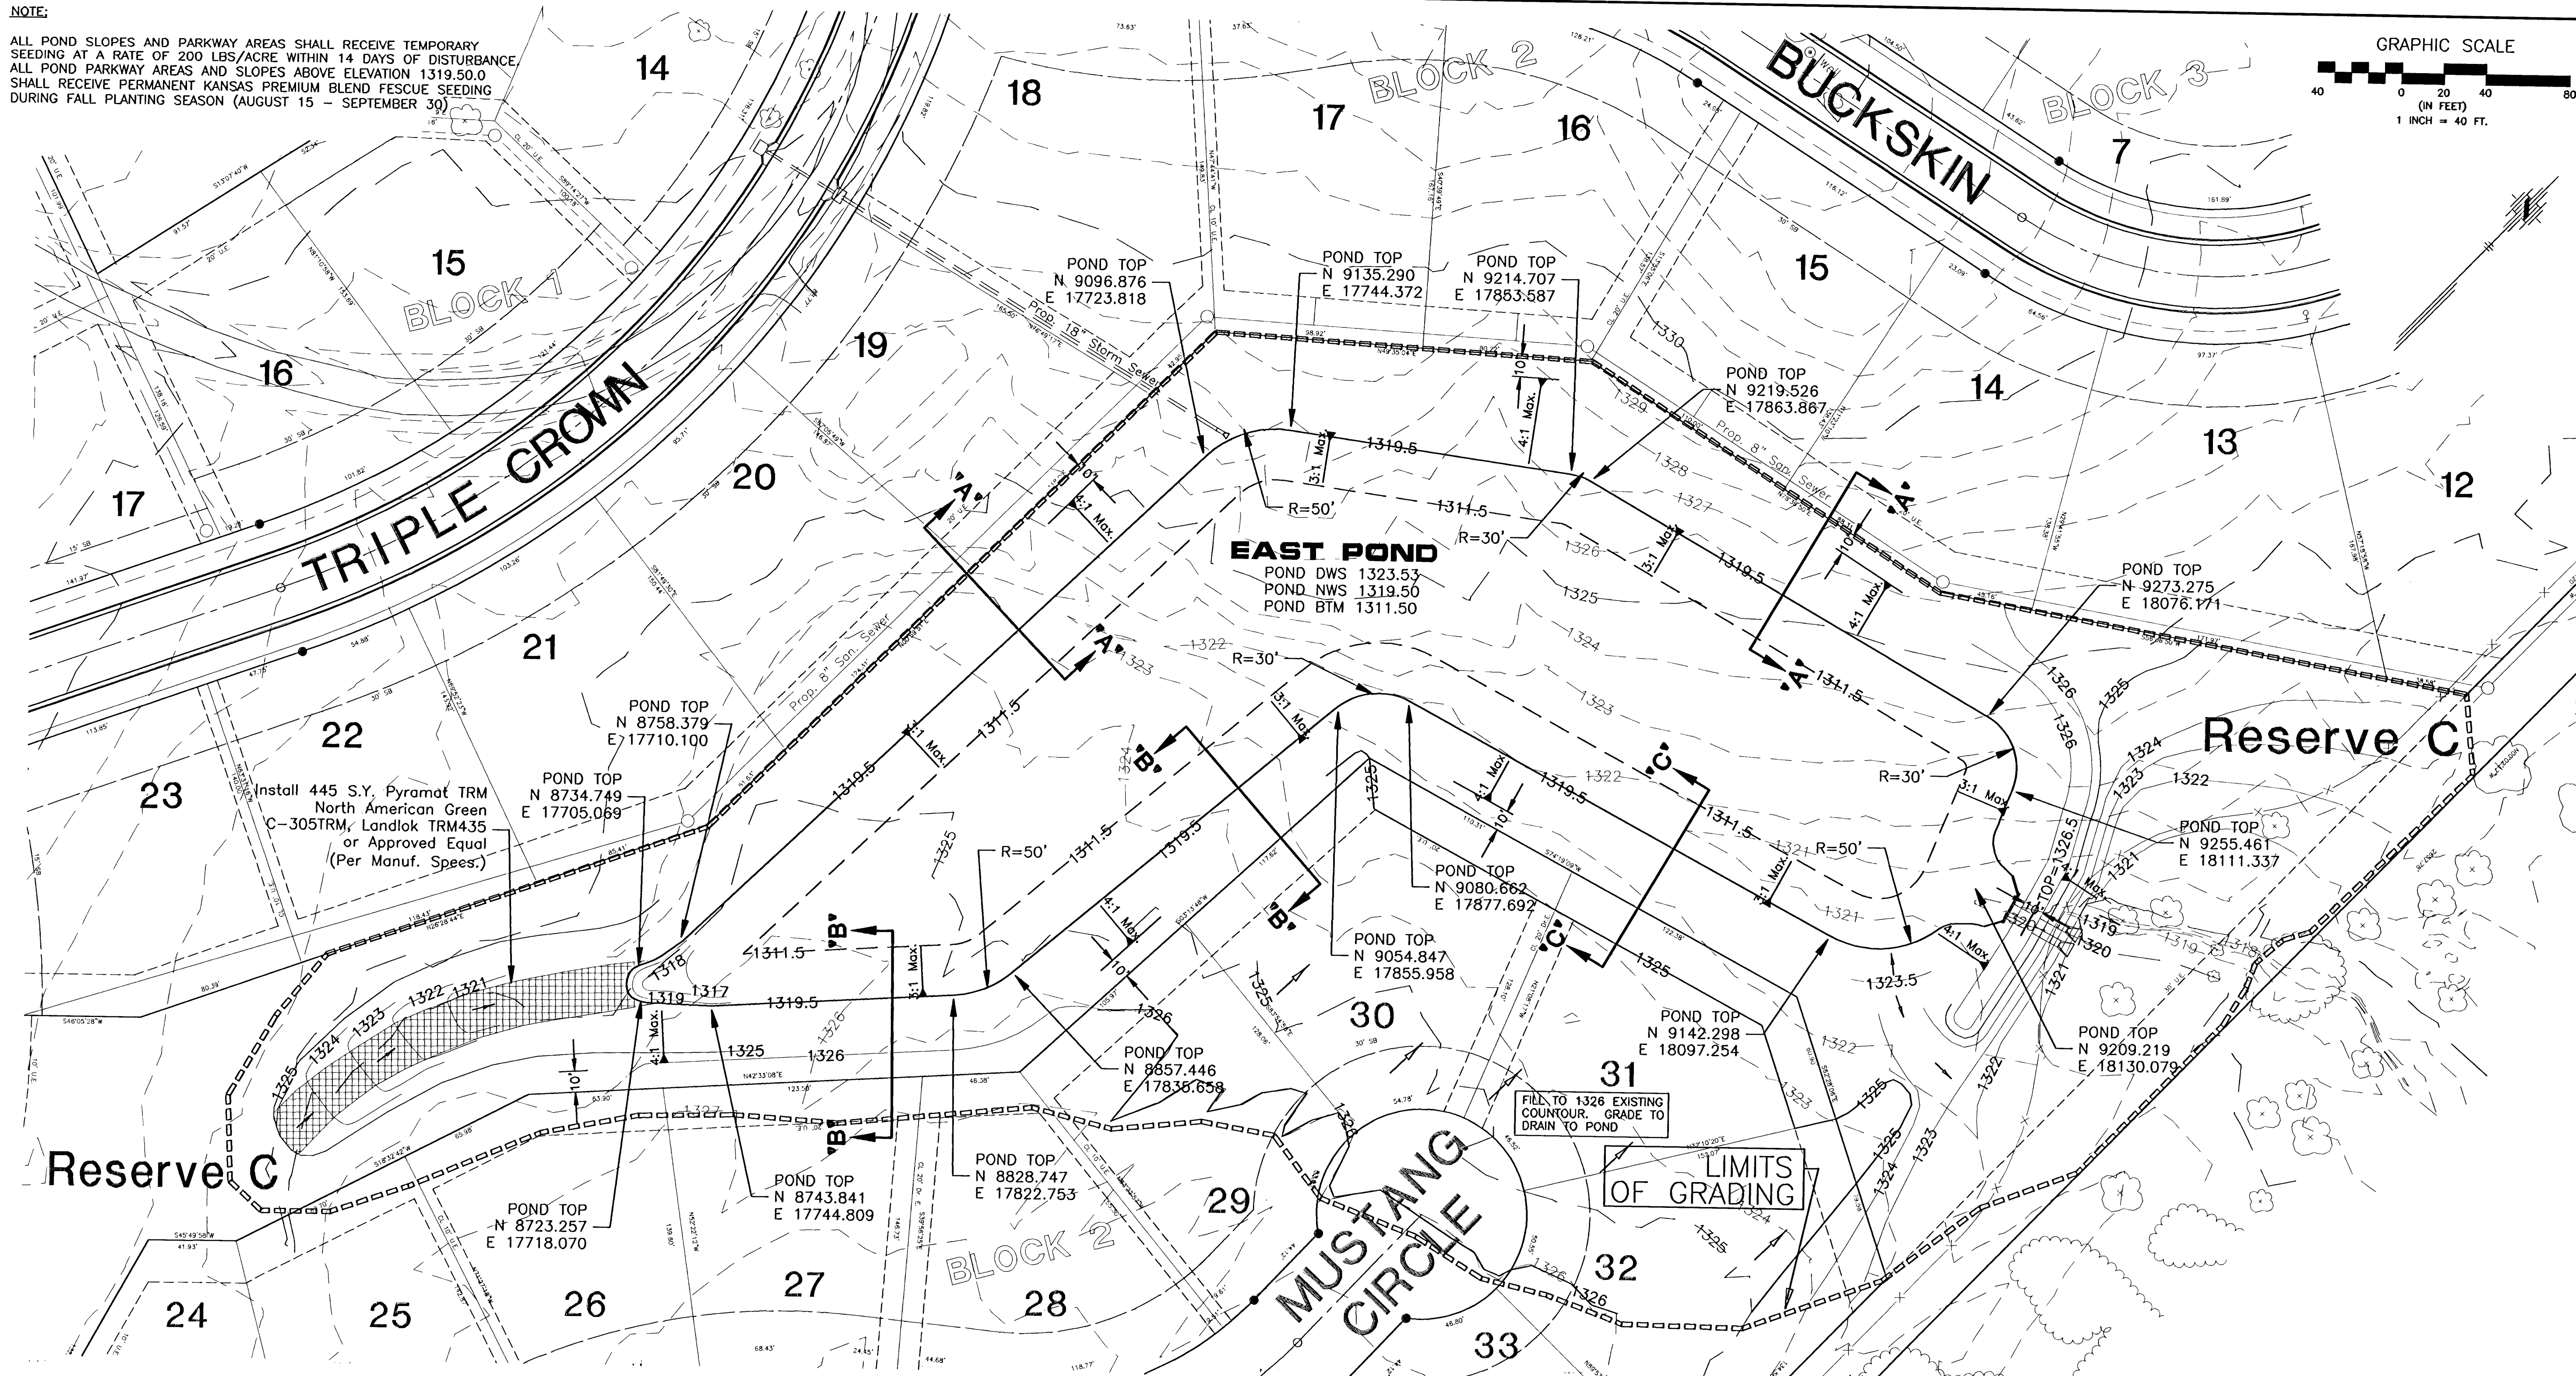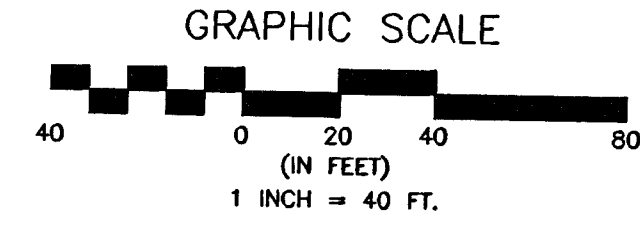

CONSTRUCT 12" MINIMUM THICKNESS CLAY LINER, COMPACT TO ABOVE OPTIMUM MOISTURE CONTENT A MINIMUM OF 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 698, STANDARD PROCTOR PROCEDURE. CLAY LINER TO BE CONSTRUCTED WITH SOILS HAVING A PLASTICITY INDEX OF 25. IF SUITABLE MATERIAL IS NOT ON SITE, CONTRACTOR SHALL FURNISH SUITABLE CLAY. PROCTOR AND COMPACTION TESTING SHALL BE BY TERRACON AT A COST NOT TO EXCEED \$3,600. (COST OF CLAY LINER FROM ON SITE OR CONTRACTOR FURNISHED AND TERRACON TESTING SHALL BE SUBSIDIARY TO EXCAVATION).

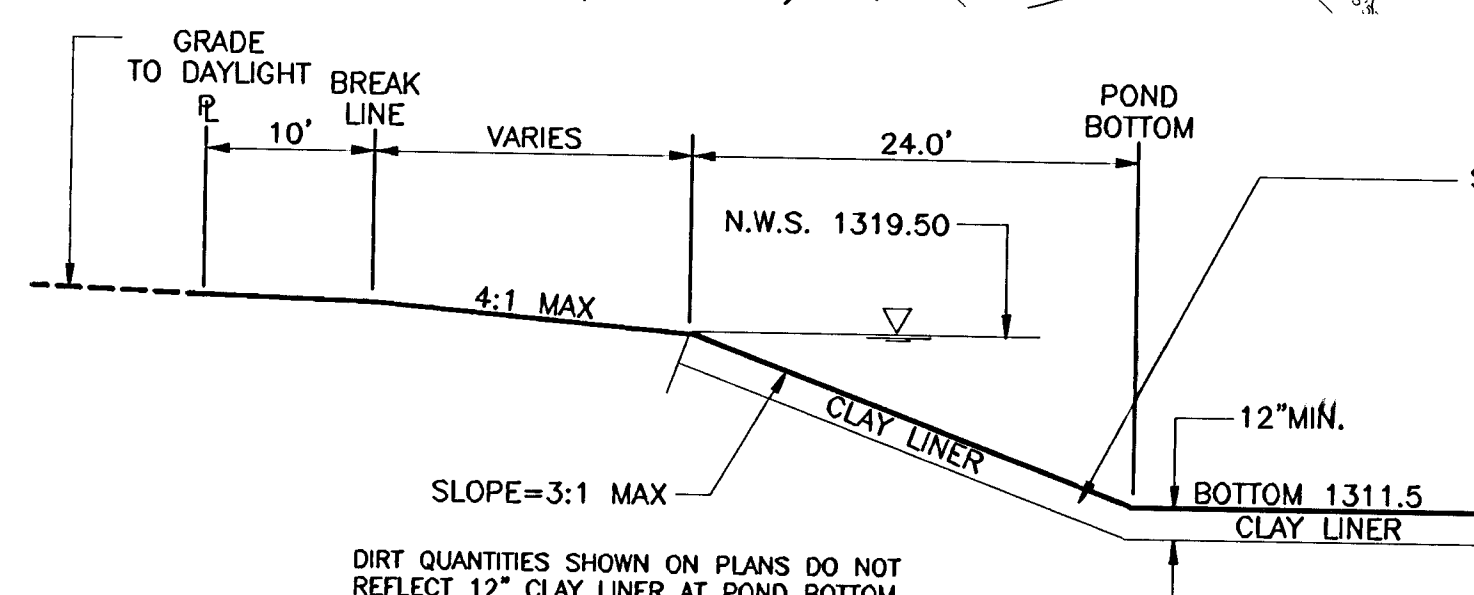

SEE SECTION A-A

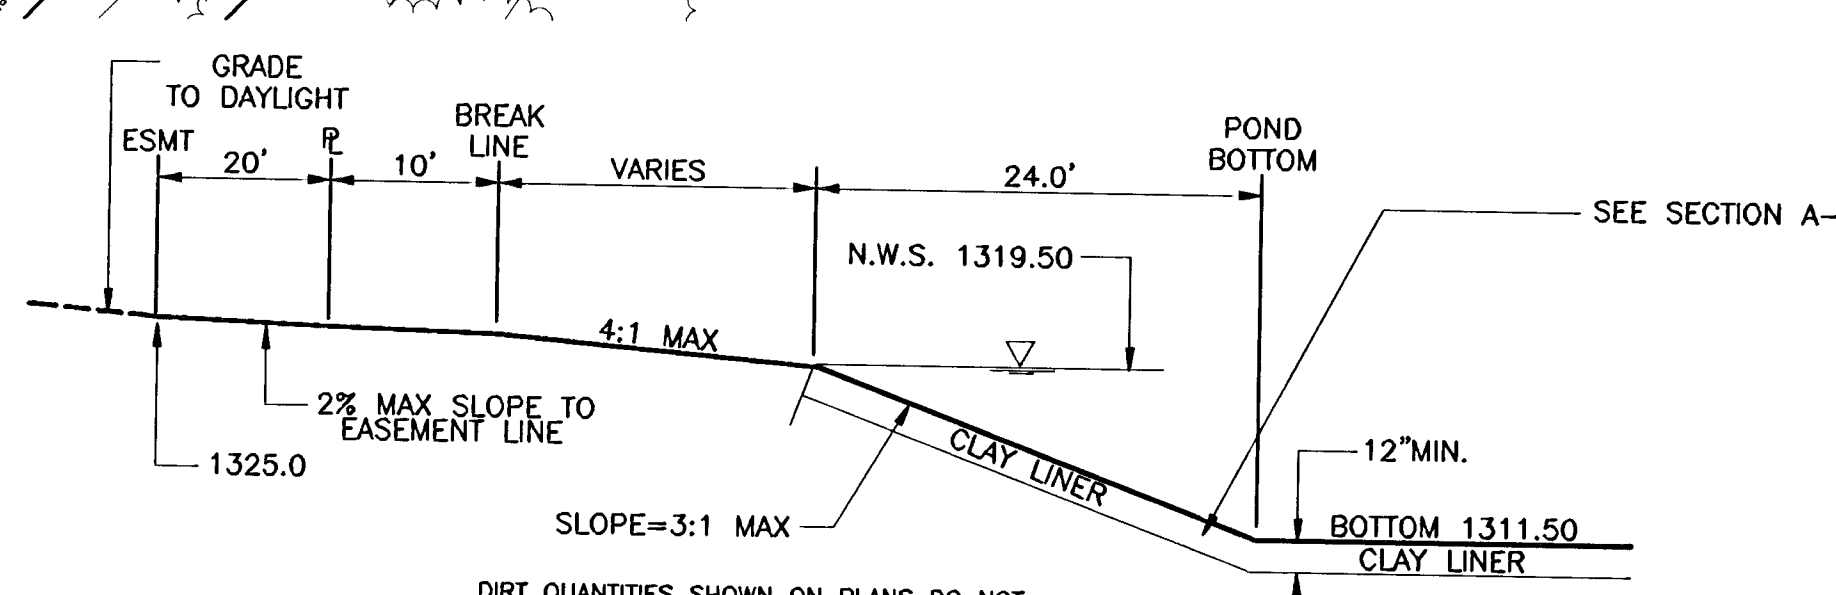

DIRT QUANTITIES SHOWN ON PLANS DO NOT REFLECT 12" CLAY LINER AT POND BOTTOM. THE PLACEMENT OF THESE ITEMS WILL BE SUBSIDIARY TO THE EXCAVATION BID ITEM.

SECTION "A" - "A"




SECTION "B" - "B"

SECTION "C" - "C"

POE & ASSOCIATES OF KANSAS, INC. CONSULTING ENGINEERS 5940 E. Central, Suite 200 • Wichita, KS 67208-4242 Phone 316/685-4114 • FAX 316/685-4444		EQUESTRIAN ESTATES - PHASE 1 DRAINAGE IMPROVEMENTS POND GRADING PLAN CITY OF WICHITA, KANSAS MICHAEL E. UNDERKAMP, P.E. - CITY ENGINEER C.O.N. Project # 468-63520 O.C.A. # 751305
FINAL Designed By: J. Ubert / J. Dickman Drawn By: J. Dickman Poe Job No.: 1694A Date: March 2002	Revision No. Date By Approved 1 2 3	


NOTE:

ALL POND SLOPES AND PARKWAY AREAS SHALL RECEIVE TEMPORARY SEEDING AT A RATE OF 250 LBS/ACRE WITHIN 14 DAYS OF DISTURBANCE.
ALL POND PARKWAY AREAS AND SLOPES ABOVE ELEVATION 1310.0 SHALL RECEIVE PERMANENT KANSAS PREMIUM BLEND FESCUE SEEDING DURING FALL PLANTING SEASON (AUGUST 15 - SEPTEMBER 30)

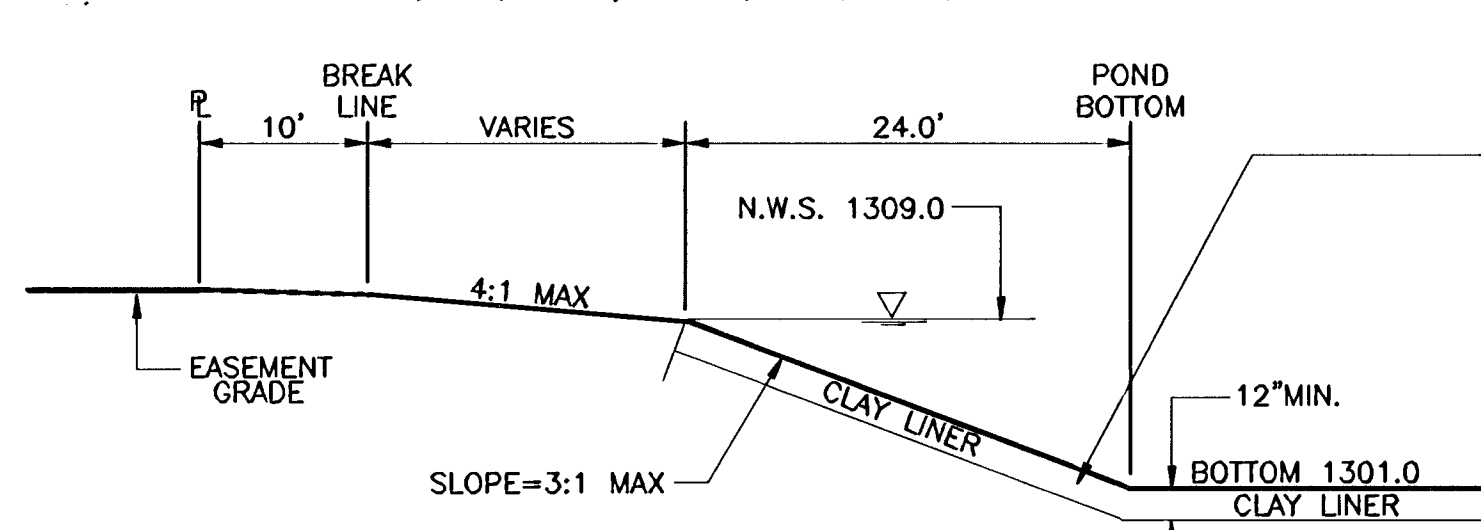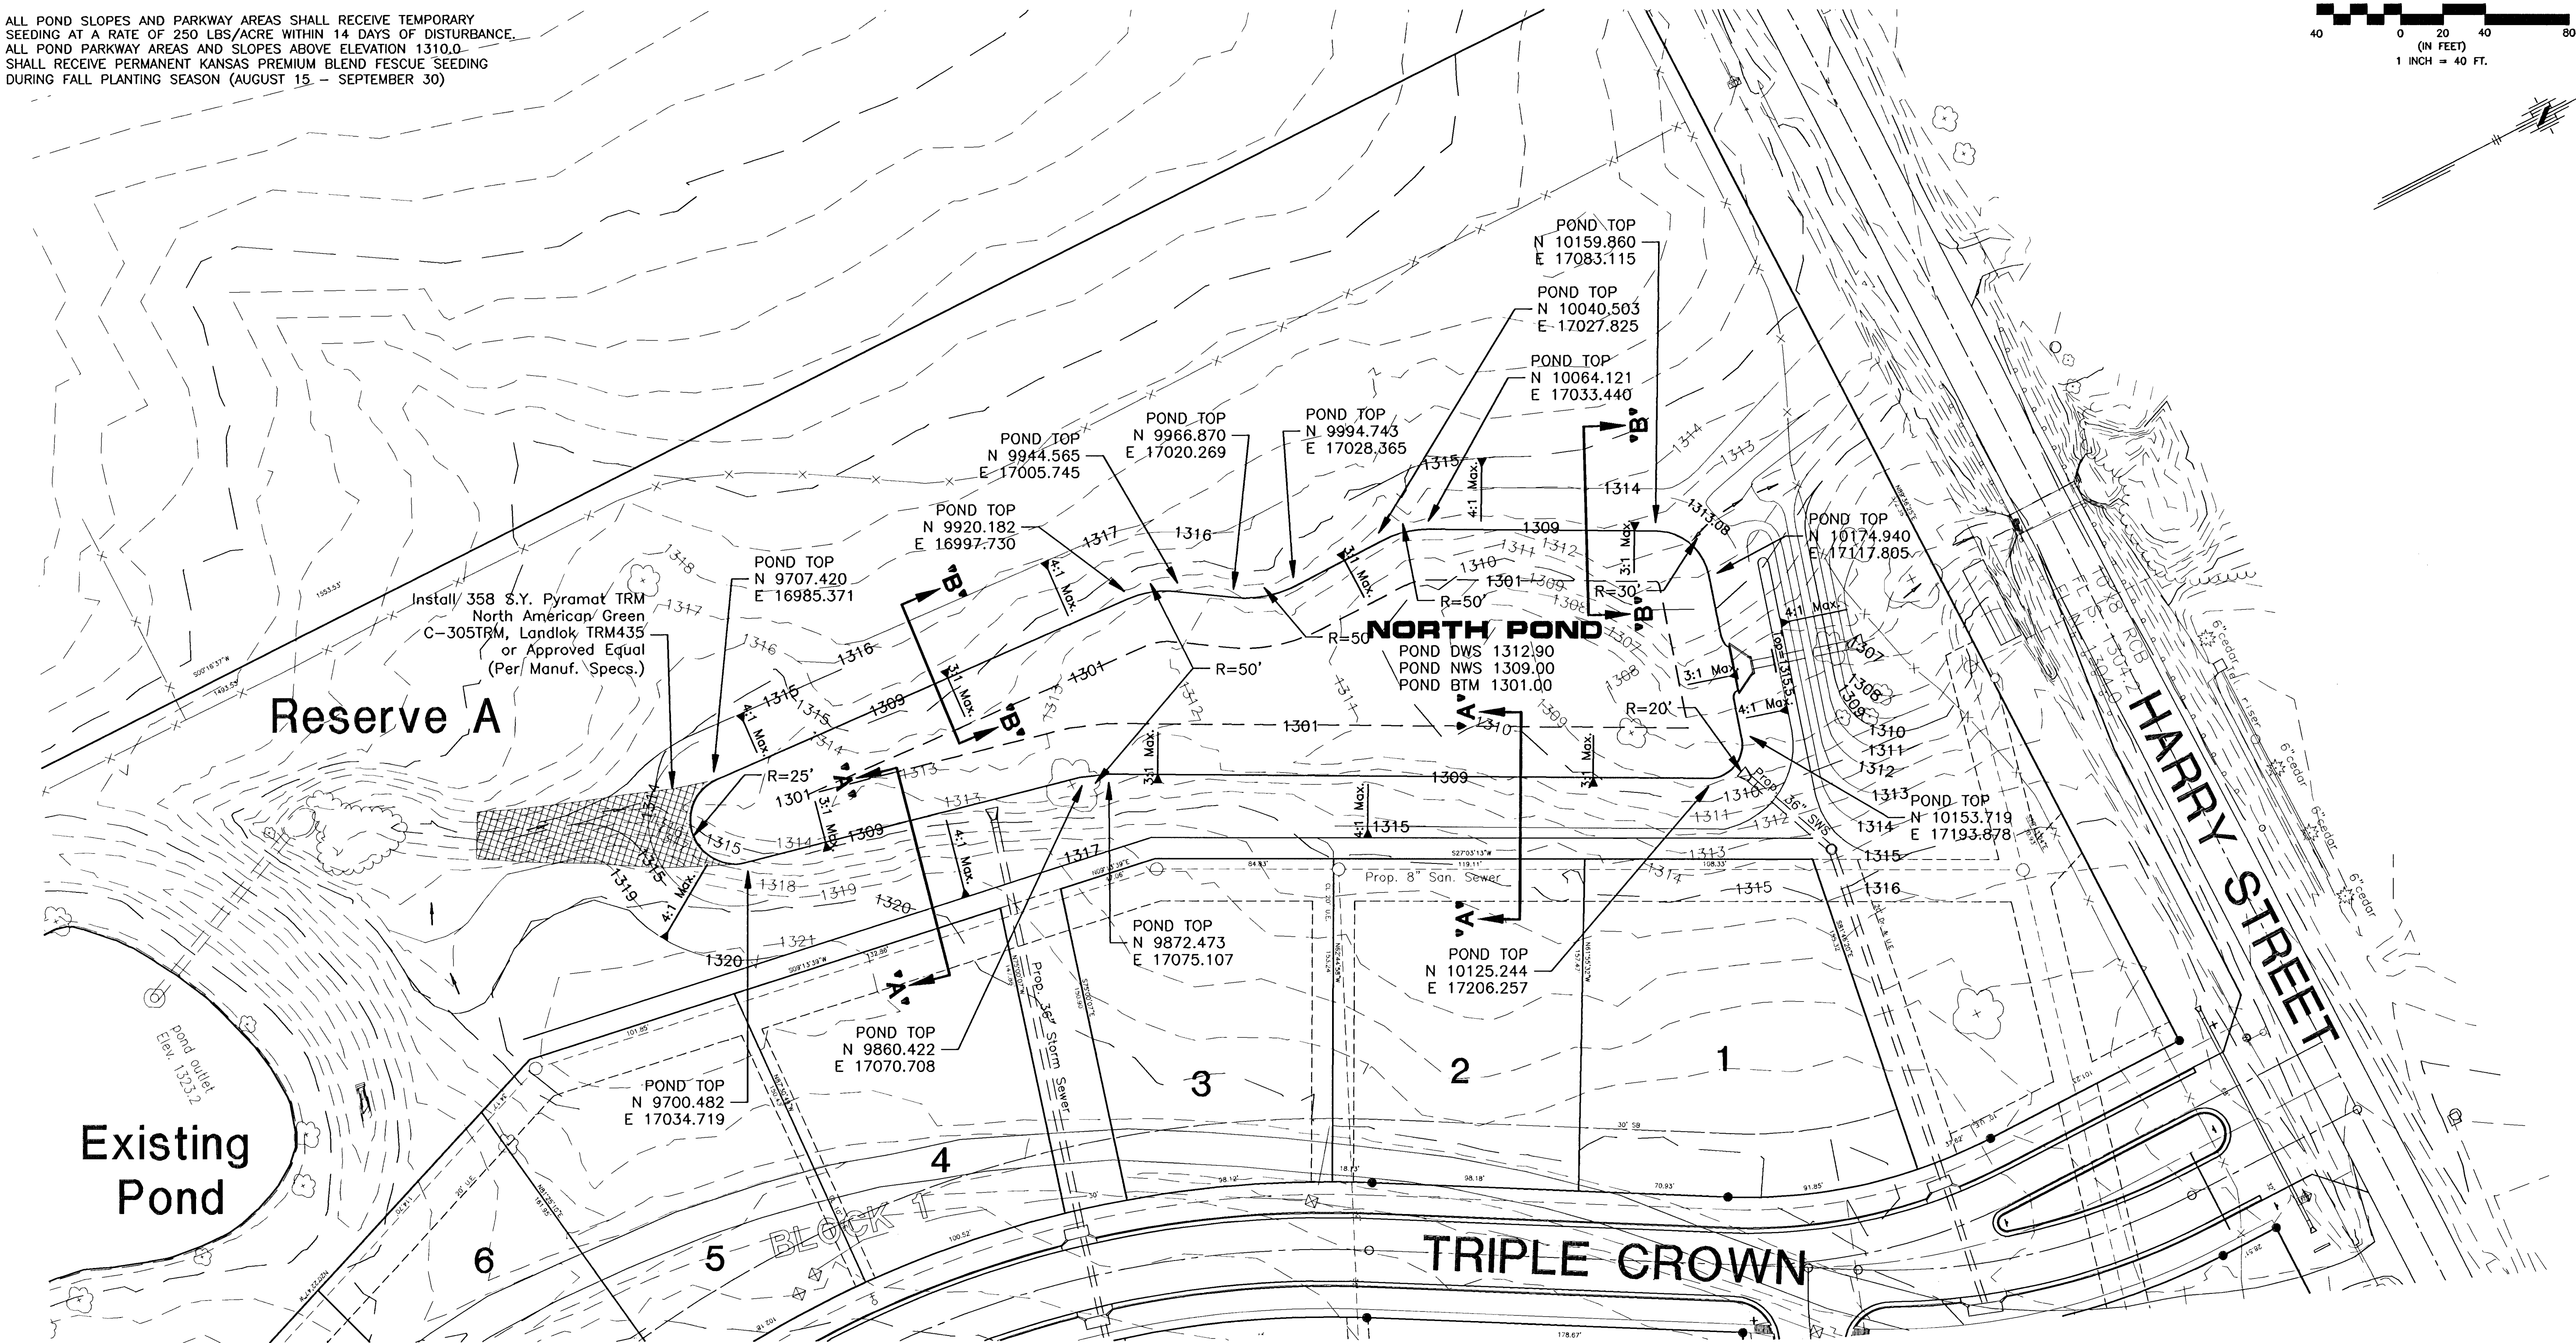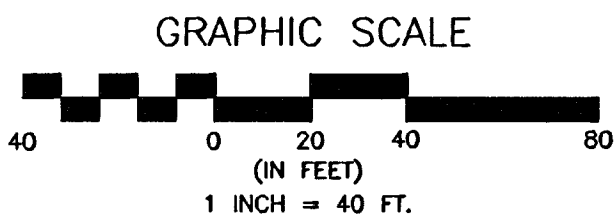

CONSTRUCT 12" MINIMUM THICKNESS CLAY LINER, COMPACT TO ABOVE OPTIMUM MOISTURE CONTENT A MINIMUM OF 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 698, STANDARD PROCTOR PROCEDURE. CLAY LINER TO BE CONSTRUCTED WITH SOILS WITH A MINIMUM PLASTICITY INDEX OF 25. IF SUITABLE MATERIAL IS NOT ONSITE, CONTRACTOR SHALL FURNISH SUITABLE CLAY. PROCTOR & COMPACTION TESTING SHALL BE BY TERRACON AT A COST NOT TO EXCEED \$3,600. (COST OF CLAY LINER FROM ON SITE OR CONTRACTOR FURNISHED AND TERRACON TESTING SHALL BE SUBSIDIARY TO EXCAVATION.)

SECTION "A" - "A"

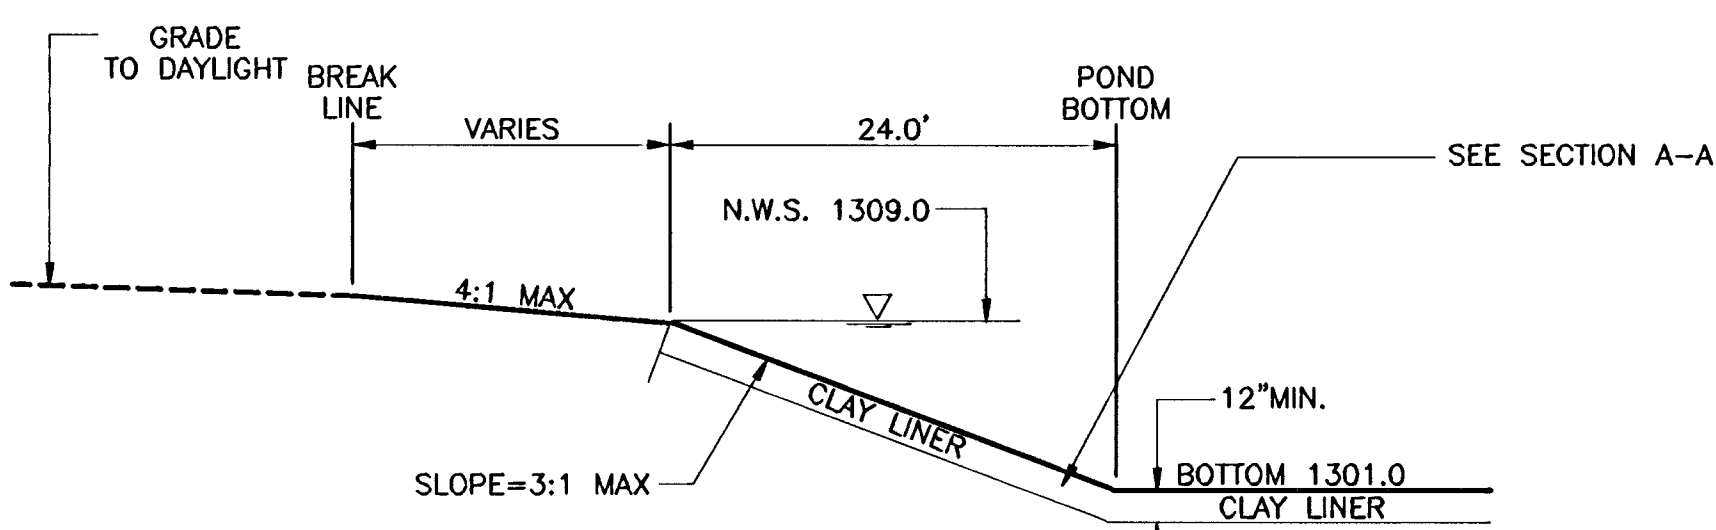

DIRT QUANTITIES SHOWN ON PLANS DO NOT REFLECT 12" CLAY LINER AT POND BOTTOM. THE PLACEMENT OF THESE ITEMS WILL BE SUBSIDIARY TO THE EXCAVATION BID ITEM.



SECTION "B" - "B"

EQUESTRIAN ESTATES - PHASE 1	
DRAINAGE IMPROVEMENTS	
POND GRADING PLAN	
CITY OF WICHITA, KANSAS	
MICHAEL E. LINDEBAK, P.E., CITY ENGINEER	
C.O.W. Project # 868-8330 O.C.A. # 751305	
POE & ASSOCIATES OF KANSAS, INC.	
CONSULTING ENGINEERS	
5940 E. Central, Suite 200 • Wichita, KS 67208-4242	
Phone 316/685-4114 • FAX 316/685-4444	
Designed By: J. Ubert / J. Dickman	
Drawn By: J. Dickman	
Poe Job No.: 1694A	
Date: March 2002	
Sheet	
8 of 20	

NOTE:

ALL DISTURBED POND SLOPES AND PARKWAY AREAS SHALL RECEIVE TEMPORARY SEEDING AT A RATE OF 250 LBS/ACRE WITHIN 14 DAYS OF DISTURBANCE.
ALL POND DISTURBED PARKWAY AREAS AND SLOPES ABOVE ELEVATION 1323.2 SHALL RECEIVE PERMANENT KANSAS PREMIUM BLEND FESCUE SEEDING DURING FALL PLANTING SEASON (AUGUST 15 - SEPTEMBER 30)

GRAPHIC SCALE

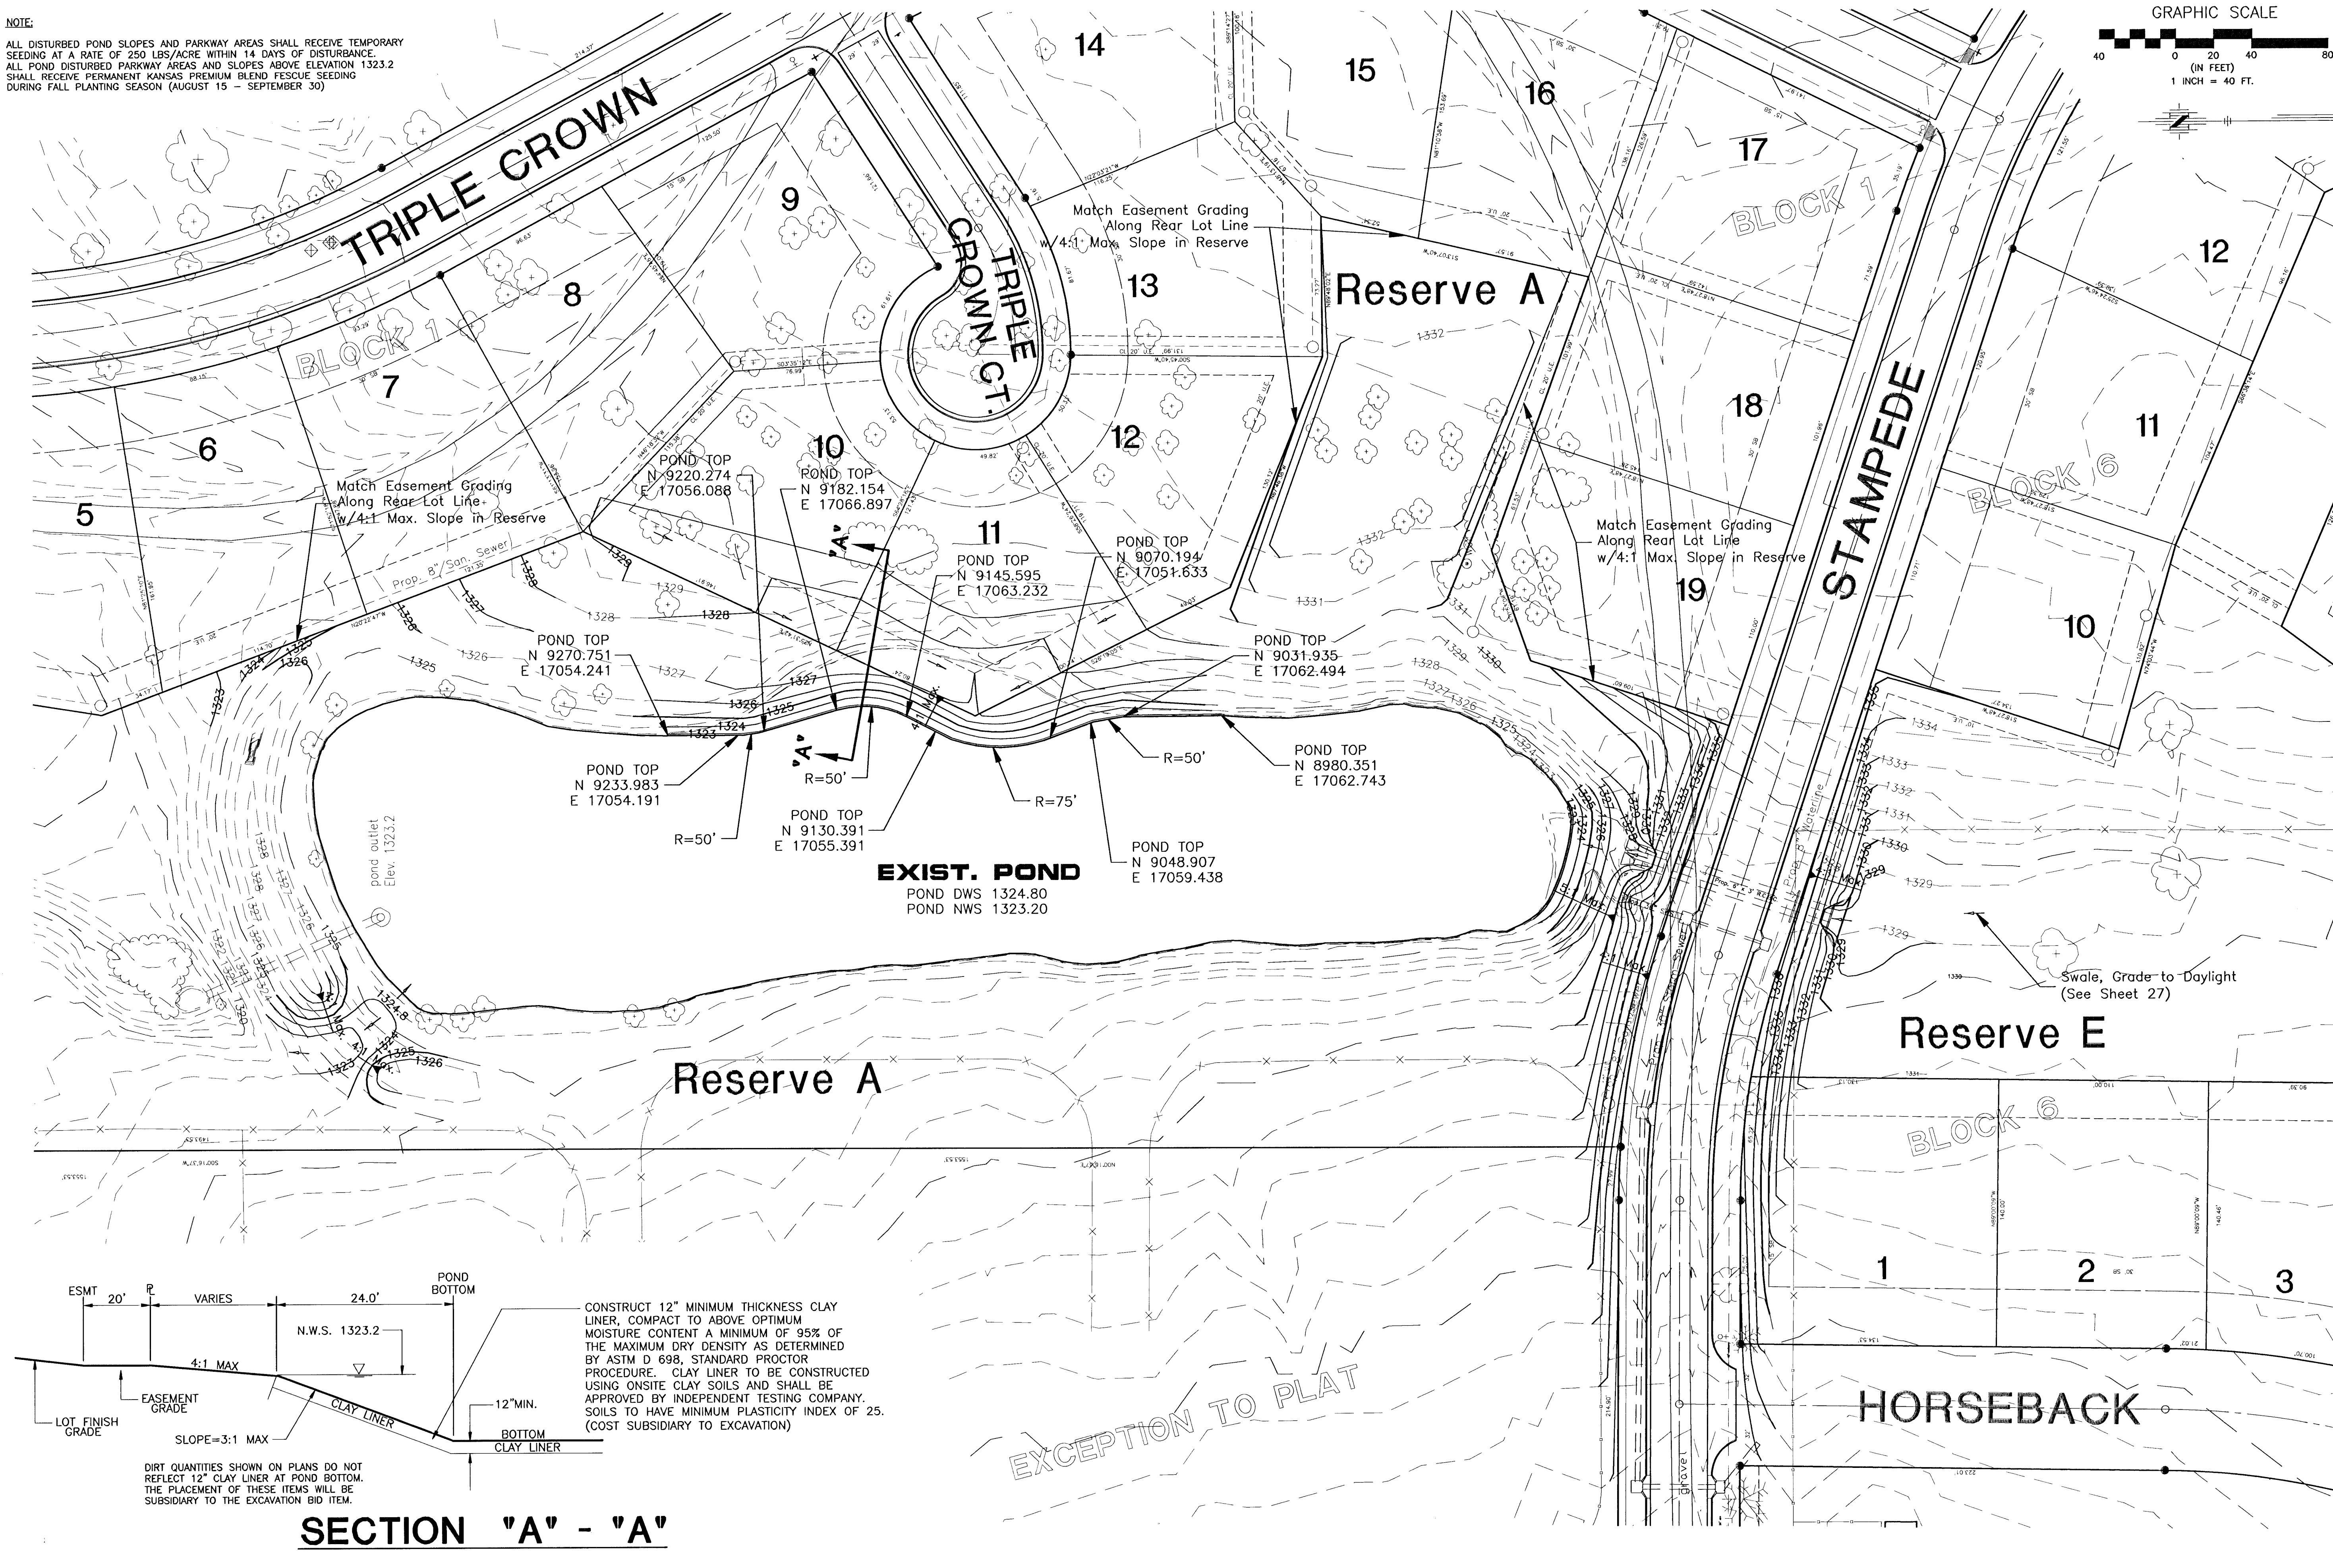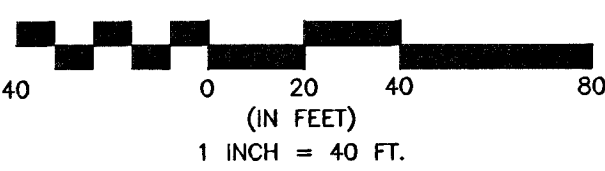


EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
POND RESERVE GRADING PLAN

CITY OF WICHITA, KANSAS

MICHAEL E. LINDEBAUM, P.E. - CITY ENGINEER

C.O.W. Project # 468-85320 O.C.A. # 751305

POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 - Wichita, KS 67208-4212
Phone 316.685-4114 FAX 316.685-4444

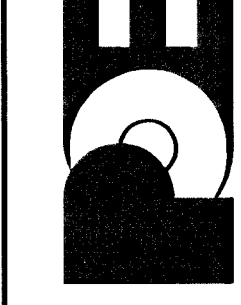

FINAL

Designed By: J. Ubert / J. Dickman

Drawn By: J. Dickman


Poe Job No.: 1694A

Date: March 2002


Sheet
9 of 20

G:\APPS\LOCAL\B4\BASE-ST.dwg Thu Mar 14 07:59:25 2002 Bernard Kujala - POE & ASSOCIATES OF KANSAS INC.

SHT P-104M

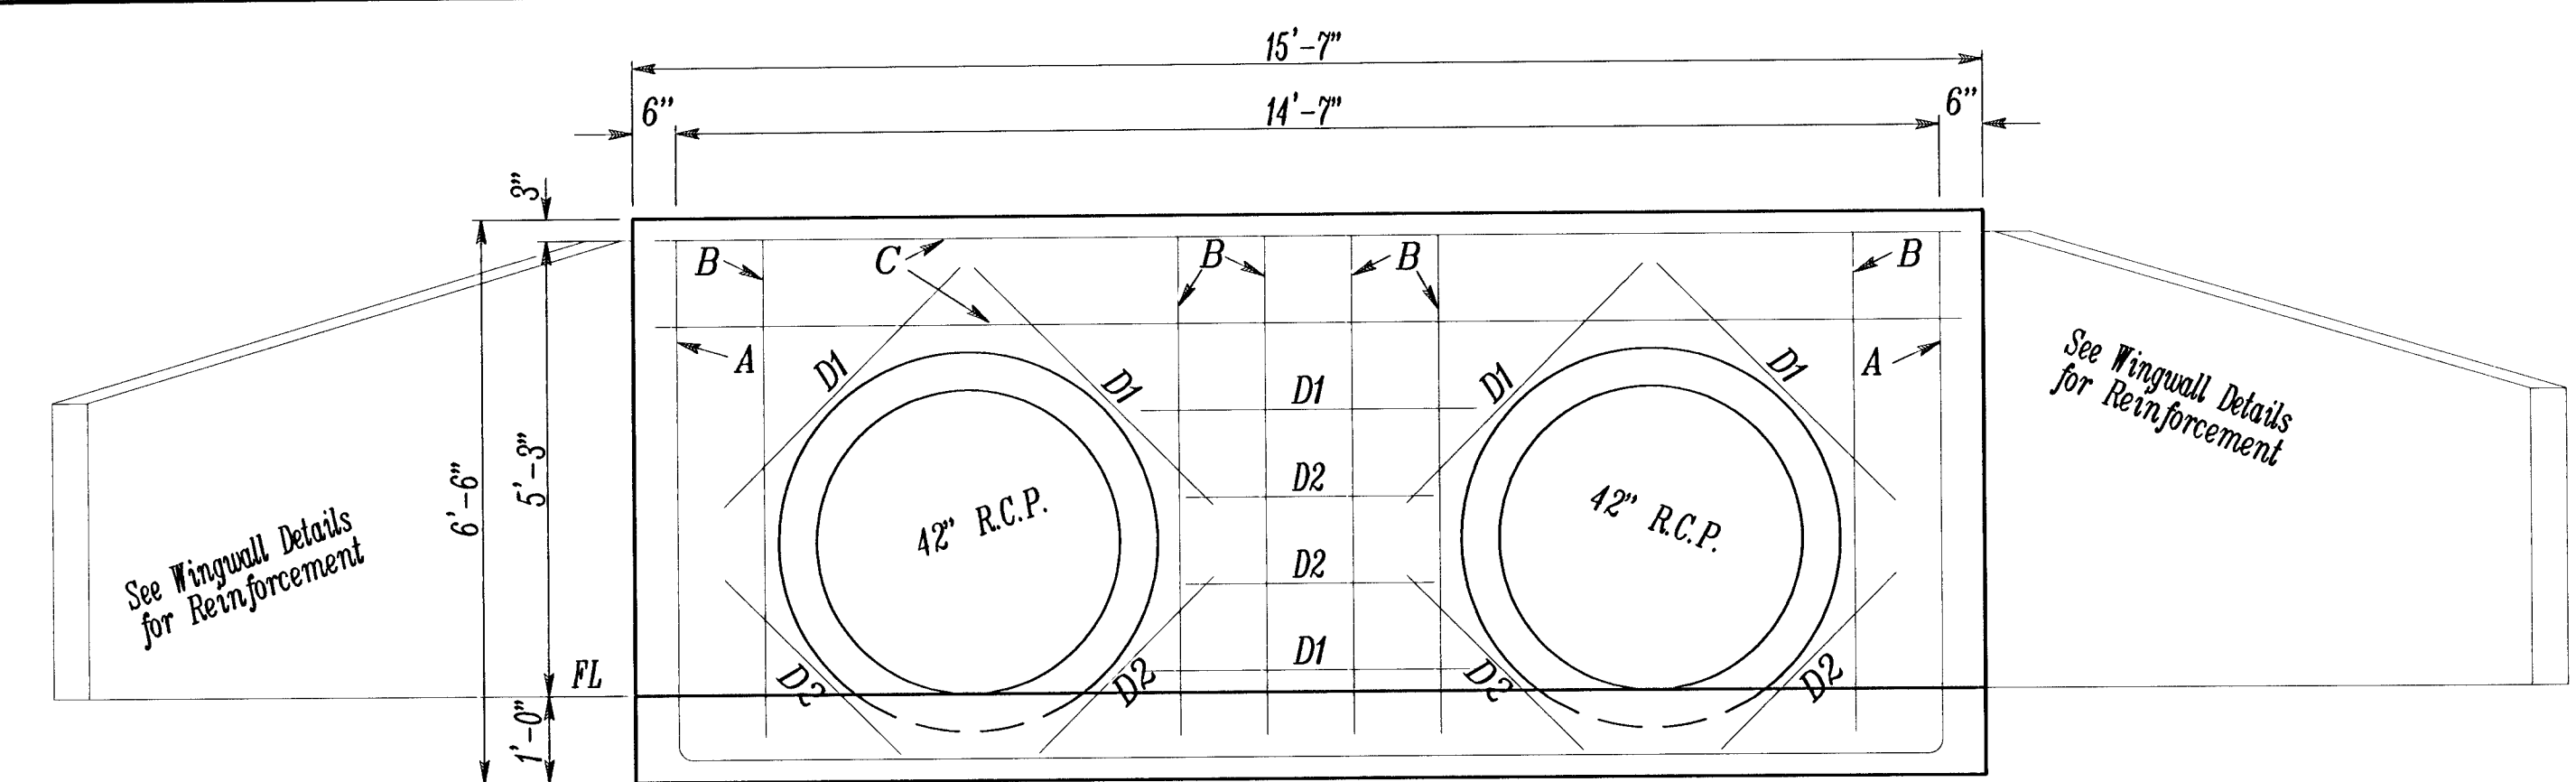


FRONT

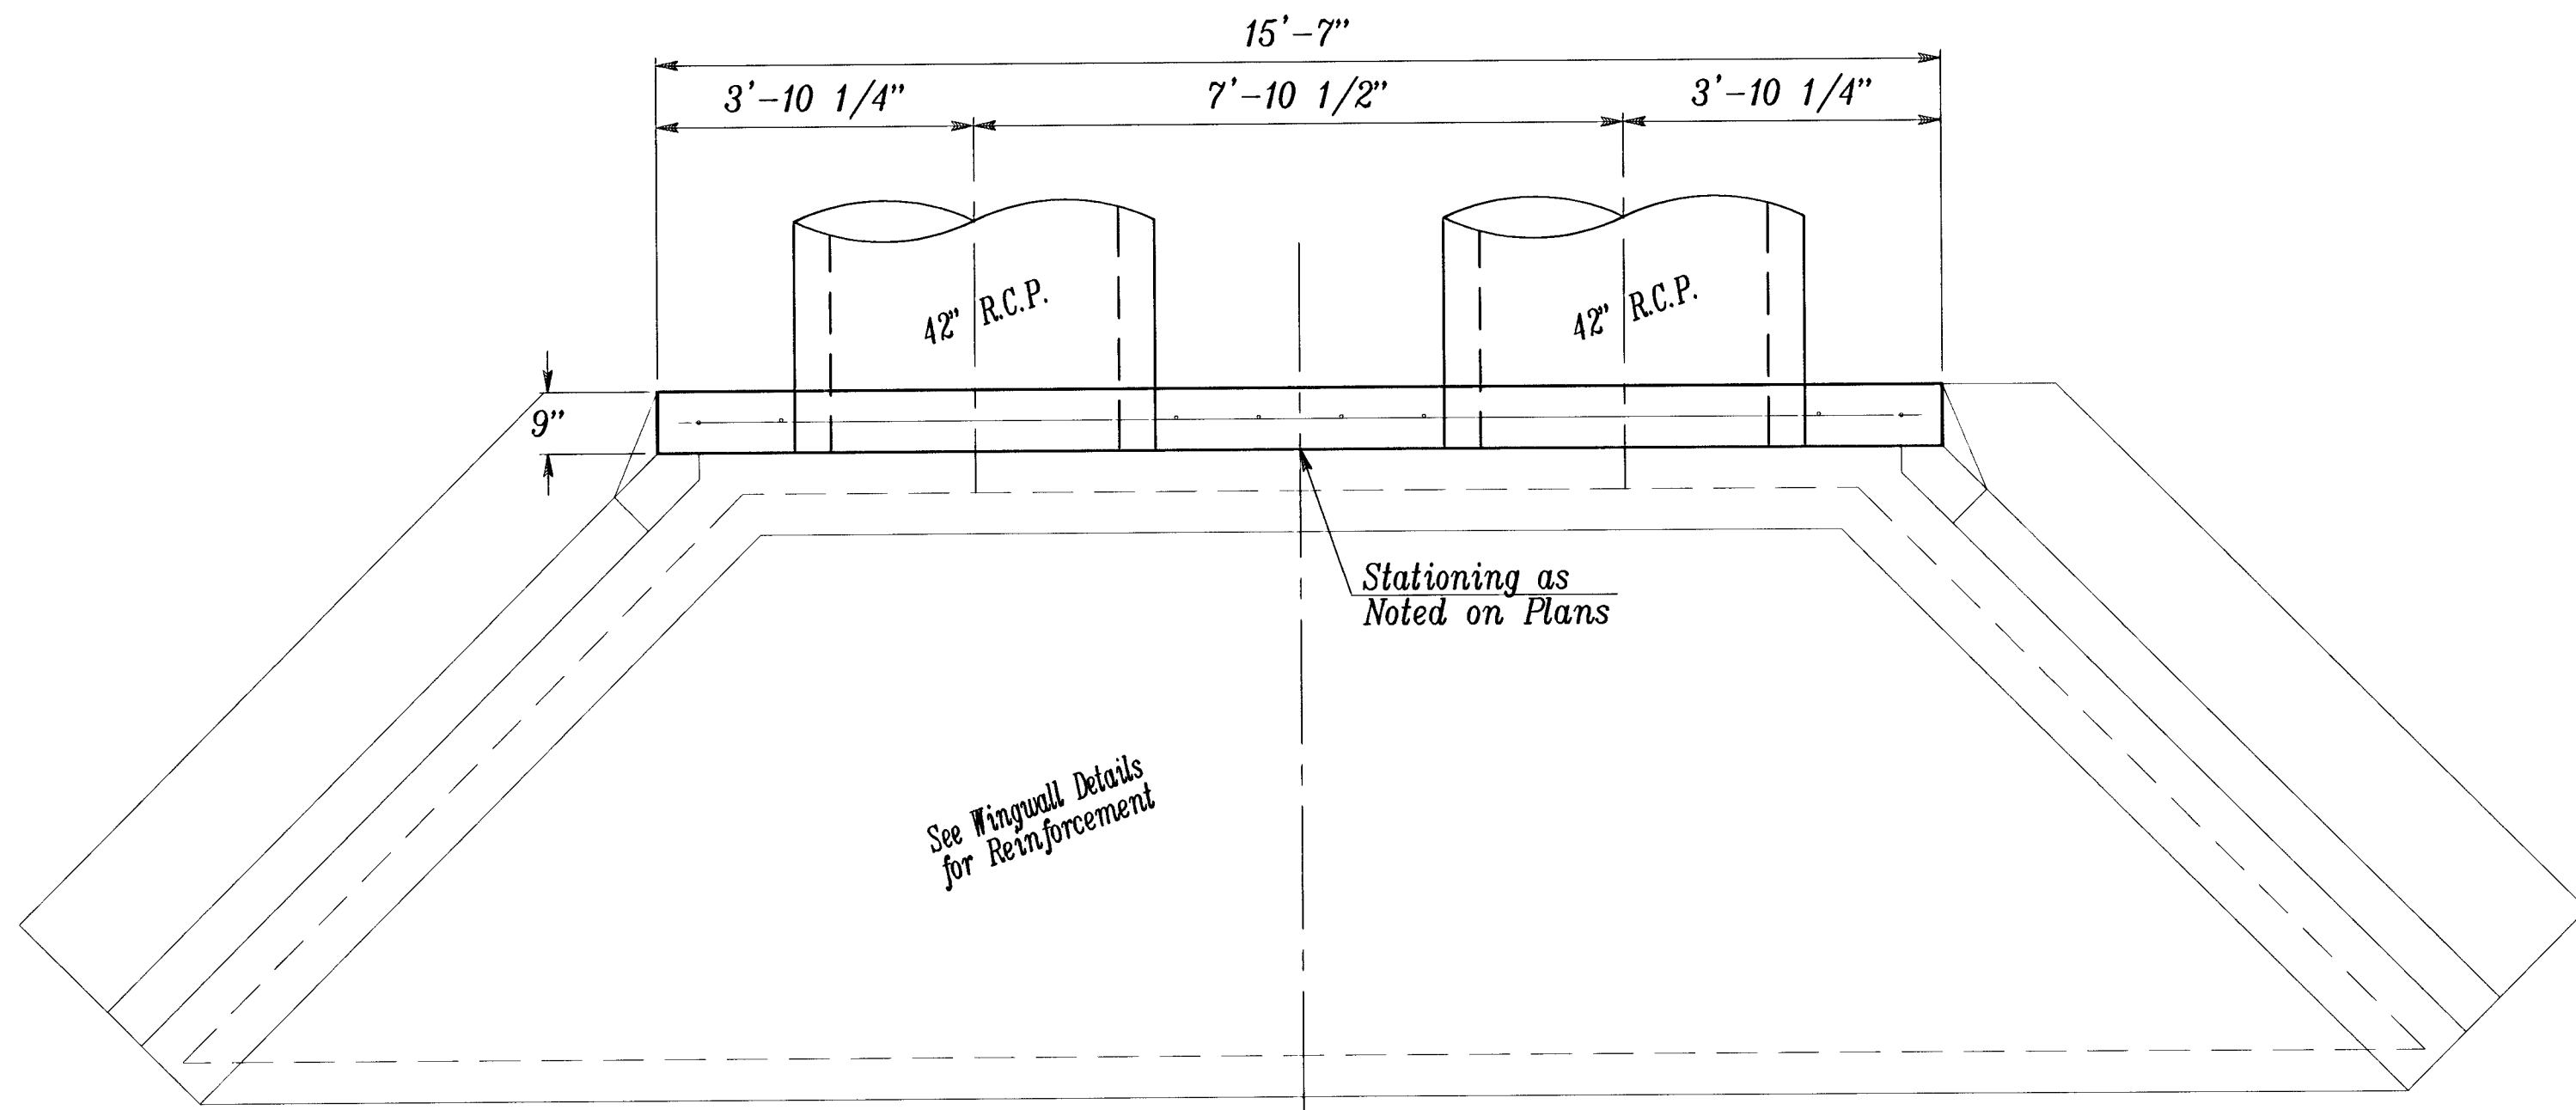


PLAN

2-42" HEADWALL RE-BAR SCHEDULE				
Mark	Shape	No.	Length	Weight
A		1	26'-7"	18.29
B		6	5'-9"	23.74
C		2	15'-1"	20.75
D1		6	3'-8"	15.14
D2		6	2'-4"	9.63
Total Rebar		88 Lbs.		
Concrete		1.98 C.Y.		


All Concrete Reinforcement to be #4 bars.

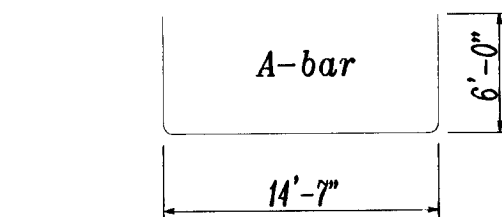


BENDING DIAGRAM

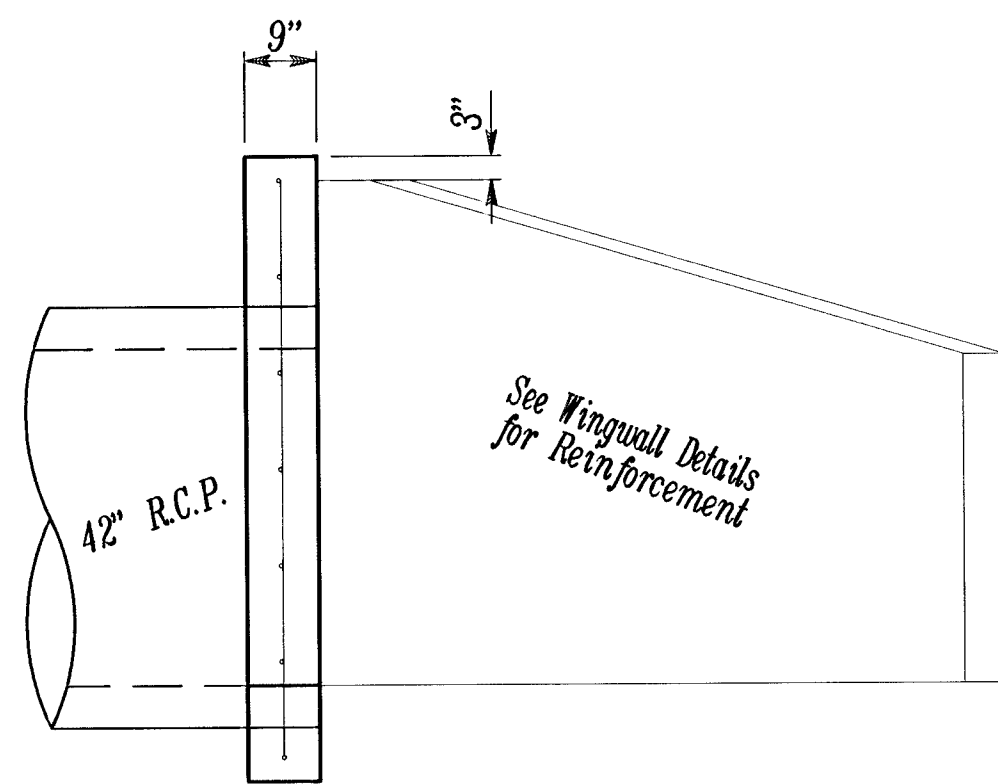

SECTION

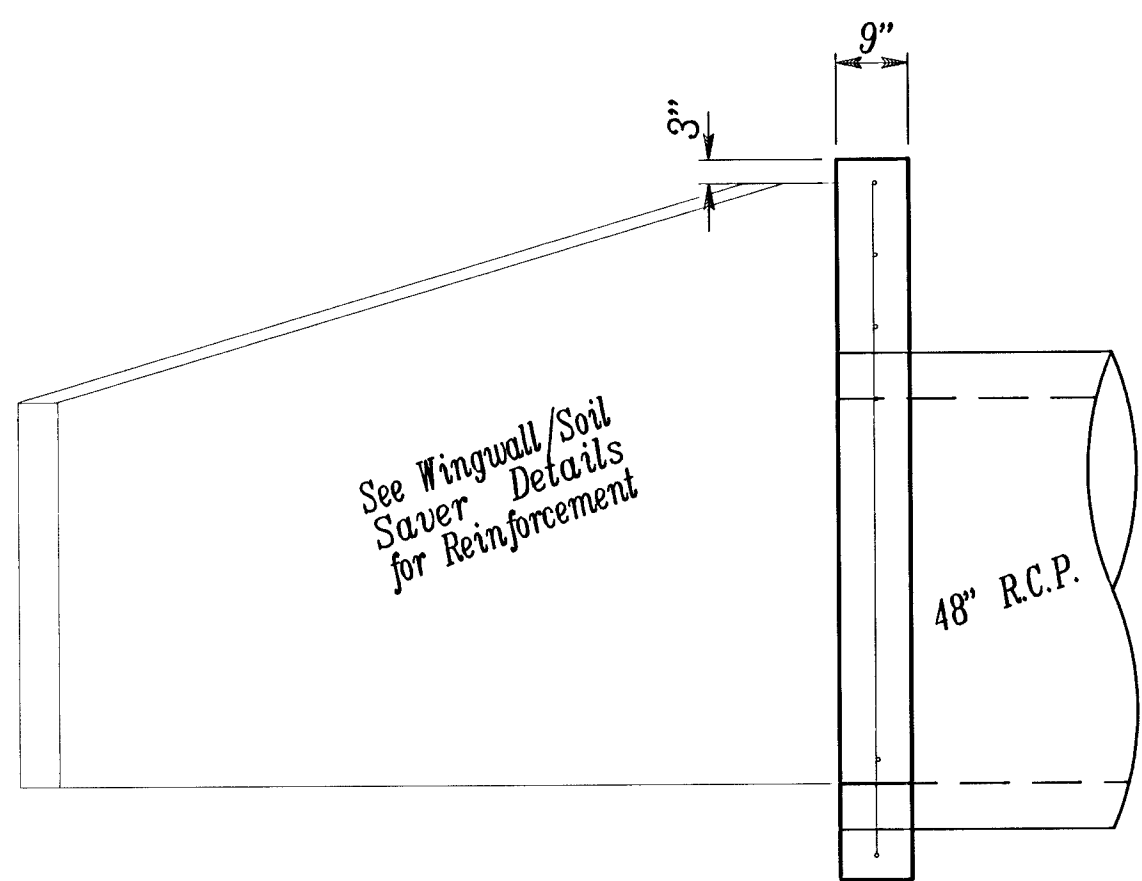


SECTION

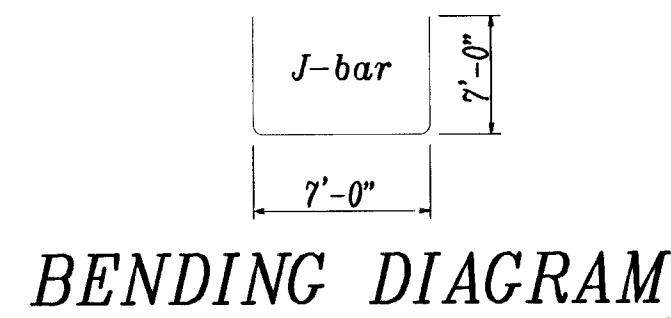


BENDING DIAGRAM

48" HEADWALL RE-BAR SCHEDULE				
Mark	Shape	No.	Length	Weight
J		1	21'-0"	14.45
K		2	6'-9"	14.19
L		3	7'-6"	15.48
M1		2	3'-8"	5.05
M2		4	2'-4"	6.42
N		6	1'-10"	7.57
Total Rebar		63 Lbs.		
Concrete		2.01 C.Y.		

All Concrete Reinforcement to be #4 bars.

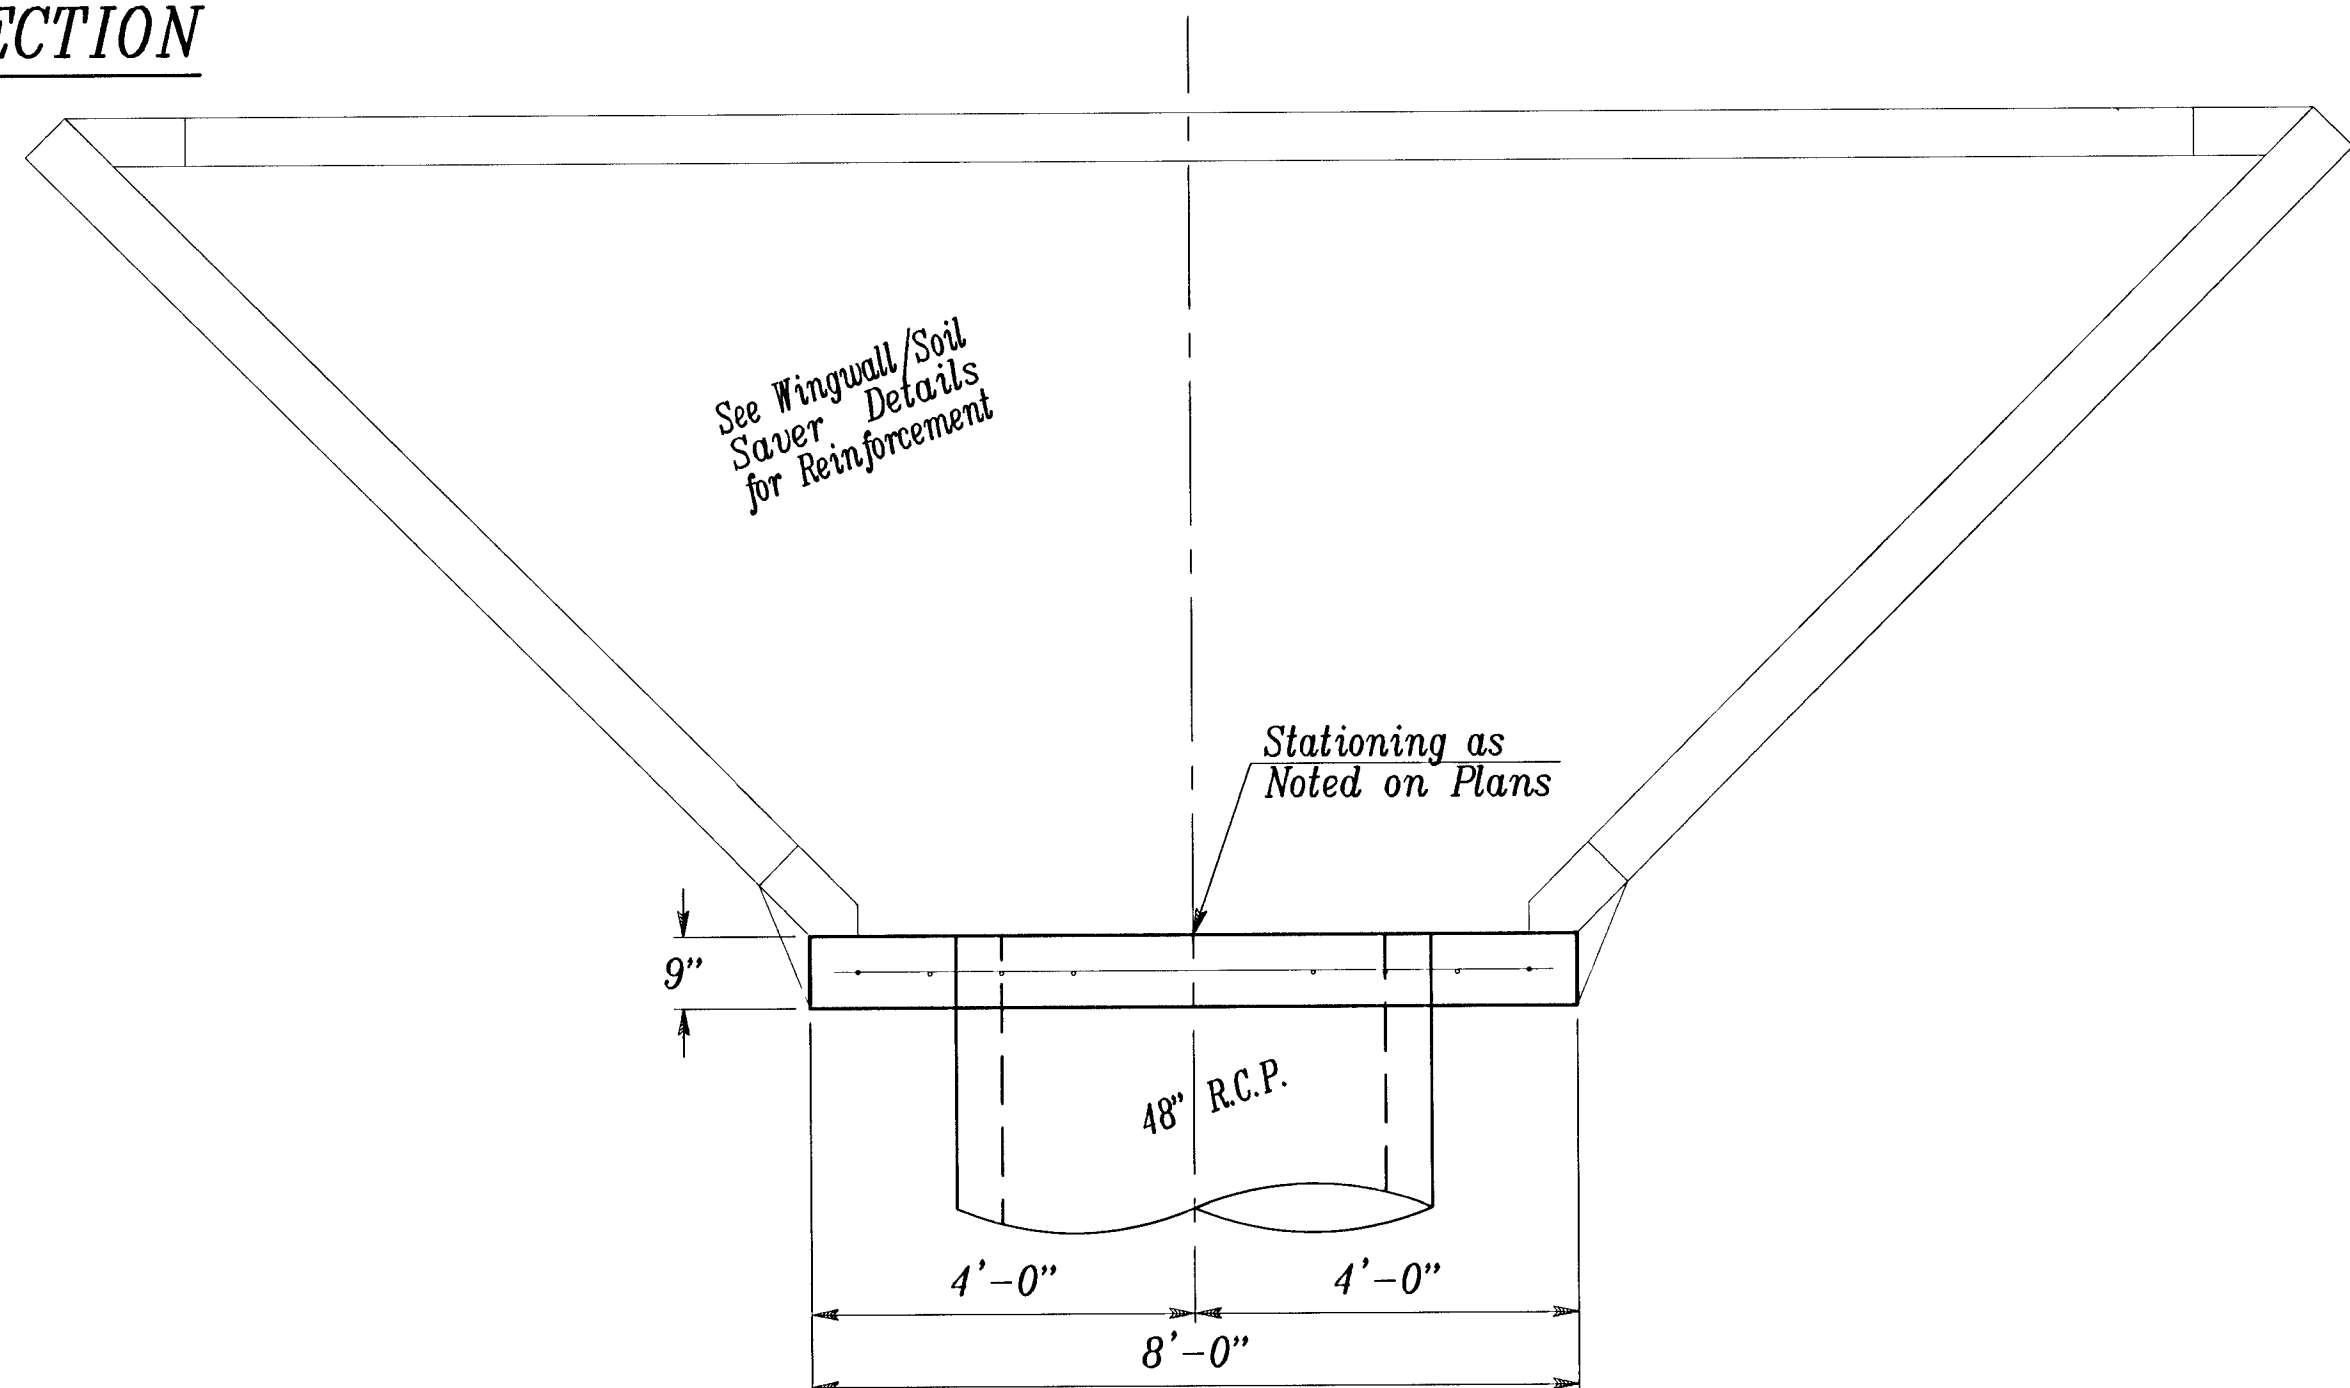

FRONT

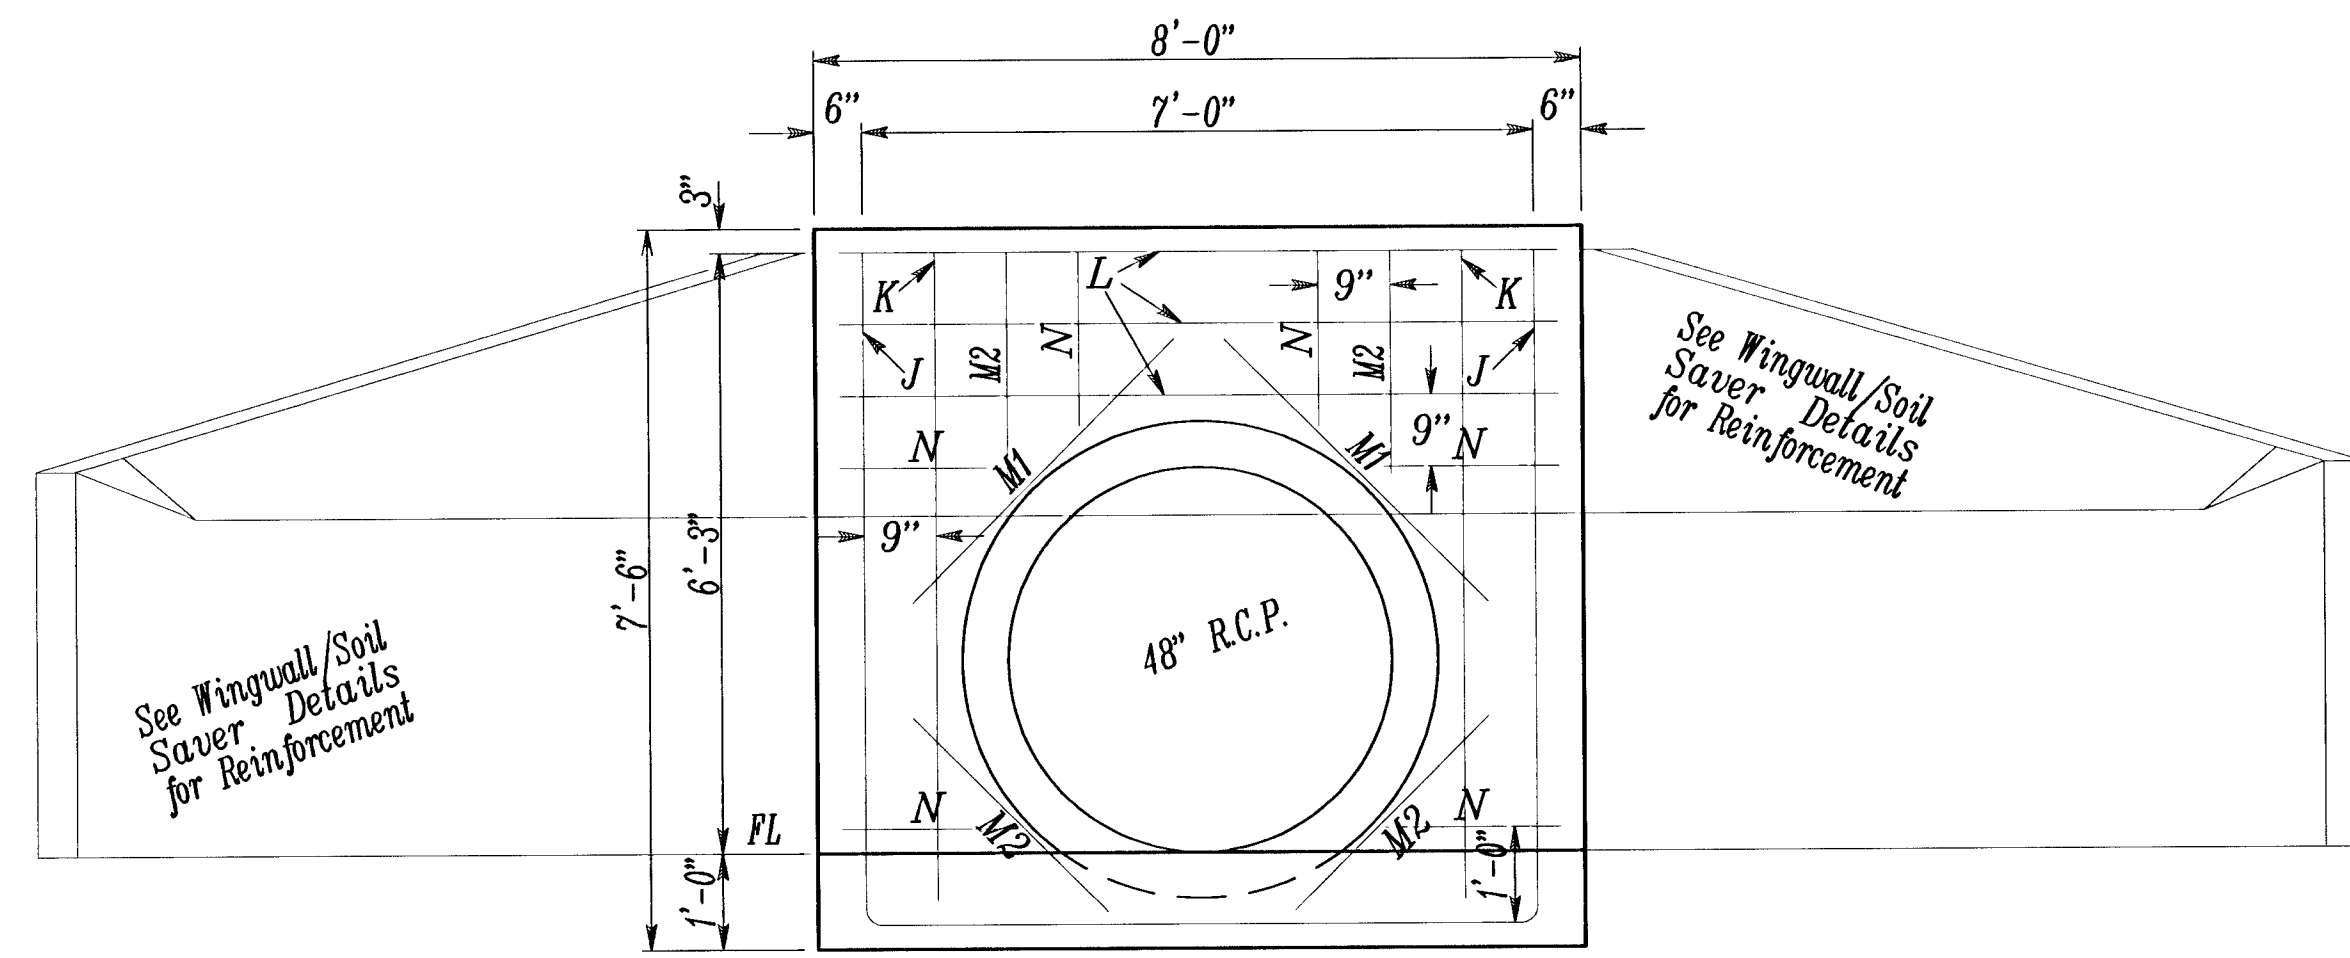

CONCRETE HEADWALL/COLLAR NOTES

CONCRETE: BEVEL ALL EXPOSED EDGES WITH A 3/4" TRIANGULAR MOLDING OR FINISH WITH AN APPROVED EDGING TOOL. CONCRETE SHALL BE AS PER CITY OF WICHITA STANDARD SPECIFICATIONS FOR CONCRETE PAVING MIX EXCEPT THAT IT SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4,000 P.S.I. ALL PIPES SHALL BE FLUSH CUT PRIOR TO BEING CAST INTO THE HEADWALL.

REINFORCING STEEL: ALL DIMENSIONS RELATIVE TO REINFORCING STEEL ARE TO CENTERLINE OF BAR UNLESS OTHERWISE NOTED. ALL CLEARANCES SHALL BE 2" UNLESS OTHERWISE NOTED. ALL REINFORCING STEEL SHALL CONFORM TO A.S.T.M. DESIGNATION A615 GRADE 60 AND SHALL BE EPOXY COATED. ALL HORIZONTAL AND VERTICAL REINFORCING STEEL SHALL BE SPACED 12" CENTER TO CENTER UNLESS OTHERWISE NOTED.


PAYMENT: A DEDUCTION IN CONCRETE QUANTITIES HAS BEEN MADE FOR THE PIPE OPENINGS. THE "2- 42" HEADWALL/COLLAR (REINFORCED CONCRETE) OR "48" HEADWALL/COLLAR (REINFORCED CONCRETE)" SHALL BE PAID FOR AT THE UNIT PRICE BID PER EACH IN PLACE INCLUDING CONCRETE, REINFORCING STEEL, EXCAVATION AND ALL OTHER MISCELLANEOUS MATERIALS, LABOR, TOOLS, EQUIPMENT AND INCIDENTALS NECESSARY TO COMPLETE THE WORK. QUANTITIES SHOWN ARE FOR INFORMATION ONLY.

2-42" HEADWALL/
48" HEADWALL DETAIL

EQUESTRIAN ESTATES - PHASE 1 DRAINAGE IMPROVEMENTS HEADWALL DETAILS CITY OF WICHITA, KANSAS MICHAEL E. LINDEBAK, P.E. - CITY ENGINEER C.O.W. Project # 468-83320 O.C.A. # 751305	No.	Date	By	Approved
	1			
	2			
	3			
POE & ASSOCIATES OF KANSAS, INC. CONSULTING ENGINEERS 5940 E. Central, Suite 200 ■ Wichita, KS 67208-4242 Phone 316/685-4114 ■ FAX 316/685-4444	Designed By: J. Ubert / J. Dickman			
	Drawn By: J. Dickman			
	Poe Job No.: 1694A			
	Date: March 2002			
FINAL	Sheet			
	10 of 20			

C:\APPS\UCR\PROJECTS\BASE-ST.dwg Thu Mar 14 08:00:47 2002 Bernard Kulla - POE & ASSOCIATES OF KANSAS INC.

1-11-11-03

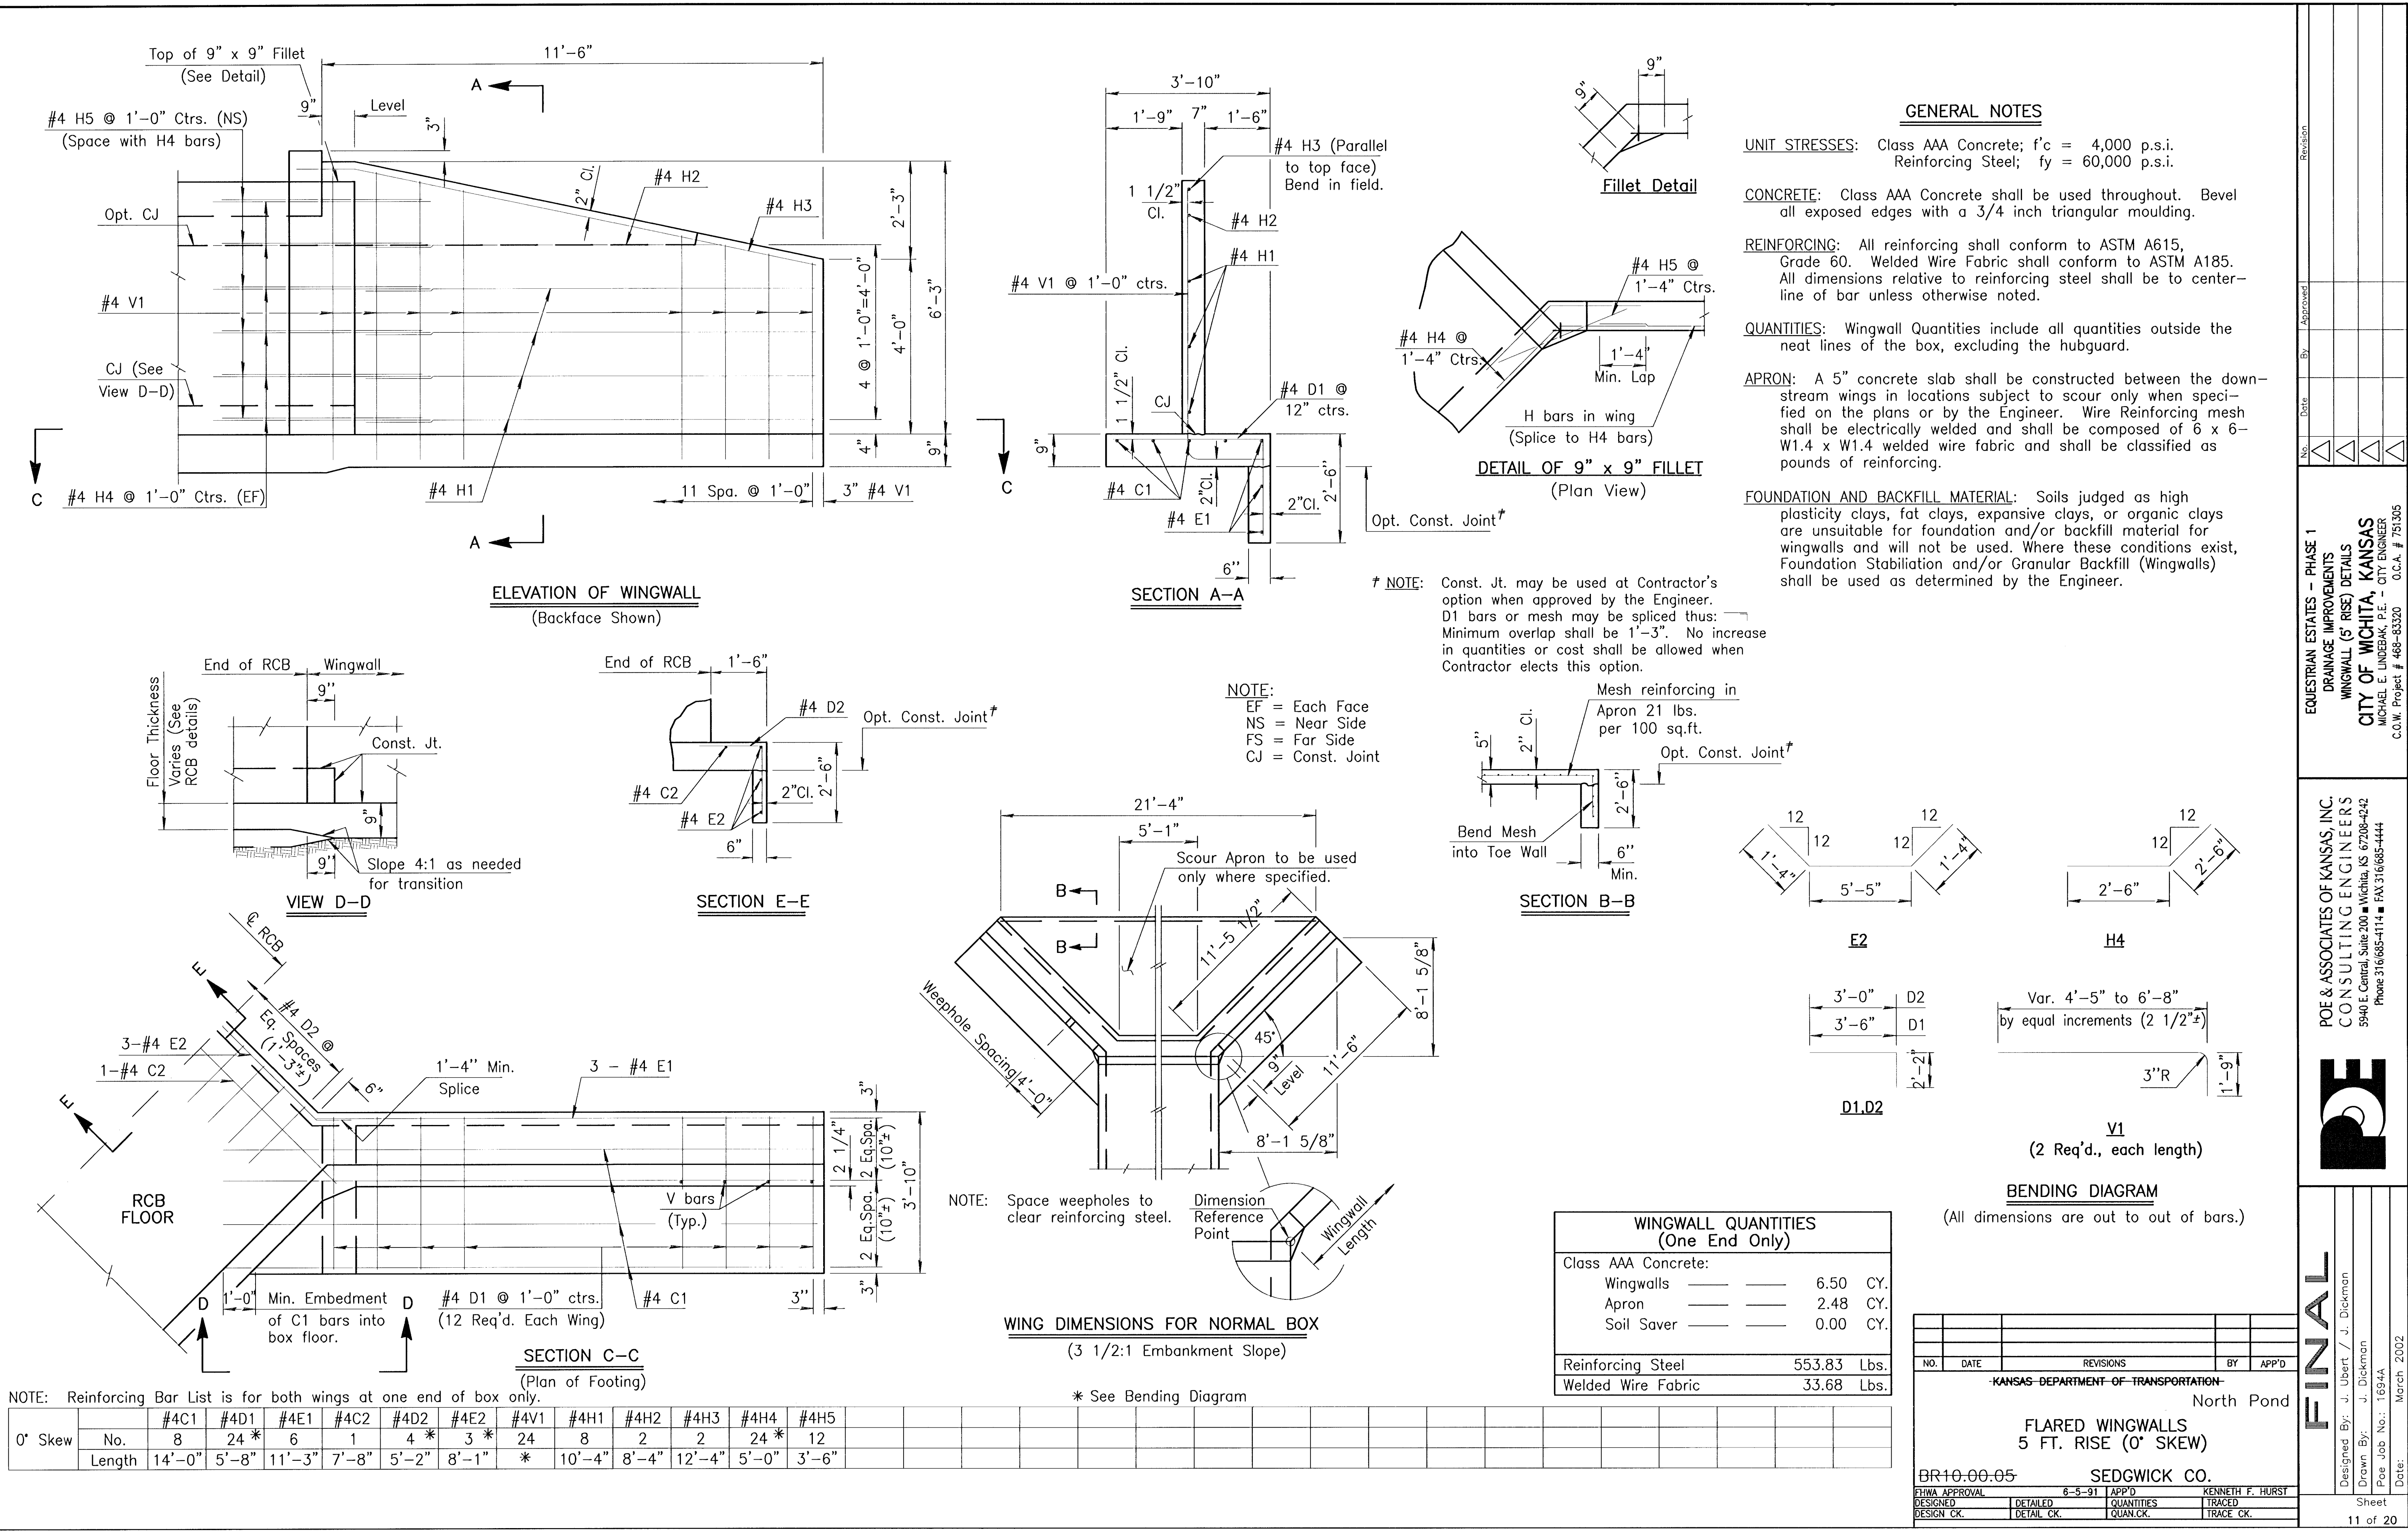

GENERAL NOTES

UNIT STRESSES: Class AAA Concrete; $f'_c = 4,000$ p.s.i.
Reinforcing Steel; $f_y = 60,000$ p.s.i.

CONCRETE: Class AAA Concrete shall be used throughout. Bevel all exposed edges with a 3/4 inch triangular moulding.

REINFORCING: All reinforcing shall conform to ASTM A615, Grade 60. Welded Wire Fabric shall conform to ASTM A185. All dimensions relative to reinforcing steel shall be to center-line of bar unless otherwise noted.

QUANTITIES: Wingwall Quantities include all quantities outside the neat lines of the box, excluding the hubguard.

APRON: A 5" concrete slab shall be constructed between the downstream wings in locations subject to scour only when specified on the plans or by the Engineer. Wire Reinforcing mesh shall be electrically welded and shall be composed of 6 x 6-W1.4 x W1.4 welded wire fabric and shall be classified as pounds of reinforcing.

FOUNDATION AND BACKFILL MATERIAL: Soils judged as high plasticity clays, fat clays, expansive clays, or organic clays are unsuitable for foundation and/or backfill material for wingwalls and will not be used. Where these conditions exist, Foundation Stabilization and/or Granular Backfill (Wingwalls) shall be used as determined by the Engineer.

* NOTE: Const. Jt. may be used at Contractor's option when approved by the Engineer. D1 bars or mesh may be spliced thus: Minimum overlap shall be 1'-3". No increase in quantities or cost shall be allowed when Contractor elects this option.

NOTE:
EF = Each Face
NS = Near Side
FS = Far Side
CJ = Const. Joint

BENDING DIAGRAM

(All dimensions are out to out of bars.)

NO.	DATE	REVISIONS	BY	APP'D

KANSAS DEPARTMENT OF TRANSPORTATION

North Pond

FLARED WINGWALLS
5 FT. RISE (0° SKEW)

BR10-00-05 SEDGWICK CO.

DESIGNED	8-5-91	APP'D	KENNETH F. HURST
DETAIL		QUANTITIES	


Sheet 11 of 20

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
WINGWALL (5' RISE) DETAILS
CITY OF WICHITA, KANSAS
MICHAEL E. UNDERKAMP, P.E. - CITY ENGINEER
C.O.W. Project # 488-8320 O.C.A. # 75305


POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E Central, Suite 200 • Wichita, KS 67208-4242
Phone 316/685-4114 • FAX 316/685-4444

POE

FINAL
Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Poe Job No.: 1694A
Date: March 2002

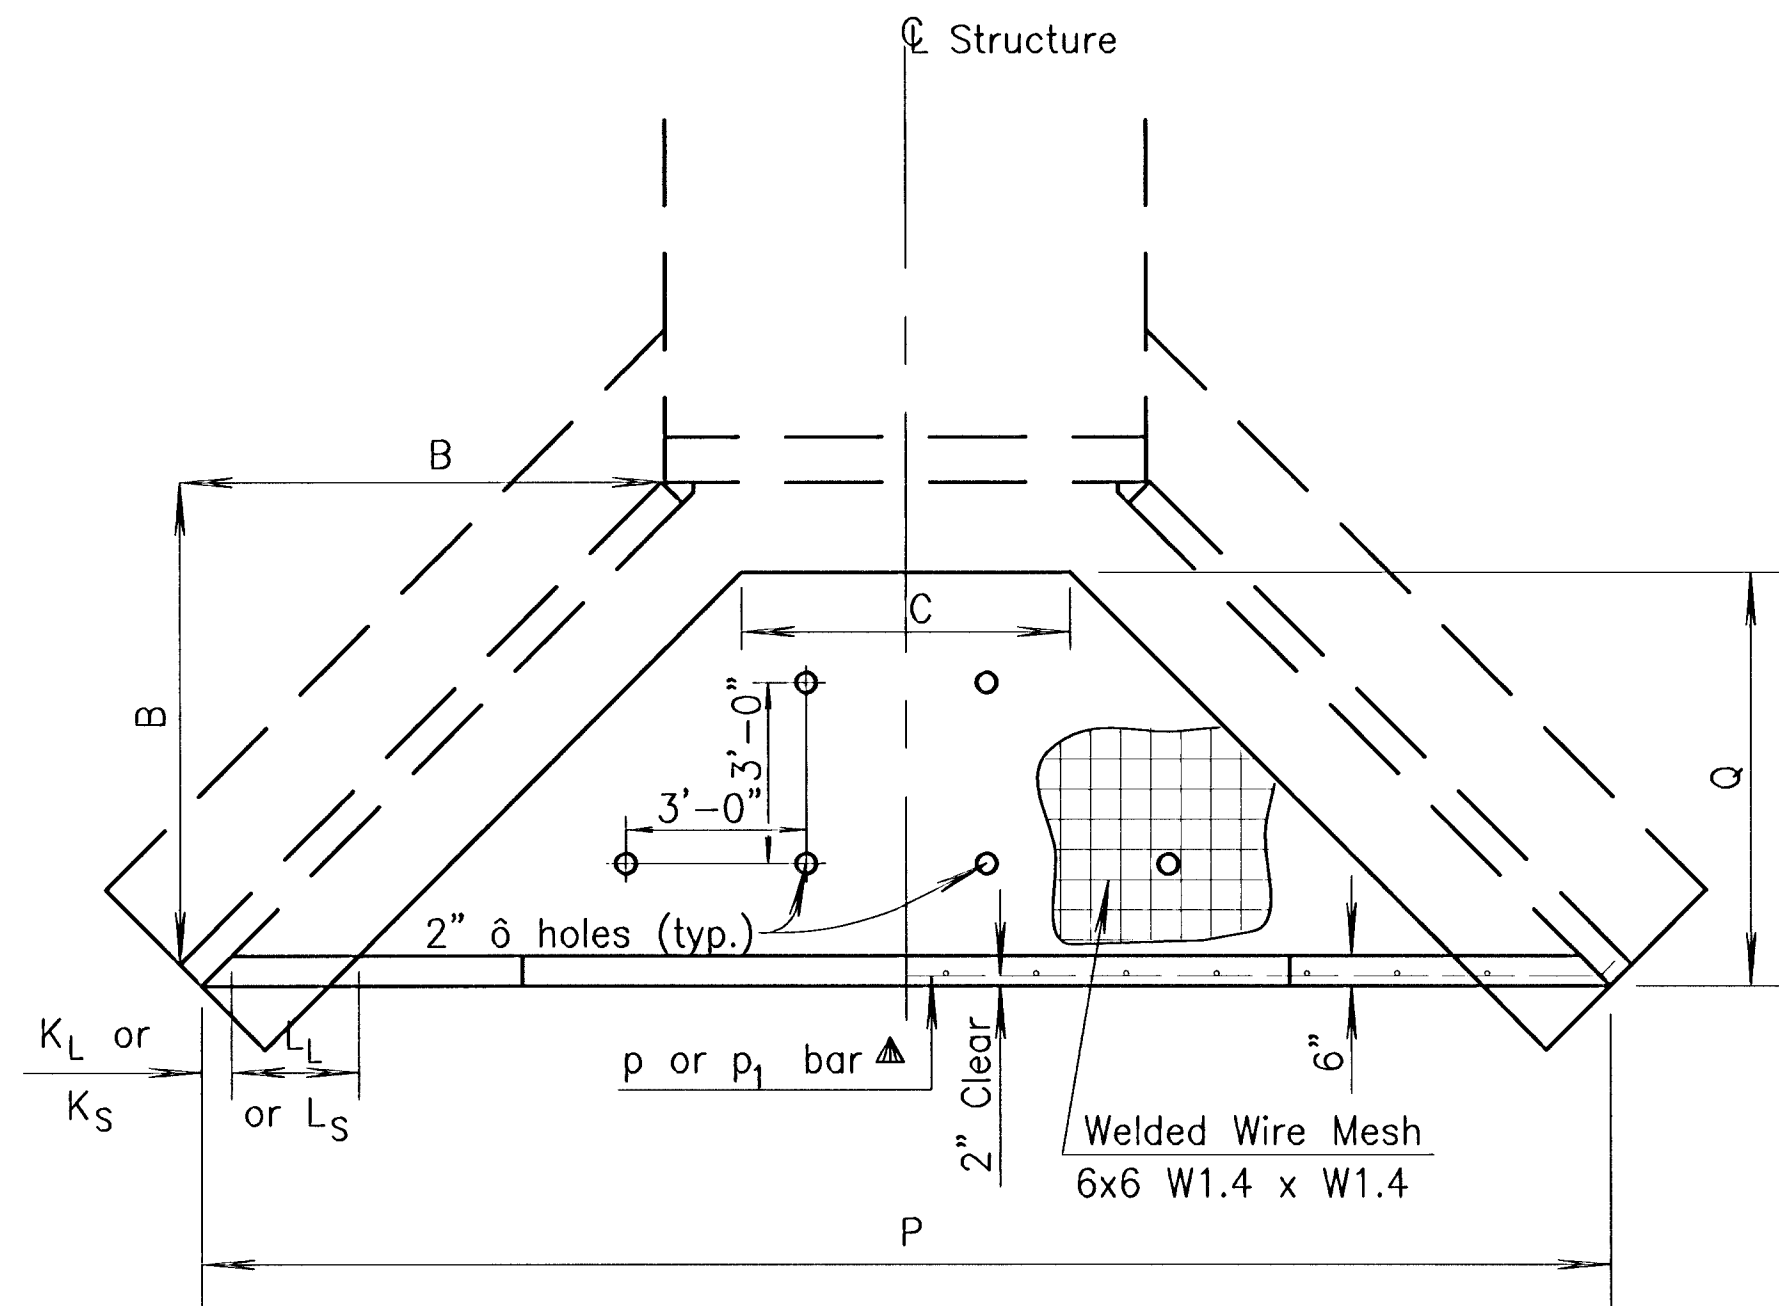

PLAN

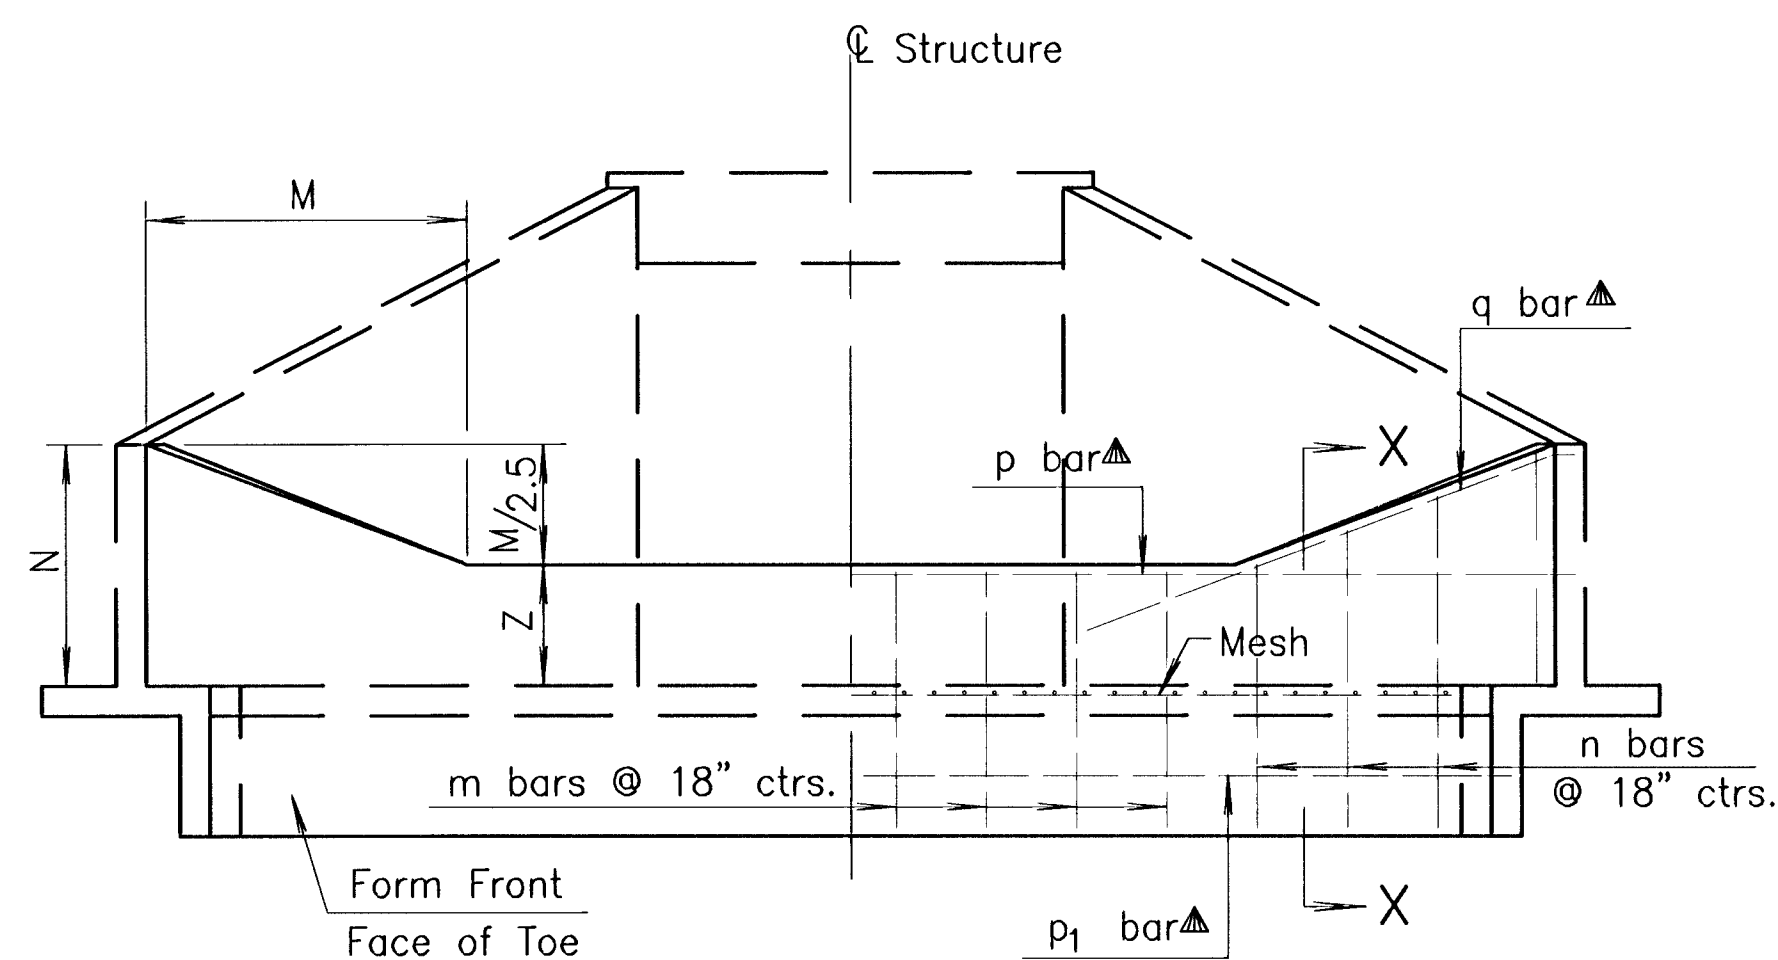


ELEVATION AND SECTION


GENERAL NOTE

CONCRETE: Class AAA Concrete shall be used throughout.
All exposed edges shall be finished with an edging tool.
REINFORCING: All dimensions are to ϕ of bar except where noted. All reinforcing bars are No. 4. Reinforcing bars shall be Grade 60 billet steel. Minimum clearance on all reinforcement shall be 2". Weight of welded wire mesh is 21 lbs. per 100 sq. ft. Mesh shall be paid as pounds of reinforcing steel.
When holes in the apron are warranted by drainage conditions they shall be constructed as directed by the Engineer.

▲ Drill and grout p and q bars into wingwalls and p_1 bar into wing footings when the soil saver end wall is constructed separately from the wingwalls. Drilling and grouting shall be Subsidiary to the bid item "Reinforcing Steel".

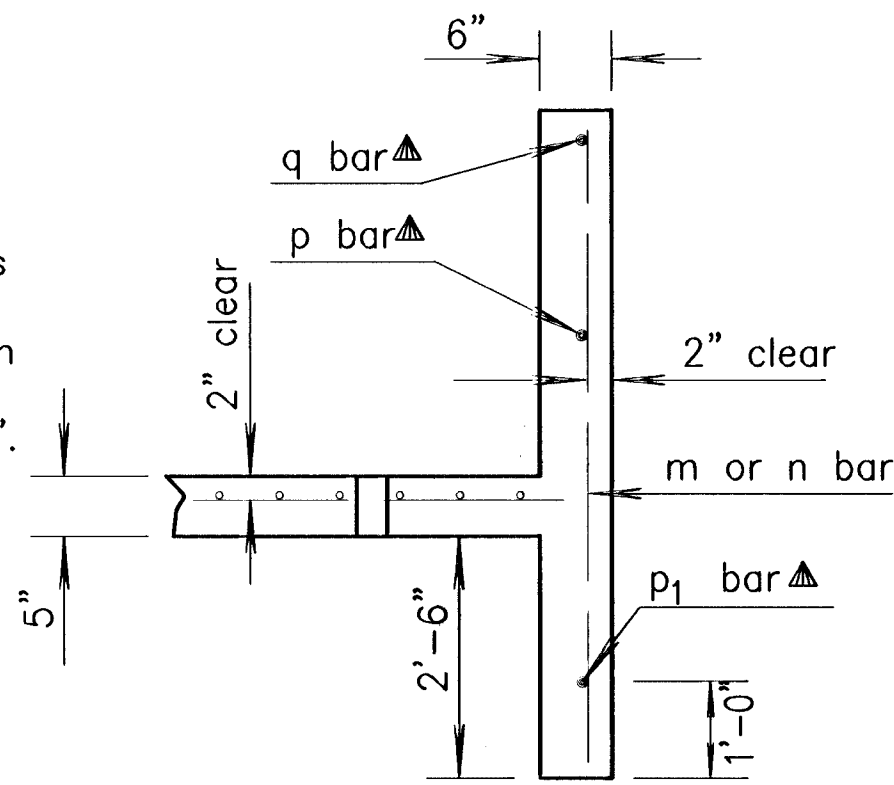

SECTION X-X

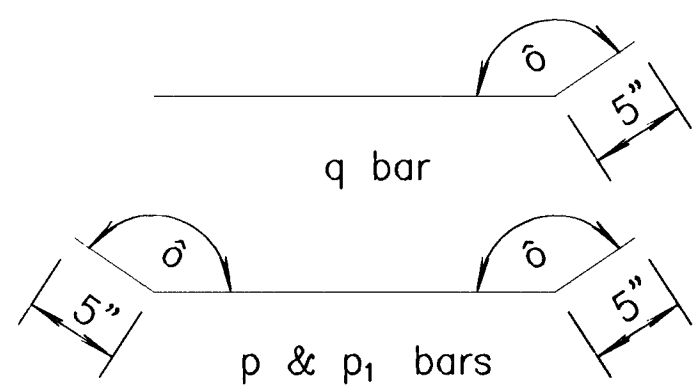

δ Angle varies according to skew of RCB. Bars shall be field bent.

BENDING DIAGRAMS

SUMMARY OF SOIL SAVERS

Station	Culvert Size	Side	Z	Skew

STATION		SIDE										Skew		Z= 3'-6'	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N	4'-0"	P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							

STATION		SIDE										Skew		Z=	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N		P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							


STATION		SIDE										Skew		Z=	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N		P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							

STATION		SIDE										Skew		Z=	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N		P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							

STATION		SIDE										Skew		Z=	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N		P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							


STATION		SIDE										Skew		Z=	
Letter	Dimension	B	C	K_L	K_S	L_L	L_S	M	N		P	P_L	P_S	Q	
Bar	m	n*	p	p_1	q			Sq. Ft. Mesh							Cu.Yd.
Number								Class "AAA" Conc.							Lbs.
Length								Reinf. steel							

2					
1	08-01-00	Revised Drill & Grout Note		R.J.S.	J.O.B.
NO.	DATE	REVISIONS		BY	APP'D
KANSAS DEPARTMENT OF TRANSPORTATION					
SOIL SAVER					
FOR R.C. CULVERTS					
RD520					
FHWA APPROVAL		8-23-00		APP'D. James O. Brewer	
DESIGNED		DETAILED		QUANTITIES	
DESIGN CK.		DETAIL CK.		TRACE CK. Seltz	

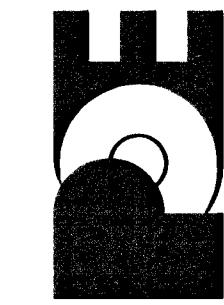

POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central Suite 200 • Wichita, KS 67208-4242
Phone 316/685-4114 • FAX 316/685-4444

Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Pec Job No.: 1894A
Date: March 2002

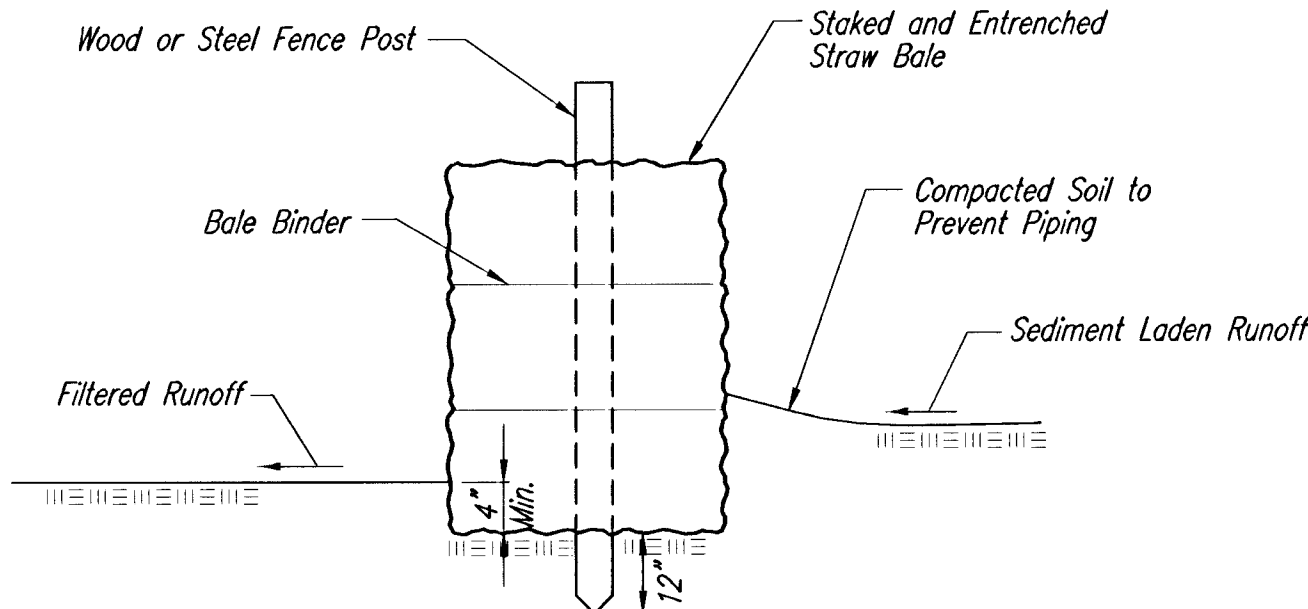

STRAW BALE BARRIERS

Material Specification:

Bale slope barriers may be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long.

Placement:

A slope barrier should be used at the toe of a slope when a ditch does not exist. The slope barrier should be placed on nearly level ground 5' to 10' away from the toe of a slope. The barrier is placed away from the toe of the slope to provide adequate storage for settling out sediment. When practicable, bale slope barriers should be placed along contours to avoid a concentration of flow. Bale slope barriers can also be placed along right-of-way fence lines to keep sediment from crossing onto adjacent property. When placed in this manner, the slope barrier will not likely follow contours.

Proper installation method:

Excavate a trench the length of the planned slope barrier that is 4" deep and a bale's width wide. Make sure that the trench is excavated along a single contour. When practicable, slope barriers should be placed along contours to avoid a concentration of flow. Place the soil on the upslope side of the trench for later use. Place the bales in the trench, making sure that they are butted tightly. Two stakes should be driven through each bale along the centerline of the ditch check, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the upslope side of the check and compact it. The compacted soil should be no more than 3" to 4" deep.

List of common placement/installation mistakes to avoid:


When practicable, do not place bale slope barriers across contours. Slope barriers should be placed along contours to avoid a concentration of flow. Concentrated flow over a slope barrier creates a scour hole on the downslope side of the barrier. The scour hole eventually undermines the bales and the barrier fails. Do not place bale slope barriers in areas with shallow soils underlain by rock. If the barrier is not anchored sufficiently, it will wash out. Bale slope barriers must be dug into the ground. Bales at ground level do not work because they allow water to flow under the barrier.

Inspection and Maintenance:

Bale slope barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Are there any points along the slope barrier where water is concentrating?
- Does water flow under the slope barrier?
- Does water flow through spaces between abutting bales?
- Are any bales dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the slope barrier?

NOTE: Point A must be higher than Point B so that water flows over the bales and not around them.

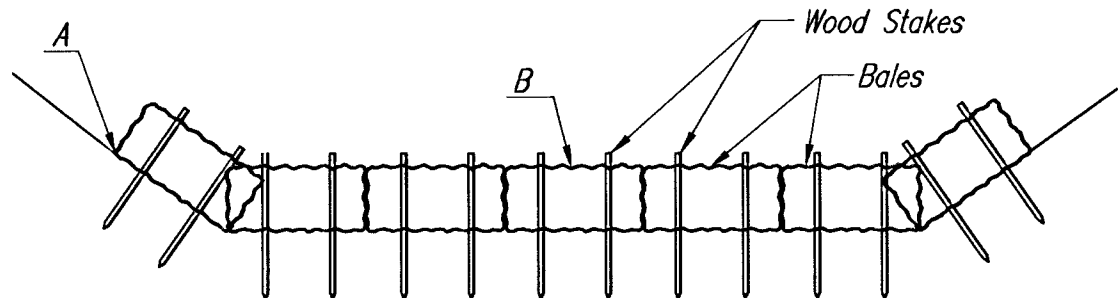

STRAW BALE DITCH CHECKS

Material Specification:

Bale ditch checks may be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Optional: The downstream scour apron should be constructed of a double-netted straw erosion-control blanket at least 6' wide. Optional: The metal landscape staples used to anchor the erosion-control blanket should be at least 8" long.

Placement:

Bale ditch checks should be placed perpendicular to the flowline of the ditch. The ditch check should extend far enough so that the ground level at the ends of the check is higher than the top of the lowest center bale. This prevents water from flowing around the check. Checks should not be placed in ditches where high flows are expected. Rock checks should be used instead. Bales should be placed in ditches with slopes of 6% or less. For slopes steeper than 6%, rock checks should be used. The following table provides check spacing for a given ditch grade:

Ditch grade (%)	Check Spacing (feet)
0.5	200
1.0	200
2.0	100
3.0	65
4.0	50
5.0	40
6.0	30

Proper installation method:

Excavate a trench perpendicular to the ditch flowline that is 4" deep and a bale's width wide. Extend the trench in a straight line along the entire length of the proposed ditch check. Place the soil on the upstream side of the trench—it will be used later. Optional: On the downstream side of the trench, roll out a length of erosion-control blanket (scour apron) equal to the length of the trench. Place the upstream edge of the erosion-control blanket along the bottom upstream edge of the trench. The erosion control blanket should be anchored in the trench with one row of 8" landscape staples placed on 18" centers. The remainder of the erosion-control blanket (the portion that is not lying in the trench) will serve as the downstream scour apron. This section of the blanket should be anchored to the ground with 8" landscape staples placed around the perimeter of the blanket on 18" centers. The remainder of the blanket should be anchored using two evenly spaced rows of 8" landscape staples on 18" centers placed perpendicular to the flowline of the ditch. Place the bales in the trench, making sure that they are butted tightly. Two stakes should be driven through each bale along the centerline of the ditch check, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the upstream side of the check and compact it. The compacted soil should be no more than 3" to 4" deep and extend upstream no more than 24".


List of common placement/installation mistakes to avoid:

Do not place a bale ditch check directly in front of a culvert outlet. It will not stand up to the concentrated flow. Do not place bale ditch checks in ditches that will likely experience high flows. They will not stand up to concentrated flow. Follow prescribed ditch-check spacing guidelines. If spacing guidelines are exceeded, erosion will occur between the ditch checks. Do not allow water to flow around the ditch check. Make sure that the ditch check is long enough so that the ground level at the ends of the check is higher than the top of the lowest center bale. Do not place bale ditch checks in channels with shallow soils underlain by rock. If the check is not anchored sufficiently, it will wash out. Bale ditch checks must be dug into the ground. Bales at ground level do not work because they allow water to flow under the check.


Inspection and Maintenance:

Bale ditch checks should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow around the ditch check?
- Does water flow under the ditch check?
- Does water flow through spaces between abutting bales?
- Are any bales and/or scour aprons (optional) dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the ditch check?

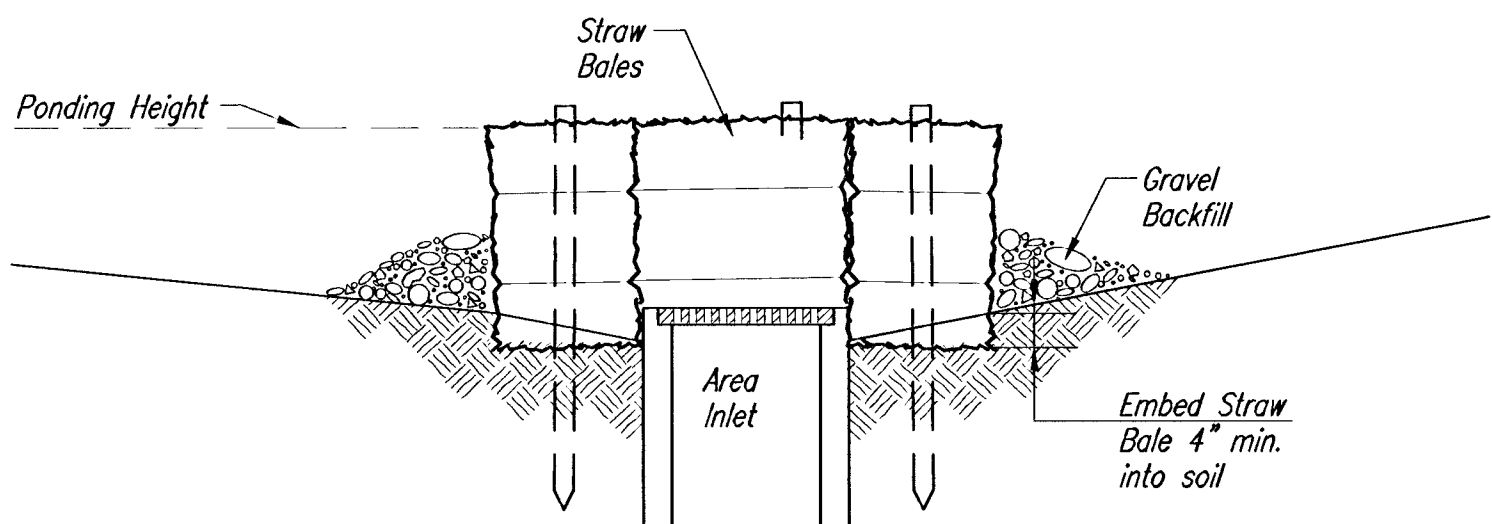

SECTION A-A

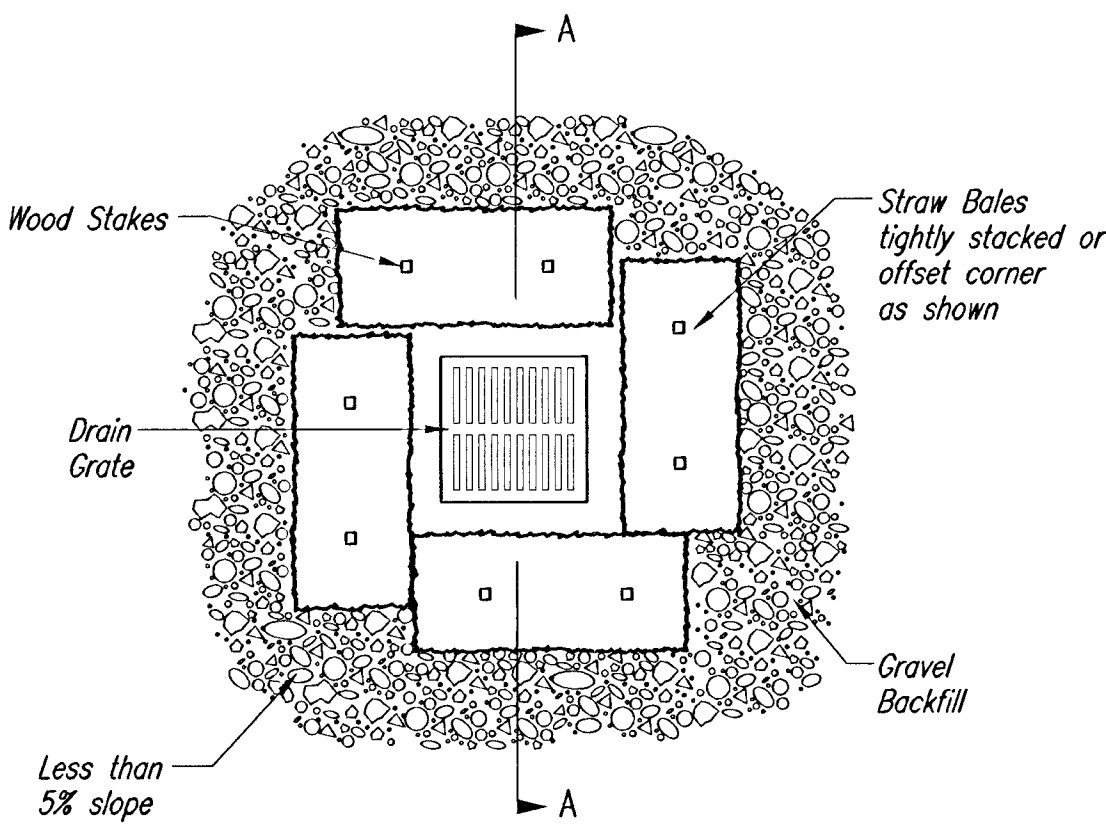

STRAW BALE BARRIERS FOR AREA INLETS
(INLET PROTECTION)

Material Specification:

Bale area inlet barriers should be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long.

Placement:

Bale area inlet barriers should be placed directly around the perimeter of a drop inlet. When a bale area inlet barrier is located near an inlet that has steep approach slopes, the storage capacity behind the barrier is drastically reduced. Timely removal of sediment must occur for a barrier to operate properly in this location.

Proper Installation Method:

Excavate a trench around the perimeter of the area inlet that is at least 4" deep by a bale's width wide. Place the bales in the trench, making sure that they are butted tightly. Some bales may need to be shortened to fit into the trench around the area inlet. Two stakes should be driven through each bale, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the receiving side of the barrier and compact it. The compacted soil should be no more than 3" to 4" deep. Note: When a bale area inlet barrier is placed in a shallow median ditch, make sure that the top of the barrier is not higher than the paved road. In this configuration, water may spread onto the roadway causing a hazardous condition.


List of common placement installation mistakes to avoid:

Bales should be placed directly against the perimeter of the area inlet. This allows overtopping water to flow directly into the inlet instead of onto nearby soil causing scour. Bale area inlet barriers must be dug into the ground. Bales at ground level do not work because they allow water to flow under the barrier.

Inspection and Maintenance:

Bale area inlet barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow under the area inlet barrier?
- Does water flow through spaces between abutting bales?
- Are any bales dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the area inlet barrier?

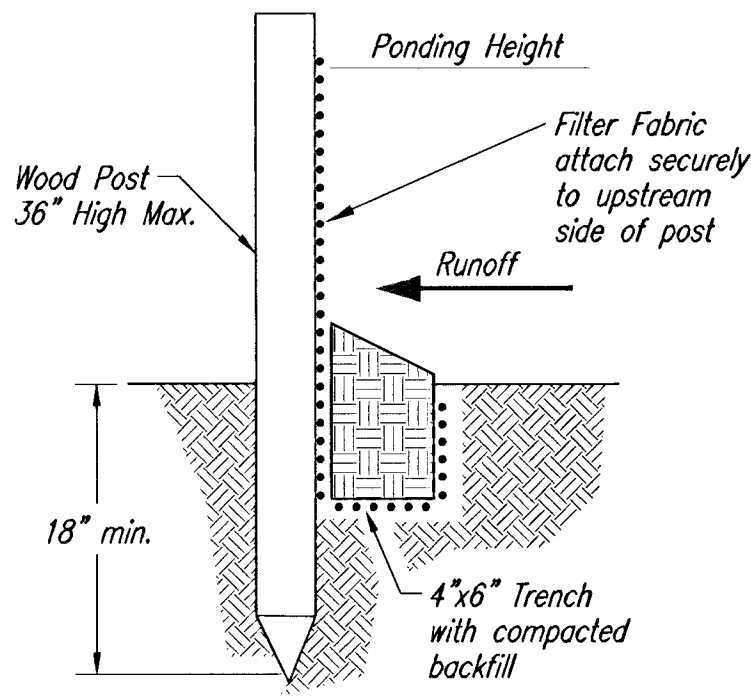

SILT FENCE BARRIERS

SILT FENCE BARRIERS

Material Specification:

Silt fence fabric should conform to the AASHTO M288 96 silt fence specification. The posts used to support the silt fence fabric should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Silt fence fabric should be attached to the wooden posts with staples, wire, zip ties, or nails.

Placement:

A slope barrier should be used at the toe of a slope when a ditch does not exist. The slope barrier should be placed on nearly level ground 5' to 10' away from the toe of a slope. The barrier is placed away from the toe of the slope to provide adequate storage for settling out sediment. When practicable, silt fence slope barriers should be placed along contours to avoid a concentration of flow. Silt fence slope barriers can also be placed along right-of-way fence lines to keep sediment from crossing onto adjacent property. When placed in this manner, the slope barrier will not likely follow contours.

Proper installation method:

Excavate a trench the length of the planned slope barrier that is 6" deep by 4" wide. Make sure that the trench is excavated along a single contour. When practicable, slope barriers should be placed along contours to avoid a concentration of flow. Place the soil on the upslope side of the trench for later use. Roll out a continuous length of silt fence fabric on the downslope side of the trench. Place the edge of the fabric in the trench starting at the top upslope edge. Line all three sides of the trench with the fabric. Backfill over the fabric in the trench with the excavated soil and compact. After filling the trench, approximately 24" to 36" of silt-fence fabric should remain exposed. Lay the exposed silt fence upslope of the trench to clear an area for driving in the posts. Just downslope of the trench, drive posts into the ground to a depth of at least 18". Place posts no more than 4' apart. Attach the silt fence to the anchored post with staples, wire, zip ties, or nails.

List of common placement/installation mistakes to avoid:

When practicable, do not place silt fence slope barriers across contours. Slope barriers should be placed along contours to avoid a concentration of flow. When the flow concentrates, it overtops the barrier and the silt fence slope barrier quickly deteriorates. Do not place silt-fence posts on the upslope side of the silt fence fabric. In this configuration, the force of the water is not restricted by the posts, but only by the staples (wire, zip ties, iails, etc.). The silt fence will rip and fail. Do not place silt fence slope barriers in areas with shallow soils underlain by rock. If the barrier is not sufficiently anchored, it will wash out. Silt fence slope barriers must be dug into the ground—silt fence at ground level does not work because water will flow underneath.

Inspection and Maintenance:

Silt fence slope barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Are there any points along the slope barrier where water is concentrating?
- Does water flow under the slope barrier?
- Do the silt fences sag excessively?
- Has the silt fence torn or become detached from the posts?
- Does sediment need to be removed from behind the slope barrier?




SOIL EROSION
BMP DETAILS

CHRISTOPHER M. CARRIER, P.E.
STORM WATER ENGINEER

PROJECT NUMBER 468-83320 OCA NO. 751305

DATE MAY 2001 SHEET 14 OF 20



POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 • Wichita, KS 67206-4242
Phone 316/685-4174 • FAX 316/685-4444

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
SOIL EROSION BMPs
CITY OF WICHITA, KANSAS
MICHAEL E. LINDBAK, P.E. - CITY ENGINEER
C.O.W. Project # 468-83320 O.C.A. # 751305


FINAL

Designed By: J. J. Libert / J. J. Dickman
Drawn By: J. J. Dickman
Poe Job No.: 1694A
Date: March 2002

Sheet
14 of 20

G:\APPS\UDAV\B94\lot_grading1.dwg Thu Mar 14 06:06:18 2002 Bernard Kulla - POE & ASSOCIATES OF KANSAS, INC.

DATE: 3/02

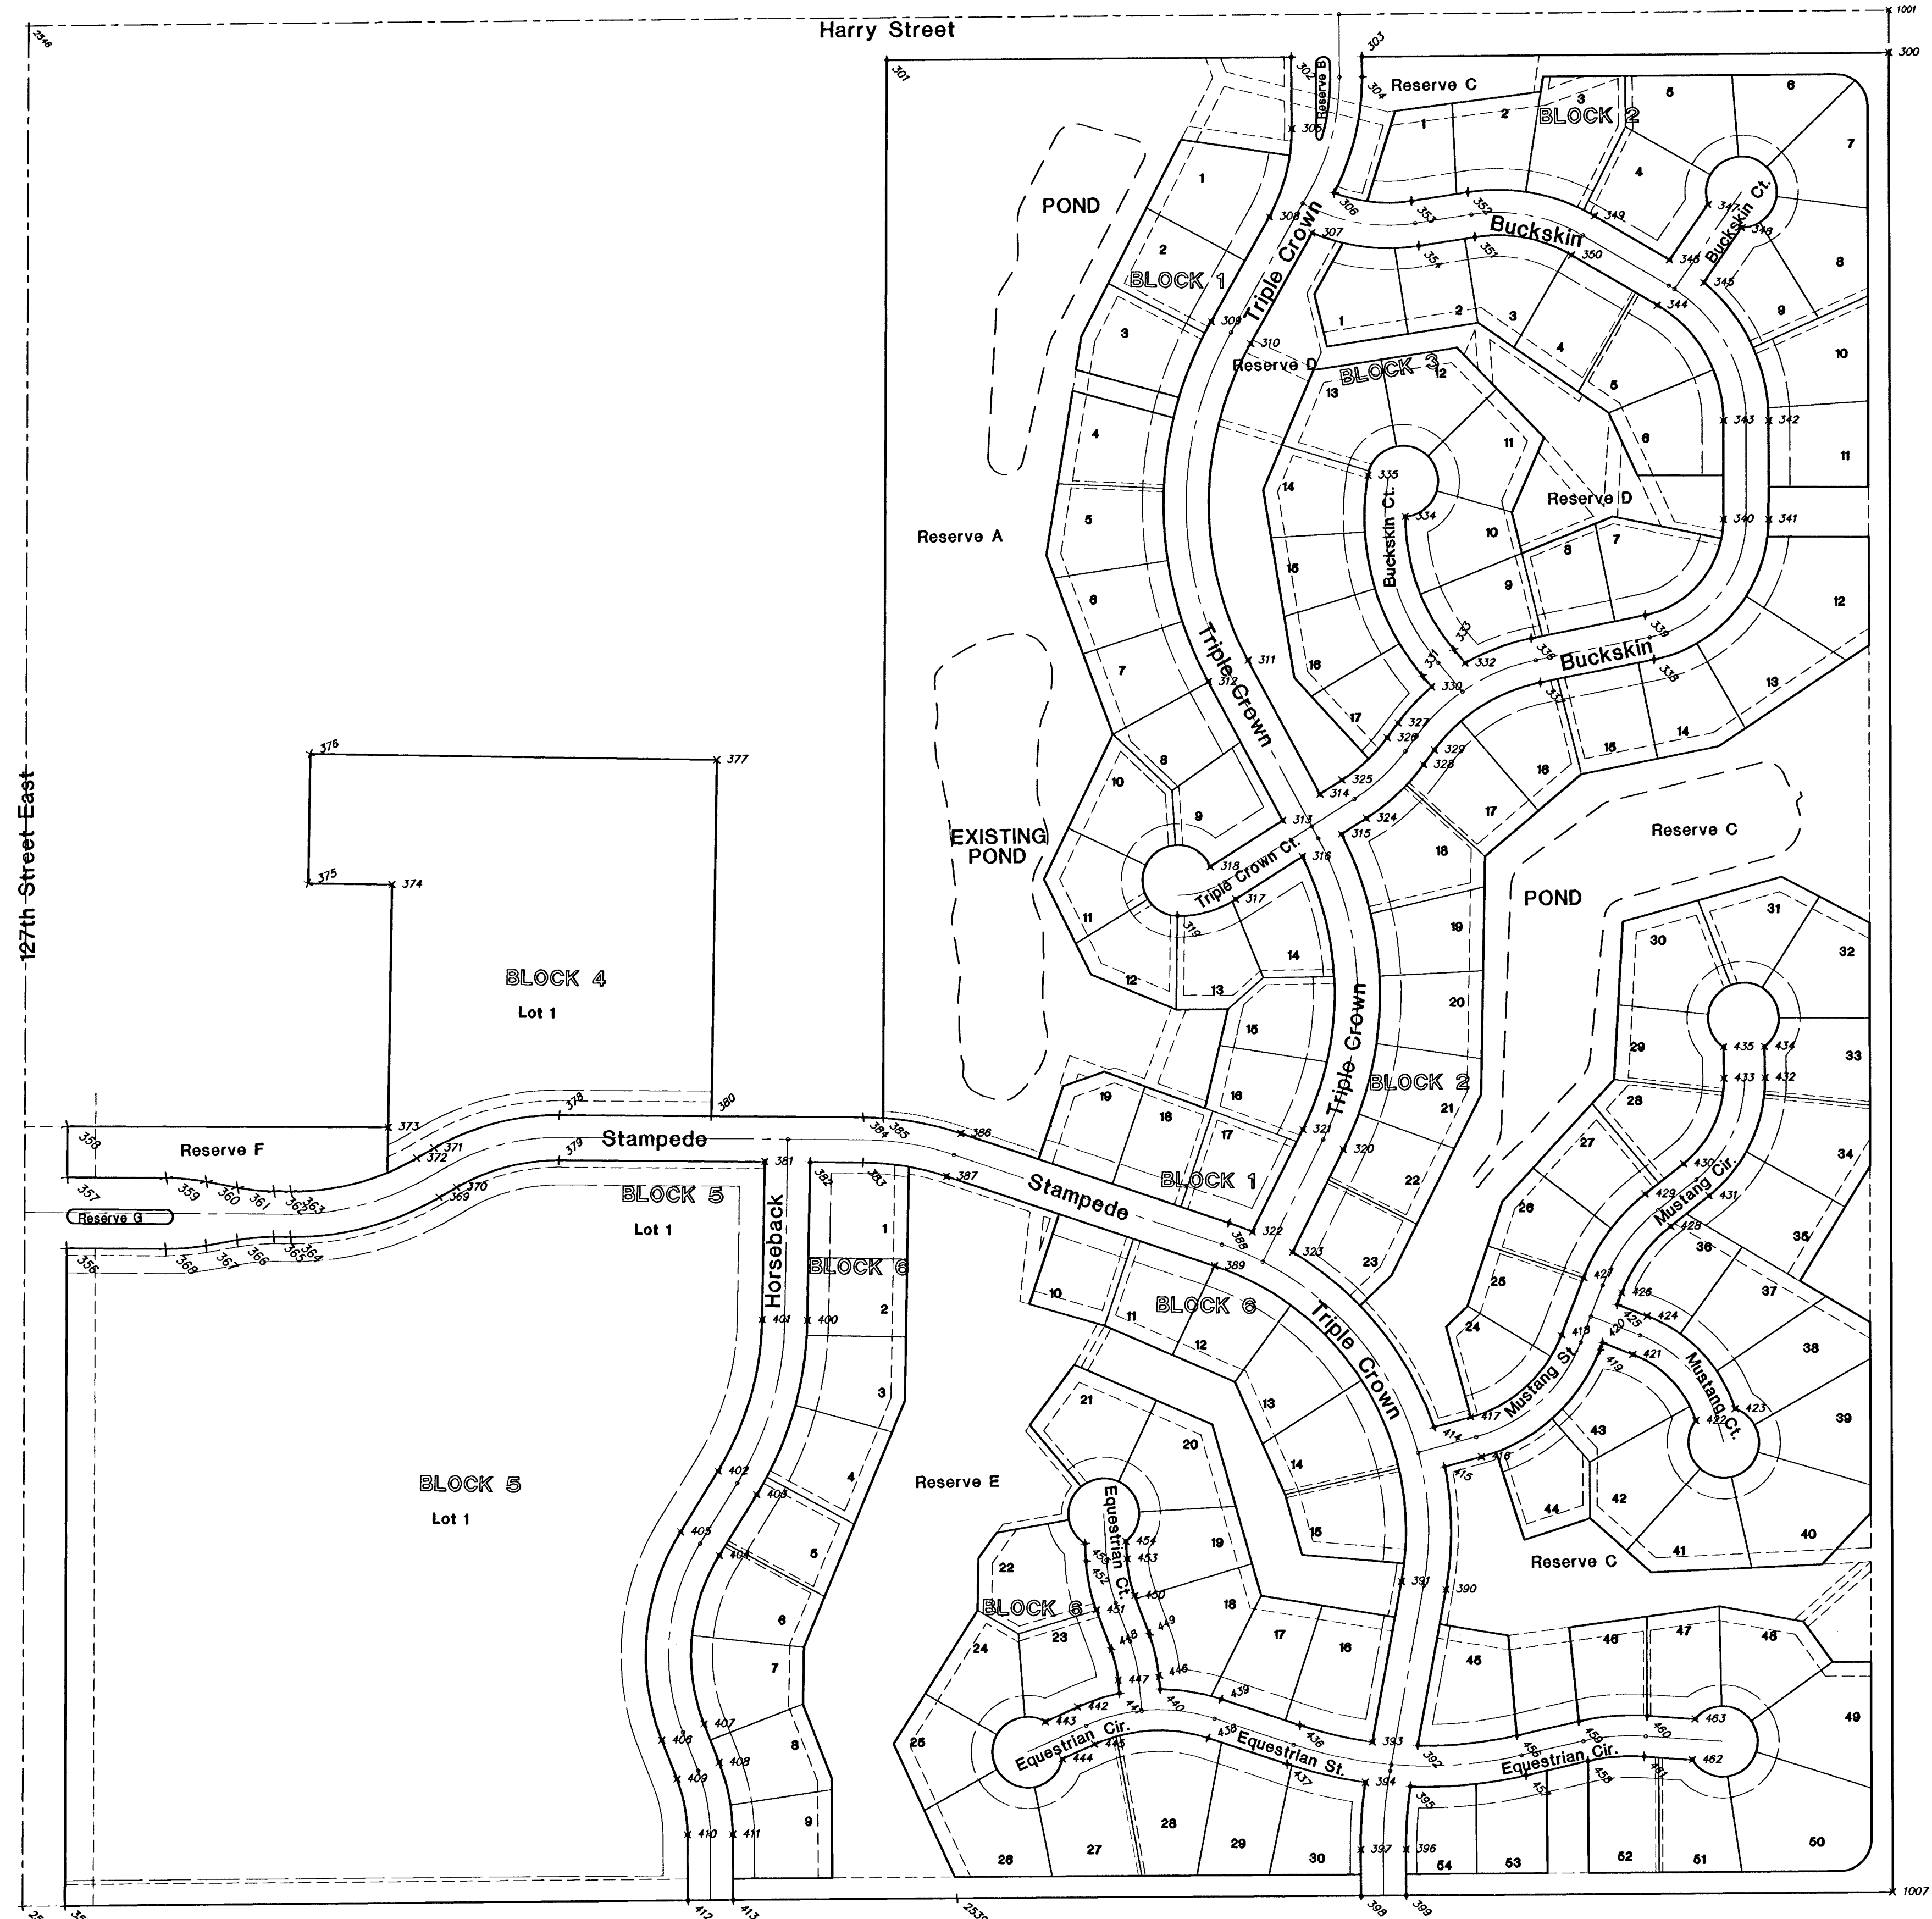


COORDINATE POINTS LIST		
POINT #	NORTING	EASTING
2388	7,835.418	16,816.508
2389	7,870.604	16,888.588
1,087	7,873.548	16,881.844
1,081	16,888.588	16,888.274
2,548	16,817.879	16,888.588
209	16,876.353	16,889.819
201	16,888.588	16,888.268
202	16,876.353	17,414.858
203	16,876.313	17,814.858
204	16,888.588	17,816.319
205	16,888.588	17,416.858
206	16,876.353	17,416.819
207	16,888.588	17,464.188
208	16,888.515	17,888.888
209	8,287.208	17,888.881
210	8,288.588	17,888.888
211	8,418.888	17,888.888
212	8,288.588	17,888.888
213	8,188.515	17,481.418
214	8,388.887	17,464.188
215	8,178.888	17,464.288
216	8,141.811	17,488.787
217	8,081.448	17,884.488
218	8,187.888	17,888.888
219	8,287.208	17,888.887
220	8,187.208	17,488.818
221	8,188.888	17,488.818
222	8,188.888	17,488.818
223	8,188.888	17,488.818
224	8,188.888	17,488.818
225	8,188.888	17,488.818
226	8,188.888	17,488.818
227	8,188.888	17,488.818
228	8,188.888	17,488.818
229	8,188.888	17,488.818
230	8,188.888	17,488.818
231	8,188.888	17,488.818
232	8,188.888	17,488.818
233	8,188.888	17,488.818
234	8,188.888	17,488.818
235	8,188.888	17,488.818
236	8,188.888	17,488.818
237	8,188.888	17,488.818
238	8,188.888	17,488.818
239	8,188.888	17,488.818
240	8,188.888	17,488.818
241	8,188.888	17,488.818
242	8,188.888	17,488.818
243	8,188.888	17,488.818
244	8,188.888	17,488.818
245	8,188.888	17,488.818
246	8,188.888	17,488.818
247	8,188.888	17,488.818
248	8,188.888	17,488.818
249	8,188.888	17,488.818
250	8,188.888	17,488.818
251	8,188.888	17,488.818
252	8,188.888	17,488.818
253	8,188.888	17,488.818
254	8,188.888	17,488.818
255	8,188.888	17,488.818
256	8,188.888	17,488.818
257	8,188.888	17,488.818
258	8,188.888	17,488.818
259	8,188.888	17,488.818
260	8,188.888	17,488.818
261	8,188.888	17,488.818
262	8,188.888	17,488.818
263	8,188.888	17,488.818
264	8,188.888	17,488.818
265	8,188.888	17,488.818
266	8,188.888	17,488.818
267	8,188.888	17,488.818
268	8,188.888	17,488.818
269	8,188.888	17,488.818
270	8,188.888	17,488.818
271	8,188.888	17,488.818
272	8,188.888	17,488.818
273	8,188.888	17,488.818
274	8,188.888	17,488.818
275	8,188.888	17,488.818
276	8,188.888	17,488.818
277	8,188.888	17,488.818
278	8,188.888	17,488.818
279	8,188.888	17,488.818

COORDINATE POINTS LIST		
POINT #	NORTING	EASTING
280	8,178.881	16,888.604
281	8,171.881	16,887.718
282	8,178.888	16,881.714
283	8,178.888	16,888.784
284	8,178.881	16,887.874
285	8,178.881	16,888.888
286	8,178.881	16,888.668
287	8,188.108	16,888.174
288	8,284.888	17,884.888
289	8,288.888	17,884.818
290	8,188.178	17,888.887
291	8,117.728	17,887.714
292	7,888.884	17,888.888
293	7,881.818	17,888.184
294	7,888.884	17,818.818
295	7,888.888	17,888.888
296	7,888.888	17,888.888
297	7,888.888	17,888.888
298	7,888.888	17,888.888
299	7,888.888	17,888.888
300	7,888.888	17,888.888
301	7,888.888	17,888.888
302	7,888.888	17,888.888
303	7,888.888	17,888.888
304	7,888.888	17,888.888
305	7,888.888	17,888.888
306	7,888.888	17,888.888
307	7,888.888	17,888.888
308	7,888.888	17,888.888
309	7,888.888	17,888.888
310	7,888.888	17,888.888
311	7,888.888	17,888.888
312	7,888.888	17,888.888
313	7,888.888	17,888.888
314	7,888.888	17,888.888
315	7,888.888	17,888.888
316	7,888.888	17,888.888
317	7,888.888	17,888.888
318	7,888.888	17,888.888
319	7,888.888	17,888.888
320	7,888.888	17,888.888
321	7,888.888	17,888.888
322	7,888.888	17,888.888
323	7,888.888	17,888.888
324	7,888.888	17,888.888
325	7,888.888	17,888.888
326	7,888.888	17,888.888
327	7,888.888	17,888.888
328	7,888.888	17,888.888
329	7,888.888	17,888.888
330	7,888.888	17,888.888
331	7,888.888	17,888.888
332	7,888.888	17,888.888
333	7,888.888	17,888.888
334	7,888.888	17,888.888
335	7,888.888	17,888.888
336	7,888.888	17,888.888
337	7,888.888	17,888.888
338	7,888.888	17,888.888
339	7,888.888	17,888.888
340	7,888.888	17,888.888
341	7,888.888	17,888.888
342	7,888.888	17,888.888
343	7,888.888	17,888.888
344	7,888.888	17,888.888
345	7,888.888	17,888.888
346	7,888.888	17,888.888
347	7,888.888	17,888.888
348	7,888.888	17,888.888
349	7,888.888	17,888.888
350	7,888.888	17,888.888
351	7,888.888	17,888.888
352	7,888.888	17,888.888
353	7,888.888	17,888.888
354	7,888.888	17,888.888
355	7,888.888	17,888.888
356	7,888.888	17,888.888
357	7,888.888	17,888.888
358	7,888.888	17,888.888
359	7,888.888	17,888.888
360	7,888.888	17,888.888
361	7,888.888	17,888.888
362	7,888.888	17,888.888
363	7,888.888	17,888.888
364	7,888.888	17,888.888
365	7,888.888	17,888.888
366	7,888.888	17,888.888
367	7,888.888	17,888.888
368	7,888.888	17,888.888
369	7,888.888	17,888.888
370	7,888.888	17,888.888
371	7,888.888	17,888.888
372	7,888.888	17,888.888
373	7,888.888	17,888.888
374	7,888.888	17,888.888
375	7,888.888	17,888.888
376	7,888.888	17,888.888
377	7,888.888	17,888.888
378	7,888.888	17,888.888
379	7,888.888	17,888.888
380	7,888.888	17,888.888
381	7,888.888	17,888.888
382	7,888.888	17,888.888
383	7,888.888	17,888.888
384	7,888.888	17,888.888
385	7,888.888	17,888.888
386	7,888.888	17,888.888
387	7,888.888	17,888.888
388	7,888.888	17,888.888
389	7,888.888	17,888.888
390	7,888.888	17,888.888
391	7,888.888	17,888.888
392	7,888.888	17,888.888
393	7,888.888	17,888.888
394	7,888.888	17,888.888
395	7,888.888	17,888.888
396	7,888.888	17,888.888
397	7,888.888	17,888.888
398	7,888.888	17,888.888
399	7,888.888	17,888.888
400	7,888.888	17,888.888
401	7,888.888	17,888.888
402	7,888.888	17,888.888
403	7,888.888	17,888.888
404	7,888.888	17,888.888
405	7,888.888	17,888.888
406	7,888.888	17,888.888
407	7,888.888	17,888.888
408	7,888.888	17,888.888
409	7,888.888	17,888.888
410	7,888.888	17,888.888
411	7,888.888	17,888.888
412	7,888.888	17,888.888
413	7,888.888	17,888.888
414	7,888.888	17,888.888
415	7,888.888	17,888.888
416	7,888.888	17,888.888
417	7,888.888	17,888.888
418	7,888.888	17,888.888
419	7,888.888	17,888.888
420	7,888.888	17,888.888
421	7,888.888	17,888.888
422	7,888.888	17,888.888
423	7,888.888	17,888.888
424	7,888.888	17,888.888
425	7,888.888	17,888.888
426	7,888.888	17,888.888
427	7,888.888	17,888.888
428	7,888.888	17,888.888
429	7,888.888	17,888.888
430	7,888.888	17,888.888
431	7,888.888	17,888.888
432	7,888.888	17,888.888
433	7,888.888	17,888.888
434	7,888.888	17,888.888
435	7,888.888	17,888.888
436	7,888.888	17,888.888
437	7,888.888	17,888.888
438	7,888.888	17,888.888
439	7,888.888	17,888.888
440	7,888.888	17,888.888
441	7,888.888	17,888.888
442	7,888.888	17,888.888
443	7,888.888	17,888.888
444	7,888.888	17,888.888
445	7,888.888	17,888.888
446	7,888.888	17,888.888
447	7,888.888	17,888.888
448	7,888.888	17,888.888
449	7,888.888	17,888.888
450	7,888.888	17,888.888
451	7,888.888	17,888.888
452	7,888.888	17,888.888
453	7,888.888	17,888.888
454	7,888.888	17,888.888
455	7,888.888	17,888.888
456	7,888.888	17,888.888
457	7,888.888	17,888.888
458	7,888.888	17,888.888
459	7,888.888	17,888.888
460	7,888.888	17,888.888
461	7,888.888	17,888.888
462	7,888.888	17,888.888
463	7,888.888	17,888.888
464	7,888.888	17,888.888
465	7,888.888	17,888.888
466	7,888.888	17,888.888
467	7,888.888	17,888.888
468	7,888.888	17,888.888
469	7,888.888	17,888.888
470	7,888.888	17,888.888
471	7,888.888	17,888.888
472	7,888.888	17,888.888
473	7,888.888	17,888.888
474	7,888.888	17,888.888
475	7,888.888	17,888.888
476	7,888.888	17,888.888
477	7,888.888	17,888.888
478	7,888.888	17,888.888
479	7,888.888	17,888.888
480	7,888.888	17,888.888
481	7,888.888	17,888.888
482	7,888.888	17,888.888
483	7,888.888	17,888.888
484	7,888.888	17,888.888

Scale 1" = 100'

127th Street East

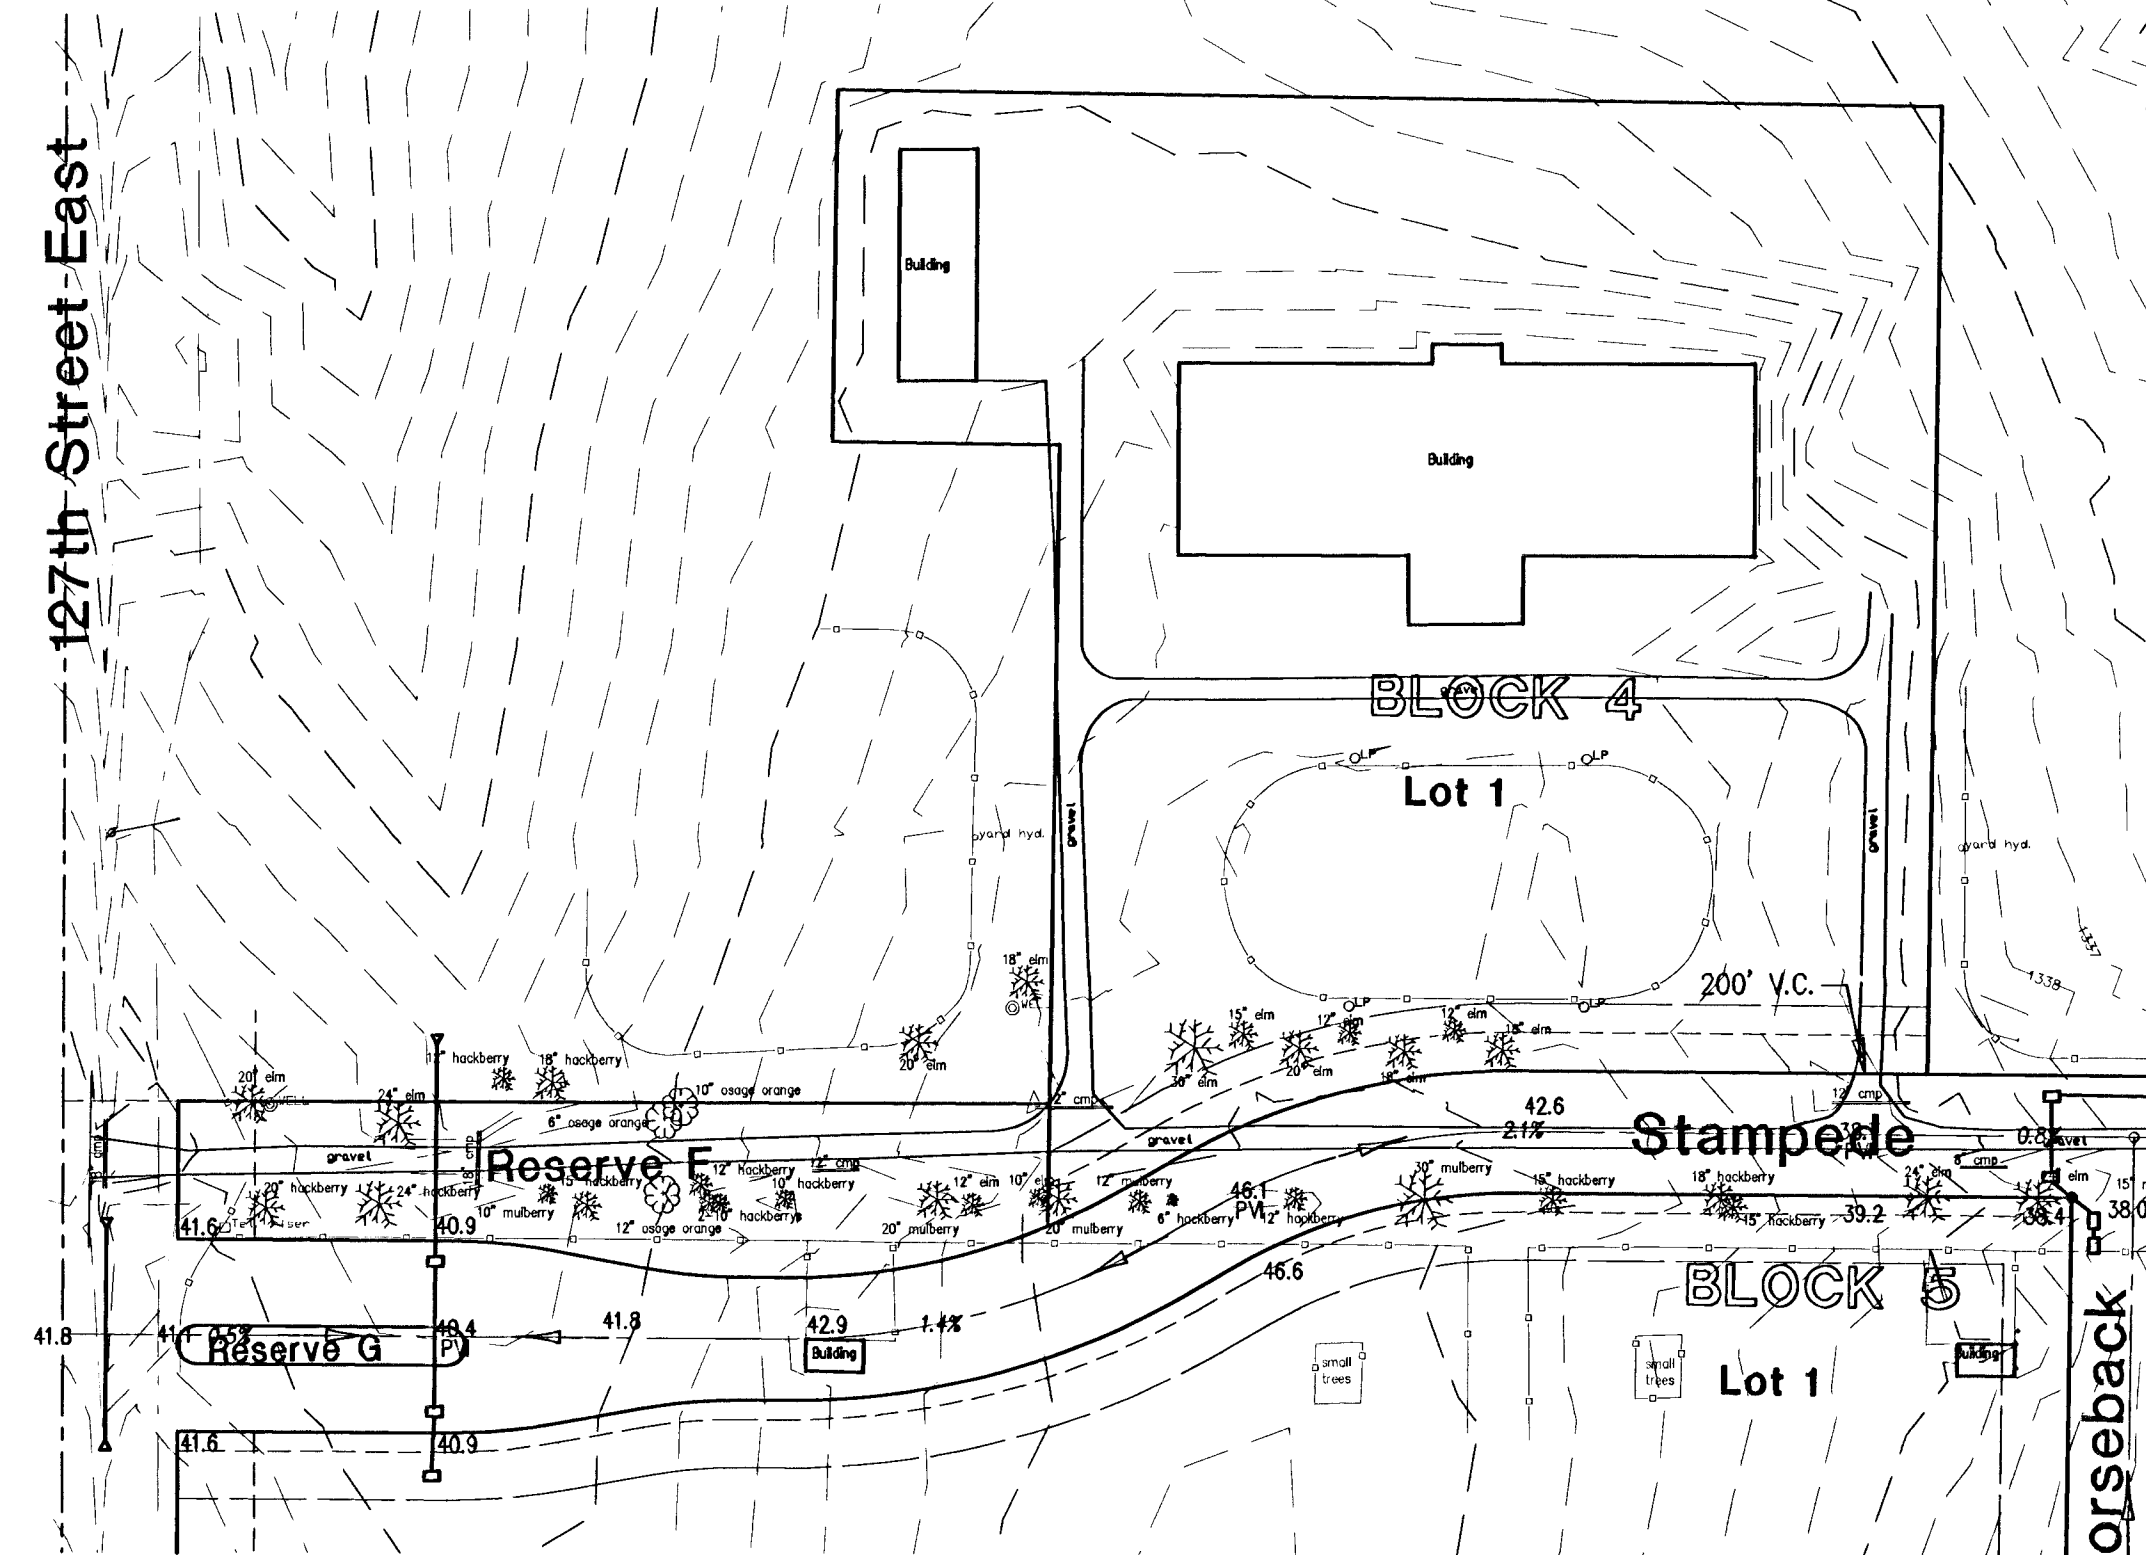

LEGEND

20.9 = Proposed Elevation at Lot Corner

X 3300 = Coordinate Point for Waste Areas

→ = Direction of Flow

■ = Waste area (To Elevations Shown)


NOTES:

- Contractor shall grade all right-of-way areas according to elevations shown. (Cost subsidiary to Site Clearing/Restoration.)
- Contractor shall waste earthwork in shaded areas. (Cost subsidiary to Site Clearing/Restoration.)

WASTE AREAS	WASTE VOLUMES
BLOCK 1 LOT 1-2	950
BLOCK 1 LOT 3	740
BLOCK 1 LOT 4-9	3,210
BLOCK 1 LOT 10-12	500
BLOCK 1 LOT 13-14	360
BLOCK 1 LOT 15-16	3,120
BLOCK 1 LOT 17	1,060
BLOCK 1 LOT 18-19	220
BLOCK 2 LOT 1-3	1,160
BLOCK 2 LOT 4-9	9,140
BLOCK 2 LOT 10-11	1,440
BLOCK 2 LOT 12-14	2,910
BLOCK 2 LOT 16-18	550
BLOCK 2 LOT 19-23	10,710
TOTALS	36,070

Scale 1" = 100'


Harry Street

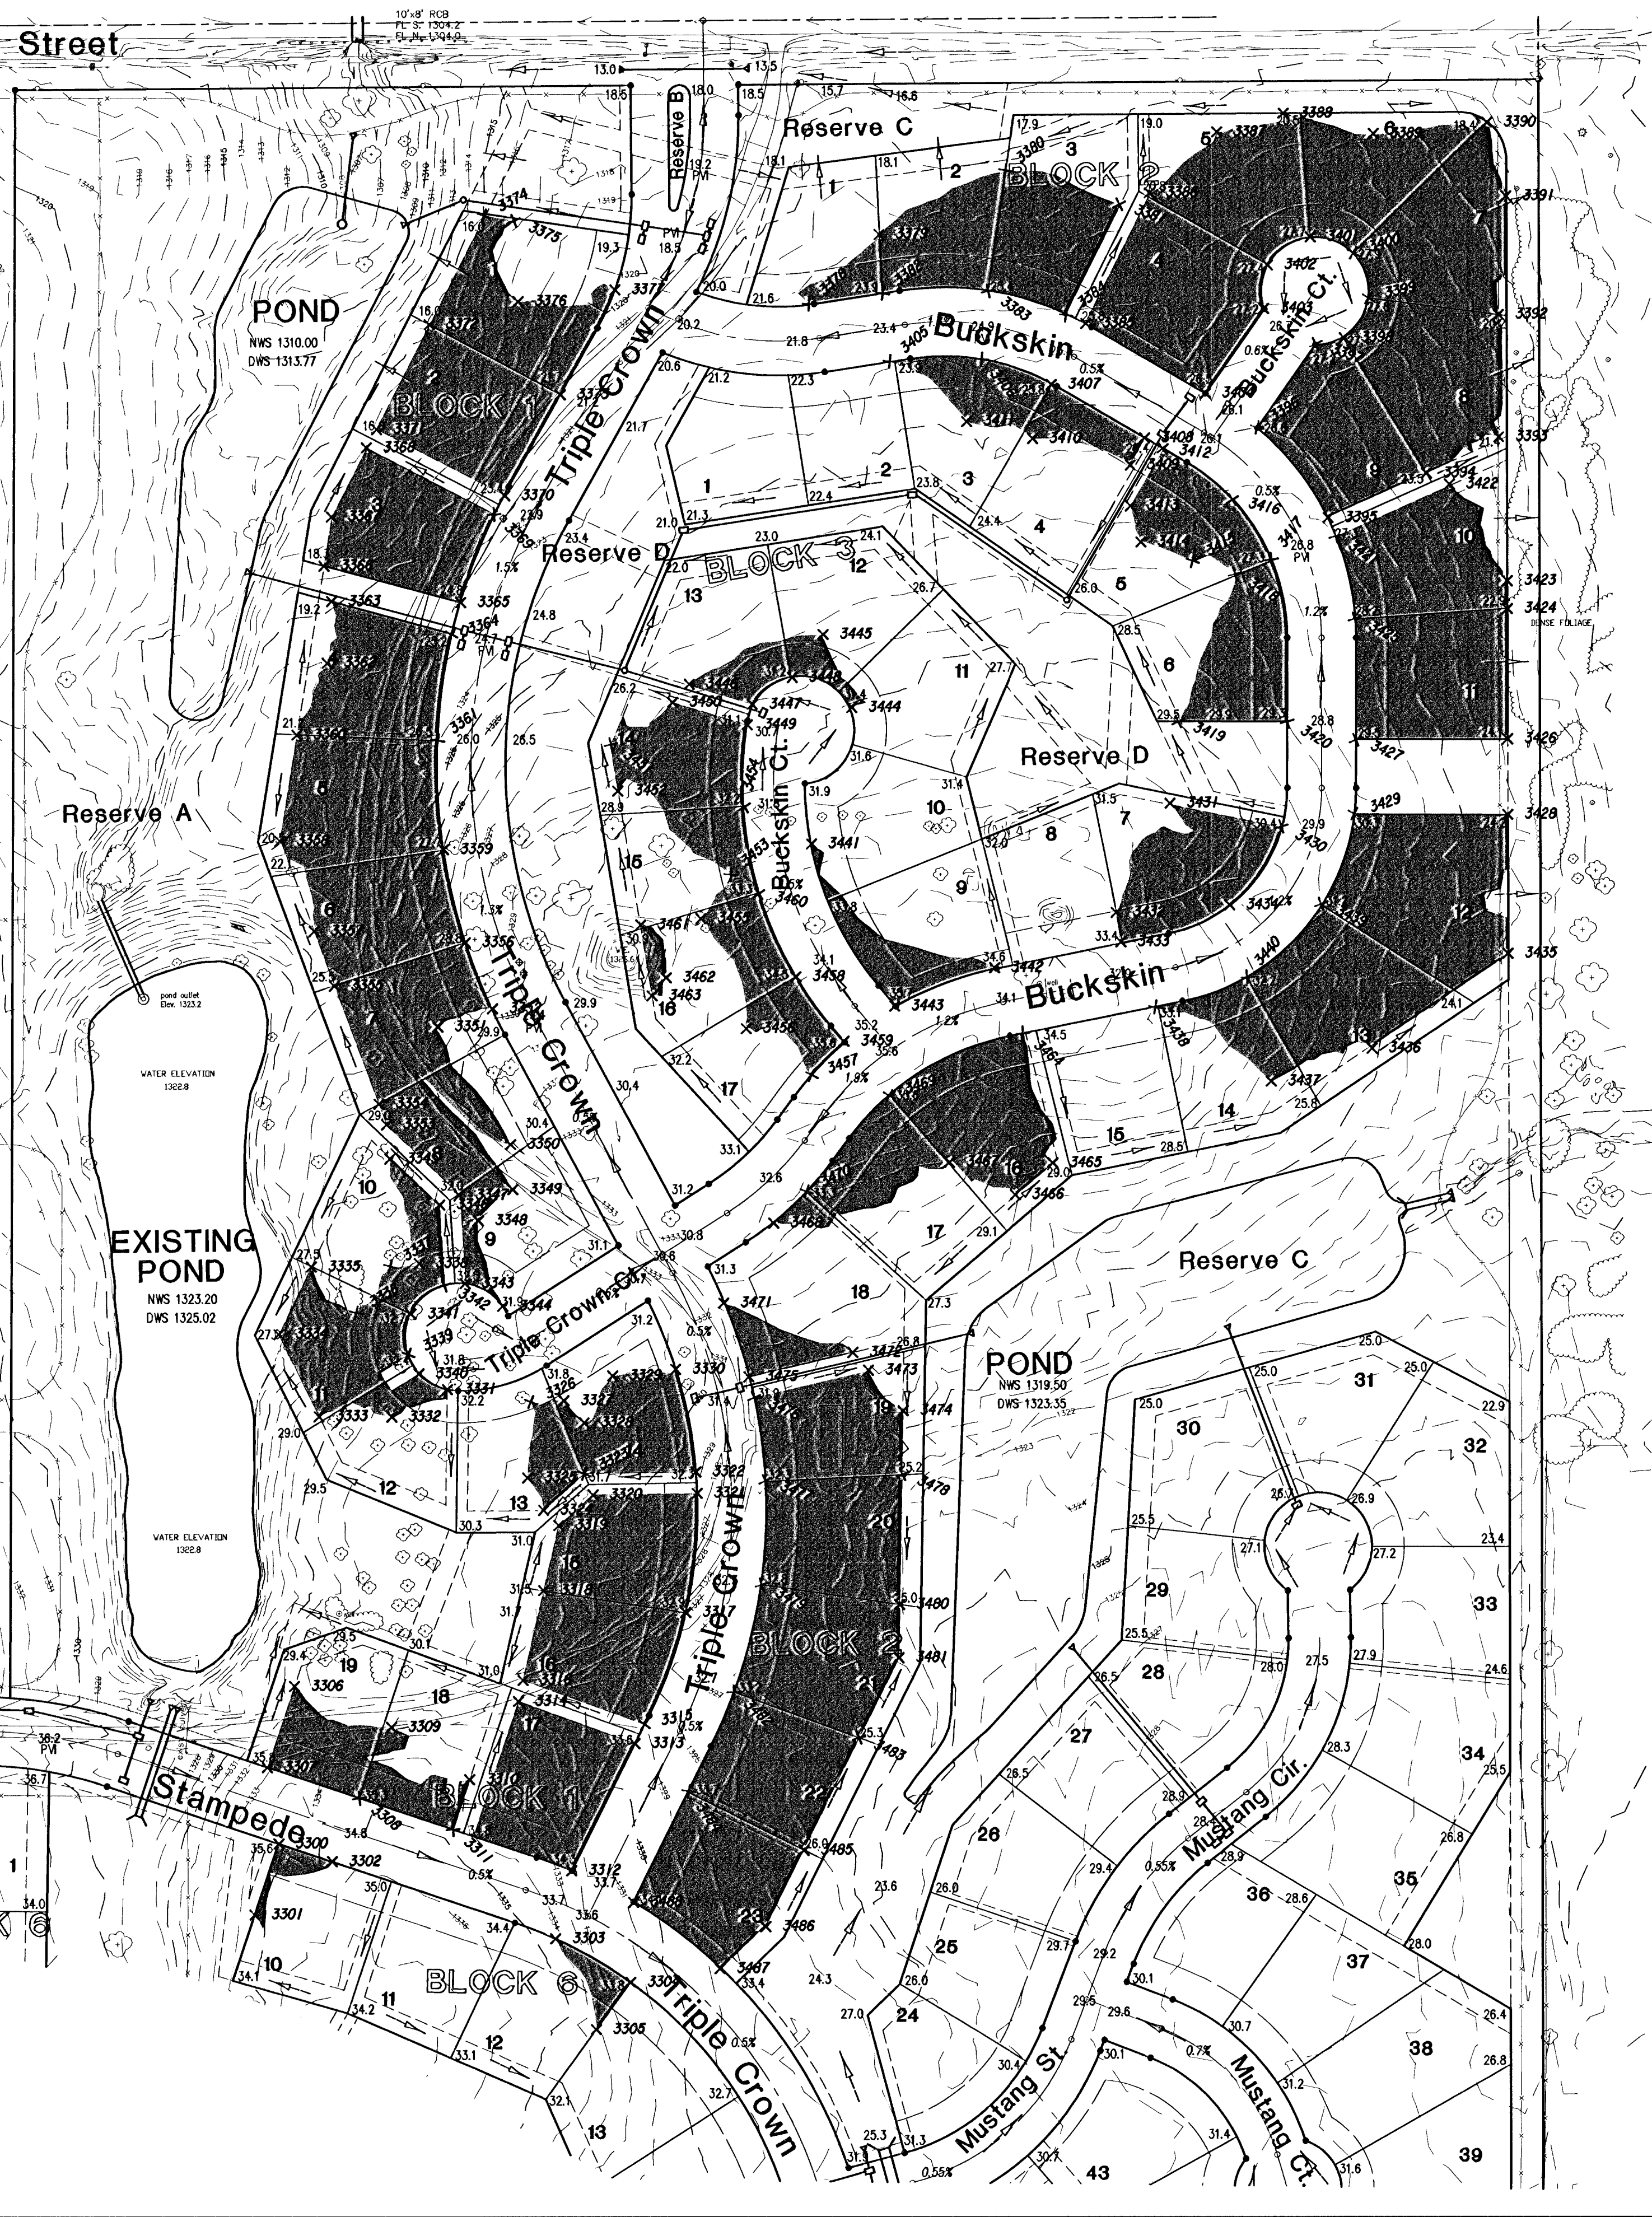

NORTHING	EASTING
1001	85.875
1002	85.875
1003	85.875
1004	85.875
1005	85.875
1006	85.875
1007	85.875
1008	85.875
1009	85.875
1010	85.875
1011	85.875
1012	85.875
1013	85.875
1014	85.875
1015	85.875
1016	85.875
1017	85.875
1018	85.875
1019	85.875
1020	85.875
1021	85.875
1022	85.875
1023	85.875
1024	85.875
1025	85.875
1026	85.875
1027	85.875
1028	85.875
1029	85.875
1030	85.875
1031	85.875
1032	85.875
1033	85.875
1034	85.875
1035	85.875
1036	85.875
1037	85.875
1038	85.875
1039	85.875
1040	85.875
1041	85.875
1042	85.875
1043	85.875
1044	85.875
1045	85.875
1046	85.875
1047	85.875
1048	85.875
1049	85.875
1050	85.875
1051	85.875
1052	85.875
1053	85.875
1054	85.875
1055	85.875
1056	85.875
1057	85.875
1058	85.875
1059	85.875
1060	85.875
1061	85.875
1062	85.875
1063	85.875
1064	85.875
1065	85.875
1066	85.875
1067	85.875
1068	85.875
1069	85.875
1070	85.875
1071	85.875
1072	85.875
1073	85.875
1074	85.875
1075	85.875
1076	85.875
1077	85.875
1078	85.875
1079	85.875
1080	85.875
1081	85.875
1082	85.875
1083	85.875
1084	85.875
1085	85.875
1086	85.875
1087	85.875
1088	85.875
1089	85.875
1090	85.875
1091	85.875
1092	85.875
1093	85.875
1094	85.875
1095	85.875
1096	85.875
1097	85.875
1098	85.875
1099	85.875
1100	85.875
1101	85.875
1102	85.875
1103	85.875
1104	85.875
1105	85.875
1106	85.875
1107	85.875
1108	85.875
1109	85.875
1110	85.875
1111	85.875
1112	85.875
1113	85.875
1114	85.875
1115	85.875
1116	85.875
1117	85.875
1118	85.875
1119	85.875
1120	85.875
1121	85.875
1122	85.875
1123	85.875
1124	85.875
1125	85.875
1126	85.875
1127	85.875
1128	85.875
1129	85.875
1130	85.875
1131	85.875
1132	85.875
1133	85.875
1134	85.875
1135	85.875
1136	85.875
1137	85.875
1138	85.875
1139	85.875
1140	85.875
1141	85.875
1142	85.875
1143	85.875
1144	85.875
1145	85.875
1146	85.875
1147	85.875
1148	85.875
1149	85.875
1150	85.875
1151	85.875
1152	85.875
1153	85.875
1154	85.875
1155	85.875
1156	85.875
1157	85.875
1158	85.875
1159	85.875
1160	85.875
1161	85.875
1162	85.875
1163	85.875
1164	85.875
1165	85.875
1166	85.875
1167	85.875
1168	85.875
1169	85.875
1170	85.875
1171	85.875
1172	85.875
1173	85.875
1174	85.875
1175	85.875
1176	85.875
1177	85.875
1178	85.875
1179	85.875
1180	85.875
1181	85.875
1182	85.875
1183	85.875
1184	85.875
1185	85.875
1186	85.875
1187	85.875
1188	85.875
1189	85.875
1190	85.875
1191	85.875
1192	85.875
1193	85.875
1194	85.875
1195	85.875
1196	85.875
1197	85.875
1198	85.875
1199	85.875
1200	85.875

FINAL

Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Poe Job No: 1694A
Date: March 2002

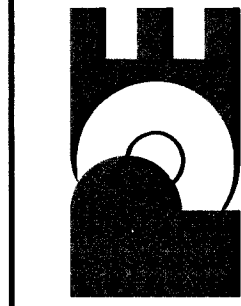

POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 • Wichita, KS 67208-4242
Phone 316/665-4114 • FAX 316/665-4444

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
LOT GRADING PLAN
CITY OF WICHITA, KANSAS
MICHAEL E. LINDBERGH, P.E. - CITY ENGINEER
C.O.M. Project # 468-63320 O.C.A. # 751305

No.	Date	By	Approved	Revision
1				
2				
3				
4				

G:\APPS\DCAP\654\Lot grading1.dwg Tue Mar 26 12:08:01 2002 Jason Dickman, Poe & Associates of Kansas, Inc.

SHEET 18 OF 20

Storm Water Pollution Prevention Plan
EQUESTRIAN ESTATES
An Addition to Wichita - Sedgwick County, Kansas


LEGEND

- ▶— = Direction of Flow
- = Temporary Seeding Area (200 lbs/acre Rye Grass)
- ▨ = Permanent Seeding Area (250 lbs/acre KS Premium Blend Fescue)
- ▤ = Back of Curb Protection (w/Seeding)
- SEDIMENT BARRIER = Sediment Barrier
(Type to be determined by Owner or Contractor)

NOTES:

1. Contractor shall grade all right-of-way areas according to elevations shown on Lot Grading Plan.
(Cost subsidiary to Site Clearing/Restoration.)
2. Contractor shall seed all disturbed areas within Right-of-Way with temporary rye grass at a rate of 200 lbs per acre.
Total Area = 2.0 Acres.
(Cost subsidiary to Site Clearing/Restoration.)
3. Contractor shall seed all disturbed areas within Reserves and outside of right-of-way with permanent fescue grass at a rate of 250 lbs per acre. Total Area = 14.0 Acres.
(Cost subsidiary to Site Clearing/Restoration.)


Scale 1" = 100'

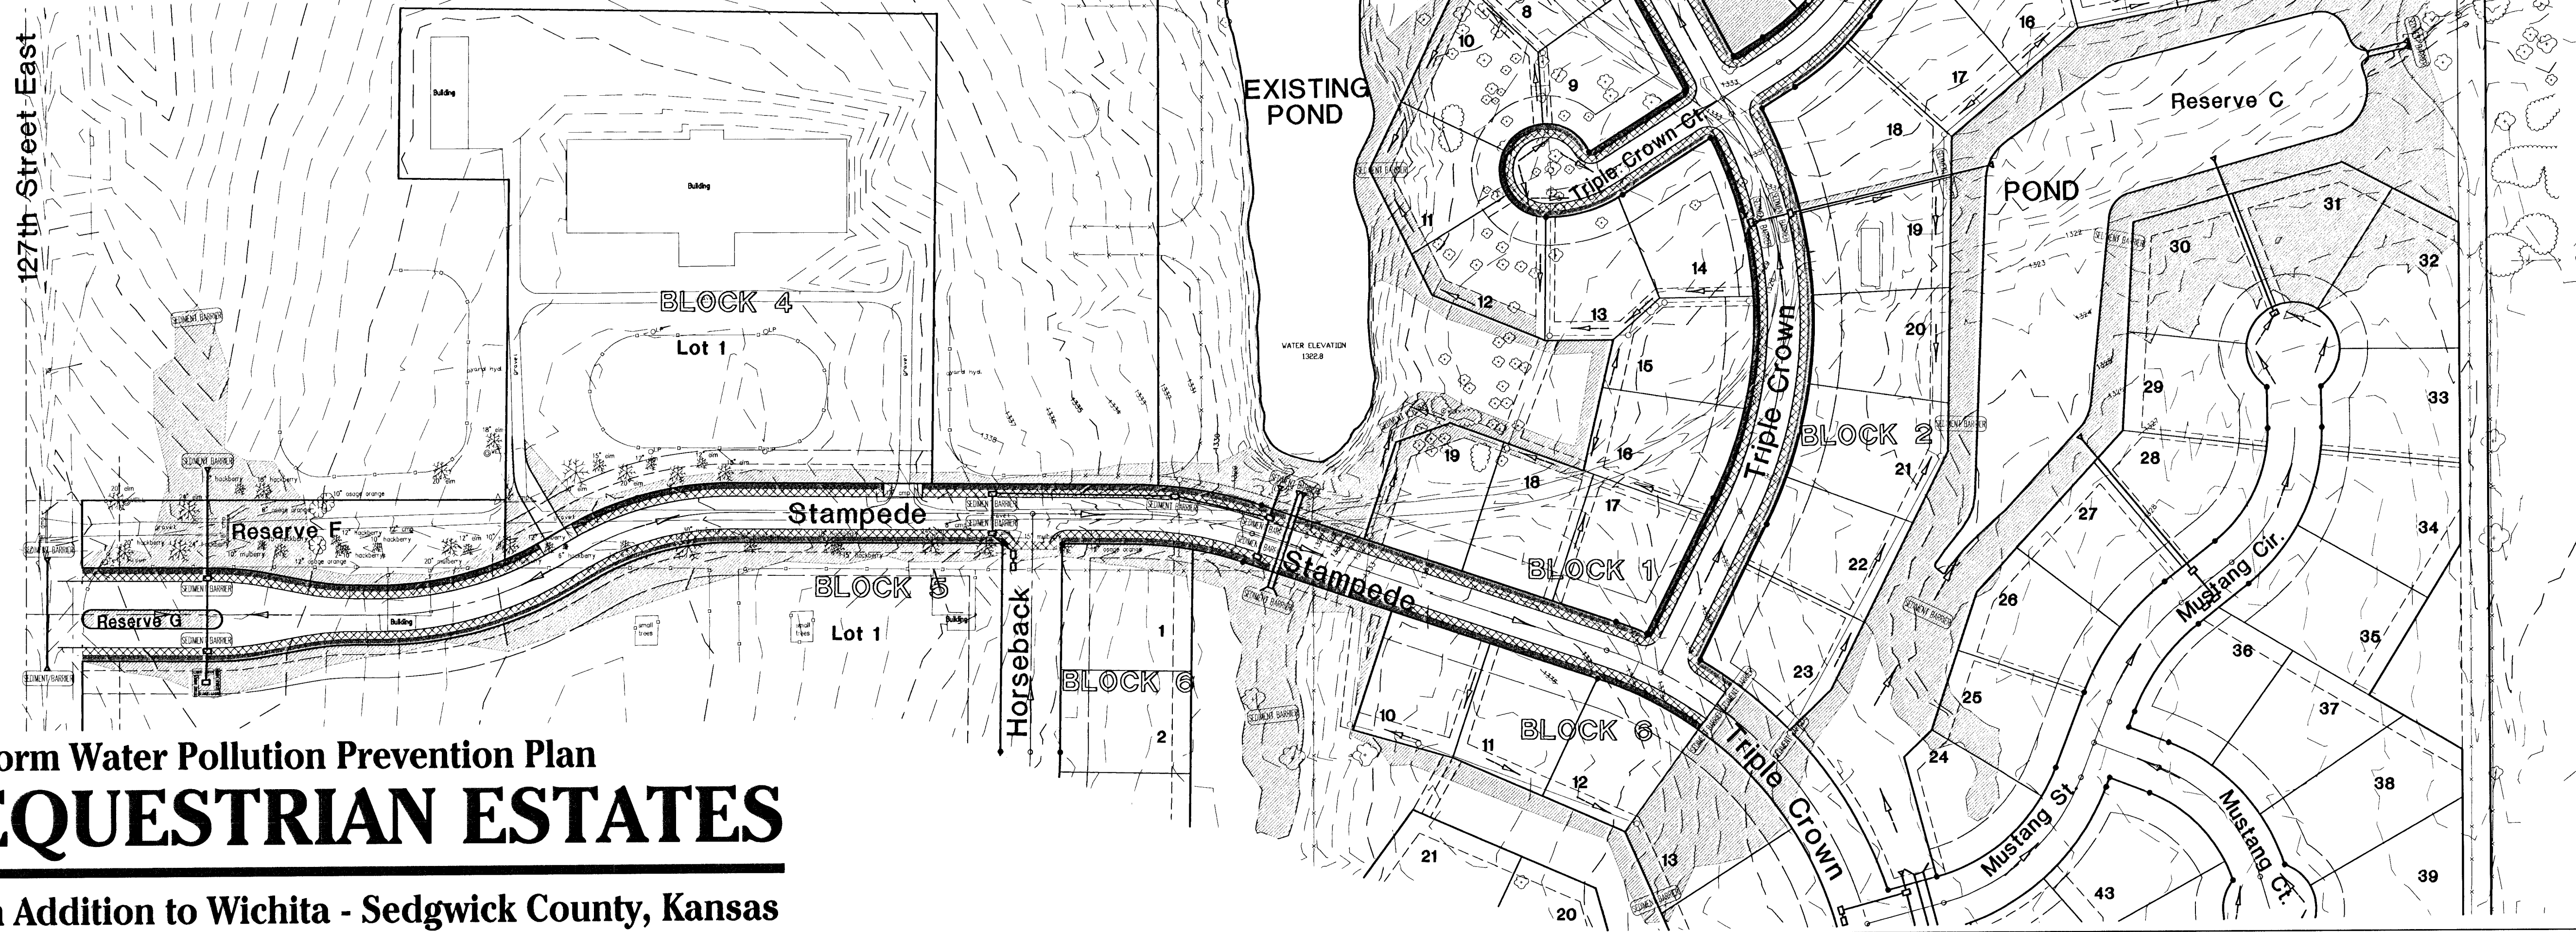

FINAL

Designed By: J. Ubert / J. Dickman
Drawn By: J. Dickman
Poe Job No.: 1694A
Date: March 2002

Sheet
18 of 20



POE & ASSOCIATES OF KANSAS, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 ■ Wichita, KS 67208-4242
Phone 316.685-4114 ■ FAX 316.685-4444

EQUESTRIAN ESTATES - PHASE 1
DRAINAGE IMPROVEMENTS
STORM WATER POLLUTION PREVENTION PLAN
CITY OF WICHITA, KANSAS
MICHAEL E. LINDBERGH, P.E. - CITY ENGINEER
C.O.W. Project # 468-83320 O.C.A. # 751305

No.	Date	By	Approved	Revision
1				
2				
3				


NW Corner, NW 1/4
Section 35-27-2E
Found 3/4" Pipe

CURVE TABLE						
CURVE	LENGTH	RADIUS	TANGENT	CHORD	BEARING	DELTA
C1	215.00	50.00	76.45	83.89	S33°49'50"W	246°22'28"
C2	36.72	150.00	44.61	85.32	N74°04'50"E	33°07'50"
C3	129.47	250.00	58.22	128.39	N14°28'35"E	28°40'20"
C4	164.88	318.00	84.23	162.85	N14°28'35"E	29°40'20"
C5	252.29	50.00	55.60	58.00	N65°06'58"W	289°05'56"
C6	39.51	271.00	50.32	98.95	N46°59'56"E	21°02'20"
C7	64.86	121.00	35.39	68.39	N74°04'50"E	33°07'50"
C8	91.55	273.00	48.09	90.35	S45°13'37"W	18°45'41"
C9	277.50	321.00	148.27	269.21	S15°09'36"E	49°45'04"
C10	223.44	50.00	63.96	78.78	N42°20'47"W	258°02'33"
C11	498.84	497.00	272.73	478.19	S00°31'23"W	51°30'43"
C12	164.51	250.00	85.36	161.59	S79°57'28"E	31°42'39"
C13	232.95	120.00	138.93	215.15	N39°21'12"E	78°50'49"
C14	113.81	278.00	57.71	113.03	S68°53'39"W	23°22'23"
C15	220.39	220.00	120.44	211.29	N28°35'11"W	51°23'52"
C16	163.71	240.00	85.19	160.56	N79°16'02"W	39°05'01"
C17	5.33	220.00	4.08	9.33	N58°30'39"W	02°29'44"
C18	29.18	45.00	15.12	28.67	N71°40'03"W	57°09'04"
C19	41.79	45.00	22.54	40.30	N28°38'24"W	53°12'14"

LINE TABLE		
LINE	LENGTH	BEARING
L1	248.83	N28°13'58"W
L2	148.26	S67°31'05"W
L3	19.48	N28°13'58"W
L4	71.54	S57°31'05"W
L5	93.41	N81°11'27"E
L6	25.56	N68°28'46"E
L7	208.65	N29°16'45"E
L8	139.46	S00°36'04"W
L9	164.19	S78°36'59"W
L10	53.40	N38°57'06"W
L11	169.71	S34°53'02"W
L12	140.08	S69°43'32"E
L13	88.51	N69°23'35"W
L14	23.05	N29°16'45"E



Exception to Plat

MINIMUM BUILDING ELEVATIONS			
Minimum Low Ceiling Elevation			
Location	NGVD Datum	City Datum	
Lot 1-5, Bk 1	1316.0	128.8	
Lot 6-19, Bk 1	1327.3	139.3	
Lot 12-32, Bk 2	1328.4	139.0	
Lot 1-9, Bk 6	1335.0	147.6	
Lot 13, Bk 6	1335.0	147.6	
Lot 21-26, Bk 6	1335.0	147.6	

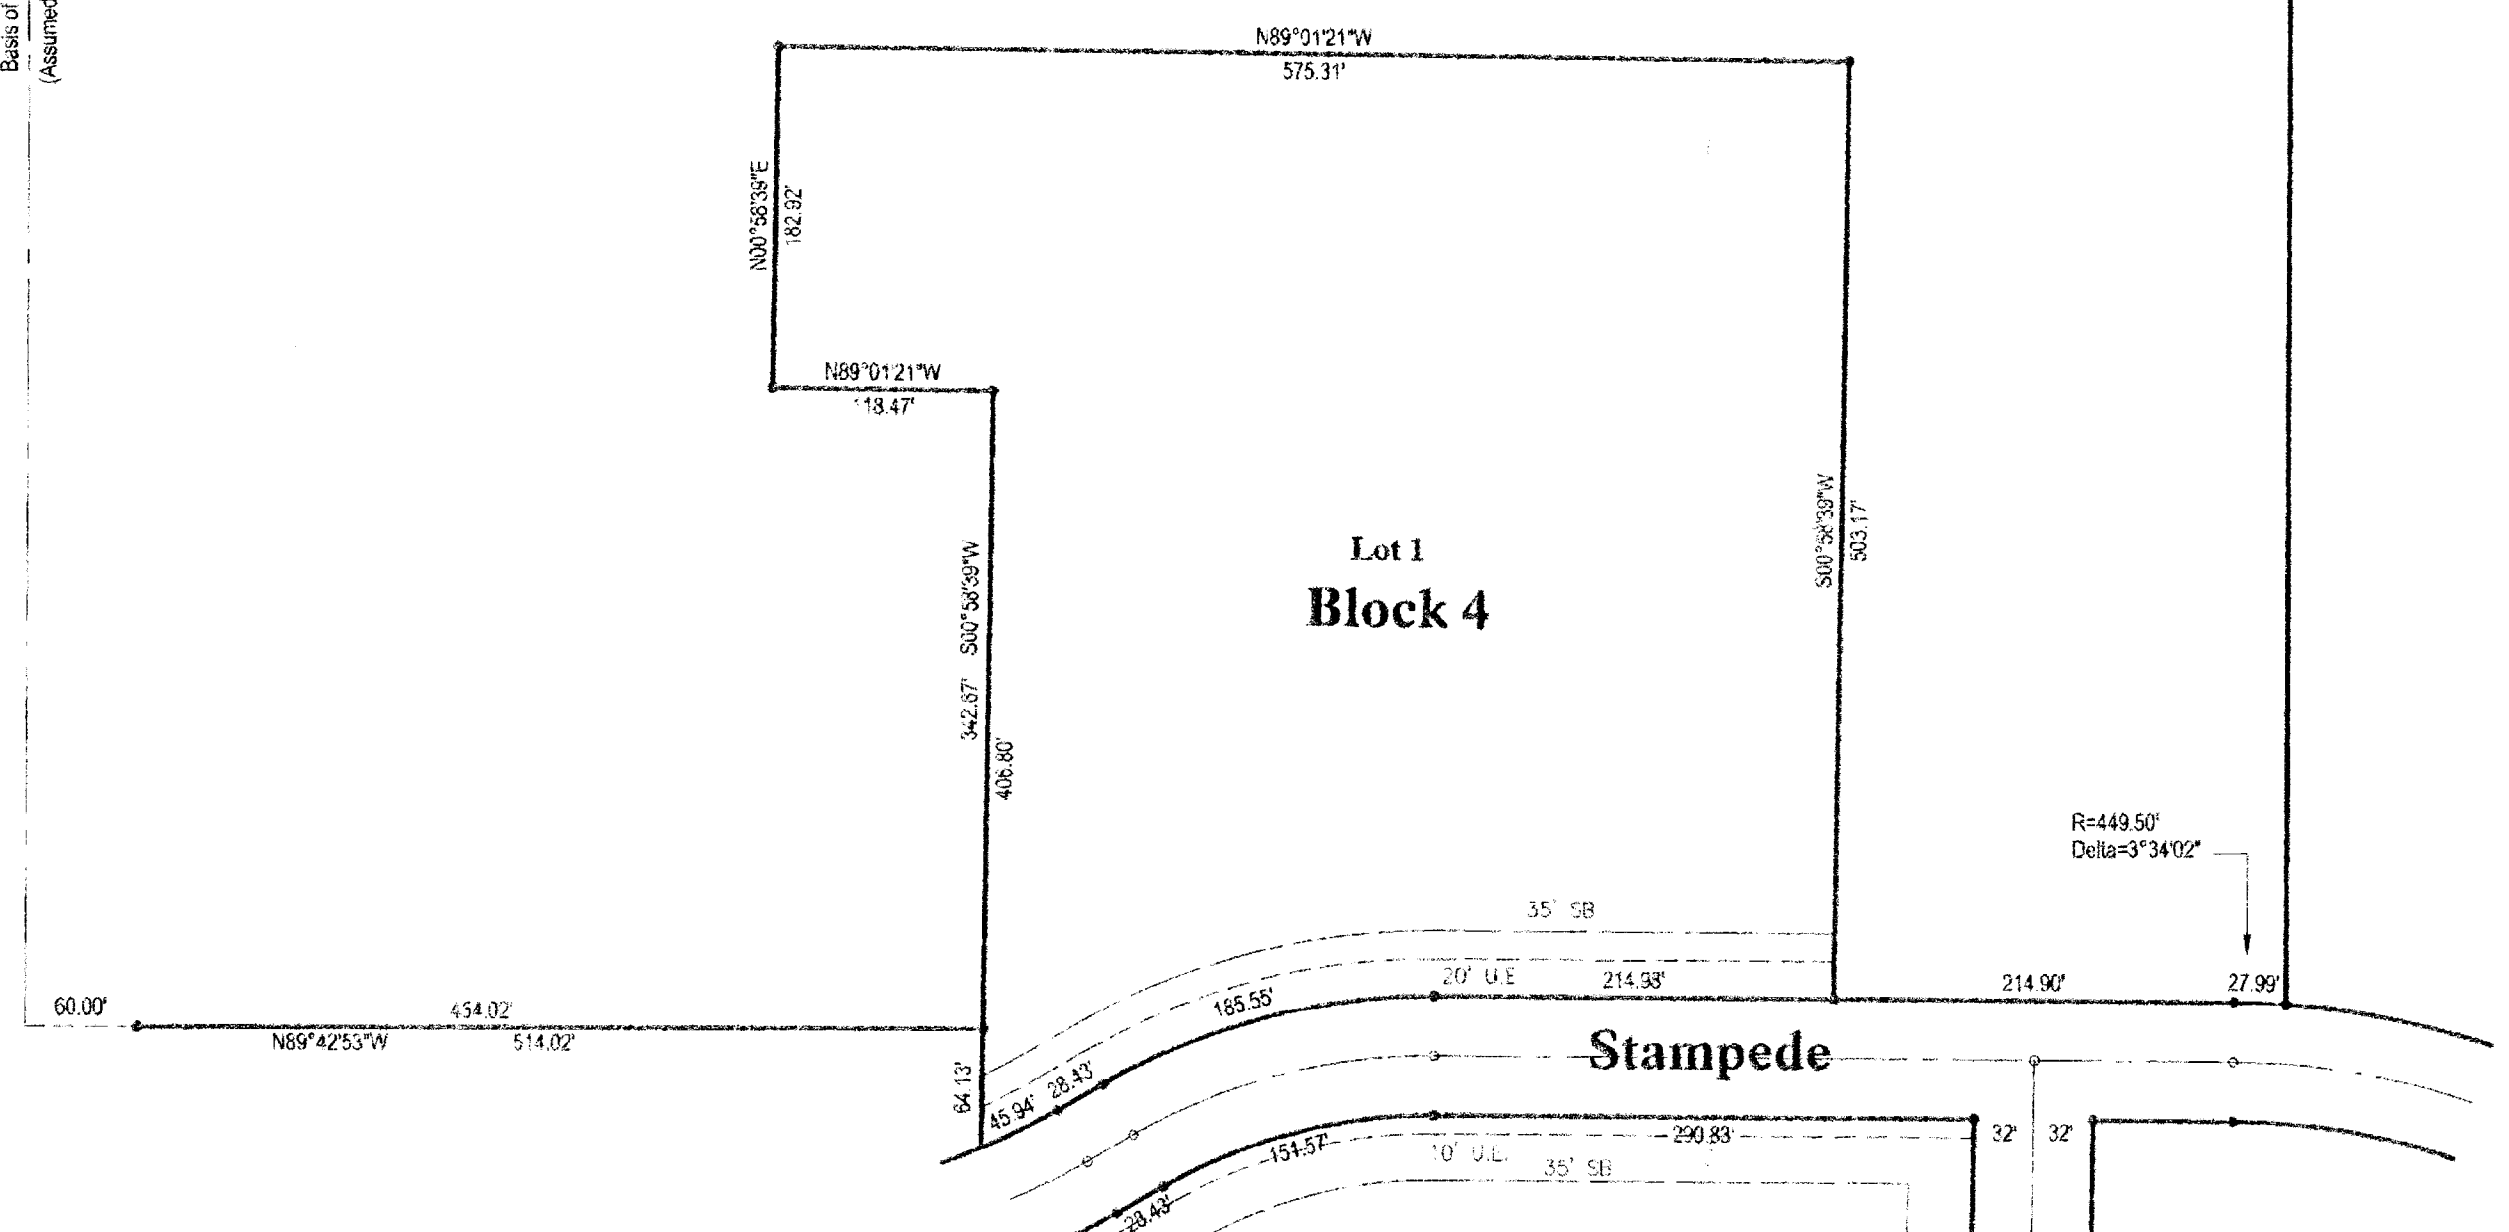


EQUESTRIAN ESTATES

An Addition to Wichita - Sedgwick County, Kansas
(Associated Zone Case PUD 2000-0001)

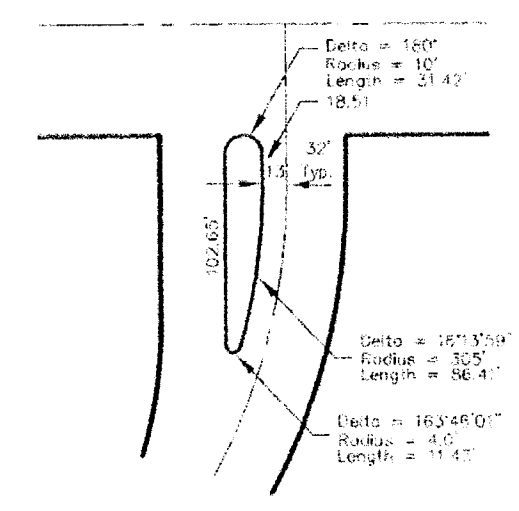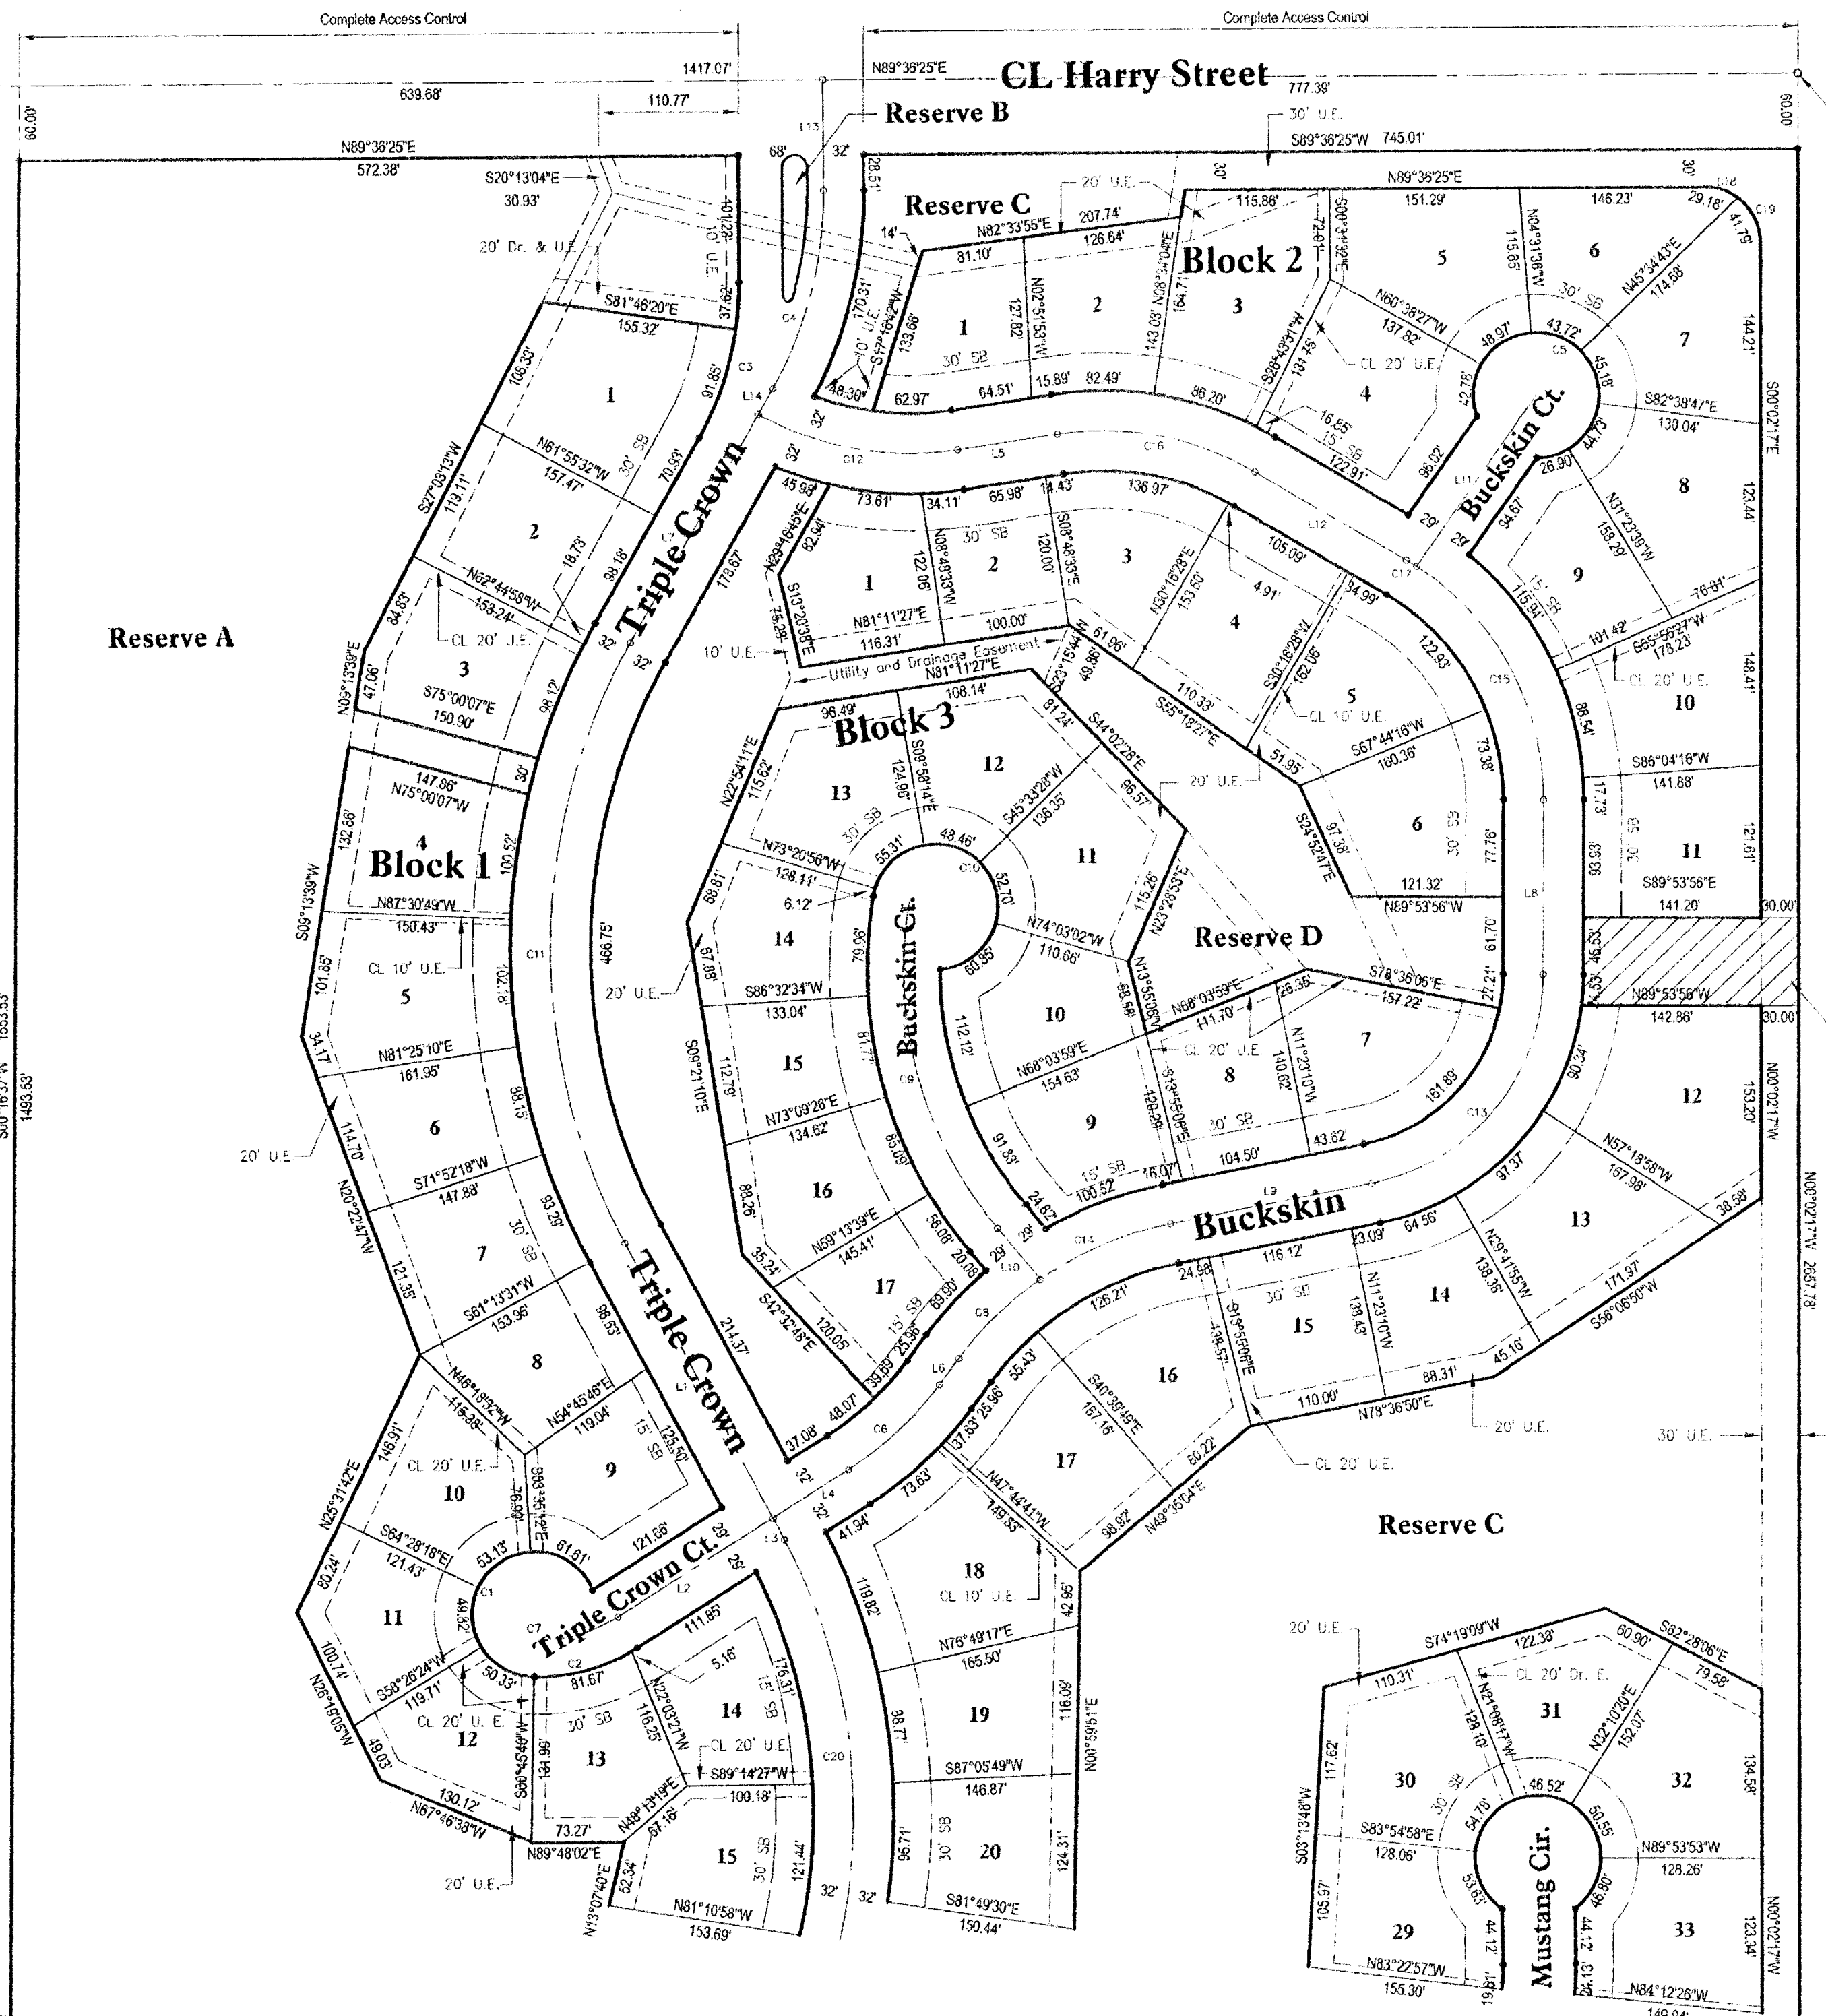

Reserve B Details

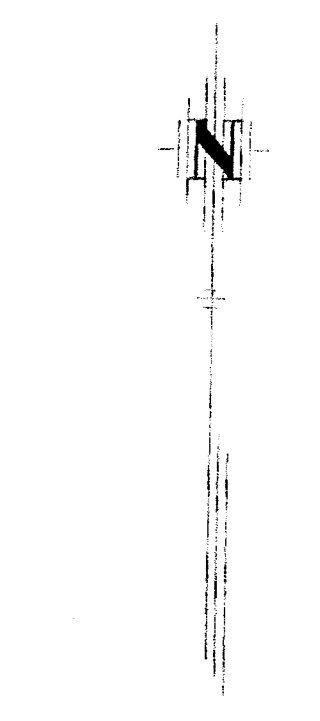

SCALE IN FEET 1" = 100'

LEGEND	
Utility Easement	20' U.E.
Drainage Easement	20' Dr. E.
Iron Set	—
Building Setback	30' SB
Curve Label	C
Line Label	L
Center Line	CL
Monument Found	—


NOTE:

This Addition is subject to the conditions of the Planned Unit Development PUD 2000-00001.




BENCHMARKS:

- NGVD Datum
- 1. Railroad spike in power pole, approximately 25' south and 30' east of NW 1/4 Corner, Section 35-27-2E. Elevation 1349.65
- 2. Square on south hub guard of RCB just west of NW Corner of Section 35-27-2E. Elevation 1311.90

SE Corner, NW 1/4
Section 35-27-2E
Found 1 1/4" Pipe

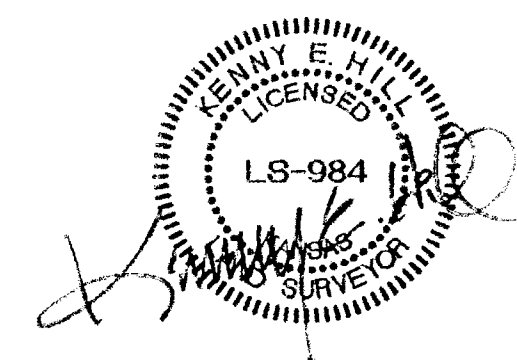

CURVE	LENGTH	RADIUS	TANGENT	CHORD	BEARING	DELTA
C20	442.12	463.00	238.54	425.51	S30°52'1"E	54°42'42"
C21	133.56	417.50	65.91	130.03	N80°29'42"W	17°02'01"
C22	242.62	453.00	124.36	239.73	N10°20'2"E	30°41'14"
C23	92.35	253.00	46.70	91.84	N10°43'04"W	20°54'55"
C24	278.77	300.00	140.12	267.06	S05°15'10"W	52°51'36"
C25	252.26	53.00	25.02	58.02	N73°25'49"E	23°55'33"
C26	358.23	427.00	190.42	347.82	N38°00'04"W	48°04'06"
C27	206.70	220.00	111.89	199.18	N48°12'01"E	53°46'56"
C28	189.51	427.00	96.34	187.96	N02°20'06"W	29°25'46"
C29	185.42	600.00	96.46	184.69	N85°56'51"E	17°42'24"
C30	104.25	250.00	52.69	103.49	N83°39'31"W	23°55'33"
C31	252.29	50.00	25.03	58.00	S24°23'32"E	23°55'33"
C32	81.93	250.00	41.35	81.81	S75°00'06"W	18°47'02"
C33	111.92	903.00	56.15	111.81	S05°09'34"W	10°38'22"
C34	141.23	600.00	70.94	140.30	S78°27'21"E	13°23'11"
C35	62.70	205.00	31.29	61.98	S11°53'30"E	17°21'22"
C36	53.55	205.00	26.59	53.29	N13°58'14"W	14°57'55"
C37	252.29	50.00	25.03	58.00	S56°47'11"W	23°55'33"
C38	88.83	300.00	44.64	88.31	S85°32'29"W	16°55'40"
C39	70.45	45.00	44.77	83.47	N44°48'45"E	89°42'04"
C40	252.29	50.00	25.03	58.00	N04°01'13"E	23°55'33"
C41	62.74	427.00	31.42	62.68	N87°19'40"W	28°55'55"
C42	164.83	190.00	88.58	158.25	N42°40'53"W	52°24'04"
C43	133.37	260.00	66.31	131.79	S36°24'01"W	30°33'51"
C44	104.96	180.00	88.74	158.24	N25°25'48"E	52°30'24"
C45	252.29	50.00	25.03	58.00	S88°10'36"W	23°55'33"
C46	168.58	317.50	86.37	168.58	N78°23'15"E	30°25'06"
C47	202.73	382.50	153.51	200.36	N78°18'45"E	30°22'02"

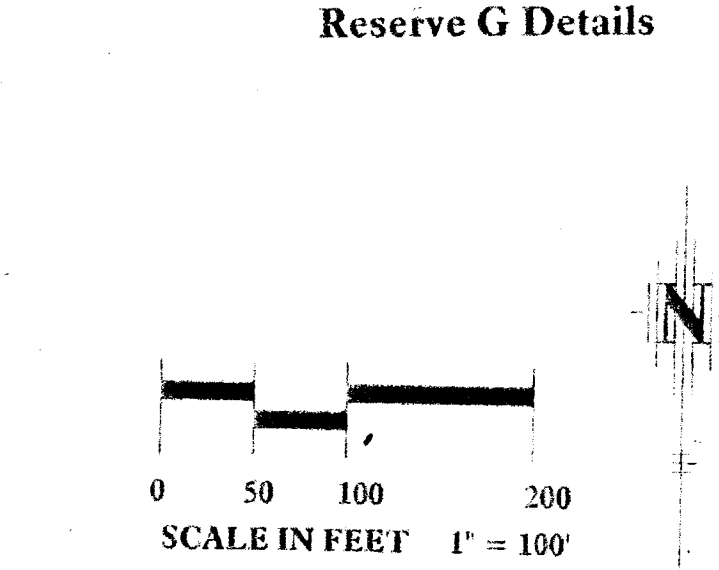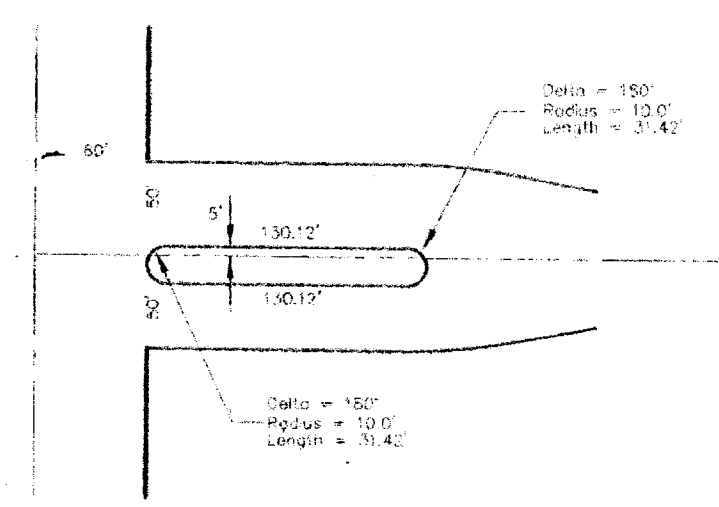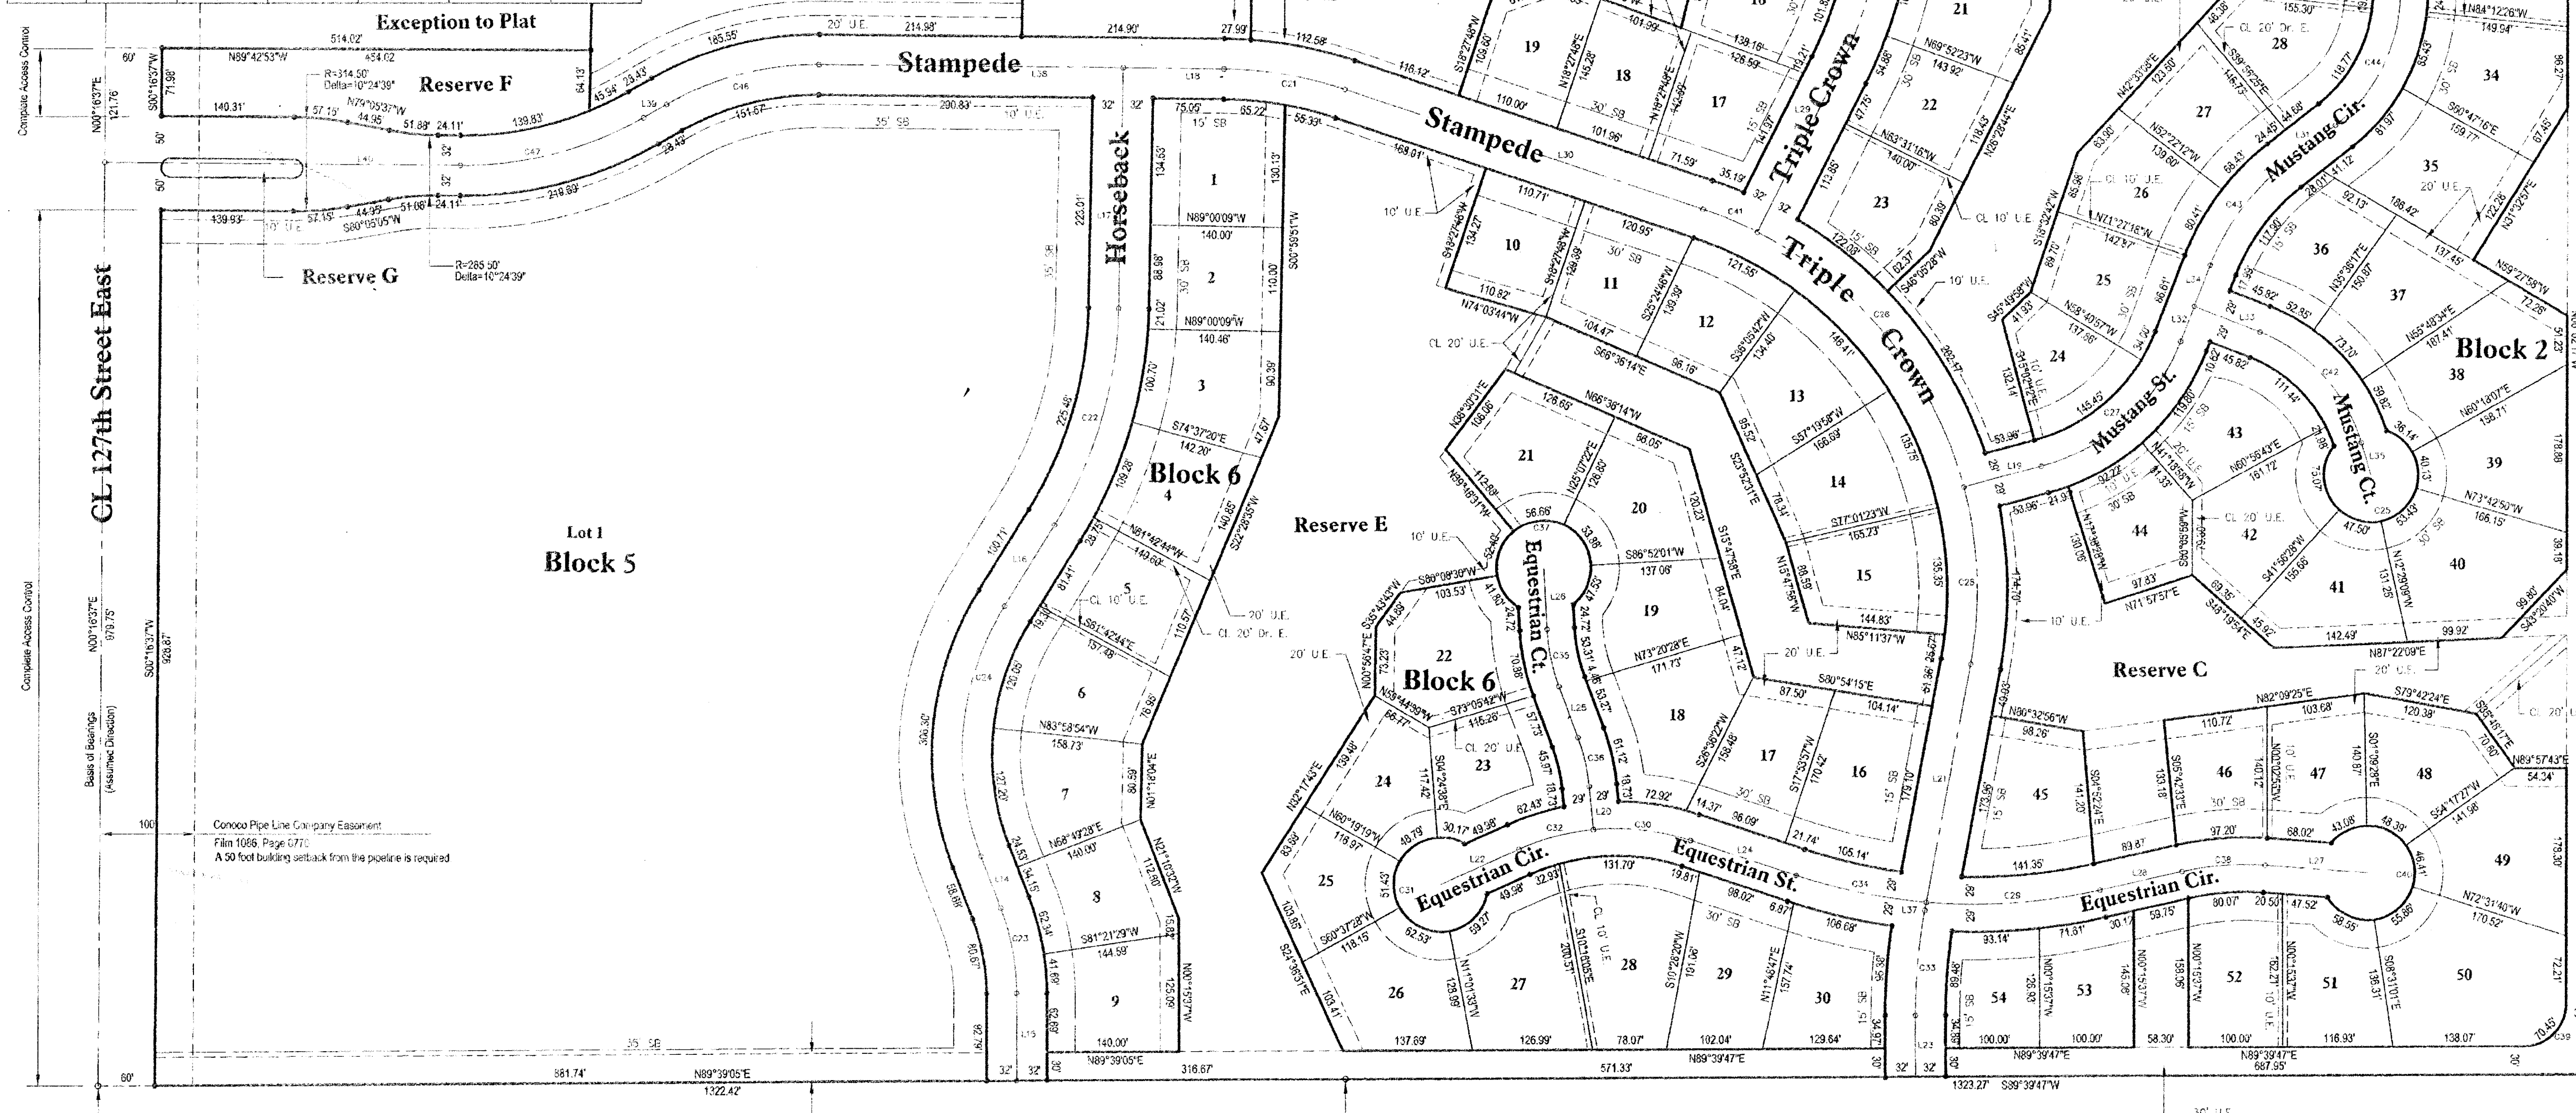

LEGEND

Utility Easement	20' U.E.
Drainage Easement	25' Dr. E.
Iron Set	—
Building Setback	30' S.D.
Curve Label	C
Line Label	L
Center Line	CL
Monument Found	—

NOTE:
This Addition is subject to the conditions of the Planned Unit Development PUD 2000-0001.

BENCHMARKS:
NGVD Datum
1. Railroad spike in power pole, approximately 25' south and 30' east of W 1/4 Corner, Section 35-27-2E. Elevation 1349.05
2. Square on south hub guard of RCBC just west of NW Corner of Section 35-27-2E. Elevation 1311.90

LINE TABLE

LINE	LENGTH	BEARING
L14	58.68	S21°10'32"E
L15	92.74	S00°15'37"E
L16	108.71	S31°41'04"W
L17	255.26	N00°59'51"E
L18	108.80	N89°27'13"W
L19	65.04	S74°56'59"W
L20	46.22	N65°38'15"W
L21	257.25	S10°22'45"W
L22	50.71	N65°38'20"E
L23	54.93	N60°15'37"W
L24	117.83	S71°42'46"E
L25	57.73	N20°34'12"W
L26	65.45	N83°12'49"W
L27	108.75	S85°58'41"E
L28	89.87	N77°05'40"E
L29	192.27	N26°28'44"E
L30	399.57	S71°32'12"E
L31	68.13	N51°41'00"E
L32	59.92	S21°10'05"W
L33	74.82	N68°52'57"W
L34	48.99	S21°07'00"W
L35	35.99	N16°28'46"W
L36	84.95	S00°49'20"E
L37	8.74	S10°22'45"W
L38	323.38	N69°27'13"W
L39	28.43	S60°07'42"W
L40	376.86	N89°30'16"W


MINIMUM BUILDING ELEVATIONS

Location	NGVD Datum	City Datum
Lots 1-5, Bk 1	1316.0	128.6
Lots 6-10, Bk 1	1327.3	139.9
Lots 12-32, Bk 2	1326.4	139.0
Lots 1-9, Bk 6	1335.0	147.6
Lots 10, Bk 6	1335.0	147.6
Lots 21-26, Bk 6	1335.0	147.6

EQUESTRIAN ESTATES

An Addition to Wichita - Sedgwick County, Kansas

(Associated Zone Case PUD 2000-0001)

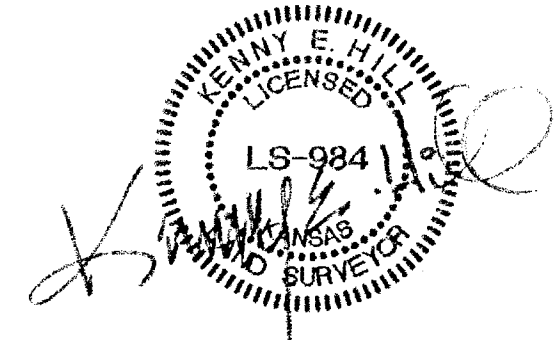

6:\APPS\CD\1\664\STATE.dwg Mon Mar 25 13:48:18 2002 James Libert - Roe & Associates of Kansas, Inc.