
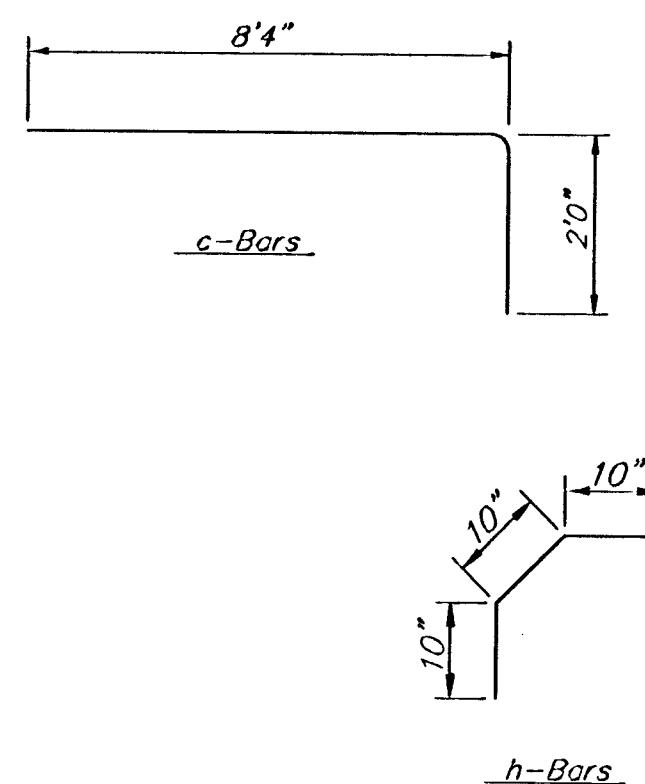
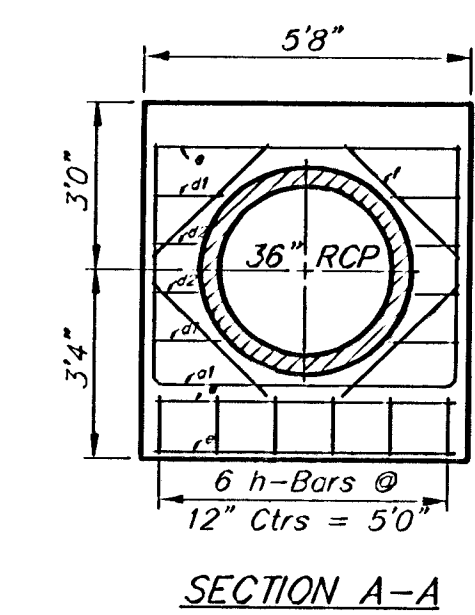
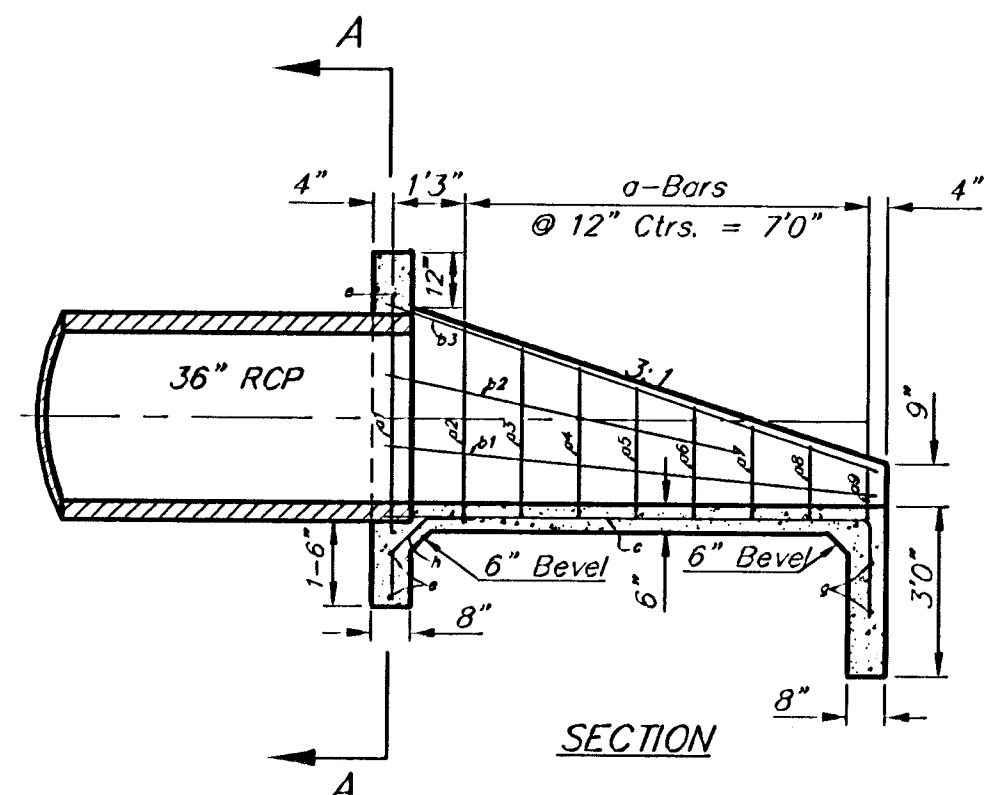




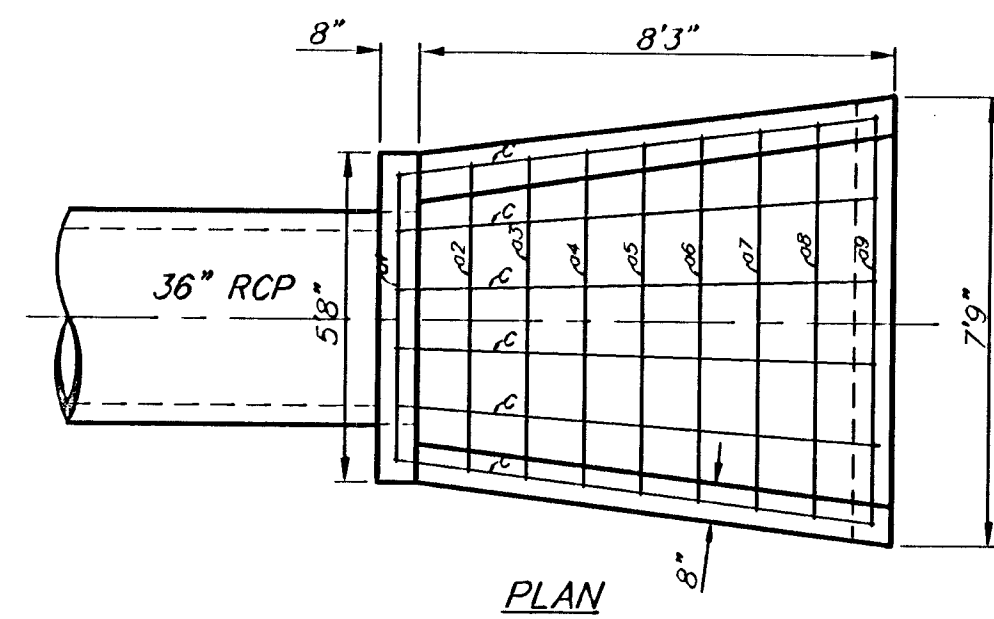


a-Bars	
a1 5'2"	a1 4'5"
a2 5'2"	a2 3'4"
a3 5'5"	a3 2'11"
a4 5'8"	a4 2'7"
a5 5'11"	a5 2'3"
a6 6'2"	a6 1'11"
a7 6'5"	a7 1'7"
a8 6'8"	a8 1'2"
a9 6'11"	a9 10"

REBAR SCHEDULE				
Bar	Shape	No.	Length	Weight
a1		1	14'0"	9.35
a2		1	11'10"	7.90
a3		1	11'3"	7.52
a4		1	10'10"	7.24
a5		1	10'5"	6.96
a6		1	10'0"	6.68
a7		1	9'7"	6.40
a8		1	9'0"	6.01
a9		1	8'7"	5.73
b1		2	8'5"	11.24
b2		2	4'7"	6.12
b3		2	9'0"	12.02
c		6	10'4"	41.42
d1		4	1'6"	4.01
d2		4	10"	2.23
e		3	5'4"	10.69
f		4	3'0"	8.02
g		2	7'0"	9.35
h		6	2'6"	10.02
Total Rebar			178.91 Lbs.	
Concrete			3.20 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.
 * Field Bend or Cut Reinforcing as Required for Clearance.
 All Concrete Reinforcement to be #4 Rebar.
 All Rebar to Have Min. of 1 1/2" Conc. Cover




HEADWALL FOR 36" RCP

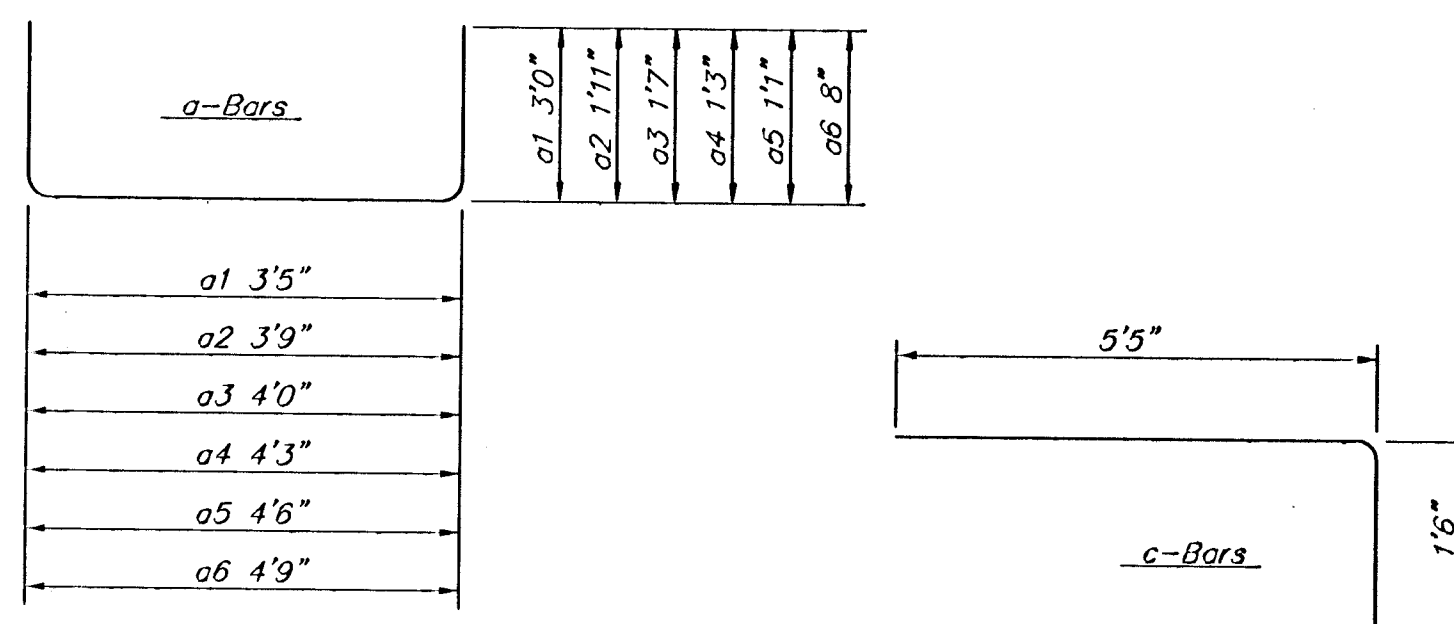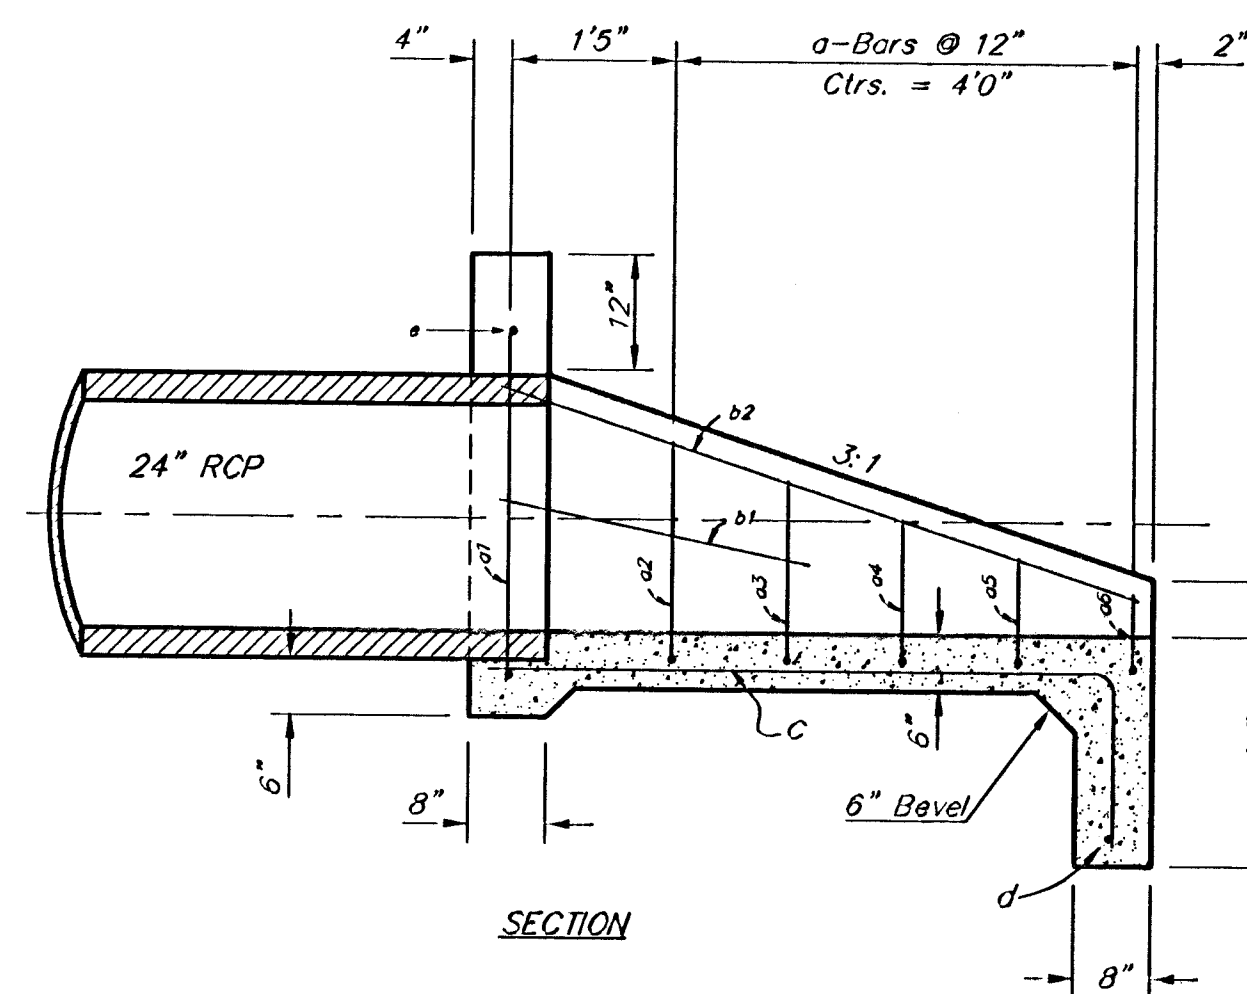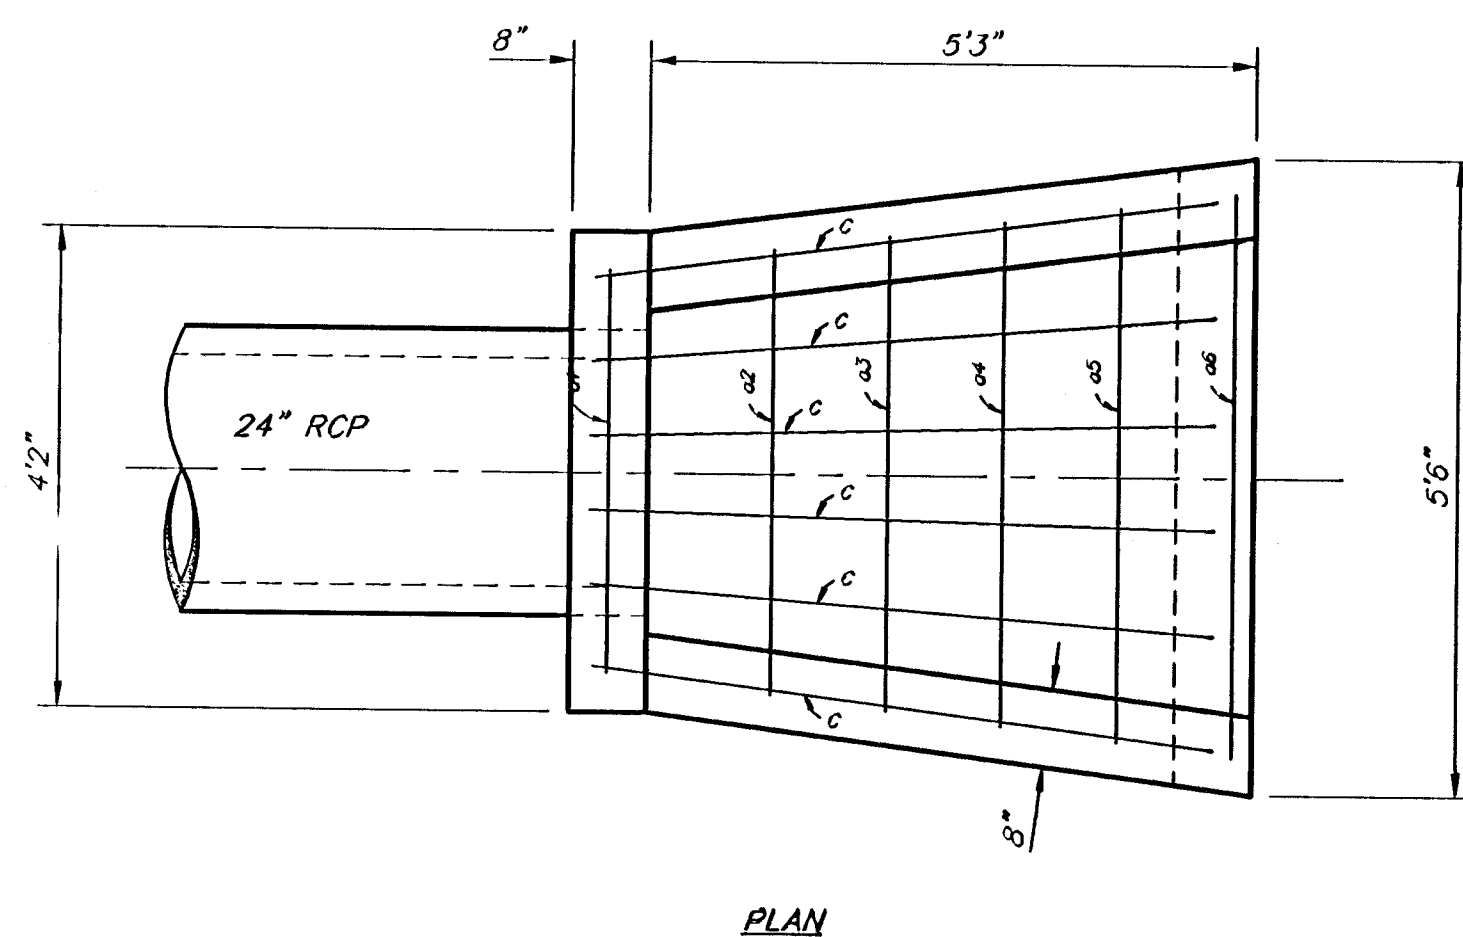

REBAR SCHEDULE				
Bar	Shape	No.	Length	Weight
a1		1	9'5"	6.29
a2		1	7'7"	5.07
a3		1	7'2"	4.79
a4		1	6'9"	4.51
a5		1	6'4"	4.23
a6		1	6'1"	4.06
b1		2	2'9"	3.67
b2		2	5'10"	7.79
c		6	6'11"	27.72
d		1	5'0"	3.37
e		1	3'10"	2.56
Total Rebar			74.03 Lbs.	
Concrete			1.40 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.
 * Field Bend or Cut Reinforcing as Required for Clearance.
 All Concrete Reinforcement to be #4 Rebar.
 All Rebar to Have Min. of 1 1/2" Conc. Cover

HEADWALL FOR 24" RCP

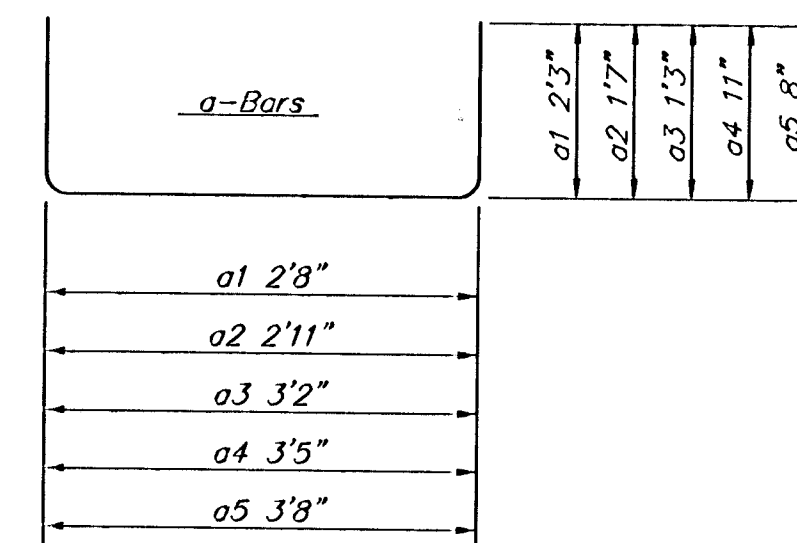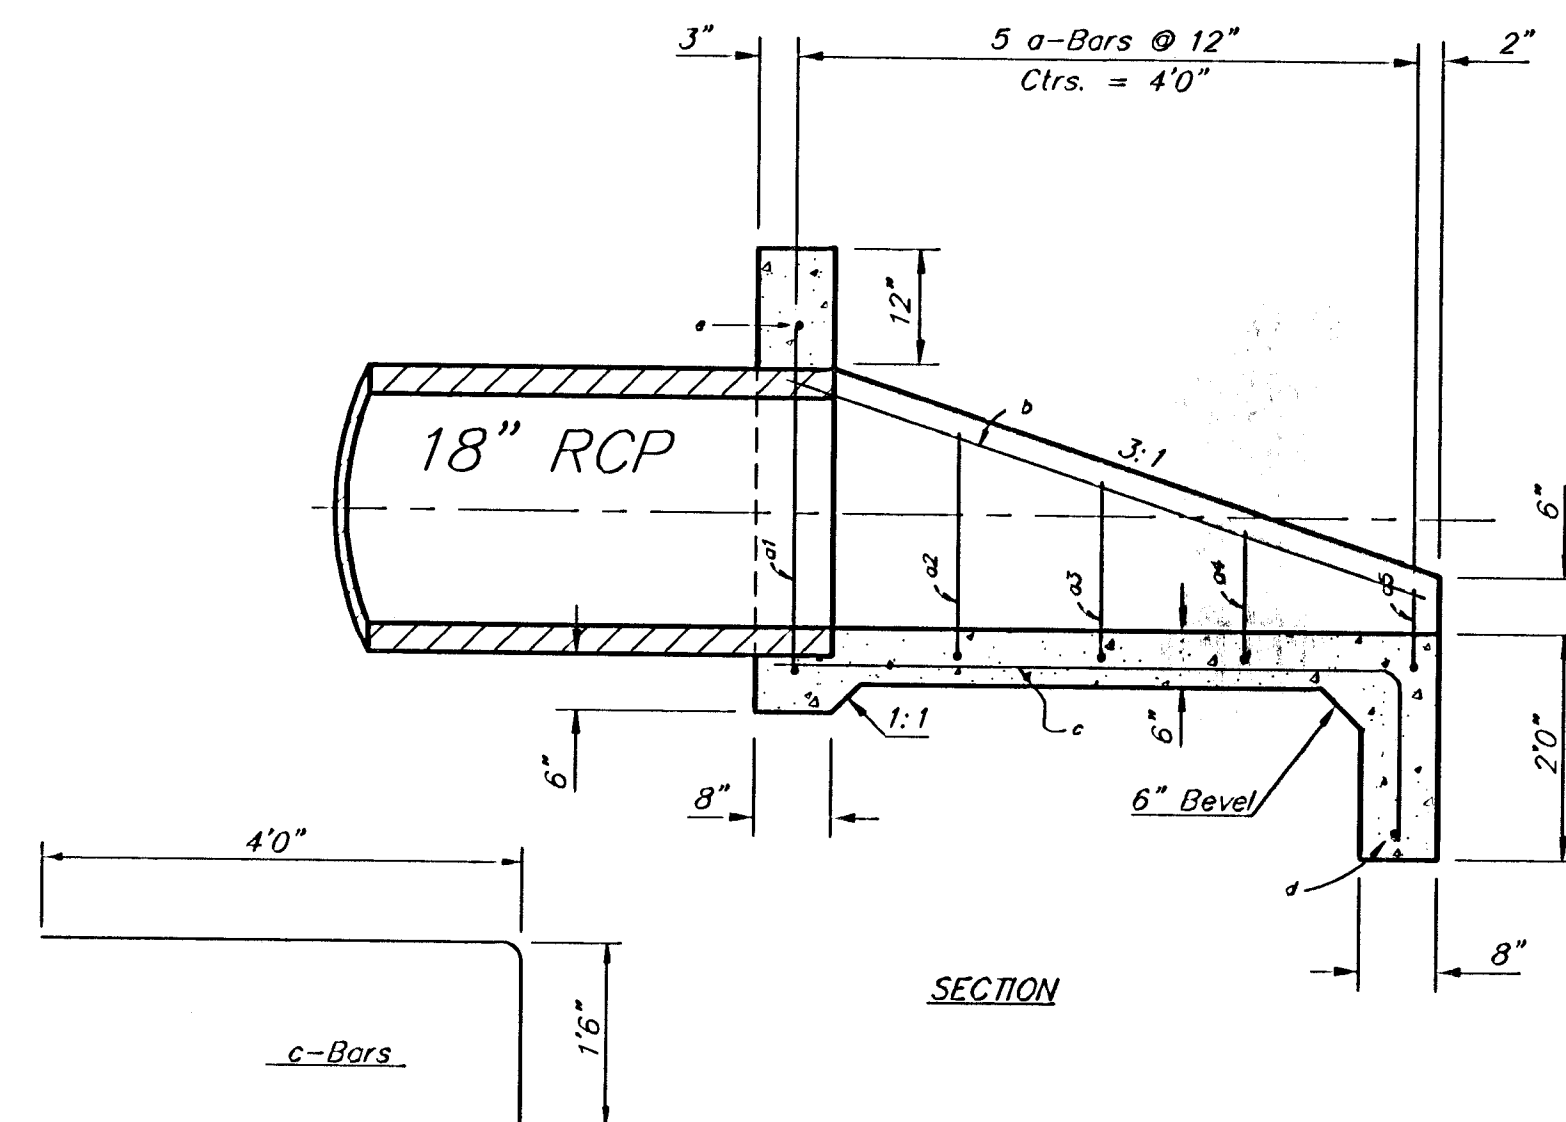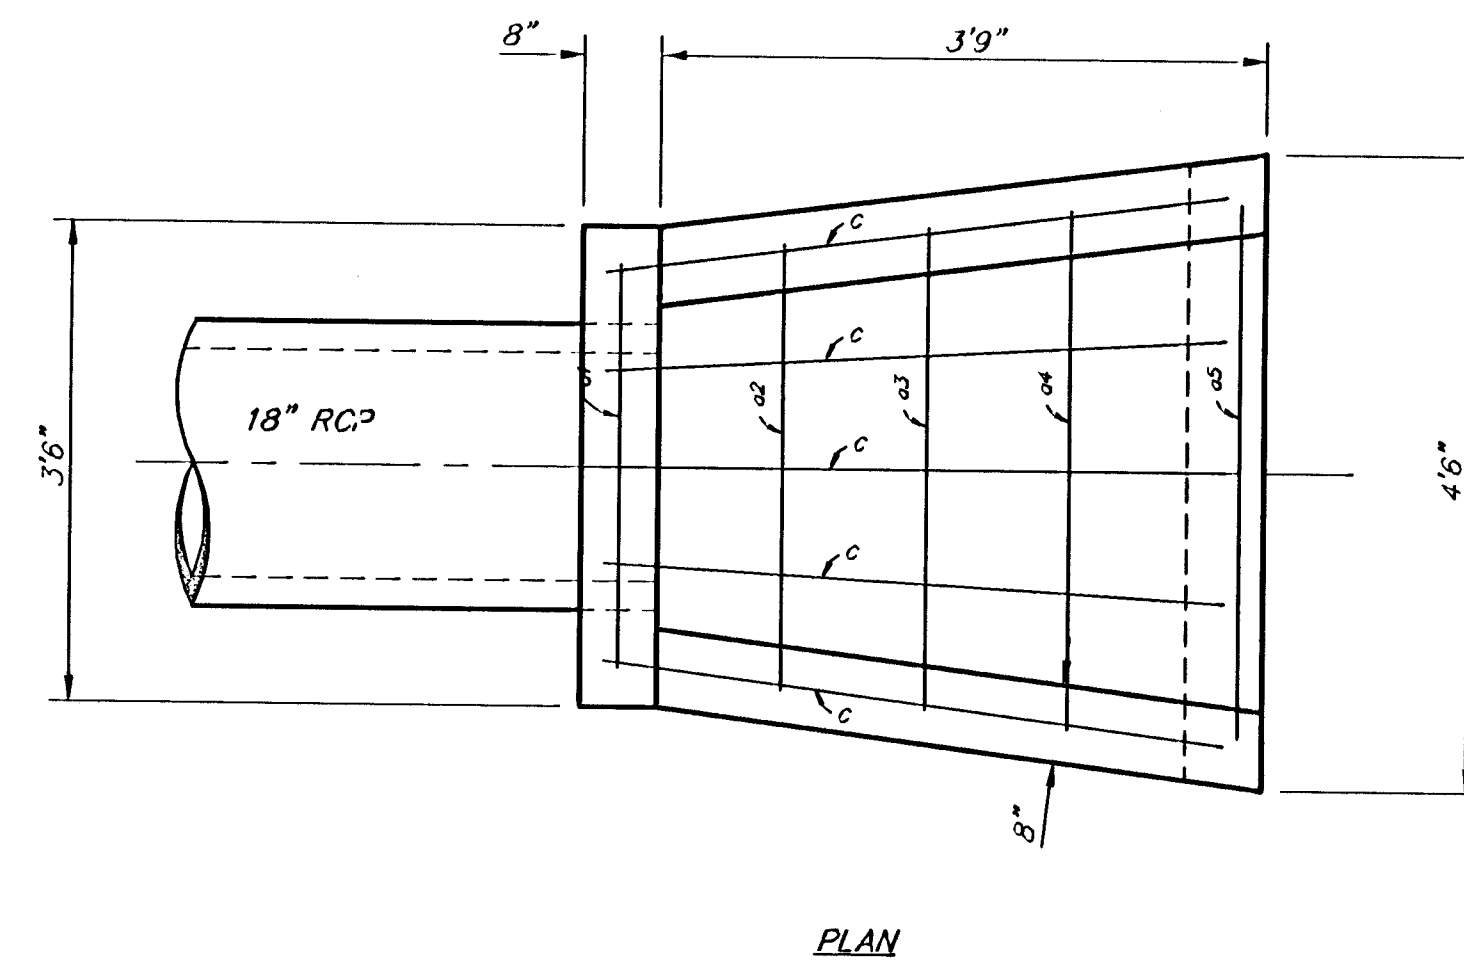

REBAR SCHEDULE				
Bar	Shape	No.	Length	Weight
a1		1	7'2"	4.79
a2		1	6'1"	4.06
a3		1	5'8"	3.79
a4		1	5'3"	3.51
a5		1	5'0"	3.34
b		2	4'0"	5.34
c		5	5'6"	18.37
d		1	4'0"	2.67
e		1	3'2"	2.12
Total Rebar			47.99 Lbs.	
Concrete			0.91 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.
 * Field Bend or Cut Reinforcing as Required for Clearance.
 All Concrete Reinforcement to be #4 Rebar.
 All Rebar to Have Min. of 1 1/2" Conc. Cover

HEADWALL FOR 18" RCP

GENERAL NOTES
 1. All pipes shall be flush cut prior to being cast into concrete headwall.
 2. Concrete used in headwall construction shall be same as per city standard paving mix except that it shall have a minimum 28 day compressive strength of 4000 psi.
 3. All exposed edges shall be beveled 1/2".
 4. Reinforcing steel shall comply to a.s.t.m. designation a615 grade 60. All dimensions relative to reinforcing steel are to centerline of bar unless otherwise noted.
 5. The "Rein. Conc. Headwall" shall be paid for at the unit price bid per each in place which shall include all labor, materials, excavation, concrete, reinforcing steel and all other incidental items necessary to complete the work. Material quantities shown are for information only.
 6. A deduction in concrete quantities has been made for pipe openings through the headwall.
 7. All concrete reinforcement to be #4 Rebar.
 8. All rebar to have min. of 1 1/2" conc. cover.

		Clifton Cove Addition HEADWALL DETAIL STORM WATER DRAIN #269	
Baughman Company, P.A. 315 E. St. White, KS 67111 P 3162627271 F 316262149 ENGINEERING SURVEYING PLANNING LANDSCAPE ARCHITECTURE			
PROJECT NUMBER 468-84024		DESIGN Staff	
REVISIONS		APPROVED DATE 5/30/06	
SCALE Noted		SHEET 16 OF 25	
Clifton Cove Addition			