


Brick barrels less than 16' deep shall have 8" walls except when located within public street or alley pavement; then the wall shall be 12". Brick barrels more than 16' deep shall have 12" walls. The "L" and "W" dimensions shall be a minimum of 5'6" for brick barrels with 8" walls and 6'2" for brick barrels with 12" walls when the brick barrels are over 4' in height. Completed manhole shall be without leaks and watertight.

TOP VIEW

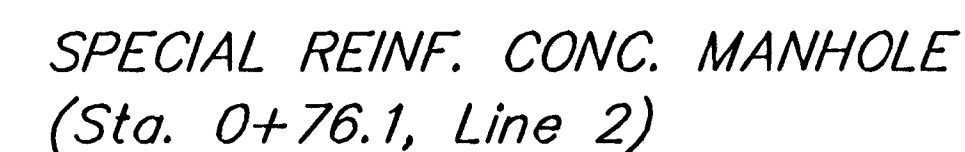

NOTE:
Bend Bars Not More Than 8"
to Clear Pipes, or Cut Bars
2" Clear of Pipe, as Necessary.

 Baughman ENGINEERING	City of Wichita Standard Reinforced Concrete Manhole Strom Water Drain #269												
Baughman Company, P.A. 315 S.W. 8th, Wichita, KS 67211 F3163630721 F3163630749 ENGINEERING SURVEYING PLANNING LANDSCAPE ARCHITECTURE													
PROJECT NUMBER 4684024	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">DESIGN</td> <td style="width: 50%;">DRAWN</td> </tr> <tr> <td style="text-align: center;">C.O.W.</td> <td style="text-align: center;">Staff</td> </tr> <tr> <td style="text-align: center;">APPROVED</td> <td style="text-align: center;">DATE</td> </tr> <tr> <td></td> <td style="text-align: center;">5/30/06</td> </tr> <tr> <td colspan="2" style="padding: 5px;"> SCALE None </td> </tr> <tr> <td colspan="2" style="padding: 5px;"> SHEET </td> </tr> </table>	DESIGN	DRAWN	C.O.W.	Staff	APPROVED	DATE		5/30/06	SCALE None		SHEET	
DESIGN	DRAWN												
C.O.W.	Staff												
APPROVED	DATE												
	5/30/06												
SCALE None													
SHEET													
REVISIONS	17 OF 25												