

PROFESSIONAL
ENGINEERING
CONSULTANTS
PROFESSIONAL ASSOCIATION

DRAINAGE PLAN
AND
SUPPORTING CALCULATIONS

FOR
BRADFORD PLACE
AN ADDITION TO WICHITA, SEDGWICK COUNTY, KANSAS

PREPARED BY
PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
ENGINEERS
WICHITA, KANSAS

OCTOBER 23, 1987



Date _____ Page _____ of _____

Project _____

Item _____

Items For Vicki (Subdivision Committee)

Bradford Place

Bth Street (So Ditch)
High point = Gstewood St.
Low point = Creek in Wichita
Country Club \approx 1,000'
W. of W.L. of Plat.

Total D.A. Contributing to Bth St.
Ditch at W.L. Bradford Place:

Area in Plat = 3.8 Ac.
St R.O.W \downarrow = 2.1
Per Lot = 2.1
5.9 Ac.

Reflection Ridge Commercial:



Date 10.22.87 Page 1 of 8

Project Bradford Place

Item Drainage Plan System 100

I. HYDROLOGY

Use Rational Method $Q = cIA$

1. Determine "C"

	<u>Node</u>	<u>Soil Type</u>	<u>Land Use</u>	<u>C₂</u>	<u>C₁₀₀</u>
<i>in</i>	101	D	Res. 1/8 Acre Lot	0.57	0.79
<i>out</i>	100	(End section)			

2. Determine "I"

	<u>Node</u>	<u>t_c</u>	<u>I₂</u>	<u>I₁₀₀</u>
	101	15	3.83	7.37
	100	(End section)		

3. Determine "A"

	<u>Node</u>	<u>Plan. Units</u>	<u>Area (SF)</u>	<u>Area (Acre)</u>
	101	16.5	165,000	3.79
	100	(End section)		



Date 10.22.87 Page 2 of 8

Project Bradford Place


Item Drainage Plan System 100

4. Determine "Q₂"

<u>Node</u>	<u>C₂</u>	<u>I₂</u>	<u>A</u>	<u>Q₂</u>
101	0.57	3.83	3.79	8.3
100	(End Section)			

5. Determine "Q₁₀₀"

<u>Node</u>	<u>C₁₀₀</u>	<u>I₁₀₀</u>	<u>A</u>	<u>Q₁₀₀</u>
101	0.79	7.37	3.79	22.1
100	(End Section)			




Date 10.22.87 Page 3 of 8
 Project Bradford Place
 Item Drainage Plan System 100

II INLET SIZING / FLOOD ROUTING

<u>Node</u>	<u>Inlet Condition</u>	<u>L</u>	<u>Q_{approach}*</u>	<u>Q_{intercept}‡</u>	<u>Q_{bypass}</u>	<u>to Node</u>
101	Sump	10'	22.1	22.1	0.0	-
100	(End Section)					

* $Q_{approach} = Q_{100}$ (Confine Q_{100} to pipe channel)
 No overflow

‡ $Q_{intercept} =$ Input Q in "storm" program.



Date 10.22.87 Page 4 of 8

Project Bradford Place

Item Drainage Plan System 100

III STREET FLOW


2-Yr

<u>Node</u>	<u>Q₂</u>	<u>Distribution</u>	<u>street slope</u>	<u>d</u>	<u>Comment</u>
101	8.3	35% (W) = 2.9 65% (E) = 5.4	0.7% 0.7%	0.27' 0.35'	OK OK
100	(End Section)				


100-Yr

<u>Contributing Nodes</u>	<u>Q₁₀₀</u>	<u>street slope</u>	<u>Q_{max}*</u>	<u>Comment</u>
101	22.1	0.7%	64.7	OK

* from page 5



Date 10.22.87 Page 5 of 8
 Project Bradford Place
 Item Drainage Plan - System 100

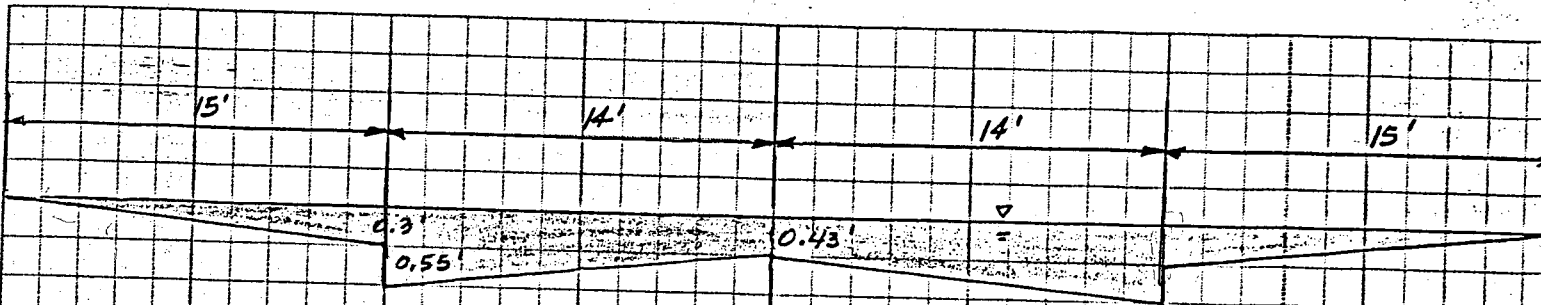

Determine Q_{max} in street R-O-W

Use Manning's Equation $Q = \frac{1.486}{n} A R^{2/3} S^{1/2}$

$$n = \frac{2(14.5 \times 0.03) + 2(3.05 \times 0.013) + 2(12 \times 0.016)}{59.1}$$

$$n = 0.02256$$

$$A = 2(\frac{1}{2} \times 15 \times 0.3) + (28 \times 0.43) + 2(\frac{1}{2} \times 14 \times 0.42)$$

$$A = 22.42 \text{ SF}$$

$$R = A/p = 22.42/59.1 = 0.379357$$

$$R^{2/3} = 0.524041$$

$$Q = \frac{1.486}{0.02256} \times 22.42 \times 0.524041 \times S^{1/2}$$

$$Q = 773.89 \sqrt{S}$$

100 j, 190.0000 100 3 2 1
110 t, drainage plan
120 t, bradford place addition
130 t, storm water sewer system 100 analysis
140 i, 101 0.79 3.79 0.00 0.00 22.10 15.00 192.00
150 m, 100 190.00
160 p, 101 100 130.00 24 0.013 90.00 0.00
170 e

7/3

Date: 10-21-1987
Time: 10:04:48

Input File: brad100

drainage plan
bradford place addition
storm water sewer system 100 analysis

Storm Frequency = 100-Year

* * * HYDROLOGY * * *

Tributary Area								Hydrology Summation				Conduit Data					
Node to	C	Area	Slope	Length	TC(0)	I(0)	Q(0)	TC	I	Q	Sum Q	Size	Velocity	Length	TT	TT+TC	
Node		(Ac)	(%)	(Ft)	(Min)	(In/Hr)	(CFS)	(Min)	(In/Hr)	(CFS)	(CFS)		(Ft/Sec)	(Ft)	(Min)	(Min)	
101	100	0.79	3.79	0.00	0.0	15.00	8.97	22.10	15.00	8.97	22.10	22.10	24"	7.03	130.00	0.31	15.31

8/8

Date: 10-21-1987
Time: 10:04:48

Input File: bradi00

drainage plan
bradford place addition
storm water sewer system 100 analysis

Storm Frequency = 100-Year


* * * H Y D R A U L I C S * * *

```

*****
Node      Hyd-Slope  Friction   Bend      Transition  Manhole  Deflection  Junction  Total  Hyd-GI  Desired  Diff.
          (Ft/Ft)   (Ft)      (Ft)      (Ft)        (Ft)     (Ft)       (Ft)     (Ft)   Elevation Elevation (Ft)
*****
101       0.00954   1.2407    0.0000    0.0000     0.0000   0.0000    0.0000   1.2407  191.2406  192.0000   0.76
100       0.00000   0.0000    0.0000    0.0000     0.0000   0.0000    0.0000   0.0000  190.0000  190.0000   0.00
*****

```

(Joins sheet 28)

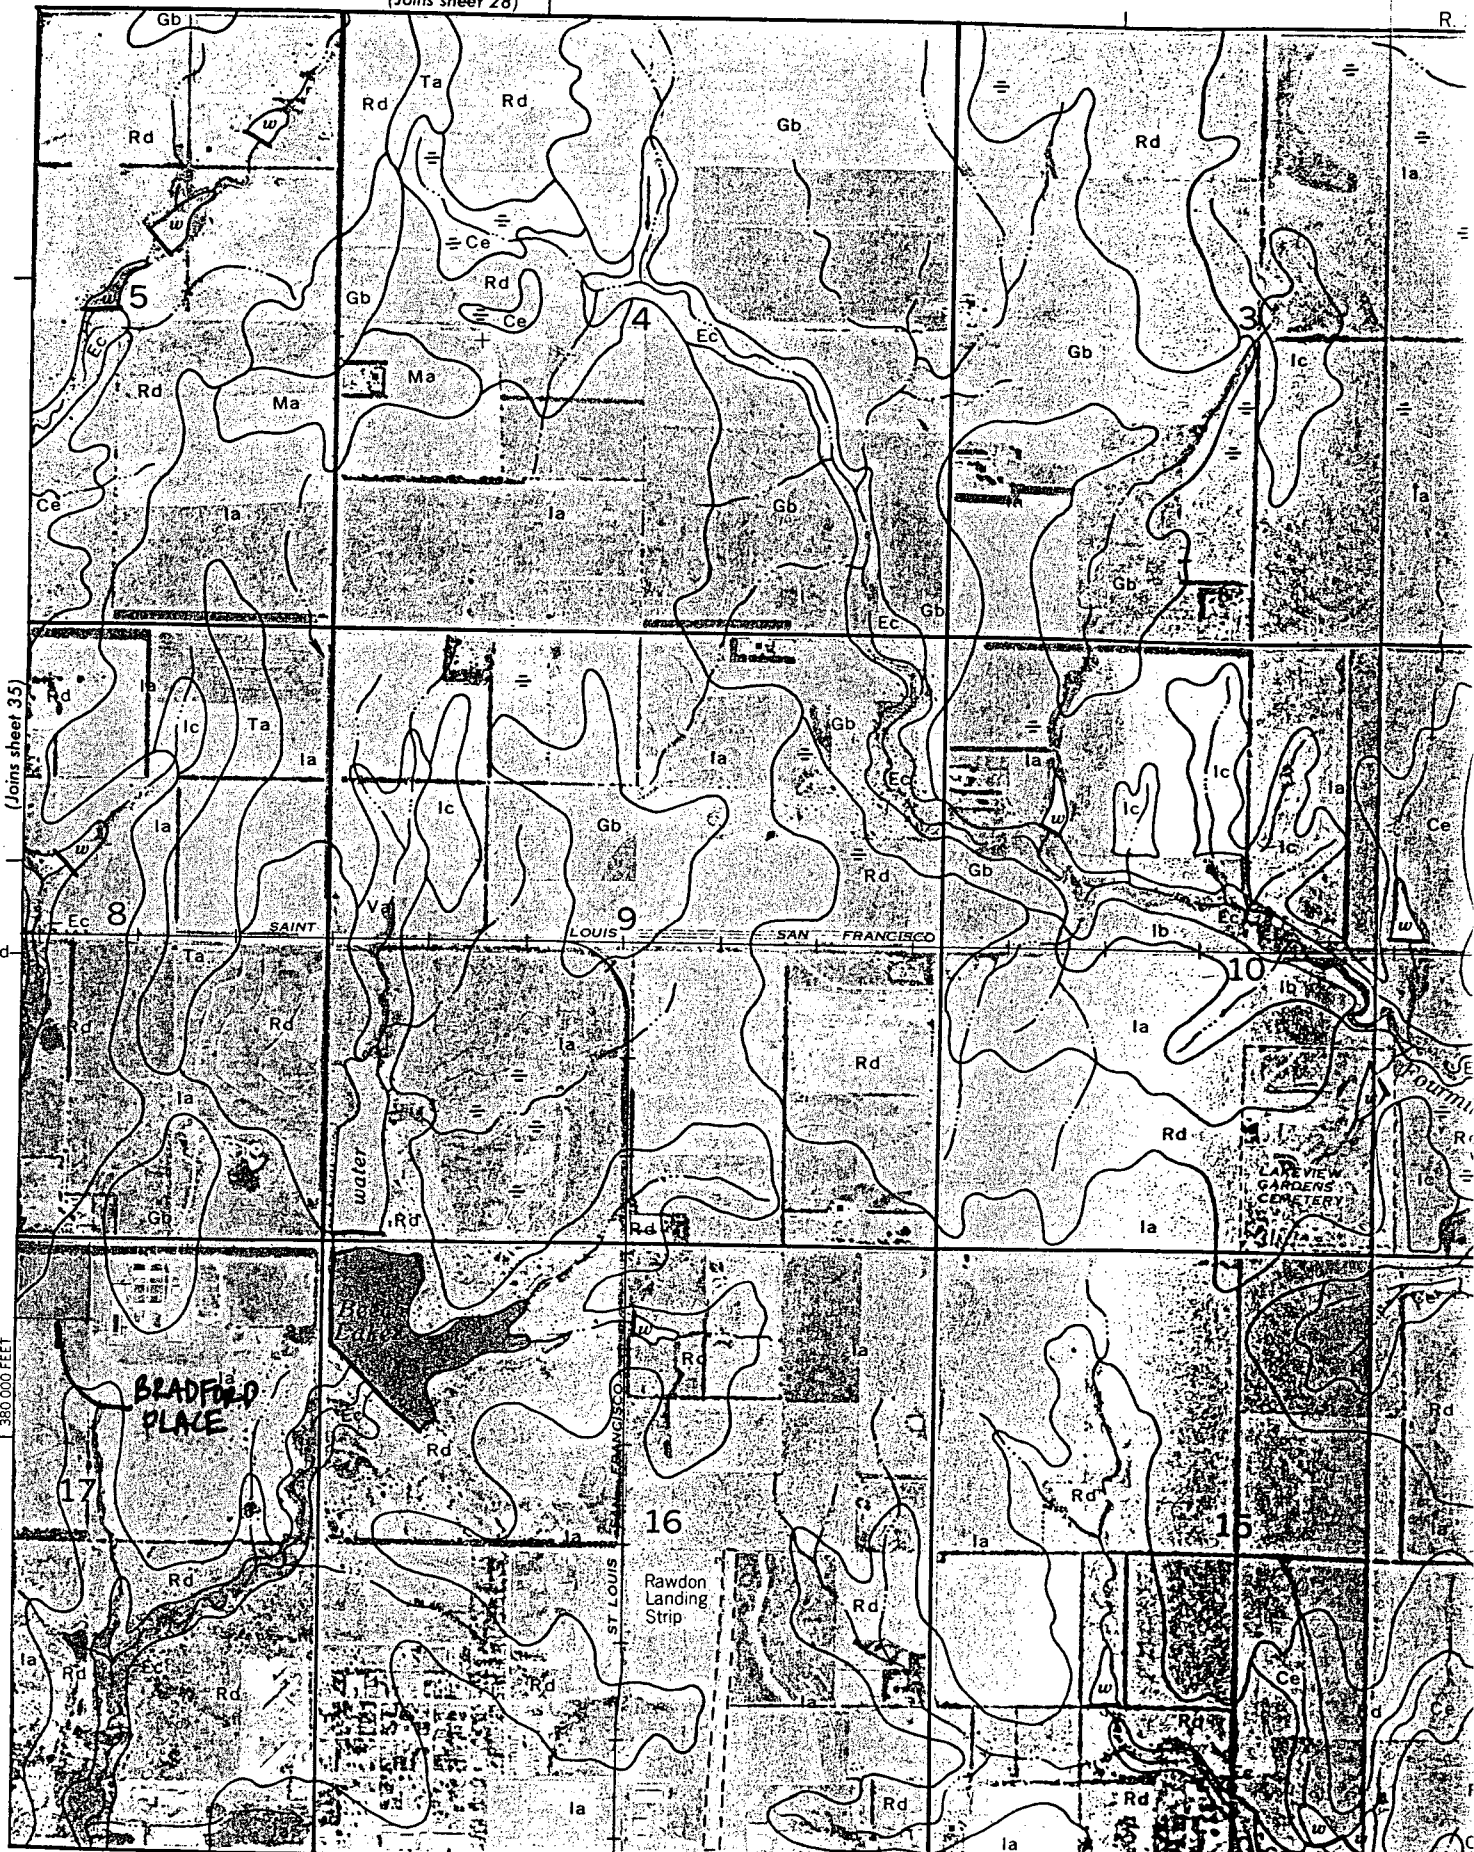

(Joins sheet 44) | 2 370 000 FEET

1 Mile
5,000 Feet

Scale 1:20,000

0 1000 2000 3000 4000 5000

380,000 FEET

(Joins sheet 35)

BLADFORD PLACE

Rawdon Landing Strip

LAKE VIEW GARDENS CONCRETE

(Joins sheet 44) | 2 370 000 FEET

EXHIBIT NO. 1

SOIL LEGEND

<u>SYMBOL</u>	<u>HYDROLOGIC GROUP</u>	<u>NAME</u>
Aa	B	Albion-Shellabarger sandy loams, 1 to 4 percent slopes
Ab	B	Albion and Shellabarger sandy loams, 7 to 15 percent slopes
Ba	C	Blanket silt loam, 0 to 1 percent slopes
Bb	C	Blanket silt loam, 1 to 3 percent slopes
Ca	B	Canadian fine sandy loam
Cb	B	Canadian-Waldeck fine sandy loams
Cc	D	Carwile fine sandy loam
Cd	B	Clark-Ost clay loams, 1 to 4 percent slopes
Ce	C	Cline silty clay, 3 to 6 percent slopes
Ea	B	Elandco silt loam
Eb	B	Elandco silt loam, occasionally flooded
Ec	B	Elandco silt loam, frequently flooded
Fa	B	Farnum loam, 0 to 1 percent slopes
Fb	B	Farnum loam, 1 to 3 percent slopes
Fc	B	Farnum loam, sandy substratum, 0 to 1 percent slopes
Ga	D	Goessel silty clay, 0 to 1 percent slopes
Gb	D	Goessel silty clay, 1 to 2 percent slopes
Ia	D	Irwin silty clay loam, 1 to 3 percent slopes
Ib	D	Irwin silty clay loam, 3 to 6 percent slopes
Ic	D	Irwin silty clay loam, 2 to 6 percent slopes, eroded
La	C	Lesho loam
Lb	A	Lincoln soils
Ma	B	Milan loam, 1 to 3 percent slopes
Mb	B	Milan form, 3 to 6 percent slopes
Mc	B	Milan clay loam, 2 to 6 percent slopes, eroded
Na	B	Naron fine sandy loam
Oc	D	Owens clay loam, 1 to 3 percent slopes
Od	D	Owens-Rock outcrop complex, 3 to 10 percent slopes
Pa		Pits
Pb	D	Plevna fine sandy loam
Pc	A <i>Sandiest</i>	Pratt loamy fine sand, undulating
Pd	A	Pratt-Tivoli complex, rolling
Ra	D	Renfrow silty clay loam, 1 to 3 percent slopes
Rb	D	Renfrow silty clay loam, 3 to 6 percent slopes
Rc	D	Renfrow-Owens clay loams, 1 to 4 percent slopes
Rd	D	Rosehill silty clay, 1 to 3 percent slopes
Sa	B	Shellabarger sandy loam, 1 to 3 percent slopes
Sb	B	Shellabarger sandy loam, 3 to 6 percent slopes
Sc-	B	Shellabarger sandy loam, 3 to 6 percent slopes, eroded
Ta	D	Tabler silty clay loam
Tb	D	Tabler-Drummond complex
Ua	B	Urban land-Canadian complex
Ub	B	Urban land-Elandco complex
Uc	B	Urban land-Farnum complex, 0 to 3 percent slopes
Ud	D	Urban land-Irwin complex, 1 to 3 percent slopes
Ue	D	Urban land-Tabler complex
Va	B	Vanoss silt loam, 0 to 1 percent slopes
Vb	B	Vanoss silt loam, 1 to 3 percent slopes
Vc	B	Vanoss silt loam, 3 to 6 percent slopes
Vd	B	Vanoss silt loam, 3 to 6 percent slopes, eroded
Ve	D	Vernon sandy loam, 1 to 3 percent slopes
Vf	D	Vernon sandy loam, 3 to 6 percent slopes
Wa	C	Waldeck sandy loam
Wb	D	Waurika silt loam

ATTACHMENT D

DRAINAGE CRITERIA

CITY OF WICHITA, KANSAS

RECOMMENDED RUNOFF COEFFICIENTS FOR RATIONAL METHOD
AND PERCENT IMPERVIOUS FOR UNIT HYDROGRAPH METHOD

<u>Land Use or Surface Characteristics</u>	<u>Percent Impervious</u>	<u>Frequency</u>			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
1. Business:					
Downtown Areas	95	0.84	0.85	0.87	0.91
Neighborhood Areas	70	0.68	0.69	0.73	0.80
2. Residential:					
<u>Single Family (Soil Group D)</u>					
1/8 Acre	50	0.57	0.61	0.66	0.79
1/4 Acre	38	0.50	0.54	0.62	0.76
1/3 Acre	30	0.46	0.50	0.59	0.73
1/2 Acre	25	0.42	0.48	0.56	0.72
3/4 Acre	22	0.42	0.46	0.55	0.71
1 Acre	20	0.41	0.45	0.54	0.71
<u>Multi-Family (Soil Group D)</u>					
Multi-Unit (detached)	60	0.62	0.66	0.72	0.82
Multi-Unit (attached)	65	0.64	0.68	0.73	0.83
Apartments	75	0.70	0.73	0.79	0.86
<u>Single Family (Soil Group C)</u>					
1/8 Acre	50	0.55	0.58	0.64	0.73
1/4 Acre	38	0.48	0.51	0.57	0.68
1/3 Acre	30	0.43	0.46	0.53	0.65
1/2 Acre	25	0.40	0.43	0.50	0.63
3/4 Acre	22	0.39	0.42	0.49	0.62
1 Acre	20	0.37	0.40	0.48	0.61
<u>Multi-Family (Soil Group C)</u>					
Multi-Unit (detached)	60	0.60	0.63	0.69	0.77
Multi-Unit (attached)	65	0.63	0.66	0.71	0.79
Apartments	75	0.68	0.72	0.77	0.83
<u>Single-Family (Soil Group B)</u>					
1/8 Acre	50	0.52	0.54	0.59	0.67
1/4 Acre	38	0.44	0.46	0.52	0.61
1/3 Acre	30	0.39	0.41	0.47	0.57
1/2 Acre	25	0.36	0.38	0.44	0.54
3/4 Acre	22	0.34	0.36	0.42	0.52
1 Acre	20	0.33	0.35	0.40	0.51
<u>Multi-Family (Soil Group B)</u>					
Multi-Unit (detached)	60	0.58	0.60	0.65	0.72
Multi-Unit (attached)	65	0.61	0.64	0.68	0.75
Apartments	75	0.67	0.70	0.74	0.80

Land Use or Surface Characteristics	Percent Impervious	Frequency			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
<u>Single Family (Soil Group A)</u>					
1/8 Acre	50	0.47	0.50	0.54	0.60
1/4 Acre	38	0.39	0.41	0.45	0.52
1/3 Acre	30	0.33	0.35	0.39	0.47
1/2 Acre	25	0.30	0.31	0.35	0.44
3/4 Acre	22	0.28	0.29	0.33	0.42
1 Acre	20	0.26	0.28	0.32	0.40
<u>Multi-Family (Soil Group A)</u>					
Multi-Unit (detached)	60	0.55	0.57	0.61	0.67
Multi-Unit (attached)	65	0.58	0.60	0.64	0.70
Apartments	75	0.65	0.68	0.72	0.77
3. Industrial:					
Light Areas	70	0.68	0.69	0.73	0.80
Heavy Areas	80	0.74	0.76	0.79	0.84
4. Playgrounds:	15	0.33	0.35	0.42	0.55
5. Schools:	40	0.49	0.51	0.56	0.66
6. Railroad Yard Areas:	30	0.43	0.45	0.50	0.62
7. Undeveloped Urban Areas: Offsite Flow Analysis (when land use not defined)	45	0.52	0.54	0.59	0.68
8. Streets:					
Paved	99	0.87	0.88	0.90	0.93
Gravel	00	0.24	0.26	0.33	0.48
9. Drive, Parking Lots and Walks:	96	0.87	0.87	0.88	0.89
10. Roofs:	90	0.80	0.85	0.90	0.93
11. Urban Lawn Areas (See Note No. 1 below):					
<u>Soil Group A</u>					
Slope less than 1%	00	0.08	0.09	0.13	0.23
Slope 1% to 4%	00	0.12	0.13	0.17	0.27
Slope more than 4%	00	0.16	0.17	0.21	0.31
<u>Soil Group B</u>					
Slope less than 1%	00	0.16	0.18	0.24	0.37
Slope 1% to 4%	00	0.20	0.22	0.28	0.41
Slope more than 4%	00	0.24	0.26	0.32	0.45
<u>Soil Group C</u>					
Slope less than 1%	00	0.24	0.27	0.35	0.51
Slope 1% to 4%	00	0.26	0.29	0.37	0.53
Slope more than 4%	00	0.28	0.31	0.39	0.55

<u>Land Use or Surface Characteristics</u>	<u>Percent Impervious</u>	<u>Frequency</u>			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
<u>Soil Group D</u>					
Slope less than 1%	00	0.28	0.33	0.43	0.63
Slope 1% to 4%	00	0.30	0.35	0.45	0.65
Slope more than 4%	00	0.32	0.37	0.47	0.67

Note No. 1: Coefficients shown in the above table are for pervious open space areas with thick turf which includes pervious areas in parks and cemeteries. Coefficients shown above must be increased 0.02 for use with agricultural pasture areas. Coefficients shown above must be reduced by 0.04 for use with agricultural cultivated areas. Group A soils are well-drained, coarse textured sands with high infiltration rates. Group B soils are moderately well-drained, moderately coarse textured soils with moderate infiltration rates. Group C soils are moderately poor-drained, moderately fine textured soils with slow infiltration rates. Group D soils are poor-drained, fine textured soils with very slow infiltration rates.

GENERAL NOTE: These Rational Formula Coefficients may not be valid for basins 320 acres or larger.

April 15, 1986

ATTACHMENT A
DRAINAGE CRITERIA MANUAL

CITY OF WICHITA, KANSAS

RAINFALL INTENSITY TABLE FOR SEDGWICK COUNTY, KANSAS

The following tabulation contains rainfall intensity in inches per hour as derived from ESSA Weather Bureau Technical Paper 40 Modified to NWS Hydro-35, 1977 During First Hour

DURATION IN MINUTES	RETURN PERIODS OF						
	1-YR	2-YR	5-YR	10-YR	25-YR	50-YR	100-YR
5	4.18	5.57	6.53	7.41	8.52	9.48	10.32
6	3.99	5.32	6.25	7.09	8.16	9.09	9.89
7	3.81	5.09	5.99	6.81	7.84	8.74	9.50
8	3.66	4.89	5.75	6.55	7.55	8.42	9.15
9	3.52	4.70	5.54	6.31	7.28	8.13	8.83
10	3.39	4.52	5.34	6.09	7.04	7.86	8.54
11	3.27	4.36	5.16	5.89	6.81	7.61	8.27
12	3.18	4.21	4.99	5.71	6.60	7.38	8.02
13	3.05	4.08	4.84	5.53	6.41	7.17	7.79
14	2.96	3.95	4.69	5.37	6.23	6.97	7.57
15	2.87	3.83	4.56	5.22	6.06	6.78	7.37
16	2.78	3.72	4.43	5.08	5.90	6.60	7.18
17	2.71	3.61	4.31	4.95	5.75	6.44	7.00
18	2.63	3.51	4.20	4.83	5.61	6.29	6.84
19	2.56	3.42	4.10	4.71	5.47	6.14	6.68
20	2.50	3.33	4.00	4.60	5.35	6.00	6.53
21	2.44	3.25	3.90	4.50	5.23	5.87	6.39
22	2.38	3.17	3.81	4.40	5.12	5.75	6.26
23	2.32	3.10	3.73	4.31	5.01	5.63	6.13
24	2.27	3.03	3.65	4.22	4.91	5.52	6.01
25	2.22	2.96	3.57	4.13	4.81	5.41	5.90
26	2.20	2.90	3.50	4.05	4.72	5.31	5.79
27	2.16	2.84	3.43	3.98	4.63	5.21	5.69
28	2.14	2.78	3.37	3.90	4.55	5.12	5.59
29	2.11	2.72	3.30	3.83	4.47	5.03	5.49
30	2.08	2.67	3.24	3.76	4.39	4.94	5.40
31	2.05	2.62	3.19	3.70	4.32	4.86	5.32
32	2.02	2.57	3.10	3.63	4.25	4.79	5.22
33	1.99	2.52	3.05	3.57	4.18	4.71	5.14
34	1.96	2.48	3.01	3.51	4.11	4.63	5.07
35	1.93	2.44	2.98	3.46	4.05	4.56	5.00
36	1.91	2.39	2.93	3.41	3.99	4.50	4.93
37	1.89	2.35	2.88	3.36	3.93	4.43	4.86
38	1.87	2.32	2.84	3.31	3.87	4.37	4.79
39	1.85	2.28	2.80	3.26	3.82	4.31	4.73
40	1.83	2.24	2.76	3.22	3.76	4.25	4.66
41	1.81	2.21	2.72	3.17	3.71	4.19	4.60
42	1.79	2.18	2.68	3.13	3.66	4.13	4.54
43	1.77	2.14	2.64	3.09	3.61	4.08	4.49
44	1.75	2.11	2.61	3.05	3.57	4.03	4.43
45	1.73	2.08	2.57	3.01	3.52	3.98	4.38


ATTACHMENT A CONTINUED
Page 2

DURATION IN MINUTES	RETURN PERIODS OF						
	1-YR	2-YR	5-YR	10-YR	25-YR	50-YR	100-YR
46	1.70	2.05	2.54	2.97	3.48	3.93	4.33
47	1.67	2.02	2.50	2.93	3.44	3.88	4.28
48	1.66	2.00	2.47	2.90	3.39	3.84	4.23
49	1.64	1.97	2.44	2.86	3.35	3.79	4.18
50	1.61	1.95	2.41	2.83	3.32	3.75	4.13
51	1.59	1.92	2.38	2.79	3.28	3.71	4.09
52	1.56	1.89	2.35	2.76	3.24	3.67	4.05
53	1.54	1.86	2.33	2.73	3.20	3.63	4.00
54	1.52	1.84	2.30	2.70	3.17	3.59	3.96
55	1.50	1.81	2.27	2.67	3.14	3.55	3.92
56	1.47	1.79	2.25	2.64	3.10	3.51	3.88
57	1.45	1.76	2.22	2.61	3.07	3.48	3.84
58	1.43	1.74	2.20	2.59	3.04	3.44	3.81
59	1.42	1.72	2.18	2.56	3.01	3.41	3.77
60	1.40	1.69	2.15	2.53	2.98	3.37	3.73
61	1.38	1.67	2.13	2.51	2.95	3.34	3.70
62	1.36	1.65	2.11	2.48	2.92	3.31	3.67
63	1.34	1.63	2.09	2.46	2.89	3.28	3.63
64	1.33	1.61	2.07	2.44	2.86	3.25	3.60
65	1.31	1.59	2.05	2.41	2.84	3.22	3.57
66	1.30	1.57	2.03	2.39	2.81	3.19	3.54
67	1.28	1.56	2.01	2.37	2.79	3.16	3.51
68	1.26	1.54	1.99	2.35	2.76	3.13	3.48
69	1.25	1.52	1.97	2.33	2.74	3.10	3.45
70	1.24	1.50	1.95	2.31	2.71	3.08	3.42
71	1.22	1.49	1.93	2.28	2.69	3.05	3.39
72	1.21	1.47	1.92	2.26	2.67	3.02	3.36
73	1.20	1.46	1.90	2.25	2.64	3.00	3.34
74	1.18	1.44	1.88	2.23	2.63	2.98	3.31
75	1.17	1.43	1.86	2.21	2.61	2.95	3.29
76	1.16	1.41	1.85	2.19	2.58	2.93	3.26
77	1.15	1.40	1.83	2.17	2.55	2.90	3.24
78	1.13	1.38	1.82	2.15	2.53	2.88	3.22
79	1.12	1.37	1.80	2.14	2.50	2.86	3.19
80	1.11	1.36	1.79	2.12	2.48	2.84	3.16
81	1.10	1.34	1.77	2.10	2.46	2.82	3.13
82	1.09	1.33	1.76	2.08	2.43	2.79	3.10
83	1.08	1.32	1.74	2.06	2.41	2.76	3.07
84	1.07	1.31	1.73	2.04	2.39	2.74	3.04
85	1.06	1.30	1.72	2.02	2.37	2.71	3.01
86	1.05	1.28	1.70	2.00	2.34	2.69	2.99
87	1.04	1.27	1.69	1.99	2.32	2.66	2.96
88	1.03	1.26	1.68	1.97	2.30	2.64	2.93
89	1.02	1.25	1.68	1.95	2.28	2.62	2.91
90	1.01	1.24	1.66	1.93	2.26	2.59	2.88

ATTACHMENT A CONTINUED
Page 3

<u>DURATION IN MINUTES</u>	<u>RETURN PERIODS OF</u>						
	<u>1-YR</u>	<u>2-YR</u>	<u>5-YR</u>	<u>10-YR</u>	<u>25-YR</u>	<u>50-YR</u>	<u>100-YR</u>
91	1.00	1.23	1.65	1.92	2.24	2.57	2.86
92	1.00	1.22	1.63	1.90	2.22	2.55	2.83
93	0.99	1.21	1.62	1.89	2.20	2.53	2.81
94	0.98	1.20	1.61	1.87	2.19	2.51	2.79
95	0.97	1.19	1.59	1.85	2.17	2.49	2.76
96	0.96	1.18	1.58	1.84	2.15	2.46	2.74
97	0.96	1.17	1.57	1.82	2.13	2.44	2.72
98	0.95	1.16	1.56	1.81	2.12	2.42	2.70
99	0.94	1.15	1.54	1.80	2.10	2.41	2.67
100	0.93	1.14	1.53	1.78	2.08	2.39	2.65
101	0.93	1.13	1.52	1.77	2.07	2.39	2.65
102	0.92	1.13	1.51	1.75	2.05	2.35	2.61
103	0.91	1.12	1.50	1.74	2.04	2.33	2.59
104	0.90	1.11	1.49	1.73	2.02	2.31	2.57
105	0.90	1.10	1.47	1.72	2.01	2.30	2.55
106	0.89	1.09	1.46	1.70	1.99	2.28	2.54
107	0.88	1.09	1.45	1.69	1.98	2.26	2.52
108	0.88	1.08	1.44	1.68	1.96	2.25	2.50
109	0.87	1.07	1.43	1.67	1.95	2.23	2.48
110	0.87	1.06	1.42	1.65	1.93	2.21	2.46
111	0.86	1.06	1.41	1.64	1.92	2.20	2.45
112	0.85	1.05	1.40	1.63	1.91	2.18	2.43
113	0.85	1.04	1.39	1.62	1.89	2.17	2.41
114	0.84	1.03	1.38	1.61	1.88	2.15	2.40
115	0.84	1.03	1.37	1.60	1.87	2.14	2.38
116	0.83	1.02	1.36	1.59	1.86	2.12	2.36
117	0.82	1.01	1.36	1.58	1.84	2.11	2.35
118	0.82	1.01	1.35	1.57	1.83	2.09	2.33
119	0.81	1.00	1.34	1.56	1.82	2.08	2.32
120	0.81	0.99	1.33	1.55	1.81	2.07	2.30

<u>DURATION IN HOURS</u>	<u>RETURN PERIODS OF</u>						
	<u>1-YR</u>	<u>2-YR</u>	<u>5-YR</u>	<u>10-YR</u>	<u>25-YR</u>	<u>50-YR</u>	<u>100-YR</u>
2	0.81	0.99	1.33	1.55	1.81	2.07	2.30
3	0.59	0.72	0.97	1.13	1.32	1.51	1.68
4	0.47	0.58	0.78	0.91	1.06	1.21	1.35
5	0.40	0.49	0.66	0.77	0.89	1.02	1.14
6	0.35	0.42	0.57	0.67	0.78	0.89	0.99
8	0.28	0.34	0.46	0.53	0.62	0.71	0.79
10	0.23	0.29	0.39	0.45	0.52	0.60	0.67
12	0.20	0.25	0.33	0.39	0.45	0.52	0.58
18	0.15	0.18	0.24	0.28	0.33	0.38	0.42
24	0.12	0.15	0.20	0.23	0.27	0.31	0.34

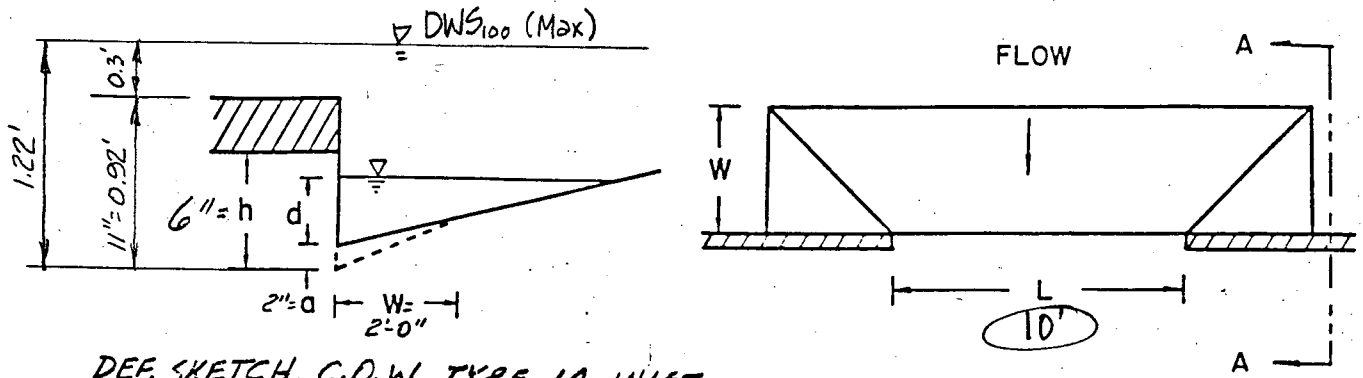

DEF. SKETCH, C.O.W. TYPE 1A INLET

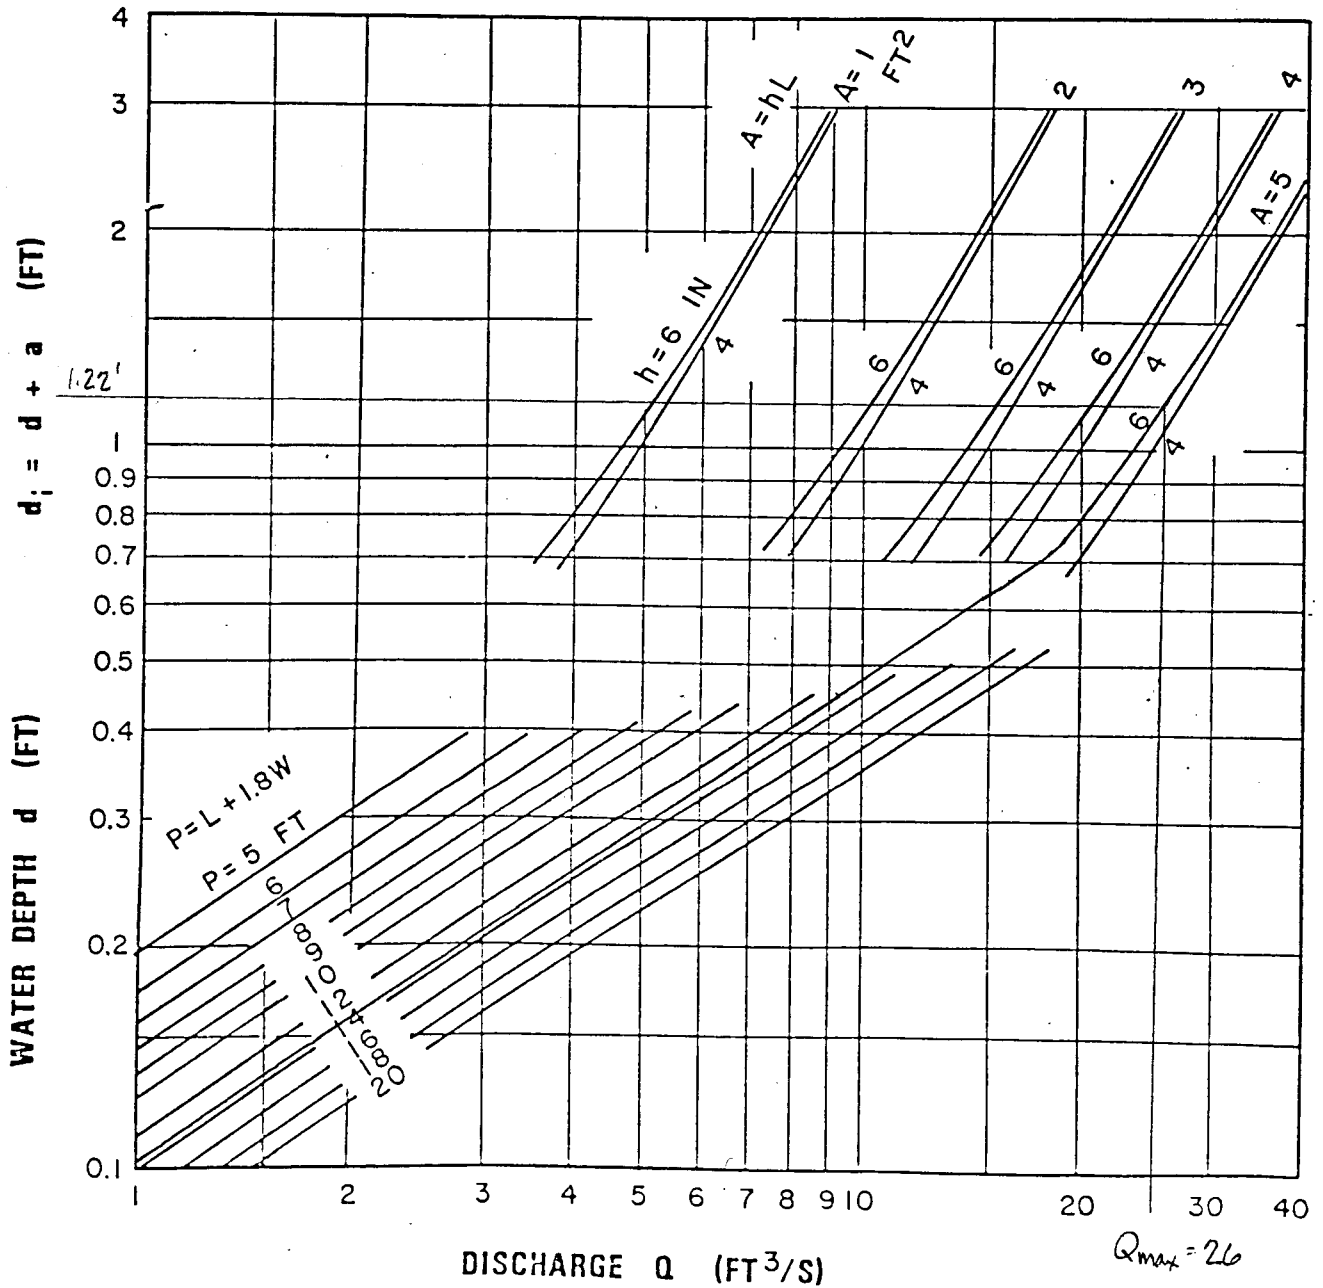


CHART 12. Depressed curb-opening inlet capacity in sump locations.

FROM: HEC-12, DRAINAGE OF HIGHWAY PAVEMENTS, F.H.W.A., MAR., 1974

Bradford place


x-slope = $\frac{3}{8}''/1' = 0.03125''/1'$

Z = $\frac{1}{x\text{-slope}} = \frac{1}{0.03125} = 32$

n = 0.016

Z/n = $\frac{32}{0.016} = 2,000$

Chart 1




EQUATION: $Q = 0.56 \left(\frac{Z}{n}\right) s^{3/2} d^{5/2}$
 n IS ROUGHNESS COEFFICIENT IN MANNING
 FORMULA APPROPRIATE TO MATERIAL IN
 BOTTOM OF CHANNEL
 Z IS RECIPROCAL OF CROSS SLOPE
 REFERENCE: H. R. B. PROCEEDINGS 1946,
 PAGE 150, EQUATION (14)

EXAMPLE (SEE INSTRUCTION 1)

GIVEN: $s = 0.03$
 $Z = 32$
 $n = .02$ $Z/n = 1200$
 $Q = 20 \text{ CFS}$

FIND: $d = 0.22$ BY FOLLOWING
 DASHED LINES

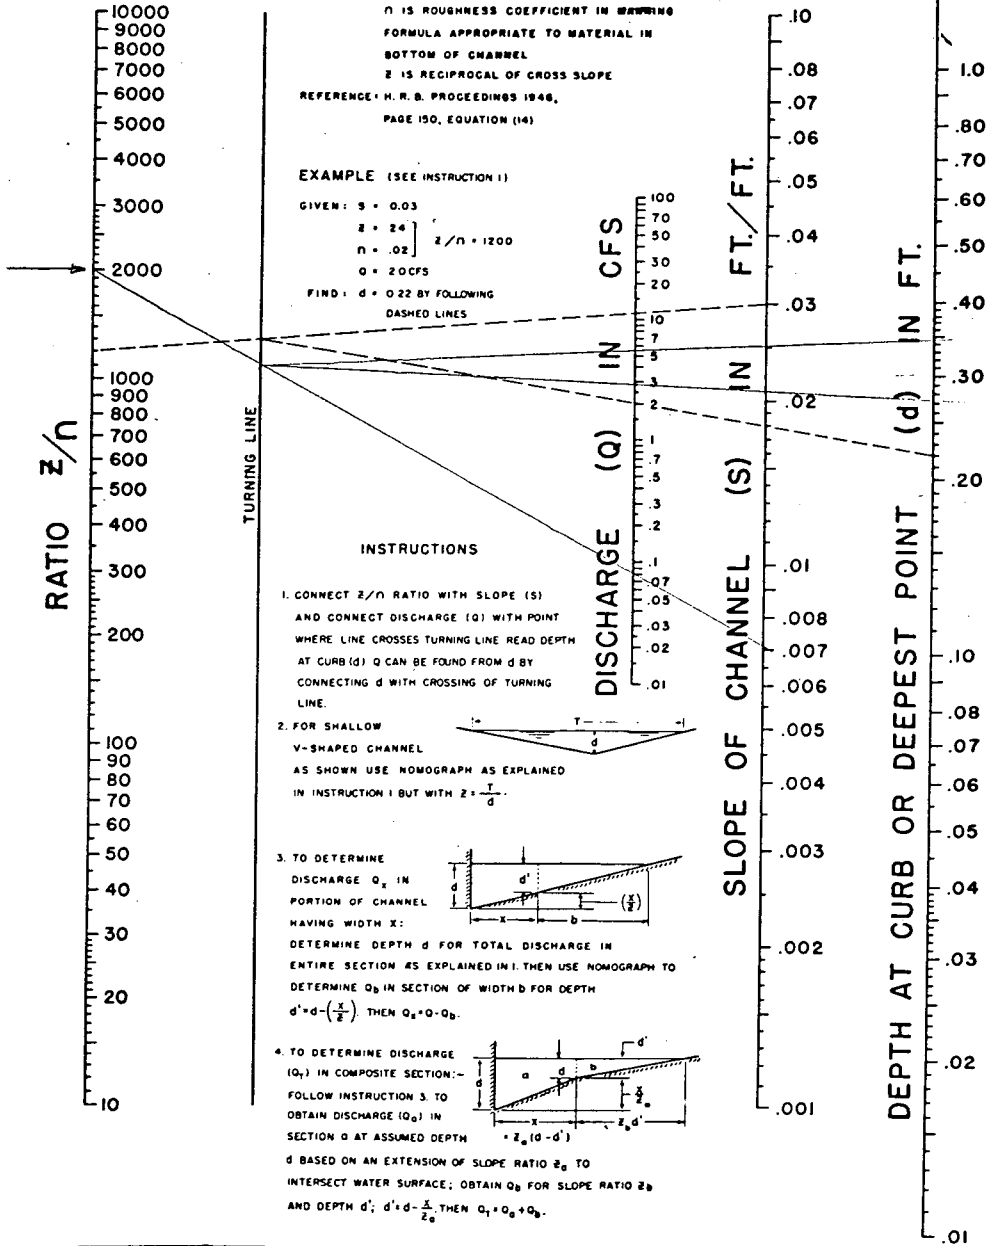

INSTRUCTIONS

- CONNECT Z/n RATIO WITH SLOPE (S) AND CONNECT DISCHARGE (Q) WITH POINT WHERE LINE CROSSES TURNING LINE. READ DEPTH AT CURB (d). Q CAN BE FOUND FROM d BY CONNECTING d WITH CROSSING OF TURNING LINE.
- FOR SHALLOW V-SHAPED CHANNEL AS SHOWN USE NOMOGRAPH AS EXPLAINED IN INSTRUCTION 1 BUT WITH $Z = \frac{T}{d}$.
- TO DETERMINE DISCHARGE Q_x IN PORTION OF CHANNEL HAVING WIDTH X: DETERMINE DEPTH d FOR TOTAL DISCHARGE IN ENTIRE SECTION AS EXPLAINED IN 1. THEN USE NOMOGRAPH TO DETERMINE Q_b IN SECTION OF WIDTH b FOR DEPTH $d' = d - (\frac{x}{z})$. THEN $Q_x = Q - Q_b$.
- TO DETERMINE DISCHARGE (Q_1) IN COMPOSITE SECTION: FOLLOW INSTRUCTION 3. TO OBTAIN DISCHARGE (Q_0) IN SECTION a AT ASSUMED DEPTH $d = z_0 (a - d')$ TO b BASED ON AN EXTENSION OF SLOPE RATIO z_0 TO INTERSECT WATER SURFACE; OBTAIN Q_b FOR SLOPE RATIO z_b AND DEPTH d' ; $d' = d - \frac{x}{z_0}$. THEN $Q_1 = Q_0 + Q_b$.