

**P**ROFESSIONAL  
**E**NGINEERING  
**C**ONSULTANTS  
PROFESSIONAL ASSOCIATION

**DRAINAGE PLAN**  
**AND**  
**SUPPORTING CALCULATIONS**  
**FOR**  
**STERLING FARMS 3RD ADDITION**  
**AN ADDITION TO WICHITA, KANSAS**

**PREPARED BY**  
**PROFESSIONAL ENGINEERING CONSULTANTS, P.A.**  
**ENGINEERS**  
**WICHITA, KANSAS**

**APRIL 12, 1993**

303 S. TOPEKA  
WICHITA, KANSAS 67202  
(316) 262-2691  
FAX (316) 262-3003

# MEMO



TO: Michael E. Lindebak, P.E.  
455 N. Main, 7th Floor  
Wichita, KS 67202

PROJECT NO. 36-93178-2051  
PROJECT: Sterling Farms 3rd Addition  
Drainage Plan

COPIES TO:

ATTN: Vicky Huang, P.E.

DATE: 4/9/93

Jack Ritchie

FROM: Michael W. Berry, P.E. *MB*

REFERENCE: Drainage Plan Computations

PLEASE ADVISE IMMEDIATELY OF ANY MISCONCEPTIONS OR OMISSIONS YOU BELIEVE TO BE CONTAINED HEREIN.

Attached hereto are the computations for the referenced project.

The publication Interim Drainage and Storm Sewer Policy for Design Criteria and Documentation, City of Wichita, as revised 7/1/87, was used as the guideline for the hydrologic and hydraulic computations. This publication is hereinafter referred to as the "Design Manual."

Manual #1, as referenced herein, refers to Design of Urban Highway Drainage - The State of the Art, by Reitz & Jens, Inc., April 1980. Manual #2 refers to Drainage of Highway Pavements, Hydraulic Engineering Circular #12, by Tye Engineering, Inc., March 1984.

The analysis made herein is based on the available site data which includes 1"=100' topographic map with 2' contours, project plans for various improvements on adjacent lands, and the original Drainage Plans for the Sterling Farms Addition (1988) and Sterling Farms 2nd Addition (1993).

## HYDROLOGIC ANALYSIS FOR STORM WATER SEWERS

For storm sewer design, the Rational Method was used for hydrologic analysis in accordance with the Design Manual. Runoff coefficients were estimated based on tables provided in the Manual.

For this development, a uniform assumption of the minimum time of concentration value of 15 minutes was appropriate.

Travel time for flow-through defined channels, pipes, etc., for these basins was estimated on the basis of Manning's Equation.

Michael E. Lindebak, P.E.  
Sterling Farms 3rd Addition Drainage Plan  
April 9, 1993  
Page 2

## HYDRAULIC ANALYSIS FOR STORM WATER SEWERS

For each inlet, street flooding and inlet capacity was checked for the minor storm. Conveyance in the street was based on the modified Manning's Equation:

$$Q = 0.56 (Z/n) S^{1/2} d^{8/3} \text{ (Manual \#1)}$$

It was assumed that  $t_c$  for street flow was equal to  $t_c$  for pipe flow. This is a conservative assumption, as pipe velocities generally exceed gutter velocities.

For local streets, curb-deep flow is tolerable for the minor storm. For collectors, a single eight-foot center line should remain unflooded for the minor storm.

Inlet capacities were determined by the methods presented in Manual #2, using Chart No. 12.

In this analysis, City of Wichita Type 1A inlets and 3/8 in./ft. street cross-slope were assumed to be utilized. Minimum walk grade was assumed as 0.3 feet above the top of curb, except as otherwise noted. Local streets are assumed to have 3-5/8" roll curb and gutter as shown.

All storm sewer systems serve residential streets. Therefore, the design minor storm has a recurrence interval of two years, and the major storm one hundred years. Systems are designed for the minor storm, with major storm overflows directed through pipes at sump locations to the ponds.

To simplify analysis, the following assumptions were made:

1. The time of concentration is identical for both the major and minor storm.
2. The street conveyance was analyzed using only the street width. Depths above the curb up to the walk grade were used, but the conveyance of the parking was neglected. In general, the parking area conveyance is quite small, due to the relatively higher "n" factor.

Hydraulic computations for the pipe system were performed using PEC's Storm Program. This program uses Manning's Equation to calculate friction losses in pipes flowing full. Minor losses are computed by momentum principles at each structure. All pipes were assumed to be reinforced concrete with a Manning's "n" factor of 0.013. It is desirable to keep the hydraulic grade line approximately one foot below the top of curb elevations for the minor storm.

## HYDRAULIC MODELS FOR DETENTION

The detention basin was analyzed in the report prepared for Sterling Farms 2nd Addition and is reprinted herein in the section entitled "Post Developed Conditions."

## DRAINAGE MAP

A 1"=100' scale drainage map is included in a map pocket at the back of the report.



Revised 4/9/93 MNB

Date October 26, 1988 Page 1 of 10

Project Sterling Farms 3rd. Add.

Item Drainage Plan SWS System 5


I HYDROLOGY Use Rational Formula  $Q = CIA$

Determine "C"

	<u>Node</u>	<u>Soil Type</u>	<u>Hyd. Group</u>	<u>Land Use</u>	<u>C<sub>2</sub></u>	<u>C<sub>100</sub></u>
	505	Bb	C	Res; 1/4 Ac Lot	0.48	0.68
	504	Bb	C	Res; 1/4 Ac Lot	0.48	0.68
	503	Bb	C	Res; 1/4 Ac Lot	0.48	0.68
combined	502	Bb	C	Res; 1/4 Ac Lot	0.48	0.68
	501	Bb	C	Res; 1/4 Ac Lot	0.48	0.68
	500	(Headwall)				

Determine "I"

	<u>Node</u>	<u>t<sub>c</sub></u>	<u>I<sub>2</sub></u>	<u>I<sub>100</sub></u>
	505	15	3.83	7.37
	504	15	3.83	7.37
	503	15	3.83	7.37
combined	502	15	3.83	7.37
	501	15	3.83	7.37
	500	(Headwall)		



Revised 4/9/93 MNB

Date Oct. 26, 1988 Page 2 of 10

Project Sterling Farms 3rd Add.

Item Drainage Plan System 5

Determine "A"

	<u>Node</u>	<u>Plan. Units</u>	<u>Area SF</u>	<u>Area Ac</u>
	505	262	41,920	0.96
	504	449	71,840	1.65
	503	604	96,640	2.22
combined	{ 502	403	74,080	1.70
	{ 501	228	36,480	0.84
	500	(Headwall)		

Determine "Q<sub>2</sub>"

	<u>Node</u>	<u>C<sub>2</sub></u>	<u>I<sub>2</sub></u>	<u>A</u>	<u>Q<sub>2</sub></u>
	505	0.48	3.83	0.96	1.8
	504	0.48	3.83	1.65	3.0
	503	0.48	3.83	2.22	4.1
combined	{ 502	0.48	3.83	1.70	3.17
	{ 501	0.48	3.83	0.84	1.5
	500	(Headwall)			

~~5.155~~

4.6



Revised 4/9/93

Date Oct. 26, 1988 Page 3 of 10

Project Sterling Farms 3rd Add.

Item Drainage Plan System 5

Determine "Q<sub>100</sub>"

	<u>Node</u>	<u>C<sub>100</sub></u>	<u>I<sub>100</sub></u>	<u>A</u>	<u>Q<sub>100</sub></u>
	505	0.68	7.37	0.96	4.8
	504	0.68	7.37	1.65	8.3
	503	0.68	7.37	2.22	11.1
combined	502	0.68	7.37	1.70	8.5
	501	0.68	7.37	0.84	4.2
	500	(Headwall)			<del>2 = 36.9</del>

II INLET SIZING

Size for <sup>Q<sub>100</sub></sup> ~~Q<sub>2</sub>~~ at all nodes ~~except 501~~  
~~Size for Q<sub>100</sub> 501-500~~

<u>Node</u>	<u>Inlet Cond.</u>	<u>Q<sub>100</sub></u>	<u>Q<sub>max</sub>*</u>	<u>Q<sub>intercept</sub>†</u>	<u>Q<sub>bypass</sub></u>	<u>to</u>	<u>Use</u>
505	Sump	4.8	11	4.8	0.0	-	5'
504	Sump	8.3	11	8.3	0.0	-	5'
503	Sump	11.1	11	11.1	0.0	-	5'
<del>502</del>	<del>Sump</del>		<del>#</del>		<del>0.0</del>	-	<del>5'</del>
501	Sump	12.7	32	12.7	0.0	-	10'

\* see charts & nomographs

† Input Q in "storm" program.

100 j,	1346.5000	506	4	3	3					
110 t,	Sterling Farms 3rd Addition Drainage Plan									
120 t,	North System 100 yr									
130 t,	Professional Engineering Consultants, P.A.									
140 t,	MWBerry	4/9/93								
150 i,	503	0.68	2.22	0.00	0.00	11.10	15.00	1353.30		
160 i,	504	0.68	1.65	0.00	0.00	8.30	15.00	1353.00		
170 i,	505	0.68	0.96	0.00	0.00	4.80	15.00	1353.00		
175 m,	506	1351.0								
180 p,	503	504	70.00	18	0.013	90.00	0.00			
190 p,	504	505	30.00	24	0.013	0.00	0.00			
200 p,	505	506	150.00	24	0.013	0.00	0.00			
210 e										

Date: 04-09-1993  
Time: 13:31:50

Input File: c:\storm\stfarm3z.stm

Sterling Farms 3rd Addition Drainage Plan  
North System 100 yr  
Professional Engineering Consultants, P.A.  
MWBerry 4/9/93

Storm Frequency = 100-Year

\* \* \* H Y D R O L O G Y \* \* \*

Tributary Area										Hydrology Summation				Conduit Data				
Node to Node	C	Area (Ac)	Slope (%)	Length (Ft)	TC(0) (Min)	I(0) (In/Hr)	Q(0) (CFS)	TC (Min)	I (In/Hr)	Q (CFS)	Sum Q (CFS)	Size	Velocity (Ft/Sec)	Length (Ft)	TT (Min)	TT+TC (Min)		
503 504	.68	2.22	.00	.0	15.00	7.37	11.10	15.00	7.37	11.10	11.10	18"	6.28	70.00	.19	15.19		
504 505	.68	1.65	.00	.0	15.00	7.37	8.30	15.19	7.33	8.26	19.36	24"	6.16	30.00	.08	15.27		
505 506	.68	.96	.00	.0	15.00	7.37	4.80	15.27	7.32	4.77	24.13	24"	7.68	150.00	.33	15.59		

Date: 04-09-1993  
Time: 13:31:50

Input File: c:\storm\stfarm3z.stm

Sterling Farms 3rd Addition Drainage Plan  
North System 100 yr  
Professional Engineering Consultants, P.A.  
MWBerry 4/9/93

Storm Frequency = 100-Year

\* \* \* HYDRAULICS \* \* \*

```

*****
Node      Hyd-Slope  Friction  Bend  Transition  Manhole  Deflection  Junction  Total  Hyd-Gl  Desired  Diff.
      (Ft/Ft)    (Ft)     (Ft)   (Ft)        (Ft)     (Ft)       (Ft)     (Ft)   Elevation Elevation (Ft)
*****
503      .01117     .7816    .0000   .0000       .0000     .0000      .0000     .7816  1350.9260 1353.3000  2.37
504      .00732     .2197    .0000   .0046       .0000     .3063      .6747     1.2054  1350.1440 1353.0000  2.86
505      .01137     1.7060   .0000   .0326       .0000     .0000      .7002     2.4388  1348.9390 1353.0000  4.06
506      .00000     .0000    .0000   .0000       .0000     .0000      .0000     .0000  1346.5000 1351.0000  4.50
*****
    
```

100 j, 1345.0000 500 4 2 1  
110 t, Sterling Farms 3rd Addition Drainage Plan  
120 t, South SWS System 100 Yr  
130 t, Professional Engineering Consultants, P.A.  
140 t, MWBerry, PE 4/9/93  
150 i, 501 0.68 2.50 0.00 0.00 12.70 15.00 1353.00  
160 m, 500 1350.50  
170 p, 501 500 175.00 18 0.013 0.00 0.00  
180 e

Date: 04-09-1993  
Time: 12:09:10

Input File: c:\storm\stfarm3n.stm

Sterling Farms 3rd Addition Drainage Plan  
South SWS System 100 Yr  
Professional Engineering Consultants, P.A.  
MWBerry, PE 4/9/93

Storm Frequency = 100-Year

\* \* \* H Y D R O L O G Y \* \* \*

Tributary Area										Hydrology Summation				Conduit Data			
Node to	C	Area	Slope	Length	TC(0)	I(0)	Q(0)	TC	I	Q	Sum Q	Size	Velocity	Length	TT	TT+TC	
Node		(Ac)	(%)	(Ft)	(Min)	(In/Hr)	(CFS)	(Min)	(In/Hr)	(CFS)	(CFS)		(Ft/Sec)	(Ft)	(Min)	(Min)	
501	500	.68	2.50	.00	.0	15.00	7.37	12.70	15.00	7.37	12.70	12.70	18"	7.19	175.00	.41	15.41

Date: 04-09-1993  
Time: 12:09:10

Input File: c:\storm\stfarm3n.stm

Sterling Farms 3rd Addition Drainage Plan  
South SWS System 100 Yr  
Professional Engineering Consultants, P.A.  
MWBerry, PE 4/9/93

Storm Frequency = 100-Year

\* \* \* HYDRAULICS \* \* \*

```

*****
Node      Hyd-Slope  Friction  Bend  Transition  Manhole  Deflection  Junction  Total  Hyd-Gl  Desired  Diff.
      (Ft/Ft)    (Ft)    (Ft)    (Ft)    (Ft)    (Ft)    (Ft)    (Ft)    Elevation  Elevation  (Ft)
*****
501      .01462    2.5580   .0000   .0000   .0000   .0000   .0000    2.5580  1347.5580  1353.0000  5.44
500      .00000    .0000   .0000   .0000   .0000   .0000   .0000    .0000  1345.0000  1350.5000  5.50
*****

```



Revised 4/9/93

Date Oct. 26, 1988 Page 10 of 10

Project Sterling Farms 3rd Add.

Item Drainage Plan System 5

IV STREET FLOW

2-YR

<u>Node</u>	<u>Q<sub>2</sub></u>	<u>Distribution</u>	<u>street slope</u>	<u>d</u>	<u>3 5/8" Roll CURB</u> <u>d<sub>max</sub></u>	<u>Comment</u>
505	1.8	50% (N) = 0.9 50% (S) = 0.9	0.50% 0.40%	0.19' 0.19'	0.3' 0.3'	OK OK
504	3.0	40% (N) = 1.2 60% (W) = 1.8	0.5% 0.4%	0.21' 0.25'	0.3' 0.3'	OK OK
503	4.1	≈ 100% (W) = 4.1	0.4%	0.34'	0.3'	Borderline
<del>502</del> 501 W	3.1	≈ 100% (E) = 3.1	0.32%	0.32'	0.3'	Borderline
501 E	1.5	≈ 100% (E) = 1.5	0.4%	0.24'	0.3'	OK
500	(Headwall)					

100-YR

$Q_{street} = Q_{100} - Q_{pipe}$

<u>Location</u>	<u>Contrib. Areas</u>	<u>Q<sub>100</sub></u>	<u>Q<sub>pipe</sub></u>	<u>Q<sub>street</sub></u>	<u>street slope</u>	<u>Q<sub>max</sub></u>	<u>Comment</u>
Approaching Nodes 505 + 504 (N)	50% 505 = 40% 504 =	2.4 3.3 5.7	0.0	5.7	0.50%	29	OK Roll Curb 0.3' WK Gr.
Approaching Nodes 504 + 503 (W)	60% 504 = ≈ 100% 503 =	5.0 11.1 16.1	0.0	16.1	0.4%	25.6	OK Roll Curb 0.3' WK Gr.
Approaching Nodes <del>502</del> + 501 (E)	100% <del>505</del> = 100% 504 = 100% 503 = 100% 502 = 100% 501 =	4.8 8.3 11.1 8.5 4.2	} combined 0.9 <del>26.0</del> 12.7 (502, 505, 504, 503)		0.4%	25.6	OK Roll Curb 0.3' WK Gr.
	<del>36.9</del> 12.7						

Sterling Farms 2nd Addition Drainage Plan  
Proposed Conditions Hydrologic Model  
PEC File 36-92600-2051 2/11/93

Sterling Farms 2nd Addition is a plat lying in the northeast corner of the Southeast Quarter of Section 5, Township 27 South, Range 1 West. This basin has been studied previously in the Drainage Plan for Sterling Farms Addition submitted Nov 4, 1988 and revised Nov. 29, 1988, and in a letter report dated January 30, 1989 submitted with the design of City of Wichita Storm Water Sewer 383. The latter report contained minor revisions to the original report based on field conditions discovered in the design survey and based on final design of the referenced storm sewer. Changes in the hydrologic model from the latest report are as follows:

1. The off-site drainage areas lying east of Tyler Road have been broken into two subareas:
  - a. A tract lying in the northwest quarter of Sec. 4 presently owned by the Kastens family. This basin is approximately 40 acres. The design condition is assumed to be cultivated land. At the time of development, it is assumed that detention will be required on this site to reduce the discharge to values at or below those assumed in this report, that is, for an existing cultivated conditions. Please note that in the development of the hydrologic model, it was discovered that the hydrograph peak discharges in the watershed downstream are extremely sensitive to the timing of flood peaks. Any detention provided must take into account the timing of flood peak as well as the reduction in runoff. Computation sheets for hydraulic parameters are included in this section directly behind the typewritten narrative.
  - b. A tract lying in the west portion of the Southwest Quarter of Section 4, which has been partially developed as Reflection Ridge 3rd Addition (single family residential), Reflection Ridge golf course, and Village Charters. This basin was assumed to be fully developed in accordance with the Drainage Plan document submitted with the platting of Reflection Ridge Addition. There is an existing pond on the No. 5 hole adjacent to Tyler Road. In its present condition, it has no functional outlet due to the lack of a suitable outfall to the west. Development of Sterling Farms 2nd Addition may provide an opportunity to construct an outfall and thereby gain some detention storage in the present lake. In this analysis, however, no detention storage was considered to be available. It should be noted that an enlargement of this lake could serve to provide detention not only for Reflection Ridge, but also possibly for the Kastens property mentioned above if sufficient conveyance along the east side of Tyler Road can be provided.
2. The static pool for Pond No. 1 in Sterling Farms has been assumed to be lowered 0.5 ft to 1346.5. Thus, this pond and the pond immediately downstream operate as a single pond. The culvert between Pond Nos. 1 and 2 has been enlarged to a 3-8' x 3' RCBB.
3. The outlet weir for Pond No. 2 has been changed to 30 ft in length.

As an result of the changes in the model stated above, the following impacts to the Sterling Farms development relative to the original design should be noted:


POND #1: The 100-year Design Water Surface (DWS100) dropped from 1350.72 to 1349.86. The 100-year discharge (Q100) from off-site into the pond increased from 197 cfs to 264 cfs.

POND #2: The DWS100 raised from 1348.70 to 1349.86. This does not affect any lots platted to date. The Q100 out of the pond increased from 238 cfs to 332 cfs.

POND #3: The DWS100 raised from 1348.24 to 1348.78, which should be compared to the platted minimum pad elevation of 1350.0 adjacent to this pond. The Q100 into the lake increased from 634 cfs to 720 cfs, and Q100 out increased from 343 cfs to 383 cfs.

POND #4: The DWS100 raised from 1347.77 to 1348.16, which compares to the platted minimum pad elevation adjacent to the lake of 1349.5. The Q100 into the lake increased from 357 cfs to 397 cfs, and the Q100 out increased from 357 cfs to 396 cfs. This discharge is 8.5% more than the original 25-year design discharge of the 2-9' x 3' reinforced concrete box bridge under 21st Street. However, the design headwater is only 0.1 ft higher than that of the original structure. The reader should note that the detention basins provided have reduced the 100-year runoff for fully developed conditions (except the Kastens property) to within 8.5 % of the 25-year discharge for pre-developed conditions.

# KASTENS PROPERTY

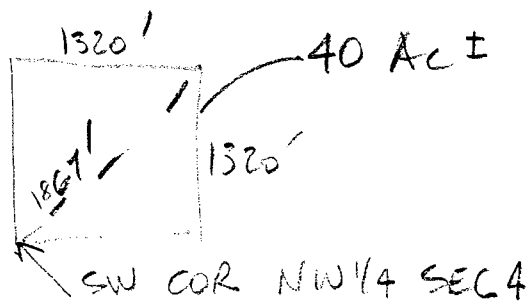

300' SHEET FLOW  
1500' SHALLOW CONC FLOW  
600' DITCH FLOW

$T_1$  SHEET FLOW  $n = 0.17$   $S = 0.01$

$$T_1 = \frac{0.007 (0.17 \times 300)^{0.8}}{\sqrt{3.5} (0.01)^{0.4}} = 0.55 \text{ HR}$$

$T_2$  = SHALLOW CONC FLOW

$$V_2 = 16.1345 \sqrt{0.01} = 1.6 \text{ FT/SEC}$$


$$T_2 = \frac{1500 \text{ FT}}{1.6 \text{ FT/SEC}} \times \frac{1 \text{ MIN}}{60 \text{ SEC}} = 15.5 \text{ MIN} = 0.26 \text{ HR}$$

$T_3$  = DITCH FLOW ASSUME  $V = 1 \text{ FT/SEC}$

$$T_3 = \frac{600}{1} \times \frac{1}{60} = 10 \text{ MIN} = 0.17 \text{ HR}$$

$$T_c = 0.55 + 0.26 + 0.17 = 0.98 \text{ HR} \text{ SAY } \underline{1 \text{ HR}}$$

$$\text{LAG} = 0.6 T_c = 0.6 \text{ HR}$$



Date 2/10/93 MJB Page        of         
Project STERLING FARMS 2ND ADDITION  
Item OFF-SITE DRAINAGE

KASTENS PROPERTY (NW 1/4 SEC 4)

$$DA = 40 \text{ AC} = 0.0625$$

SOIL CLASS B 100%

PROPOSED 1/4 AC LOT SINGLE FAM RES CN = 75

AVAILABLE FALL = 10'

FLOW LENGTH  $\approx$  2500 FT <sup>FUTURE</sup> = AC CURB/GUTTER SYS

$$S_{\text{AVG}} = 0.004 \text{ FT/FT}$$


ASSUME 2 FT/SEC GUTTER VELOCITY

$$T_c = \frac{2500 \text{ FT}}{2 \text{ FT/SEC}} \frac{\text{MIN}}{60 \text{ SEC}} = 21 \text{ MIN.}$$

$$\text{LAG} = 0.6 T_c = 0.2 \text{ HR.}$$

MWB 2/1/93

# REFLECTION RIDGE WEST PORTION

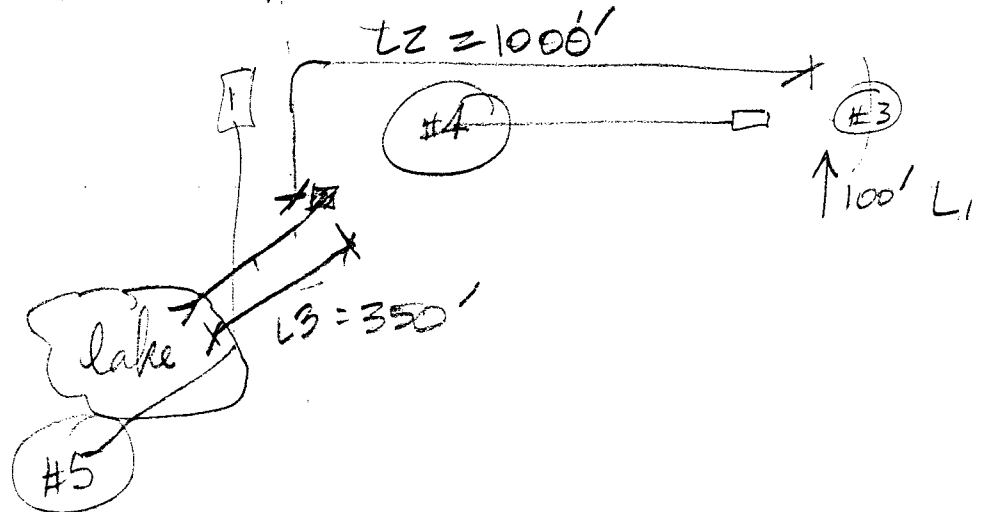

$T_1$  FOR  $L_1 = 100'$  sheet flow

$$T_1 = \frac{0.007 (nD)^{0.8}}{\sqrt{P_2} S^{0.4}} = \frac{0.007 [(0.4)(100)]^{0.8}}{\sqrt{3.5} (0.01)^{0.4}} = 0.45 \text{ hr} = 27 \text{ MIN}$$

$T_2$  FOR  $L_2 = 1000'$  Shallow Conc. Flow

$$V = 16.1345 \sqrt{0.01} = 1.6 \text{ ft/sec}$$


$$T_2 = \frac{1000'}{1.6} \times \frac{1}{60} = 10 \text{ MIN}$$

$T_3$  FOR PIPE FLOW      ASSUME  $V = 6 \text{ FT/SEC}$  FROM "STORM" program

$$T_3 = \frac{L_3}{V} = \frac{350'}{6 \text{ FT/SEC}} \times \frac{1}{60} = 1. \text{ MIN}$$

$$T_c = T_1 + T_2 + T_3 = 27 + 10 + 1 = 38 \text{ MIN}$$

$$\text{Lag} = 0.6 T_c = 23 \text{ MIN} = 0.38 \text{ HR} \quad \text{SAY } 0.4 \text{ HR}$$



Date 2/10/93 MUB Page \_\_\_\_\_ of \_\_\_\_\_

Project STERLING FARMS 2ND ADD'N

Item OFF-SITE DRAINAGE

## REFLECTION RIDGE PROPERTY

INCLUDES NW PORTION VILLAGE CHARTERS

TOTAL AREA = 53 AC = 0.0828

B SOIL

27.7 AC OPEN SPACE GOLF COURSE CN = 58

7.2 AC PATIO HOME 1/8 AC LOT (65% IMP) CN = 85

5.6 AC COMM 85% IMP CN = 92

4.6 + 8.0 = 12.6 AC 1/4 AC RES 38% IMP CN = 75

COMPOSITE

$$CN = \frac{27.7 \times 58 + 7.2 \times 85 + 5.6 \times 92 + 12.6 \times 75}{53} = 69$$

CONSIDER ST/SWS ONLY TO CONTROL.


800 FT STREET @ 2 FT/SEC  $\rightarrow$  6.7 MIN

500 FT PIPE @ 6 FT/SEC  $\rightarrow$  1.4 MIN

8.1 MIN

$T_L = 8.1$  MIN

$Lag = 0.6 T_L = 0.08$  HR  $\Rightarrow$  USE 0.1 HR.



Date 2-11-93 MIB Page \_\_\_\_\_ of \_\_\_\_\_

Project STERLING FARMS CVD ADD'N

Item POND VOLUMES

POND #1 & POND #2 COMBINED

POND #1 LOWER STATIC POOL = 1346.5

	<u>ELEV</u>	<u>STAGE</u>	<u>POND #1 AREA AC</u>	<u>POND #2 AREA AC</u>	<u>TOTAL ACRES</u>
STATIC POOL	1346.5	0	0.2 AC	2.6 AC	2.8 AC
	1347.5	1	0.27 AC		
1-P BOWL	1350.0	5	0.53 AC	3.4 AC	3.9 AC

```

*****
*
* FLOOD HYDROGRAPH PACKAGE (HEC-1) *
* FEBRUARY 1981 *
* REVISED 02 AUG 88 *
*
* RUN DATE 02/11/1993 TIME 22:23:59 *
*
*****

```

```

*****
*
* U.S. ARMY CORPS OF ENGINEERS *
* THE HYDROLOGIC ENGINEERING CENTER *
* 609 SECOND STREET *
* DAVIS, CALIFORNIA 95616 *
* (916) 551-1748 *
*
*****

```

```

X X XXXXXX XXXX X
X X X X X XX
X X X X X
XXXXXXXX XXXX X XXXX X
X X X X X
X X X X X
X X XXXXXX XXXX XXX

```

THIS PROGRAM REPLACES ALL PREVIOUS VERSIONS OF HEC-1 KNOWN AS HEC1 (JAN 73), HEC1GS, HEC1DB, AND HEC1KW.

THE DEFINITIONS OF VARIABLES -RTIMP- AND -RTIOR- HAVE CHANGED FROM THOSE USED WITH THE 1973-STYLE INPUT STRUCTURE.  
 THE DEFINITION OF -AMSKK- ON RM-CARD WAS CHANGED WITH REVISIONS DATED 28 SEP 81. THIS IS THE FORTRAN77 VERSION  
 NEW OPTIONS: DAMBREAK OUTFLOW SUBMERGENCE , SINGLE EVENT DAMAGE CALCULATION, DSS:WRITE STAGE FREQUENCY,  
 DSS:READ TIME SERIES AT DESIRED CALCULATION INTERVAL LOSS RATE:GREEN AND AMPT INFILTRATION  
 KINEMATIC WAVE: NEW FINITE DIFFERENCE ALGORITHM

## HEC-1 INPUT

PAGE 1

```

LINE      ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
1         ID    STERLING FARMS 2ND ADDITION DRAINAGE PLAN
2         ID    PEC PROJECT NO 36-92600-2051
3         ID    STAGE STORAGE ANALYSIS --- 100 YR
4         ID    PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
5         ID    COMPUTED BY M.W.BERRY, P.E. 02/11/93
6         ID    FILENAME="A:\MISCHEC1\STERFAR2.HEC"  DISKNAME="MWB01"

*** FREE ***
*** LIST ***

          *DIAGRAM
7         IT    5 11FEB93      600      0 11FEB93      1800
8         IO    0      0
9         IN    30 11FEB93      600

10        KK  KASTENOFF SITE DRAINAGE - SW /4 NW /4 SEC 4 27 1W - CULTIVATED
11        BA  0.0625
12        PB  7.8
13        PC  0.08  0.09  0.10  0.11  0.12  0.133  0.147  0.163  0.181  0.204
14        PC  0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865
15        PC  0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958
16        PC  0.964 0.970 0.976 0.982 0.988 0.994 1.000
17        LS  0      71      0
18        UD  0.60

19        KK  RRWESTOFF SITE DRAINAGE - WEST PORTION OF REFLECTION RIDGE
20        BA  0.0828
21        PB  7.8
22        PC  0.08  0.09  0.10  0.11  0.12  0.133  0.147  0.163  0.181  0.204
23        PC  0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865
24        PC  0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958
25        PC  0.964 0.970 0.976 0.982 0.988 0.994 1.000
26        LS  0      69      0
27        UD  0.40

28        KK  OFFSITE
29        HC  2      0

30        KK  BASIN1
31        BA  0.0047
32        PB  7.8
33        PC  0.08  0.09  0.10  0.11  0.12  0.133  0.147  0.163  0.181  0.204
34        PC  0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865
35        PC  0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958
36        PC  0.964 0.970 0.976 0.982 0.988 0.994 1.000
37        LS  0      79      0
38        UD  0.25

39        KK  BASIN2
40        BA  0.0578
41        PB  7.8
42        PC  0.08  0.09  0.10  0.11  0.12  0.133  0.147  0.163  0.181  0.204
43        PC  0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865
44        PC  0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958
45        PC  0.964 0.970 0.976 0.982 0.988 0.994 1.000
46        LS  0      81      0
47        UD  0.25

```

HEC-1 INPUT

PAGE 2

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10																			
48	KK INTO2																			
49	HC 3																			
50	KK PON1\$2																			
	* pond #1 static pool lowered to 1346.5																			
	* pond #1 & #2 combined to function together																			
51	RS 1 ELEV 1346.5																			
52	SA 2.8 3.9																			
53	SE 1346.5 1351.5																			
	* note: cofq=1.8 for submergence correction																			
54	SS 1346.5 30.0 1.8 1.5																			
55	KK BASIN3																			
56	BA 0.150																			
57	PB 7.8																			
58	PC 0.08 0.09 0.10 0.11 0.12 0.133 0.147 0.163 0.181 0.204																			
59	PC 0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865																			
60	PC 0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958																			
61	PC 0.964 0.970 0.976 0.982 0.988 0.994 1.000																			
62	LS 0 82 0																			
63	UD 0.25																			
64	KK INTO3																			
65	HC 2																			
66	KK POND3																			
67	RS 1 ELEV 1345																			
68	SV 0 8 16 23 31 35																			
69	SQ 0 40 220 325 400 440																			
70	SE 1344.7 1346.0 1347.0 1348.0 1349.0 1349.5																			
71	KK BASIN4																			
72	BA 0.0188																			
73	PB 7.8																			
74	PC 0.08 0.09 0.10 0.11 0.12 0.133 0.147 0.163 0.181 0.204																			
75	PC 0.235 0.283 0.663 0.735 0.772 0.799 0.820 0.835 0.850 0.865																			
76	PC 0.880 0.890 0.900 0.910 0.916 0.925 0.934 0.943 0.952 0.958																			
77	PC 0.964 0.970 0.976 0.982 0.988 0.994 1.000																			
78	LS 0 76 0																			
79	UD 0.25																			
80	KK INTO4																			
81	HC 2																			
82	KK POND4																			
83	RS 1 ELEV 1344.7																			
84	SV 0.0 0.6 1.1 1.7 2.3 2.8																			
85	SQ 0 40 210 350 450 530																			
86	SE 1344.7 1345.7 1346.7 1347.7 1348.7 1349.7																			
87	ZZ																			

SCHEMATIC DIAGRAM OF STREAM NETWORK

INPUT	(V) ROUTING	(-->) DIVERSION OR PUMP FLOW
LINE	(.) CONNECTOR	(<-->) RETURN OF DIVERTED OR PUMPED FLOW
NO.		
10	KASTEN	
	.	
19	RRWEST	
	.	
28	OFFSITE.....	
	.	
30	BASIN1	
	.	
39	BASIN2	
	.	
48	INTO2.....	
	V	
	V	
50	PON1\$2	
	.	
55	BASIN3	
	.	
64	INTO3.....	
	V	
	V	
66	POND3	
	.	
71	BASIN4	
	.	
80	INTO4.....	
	V	
	V	
82	POND4	

(\*\*\*) RUNOFF ALSO COMPUTED AT THIS LOCATION

```
*****
*
* FLOOD HYDROGRAPH PACKAGE (HEC-1)
* FEBRUARY 1981
* REVISED 02 AUG 88
*
* RUN DATE 02/11/1993 TIME 22:23:59
*
*****
```

```
*****
*
* U.S. ARMY CORPS OF ENGINEERS
* THE HYDROLOGIC ENGINEERING CENTER
* 609 SECOND STREET
* DAVIS, CALIFORNIA 95616
* (916) 551-1748
*
*****
```

```
STERLING FARMS 2ND ADDITION DRAINAGE PLAN
PEC PROJECT NO 36-92600-2051
STAGE STORAGE ANALYSIS --- 100 YR
PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
COMPUTED BY M.W.BERRY, P.E. 02/11/93
FILENAME="A:\MISCHEC1\STERFAR2.HEC" DISKNAME="MWB01"
```

```
8 IO OUTPUT CONTROL VARIABLES
      IPRNT      0 PRINT CONTROL
      IPLOT      0 PLOT CONTROL
      QSCAL      0. HYDROGRAPH PLOT SCALE
```

```
IT HYDROGRAPH TIME DATA
      NMIN      5 MINUTES IN COMPUTATION INTERVAL
      IDATE     11FEB93 STARTING DATE
      ITIME     0600 STARTING TIME
      NQ        145 NUMBER OF HYDROGRAPH ORDINATES
      NDDATE    11FEB93 ENDING DATE
      NDTIME    1800 ENDING TIME
      ICENT     19 CENTURY MARK
```

```
COMPUTATION INTERVAL .08 HOURS
TOTAL TIME BASE 12.00 HOURS
```

```
ENGLISH UNITS
DRAINAGE AREA SQUARE MILES
PRECIPITATION DEPTH INCHES
LENGTH, ELEVATION FEET
FLOW CUBIC FEET PER SECOND
STORAGE VOLUME ACRE-FEET
SURFACE AREA ACRES
TEMPERATURE DEGREES FAHRENHEIT
```

\*\*\* \*\* \*\* \*\* \*\*

```
*****
*
* KASTEN * OFF SITE DRAINAGE - SW /4 NW /4 SEC 4 27 1W - CULTIVATED
*
*****
```

```
9 IN TIME DATA FOR INPUT TIME SERIES
      JXMIN     30 TIME INTERVAL IN MINUTES
      JXDATE    11FEB93 STARTING DATE
      JXTIME    600 STARTING TIME
```

SUBBASIN RUNOFF DATA

```
11 BA SUBBASIN CHARACTERISTICS
      TAREA     .06 SUBBASIN AREA
```

PRECIPITATION DATA

```
12 PB STORM 7.80 BASIN TOTAL PRECIPITATION
```

13 PI INCREMENTAL PRECIPITATION PATTERN

.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.01	.01	.01	.01	.01	.01	.01
.01	.01	.01	.01	.01	.01	.01	.06	.06	.06	.06

.06	.06	.01	.01	.01	.01	.01	.01	.01	.01
.01	.01	.01	.01	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

17 LS SCS LOSS RATE  
 STRTL .82 INITIAL ABSTRACTION  
 CRVNBR 71.00 CURVE NUMBER  
 RTIMP .00 PERCENT IMPERVIOUS AREA

18 UD SCS DIMENSIONLESS UNITGRAPH  
 TLAG .60 LAG

\*\*\*

UNIT HYDROGRAPH  
 38 END-OF-PERIOD ORDINATES

2.	7.	14.	24.	35.	43.	47.	47.	45.	41.
35.	29.	22.	18.	14.	12.	10.	8.	6.	5.
4.	3.	3.	2.	2.	1.	1.	1.	1.	1.
1.	0.	0.	0.	0.	0.	0.	0.		

\*\*\*\*\*

HYDROGRAPH AT STATION KASTEN

\*\*\*\*\*

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*
11	FEB	0600	1	.00	.00	.00	0.	*	11	FEB	1205	74	.11	.02	.09	64.	*
11	FEB	0605	2	.02	.02	.00	0.	*	11	FEB	1210	75	.11	.02	.09	79.	*
11	FEB	0610	3	.02	.02	.00	0.	*	11	FEB	1215	76	.11	.02	.09	93.	*
11	FEB	0615	4	.02	.02	.00	0.	*	11	FEB	1220	77	.11	.02	.09	103.	*
11	FEB	0620	5	.02	.02	.00	0.	*	11	FEB	1225	78	.11	.02	.09	107.	*
11	FEB	0625	6	.02	.02	.00	0.	*	11	FEB	1230	79	.11	.02	.09	106.	*
11	FEB	0630	7	.02	.02	.00	0.	*	11	FEB	1235	80	.06	.01	.05	102.	*
11	FEB	0635	8	.02	.02	.00	0.	*	11	FEB	1240	81	.06	.01	.05	95.	*
11	FEB	0640	9	.02	.02	.00	0.	*	11	FEB	1245	82	.06	.01	.05	86.	*
11	FEB	0645	10	.02	.02	.00	0.	*	11	FEB	1250	83	.06	.01	.05	78.	*
11	FEB	0650	11	.02	.02	.00	0.	*	11	FEB	1255	84	.06	.01	.05	69.	*
11	FEB	0655	12	.02	.02	.00	0.	*	11	FEB	1300	85	.06	.01	.05	61.	*
11	FEB	0700	13	.02	.02	.00	0.	*	11	FEB	1305	86	.04	.01	.03	55.	*
11	FEB	0705	14	.02	.02	.00	0.	*	11	FEB	1310	87	.04	.01	.03	49.	*
11	FEB	0710	15	.02	.02	.00	0.	*	11	FEB	1315	88	.04	.01	.03	44.	*
11	FEB	0715	16	.02	.02	.00	0.	*	11	FEB	1320	89	.04	.01	.03	40.	*
11	FEB	0720	17	.02	.02	.00	0.	*	11	FEB	1325	90	.04	.01	.03	36.	*
11	FEB	0725	18	.02	.02	.00	0.	*	11	FEB	1330	91	.04	.01	.03	33.	*
11	FEB	0730	19	.02	.02	.00	0.	*	11	FEB	1335	92	.03	.01	.03	30.	*
11	FEB	0735	20	.02	.02	.00	0.	*	11	FEB	1340	93	.03	.01	.03	28.	*
11	FEB	0740	21	.02	.02	.00	0.	*	11	FEB	1345	94	.03	.01	.03	25.	*
11	FEB	0745	22	.02	.02	.00	0.	*	11	FEB	1350	95	.03	.01	.03	24.	*
11	FEB	0750	23	.02	.02	.00	0.	*	11	FEB	1355	96	.03	.01	.03	22.	*
11	FEB	0755	24	.02	.02	.00	0.	*	11	FEB	1400	97	.03	.01	.03	21.	*
11	FEB	0800	25	.02	.02	.00	0.	*	11	FEB	1405	98	.02	.00	.02	19.	*
11	FEB	0805	26	.02	.02	.00	0.	*	11	FEB	1410	99	.02	.00	.02	18.	*
11	FEB	0810	27	.02	.02	.00	0.	*	11	FEB	1415	100	.02	.00	.02	17.	*
11	FEB	0815	28	.02	.02	.00	0.	*	11	FEB	1420	101	.02	.00	.02	16.	*
11	FEB	0820	29	.02	.02	.00	0.	*	11	FEB	1425	102	.02	.00	.02	15.	*
11	FEB	0825	30	.02	.02	.00	0.	*	11	FEB	1430	103	.02	.00	.02	14.	*
11	FEB	0830	31	.02	.02	.00	0.	*	11	FEB	1435	104	.02	.00	.02	14.	*
11	FEB	0835	32	.02	.02	.00	0.	*	11	FEB	1440	105	.02	.00	.02	13.	*
11	FEB	0840	33	.02	.02	.00	0.	*	11	FEB	1445	106	.02	.00	.02	12.	*
11	FEB	0845	34	.02	.02	.00	0.	*	11	FEB	1450	107	.02	.00	.02	12.	*
11	FEB	0850	35	.02	.02	.00	0.	*	11	FEB	1455	108	.02	.00	.02	11.	*
11	FEB	0855	36	.02	.02	.00	0.	*	11	FEB	1500	109	.02	.00	.02	11.	*
11	FEB	0900	37	.02	.02	.00	0.	*	11	FEB	1505	110	.02	.00	.02	11.	*
11	FEB	0905	38	.02	.02	.00	0.	*	11	FEB	1510	111	.02	.00	.02	10.	*
11	FEB	0910	39	.02	.02	.00	0.	*	11	FEB	1515	112	.02	.00	.02	10.	*
11	FEB	0915	40	.02	.02	.00	0.	*	11	FEB	1520	113	.02	.00	.02	10.	*
11	FEB	0920	41	.02	.02	.00	0.	*	11	FEB	1525	114	.02	.00	.02	10.	*
11	FEB	0925	42	.02	.02	.00	0.	*	11	FEB	1530	115	.02	.00	.02	10.	*
11	FEB	0930	43	.02	.02	.00	0.	*	11	FEB	1535	116	.02	.00	.02	10.	*
11	FEB	0935	44	.03	.03	.00	0.	*	11	FEB	1540	117	.02	.00	.02	10.	*
11	FEB	0940	45	.03	.03	.00	0.	*	11	FEB	1545	118	.02	.00	.02	10.	*
11	FEB	0945	46	.03	.03	.00	0.	*	11	FEB	1550	119	.02	.00	.02	10.	*

11 FEB 0950	47	.03	.03	.00	0.	*	11 FEB 1555	120	.02	.00	.02	10.
11 FEB 0955	48	.03	.03	.00	0.	*	11 FEB 1600	121	.02	.00	.02	10.
11 FEB 1000	49	.03	.03	.00	0.	*	11 FEB 1605	122	.02	.00	.01	10.
11 FEB 1005	50	.04	.03	.00	0.	*	11 FEB 1610	123	.02	.00	.01	10.
11 FEB 1010	51	.04	.03	.00	0.	*	11 FEB 1615	124	.02	.00	.01	9.
11 FEB 1015	52	.04	.03	.00	0.	*	11 FEB 1620	125	.02	.00	.01	9.
11 FEB 1020	53	.04	.03	.00	0.	*	11 FEB 1625	126	.02	.00	.01	9.
11 FEB 1025	54	.04	.03	.00	0.	*	11 FEB 1630	127	.02	.00	.01	9.
11 FEB 1030	55	.04	.03	.01	1.	*	11 FEB 1635	128	.02	.00	.01	9.
11 FEB 1035	56	.05	.04	.01	1.	*	11 FEB 1640	129	.02	.00	.01	8.
11 FEB 1040	57	.05	.04	.01	1.	*	11 FEB 1645	130	.02	.00	.01	8.
11 FEB 1045	58	.05	.04	.01	1.	*	11 FEB 1650	131	.02	.00	.01	8.
11 FEB 1050	59	.05	.04	.01	1.	*	11 FEB 1655	132	.02	.00	.01	7.
11 FEB 1055	60	.05	.04	.01	2.	*	11 FEB 1700	133	.02	.00	.01	7.
11 FEB 1100	61	.05	.04	.01	2.	*	11 FEB 1705	134	.02	.00	.01	7.
11 FEB 1105	62	.07	.06	.02	2.	*	11 FEB 1710	135	.02	.00	.01	7.
11 FEB 1110	63	.07	.05	.02	3.	*	11 FEB 1715	136	.02	.00	.01	7.
11 FEB 1115	64	.07	.05	.02	3.	*	11 FEB 1720	137	.02	.00	.01	7.
11 FEB 1120	65	.07	.05	.02	4.	*	11 FEB 1725	138	.02	.00	.01	7.
11 FEB 1125	66	.07	.05	.03	5.	*	11 FEB 1730	139	.02	.00	.01	7.
11 FEB 1130	67	.07	.05	.03	5.	*	11 FEB 1735	140	.01	.00	.01	7.
11 FEB 1135	68	.59	.33	.26	7.	*	11 FEB 1740	141	.01	.00	.01	7.
11 FEB 1140	69	.59	.27	.32	10.	*	11 FEB 1745	142	.01	.00	.01	6.
11 FEB 1145	70	.59	.22	.37	14.	*	11 FEB 1750	143	.01	.00	.01	6.
11 FEB 1150	71	.59	.19	.40	22.	*	11 FEB 1755	144	.01	.00	.01	6.
11 FEB 1155	72	.59	.16	.43	33.	*	11 FEB 1800	145	.01	.00	.01	6.
11 FEB 1200	73	.59	.14	.45	48.	*						

\*\*\*\*\*

TOTAL RAINFALL = 7.80, TOTAL LOSS = 3.39, TOTAL EXCESS = 4.41

PEAK FLOW (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	12.00-HR
+	107.				
	6.42	(CFS)			
		(INCHES)	4.168	4.308	4.308
		(AC-FT)	14.	14.	14.

CUMULATIVE AREA = .06 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
 \* \*  
 19 KK \* RWEST \* OFF SITE DRAINAGE - WEST PORTION OF REFLECTION RIDGE  
 \* \*  
 \*\*\*\*\*

9 IN TIME DATA FOR INPUT TIME SERIES  
 JKMIN 30 TIME INTERVAL IN MINUTES  
 JXDATE 11FEB93 STARTING DATE  
 JXTIME 600 STARTING TIME

SUBBASIN RUNOFF DATA

20 BA SUBBASIN CHARACTERISTICS  
 TAREA .08 SUBBASIN AREA

PRECIPITATION DATA

21 PB STORM 7.80 BASIN TOTAL PRECIPITATION

22 PI INCREMENTAL PRECIPITATION PATTERN

.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.01	.01	.01	.01	.01	.01	.01	.06	.06	.06	.06
.06	.06	.01	.01	.01	.01	.01	.01	.01	.01	.01
.01	.01	.01	.01	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

.00 .00 .00 .00 .00 .00 .00 .00 .00 .00  
 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00  
 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00  
 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00

26 LS SCS LOSS RATE  
 STRTL .90 INITIAL ABSTRACTION  
 CRVNBR 69.00 CURVE NUMBER  
 RTIMP .00 PERCENT IMPERVIOUS AREA

27 UD SCS DIMENSIONLESS UNITGRAPH  
 TLAG .40 LAG

\*\*\*

UNIT HYDROGRAPH  
 26 END-OF-PERIOD ORDINATES

8. 26. 54. 80. 90. 88. 76. 61. 42. 31.  
 23. 17. 12. 9. 7. 5. 4. 3. 2. 1.  
 1. 1. 1. 0. 0. 0.

\*\*\*\*\*

HYDROGRAPH AT STATION RRWEST

\*\*\*\*\*

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
11	FEB	0600	1	.00	.00	.00	0.	*	11	FEB	1205	74	.11	.03	.08	144.
11	FEB	0605	2	.02	.02	.00	0.	*	11	FEB	1210	75	.11	.03	.09	164.
11	FEB	0610	3	.02	.02	.00	0.	*	11	FEB	1215	76	.11	.03	.09	169.
11	FEB	0615	4	.02	.02	.00	0.	*	11	FEB	1220	77	.11	.03	.09	161.
11	FEB	0620	5	.02	.02	.00	0.	*	11	FEB	1225	78	.11	.02	.09	145.
11	FEB	0625	6	.02	.02	.00	0.	*	11	FEB	1230	79	.11	.02	.09	126.
11	FEB	0630	7	.02	.02	.00	0.	*	11	FEB	1235	80	.06	.01	.05	108.
11	FEB	0635	8	.02	.02	.00	0.	*	11	FEB	1240	81	.06	.01	.05	92.
11	FEB	0640	9	.02	.02	.00	0.	*	11	FEB	1245	82	.06	.01	.05	80.
11	FEB	0645	10	.02	.02	.00	0.	*	11	FEB	1250	83	.06	.01	.05	69.
11	FEB	0650	11	.02	.02	.00	0.	*	11	FEB	1255	84	.06	.01	.05	60.
11	FEB	0655	12	.02	.02	.00	0.	*	11	FEB	1300	85	.06	.01	.05	53.
11	FEB	0700	13	.02	.02	.00	0.	*	11	FEB	1305	86	.04	.01	.03	46.
11	FEB	0705	14	.02	.02	.00	0.	*	11	FEB	1310	87	.04	.01	.03	41.
11	FEB	0710	15	.02	.02	.00	0.	*	11	FEB	1315	88	.04	.01	.03	37.
11	FEB	0715	16	.02	.02	.00	0.	*	11	FEB	1320	89	.04	.01	.03	34.
11	FEB	0720	17	.02	.02	.00	0.	*	11	FEB	1325	90	.04	.01	.03	31.
11	FEB	0725	18	.02	.02	.00	0.	*	11	FEB	1330	91	.04	.01	.03	29.
11	FEB	0730	19	.02	.02	.00	0.	*	11	FEB	1335	92	.03	.01	.03	27.
11	FEB	0735	20	.02	.02	.00	0.	*	11	FEB	1340	93	.03	.01	.03	25.
11	FEB	0740	21	.02	.02	.00	0.	*	11	FEB	1345	94	.03	.01	.03	24.
11	FEB	0745	22	.02	.02	.00	0.	*	11	FEB	1350	95	.03	.01	.03	22.
11	FEB	0750	23	.02	.02	.00	0.	*	11	FEB	1355	96	.03	.01	.03	21.
11	FEB	0755	24	.02	.02	.00	0.	*	11	FEB	1400	97	.03	.01	.03	20.
11	FEB	0800	25	.02	.02	.00	0.	*	11	FEB	1405	98	.02	.00	.02	19.
11	FEB	0805	26	.02	.02	.00	0.	*	11	FEB	1410	99	.02	.00	.02	18.
11	FEB	0810	27	.02	.02	.00	0.	*	11	FEB	1415	100	.02	.00	.02	18.
11	FEB	0815	28	.02	.02	.00	0.	*	11	FEB	1420	101	.02	.00	.02	17.
11	FEB	0820	29	.02	.02	.00	0.	*	11	FEB	1425	102	.02	.00	.02	16.
11	FEB	0825	30	.02	.02	.00	0.	*	11	FEB	1430	103	.02	.00	.02	15.
11	FEB	0830	31	.02	.02	.00	0.	*	11	FEB	1435	104	.02	.00	.02	14.
11	FEB	0835	32	.02	.02	.00	0.	*	11	FEB	1440	105	.02	.00	.02	14.
11	FEB	0840	33	.02	.02	.00	0.	*	11	FEB	1445	106	.02	.00	.02	13.
11	FEB	0845	34	.02	.02	.00	0.	*	11	FEB	1450	107	.02	.00	.02	13.
11	FEB	0850	35	.02	.02	.00	0.	*	11	FEB	1455	108	.02	.00	.02	13.
11	FEB	0855	36	.02	.02	.00	0.	*	11	FEB	1500	109	.02	.00	.02	13.
11	FEB	0900	37	.02	.02	.00	0.	*	11	FEB	1505	110	.02	.00	.02	13.
11	FEB	0905	38	.02	.02	.00	0.	*	11	FEB	1510	111	.02	.00	.02	13.
11	FEB	0910	39	.02	.02	.00	0.	*	11	FEB	1515	112	.02	.00	.02	12.
11	FEB	0915	40	.02	.02	.00	0.	*	11	FEB	1520	113	.02	.00	.02	12.
11	FEB	0920	41	.02	.02	.00	0.	*	11	FEB	1525	114	.02	.00	.02	12.
11	FEB	0925	42	.02	.02	.00	0.	*	11	FEB	1530	115	.02	.00	.02	12.
11	FEB	0930	43	.02	.02	.00	0.	*	11	FEB	1535	116	.02	.00	.02	12.
11	FEB	0935	44	.03	.03	.00	0.	*	11	FEB	1540	117	.02	.00	.02	12.
11	FEB	0940	45	.03	.03	.00	0.	*	11	FEB	1545	118	.02	.00	.02	12.
11	FEB	0945	46	.03	.03	.00	0.	*	11	FEB	1550	119	.02	.00	.02	12.
11	FEB	0950	47	.03	.03	.00	0.	*	11	FEB	1555	120	.02	.00	.02	12.
11	FEB	0955	48	.03	.03	.00	0.	*	11	FEB	1600	121	.02	.00	.02	12.
11	FEB	1000	49	.03	.03	.00	0.	*	11	FEB	1605	122	.02	.00	.01	12.
11	FEB	1005	50	.04	.03	.00	0.	*	11	FEB	1610	123	.02	.00	.01	12.
11	FEB	1010	51	.04	.03	.00	0.	*	11	FEB	1615	124	.02	.00	.01	12.

11 FEB 1015	52	.04	.03	.00	0.	*	11 FEB 1620	125	.02	.00	.01	11.
11 FEB 1020	53	.04	.03	.00	0.	*	11 FEB 1625	126	.02	.00	.01	11.
11 FEB 1025	54	.04	.03	.00	0.	*	11 FEB 1630	127	.02	.00	.01	10.
11 FEB 1030	55	.04	.03	.00	1.	*	11 FEB 1635	128	.02	.00	.01	10.
11 FEB 1035	56	.05	.04	.01	1.	*	11 FEB 1640	129	.02	.00	.01	9.
11 FEB 1040	57	.05	.04	.01	1.	*	11 FEB 1645	130	.02	.00	.01	9.
11 FEB 1045	58	.05	.04	.01	2.	*	11 FEB 1650	131	.02	.00	.01	9.
11 FEB 1050	59	.05	.04	.01	2.	*	11 FEB 1655	132	.02	.00	.01	9.
11 FEB 1055	60	.05	.04	.01	3.	*	11 FEB 1700	133	.02	.00	.01	9.
11 FEB 1100	61	.05	.04	.01	3.	*	11 FEB 1705	134	.02	.00	.01	9.
11 FEB 1105	62	.07	.06	.02	4.	*	11 FEB 1710	135	.02	.00	.01	9.
11 FEB 1110	63	.07	.06	.02	4.	*	11 FEB 1715	136	.02	.00	.01	8.
11 FEB 1115	64	.07	.06	.02	5.	*	11 FEB 1720	137	.02	.00	.01	8.
11 FEB 1120	65	.07	.05	.02	6.	*	11 FEB 1725	138	.02	.00	.01	8.
11 FEB 1125	66	.07	.05	.02	7.	*	11 FEB 1730	139	.02	.00	.01	8.
11 FEB 1130	67	.07	.05	.02	9.	*	11 FEB 1735	140	.01	.00	.01	8.
11 FEB 1135	68	.59	.36	.23	12.	*	11 FEB 1740	141	.01	.00	.01	8.
11 FEB 1140	69	.59	.29	.30	19.	*	11 FEB 1745	142	.01	.00	.01	8.
11 FEB 1145	70	.59	.25	.34	33.	*	11 FEB 1750	143	.01	.00	.01	8.
11 FEB 1150	71	.59	.21	.38	55.	*	11 FEB 1755	144	.01	.00	.01	7.
11 FEB 1155	72	.59	.18	.41	84.	*	11 FEB 1800	145	.01	.00	.01	7.
11 FEB 1200	73	.59	.16	.43	115.	*						

\*\*\*\*\*

TOTAL RAINFALL = 7.80, TOTAL LOSS = 3.62, TOTAL EXCESS = 4.18

PEAK FLOW	TIME		MAXIMUM AVERAGE FLOW			
(CFS)	(HR)	(CFS)	6-HR	24-HR	72-HR	12.00-HR
+	169.	6.25	35.	18.	18.	18.
		(INCHES)	3.981	4.122	4.122	4.122
		(AC-FT)	18.	18.	18.	18.

CUMULATIVE AREA = .08 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
 \* \*  
 28 KK \* OFFSITE \*  
 \* \*  
 \*\*\*\*\*

29 HC HYDROGRAPH COMBINATION  
 ICOMP 2 NUMBER OF HYDROGRAPHS TO COMBINE

\*\*\*

\*\*\*\*\*

HYDROGRAPH AT STATION OFFSITE  
 SUM OF 2 HYDROGRAPHS

\*\*\*\*\*

DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*
11	FEB	0600	1	0.	*	11	FEB	0905	38	0.	*	11	FEB	1210	75	243.	*	11	FEB	1515	112	23.	*
11	FEB	0605	2	0.	*	11	FEB	0910	39	0.	*	11	FEB	1215	76	262.	*	11	FEB	1520	113	23.	*
11	FEB	0610	3	0.	*	11	FEB	0915	40	0.	*	11	FEB	1220	77	264.	*	11	FEB	1525	114	22.	*
11	FEB	0615	4	0.	*	11	FEB	0920	41	0.	*	11	FEB	1225	78	252.	*	11	FEB	1530	115	22.	*
11	FEB	0620	5	0.	*	11	FEB	0925	42	0.	*	11	FEB	1230	79	232.	*	11	FEB	1535	116	22.	*
11	FEB	0625	6	0.	*	11	FEB	0930	43	0.	*	11	FEB	1235	80	209.	*	11	FEB	1540	117	22.	*
11	FEB	0630	7	0.	*	11	FEB	0935	44	0.	*	11	FEB	1240	81	186.	*	11	FEB	1545	118	22.	*
11	FEB	0635	8	0.	*	11	FEB	0940	45	0.	*	11	FEB	1245	82	166.	*	11	FEB	1550	119	22.	*
11	FEB	0640	9	0.	*	11	FEB	0945	46	0.	*	11	FEB	1250	83	147.	*	11	FEB	1555	120	22.	*
11	FEB	0645	10	0.	*	11	FEB	0950	47	0.	*	11	FEB	1255	84	129.	*	11	FEB	1600	121	22.	*
11	FEB	0650	11	0.	*	11	FEB	0955	48	0.	*	11	FEB	1300	85	114.	*	11	FEB	1605	122	22.	*
11	FEB	0655	12	0.	*	11	FEB	1000	49	0.	*	11	FEB	1305	86	101.	*	11	FEB	1610	123	22.	*
11	FEB	0700	13	0.	*	11	FEB	1005	50	0.	*	11	FEB	1310	87	91.	*	11	FEB	1615	124	21.	*
11	FEB	0705	14	0.	*	11	FEB	1010	51	0.	*	11	FEB	1315	88	82.	*	11	FEB	1620	125	21.	*
11	FEB	0710	15	0.	*	11	FEB	1015	52	0.	*	11	FEB	1320	89	74.	*	11	FEB	1625	126	20.	*
11	FEB	0715	16	0.	*	11	FEB	1020	53	1.	*	11	FEB	1325	90	67.	*	11	FEB	1630	127	19.	*
11	FEB	0720	17	0.	*	11	FEB	1025	54	1.	*	11	FEB	1330	91	62.	*	11	FEB	1635	128	18.	*

11 FEB 0725	18	0.	*	11 FEB 1030	55	1.	*	11 FEB 1335	92	57.	*	11 FEB 1640	129	18.
11 FEB 0730	19	0.	*	11 FEB 1035	56	2.	*	11 FEB 1340	93	53.	*	11 FEB 1645	130	17.
11 FEB 0735	20	0.	*	11 FEB 1040	57	2.	*	11 FEB 1345	94	49.	*	11 FEB 1650	131	17.
11 FEB 0740	21	0.	*	11 FEB 1045	58	3.	*	11 FEB 1350	95	46.	*	11 FEB 1655	132	16.
11 FEB 0745	22	0.	*	11 FEB 1050	59	3.	*	11 FEB 1355	96	43.	*	11 FEB 1700	133	16.
11 FEB 0750	23	0.	*	11 FEB 1055	60	4.	*	11 FEB 1400	97	41.	*	11 FEB 1705	134	16.
11 FEB 0755	24	0.	*	11 FEB 1100	61	5.	*	11 FEB 1405	98	39.	*	11 FEB 1710	135	15.
11 FEB 0800	25	0.	*	11 FEB 1105	62	6.	*	11 FEB 1410	99	37.	*	11 FEB 1715	136	15.
11 FEB 0805	26	0.	*	11 FEB 1110	63	7.	*	11 FEB 1415	100	35.	*	11 FEB 1720	137	15.
11 FEB 0810	27	0.	*	11 FEB 1115	64	9.	*	11 FEB 1420	101	33.	*	11 FEB 1725	138	15.
11 FEB 0815	28	0.	*	11 FEB 1120	65	10.	*	11 FEB 1425	102	31.	*	11 FEB 1730	139	15.
11 FEB 0820	29	0.	*	11 FEB 1125	66	12.	*	11 FEB 1430	103	29.	*	11 FEB 1735	140	15.
11 FEB 0825	30	0.	*	11 FEB 1130	67	14.	*	11 FEB 1435	104	28.	*	11 FEB 1740	141	15.
11 FEB 0830	31	0.	*	11 FEB 1135	68	18.	*	11 FEB 1440	105	27.	*	11 FEB 1745	142	14.
11 FEB 0835	32	0.	*	11 FEB 1140	69	28.	*	11 FEB 1445	106	26.	*	11 FEB 1750	143	14.
11 FEB 0840	33	0.	*	11 FEB 1145	70	47.	*	11 FEB 1450	107	25.	*	11 FEB 1755	144	13.
11 FEB 0845	34	0.	*	11 FEB 1150	71	77.	*	11 FEB 1455	108	24.	*	11 FEB 1800	145	12.
11 FEB 0850	35	0.	*	11 FEB 1155	72	117.	*	11 FEB 1500	109	24.	*			
11 FEB 0855	36	0.	*	11 FEB 1200	73	163.	*	11 FEB 1505	110	23.	*			
11 FEB 0900	37	0.	*	11 FEB 1205	74	207.	*	11 FEB 1510	111	23.	*			

\*\*\*\*\*

PEAK FLOW (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	12.00-HR	
264.	6.33	63.	33.	33.	33.	
		(INCHES)	4.061	4.202	4.202	4.202
		(AC-FT)	31.	33.	33.	33.

CUMULATIVE AREA = .15 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
\* \*  
30 KK \* BASIN1 \*  
\* \*  
\*\*\*\*\*

9 IN TIME DATA FOR INPUT TIME SERIES  
JXMIN 30 TIME INTERVAL IN MINUTES  
JXDATE 11FEB93 STARTING DATE  
JXTIME 600 STARTING TIME

SUBBASIN RUNOFF DATA

31 BA SUBBASIN CHARACTERISTICS  
TAREA .00 SUBBASIN AREA

PRECIPITATION DATA

32 PB STORM 7.80 BASIN TOTAL PRECIPITATION

33 PI INCREMENTAL PRECIPITATION PATTERN

.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.01	.01	.01	.01	.01	.01	.01	.06	.06	.06	.06
.06	.06	.01	.01	.01	.01	.01	.01	.01	.01	.01
.01	.01	.01	.01	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

37 LS SCS LOSS RATE  
STRIL .53 INITIAL ABSTRACTION  
CRVNR 79.00 CURVE NUMBER  
RTIMP .00 PERCENT IMPERVIOUS AREA

38 UD SCS DIMENSIONLESS UNITGRAPH  
TLAG .25 LAG

\*\*\*

WARNING \*\*\* TIME INTERVAL IS GREATER THAN .29\*LAG

UNIT HYDROGRAPH  
17 END-OF-PERIOD ORDINATES

1. 5. 8. 8. 6. 4. 2. 1. 1. 1.  
0. 0. 0. 0. 0. 0. 0.

\*\*\*\*\*

HYDROGRAPH AT STATION BASIN1

\*\*\*\*\*

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
11	FEB	0600	1	.00	.00	.00	0.	*	11	FEB	1205	74	.11	.01	.10	15.
11	FEB	0605	2	.02	.02	.00	0.	*	11	FEB	1210	75	.11	.01	.10	14.
11	FEB	0610	3	.02	.02	.00	0.	*	11	FEB	1215	76	.11	.01	.10	12.
11	FEB	0615	4	.02	.02	.00	0.	*	11	FEB	1220	77	.11	.01	.10	9.
11	FEB	0620	5	.02	.02	.00	0.	*	11	FEB	1225	78	.11	.01	.10	7.
11	FEB	0625	6	.02	.02	.00	0.	*	11	FEB	1230	79	.11	.01	.10	6.
11	FEB	0630	7	.02	.02	.00	0.	*	11	FEB	1235	80	.06	.01	.05	5.
11	FEB	0635	8	.02	.02	.00	0.	*	11	FEB	1240	81	.06	.01	.05	4.
11	FEB	0640	9	.02	.02	.00	0.	*	11	FEB	1245	82	.06	.01	.05	4.
11	FEB	0645	10	.02	.02	.00	0.	*	11	FEB	1250	83	.06	.01	.05	3.
11	FEB	0650	11	.02	.02	.00	0.	*	11	FEB	1255	84	.06	.01	.05	3.
11	FEB	0655	12	.02	.02	.00	0.	*	11	FEB	1300	85	.06	.01	.05	2.
11	FEB	0700	13	.02	.02	.00	0.	*	11	FEB	1305	86	.04	.00	.04	2.
11	FEB	0705	14	.02	.02	.00	0.	*	11	FEB	1310	87	.04	.00	.04	2.
11	FEB	0710	15	.02	.02	.00	0.	*	11	FEB	1315	88	.04	.00	.04	2.
11	FEB	0715	16	.02	.02	.00	0.	*	11	FEB	1320	89	.04	.00	.04	2.
11	FEB	0720	17	.02	.02	.00	0.	*	11	FEB	1325	90	.04	.00	.04	2.
11	FEB	0725	18	.02	.02	.00	0.	*	11	FEB	1330	91	.04	.00	.04	1.
11	FEB	0730	19	.02	.02	.00	0.	*	11	FEB	1335	92	.03	.00	.03	1.
11	FEB	0735	20	.02	.02	.00	0.	*	11	FEB	1340	93	.03	.00	.03	1.
11	FEB	0740	21	.02	.02	.00	0.	*	11	FEB	1345	94	.03	.00	.03	1.
11	FEB	0745	22	.02	.02	.00	0.	*	11	FEB	1350	95	.03	.00	.03	1.
11	FEB	0750	23	.02	.02	.00	0.	*	11	FEB	1355	96	.03	.00	.03	1.
11	FEB	0755	24	.02	.02	.00	0.	*	11	FEB	1400	97	.03	.00	.03	1.
11	FEB	0800	25	.02	.02	.00	0.	*	11	FEB	1405	98	.02	.00	.02	1.
11	FEB	0805	26	.02	.02	.00	0.	*	11	FEB	1410	99	.02	.00	.02	1.
11	FEB	0810	27	.02	.02	.00	0.	*	11	FEB	1415	100	.02	.00	.02	1.
11	FEB	0815	28	.02	.02	.00	0.	*	11	FEB	1420	101	.02	.00	.02	1.
11	FEB	0820	29	.02	.02	.00	0.	*	11	FEB	1425	102	.02	.00	.02	1.
11	FEB	0825	30	.02	.02	.00	0.	*	11	FEB	1430	103	.02	.00	.02	1.
11	FEB	0830	31	.02	.02	.00	0.	*	11	FEB	1435	104	.02	.00	.02	1.
11	FEB	0835	32	.02	.02	.00	0.	*	11	FEB	1440	105	.02	.00	.02	1.
11	FEB	0840	33	.02	.02	.00	0.	*	11	FEB	1445	106	.02	.00	.02	1.
11	FEB	0845	34	.02	.02	.00	0.	*	11	FEB	1450	107	.02	.00	.02	1.
11	FEB	0850	35	.02	.02	.00	0.	*	11	FEB	1455	108	.02	.00	.02	1.
11	FEB	0855	36	.02	.02	.00	0.	*	11	FEB	1500	109	.02	.00	.02	1.
11	FEB	0900	37	.02	.02	.00	0.	*	11	FEB	1505	110	.02	.00	.02	1.
11	FEB	0905	38	.02	.02	.00	0.	*	11	FEB	1510	111	.02	.00	.02	1.
11	FEB	0910	39	.02	.02	.00	0.	*	11	FEB	1515	112	.02	.00	.02	1.
11	FEB	0915	40	.02	.02	.00	0.	*	11	FEB	1520	113	.02	.00	.02	1.
11	FEB	0920	41	.02	.02	.00	0.	*	11	FEB	1525	114	.02	.00	.02	1.
11	FEB	0925	42	.02	.02	.00	0.	*	11	FEB	1530	115	.02	.00	.02	1.
11	FEB	0930	43	.02	.02	.00	0.	*	11	FEB	1535	116	.02	.00	.02	1.
11	FEB	0935	44	.03	.02	.00	0.	*	11	FEB	1540	117	.02	.00	.02	1.
11	FEB	0940	45	.03	.02	.01	0.	*	11	FEB	1545	118	.02	.00	.02	1.
11	FEB	0945	46	.03	.02	.01	0.	*	11	FEB	1550	119	.02	.00	.02	1.
11	FEB	0950	47	.03	.02	.01	0.	*	11	FEB	1555	120	.02	.00	.02	1.
11	FEB	0955	48	.03	.02	.01	0.	*	11	FEB	1600	121	.02	.00	.02	1.
11	FEB	1000	49	.03	.02	.01	0.	*	11	FEB	1605	122	.02	.00	.01	1.
11	FEB	1005	50	.04	.03	.01	0.	*	11	FEB	1610	123	.02	.00	.01	1.
11	FEB	1010	51	.04	.03	.01	0.	*	11	FEB	1615	124	.02	.00	.01	1.
11	FEB	1015	52	.04	.03	.01	0.	*	11	FEB	1620	125	.02	.00	.01	1.
11	FEB	1020	53	.04	.02	.01	0.	*	11	FEB	1625	126	.02	.00	.01	1.
11	FEB	1025	54	.04	.02	.01	0.	*	11	FEB	1630	127	.02	.00	.01	1.
11	FEB	1030	55	.04	.02	.01	0.	*	11	FEB	1635	128	.02	.00	.01	1.
11	FEB	1035	56	.05	.03	.02	0.	*	11	FEB	1640	129	.02	.00	.01	1.
11	FEB	1040	57	.05	.03	.02	0.	*	11	FEB	1645	130	.02	.00	.01	1.
11	FEB	1045	58	.05	.03	.02	0.	*	11	FEB	1650	131	.02	.00	.01	1.
11	FEB	1050	59	.05	.03	.02	1.	*	11	FEB	1655	132	.02	.00	.01	1.



\*\*\*

WARNING \*\*\* TIME INTERVAL IS GREATER THAN .29\*LAG

UNIT HYDROGRAPH  
17 END-OF-PERIOD ORDINATES

17. 58. 92. 92. 72. 43. 27. 17. 11. 7.  
4. 3. 2. 1. 1. 0. 0.

\*\*\*\*\*

HYDROGRAPH AT STATION BASIN2

\*\*\*\*\*

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
11	FEB	0600	1	.00	.00	.00	0.	*	11	FEB	1205	74	.11	.01	.10	191.
11	FEB	0605	2	.02	.02	.00	0.	*	11	FEB	1210	75	.11	.01	.10	179.
11	FEB	0610	3	.02	.02	.00	0.	*	11	FEB	1215	76	.11	.01	.10	149.
11	FEB	0615	4	.02	.02	.00	0.	*	11	FEB	1220	77	.11	.01	.10	115.
11	FEB	0620	5	.02	.02	.00	0.	*	11	FEB	1225	78	.11	.01	.10	89.
11	FEB	0625	6	.02	.02	.00	0.	*	11	FEB	1230	79	.11	.01	.10	73.
11	FEB	0630	7	.02	.02	.00	0.	*	11	FEB	1235	80	.06	.00	.05	62.
11	FEB	0635	8	.02	.02	.00	0.	*	11	FEB	1240	81	.06	.00	.05	53.
11	FEB	0640	9	.02	.02	.00	0.	*	11	FEB	1245	82	.06	.00	.05	44.
11	FEB	0645	10	.02	.02	.00	0.	*	11	FEB	1250	83	.06	.00	.05	37.
11	FEB	0650	11	.02	.02	.00	0.	*	11	FEB	1255	84	.06	.00	.05	32.
11	FEB	0655	12	.02	.02	.00	0.	*	11	FEB	1300	85	.06	.00	.05	29.
11	FEB	0700	13	.02	.02	.00	0.	*	11	FEB	1305	86	.04	.00	.04	27.
11	FEB	0705	14	.02	.02	.00	0.	*	11	FEB	1310	87	.04	.00	.04	25.
11	FEB	0710	15	.02	.02	.00	0.	*	11	FEB	1315	88	.04	.00	.04	22.
11	FEB	0715	16	.02	.02	.00	0.	*	11	FEB	1320	89	.04	.00	.04	21.
11	FEB	0720	17	.02	.02	.00	0.	*	11	FEB	1325	90	.04	.00	.04	19.
11	FEB	0725	18	.02	.02	.00	0.	*	11	FEB	1330	91	.04	.00	.04	19.
11	FEB	0730	19	.02	.02	.00	0.	*	11	FEB	1335	92	.03	.00	.03	18.
11	FEB	0735	20	.02	.02	.00	0.	*	11	FEB	1340	93	.03	.00	.03	17.
11	FEB	0740	21	.02	.02	.00	0.	*	11	FEB	1345	94	.03	.00	.03	16.
11	FEB	0745	22	.02	.02	.00	0.	*	11	FEB	1350	95	.03	.00	.03	15.
11	FEB	0750	23	.02	.02	.00	0.	*	11	FEB	1355	96	.03	.00	.03	15.
11	FEB	0755	24	.02	.02	.00	0.	*	11	FEB	1400	97	.03	.00	.03	14.
11	FEB	0800	25	.02	.02	.00	0.	*	11	FEB	1405	98	.02	.00	.02	14.
11	FEB	0805	26	.02	.02	.00	0.	*	11	FEB	1410	99	.02	.00	.02	13.
11	FEB	0810	27	.02	.02	.00	0.	*	11	FEB	1415	100	.02	.00	.02	12.
11	FEB	0815	28	.02	.02	.00	0.	*	11	FEB	1420	101	.02	.00	.02	11.
11	FEB	0820	29	.02	.02	.00	0.	*	11	FEB	1425	102	.02	.00	.02	11.
11	FEB	0825	30	.02	.02	.00	0.	*	11	FEB	1430	103	.02	.00	.02	10.
11	FEB	0830	31	.02	.02	.00	0.	*	11	FEB	1435	104	.02	.00	.02	10.
11	FEB	0835	32	.02	.02	.00	0.	*	11	FEB	1440	105	.02	.00	.02	10.
11	FEB	0840	33	.02	.02	.00	0.	*	11	FEB	1445	106	.02	.00	.02	10.
11	FEB	0845	34	.02	.02	.00	0.	*	11	FEB	1450	107	.02	.00	.02	10.
11	FEB	0850	35	.02	.02	.00	0.	*	11	FEB	1455	108	.02	.00	.02	10.
11	FEB	0855	36	.02	.02	.00	0.	*	11	FEB	1500	109	.02	.00	.02	10.
11	FEB	0900	37	.02	.02	.00	1.	*	11	FEB	1505	110	.02	.00	.02	10.
11	FEB	0905	38	.02	.02	.00	1.	*	11	FEB	1510	111	.02	.00	.02	10.
11	FEB	0910	39	.02	.02	.00	1.	*	11	FEB	1515	112	.02	.00	.02	10.
11	FEB	0915	40	.02	.02	.00	1.	*	11	FEB	1520	113	.02	.00	.02	10.
11	FEB	0920	41	.02	.02	.00	1.	*	11	FEB	1525	114	.02	.00	.02	10.
11	FEB	0925	42	.02	.02	.00	2.	*	11	FEB	1530	115	.02	.00	.02	10.
11	FEB	0930	43	.02	.02	.01	2.	*	11	FEB	1535	116	.02	.00	.02	10.
11	FEB	0935	44	.03	.02	.01	2.	*	11	FEB	1540	117	.02	.00	.02	10.
11	FEB	0940	45	.03	.02	.01	2.	*	11	FEB	1545	118	.02	.00	.02	10.
11	FEB	0945	46	.03	.02	.01	2.	*	11	FEB	1550	119	.02	.00	.02	10.
11	FEB	0950	47	.03	.02	.01	3.	*	11	FEB	1555	120	.02	.00	.02	10.
11	FEB	0955	48	.03	.02	.01	3.	*	11	FEB	1600	121	.02	.00	.02	10.
11	FEB	1000	49	.03	.02	.01	3.	*	11	FEB	1605	122	.02	.00	.01	10.
11	FEB	1005	50	.04	.02	.01	3.	*	11	FEB	1610	123	.02	.00	.01	9.
11	FEB	1010	51	.04	.02	.01	4.	*	11	FEB	1615	124	.02	.00	.01	9.
11	FEB	1015	52	.04	.02	.01	4.	*	11	FEB	1620	125	.02	.00	.01	8.
11	FEB	1020	53	.04	.02	.01	5.	*	11	FEB	1625	126	.02	.00	.01	7.
11	FEB	1025	54	.04	.02	.01	5.	*	11	FEB	1630	127	.02	.00	.01	7.
11	FEB	1030	55	.04	.02	.01	5.	*	11	FEB	1635	128	.02	.00	.01	7.
11	FEB	1035	56	.05	.03	.02	6.	*	11	FEB	1640	129	.02	.00	.01	7.
11	FEB	1040	57	.05	.03	.02	6.	*	11	FEB	1645	130	.02	.00	.01	7.
11	FEB	1045	58	.05	.03	.02	7.	*	11	FEB	1650	131	.02	.00	.01	7.
11	FEB	1050	59	.05	.03	.02	8.	*	11	FEB	1655	132	.02	.00	.01	7.
11	FEB	1055	60	.05	.03	.02	9.	*	11	FEB	1700	133	.02	.00	.01	7.
11	FEB	1100	61	.05	.02	.02	9.	*	11	FEB	1705	134	.02	.00	.01	7.
11	FEB	1105	62	.07	.04	.04	10.	*	11	FEB	1710	135	.02	.00	.01	7.
11	FEB	1110	63	.07	.03	.04	11.	*	11	FEB	1715	136	.02	.00	.01	7.

11 FEB 1115	64	.07	.03	.04	13.	*	11 FEB 1720	137	.02	.00	.01	7.
11 FEB 1120	65	.07	.03	.04	15.	*	11 FEB 1725	138	.02	.00	.01	7.
11 FEB 1125	66	.07	.03	.04	16.	*	11 FEB 1730	139	.02	.00	.01	7.
11 FEB 1130	67	.07	.03	.05	17.	*	11 FEB 1735	140	.01	.00	.01	6.
11 FEB 1135	68	.59	.20	.39	24.	*	11 FEB 1740	141	.01	.00	.01	6.
11 FEB 1140	69	.59	.15	.44	46.	*	11 FEB 1745	142	.01	.00	.01	6.
11 FEB 1145	70	.59	.12	.47	82.	*	11 FEB 1750	143	.01	.00	.01	5.
11 FEB 1150	71	.59	.10	.50	121.	*	11 FEB 1755	144	.01	.00	.01	5.
11 FEB 1155	72	.59	.08	.51	155.	*	11 FEB 1800	145	.01	.00	.01	4.
11 FEB 1200	73	.59	.07	.52	180.	*						

\*\*\*\*\*

TOTAL RAINFALL = 7.80, TOTAL LOSS = 2.25, TOTAL EXCESS = 5.55

PEAK FLOW (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	12.00-HR	
191.	6.08	32.	17.	17.	17.	
		(INCHES)	5.165	5.516	5.516	5.516
		(AC-FT)	16.	17.	17.	17.

CUMULATIVE AREA = .06 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
\* \*  
48 KK \* INTO2 \*  
\* \*  
\*\*\*\*\*

49 HC HYDROGRAPH COMBINATION  
ICOMP 3 NUMBER OF HYDROGRAPHS TO COMBINE

\*\*\*

\*\*\*\*\*

HYDROGRAPH AT STATION INTO2  
SUM OF 3 HYDROGRAPHS

\*\*\*\*\*

DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*
11	FEB	0600	1	0.	*	11	FEB	0905	38	1.	*	11	FEB	1210	75	436.	*	11	FEB	1515	112	33.	*
11	FEB	0605	2	0.	*	11	FEB	0910	39	1.	*	11	FEB	1215	76	423.	*	11	FEB	1520	113	33.	*
11	FEB	0610	3	0.	*	11	FEB	0915	40	1.	*	11	FEB	1220	77	388.	*	11	FEB	1525	114	33.	*
11	FEB	0615	4	0.	*	11	FEB	0920	41	1.	*	11	FEB	1225	78	347.	*	11	FEB	1530	115	33.	*
11	FEB	0620	5	0.	*	11	FEB	0925	42	2.	*	11	FEB	1230	79	310.	*	11	FEB	1535	116	33.	*
11	FEB	0625	6	0.	*	11	FEB	0930	43	2.	*	11	FEB	1235	80	276.	*	11	FEB	1540	117	33.	*
11	FEB	0630	7	0.	*	11	FEB	0935	44	2.	*	11	FEB	1240	81	243.	*	11	FEB	1545	118	33.	*
11	FEB	0635	8	0.	*	11	FEB	0940	45	2.	*	11	FEB	1245	82	214.	*	11	FEB	1550	119	33.	*
11	FEB	0640	9	0.	*	11	FEB	0945	46	3.	*	11	FEB	1250	83	187.	*	11	FEB	1555	120	33.	*
11	FEB	0645	10	0.	*	11	FEB	0950	47	3.	*	11	FEB	1255	84	164.	*	11	FEB	1600	121	33.	*
11	FEB	0650	11	0.	*	11	FEB	0955	48	3.	*	11	FEB	1300	85	145.	*	11	FEB	1605	122	32.	*
11	FEB	0655	12	0.	*	11	FEB	1000	49	3.	*	11	FEB	1305	86	130.	*	11	FEB	1610	123	32.	*
11	FEB	0700	13	0.	*	11	FEB	1005	50	4.	*	11	FEB	1310	87	117.	*	11	FEB	1615	124	31.	*
11	FEB	0705	14	0.	*	11	FEB	1010	51	4.	*	11	FEB	1315	88	106.	*	11	FEB	1620	125	29.	*
11	FEB	0710	15	0.	*	11	FEB	1015	52	5.	*	11	FEB	1320	89	96.	*	11	FEB	1625	126	28.	*
11	FEB	0715	16	0.	*	11	FEB	1020	53	5.	*	11	FEB	1325	90	88.	*	11	FEB	1630	127	27.	*
11	FEB	0720	17	0.	*	11	FEB	1025	54	6.	*	11	FEB	1330	91	82.	*	11	FEB	1635	128	26.	*
11	FEB	0725	18	0.	*	11	FEB	1030	55	7.	*	11	FEB	1335	92	76.	*	11	FEB	1640	129	25.	*
11	FEB	0730	19	0.	*	11	FEB	1035	56	8.	*	11	FEB	1340	93	71.	*	11	FEB	1645	130	24.	*
11	FEB	0735	20	0.	*	11	FEB	1040	57	9.	*	11	FEB	1345	94	67.	*	11	FEB	1650	131	24.	*
11	FEB	0740	21	0.	*	11	FEB	1045	58	10.	*	11	FEB	1350	95	63.	*	11	FEB	1655	132	23.	*
11	FEB	0745	22	0.	*	11	FEB	1050	59	12.	*	11	FEB	1355	96	59.	*	11	FEB	1700	133	23.	*
11	FEB	0750	23	0.	*	11	FEB	1055	60	13.	*	11	FEB	1400	97	56.	*	11	FEB	1705	134	23.	*
11	FEB	0755	24	0.	*	11	FEB	1100	61	15.	*	11	FEB	1405	98	53.	*	11	FEB	1710	135	23.	*
11	FEB	0800	25	0.	*	11	FEB	1105	62	17.	*	11	FEB	1410	99	51.	*	11	FEB	1715	136	22.	*
11	FEB	0805	26	0.	*	11	FEB	1110	63	19.	*	11	FEB	1415	100	48.	*	11	FEB	1720	137	22.	*
11	FEB	0810	27	0.	*	11	FEB	1115	64	22.	*	11	FEB	1420	101	45.	*	11	FEB	1725	138	22.	*
11	FEB	0815	28	0.	*	11	FEB	1120	65	26.	*	11	FEB	1425	102	43.	*	11	FEB	1730	139	22.	*
11	FEB	0820	29	0.	*	11	FEB	1125	66	29.	*	11	FEB	1430	103	41.	*	11	FEB	1735	140	22.	*

11 FEB 0825	30	0.	*	11 FEB 1130	67	33.	*	11 FEB 1435	104	39.	*	11 FEB 1740	141	21.
11 FEB 0830	31	0.	*	11 FEB 1135	68	44.	*	11 FEB 1440	105	37.	*	11 FEB 1745	142	20.
11 FEB 0835	32	0.	*	11 FEB 1140	69	77.	*	11 FEB 1445	106	36.	*	11 FEB 1750	143	19.
11 FEB 0840	33	0.	*	11 FEB 1145	70	135.	*	11 FEB 1450	107	35.	*	11 FEB 1755	144	18.
11 FEB 0845	34	0.	*	11 FEB 1150	71	207.	*	11 FEB 1455	108	35.	*	11 FEB 1800	145	17.
11 FEB 0850	35	0.	*	11 FEB 1155	72	284.	*	11 FEB 1500	109	34.	*			
11 FEB 0855	36	0.	*	11 FEB 1200	73	357.	*	11 FEB 1505	110	34.	*			
11 FEB 0900	37	1.	*	11 FEB 1205	74	413.	*	11 FEB 1510	111	33.	*			

\*\*\*\*\*

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	12.00-HR
436.	6.17	98.	51.	51.	51.
		4.370	4.592	4.592	4.592
		48.	51.	51.	51.

CUMULATIVE AREA = .21 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
\* \*  
50 KK \* PON1\$2 \*  
\* \*  
\*\*\*\*\*

HYDROGRAPH ROUTING DATA

51 RS	STORAGE ROUTING		
	NSTPS	1	NUMBER OF SUBREACHES
	ITYP	ELEV	TYPE OF INITIAL CONDITION
	RSVRIC	1346.50	INITIAL CONDITION
	X	.00	WORKING R AND D COEFFICIENT
52 SA	AREA	2.8	3.9
53 SE	ELEVATION	1346.50	1351.50
54 SS	SPILLWAY		
	CREL	1346.50	SPILLWAY CREST ELEVATION
	SPWID	30.00	SPILLWAY WIDTH
	COQW	1.80	WEIR COEFFICIENT
	EXPW	1.50	EXPONENT OF HEAD

\*\*\*

COMPUTED STORAGE-ELEVATION DATA

STORAGE	.00	16.67
ELEVATION	1346.50	1351.50

COMPUTED OUTFLOW-ELEVATION DATA

OUTFLOW	.00	.00	.10	.83	2.80	6.63	12.94	22.36	35.51	53.00
ELEVATION	1346.50	1346.50	1346.52	1346.56	1346.64	1346.75	1346.89	1347.06	1347.26	1347.49
OUTFLOW	75.47	103.52	137.79	178.88	227.44	284.06	349.38	424.02	508.60	603.74
ELEVATION	1347.75	1348.04	1348.37	1348.72	1349.11	1349.52	1349.97	1350.45	1350.96	1351.50

COMPUTED STORAGE-OUTFLOW-ELEVATION DATA

STORAGE	.00	.04	.17	.39	.70	1.10	1.59	2.18	2.87	3.66
OUTFLOW	.00	.10	.83	2.80	6.63	12.94	22.36	35.51	53.00	75.47
ELEVATION	1346.50	1346.52	1346.56	1346.64	1346.75	1346.89	1347.06	1347.26	1347.49	1347.75
STORAGE	4.57	5.59	6.73	8.01	9.43	10.99	12.71	14.60	16.67	
OUTFLOW	103.52	137.79	178.88	227.44	284.06	349.38	424.02	508.60	603.74	
ELEVATION	1348.04	1348.37	1348.72	1349.11	1349.52	1349.97	1350.45	1350.96	1351.50	

\*\*\*\*\*

HYDROGRAPH AT STATION PON1\$2

\*\*\*\*\*

*				*				*				*											
DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*
11	FEB	0600	1	0.	.0	1346.5	*	11	FEB	1005	50	1.	.2	1346.6	*	11	FEB	1410	99	72.	3.5	1347.7	*
11	FEB	0605	2	0.	.0	1346.5	*	11	FEB	1010	51	1.	.2	1346.6	*	11	FEB	1415	100	68.	3.4	1347.7	*
11	FEB	0610	3	0.	.0	1346.5	*	11	FEB	1015	52	1.	.2	1346.6	*	11	FEB	1420	101	64.	3.3	1347.6	*
11	FEB	0615	4	0.	.0	1346.5	*	11	FEB	1020	53	1.	.2	1346.6	*	11	FEB	1425	102	61.	3.1	1347.6	*
11	FEB	0620	5	0.	.0	1346.5	*	11	FEB	1025	54	2.	.3	1346.6	*	11	FEB	1430	103	57.	3.0	1347.5	*
11	FEB	0625	6	0.	.0	1346.5	*	11	FEB	1030	55	2.	.3	1346.6	*	11	FEB	1435	104	54.	2.9	1347.5	*
11	FEB	0630	7	0.	.0	1346.5	*	11	FEB	1035	56	2.	.3	1346.6	*	11	FEB	1440	105	51.	2.8	1347.5	*
11	FEB	0635	8	0.	.0	1346.5	*	11	FEB	1040	57	3.	.4	1346.6	*	11	FEB	1445	106	49.	2.7	1347.4	*
11	FEB	0640	9	0.	.0	1346.5	*	11	FEB	1045	58	3.	.4	1346.6	*	11	FEB	1450	107	47.	2.6	1347.4	*
11	FEB	0645	10	0.	.0	1346.5	*	11	FEB	1050	59	4.	.5	1346.7	*	11	FEB	1455	108	45.	2.6	1347.4	*
11	FEB	0650	11	0.	.0	1346.5	*	11	FEB	1055	60	4.	.5	1346.7	*	11	FEB	1500	109	43.	2.5	1347.4	*
11	FEB	0655	12	0.	.0	1346.5	*	11	FEB	1100	61	5.	.6	1346.7	*	11	FEB	1505	110	42.	2.4	1347.3	*
11	FEB	0700	13	0.	.0	1346.5	*	11	FEB	1105	62	6.	.7	1346.7	*	11	FEB	1510	111	40.	2.4	1347.3	*
11	FEB	0705	14	0.	.0	1346.5	*	11	FEB	1110	63	7.	.7	1346.8	*	11	FEB	1515	112	39.	2.3	1347.3	*
11	FEB	0710	15	0.	.0	1346.5	*	11	FEB	1115	64	9.	.8	1346.8	*	11	FEB	1520	113	38.	2.3	1347.3	*
11	FEB	0715	16	0.	.0	1346.5	*	11	FEB	1120	65	10.	.9	1346.8	*	11	FEB	1525	114	37.	2.3	1347.3	*
11	FEB	0720	17	0.	.0	1346.5	*	11	FEB	1125	66	12.	1.0	1346.9	*	11	FEB	1530	115	37.	2.2	1347.3	*
11	FEB	0725	18	0.	.0	1346.5	*	11	FEB	1130	67	14.	1.2	1346.9	*	11	FEB	1535	116	36.	2.2	1347.3	*
11	FEB	0730	19	0.	.0	1346.5	*	11	FEB	1135	68	17.	1.3	1347.0	*	11	FEB	1540	117	36.	2.2	1347.3	*
11	FEB	0735	20	0.	.0	1346.5	*	11	FEB	1140	69	23.	1.6	1347.1	*	11	FEB	1545	118	35.	2.2	1347.3	*
11	FEB	0740	21	0.	.0	1346.5	*	11	FEB	1145	70	35.	2.1	1347.2	*	11	FEB	1550	119	35.	2.1	1347.2	*
11	FEB	0745	22	0.	.0	1346.5	*	11	FEB	1150	71	57.	3.0	1347.5	*	11	FEB	1555	120	34.	2.1	1347.2	*
11	FEB	0750	23	0.	.0	1346.5	*	11	FEB	1155	72	92.	4.2	1347.9	*	11	FEB	1600	121	34.	2.1	1347.2	*
11	FEB	0755	24	0.	.0	1346.5	*	11	FEB	1200	73	138.	5.6	1348.4	*	11	FEB	1605	122	34.	2.1	1347.2	*
11	FEB	0800	25	0.	.0	1346.5	*	11	FEB	1205	74	193.	7.1	1348.8	*	11	FEB	1610	123	34.	2.1	1347.2	*
11	FEB	0805	26	0.	.0	1346.5	*	11	FEB	1210	75	248.	8.5	1349.3	*	11	FEB	1615	124	33.	2.1	1347.2	*
11	FEB	0810	27	0.	.0	1346.5	*	11	FEB	1215	76	292.	9.6	1349.6	*	11	FEB	1620	125	33.	2.1	1347.2	*
11	FEB	0815	28	0.	.0	1346.5	*	11	FEB	1220	77	320.	10.3	1349.8	*	11	FEB	1625	126	32.	2.0	1347.2	*
11	FEB	0820	29	0.	.0	1346.5	*	11	FEB	1225	78	332.	10.6	1349.9	*	11	FEB	1630	127	32.	2.0	1347.2	*
11	FEB	0825	30	0.	.0	1346.5	*	11	FEB	1230	79	331.	10.6	1349.8	*	11	FEB	1635	128	31.	2.0	1347.2	*
11	FEB	0830	31	0.	.0	1346.5	*	11	FEB	1235	80	322.	10.3	1349.8	*	11	FEB	1640	129	30.	1.9	1347.2	*
11	FEB	0835	32	0.	.0	1346.5	*	11	FEB	1240	81	306.	10.0	1349.7	*	11	FEB	1645	130	29.	1.9	1347.2	*
11	FEB	0840	33	0.	.0	1346.5	*	11	FEB	1245	82	287.	9.5	1349.5	*	11	FEB	1650	131	28.	1.9	1347.1	*
11	FEB	0845	34	0.	.0	1346.5	*	11	FEB	1250	83	266.	9.0	1349.4	*	11	FEB	1655	132	28.	1.8	1347.1	*
11	FEB	0850	35	0.	.0	1346.5	*	11	FEB	1255	84	244.	8.4	1349.2	*	11	FEB	1700	133	27.	1.8	1347.1	*
11	FEB	0855	36	0.	.0	1346.5	*	11	FEB	1300	85	222.	7.9	1349.1	*	11	FEB	1705	134	26.	1.8	1347.1	*
11	FEB	0900	37	0.	.0	1346.5	*	11	FEB	1305	86	203.	7.4	1348.9	*	11	FEB	1710	135	26.	1.7	1347.1	*
11	FEB	0905	38	0.	.0	1346.5	*	11	FEB	1310	87	184.	6.9	1348.8	*	11	FEB	1715	136	25.	1.7	1347.1	*
11	FEB	0910	39	0.	.0	1346.5	*	11	FEB	1315	88	168.	6.4	1348.6	*	11	FEB	1720	137	25.	1.7	1347.1	*
11	FEB	0915	40	0.	.0	1346.5	*	11	FEB	1320	89	153.	6.0	1348.5	*	11	FEB	1725	138	25.	1.7	1347.1	*
11	FEB	0920	41	0.	.0	1346.5	*	11	FEB	1325	90	140.	5.6	1348.4	*	11	FEB	1730	139	24.	1.7	1347.1	*
11	FEB	0925	42	0.	.0	1346.5	*	11	FEB	1330	91	128.	5.3	1348.3	*	11	FEB	1735	140	24.	1.7	1347.1	*
11	FEB	0930	43	0.	.1	1346.5	*	11	FEB	1335	92	118.	5.0	1348.2	*	11	FEB	1740	141	24.	1.6	1347.1	*
11	FEB	0935	44	0.	.1	1346.5	*	11	FEB	1340	93	109.	4.7	1348.1	*	11	FEB	1745	142	23.	1.6	1347.1	*
11	FEB	0940	45	0.	.1	1346.5	*	11	FEB	1345	94	101.	4.5	1348.0	*	11	FEB	1750	143	23.	1.6	1347.1	*
11	FEB	0945	46	0.	.1	1346.5	*	11	FEB	1350	95	94.	4.3	1347.9	*	11	FEB	1755	144	22.	1.6	1347.1	*
11	FEB	0950	47	0.	.1	1346.5	*	11	FEB	1355	96	88.	4.1	1347.9	*	11	FEB	1800	145	22.	1.5	1347.0	*
11	FEB	0955	48	1.	.1	1346.5	*	11	FEB	1400	97	82.	3.9	1347.8	*								
11	FEB	1000	49	1.	.1	1346.6	*	11	FEB	1405	98	77.	3.7	1347.8	*								

\*\*\*\*\*

PEAK FLOW	TIME	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	12.00-HR
+ (CFS)	(HR)				
+ 332.	6.42	97.	50.	50.	50.
		(INCHES)	4.322	4.453	4.453
		(AC-FT)	48.	49.	49.
PEAK STORAGE	TIME	MAXIMUM AVERAGE STORAGE			
		6-HR	24-HR	72-HR	12.00-HR
+ (AC-FT)	(HR)				
+ 11.	6.42	4.	2.	2.	2.
PEAK STAGE	TIME	MAXIMUM AVERAGE STAGE			
		6-HR	24-HR	72-HR	12.00-HR
+ (FEET)	(HR)				
+ 1349.86	6.42	1347.85	1347.22	1347.22	1347.22

CUMULATIVE AREA = .21 SQ MI



11 FEB 0715	16	.02	.02	.00	0.	*	11 FEB 1320	89	.04	.00	.04	54.
11 FEB 0720	17	.02	.02	.00	0.	*	11 FEB 1325	90	.04	.00	.04	51.
11 FEB 0725	18	.02	.02	.00	0.	*	11 FEB 1330	91	.04	.00	.04	49.
11 FEB 0730	19	.02	.02	.00	0.	*	11 FEB 1335	92	.03	.00	.03	47.
11 FEB 0735	20	.02	.02	.00	0.	*	11 FEB 1340	93	.03	.00	.03	45.
11 FEB 0740	21	.02	.02	.00	0.	*	11 FEB 1345	94	.03	.00	.03	42.
11 FEB 0745	22	.02	.02	.00	0.	*	11 FEB 1350	95	.03	.00	.03	40.
11 FEB 0750	23	.02	.02	.00	0.	*	11 FEB 1355	96	.03	.00	.03	38.
11 FEB 0755	24	.02	.02	.00	0.	*	11 FEB 1400	97	.03	.00	.03	37.
11 FEB 0800	25	.02	.02	.00	0.	*	11 FEB 1405	98	.02	.00	.02	36.
11 FEB 0805	26	.02	.02	.00	0.	*	11 FEB 1410	99	.02	.00	.02	34.
11 FEB 0810	27	.02	.02	.00	0.	*	11 FEB 1415	100	.02	.00	.02	32.
11 FEB 0815	28	.02	.02	.00	0.	*	11 FEB 1420	101	.02	.00	.02	30.
11 FEB 0820	29	.02	.02	.00	0.	*	11 FEB 1425	102	.02	.00	.02	28.
11 FEB 0825	30	.02	.02	.00	0.	*	11 FEB 1430	103	.02	.00	.02	27.
11 FEB 0830	31	.02	.02	.00	0.	*	11 FEB 1435	104	.02	.00	.02	26.
11 FEB 0835	32	.02	.02	.00	0.	*	11 FEB 1440	105	.02	.00	.02	26.
11 FEB 0840	33	.02	.02	.00	1.	*	11 FEB 1445	106	.02	.00	.02	26.
11 FEB 0845	34	.02	.02	.00	1.	*	11 FEB 1450	107	.02	.00	.02	26.
11 FEB 0850	35	.02	.02	.00	1.	*	11 FEB 1455	108	.02	.00	.02	26.
11 FEB 0855	36	.02	.02	.00	2.	*	11 FEB 1500	109	.02	.00	.02	26.
11 FEB 0900	37	.02	.02	.00	2.	*	11 FEB 1505	110	.02	.00	.02	25.
11 FEB 0905	38	.02	.02	.00	3.	*	11 FEB 1510	111	.02	.00	.02	25.
11 FEB 0910	39	.02	.02	.00	3.	*	11 FEB 1515	112	.02	.00	.02	25.
11 FEB 0915	40	.02	.02	.00	4.	*	11 FEB 1520	113	.02	.00	.02	25.
11 FEB 0920	41	.02	.02	.01	4.	*	11 FEB 1525	114	.02	.00	.02	25.
11 FEB 0925	42	.02	.02	.01	5.	*	11 FEB 1530	115	.02	.00	.02	25.
11 FEB 0930	43	.02	.02	.01	5.	*	11 FEB 1535	116	.02	.00	.02	25.
11 FEB 0935	44	.03	.02	.01	6.	*	11 FEB 1540	117	.02	.00	.02	25.
11 FEB 0940	45	.03	.02	.01	6.	*	11 FEB 1545	118	.02	.00	.02	26.
11 FEB 0945	46	.03	.02	.01	7.	*	11 FEB 1550	119	.02	.00	.02	26.
11 FEB 0950	47	.03	.02	.01	8.	*	11 FEB 1555	120	.02	.00	.02	26.
11 FEB 0955	48	.03	.02	.01	8.	*	11 FEB 1600	121	.02	.00	.02	26.
11 FEB 1000	49	.03	.02	.01	9.	*	11 FEB 1605	122	.02	.00	.01	25.
11 FEB 1005	50	.04	.02	.01	10.	*	11 FEB 1610	123	.02	.00	.01	24.
11 FEB 1010	51	.04	.02	.01	11.	*	11 FEB 1615	124	.02	.00	.01	22.
11 FEB 1015	52	.04	.02	.01	12.	*	11 FEB 1620	125	.02	.00	.01	21.
11 FEB 1020	53	.04	.02	.01	13.	*	11 FEB 1625	126	.02	.00	.01	19.
11 FEB 1025	54	.04	.02	.01	14.	*	11 FEB 1630	127	.02	.00	.01	18.
11 FEB 1030	55	.04	.02	.02	15.	*	11 FEB 1635	128	.02	.00	.01	18.
11 FEB 1035	56	.05	.03	.02	16.	*	11 FEB 1640	129	.02	.00	.01	18.
11 FEB 1040	57	.05	.03	.02	18.	*	11 FEB 1645	130	.02	.00	.01	17.
11 FEB 1045	58	.05	.03	.02	20.	*	11 FEB 1650	131	.02	.00	.01	17.
11 FEB 1050	59	.05	.02	.02	22.	*	11 FEB 1655	132	.02	.00	.01	17.
11 FEB 1055	60	.05	.02	.02	24.	*	11 FEB 1700	133	.02	.00	.01	17.
11 FEB 1100	61	.05	.02	.03	25.	*	11 FEB 1705	134	.02	.00	.01	17.
11 FEB 1105	62	.07	.03	.04	27.	*	11 FEB 1710	135	.02	.00	.01	17.
11 FEB 1110	63	.07	.03	.04	30.	*	11 FEB 1715	136	.02	.00	.01	17.
11 FEB 1115	64	.07	.03	.04	35.	*	11 FEB 1720	137	.02	.00	.01	17.
11 FEB 1120	65	.07	.03	.04	40.	*	11 FEB 1725	138	.02	.00	.01	17.
11 FEB 1125	66	.07	.03	.05	44.	*	11 FEB 1730	139	.02	.00	.01	17.
11 FEB 1130	67	.07	.03	.05	47.	*	11 FEB 1735	140	.01	.00	.01	17.
11 FEB 1135	68	.59	.18	.41	65.	*	11 FEB 1740	141	.01	.00	.01	16.
11 FEB 1140	69	.59	.14	.45	123.	*	11 FEB 1745	142	.01	.00	.01	15.
11 FEB 1145	70	.59	.11	.48	219.	*	11 FEB 1750	143	.01	.00	.01	13.
11 FEB 1150	71	.59	.09	.50	322.	*	11 FEB 1755	144	.01	.00	.01	12.
11 FEB 1155	72	.59	.07	.52	412.	*	11 FEB 1800	145	.01	.00	.01	11.
11 FEB 1200	73	.59	.06	.53	476.	*						

\*\*\*\*\*

TOTAL RAINFALL = 7.80, TOTAL LOSS = 2.13, TOTAL EXCESS = 5.67

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	12.00-HR	
504.	6.08	85.	45.	45.	45.	
		(INCHES)	5.261	5.633	5.633	5.633
		(AC-FT)	42.	45.	45.	45.

CUMULATIVE AREA = .15 SQ MI

\*\*\* \*\*

\*\*\*\*\*

64 KK \* INTO3 \*  
 \* \*  
 \*\*\*\*\*

65 HC HYDROGRAPH COMBINATION  
 ICOMP 2 NUMBER OF HYDROGRAPHS TO COMBINE

\*\*\*

\*\*\*\*\*

HYDROGRAPH AT STATION INTO3  
 SUM OF 2 HYDROGRAPHS

\*\*\*\*\*


DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	
11	FEB	0600	1	0.	*	11	FEB	0905	38	3.	*	11	FEB	1210	75	720.	*	11	FEB	1515	112	65.	*	
11	FEB	0605	2	0.	*	11	FEB	0910	39	3.	*	11	FEB	1215	76	684.	*	11	FEB	1520	113	64.	*	
11	FEB	0610	3	0.	*	11	FEB	0915	40	4.	*	11	FEB	1220	77	624.	*	11	FEB	1525	114	63.	*	
11	FEB	0615	4	0.	*	11	FEB	0920	41	4.	*	11	FEB	1225	78	565.	*	11	FEB	1530	115	62.	*	
11	FEB	0620	5	0.	*	11	FEB	0925	42	5.	*	11	FEB	1230	79	522.	*	11	FEB	1535	116	62.	*	
11	FEB	0625	6	0.	*	11	FEB	0930	43	5.	*	11	FEB	1235	80	484.	*	11	FEB	1540	117	61.	*	
11	FEB	0630	7	0.	*	11	FEB	0935	44	6.	*	11	FEB	1240	81	444.	*	11	FEB	1545	118	61.	*	
11	FEB	0635	8	0.	*	11	FEB	0940	45	7.	*	11	FEB	1245	82	402.	*	11	FEB	1550	119	60.	*	
11	FEB	0640	9	0.	*	11	FEB	0945	46	7.	*	11	FEB	1250	83	363.	*	11	FEB	1555	120	60.	*	
11	FEB	0645	10	0.	*	11	FEB	0950	47	8.	*	11	FEB	1255	84	328.	*	11	FEB	1600	121	60.	*	
11	FEB	0650	11	0.	*	11	FEB	0955	48	9.	*	11	FEB	1300	85	298.	*	11	FEB	1605	122	59.	*	
11	FEB	0655	12	0.	*	11	FEB	1000	49	10.	*	11	FEB	1305	86	272.	*	11	FEB	1610	123	58.	*	
11	FEB	0700	13	0.	*	11	FEB	1005	50	10.	*	11	FEB	1310	87	248.	*	11	FEB	1615	124	56.	*	
11	FEB	0705	14	0.	*	11	FEB	1010	51	11.	*	11	FEB	1315	88	227.	*	11	FEB	1620	125	53.	*	
11	FEB	0710	15	0.	*	11	FEB	1015	52	13.	*	11	FEB	1320	89	207.	*	11	FEB	1625	126	51.	*	
11	FEB	0715	16	0.	*	11	FEB	1020	53	14.	*	11	FEB	1325	90	190.	*	11	FEB	1630	127	50.	*	
11	FEB	0720	17	0.	*	11	FEB	1025	54	16.	*	11	FEB	1330	91	177.	*	11	FEB	1635	128	49.	*	
11	FEB	0725	18	0.	*	11	FEB	1030	55	17.	*	11	FEB	1335	92	165.	*	11	FEB	1640	129	48.	*	
11	FEB	0730	19	0.	*	11	FEB	1035	56	18.	*	11	FEB	1340	93	154.	*	11	FEB	1645	130	47.	*	
11	FEB	0735	20	0.	*	11	FEB	1040	57	20.	*	11	FEB	1345	94	143.	*	11	FEB	1650	131	46.	*	
11	FEB	0740	21	0.	*	11	FEB	1045	58	23.	*	11	FEB	1350	95	134.	*	11	FEB	1655	132	45.	*	
11	FEB	0745	22	0.	*	11	FEB	1050	59	26.	*	11	FEB	1355	96	126.	*	11	FEB	1700	133	44.	*	
11	FEB	0750	23	0.	*	11	FEB	1055	60	28.	*	11	FEB	1400	97	119.	*	11	FEB	1705	134	44.	*	
11	FEB	0755	24	0.	*	11	FEB	1100	61	30.	*	11	FEB	1405	98	113.	*	11	FEB	1710	135	43.	*	
11	FEB	0800	25	0.	*	11	FEB	1105	62	33.	*	11	FEB	1410	99	107.	*	11	FEB	1715	136	43.	*	
11	FEB	0805	26	0.	*	11	FEB	1110	63	38.	*	11	FEB	1415	100	100.	*	11	FEB	1720	137	42.	*	
11	FEB	0810	27	0.	*	11	FEB	1115	64	44.	*	11	FEB	1420	101	94.	*	11	FEB	1725	138	42.	*	
11	FEB	0815	28	0.	*	11	FEB	1120	65	50.	*	11	FEB	1425	102	89.	*	11	FEB	1730	139	41.	*	
11	FEB	0820	29	0.	*	11	FEB	1125	66	56.	*	11	FEB	1430	103	84.	*	11	FEB	1735	140	41.	*	
11	FEB	0825	30	0.	*	11	FEB	1130	67	61.	*	11	FEB	1435	104	81.	*	11	FEB	1740	141	40.	*	
11	FEB	0830	31	0.	*	11	FEB	1135	68	82.	*	11	FEB	1440	105	78.	*	11	FEB	1745	142	38.	*	
11	FEB	0835	32	0.	*	11	FEB	1140	69	146.	*	11	FEB	1445	106	75.	*	11	FEB	1750	143	36.	*	
11	FEB	0840	33	1.	*	11	FEB	1145	70	253.	*	11	FEB	1450	107	73.	*	11	FEB	1755	144	34.	*	
11	FEB	0845	34	1.	*	11	FEB	1150	71	379.	*	11	FEB	1455	108	71.	*	11	FEB	1800	145	33.	*	
11	FEB	0850	35	1.	*	11	FEB	1155	72	504.	*	11	FEB	1500	109	69.	*							
11	FEB	0855	36	2.	*	11	FEB	1200	73	614.	*	11	FEB	1505	110	67.	*							
11	FEB	0900	37	2.	*	11	FEB	1205	74	697.	*	11	FEB	1510	111	66.	*							

\*\*\*\*\*

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	12.00-HR	
720.	6.17	180.	95.	95.	95.	
		(INCHES)	4.677	4.947	4.947	4.947
		(AC-FT)	89.	94.	94.	94.
CUMULATIVE AREA =		.36 SQ MI				

\*\*\*\*\*

\*\*\*\*\*  
 \* \*  
 66 KK \* POND3 \*  
 \* \*  
 \*\*\*\*\*



HYDROGRAPH ROUTING DATA

67 RS	STORAGE ROUTING						
	NSTPS	1	NUMBER OF SUBREACHES				
	ITYP	ELEV	TYPE OF INITIAL CONDITION				
	RSVRIC	1345.00	INITIAL CONDITION				
	X	.00	WORKING R AND D COEFFICIENT				
68 SV	STORAGE	.0	8.0	16.0	23.0	31.0	35.0
69 SQ	DISCHARGE	0.	40.	220.	325.	400.	440.
70 SE	ELEVATION	1344.70	1346.00	1347.00	1348.00	1349.00	1349.50

\*\*\*

\*\*\*\*\*

HYDROGRAPH AT STATION POND3

\*\*\*\*\*

DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE
11	FEB	0600	1	9.	1.8	1345.0	*	11	FEB	1005	50	4.	.8	1344.8	*	11	FEB	1410	99	219.	15.9	1347.0
11	FEB	0605	2	9.	1.8	1345.0	*	11	FEB	1010	51	4.	.9	1344.8	*	11	FEB	1415	100	202.	15.2	1346.9
11	FEB	0610	3	9.	1.7	1345.0	*	11	FEB	1015	52	5.	.9	1344.8	*	11	FEB	1420	101	187.	14.5	1346.8
11	FEB	0615	4	8.	1.7	1345.0	*	11	FEB	1020	53	5.	1.0	1344.9	*	11	FEB	1425	102	173.	13.9	1346.7
11	FEB	0620	5	8.	1.6	1345.0	*	11	FEB	1025	54	5.	1.0	1344.9	*	11	FEB	1430	103	161.	13.4	1346.7
11	FEB	0625	6	8.	1.6	1345.0	*	11	FEB	1030	55	6.	1.1	1344.9	*	11	FEB	1435	104	150.	12.9	1346.6
11	FEB	0630	7	8.	1.5	1344.9	*	11	FEB	1035	56	6.	1.2	1344.9	*	11	FEB	1440	105	139.	12.4	1346.6
11	FEB	0635	8	7.	1.5	1344.9	*	11	FEB	1040	57	6.	1.3	1344.9	*	11	FEB	1445	106	130.	12.0	1346.5
11	FEB	0640	9	7.	1.4	1344.9	*	11	FEB	1045	58	7.	1.4	1344.9	*	11	FEB	1450	107	122.	11.7	1346.5
11	FEB	0645	10	7.	1.4	1344.9	*	11	FEB	1050	59	8.	1.5	1344.9	*	11	FEB	1455	108	115.	11.3	1346.4
11	FEB	0650	11	7.	1.3	1344.9	*	11	FEB	1055	60	8.	1.6	1345.0	*	11	FEB	1500	109	108.	11.0	1346.4
11	FEB	0655	12	6.	1.3	1344.9	*	11	FEB	1100	61	9.	1.8	1345.0	*	11	FEB	1505	110	103.	10.8	1346.3
11	FEB	0700	13	6.	1.2	1344.9	*	11	FEB	1105	62	10.	1.9	1345.0	*	11	FEB	1510	111	97.	10.6	1346.3
11	FEB	0705	14	6.	1.2	1344.9	*	11	FEB	1110	63	11.	2.1	1345.0	*	11	FEB	1515	112	93.	10.3	1346.3
11	FEB	0710	15	6.	1.1	1344.9	*	11	FEB	1115	64	12.	2.3	1345.1	*	11	FEB	1520	113	89.	10.2	1346.3
11	FEB	0715	16	6.	1.1	1344.9	*	11	FEB	1120	65	13.	2.6	1345.1	*	11	FEB	1525	114	85.	10.0	1346.3
11	FEB	0720	17	5.	1.1	1344.9	*	11	FEB	1125	66	14.	2.8	1345.2	*	11	FEB	1530	115	82.	9.9	1346.2
11	FEB	0725	18	5.	1.0	1344.9	*	11	FEB	1130	67	16.	3.1	1345.2	*	11	FEB	1535	116	79.	9.7	1346.2
11	FEB	0730	19	5.	1.0	1344.9	*	11	FEB	1135	68	18.	3.5	1345.3	*	11	FEB	1540	117	76.	9.6	1346.2
11	FEB	0735	20	5.	1.0	1344.9	*	11	FEB	1140	69	21.	4.2	1345.4	*	11	FEB	1545	118	74.	9.5	1346.2
11	FEB	0740	21	5.	.9	1344.9	*	11	FEB	1145	70	27.	5.4	1345.6	*	11	FEB	1550	119	72.	9.4	1346.2
11	FEB	0745	22	4.	.9	1344.8	*	11	FEB	1150	71	37.	7.3	1345.9	*	11	FEB	1555	120	70.	9.4	1346.2
11	FEB	0750	23	4.	.9	1344.8	*	11	FEB	1155	72	84.	10.0	1346.2	*	11	FEB	1600	121	69.	9.3	1346.2
11	FEB	0755	24	4.	.8	1344.8	*	11	FEB	1200	73	152.	13.0	1346.6	*	11	FEB	1605	122	68.	9.2	1346.2
11	FEB	0800	25	4.	.8	1344.8	*	11	FEB	1205	74	223.	16.2	1347.0	*	11	FEB	1610	123	66.	9.2	1346.1
11	FEB	0805	26	4.	.8	1344.8	*	11	FEB	1210	75	271.	19.4	1347.5	*	11	FEB	1615	124	65.	9.1	1346.1
11	FEB	0810	27	4.	.8	1344.8	*	11	FEB	1215	76	313.	22.2	1347.9	*	11	FEB	1620	125	63.	9.0	1346.1
11	FEB	0815	28	4.	.7	1344.8	*	11	FEB	1220	77	339.	24.5	1348.2	*	11	FEB	1625	126	62.	9.0	1346.1
11	FEB	0820	29	4.	.7	1344.8	*	11	FEB	1225	78	355.	26.2	1348.4	*	11	FEB	1630	127	60.	8.9	1346.1
11	FEB	0825	30	3.	.7	1344.8	*	11	FEB	1230	79	367.	27.4	1348.6	*	11	FEB	1635	128	59.	8.8	1346.1
11	FEB	0830	31	3.	.7	1344.8	*	11	FEB	1235	80	375.	28.4	1348.7	*	11	FEB	1640	129	57.	8.8	1346.1
11	FEB	0835	32	3.	.6	1344.8	*	11	FEB	1240	81	381.	29.0	1348.7	*	11	FEB	1645	130	56.	8.7	1346.1
11	FEB	0840	33	3.	.6	1344.8	*	11	FEB	1245	82	383.	29.2	1348.8	*	11	FEB	1650	131	54.	8.6	1346.1
11	FEB	0845	34	3.	.6	1344.8	*	11	FEB	1250	83	383.	29.2	1348.8	*	11	FEB	1655	132	53.	8.6	1346.1
11	FEB	0850	35	3.	.6	1344.8	*	11	FEB	1255	84	381.	29.0	1348.7	*	11	FEB	1700	133	52.	8.5	1346.1
11	FEB	0855	36	3.	.6	1344.8	*	11	FEB	1300	85	377.	28.5	1348.7	*	11	FEB	1705	134	51.	8.5	1346.1
11	FEB	0900	37	3.	.6	1344.8	*	11	FEB	1305	86	371.	27.9	1348.6	*	11	FEB	1710	135	50.	8.4	1346.1
11	FEB	0905	38	3.	.6	1344.8	*	11	FEB	1310	87	364.	27.2	1348.5	*	11	FEB	1715	136	49.	8.4	1346.0
11	FEB	0910	39	3.	.6	1344.8	*	11	FEB	1315	88	356.	26.3	1348.4	*	11	FEB	1720	137	48.	8.3	1346.0
11	FEB	0915	40	3.	.6	1344.8	*	11	FEB	1320	89	347.	25.4	1348.3	*	11	FEB	1725	138	47.	8.3	1346.0
11	FEB	0920	41	3.	.6	1344.8	*	11	FEB	1325	90	338.	24.4	1348.2	*	11	FEB	1730	139	46.	8.3	1346.0
11	FEB	0925	42	3.	.6	1344.8	*	11	FEB	1330	91	329.	23.4	1348.0	*	11	FEB	1735	140	45.	8.2	1346.0
11	FEB	0930	43	3.	.6	1344.8	*	11	FEB	1335	92	315.	22.3	1347.9	*	11	FEB	1740	141	45.	8.2	1346.0
11	FEB	0935	44	3.	.6	1344.8	*	11	FEB	1340	93	300.	21.3	1347.8	*	11	FEB	1745	142	44.	8.2	1346.0
11	FEB	0940	45	3.	.6	1344.8	*	11	FEB	1345	94	285.	20.3	1347.6	*	11	FEB	1750	143	43.	8.1	1346.0
11	FEB	0945	46	3.	.7	1344.8	*	11	FEB	1350	95	271.	19.4	1347.5	*	11	FEB	1755	144	42.	8.1	1346.0
11	FEB	0950	47	4.	.7	1344.8	*	11	FEB	1355	96	257.	18.4	1347.3	*	11	FEB	1800	145	41.	8.0	1346.0
11	FEB	0955	48	4.	.7	1344.8	*	11	FEB	1400	97	244.	17.6	1347.2	*							
11	FEB	1000	49	4.	.8	1344.8	*	11	FEB	1405	98	231.	16.7	1347.1	*							

\*\*\*\*\*

PEAK FLOW	TIME	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	12.00-HR
+ (CFS)	(HR)				



\*\*\*\*\*

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q
11	FEB	0600	1	.00	.00	.00	0.	0.	*	11	FEB	1205	74	.11	.02	.09	56.	
11	FEB	0605	2	.02	.02	.00	0.	0.	*	11	FEB	1210	75	.11	.02	.10	53.	
11	FEB	0610	3	.02	.02	.00	0.	0.	*	11	FEB	1215	76	.11	.02	.10	44.	
11	FEB	0615	4	.02	.02	.00	0.	0.	*	11	FEB	1220	77	.11	.02	.10	35.	
11	FEB	0620	5	.02	.02	.00	0.	0.	*	11	FEB	1225	78	.11	.02	.10	27.	
11	FEB	0625	6	.02	.02	.00	0.	0.	*	11	FEB	1230	79	.11	.02	.10	22.	
11	FEB	0630	7	.02	.02	.00	0.	0.	*	11	FEB	1235	80	.06	.01	.05	19.	
11	FEB	0635	8	.02	.02	.00	0.	0.	*	11	FEB	1240	81	.06	.01	.05	16.	
11	FEB	0640	9	.02	.02	.00	0.	0.	*	11	FEB	1245	82	.06	.01	.05	14.	
11	FEB	0645	10	.02	.02	.00	0.	0.	*	11	FEB	1250	83	.06	.01	.05	11.	
11	FEB	0650	11	.02	.02	.00	0.	0.	*	11	FEB	1255	84	.06	.01	.05	10.	
11	FEB	0655	12	.02	.02	.00	0.	0.	*	11	FEB	1300	85	.06	.01	.05	9.	
11	FEB	0700	13	.02	.02	.00	0.	0.	*	11	FEB	1305	86	.04	.01	.04	8.	
11	FEB	0705	14	.02	.02	.00	0.	0.	*	11	FEB	1310	87	.04	.01	.04	8.	
11	FEB	0710	15	.02	.02	.00	0.	0.	*	11	FEB	1315	88	.04	.01	.04	7.	
11	FEB	0715	16	.02	.02	.00	0.	0.	*	11	FEB	1320	89	.04	.01	.04	6.	
11	FEB	0720	17	.02	.02	.00	0.	0.	*	11	FEB	1325	90	.04	.00	.04	6.	
11	FEB	0725	18	.02	.02	.00	0.	0.	*	11	FEB	1330	91	.04	.00	.04	6.	
11	FEB	0730	19	.02	.02	.00	0.	0.	*	11	FEB	1335	92	.03	.00	.03	6.	
11	FEB	0735	20	.02	.02	.00	0.	0.	*	11	FEB	1340	93	.03	.00	.03	5.	
11	FEB	0740	21	.02	.02	.00	0.	0.	*	11	FEB	1345	94	.03	.00	.03	5.	
11	FEB	0745	22	.02	.02	.00	0.	0.	*	11	FEB	1350	95	.03	.00	.03	5.	
11	FEB	0750	23	.02	.02	.00	0.	0.	*	11	FEB	1355	96	.03	.00	.03	5.	
11	FEB	0755	24	.02	.02	.00	0.	0.	*	11	FEB	1400	97	.03	.00	.03	4.	
11	FEB	0800	25	.02	.02	.00	0.	0.	*	11	FEB	1405	98	.02	.00	.02	4.	
11	FEB	0805	26	.02	.02	.00	0.	0.	*	11	FEB	1410	99	.02	.00	.02	4.	
11	FEB	0810	27	.02	.02	.00	0.	0.	*	11	FEB	1415	100	.02	.00	.02	4.	
11	FEB	0815	28	.02	.02	.00	0.	0.	*	11	FEB	1420	101	.02	.00	.02	4.	
11	FEB	0820	29	.02	.02	.00	0.	0.	*	11	FEB	1425	102	.02	.00	.02	3.	
11	FEB	0825	30	.02	.02	.00	0.	0.	*	11	FEB	1430	103	.02	.00	.02	3.	
11	FEB	0830	31	.02	.02	.00	0.	0.	*	11	FEB	1435	104	.02	.00	.02	3.	
11	FEB	0835	32	.02	.02	.00	0.	0.	*	11	FEB	1440	105	.02	.00	.02	3.	
11	FEB	0840	33	.02	.02	.00	0.	0.	*	11	FEB	1445	106	.02	.00	.02	3.	
11	FEB	0845	34	.02	.02	.00	0.	0.	*	11	FEB	1450	107	.02	.00	.02	3.	
11	FEB	0850	35	.02	.02	.00	0.	0.	*	11	FEB	1455	108	.02	.00	.02	3.	
11	FEB	0855	36	.02	.02	.00	0.	0.	*	11	FEB	1500	109	.02	.00	.02	3.	
11	FEB	0900	37	.02	.02	.00	0.	0.	*	11	FEB	1505	110	.02	.00	.02	3.	
11	FEB	0905	38	.02	.02	.00	0.	0.	*	11	FEB	1510	111	.02	.00	.02	3.	
11	FEB	0910	39	.02	.02	.00	0.	0.	*	11	FEB	1515	112	.02	.00	.02	3.	
11	FEB	0915	40	.02	.02	.00	0.	0.	*	11	FEB	1520	113	.02	.00	.02	3.	
11	FEB	0920	41	.02	.02	.00	0.	0.	*	11	FEB	1525	114	.02	.00	.02	3.	
11	FEB	0925	42	.02	.02	.00	0.	0.	*	11	FEB	1530	115	.02	.00	.02	3.	
11	FEB	0930	43	.02	.02	.00	0.	0.	*	11	FEB	1535	116	.02	.00	.02	3.	
11	FEB	0935	44	.03	.03	.00	0.	0.	*	11	FEB	1540	117	.02	.00	.02	3.	
11	FEB	0940	45	.03	.02	.00	0.	0.	*	11	FEB	1545	118	.02	.00	.02	3.	
11	FEB	0945	46	.03	.02	.00	0.	0.	*	11	FEB	1550	119	.02	.00	.02	3.	
11	FEB	0950	47	.03	.02	.00	0.	0.	*	11	FEB	1555	120	.02	.00	.02	3.	
11	FEB	0955	48	.03	.02	.00	0.	0.	*	11	FEB	1600	121	.02	.00	.02	3.	
11	FEB	1000	49	.03	.02	.00	0.	0.	*	11	FEB	1605	122	.02	.00	.01	3.	
11	FEB	1005	50	.04	.03	.01	1.	1.	*	11	FEB	1610	123	.02	.00	.01	3.	
11	FEB	1010	51	.04	.03	.01	1.	1.	*	11	FEB	1615	124	.02	.00	.01	3.	
11	FEB	1015	52	.04	.03	.01	1.	1.	*	11	FEB	1620	125	.02	.00	.01	2.	
11	FEB	1020	53	.04	.03	.01	1.	1.	*	11	FEB	1625	126	.02	.00	.01	2.	
11	FEB	1025	54	.04	.03	.01	1.	1.	*	11	FEB	1630	127	.02	.00	.01	2.	
11	FEB	1030	55	.04	.03	.01	1.	1.	*	11	FEB	1635	128	.02	.00	.01	2.	
11	FEB	1035	56	.05	.03	.01	1.	1.	*	11	FEB	1640	129	.02	.00	.01	2.	
11	FEB	1040	57	.05	.03	.01	1.	1.	*	11	FEB	1645	130	.02	.00	.01	2.	
11	FEB	1045	58	.05	.03	.01	1.	1.	*	11	FEB	1650	131	.02	.00	.01	2.	
11	FEB	1050	59	.05	.03	.02	2.	2.	*	11	FEB	1655	132	.02	.00	.01	2.	
11	FEB	1055	60	.05	.03	.02	2.	2.	*	11	FEB	1700	133	.02	.00	.01	2.	
11	FEB	1100	61	.05	.03	.02	2.	2.	*	11	FEB	1705	134	.02	.00	.01	2.	
11	FEB	1105	62	.07	.05	.03	2.	2.	*	11	FEB	1710	135	.02	.00	.01	2.	
11	FEB	1110	63	.07	.04	.03	3.	3.	*	11	FEB	1715	136	.02	.00	.01	2.	
11	FEB	1115	64	.07	.04	.03	3.	3.	*	11	FEB	1720	137	.02	.00	.01	2.	
11	FEB	1120	65	.07	.04	.03	4.	4.	*	11	FEB	1725	138	.02	.00	.01	2.	
11	FEB	1125	66	.07	.04	.03	4.	4.	*	11	FEB	1730	139	.02	.00	.01	2.	
11	FEB	1130	67	.07	.04	.04	4.	4.	*	11	FEB	1735	140	.01	.00	.01	2.	
11	FEB	1135	68	.59	.27	.32	6.	6.	*	11	FEB	1740	141	.01	.00	.01	2.	
11	FEB	1140	69	.59	.21	.38	12.	12.	*	11	FEB	1745	142	.01	.00	.01	2.	
11	FEB	1145	70	.59	.17	.42	22.	22.	*	11	FEB	1750	143	.01	.00	.01	2.	
11	FEB	1150	71	.59	.14	.45	34.	34.	*	11	FEB	1755	144	.01	.00	.01	1.	
11	FEB	1155	72	.59	.12	.47	44.	44.	*	11	FEB	1800	145	.01	.00	.01	1.	
11	FEB	1200	73	.59	.10	.49	52.	52.	*									

\*\*\*\*\*

TOTAL RAINFALL = 7.80, TOTAL LOSS = 2.82, TOTAL EXCESS = 4.98

PEAK FLOW + (CFS)	TIME (HR)	(CFS)	MAXIMUM AVERAGE FLOW			
			6-HR	24-HR	72-HR	12.00-HR
+ 56.	6.08		9.	5.	5.	5.
		(INCHES)	4.679	4.940	4.940	4.940
		(AC-FT)	5.	5.	5.	5.
CUMULATIVE AREA =			.02 SQ MI			

\*\*\* \*\*

80 KK \*\*\*\*\*  
\* \*  
\* INTO4 \*  
\* \*  
\*\*\*\*\*

81 HC HYDROGRAPH COMBINATION  
ICOMP 2 NUMBER OF HYDROGRAPHS TO COMBINE

\*\*\*

\*\*\*\*\*

HYDROGRAPH AT STATION INTO4  
SUM OF 2 HYDROGRAPHS

\*\*\*\*\*

DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*
11	FEB	0600	1	9.	*	11	FEB	0905	38	3.	*	11	FEB	1210	75	324.	*	11	FEB	1515	112	96.	*						
11	FEB	0605	2	9.	*	11	FEB	0910	39	3.	*	11	FEB	1215	76	358.	*	11	FEB	1520	113	92.	*						
11	FEB	0610	3	9.	*	11	FEB	0915	40	3.	*	11	FEB	1220	77	374.	*	11	FEB	1525	114	88.	*						
11	FEB	0615	4	8.	*	11	FEB	0920	41	3.	*	11	FEB	1225	78	382.	*	11	FEB	1530	115	85.	*						
11	FEB	0620	5	8.	*	11	FEB	0925	42	3.	*	11	FEB	1230	79	389.	*	11	FEB	1535	116	82.	*						
11	FEB	0625	6	8.	*	11	FEB	0930	43	3.	*	11	FEB	1235	80	394.	*	11	FEB	1540	117	79.	*						
11	FEB	0630	7	8.	*	11	FEB	0935	44	3.	*	11	FEB	1240	81	397.	*	11	FEB	1545	118	77.	*						
11	FEB	0635	8	7.	*	11	FEB	0940	45	3.	*	11	FEB	1245	82	397.	*	11	FEB	1550	119	75.	*						
11	FEB	0640	9	7.	*	11	FEB	0945	46	4.	*	11	FEB	1250	83	395.	*	11	FEB	1555	120	74.	*						
11	FEB	0645	10	7.	*	11	FEB	0950	47	4.	*	11	FEB	1255	84	391.	*	11	FEB	1600	121	72.	*						
11	FEB	0650	11	7.	*	11	FEB	0955	48	4.	*	11	FEB	1300	85	386.	*	11	FEB	1605	122	71.	*						
11	FEB	0655	12	6.	*	11	FEB	1000	49	4.	*	11	FEB	1305	86	379.	*	11	FEB	1610	123	69.	*						
11	FEB	0700	13	6.	*	11	FEB	1005	50	5.	*	11	FEB	1310	87	372.	*	11	FEB	1615	124	68.	*						
11	FEB	0705	14	6.	*	11	FEB	1010	51	5.	*	11	FEB	1315	88	363.	*	11	FEB	1620	125	66.	*						
11	FEB	0710	15	6.	*	11	FEB	1015	52	5.	*	11	FEB	1320	89	354.	*	11	FEB	1625	126	64.	*						
11	FEB	0715	16	6.	*	11	FEB	1020	53	6.	*	11	FEB	1325	90	344.	*	11	FEB	1630	127	62.	*						
11	FEB	0720	17	5.	*	11	FEB	1025	54	6.	*	11	FEB	1330	91	334.	*	11	FEB	1635	128	61.	*						
11	FEB	0725	18	5.	*	11	FEB	1030	55	7.	*	11	FEB	1335	92	321.	*	11	FEB	1640	129	59.	*						
11	FEB	0730	19	5.	*	11	FEB	1035	56	7.	*	11	FEB	1340	93	305.	*	11	FEB	1645	130	58.	*						
11	FEB	0735	20	5.	*	11	FEB	1040	57	8.	*	11	FEB	1345	94	290.	*	11	FEB	1650	131	56.	*						
11	FEB	0740	21	5.	*	11	FEB	1045	58	8.	*	11	FEB	1350	95	275.	*	11	FEB	1655	132	55.	*						
11	FEB	0745	22	4.	*	11	FEB	1050	59	9.	*	11	FEB	1355	96	261.	*	11	FEB	1700	133	54.	*						
11	FEB	0750	23	4.	*	11	FEB	1055	60	10.	*	11	FEB	1400	97	248.	*	11	FEB	1705	134	53.	*						
11	FEB	0755	24	4.	*	11	FEB	1100	61	11.	*	11	FEB	1405	98	235.	*	11	FEB	1710	135	52.	*						
11	FEB	0800	25	4.	*	11	FEB	1105	62	12.	*	11	FEB	1410	99	223.	*	11	FEB	1715	136	51.	*						
11	FEB	0805	26	4.	*	11	FEB	1110	63	13.	*	11	FEB	1415	100	206.	*	11	FEB	1720	137	50.	*						
11	FEB	0810	27	4.	*	11	FEB	1115	64	15.	*	11	FEB	1420	101	191.	*	11	FEB	1725	138	49.	*						
11	FEB	0815	28	4.	*	11	FEB	1120	65	16.	*	11	FEB	1425	102	177.	*	11	FEB	1730	139	48.	*						
11	FEB	0820	29	4.	*	11	FEB	1125	66	18.	*	11	FEB	1430	103	164.	*	11	FEB	1735	140	47.	*						
11	FEB	0825	30	3.	*	11	FEB	1130	67	20.	*	11	FEB	1435	104	153.	*	11	FEB	1740	141	47.	*						
11	FEB	0830	31	3.	*	11	FEB	1135	68	24.	*	11	FEB	1440	105	143.	*	11	FEB	1745	142	46.	*						
11	FEB	0835	32	3.	*	11	FEB	1140	69	33.	*	11	FEB	1445	106	133.	*	11	FEB	1750	143	44.	*						
11	FEB	0840	33	3.	*	11	FEB	1145	70	49.	*	11	FEB	1450	107	125.	*	11	FEB	1755	144	43.	*						
11	FEB	0845	34	3.	*	11	FEB	1150	71	70.	*	11	FEB	1455	108	118.	*	11	FEB	1800	145	42.	*						
11	FEB	0850	35	3.	*	11	FEB	1155	72	128.	*	11	FEB	1500	109	111.	*						*						
11	FEB	0855	36	3.	*	11	FEB	1200	73	204.	*	11	FEB	1505	110	106.	*						*						
11	FEB	0900	37	3.	*	11	FEB	1205	74	279.	*	11	FEB	1510	111	100.	*						*						

\*\*\*\*\*

PEAK FLOW TIME MAXIMUM AVERAGE FLOW

+ (CFS)	(HR)		6-HR	24-HR	72-HR	12.00-HR
+ 397.	6.75	(CFS)	179.	94.	94.	94.
		(INCHES)	4.425	4.639	4.639	4.639
		(AC-FT)	89.	93.	93.	93.

CUMULATIVE AREA = .38 SQ MI

\*\*\* \*\*

\*\*\*\*\*  
 \* \*  
 82 KK \* POND4 \*  
 \* \*  
 \*\*\*\*\*

HYDROGRAPH ROUTING DATA

83 RS	STORAGE ROUTING					
	NSTPS	1	NUMBER OF SUBREACHES			
	ITYP	ELEV	TYPE OF INITIAL CONDITION			
	RSVRIC	1344.70	INITIAL CONDITION			
	X	.00	WORKING R AND D COEFFICIENT			
84 SV	STORAGE	.0	.6	1.1	1.7	2.3 2.8
85 SQ	DISCHARGE	0.	40.	210.	350.	450. 530.
86 SE	ELEVATION	1344.70	1345.70	1346.70	1347.70	1348.70 1349.70

\*\*\*

\*\*\* WARNING \*\*\* MODIFIED PULS ROUTING MAY BE NUMERICALLY UNSTABLE FOR OUTFLOWS BETWEEN 40. TO 210.  
 THE ROUTED HYDROGRAPH SHOULD BE EXAMINED FOR OSCILLATIONS OR OUTFLOWS GREATER THAN PEAK INFLOWS.  
 THIS CAN BE CORRECTED BY DECREASING THE TIME INTERVAL OR INCREASING STORAGE (USE A LONGER REACH.)

\*\*\*\*\*

HYDROGRAPH AT STATION POND4

\*\*\*\*\*

DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE
11	FEB	0600	1	0.	.0	1344.7	*	11	FEB	1005	50	4.	.1	1344.8	*	11	FEB	1410	99	231.	1.2	1346.8
11	FEB	0605	2	3.	.1	1344.8	*	11	FEB	1010	51	4.	.1	1344.8	*	11	FEB	1415	100	216.	1.1	1346.7
11	FEB	0610	3	5.	.1	1344.8	*	11	FEB	1015	52	5.	.1	1344.8	*	11	FEB	1420	101	198.	1.1	1346.6
11	FEB	0615	4	7.	.1	1344.9	*	11	FEB	1020	53	5.	.1	1344.8	*	11	FEB	1425	102	182.	1.0	1346.5
11	FEB	0620	5	7.	.1	1344.9	*	11	FEB	1025	54	5.	.1	1344.8	*	11	FEB	1430	103	169.	1.0	1346.5
11	FEB	0625	6	7.	.1	1344.9	*	11	FEB	1030	55	6.	.1	1344.8	*	11	FEB	1435	104	157.	.9	1346.4
11	FEB	0630	7	8.	.1	1344.9	*	11	FEB	1035	56	6.	.1	1344.9	*	11	FEB	1440	105	147.	.9	1346.3
11	FEB	0635	8	7.	.1	1344.9	*	11	FEB	1040	57	7.	.1	1344.9	*	11	FEB	1445	106	137.	.9	1346.3
11	FEB	0640	9	7.	.1	1344.9	*	11	FEB	1045	58	7.	.1	1344.9	*	11	FEB	1450	107	129.	.9	1346.2
11	FEB	0645	10	7.	.1	1344.9	*	11	FEB	1050	59	8.	.1	1344.9	*	11	FEB	1455	108	121.	.8	1346.2
11	FEB	0650	11	7.	.1	1344.9	*	11	FEB	1055	60	8.	.1	1344.9	*	11	FEB	1500	109	114.	.8	1346.1
11	FEB	0655	12	7.	.1	1344.9	*	11	FEB	1100	61	9.	.1	1344.9	*	11	FEB	1505	110	108.	.8	1346.1
11	FEB	0700	13	7.	.1	1344.9	*	11	FEB	1105	62	10.	.2	1345.0	*	11	FEB	1510	111	103.	.8	1346.1
11	FEB	0705	14	6.	.1	1344.9	*	11	FEB	1110	63	11.	.2	1345.0	*	11	FEB	1515	112	98.	.8	1346.0
11	FEB	0710	15	6.	.1	1344.9	*	11	FEB	1115	64	12.	.2	1345.0	*	11	FEB	1520	113	94.	.8	1346.0
11	FEB	0715	16	6.	.1	1344.8	*	11	FEB	1120	65	13.	.2	1345.0	*	11	FEB	1525	114	90.	.7	1346.0
11	FEB	0720	17	6.	.1	1344.8	*	11	FEB	1125	66	15.	.2	1345.1	*	11	FEB	1530	115	86.	.7	1346.0
11	FEB	0725	18	6.	.1	1344.8	*	11	FEB	1130	67	16.	.2	1345.1	*	11	FEB	1535	116	83.	.7	1346.0
11	FEB	0730	19	5.	.1	1344.8	*	11	FEB	1135	68	18.	.3	1345.2	*	11	FEB	1540	117	81.	.7	1345.9
11	FEB	0735	20	5.	.1	1344.8	*	11	FEB	1140	69	22.	.3	1345.3	*	11	FEB	1545	118	78.	.7	1345.9
11	FEB	0740	21	5.	.1	1344.8	*	11	FEB	1145	70	29.	.4	1345.4	*	11	FEB	1550	119	76.	.7	1345.9
11	FEB	0745	22	5.	.1	1344.8	*	11	FEB	1150	71	42.	.6	1345.7	*	11	FEB	1555	120	74.	.7	1345.9
11	FEB	0750	23	5.	.1	1344.8	*	11	FEB	1155	72	104.	.8	1346.1	*	11	FEB	1600	121	73.	.7	1345.9
11	FEB	0755	24	5.	.1	1344.8	*	11	FEB	1200	73	171.	1.0	1346.5	*	11	FEB	1605	122	71.	.7	1345.9
11	FEB	0800	25	4.	.1	1344.8	*	11	FEB	1205	74	241.	1.2	1346.9	*	11	FEB	1610	123	70.	.7	1345.9
11	FEB	0805	26	4.	.1	1344.8	*	11	FEB	1210	75	295.	1.5	1347.3	*	11	FEB	1615	124	68.	.7	1345.9
11	FEB	0810	27	4.	.1	1344.8	*	11	FEB	1215	76	336.	1.6	1347.6	*	11	FEB	1620	125	67.	.7	1345.9
11	FEB	0815	28	4.	.1	1344.8	*	11	FEB	1220	77	360.	1.8	1347.8	*	11	FEB	1625	126	65.	.7	1345.8
11	FEB	0820	29	4.	.1	1344.8	*	11	FEB	1225	78	373.	1.8	1347.9	*	11	FEB	1630	127	63.	.7	1345.8
11	FEB	0825	30	4.	.1	1344.8	*	11	FEB	1230	79	382.	1.9	1348.0	*	11	FEB	1635	128	62.	.7	1345.8
11	FEB	0830	31	4.	.1	1344.8	*	11	FEB	1235	80	389.	1.9	1348.1	*	11	FEB	1640	129	60.	.7	1345.8

11 FEB 0835	32	3.	.1	1344.8	* 11 FEB 1240	81	394.	2.0	1348.1	* 11 FEB 1645	130	58.	.7	1345.8
11 FEB 0840	33	3.	.0	1344.8	* 11 FEB 1245	82	396.	2.0	1348.2	* 11 FEB 1650	131	57.	.7	1345.8
11 FEB 0845	34	3.	.0	1344.8	* 11 FEB 1250	83	396.	2.0	1348.2	* 11 FEB 1655	132	56.	.6	1345.8
11 FEB 0850	35	3.	.0	1344.8	* 11 FEB 1255	84	394.	2.0	1348.1	* 11 FEB 1700	133	54.	.6	1345.8
11 FEB 0855	36	3.	.0	1344.8	* 11 FEB 1300	85	390.	1.9	1348.1	* 11 FEB 1705	134	53.	.6	1345.8
11 FEB 0900	37	3.	.0	1344.8	* 11 FEB 1305	86	384.	1.9	1348.0	* 11 FEB 1710	135	52.	.6	1345.8
11 FEB 0905	38	3.	.0	1344.8	* 11 FEB 1310	87	378.	1.9	1348.0	* 11 FEB 1715	136	51.	.6	1345.8
11 FEB 0910	39	3.	.0	1344.8	* 11 FEB 1315	88	370.	1.8	1347.9	* 11 FEB 1720	137	50.	.6	1345.8
11 FEB 0915	40	3.	.0	1344.8	* 11 FEB 1320	89	362.	1.8	1347.8	* 11 FEB 1725	138	49.	.6	1345.8
11 FEB 0920	41	3.	.0	1344.8	* 11 FEB 1325	90	352.	1.7	1347.7	* 11 FEB 1730	139	48.	.6	1345.7
11 FEB 0925	42	3.	.0	1344.8	* 11 FEB 1330	91	341.	1.7	1347.6	* 11 FEB 1735	140	48.	.6	1345.7
11 FEB 0930	43	3.	.0	1344.8	* 11 FEB 1335	92	329.	1.6	1347.5	* 11 FEB 1740	141	47.	.6	1345.7
11 FEB 0935	44	3.	.0	1344.8	* 11 FEB 1340	93	315.	1.5	1347.4	* 11 FEB 1745	142	46.	.6	1345.7
11 FEB 0940	45	3.	.0	1344.8	* 11 FEB 1345	94	299.	1.5	1347.3	* 11 FEB 1750	143	45.	.6	1345.7
11 FEB 0945	46	3.	.0	1344.8	* 11 FEB 1350	95	284.	1.4	1347.2	* 11 FEB 1755	144	44.	.6	1345.7
11 FEB 0950	47	3.	.1	1344.8	* 11 FEB 1355	96	270.	1.4	1347.1	* 11 FEB 1800	145	42.	.6	1345.7
11 FEB 0955	48	4.	.1	1344.8	* 11 FEB 1400	97	256.	1.3	1347.0	*				
11 FEB 1000	49	4.	.1	1344.8	* 11 FEB 1405	98	243.	1.2	1346.9	*				

\*\*\*\*\*

PEAK FLOW		MAXIMUM AVERAGE FLOW			
(CFS)	(HR)	6-HR	24-HR	72-HR	12.00-HR
+	396.	179.	93.	93.	93.
	6.75	4.419	4.609	4.609	4.609
		(INCHES)			
		(AC-FT)	89.	93.	93.

PEAK STORAGE		MAXIMUM AVERAGE STORAGE			
(AC-FT)	(HR)	6-HR	24-HR	72-HR	12.00-HR
+	2.	1.	1.	1.	1.
	6.75				

PEAK STAGE		MAXIMUM AVERAGE STAGE			
(FEET)	(HR)	6-HR	24-HR	72-HR	12.00-HR
+	1348.16	1346.59	1345.74	1345.74	1345.74
	6.75				

CUMULATIVE AREA = .38 SQ MI


RUNOFF SUMMARY  
FLOW IN CUBIC FEET PER SECOND  
TIME IN HOURS, AREA IN SQUARE MILES

	OPERATION	STATION	PEAK FLOW	TIME OF PEAK	AVERAGE FLOW FOR MAXIMUM PERIOD			BASIN AREA	MAXIMUM STAGE	TIME OF MAX STAGE
					6-HOUR	24-HOUR	72-HOUR			
+	HYDROGRAPH AT									
+		KASTEN	107.	6.42	28.	14.	14.	.06		
+	HYDROGRAPH AT									
+		RRWEST	169.	6.25	35.	18.	18.	.08		
+	2 COMBINED AT									
+		OFFSITE	264.	6.33	63.	33.	33.	.15		
+	HYDROGRAPH AT									
+		BASIN1	15.	6.08	3.	1.	1.	.00		
+	HYDROGRAPH AT									
+		BASIN2	191.	6.08	32.	17.	17.	.06		
+	3 COMBINED AT									
+		INTO2	436.	6.17	98.	51.	51.	.21		
+	ROUTED TO									
+		PONI\$2	332.	6.42	97.	50.	50.	.21		
+								1349.86	6.42	
+	HYDROGRAPH AT									
+		BASIN3	504.	6.08	85.	45.	45.	.15		
+	2 COMBINED AT									
+		INTO3	720.	6.17	180.	95.	95.	.36		
+	ROUTED TO									
+		POND3	383.	6.75	170.	89.	89.	.36		
+								1348.78	6.75	
+	HYDROGRAPH AT									
+		BASIN4	56.	6.08	9.	5.	5.	.02		
+	2 COMBINED AT									
+		INTO4	397.	6.75	179.	94.	94.	.38		
+	ROUTED TO									
+		POND4	396.	6.75	179.	93.	93.	.38		
+								1348.16	6.75	

\*\*\* NORMAL END OF HEC-1 \*\*\*

1:295,000 FEET

R. 1 W.

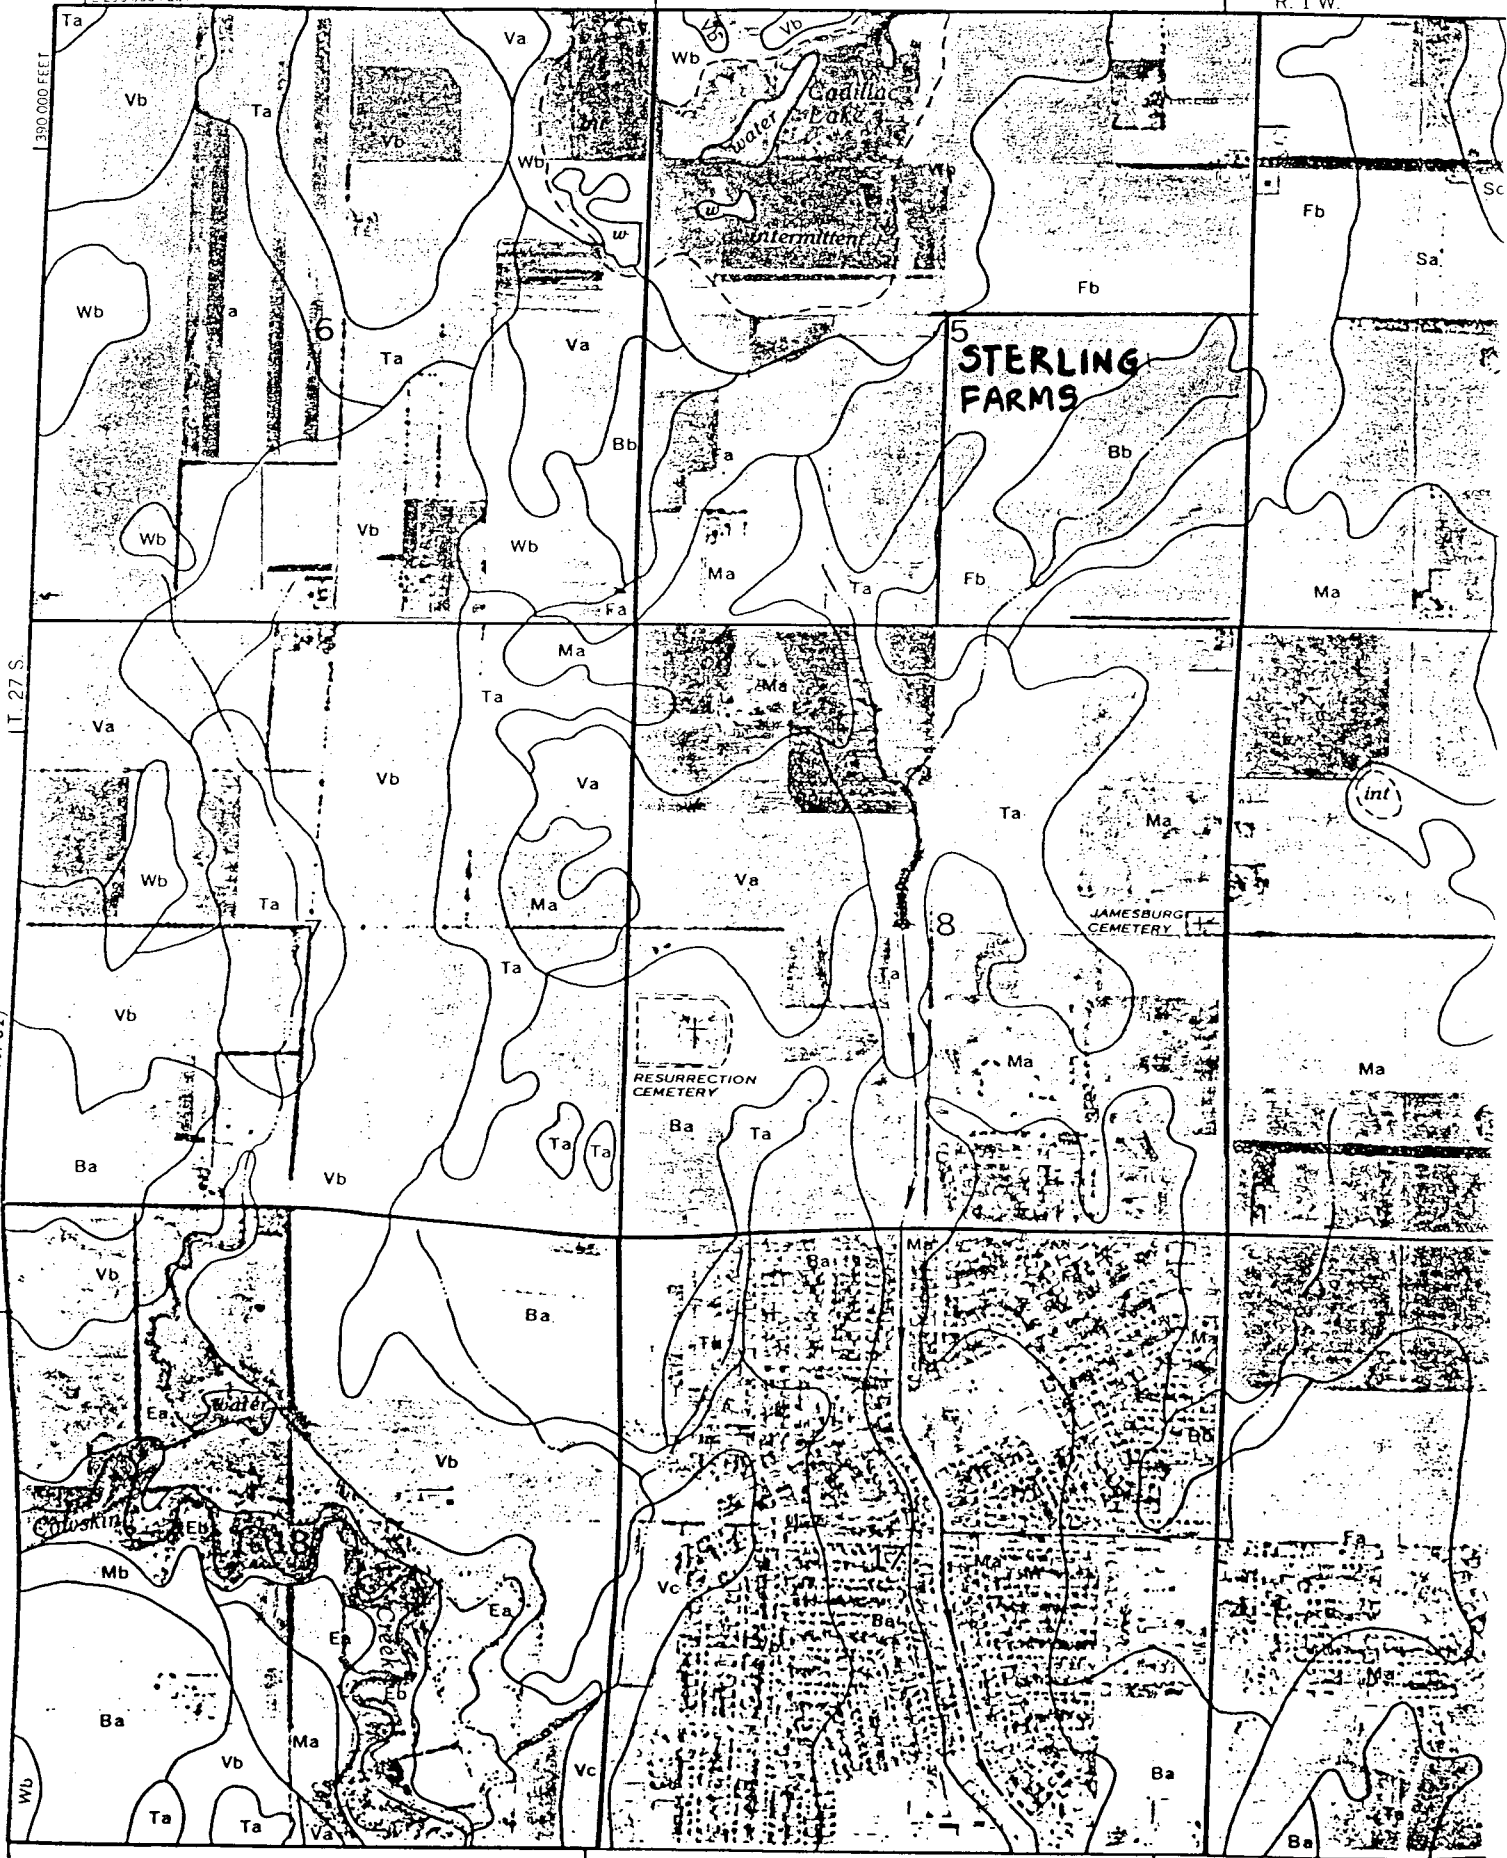

T. 27 S.  
(Joins sheet 32)

## EXHIBIT NO. 1

## SOIL LEGEND

<u>SYMBOL</u>	<u>HYDROLOGIC GROUP</u>	<u>NAME</u>
Aa	B	Albion-Shellabarger sandy loams, 1 to 4 percent slopes
Ab	B	Albion and Shellabarger sandy loams, 7 to 15 percent slopes
Ba	C	Blanket silt loam, 0 to 1 percent slopes
Bb	C	Blanket silt loam, 1 to 3 percent slopes
Ca	B	Canadian fine sandy loam
Cb	B	Canadian-Waldeck fine sandy loams
Cc	D	Carwile fine sandy loam
Cd	B	Clark-Ost clay loams, 1 to 4 percent slopes
Ce	C	Cline silty clay, 3 to 6 percent slopes
Ea	B	Elandco silt loam
Eb	B	Elandco silt loam, occasionally flooded
Ec	B	Elandco silt loam, frequently flooded
Fa	B	Farnum loam, 0 to 1 percent slopes
Fb	B	Farnum loam, 1 to 3 percent slopes
Fc	B	Farnum loam, sandy substratum, 0 to 1 percent slopes
Ga	D	Goessel silty clay, 0 to 1 percent slopes
Gb	D	Goessel silty clay, 1 to 2 percent slopes
Ia	D	Irwin silty clay loam, 1 to 3 percent slopes
Ib	D	Irwin silty clay loam, 3 to 6 percent slopes
Ic	D	Irwin silty clay loam, 2 to 6 percent slopes, eroded
La	C	Lesho loam
Lb	A	Lincoln soils
Ma	B	Milan loam, 1 to 3 percent slopes
Mb	B	Milan form, 3 to 6 percent slopes
Mc	B	Milan clay loam, 2 to 6 percent slopes, eroded
Na	B	Naron fine sandy loam
Oc	D	Owens clay loam, 1 to 3 percent slopes
Od	D	Owens-Rock outcrop complex, 3 to 10 percent slopes
Pa		Pits
Pb	D	Plevna fine sandy loam
Pc	A	Pratt loamy fine sand, undulating
Pd	A	Pratt-Tivoli complex, rolling
Ra	D	Renfrow silty clay loam, 1 to 3 percent slopes
Rb	D	Renfrow silty clay loam, 3 to 6 percent slopes
Rc	D	Renfrow-Owens clay loams, 1 to 4 percent slopes
Rd	D	Rosehill silty clay, 1 to 3 percent slopes
Sa	B	Shellabarger sandy loam, 1 to 3 percent slopes
Sb	B	Shellabarger sandy loam, 3 to 6 percent slopes
Sc	B	Shellabarger sandy loam, 3 to 6 percent slopes, eroded
Ta	D	Tabler silty clay loam
Tb	D	Tabler-Drummond complex
Ua	B	Urban land-Canadian complex
Ub	B	Urban land-Elandco complex
Uc	B	Urban land-Farnum complex, 0 to 3 percent slopes
Ud	D	Urban land-Irwin complex, 1 to 3 percent slopes
Ue	D	Urban land-Tabler complex
Va	B	Vanoss silt loam, 0 to 1 percent slopes
Vb	B	Vanoss silt loam, 1 to 3 percent slopes
Vc	B	Vanoss silt loam, 3 to 6 percent slopes
Vd	B	Vanoss silt loam, 3 to 6 percent slopes, eroded
Ve	D	Vernon sandy loam, 1 to 3 percent slopes
Vf	D	Vernon sandy loam, 3 to 6 percent slopes
Wa	C	Waldeck sandy loam

## ATTACHMENT D

## DRAINAGE CRITERIA

## CITY OF WICHITA, KANSAS

RECOMMENDED RUNOFF COEFFICIENTS FOR RATIONAL METHOD  
AND PERCENT IMPERVIOUS FOR UNIT HYDROGRAPH METHOD

Land Use or Surface Characteristics	Percent Impervious	Frequency			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
1. Business:					
Downtown Areas	95	0.84	0.85	0.87	0.91
Neighborhood Areas	70	0.68	0.69	0.73	0.80
2. Residential:					
Single Family (Soil Group D)					
1/8 Acre	50	0.57	0.61	0.66	0.79
1/4 Acre	38	0.50	0.54	0.62	0.76
1/3 Acre	30	0.46	0.50	0.59	0.73
1/2 Acre	25	0.42	0.48	0.56	0.72
3/4 Acre	22	0.42	0.46	0.55	0.71
1 Acre	20	0.41	0.45	0.54	0.71
Multi-Family (Soil Group D)					
Multi-Unit (detached)	60	0.62	0.66	0.72	0.82
Multi-Unit (attached)	65	0.64	0.68	0.73	0.83
Apartments	75	0.70	0.73	0.79	0.86
Single Family (Soil Group C)					
1/8 Acre	50	0.55	0.58	0.64	0.73
1/4 Acre	38	0.48	0.51	0.57	0.68
1/3 Acre	30	0.43	0.46	0.53	0.65
1/2 Acre	25	0.40	0.43	0.50	0.63
3/4 Acre	22	0.39	0.42	0.49	0.62
1 Acre	20	0.37	0.40	0.48	0.61
Multi-Family (Soil Group C)					
Multi-Unit (detached)	60	0.60	0.63	0.69	0.77
Multi-Unit (attached)	65	0.63	0.66	0.71	0.79
Apartments	75	0.68	0.72	0.77	0.83
Single-Family (Soil Group B)					
1/8 Acre	50	0.52	0.54	0.59	0.67
1/4 Acre	38	0.44	0.46	0.52	0.61
1/3 Acre	30	0.39	0.41	0.47	0.57
1/2 Acre	25	0.36	0.38	0.44	0.54
3/4 Acre	22	0.34	0.36	0.42	0.52
1 Acre	20	0.33	0.35	0.40	0.51
Multi-Family (Soil Group B)					
Multi-Unit (detached)	60	0.58	0.60	0.65	0.72
Multi-Unit (attached)	65	0.61	0.64	0.68	0.75
Apartments	75	0.67	0.70	0.74	0.80

Land Use or Surface Characteristics	Percent Impervious	Frequency			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
<u>Single Family (Soil Group A)</u>					
1/8 Acre	50	0.47	0.50	0.54	0.60
1/4 Acre	38	0.39	0.41	0.45	0.52
1/3 Acre	30	0.33	0.35	0.39	0.47
1/2 Acre	25	0.30	0.31	0.35	0.44
3/4 Acre	22	0.28	0.29	0.33	0.42
1 Acre	20	0.26	0.28	0.32	0.40
<u>Multi-Family (Soil Group A)</u>					
Multi-Unit (detached)	60	0.55	0.57	0.61	0.67
Multi-Unit (attached)	65	0.58	0.60	0.64	0.70
Apartments	75	0.65	0.68	0.72	0.77
3. Industrial:					
Light Areas	70	0.68	0.69	0.73	0.80
Heavy Areas	80	0.74	0.76	0.79	0.84
4. Playgrounds:					
	15	0.33	0.35	0.42	0.55
5. Schools:					
	40	0.49	0.51	0.56	0.66
6. Railroad Yard Areas:					
	30	0.43	0.45	0.50	0.62
7. Undeveloped Urban Areas: Offsite Flow Analysis (when land use not defined)					
	45	0.52	0.54	0.59	0.68
8. Streets:					
Paved	99	0.87	0.88	0.90	0.93
Gravel	00	0.24	0.26	0.33	0.48
9. Drive, Parking Lots and Walks:					
	96	0.87	0.87	0.88	0.89
10. Roofs:					
	90	0.80	0.85	0.90	0.93
11. Urban Lawn Areas (See Note No. 1 below):					
<u>Soil Group A</u>					
Slope less than 1%	00	0.08	0.09	0.13	0.23
Slope 1% to 4%	00	0.12	0.13	0.17	0.27
Slope more than 4%	00	0.16	0.17	0.21	0.31
<u>Soil Group B</u>					
Slope less than 1%	00	0.16	0.18	0.24	0.37
Slope 1% to 4%	00	0.20	0.22	0.28	0.41
Slope more than 4%	00	0.24	0.26	0.32	0.45
<u>Soil Group C</u>					
Slope less than 1%	00	0.24	0.27	0.35	0.51
Slope 1% to 4%	00	0.26	0.29	0.37	0.53
Slope more than 4%	00	0.28	0.31	0.39	0.55

Land Use or Surface Characteristics	Percent Impervious	Frequency			
		<u>2</u>	<u>5</u>	<u>10</u>	<u>100</u>
<u>Soil Group D</u>					
Slope less than 1%	00	0.28	0.33	0.43	0.63
Slope 1% to 4%	00	0.30	0.35	0.45	0.65
Slope more than 4%	00	0.32	0.37	0.47	0.67

Note No. 1: Coefficients shown in the above table are for pervious open space areas with thick turf which includes pervious areas in parks and cemeteries. Coefficients shown above must be increased 0.02 for use with agricultural pasture areas. Coefficients shown above must be reduced by 0.04 for use with agricultural cultivated areas. Group A soils are well-drained, coarse textured sands with high infiltration rates. Group B soils are moderately well-drained, moderately coarse textured soils with moderate infiltration rates. Group C soils are moderately poor-drained, moderately fine textured soils with slow infiltration rates. Group D soils are poor-drained, fine textured soils with very slow infiltration rates.

GENERAL NOTE: These Rational Formula Coefficients may not be valid for basins 320 acres or larger.

ATTACHMENT A  
DRAINAGE CRITERIA MANUAL

## CITY OF WICHITA, KANSAS

## RAINFALL INTENSITY TABLE FOR SEDGWICK COUNTY, KANSAS

The following tabulation contains rainfall intensity in inches per hour as derived from ESSA Weather Bureau Technical Paper 40 Modified to NWS Hydro-35, 1977 During First Hour

DURATION IN MINUTES	RETURN PERIODS OF						
	1-YR	2-YR	5-YR	10-YR	25-YR	50-YR	100-YR
5	4.18	5.57	6.53	7.41	8.52	9.48	10.32
6	3.99	5.32	6.25	7.09	8.16	9.09	9.89
7	3.81	5.09	5.99	6.81	7.84	8.74	9.50
8	3.66	4.89	5.75	6.55	7.55	8.42	9.15
9	3.52	4.70	5.54	6.31	7.28	8.13	8.83
10	3.39	4.52	5.34	6.09	7.04	7.86	8.54
11	3.27	4.36	5.16	5.89	6.81	7.61	8.27
12	3.18	4.21	4.99	5.71	6.60	7.38	8.02
13	3.05	4.08	4.84	5.53	6.41	7.17	7.79
14	2.96	3.95	4.69	5.37	6.23	6.97	7.57
15	2.87	3.83	4.56	5.22	6.06	6.78	7.37
16	2.78	3.72	4.43	5.08	5.90	6.60	7.18
17	2.71	3.61	4.31	4.95	5.75	6.44	7.00
18	2.63	3.51	4.20	4.83	5.61	6.29	6.84
19	2.56	3.42	4.10	4.71	5.47	6.14	6.68
20	2.50	3.33	4.00	4.60	5.35	6.00	6.53
21	2.44	3.25	3.90	4.50	5.23	5.87	6.39
22	2.38	3.17	3.81	4.40	5.12	5.75	6.26
23	2.32	3.10	3.73	4.31	5.01	5.63	6.13
24	2.27	3.03	3.65	4.22	4.91	5.52	6.01
25	2.22	2.96	3.57	4.13	4.81	5.41	5.90
26	2.20	2.90	3.50	4.05	4.72	5.31	5.79
27	2.16	2.84	3.43	3.98	4.63	5.21	5.69
28	2.14	2.78	3.37	3.90	4.55	5.12	5.59
29	2.11	2.72	3.30	3.83	4.47	5.03	5.49
30	2.08	2.67	3.24	3.76	4.39	4.94	5.40
31	2.05	2.62	3.19	3.70	4.32	4.86	5.32
32	2.02	2.57	3.10	3.63	4.25	4.79	5.22
33	1.99	2.52	3.05	3.57	4.18	4.71	5.14
34	1.96	2.48	3.01	3.51	4.11	4.63	5.07
35	1.93	2.44	2.98	3.46	4.05	4.56	5.00
36	1.91	2.39	2.93	3.41	3.99	4.50	4.93
37	1.89	2.35	2.88	3.36	3.93	4.43	4.86
38	1.87	2.32	2.84	3.31	3.87	4.37	4.79
39	1.85	2.28	2.80	3.26	3.82	4.31	4.73
40	1.83	2.24	2.76	3.22	3.76	4.25	4.66
41	1.81	2.21	2.72	3.17	3.71	4.19	4.60
42	1.79	2.18	2.68	3.13	3.66	4.13	4.54
43	1.77	2.14	2.64	3.09	3.61	4.08	4.49
44	1.75	2.11	2.61	3.05	3.57	4.03	4.43
45	1.73	2.08	2.57	3.01	3.52	3.98	4.38

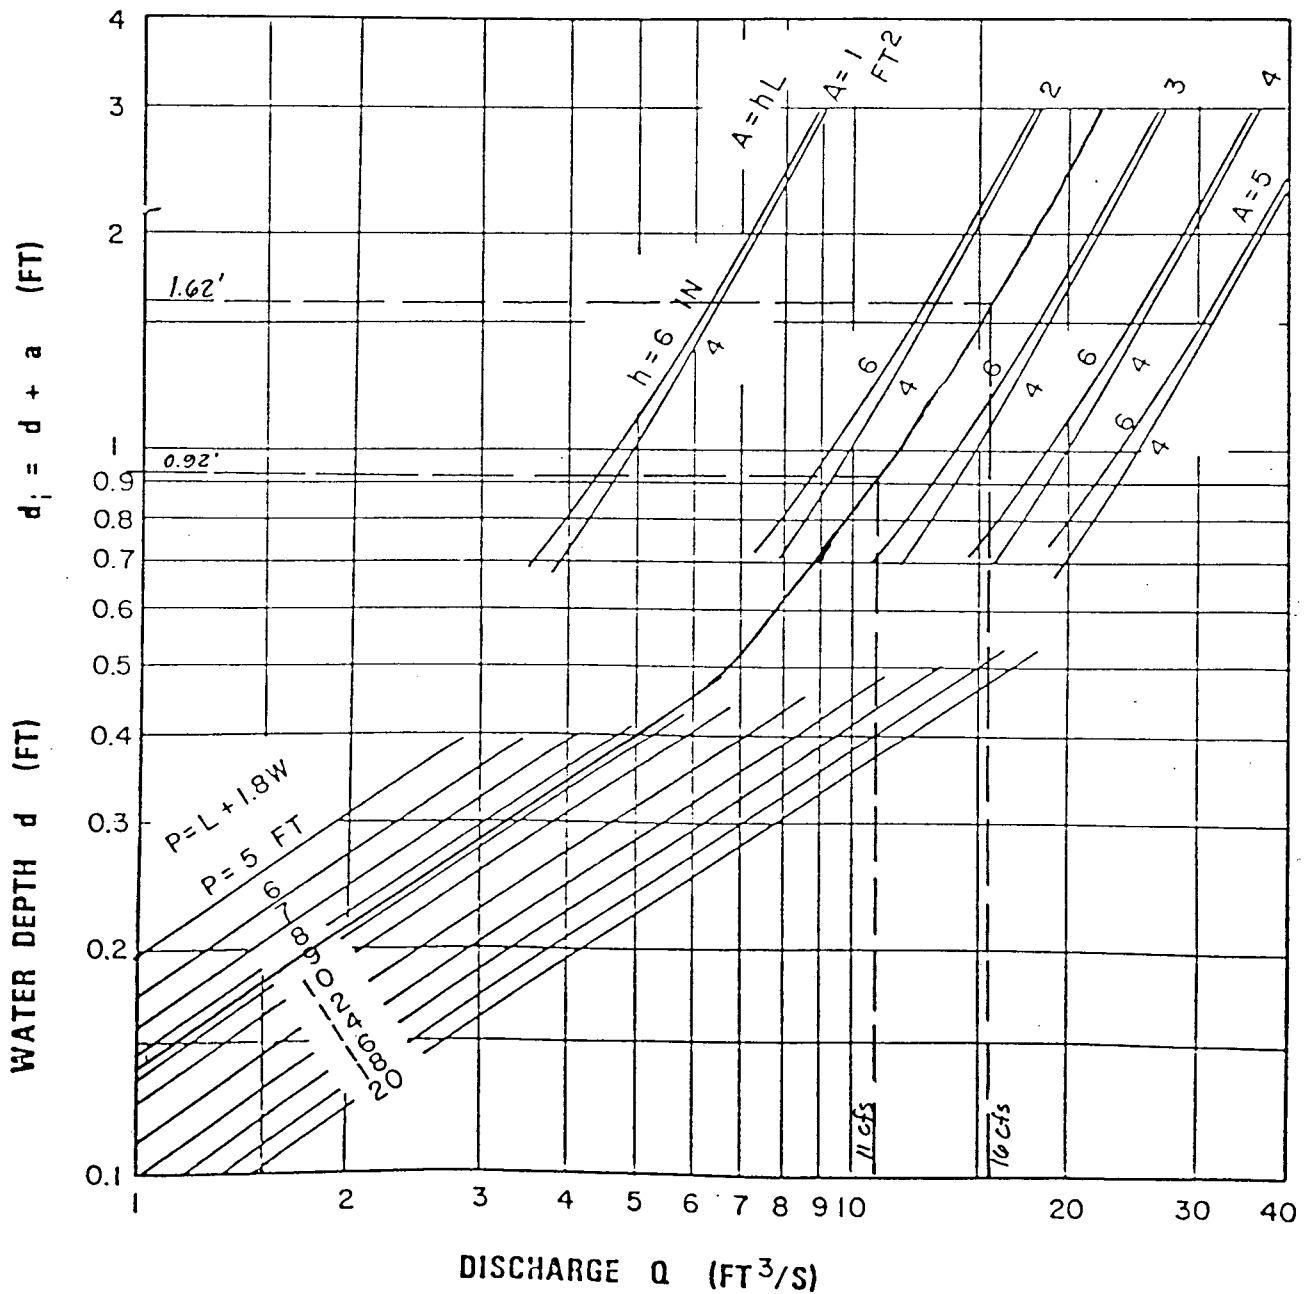
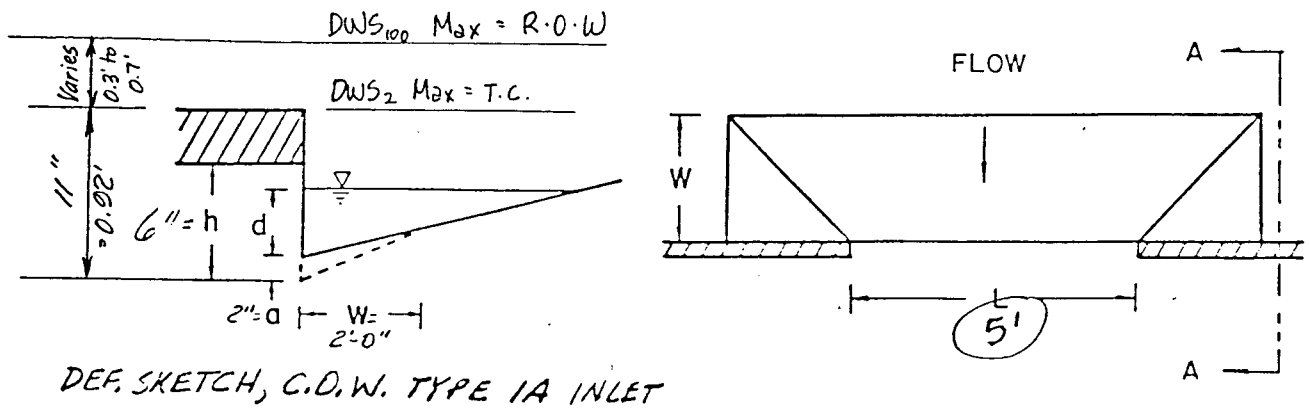


CHART 12. Depressed curb-opening inlet capacity in sump locations.

FROM: HEC-12, DRAINAGE OF HIGHWAY PAVEMENTS, FHWA, MAR., 1974


Cross-Slope =  $3/8$ "/ft =  $0.03125$  ft/ft


$Z = 1/\text{cross-slope} = 1/0.03125 = 32$

$n = 0.016$

$Z/n = 32/0.016 = 2000$

STERLING FARMS

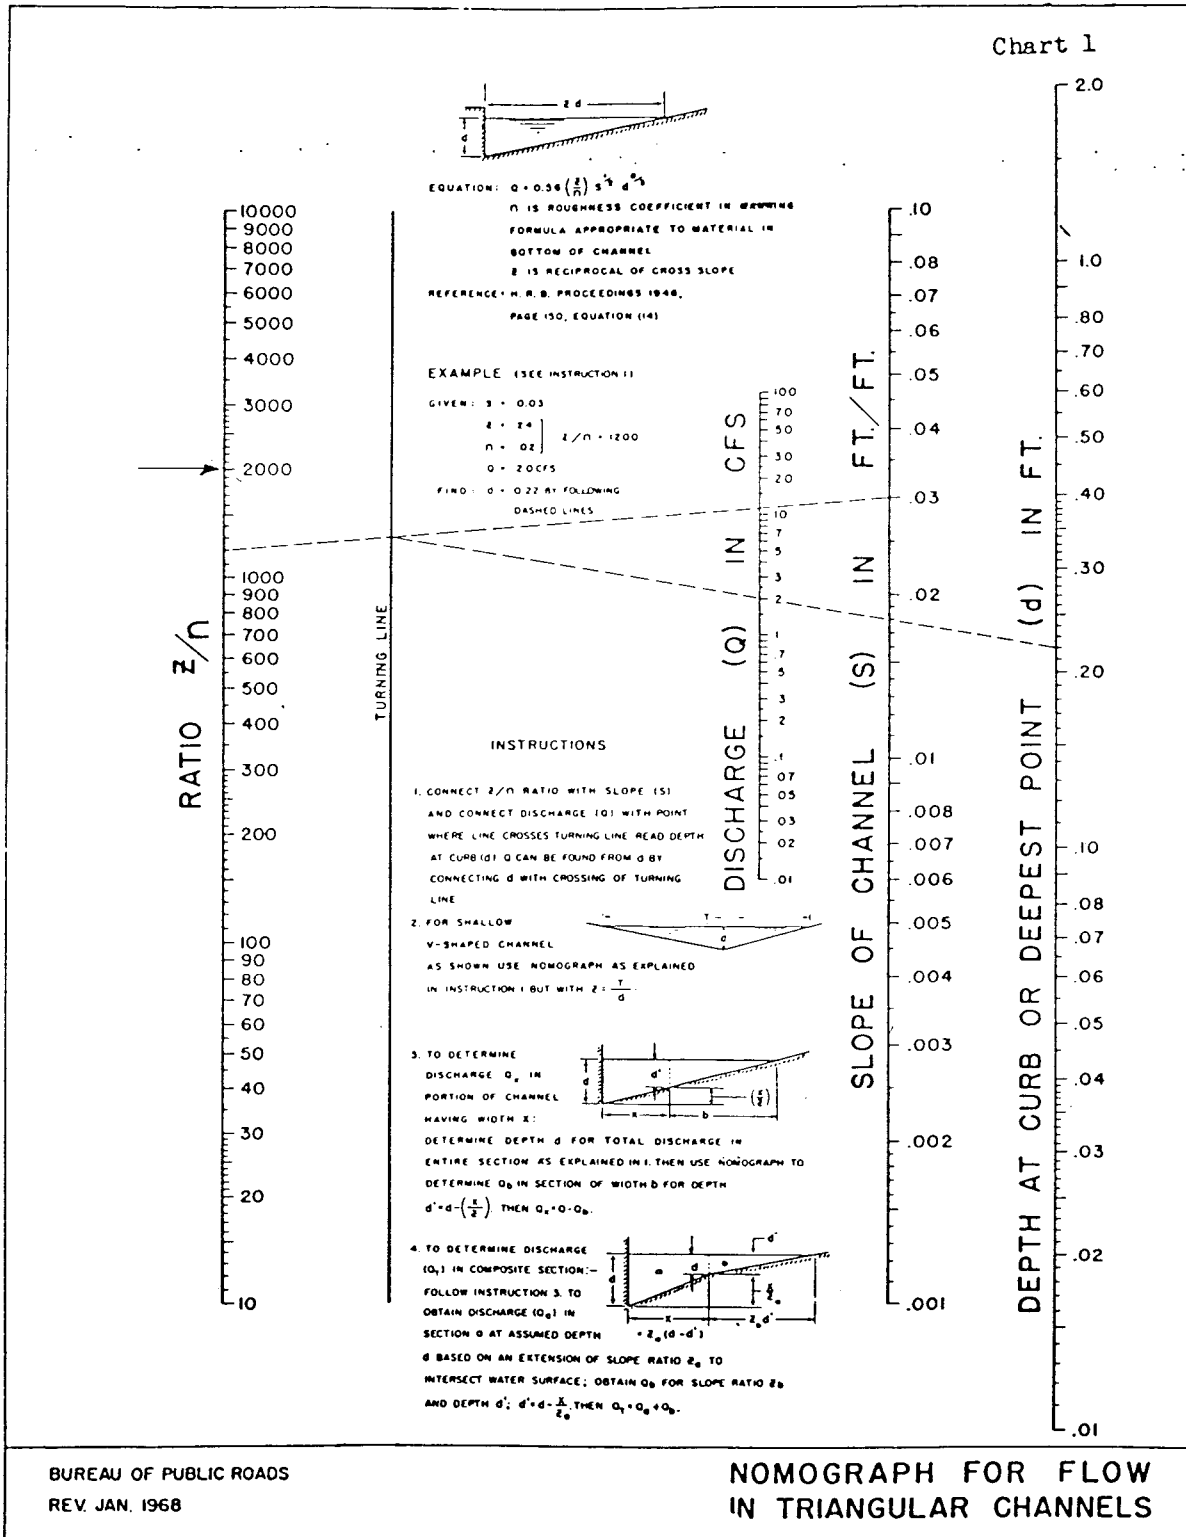




Date Oct. 25, 1988 Page \_\_\_\_\_ of \_\_\_\_\_

Project Sterling Farms

Item Drainage Plan

Determine capacities of Roll-curb streets w/  
Various Walk Grades for 100-year storm analysis  
(58' R-O-W)

0.3'  
Walk Grade

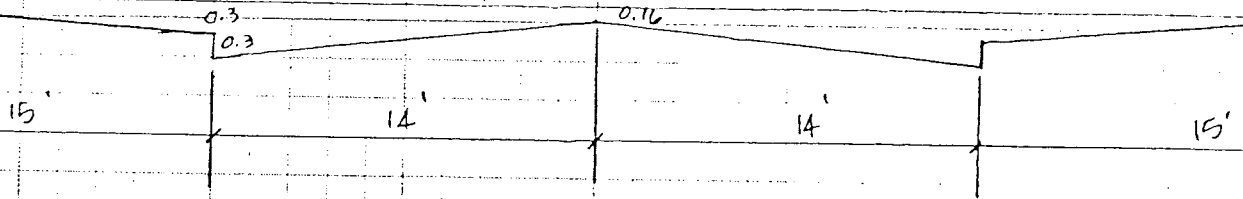

$$p = \frac{(2 \times 14.5 \times 0.03) + (2 \times 2.8 \times 0.013) + (2 \times 12 \times 0.016)}{58.6}$$

$$= \frac{(0.87) + (0.0728) + (0.384)}{58.6} = \frac{1.3268}{58.6} = 0.0226$$

$$A = (2 \times \frac{1}{2} \times 15 \times 0.3) + (28 \times 0.16) + (2 \times \frac{1}{2} \times 14 \times 0.44)$$

$$= 4.5 + 4.48 + 6.16$$

$$= 15.14 \text{ SF}$$

$$p = 58.6$$

$$R = A/p = 15.14/58.6 = 0.258362$$

$$R^{2/3} = 0.40565$$

$$Q = \frac{1.486}{n} A R^{2/3} s^{1/2}$$



$$= \frac{1.486}{0.0226} \times 15.14 \times 0.40565 \times s^{1/2}$$

$$Q = 403.82 \sqrt{s}$$

# DRAINAGE PLAN 4-12-93

## STERLING FARMS 3RD. ADDITION

### WICHITA SEDGWICK COUNTY, KANSAS.

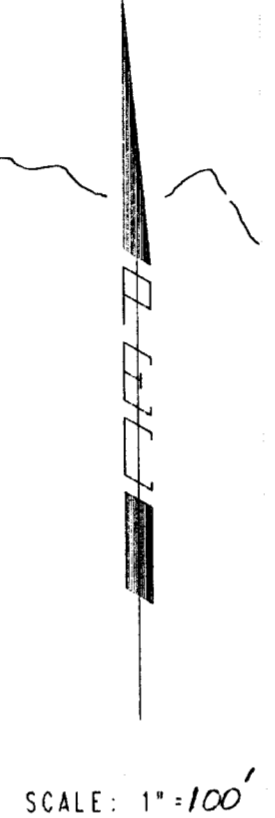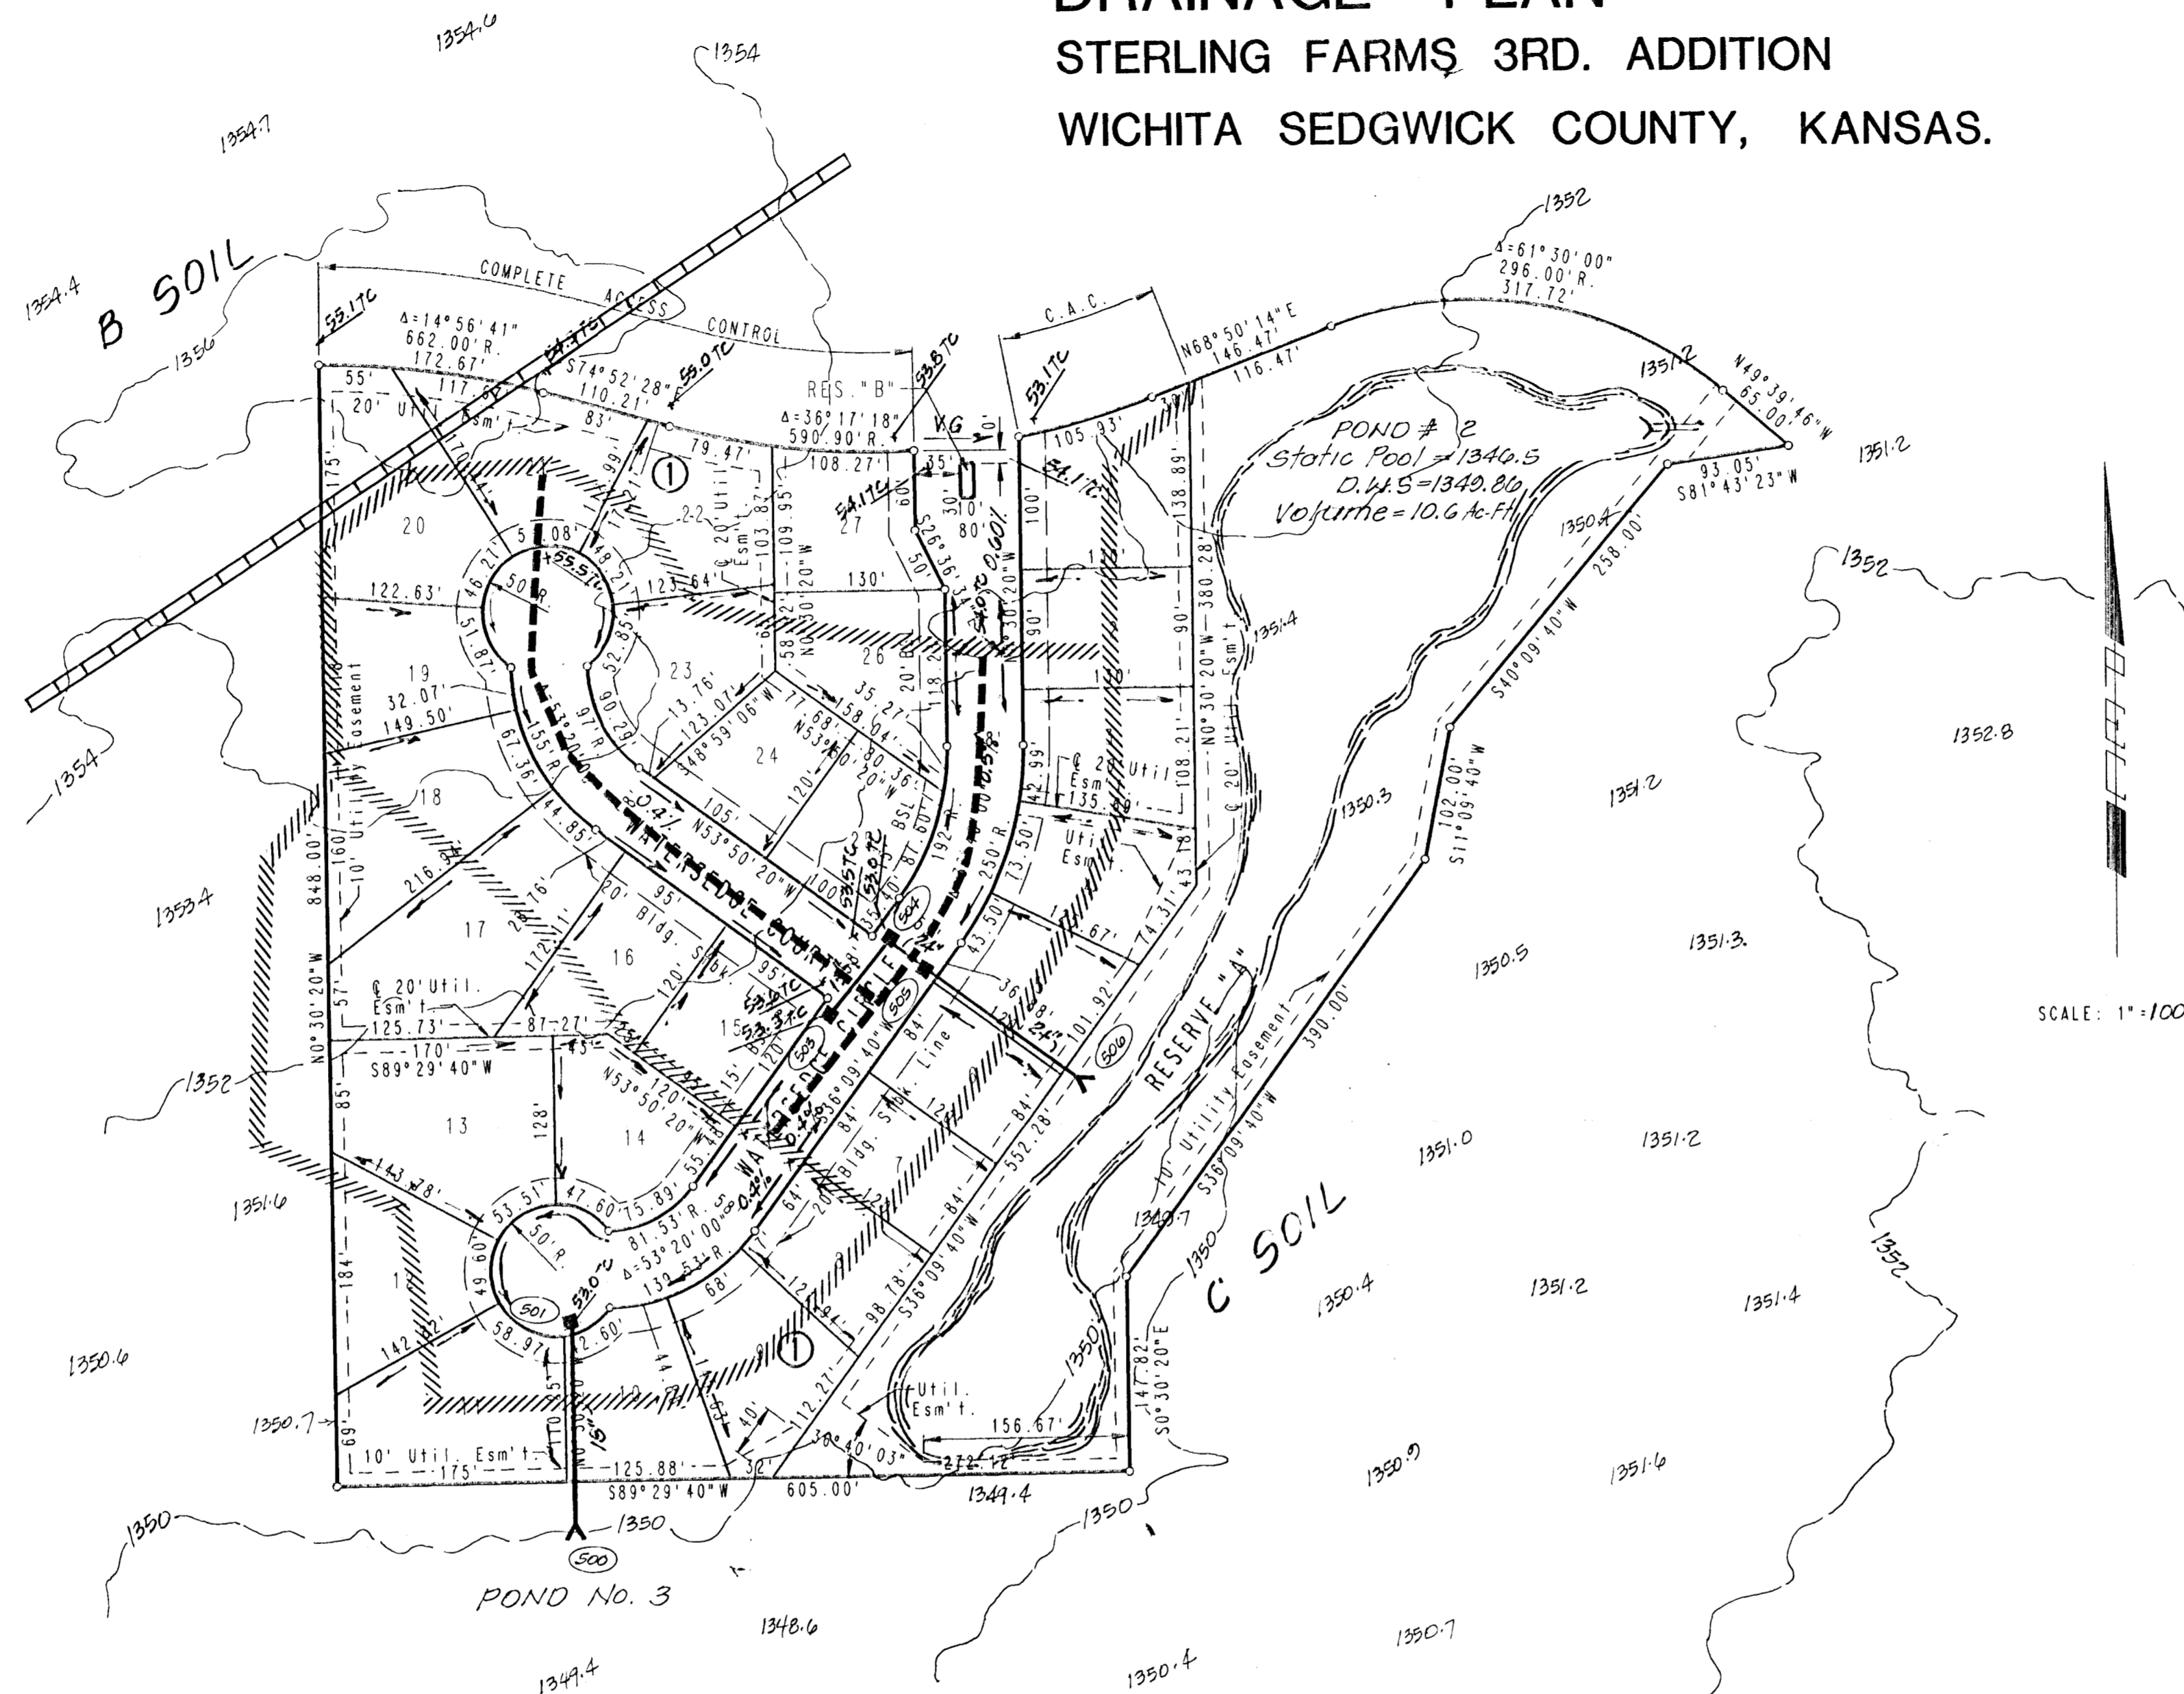

#### LEGEND

- Drainage Basin Boundary
- Drainage Sub-Basin Boundary
- Hydrologic Soil Group Boundary
- Storm Sewer Node No.
- 0.4% Minor Storm Flow & Street Grade
- Major Storm Flow
- Proposed SWS & Inlet
- Proposed SWS Manhole
- V.G. Valley Gutter
- 51.5 Top of Curb Elev. (Add 1300 for MSL)

B.M. - Standard City B.M. Disc 38 Ft. West & 30 Ft. South of E intersection of 21st St. N. & Tyler Rd. Elev.=1357.35 MSL  
169.95 City

B.M. - "T" Post located 26 Ft. South of Northeast Corner Lot 21, Block G, Sterling Farms Addition. Elev.=1354.93 MSL  
167.59 City

Minimum Pad Elevation (Lowest opening) for Lots 1 through 11, Block 1, Shall be Elev. 1351 m.s.l. = 163.6 City Datum.

