


DRAINAGE PLAN
AND
SUPPORTING CALCULATIONS



PROFESSIONAL
ENGINEERING
CONSULTANTS
PROFESSIONAL ASSOCIATION

FOR
WOODBIDGE 3RD ADDITION
WICHITA, SEDGWICK COUNTY, KANSAS

PREPARED BY
PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
ENGINEERS
1440 E. ENGLISH
WICHITA, KANSAS

FEBRUARY 26, 1986

Input File: wdbr100

woodbridge 3rd addition
storm sewer system no 100

Storm Frequency = 2-Year

* * * H Y D R O L O G Y * * *

```

*****
Node to C      Tributary Area      Hydrology Summation      Conduit Data
Node          (Ac)      Slope      Length TC(0) I(0) Q(0) TC      I      Q      Sum Q      Size      Velocity Length TT TT+TC
(Ft)          (%)      (In/Hr) (CFS) (Min) (In/Hr) (CFS) (Min) (In/Hr) (CFS) (Min) (Ft) (Min) (Min)
*****
107 105 0.70 4.80 0.00 0.0 15.00 4.06 13.64 15.00 4.06 13.64 13.64 24" 4.34 460.00 1.77 16.77
106 105 0.40 1.70 0.00 0.0 15.00 4.06 2.76 15.00 4.06 2.76 2.76 15" 2.25 30.00 0.22 15.22
105 104 0.40 5.20 0.00 0.0 15.00 4.06 8.44 16.77 3.89 8.08 24.38 30" 4.97 60.00 0.20 16.97
104 103 0.40 0.40 0.00 0.0 15.00 4.06 0.65 16.97 3.87 0.62 25.00 30" 5.09 120.00 0.39 17.36
103 102 0.00 0.00 0.00 0.0 0.00 0.00 0.00 17.36 3.83 0.00 25.00 30" 5.09 350.00 1.15 18.51
102 101 0.40 1.90 0.00 0.0 15.00 4.06 3.08 18.51 3.74 2.84 27.84 36" 3.94 170.00 0.72 19.23
101 100 0.00 0.00 0.00 0.0 0.00 0.00 0.00 19.23 3.68 0.00 27.84 36" 3.94 65.00 0.28 19.50
*****

```

Input File: wdbr100

woodbridge 3rd addition
storm sewer system no 100

Storm Frequency = 2-Year

* * * HYDRAULICS * * *

```

*****
Node   Hyd-Slope (Ft/Ft)   Friction (Ft)   Bend (Ft)   Transition (Ft)   Manhole (Ft)   Deflection (Ft)   Junction (Ft)   Total (Ft)   Hyd-GI   Elevation   Desired   Diff.
*****
107    0.00363    1.6717    0.0000    0.0000    0.0000    0.0000    0.0000    1.6717    160.5783    165.5000    4.92
106    0.00183    0.0548    0.0000    0.0000    0.0000    0.0000    0.0000    0.0548    158.9614    159.8000    0.84
105    0.00353    0.2120    0.0000    0.0090    0.0000    0.0553    0.5202    0.7965    158.9067    159.8000    0.89
104    0.00371    0.4457    0.0000    0.0020    0.0000    0.1177    0.0576    0.6230    158.1102    160.0000    1.89
103    0.00371    1.3000    0.0000    0.0000    0.0201    0.1880    0.0186    1.5268    157.4872    160.9000    3.41
102    0.00174    0.2962    0.0000    0.0324    0.0000    0.0063    -0.0780    0.2568    155.9604    159.4000    3.44
101    0.00174    0.1132    0.0000    0.0000    0.0120    0.0696    0.0087    0.2036    155.7036    159.6000    3.90
100    0.00000    0.0000    0.0000    0.0000    0.0000    0.0000    0.0000    0.0000    155.5000    155.5000    0.00
*****

```

Input File: udbri100

woodbridge 3rd addition
storm sewer system no.100

Storm Frequency = 100-Year

* * * HYDROLOGY * * *

Tributary Area		Hydrology Summation				Conduit Data												
Node	C	Area (Ac)	Slope (%)	Length (Ft)	TC(0)	I(0)	Q(0)	TC (Min)	In(Hr)	CFS	I	Q	Sum Q	Size	Velocity (Ft/Sec)	Length (Ft)	TT (Min)	TT+TC
107	105	0.70	4.80	0.00	0.0	15.00	8.97	30.15	8.97	30.15	30.15	6.10	6.10	24"	9.60	460.00	0.80	15.80
106	105	0.40	1.70	0.00	0.0	15.00	8.97	6.10	8.97	6.10	6.10	6.10	6.10	15"	4.97	30.00	0.10	15.10
105	104	0.40	5.20	0.00	0.0	15.00	8.97	18.66	15.80	18.29	54.44	18.29	54.44	30"	11.09	60.00	0.09	15.89
104	103	0.40	0.40	0.00	0.0	15.00	8.97	1.44	15.89	8.77	1.40	55.84	55.84	30"	11.38	120.00	0.18	16.06
103	102	0.00	0.00	0.00	0.0	0.00	0.00	0.00	16.06	8.74	0.00	55.84	55.84	30"	11.38	350.00	0.51	16.58
102	101	0.40	1.90	0.00	0.0	15.00	8.97	6.82	16.58	8.63	6.56	62.40	62.40	36"	8.83	170.00	0.32	16.90
101	100	0.00	0.00	0.00	0.0	0.00	0.00	0.00	16.90	8.57	0.00	62.40	62.40	36"	8.83	65.00	0.12	17.02



Date 2-25-86 Page 1 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan

Check Inlet Sizes:

<u>Nbde</u>	<u>Q₂</u>	<u>Inlet Condition</u>	<u>Size</u>
107	13.6	Sump	2'x4' Drop Inlet
106	2.8	Sump	1 @ 5'
105	8.4	Sump	1 @ 5'
104	0.7	Sump	1 @ 5'
103	-	(Manhole)	-
102	3.1	Sump.	1 @ 5'
101	-	(Manhole)	-
100	-	(End Section)	-

Using Chart 12 Attached, Allowable $d = \frac{0.17'}{0.55'} = 0.31'$ (2" dep.)
 $\frac{0.72'}{0.55'}$ (1E to T.C.)

USE 1 C.O.W Std Type 1A Curb Inlet (L=5')
 @ Nodes 106, 105, 104, 102

Node 107 $Q_2 = 13.6$


USE ORIFICE EQ'N $Q = CA\sqrt{2gh}$ where

$$13.6 = 0.6 \times A \sqrt{64.4}$$

$$A = 2.8 \text{ SF.}$$

where
 $Q = 13.6$
 $C = 0.6$
 $A = \text{Unknown}$
 $g = 32.2 \text{ ft/sec}^2$
 $h = 1.0'$

USE 1 C.O.W 2'x4' Drop Inlet

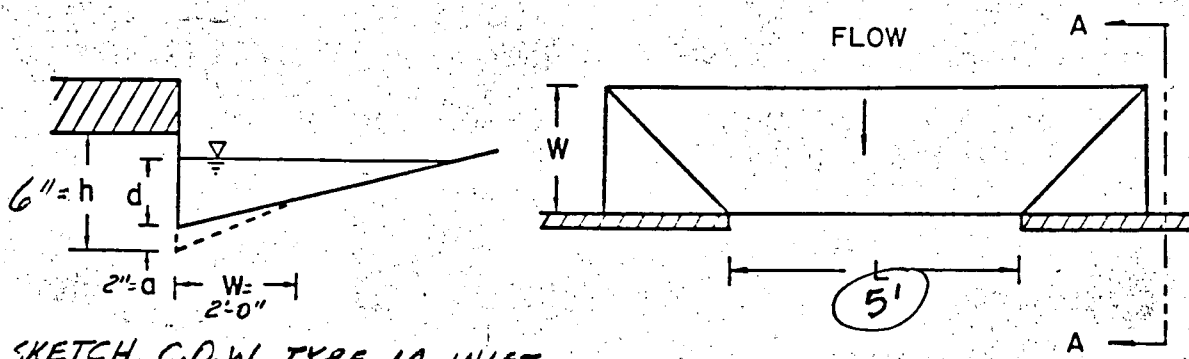

DEF. SKETCH, C.D.W. TYPE 1A INLET

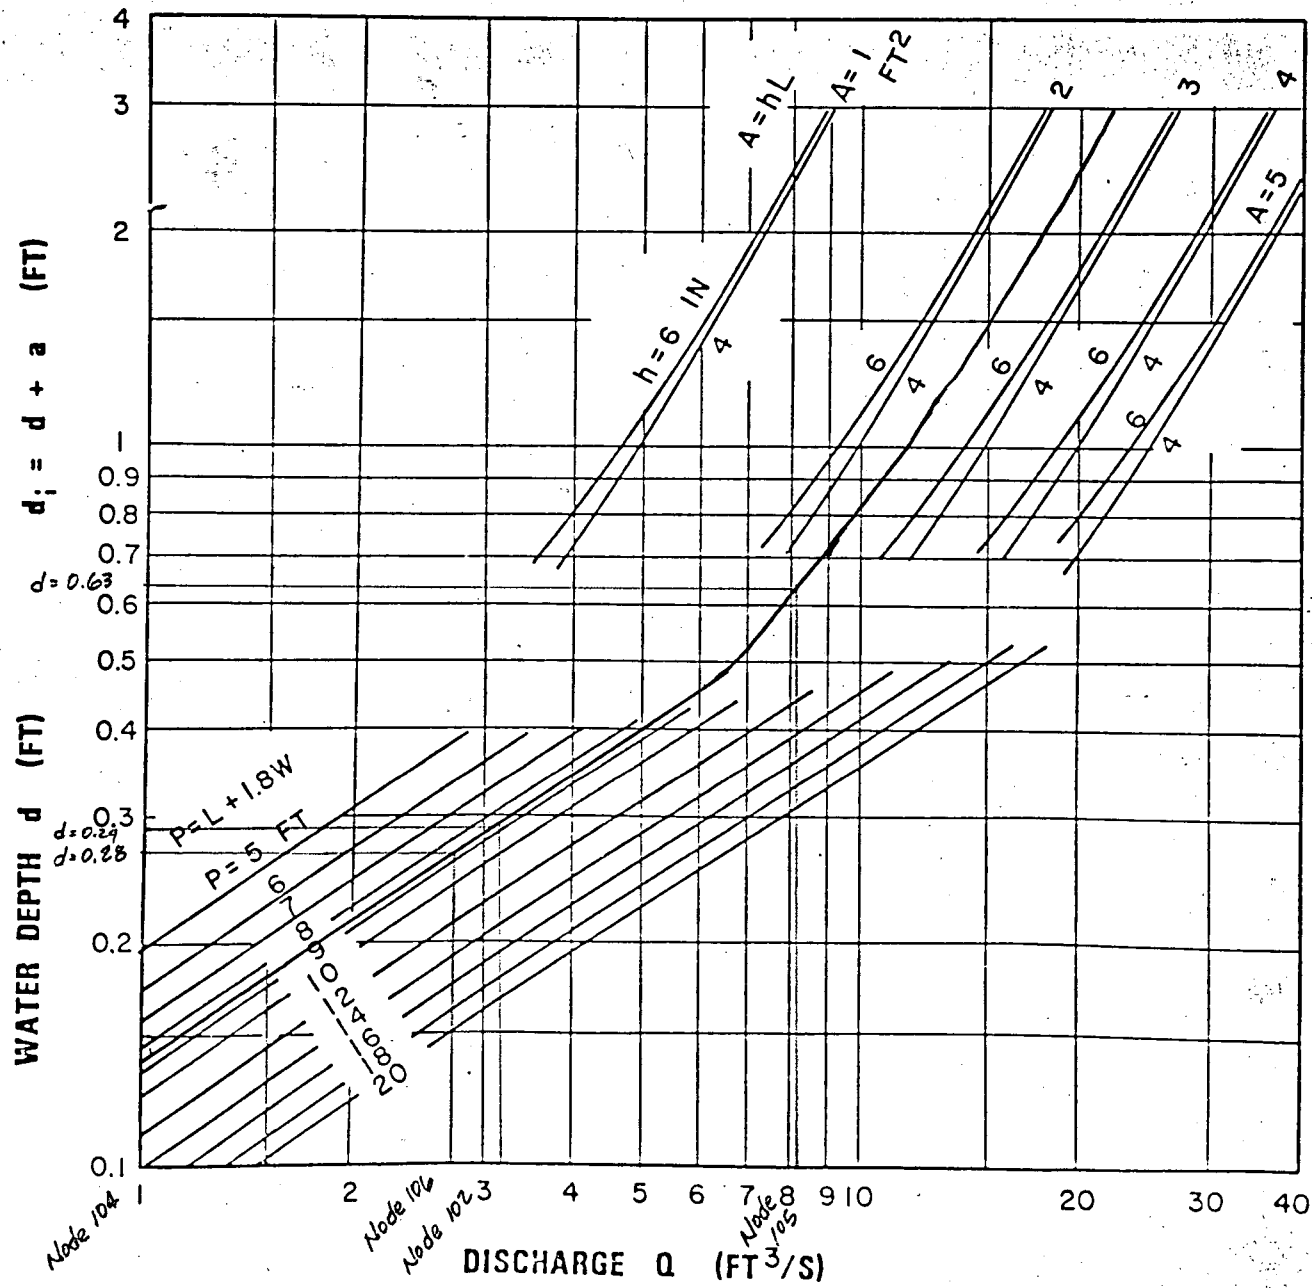


CHART 12. Depressed curb-opening inlet capacity in sump locations.

FROM: HEC-12, DRAINAGE OF HIGHWAY PAVEMENTS, FHWA, MAR, 1974



Date 2-25-86 Page 3 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan.

Check Street Flow - 2-Yr.

<u>Node</u>	<u>Q₂</u>	<u>Distribution</u>	<u>s</u>	<u>d.</u>	<u>dallow</u>
107		N/A (Not in street)			
106	2.8	20% in Parkridge = 0.6cfs @ 0.32% 80% in " Ct. = 2.2cfs @ 1.1%	0.18'	0.55'	OK
105	0.4	33% in Parkridge Ct = 2.8 @ 1.1% 67% in Parkridge = 5.6 @ 0.32%	0.24'	0.55'	OK
104	0.7	50% (N) = 0.35cfs @ 0.32% 50% (S) = 0.35cfs @ 0.32%	0.14'	0.55'	OK
102	3.1	50% (N) = 1.55cfs @ 0.32% 50% (S) = 1.55cfs @ 0.32%	0.26'	0.3'	OK



Date 2-25-86 Page 4 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan

Check Street Flow

$$Q_{\text{street}} = Q_{100} - Q_2 = 62.4 \text{ cfs} - 27.8 \text{ cfs} \quad (\text{from comp. readouts})$$
$$= 34.6 \text{ cfs}$$

$$Q_{\text{allow}} (@ 0.32\%) = 670.66 \sqrt{s}$$

(See Sheet 6)


$$Q_{\text{allow}} = 670.66 \sqrt{0.0032}$$
$$= 37.93 \quad \underline{\underline{OK}}$$

$z = \frac{1}{3/8 \text{ "/ft}} = 32$

$n = 0.016$

$z/n = 32/0.016 = 2000$

Chart 1



EQUATION: $Q = 0.56 \left(\frac{z}{n}\right) S^{1/2} d^{3/2}$

n IS ROUGHNESS COEFFICIENT IN GAUGING FORMULA APPROPRIATE TO MATERIAL IN BOTTOM OF CHANNEL


z IS RECIPROCAL OF CROSS SLOPE

REFERENCE: H. R. B. PROCEEDINGS 1946, PAGE 150, EQUATION (14)


EXAMPLE (SEE INSTRUCTION 1)

GIVEN: $S = 0.03$
 $z = 24$
 $n = .02$
 $Q = 20 \text{ CFS}$

FIND: $d = 0.22$ BY FOLLOWING DASHED LINES

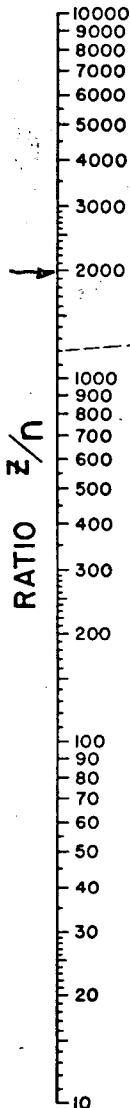

TURNING LINE



INSTRUCTIONS

1. CONNECT z/n RATIO WITH SLOPE (S) AND CONNECT DISCHARGE (Q) WITH POINT WHERE LINE CROSSES TURNING LINE READ DEPTH AT CURB (d). Q CAN BE FOUND FROM d BY CONNECTING d WITH CROSSING OF TURNING LINE.

2. FOR SHALLOW V-SHAPED CHANNEL AS SHOWN USE NOMOGRAPH AS EXPLAINED IN INSTRUCTION 1 BUT WITH $z = \frac{T}{d}$.




3. TO DETERMINE DISCHARGE Q_x IN PORTION OF CHANNEL HAVING WIDTH x :



DETERMINE DEPTH d FOR TOTAL DISCHARGE IN ENTIRE SECTION AS EXPLAINED IN 1. THEN USE NOMOGRAPH TO DETERMINE Q_b IN SECTION OF WIDTH b FOR DEPTH $d' = d - (\frac{x}{z})$ THEN $Q_x = Q - Q_b$.

4. TO DETERMINE DISCHARGE (Q_c) IN COMPOSITE SECTION:-



FOLLOW INSTRUCTION 3. TO OBTAIN DISCHARGE (Q_a) IN SECTION a AT ASSUMED DEPTH d BASED ON AN EXTENSION OF SLOPE RATIO z_1 TO INTERSECT WATER SURFACE; OBTAIN Q_b FOR SLOPE RATIO z_2 AND DEPTH d' ; $d' = d - \frac{x}{z_2}$ THEN $Q_c = Q_a + Q_b$.



Date 5/30/85 MWB Page 6 of 6

Project Woodbridge 3rd Add.

Item STREET FLOW EQUATIONS

35' Bk-Bk STREET (1/2 STREET CAPACITY)

$$15' \times \frac{3}{8} \frac{1}{2} = 0.46875'$$

$$\# \text{ to } \# = 0.47 + 0.05 = 0.52$$

Curb deep flow is 0.03' above crown.

$$T = (\text{depth above } \#) / S_x$$

$$n = 0.016$$

$$S_x = \frac{3}{8} \text{ in / ft} = 0.03125 \text{ ft/ft}$$

$$B = T - 16.6' \quad (\text{Sec I Below})$$

I. At $d = 0.52'$ (Crown deep)

$$T = 0.52 / 0.03125 = 16.6'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(16.6)^{8/3} - 1^{8/3}]$$

$$= 194.58 \sqrt{S}$$

II At $d = 0.55'$ (Curb deep)

$$T = 17.6'$$

$$B = 1.0'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(17.6)^{8/3} - 1^{8/3}]$$

$$= 227.32 \sqrt{S}$$

III. At $d = 0.85'$ (T.C. + 0.302') (14'-6" Pkg.)
(1/4" Sl.)

$$d = 0.85$$

$$T = 27.26$$

$$B = 10.66$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(27.26)^{8/3} - (10.66)^{8/3}]$$

$$= 670.66 \sqrt{S}$$

IV At T.C. + 0.41' (14'-6" Pkg., 3/8" Sl.)

$$d = 0.96'$$

$$T = 30.72'$$

$$B = 14.12'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(30.72)^{8/3} - (14.12)^{8/3}]$$

$$= 878.09 \sqrt{S}$$

V At T.C. + 0.52' (14'-6" Pkg., 1/2" Sl.)

$$d = 1.07'$$

$$T = 34.24'$$

$$B = 17.64'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(34.24)^{8/3} - (17.64)^{8/3}]$$

$$= 1112.64 \sqrt{S}$$

VI At T.C. + 0.63' (14'-6" Pkg., 5/8" Sl.)

$$d = 1.18'$$

$$T = 37.76'$$

$$B = 21.16'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(37.76)^{8/3} - (21.16)^{8/3}]$$

$$Q = 1369.72 \sqrt{S}$$



Date 2-26-86 Page 1 of 1

Project Woodbridge 3rd Add'n

Item Drainage Plan

Node 107 to Cul-De-Sac.

$$Q_{100} = 30.2 \text{ cfs}$$

$$Q_2 = 13.6 \text{ cfs}$$


$$Q_{\text{overland}} = Q_{100} - Q_2 = 30.2 - 13.6 = 16.6 \text{ cfs}$$

USE MANNINGS EQ'N $Q = \frac{1.486}{n} AR^{2/3} s^{1/2}$ where $Q = 16.6$
 $n = 0.030$
 $s = 0.01''$

$$16.6 = \frac{1.486}{0.035} (AR^{2/3})(0.01)^{1/2}$$

$$16.6 = 49.53 (AR^{2/3}) 0.10$$

$$AR^{2/3} = 3.35$$

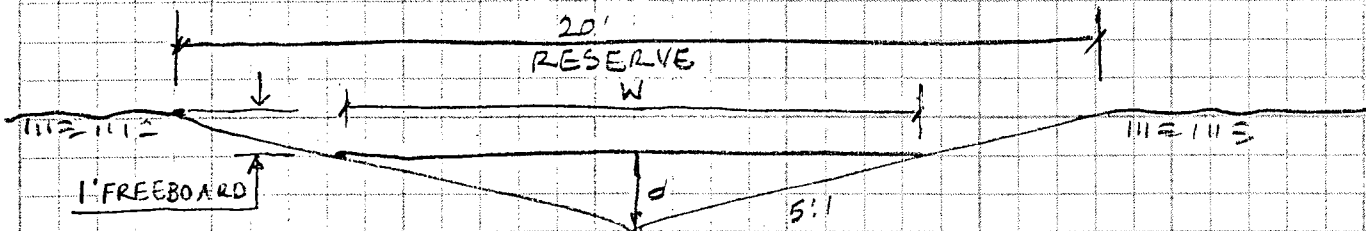

<u>d</u>	<u>A</u>	<u>P</u>	<u>R</u>	<u>R^{2/3}</u>	<u>AR^{2/3}</u>
1.0	5.0	10.20	0.49	0.62	3.10
1.1	6.05	11.22	0.54	0.66	4.00

USE $d = 1.0'$, $w = 10'$

$$V = Q/A = 16.6/5.0 = 3.3 \text{ fps} \quad \text{OK}$$

Input File: wdbr200

woodbridge 3rd addition
storm sewer system 200

Storm Frequency = 2-Year

* * * * * H Y D R O L O G Y * * * * *

Tributary Area		Hydrology				Summation			Conduit Data											
Node to	C	Area (Ac)	Slope (%)	Length (Ft)	TC (Min)	I (In/Hr)	TC (0)	I (0)	Q (0)	TC (Min)	I (In/Hr)	Q (CFS)	Sum Q	Size	Velocity (Ft/Sec)	Length (Ft)	TT (Min)	TT+TC (Min)		
210	208	0.40	1.80	0.00	0.0	15.00	4.06	2.92	2.92	2.92	4.06	15.00	4.06	2.92	2.92	15"	2.38	70.00	0.49	15.49
209	208	0.40	3.30	0.00	0.0	15.00	4.06	5.36	5.36	5.36	4.06	15.00	4.06	5.36	5.36	15"	4.37	70.00	0.27	15.27
208	206	0.40	3.30	0.00	0.0	15.00	4.06	5.36	13.54	13.54	4.01	5.29	13.54	24"	4.31	550.00	2.13	17.62		
207	206	0.40	1.80	0.00	0.0	15.00	4.06	2.92	2.92	2.92	4.06	15.00	4.06	2.92	2.92	15"	2.38	35.00	0.24	15.24
206	205	0.40	1.10	0.00	0.0	15.00	4.06	1.79	1.79	1.79	3.81	1.68	17.98	30"	3.66	43.00	0.20	17.81		
205	204	0.40	0.10	0.00	0.0	15.00	4.06	0.16	0.16	0.16	3.80	0.15	18.13	30"	3.69	110.00	0.50	18.31		
204	202	0.40	4.70	0.00	0.0	15.00	4.06	7.63	18.31	18.31	3.76	7.06	25.19	30"	5.13	75.00	0.24	18.55		
203	202	0.40	0.80	0.00	0.0	15.00	4.06	1.30	1.30	1.30	4.06	1.30	1.30	15"	1.06	35.00	0.55	15.55		
202	201	0.40	0.90	0.00	0.0	15.00	4.06	1.46	1.46	1.46	3.74	1.34	27.75	36"	3.93	340.00	1.44	20.00		
201	200	0.40	2.10	0.00	0.0	15.00	4.06	3.41	20.00	30.80	3.63	3.05	30.80	36"	4.36	155.00	0.59	20.59		

Input File: wdbr200

woodbridge 3rd addition
storm sewer system 200

Storm Frequency = 2-Year

* * * H Y D R A U L I C S * * *

Node	Hyd-Slope (Ft/Ft)	Friction (Ft)	Bend (Ft)	Transition (Ft)	Manhole (Ft)	Deflection (Ft)	Junction (Ft)	Total (Ft)	Hyd-GI Elevation	Desired Elevation	Diff.
210	0.00205	0.1433	0.0000	0.0000	0.0000	0.0000	0.0000	0.1433	160.4338	166.5000	6.07
209	0.00688	0.4815	0.0000	0.0000	0.0000	0.0000	0.0000	0.4815	160.7720	166.5000	5.73
208	0.00358	1.9704	0.0000	0.0015	0.0000	0.0644	0.4542	2.4905	160.2905	166.5000	6.21
204	0.00377	0.2829	0.0000	0.0197	0.0000	0.1130	0.4092	0.8249	157.3274	160.0000	2.67
207	0.00205	0.0716	0.0000	0.0000	0.0000	0.0000	0.0000	0.0716	157.8716	160.0000	2.13
206	0.00192	0.0826	0.0000	0.0160	0.0000	0.0628	0.0337	0.1951	157.8000	160.0000	2.20
205	0.00195	0.2150	0.0000	0.0004	0.0000	0.0453	0.0168	0.2774	157.6049	160.4000	2.80
203	0.00040	0.0141	0.0000	0.0000	0.0000	0.0000	0.0000	0.0141	156.5167	159.8000	3.28
202	0.00173	0.5885	0.0000	0.0339	0.0000	0.0146	-0.0913	0.5458	156.5025	159.8000	3.30
201	0.00213	0.3305	0.0000	0.0055	0.0000	0.0000	0.1208	0.4568	155.9568	159.4000	3.44
200	0.00000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	155.5000	155.5000	0.00

Storm Frequency = 100-Year

* * * * * H Y D R O L O G Y * * * * *

Tributary Area		Hydrology					Summation					Conduit Data					
Node to Node	C	Area (Ac)	Slope (%)	Length (Ft)	TC (Min)	I(0) (In/Hr)	TC (Min)	I (In/Hr)	Q (CFS)	Sum Q (CFS)	Q	Size	Velocity (Ft/Sec)	Length (Ft)	TT (Min)	TT+TC (Min)	
210	208	0.40	1.80	0.00	0.0	15.00	8.97	6.46	15.00	8.97	6.46	6.46	15"	5.26	70.00	0.22	15.22
209	208	0.40	3.30	0.00	0.0	15.00	8.97	11.84	15.00	8.97	11.84	11.84	15"	9.65	70.00	0.12	15.12
208	206	0.40	3.30	0.00	0.0	15.00	8.97	11.84	15.22	8.92	11.78	30.05	24"	9.57	550.00	0.76	16.18
207	206	0.40	1.80	0.00	0.0	15.00	8.97	6.46	15.00	8.97	6.46	6.46	15"	5.26	35.00	0.11	15.11
206	205	0.40	1.10	0.00	0.0	15.00	8.97	3.95	16.18	8.71	3.83	40.18	30"	8.18	43.00	0.09	16.27
205	204	0.40	0.10	0.00	0.0	15.00	8.97	0.36	16.27	8.69	0.35	40.52	30"	8.26	110.00	0.22	16.49
204	202	0.40	4.70	0.00	0.0	15.00	8.97	16.87	16.49	8.65	16.26	56.78	30"	11.57	75.00	0.11	16.60
203	202	0.40	0.80	0.00	0.0	15.00	8.97	2.87	15.00	8.97	2.87	2.87	15"	2.34	35.00	0.25	15.25
202	201	0.40	0.90	0.00	0.0	15.00	8.97	3.23	16.60	8.63	3.11	62.66	36"	8.87	340.00	0.64	17.24
201	200	0.40	2.10	0.00	0.0	15.00	8.97	7.54	17.24	8.50	7.14	69.80	36"	7.88	155.00	0.26	17.50

* * * * * H Y D R A U L I C S * * * * *

Node	Hyd-Slope (Ft/Ft)	Friction (Ft)	Bend (Ft)	Transition (Ft)	Manhole (Ft)	Deflection (Ft)	Junction (Ft)	Total (Ft)	Hyd-Gl Elevation	Desired Elevation	Diff.
210	0.01000	0.7002	0.0000	0.0000	0.0000	0.0000	0.0000	0.7002	180.2424	166.5000	-13.74
209	0.03362	2.3534	0.0000	0.0000	0.0000	0.0000	0.0000	2.3534	181.8956	166.5000	-15.40
208	0.01765	9.7055	0.0000	0.0051	0.0000	0.3148	2.2519	12.2773	179.5422	166.5000	-13.04
204	0.01916	1.4373	0.0000	0.1019	0.0000	0.5646	2.1150	4.2188	164.8784	160.0000	-4.88
207	0.01000	0.3501	0.0000	0.0000	0.0000	0.0000	0.0000	0.3501	167.6149	160.0000	-7.61
206	0.00959	0.4125	0.0000	0.0761	0.0000	0.3092	0.2019	0.9999	167.2648	160.0000	-7.26
205	0.00976	1.0737	0.0000	0.0018	0.0000	0.2264	0.0847	1.3866	166.2650	160.4000	-5.87
203	0.00198	0.0692	0.0000	0.0000	0.0000	0.0000	0.0000	0.0692	160.7288	159.8000	-0.93
202	0.00383	3.0012	0.0000	0.1715	0.0000	0.0744	-0.4530	2.7941	160.4596	159.8000	-0.66
201	0.01095	1.6977	0.0000	0.0294	0.0000	0.0000	0.6384	2.3656	157.8656	159.4000	1.53
200	0.00000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	155.5000	155.5000	0.00



Date 2-25-86 Page 1 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan


<u>Node</u>	<u>Q₂</u>	<u>Inlet Condition</u>	<u>Size</u>
210	2.9 cfs	Sump	1- COW Type 1A LES
209	5.4	Sump	"
208	5.4	Sump	"
207	2.9	Sump	"
206	1.8	On Grade	"
205	0.2	On Grade	"
204	7.6	Sump	"
203	1.3	Sump	"
202	1.5	Sump	"
201	3.4	Sump	"
200	-	(End section)	-

See Page 2 for depth @ sump

$$(Max = 0.55' + 2" dep) = 0.72'$$

Inlets on grade (Nodes 206 & 205):

Since Q is small, assume 100% interception.

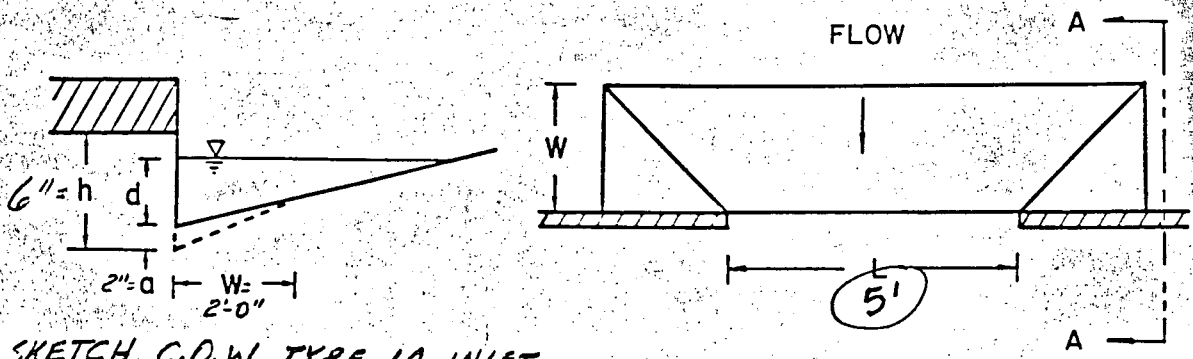

DEF. SKETCH, C.D.W. TYPE 1A INLET


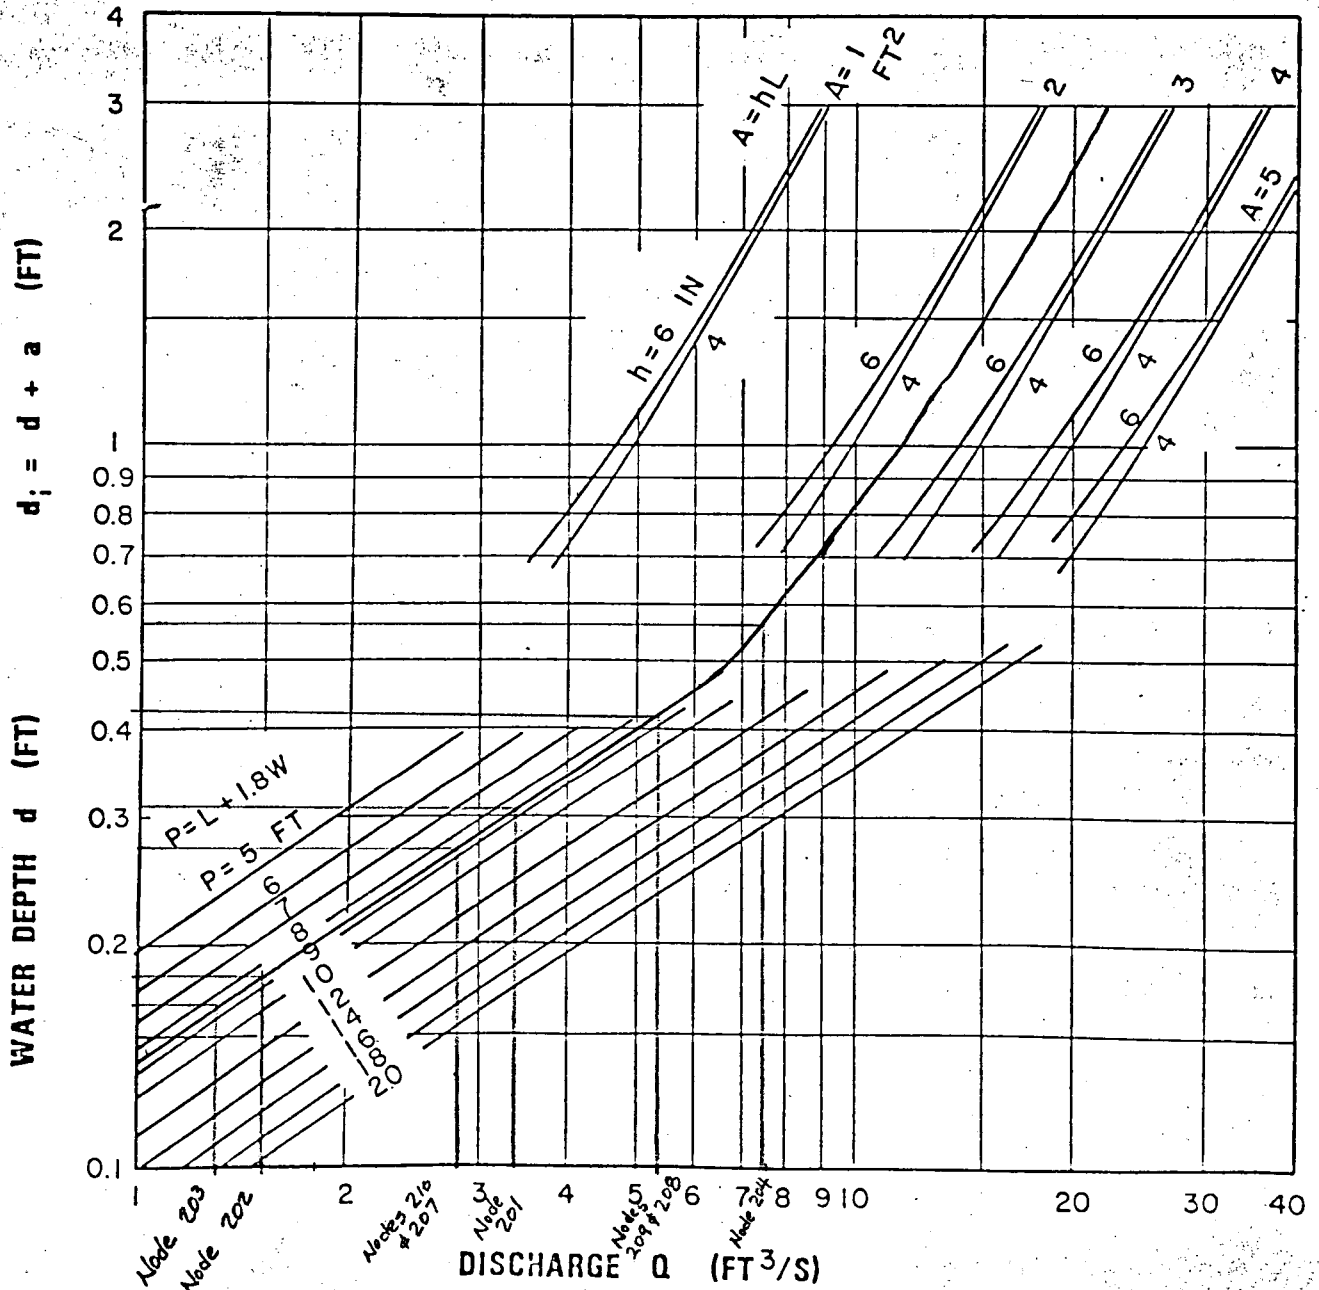


CHART 12. Depressed curb-opening inlet capacity in sump locations.

FROM: HEC-12, DRAINAGE OF HIGHWAY PAVEMENTS, F.H.W.A., MAR., 1974



Date 2-25-86 Page 3 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan

STREET FLOW - 2YR						
NODE	Q ₂	Distribution	Streets	d	d _{allow}	Comment
210	2.9	25% (S) = 0.7	0.32%	0.18'	0.55'	OK
		75% (W) = 2.2	0.32%	0.28'	0.3'	OK
209	3.4	50% (N) = 2.7	0.32%	0.30'	0.55'	OK
		50% (W) = 2.7	0.32%	0.30'	0.3'	OK
208	5.4	15% (S) = 0.8	0.32%	0.20'	0.55'	OK
		85% (W) = 4.6	0.32%	0.37'	0.55'	OK
207	2.9	10% (S) = 0.3	0.32%	0.13	0.55'	OK
		90% (W) = 2.6	1.20%	0.23	0.30'	OK
206	1.8	100% (W) = 1.8	1.2%	0.22	0.30'	OK
205	0.2	100% (S) = 0.2	0.32%	0.11	0.55'	OK
204	7.6	50% (S) = 3.8	0.32%	0.35'	0.55'	OK
		50% (W) = 3.8	0.32%	0.35'	0.55'	OK
203	1.3	75% (W) = 1.0	0.32%	0.22	0.55'	OK
		25% (E) = 0.3	0.32%	0.13	0.3'	OK
202	1.5	75% (S) = 1.2	0.32%	0.23	0.55'	OK
		25% (E) = 0.3	0.32%	0.13	0.3'	OK
201	3.4	50% (S) = 1.7	0.32%	0.26	0.3'	OK
		50% (W) = 1.7	0.32%	0.26	0.3'	OK



Date 2-15-86 Page 4 of 6

Project Woodbridge 3rd Add'n

Item Drainage Plan

Check Street Flow 100-yr

$$\text{Street Flow} = Q_{100} - Q_2$$

$$Q_{\max} = 670.66 \sqrt{s} \times 2 \quad (\text{see Page 6})$$

$$= 1341.32 \sqrt{s}$$

$$\text{w/ } s = 0.32\% \quad Q_{\max} = 75.87$$

$$\text{w/ } s = 1.2\% \quad Q_{\max} = 146.93$$


As noted on Hydrology Calcs, Q_{100} for entire system = 69 cfs (This is less than allowable max on min grade)

\therefore All street Flow OK

$Z = \frac{1}{3/8 \text{ Ft}} = 32$

$n = 0.016$

$Z/n = 32 / 0.016 = 2000$

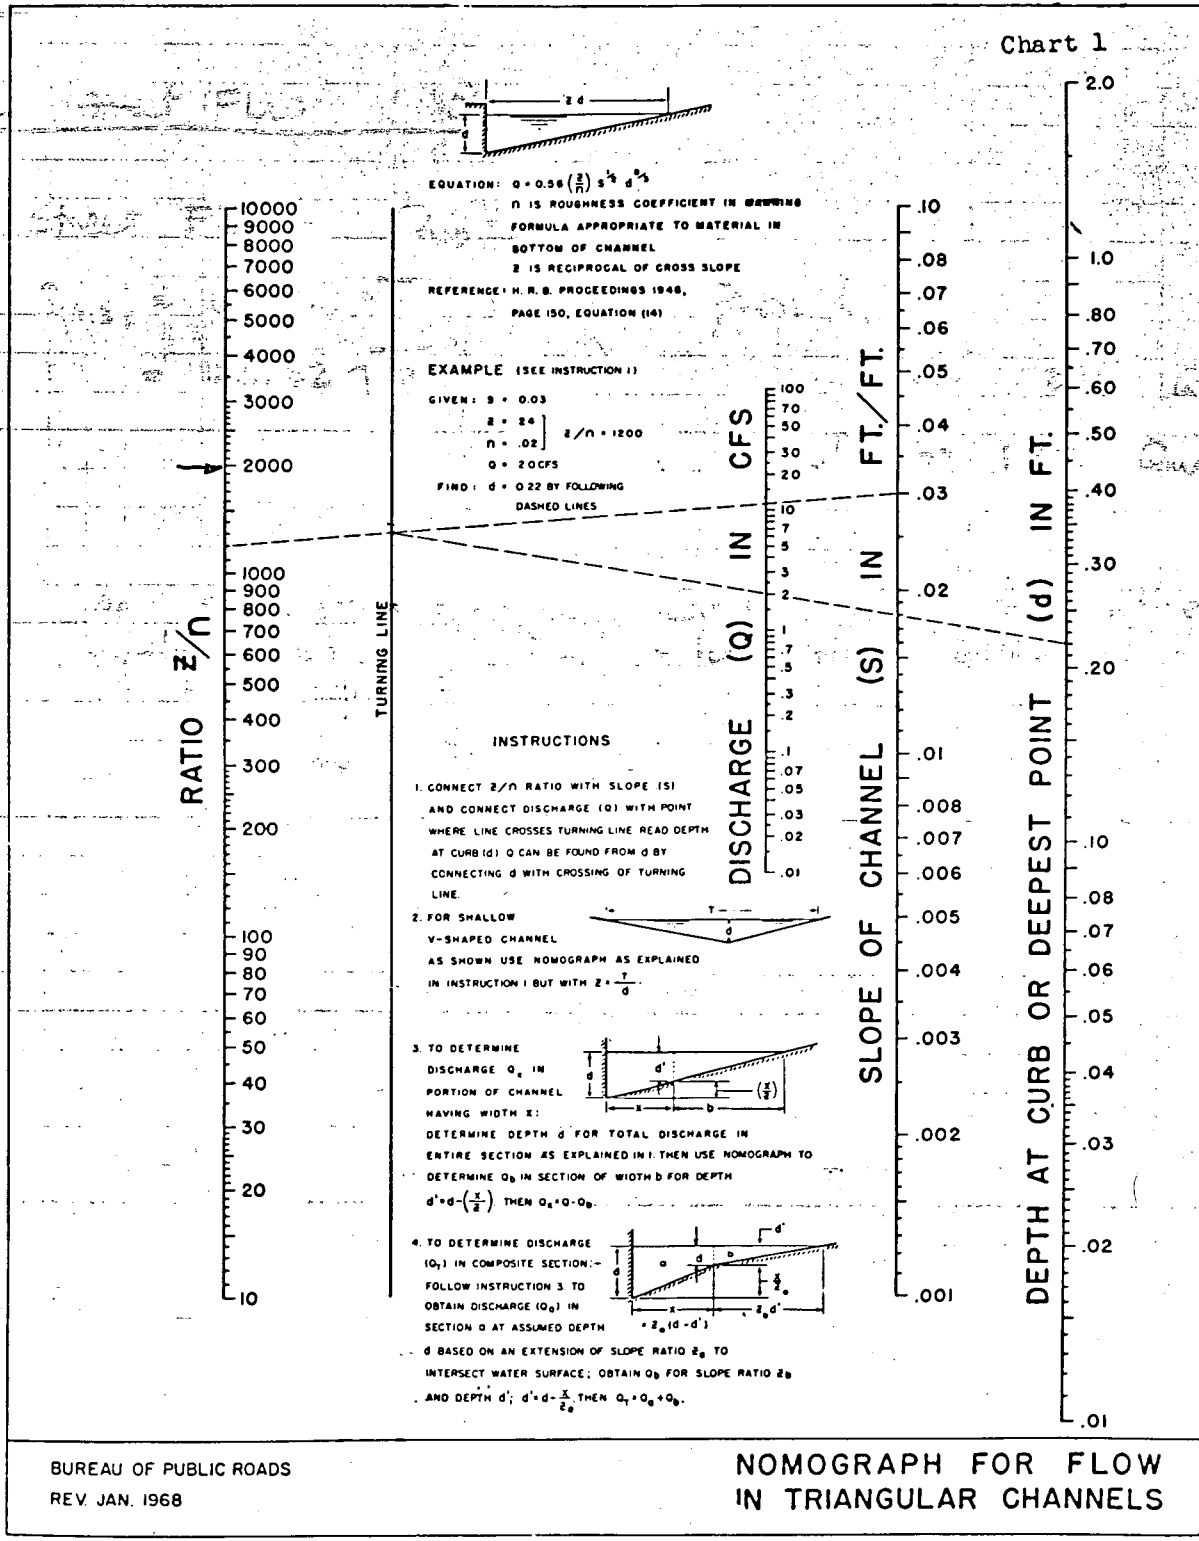



Date 5/30/85 MWB Page 6 of 6

Project Woodbridge 3rd Add.

Item STREET FLOW EQUATIONS

35' BK-BK STREET (1/2 STREET CAPACITY)

$$15' \times \frac{3}{8} \frac{1}{1} = 0.46875'$$

$$\# \text{ to } \# = 0.47 + 0.05 = 0.52$$

Curb deep flow is 0.03' above crown,

$$T = (\text{depth above } \#) / S_x$$

$$n = 0.016$$

$$S_x = \frac{3}{8} \text{ in / ft} = 0.03125 \text{ ft/ft}$$

$$B = T - 16.6' \quad (\text{Sec I Below})$$

I. At $d = 0.52'$ (Crown deep)

$$T = 0.52 / 0.03125 = 16.6'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(16.6)^{8/3} - 1^{8/3}]$$

$$= 194.58 \sqrt{S}$$

II At $d = 0.55'$ (Curb deep)

$$T = 17.6'$$

$$B = 1.0'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(17.6)^{8/3} - 1^{8/3}]$$

$$= 227.32 \sqrt{S}$$

III. At $d = 0.85'$ (T.C. + 0.302') (14'-6" Pkg.)
(1/2" S.I.)

$$d = 0.85$$

$$T = 27.26$$

$$B = 10.66$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(27.26)^{8/3} - (10.66)^{8/3}]$$

$$= 670.66 \sqrt{S}$$

IV At T.C. + 0.41' (14'-6" Pkg., 3/8" S.I.)

$$d = 0.96'$$

$$T = 30.72'$$

$$B = 14.12'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(30.72)^{8/3} - (14.12)^{8/3}]$$

$$= 878.09 \sqrt{S}$$

V At T.C. + 0.52' (14'-6" Pkg., 1/2" S.I.)

$$d = 1.07'$$

$$T = 34.24'$$

$$B = 17.64'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(34.24)^{8/3} - (17.64)^{8/3}]$$

$$= 1112.64 \sqrt{S}$$

VI At T.C. + 0.63' (14'-6" Pkg., 5/8" S.I.)

$$d = 1.18'$$

$$T = 37.76'$$

$$B = 21.16'$$

$$Q = \frac{0.56}{0.016} (0.03125)^{5/3} \sqrt{S} [(37.76)^{8/3} - (21.16)^{8/3}]$$

$$Q = 1369.72 \sqrt{S}$$



Date 2-26-86 Page 1 of 1

Project Woodbridge 3rd Add'n

Item Drainage Plan

Overflow From Pine Grove St. to Col-De-Sac

$$Q_{100} = \sum \text{Nodes } 208, 209, 210 = 11.8 + 11.8 + 6.5 = 30.1$$

$$Q_2 = \sum \text{Nodes } 208, 209, 210 = 5.4 + 5.4 + 2.9 = 13.7$$


$$Q_{\text{overflow}} = Q_{100} - Q_2 = 30.1 - 13.7 = 16.4 \text{ cfs}$$

Use Manning's Eq'n $Q = \frac{1.486}{n} A R^{2/3} S^{1/2}$ where $Q = 16.4 \text{ cfs}$
 $n = 0.030$
 $S = 0.01''$

$$16.4 = \frac{1.486}{0.030} (A R^{2/3}) (0.01)^{1/2}$$

$$16.4 = 49.53 (A R^{2/3}) 0.10$$

$$A R^{2/3} = 3.31$$

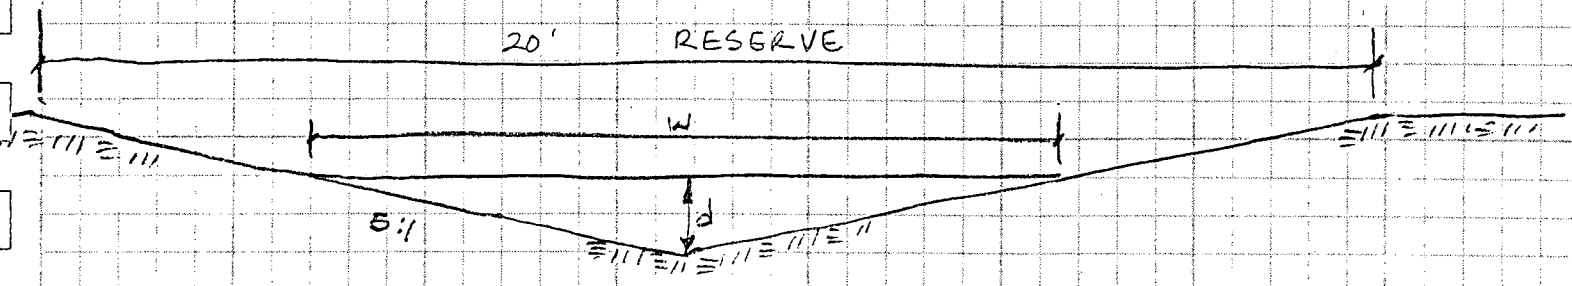

<u>d</u>	<u>A</u>	<u>P</u>	<u>R</u>	<u>R^{2/3}</u>	<u>A R^{2/3}</u>
1.0	5.0	10.2'	0.49	0.62	3.10
1.1	6.05	11.22	0.54	0.66	4.00

USE $d = 1.0'$ $W = 10'$

$$V = Q/A = 16.4/5.0 = 3.28 \text{ f/s}$$

**PROFESSIONAL
ENGINEERING CONSULTANTS, PA**

1440 E. English
WICHITA, KANSAS 67211

(316) 262-2691

LETTER OF TRANSMITTAL

TO City of Wichita
455 N. Main
Wichita, KS 67202

DATE <u>Nov. 18, 1986</u>	JOB NO.
ATTENTION <u>Carl Gipson, P.E.</u>	
RE: <u>Revisions to Drainage Plans</u>	

WE ARE SENDING YOU Attached Under separate cover via _____ the following items:


- Shop drawings Prints Plans Samples Specifications
 Copy of letter Change order _____

COPIES	DATE	NO.	DESCRIPTION
<u>1</u>			<u>Woodbridge 3rd Addition Drainage Plan (Revised)</u>
<u>1</u>			<u>Woodbridge 4th Addition Drainage Plan (Revised)</u>

THESE ARE TRANSMITTED as checked below:

- For approval Approved as submitted Resubmit _____ copies for approval
 For your use Approved as noted Submit _____ copies for distribution
 As requested Returned for corrections Return _____ corrected prints
 For review and comment _____
 FOR BIDS DUE _____ 19 _____ PRINTS RETURNED AFTER LOAN TO US

REMARKS Revision of Pipe size Between Nodes 107 & 105
to carry Q₁₀₀. (Pipe increased From 24"
to 27").

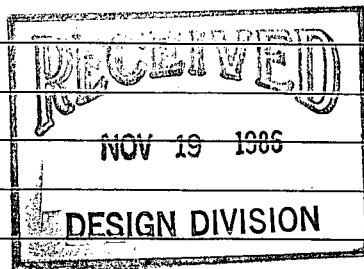

COPY TO _____

SIGNED: Charles Brown



Date Nov. 18, 1986 Page 1 of 3

Project Woodbridge 4th

Item Drainage

OPTION 1

INSTALL NEW INLET @ W. END CUL-DE-SAC

INSTALL LARGER PIPE FROM NODE 107

TO CUL-DE-SAC.

$Q = 30.2$ cfs from Woodbridge 3rd Drainage Plan

Slope: Allow Elev @ Node 107 = 165.5 top grade
 $\frac{0.6' \text{ head}}{166.1}$

Allow Elev @ Cul-De-Sac = T.C. = 164.6

Slope = $\frac{166.1 - 164.6}{150'} = \frac{1.5'}{150} = 1\%$

$n = 0.013$

USE 27" RCP (see page 2)

Additional Cost: 1 inlet \$1800

OPTION 2

INSTALL LARGER PIPE FROM NODE 107 to NODE 10


$Q = 30.2$

Slope = $\frac{166.1 \text{ (at Node 107)} - 159.8 \text{ (T.C. @ Node 10)}}{450'} = \frac{6.3}{450} = 1.4$


$n = 0.013$

USE 27" RCP

Additional Cost: Extra Cost For Larger Pipe
 $300' @ \$4.00/\text{ft} = \1200

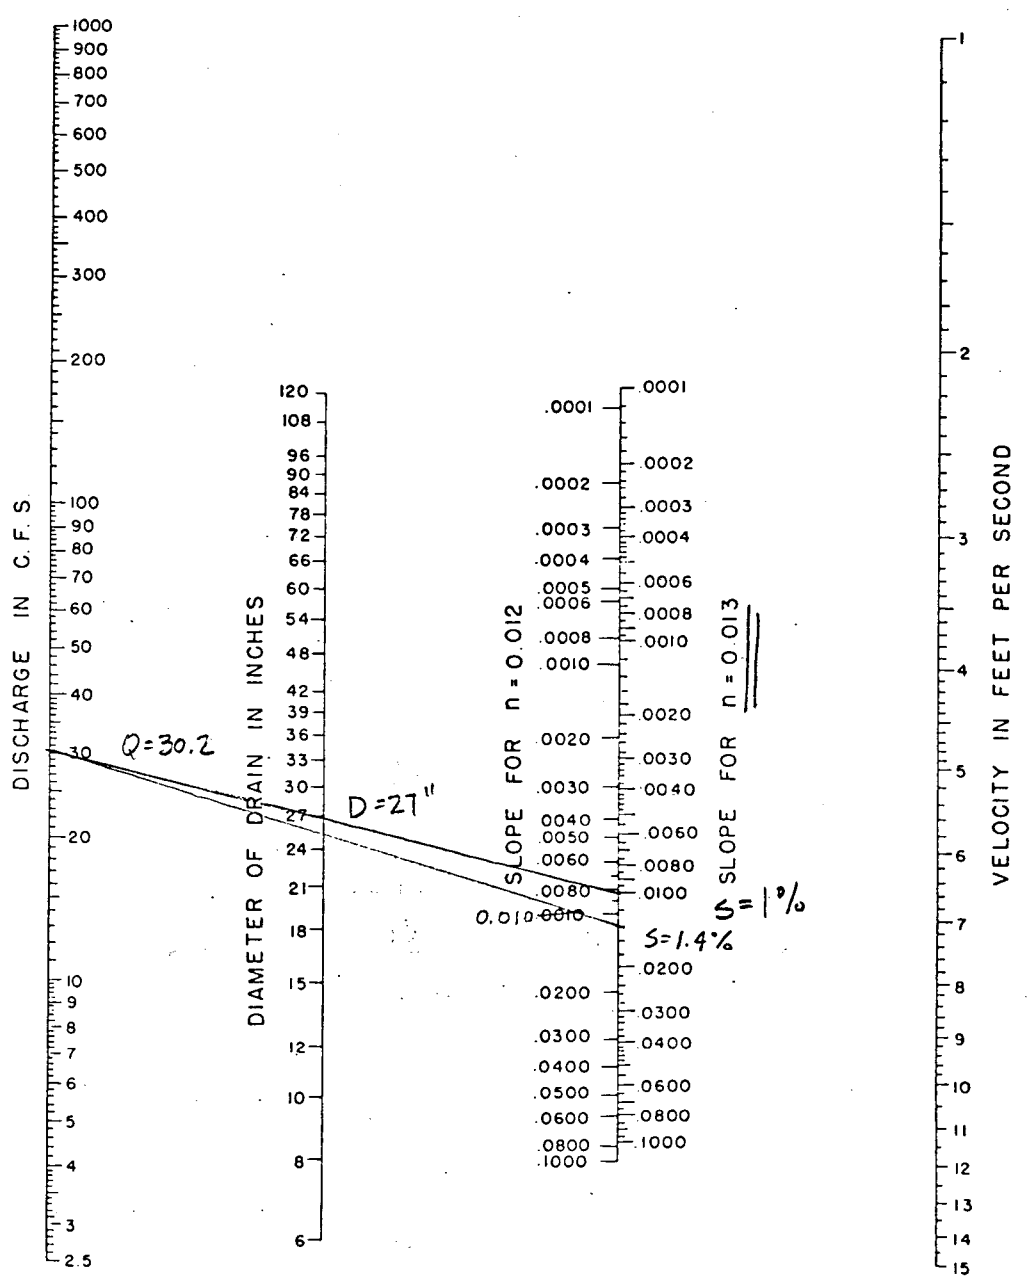

Nomograph for computing required size of circular drain, flowing full - n = 0.012 OR 0.013



Date Nov. 18 Page 3 of 3

Project Woodbridge 4th

Item Drainage.

SUMMARY : USE 27" FROM NODE 107 to NODE 105
DO NOT USE INLET @ COL-DE-SAC.