

DRAINAGE PLAN
SKYWAY WEST 3RD
ADDITION
TO
WICHITA, SEDGWICK COUNTY, KANSAS

PREPARED BY



REVISED 15 DECEMBER 2011
28 OCTOBER 2011



DRAINAGE PLAN SKYWAY WEST 3RD ADDITON

FINAL REPORT

Prepared by Baughman Company, P.A.
28 October 2011
Revised 15 December 2011

By Trevor R. Kurth, P.E., CFM
N. Brent Wooten, P.E., L.S.

REPORT CONTENTS

City of Wichita Checklist

Project Narrative

- Existing Conditions
- Proposed Conditions
- Offsite Conditions

Existing Conditions Runoff Calculations

- Drainage Methods & Standards
- Site Characteristics
- Existing Conditions Hydrologic Analysis
- Downstream Drainage Capacity

Post-Development Hydrologic Analysis

- Drainage Methods & Standards
- Developed Conditions Hydrologic Analysis
- Detention Facilities
- Discharge Points Summary
- Potential Upstream/Downstream Impacts

Floodplain Submittal

- Source of Floodplain Information

Federal, State, & Local Permitting

- US Army Corps of Engineers
- Kansas Dept of Agriculture – DWR Permitting
- FEMA
- Kansas Dept of Transportation
- Sedgwick County ROW

Exhibits

- Exhibit 1: Site Location Map
- Exhibit 2: Aerial Photo Exhibit with Lidar Topography
- Exhibit 3: Plat -- Half Scale
- Exhibit 4: Drainage Plan – Half Scale
- Exhibit 5: Floodplain Location (FIRM)

Appendices: Supporting Calculations

- Appendix A: USGS Soils Survey
- Appendix B: HydraFlow Hydrographs
- Appendix B: HydraFlow Express

Plan Sheets

- Drainage & Grading Plan 1: 100 Scale

PROJECT NARRATIVE

EXISTING CONDITIONS

The site is located at the northwest corner of Maize Road and 31st Street South. The property is adjacent north to Skyway West Addition and to the northeast of Skyway West 2nd Addition. The site encompasses approximately 50 acres and is currently terraced farmland.

The property ultimately drains to the east into an apparent swale on this property. The site is terraced which does alter the flow of the runoff.

There is no FEMA SFHA located on this property as of this report. The drainage patterns as defined above can be seen on the Existing Conditions Exhibit.

PROPOSED CONDITIONS

The property is being platted into one large industrial lot with 2 reserves for onsite and offsite runoff. The site will be further defined at site development. The detention facilities will all be dry due to the area of influence near the airport. We expect portions of the site to be paved with asphalt/concrete or with gravel upon development. The site will likely be graded to minimum grades to account for large industrial users and will likely drain via ditches/swales and overland flow. For a half-scale copy of the Plat, see Exhibit 3.

OFFSITE CONDITIONS

The proposed site drains to the northeast corner of the property. The site tends to grade to the east – not including the terracing which diverts flow to the north. There is offsite runoff encroaching this property from the west as well as from the southeast corner of the property via a RCBC.

The runoff from the west flows onto this property primarily via sheet flow and/or shallow concentrated flow over a wide path along the entire property line. This offsite area drains approximately 37.3 acres of current agricultural farmland. As mentioned earlier, this site – as well as the adjacent site – is terraced and alters the natural flow patterns of the area.

The other offsite runoff drains onto this property at the southeast corner. The offsite area drains to this point via a 3'x5' RCBC. This area is currently platted as Skyway West Addition. The approved Drainage Plan for that addition provides detention for the developed runoff to this point, although it is not constructed at the time of this report.

The entire flow from the proposed site, as well as the two points of offsite runoff, flows to the northeast corner of the property and goes north offsite. There is a farmed channel which conveys the runoff onto the adjacent agricultural land and then under Maize Road via a Triple 8'x4' RCBC. This box culvert appears to be in good working order and features a 32' soil saver on the upstream end.

The USGS Quadrangle Sheet can be seen with the site location plotted as Exhibit 1. The Aerial for this area can be viewed as Exhibit 2.

EXISTING CONDITIONS RUNOFF CALCULATIONS

DRAINAGE METHODS & STANDARDS

The following methods and standards, although not a complete list, were used in calculating the existing conditions runoff values.

- STORM SERIES
 - 24-hour; 2-yr, 5-yr, 10-yr, 25-yr, 100-yr Storm Events Modeled
 - 2-yr Rainfall Depth = 3.5 in
 - 10-yr Rainfall Depth = 5.3 in
 - 100-yr Rainfall Depth = 7.9 in

- FLOW DATA
 - Areas per LIDAR data, USGS Quadrangle Sheet, Aerial Photos, and Site Visits
 - SCS Curve Number used for Existing Flows (CN = 80)
 - Time of Concentration: Lag Method (minimum 15 min)

SITE CHARACTERISTICS

The site consists of approximately 50 acres of currently agricultural farmland. The area drains to the east and offsite at the northeast corner onto the existing agricultural farmland in the existing drainage swale/channel.

The existing site characteristics can be seen from the aerial exhibit (Exhibit 2).

EXISTING CONDITIONS HYDROLOGIC ANALYSIS

The site was analyzed for pre-development conditions using the SCS Curve Number method for the entire storm event series. A Curve Number (CN) of 80 was used for existing conditions due to row crops in a Type C soil condition. Although the CN's for this soil type would be higher utilizing TR-55, a more conservative CN of an 80 was used. This was used based on Table 4-2 in the City of Wichita's storm water manual. The Time of Concentration was calculated using the Lag Method with a minimum Tc of 15 minutes, if needed.

DOWNSTREAM DRAINAGE CAPACITY

The site flows to the northeast corner of the property. The downstream farmland consists of an agricultural field with a channel section to convey the runoff. Approximately 250' to the north, the channel drains under Maize Road via a large celled RCBC. The RCBC appears to be, based on field visits, a triple celled 8' x 4' RCBC with a soil saver on the upstream end.

POST-DEVELOPMENT HYDROLOGIC ANALYSIS

DRAINAGE METHODS & STANDARDS

The following methods and standards, although not a complete list, were used in developing the drainage and grading plans.

- STORM SERIES
 - 24-hour; 2-yr, 5-yr, 10-yr, 25-yr, 50-yr, 100-yr Storm Events Modeled
 - 1.2" Water Quality Flow modeled as '3-yr event' in HydraFlow
 - Hydrograph Method utilized for Developed Flows
 - CN = 91 (Soil Type C – Industrial Cover)
 - Time of Concentration; Lag Method, minimum Tc = 15min

- GRADING CONSTRAINTS
 - One foot freeboard between 100-yr WSE and adjacent lot corner
 - Match all existing perimeter grades

DEVELOPED CONDITIONS HYDROLOGIC ANALYSIS

The site is proposed to be platted into a one lot industrial development. There is proposed to be 3 separate detention ponds to detain developed runoff to the existing runoff peak flows. A Curve Number of 91 was used for Industrial Lots in a Soil Type C. Based on the Storm Water Manual, Table 4-4, Industrial cover will be assumed to have an impervious coverage of 72%. Since this table was taken directly from TR-55, but does not include the rest of the expanded table, TR-55 was used and a corresponding CN was used. No specific grading or lot configuration is known at the time of this plat, which will be done during the site development process.

Please be aware, that the storm listed as the '3-yr event' in the Hydraflow model is actually the 1.2" rainfall water quality event. This is due to the constraints of the programs naming conventions. All the other storm events correspond to their respective years. The Channel Protection volume is generated using the 1-year event.

DETENTION FACILITIES

There are 3 detention facilities proposed for this plat. Each facility will be dry detention due to the proximity to Wichita's Mid-Continent Airport. These facilities can achieve only 60% of the water quality for the proposed site in each of their respective basins according to the Storm Water Manual design for extended dry detention ponds. Each facility is detailed further below.

- Reserve B – West Detention Area
 - This pond is located at the northwest corner of the property and will accept all the offsite runoff from the west as well as portion of developed runoff from this property. The pond will drain via a 24" RCP with a 4" orifice located at the bottom of the detention. The 24" pipe will have a weir riser structure as well as an emergency overflow weir. These outfalls will drain to a ditch/channel section along the entire north line of the property. This pond, utilizing the orifice and riser outfall system, will provide WQ and CP requirements.

This pond will provide the full 24 hour detention for WQ, and will provide the full 24 hours of CP volume extended detention.

- Reserve B – East Detention Area

The dry detention located in Reserve B will detain provide detention throughout the storm series as well as provide CP and WQ volumes. The pond will discharge via a 4" orifice and 48" pipe section with a weir riser outfall configuration. There will also be an emergency overflow weir. This system will provide the full 24 hours for WQ extended detention as well as 24 hours of CP volume extended detention.

- Reserve A

The detention area in Reserve A will accept and treat only the developed runoff from this site. The offsite runoff will be accepted into this Reserve via a channel section, with the detention pond located immediately west. This detention area will also be dry and will drain to the north via the orifice / overflow configuration. This outfall will feature a 24" pipe and a 4" orifice along with a 6' emergency overflow weir. This detention area will also provide the WQ and CP volumes needed for the developed site. The channel is independent of the detention area; therefore no offsite flow has been modeled through the detention facility.

DISCHARGE POINTS SUMMARY

The site will continue to discharge to the northeast corner of the property. The downstream farmland consists of an agricultural field with a channel section to convey the runoff. Approximately 250' to the north, the channel drains under Maize Road via 3-8'x4' RCBC. The same elevation and the same channel will be utilized that is currently on the offsite property to the north. At the time of development, the site will be graded to remove the terraced areas and will convey the runoff to the ditch and dry detention areas.

WATER QUALITY

Preliminary water quality calculations have been provided for the basins and detention facilities. The proposed detention facilities in Reserves A and B will provide 60% of the needed water quality volume. Since the site plan and cover is not available at this time, additional locations or BMP's are not provided at this time. At this time, the following chart can be used for a general requirement of the WQ needed on the site.

Total Developed Area	Water Quality Volume Needed	WQv needed per Developed sqft
40.4 acres	76,000 cuft	0.04 cuft

This chart portrays the overall WQv needed per square foot of development. This does not include the 60% of treatment that the dry detention areas will offer to the development. The reason this was not factored in was due to the treatment train calculations can vary based on the method chosen for the additional removal the site will utilize. Upon site plan and development, the engineer should run a treatment train calculation for the chosen BMP and include the dry detention area

in that calculation. For the purpose of this report, the total needed for the site is shown above.

DOWNSTREAM CHANNEL PROTECTION

The downstream channel protection volume will be met in the detention systems located in the Reserves. The two dry detention areas in Reserve B will provide over 24 hours of extended detention in each detention area. These volumes will be achieved with the use of orifices and riser structures and will slowly release the CPv out of each pond over the 24 hour minimum.

POTENTIAL UPSTREAM/DOWNSTREAM IMPACTS

Due to the construction of dry detention ponds, and the utilization of the existing outfall elevation, we do not anticipate any downstream impacts with this development.

FLOODPLAIN SUBMITTAL

SOURCE OF FLOODPLAIN INFORMATION

The site lies within a FEMA Zone X - Unshaded. The location of the property, on FEMA FIRM Panel 340 of 700 for Sedgwick County, Kansas, effective February 2, 2007, is attached as Exhibit 6.

FEDERAL, STATE, & LOCAL PERMITTING

US ARMY CORPS OF ENGINEERS

There does not appear to be any jurisdictional waters of the US on this site.

KANSAS DEPT OF AGRICULTURE – DWR PERMITTING

There does not appear to be any DWR permitting needed on the proposed site at this time. The areas of discharge do not account for more than 240 acres.

FEMA

There is no mapped floodplain located upon the proposed site. Therefore, no FEMA permitting is expected at this time.

KANSAS DEPT OF TRANSPORTATION

There does not appear to be any KDOT permitting needed on the proposed project.

SEDGWICK COUNTY PERMITTING

There does not appear to be any Sedgwick County permitting needed at this time.

EXHIBIT 1: Site Location Map

EXHIBIT 2: Aerial Photo Exhibit with Lidar Topography

EXHIBIT 3: Plat – Half Scale

EXHIBIT 4: Drainage Plan – Half Scale

EXHIBIT 5: Floodplain Location (FIRM)

SITE LOCATION EXHIBIT
SKYWAY WEST 2ND & 3RD ADDITIONS
WICHITA, SEDGWICK COUNTY, KANSAS


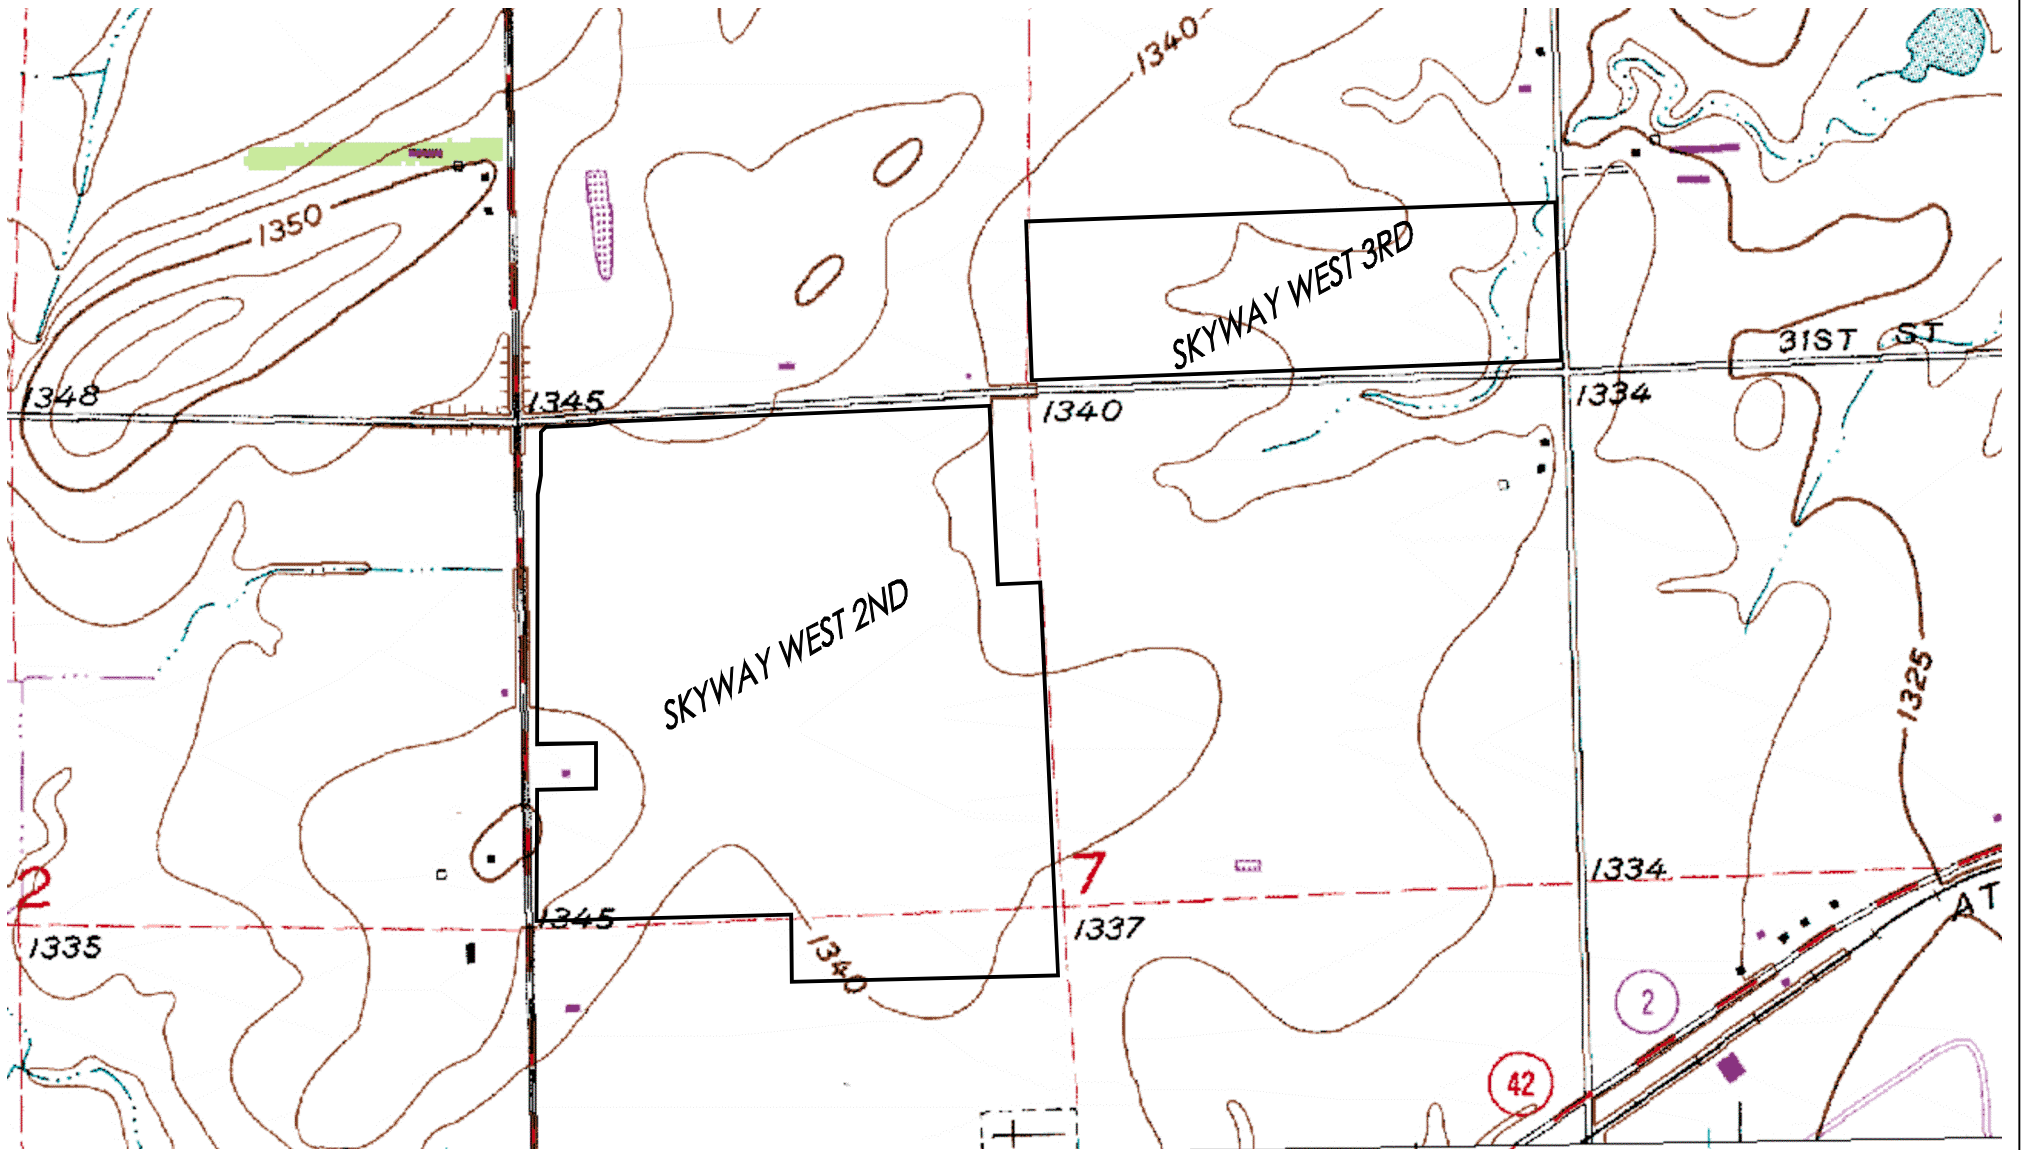


EXHIBIT 1
SKYWAY WEST 2ND & 3RD ADDITIONS
1 NOV11





AERIAL EXHIBIT

SKYWAY WEST 2ND & 3RD ADDITIONS

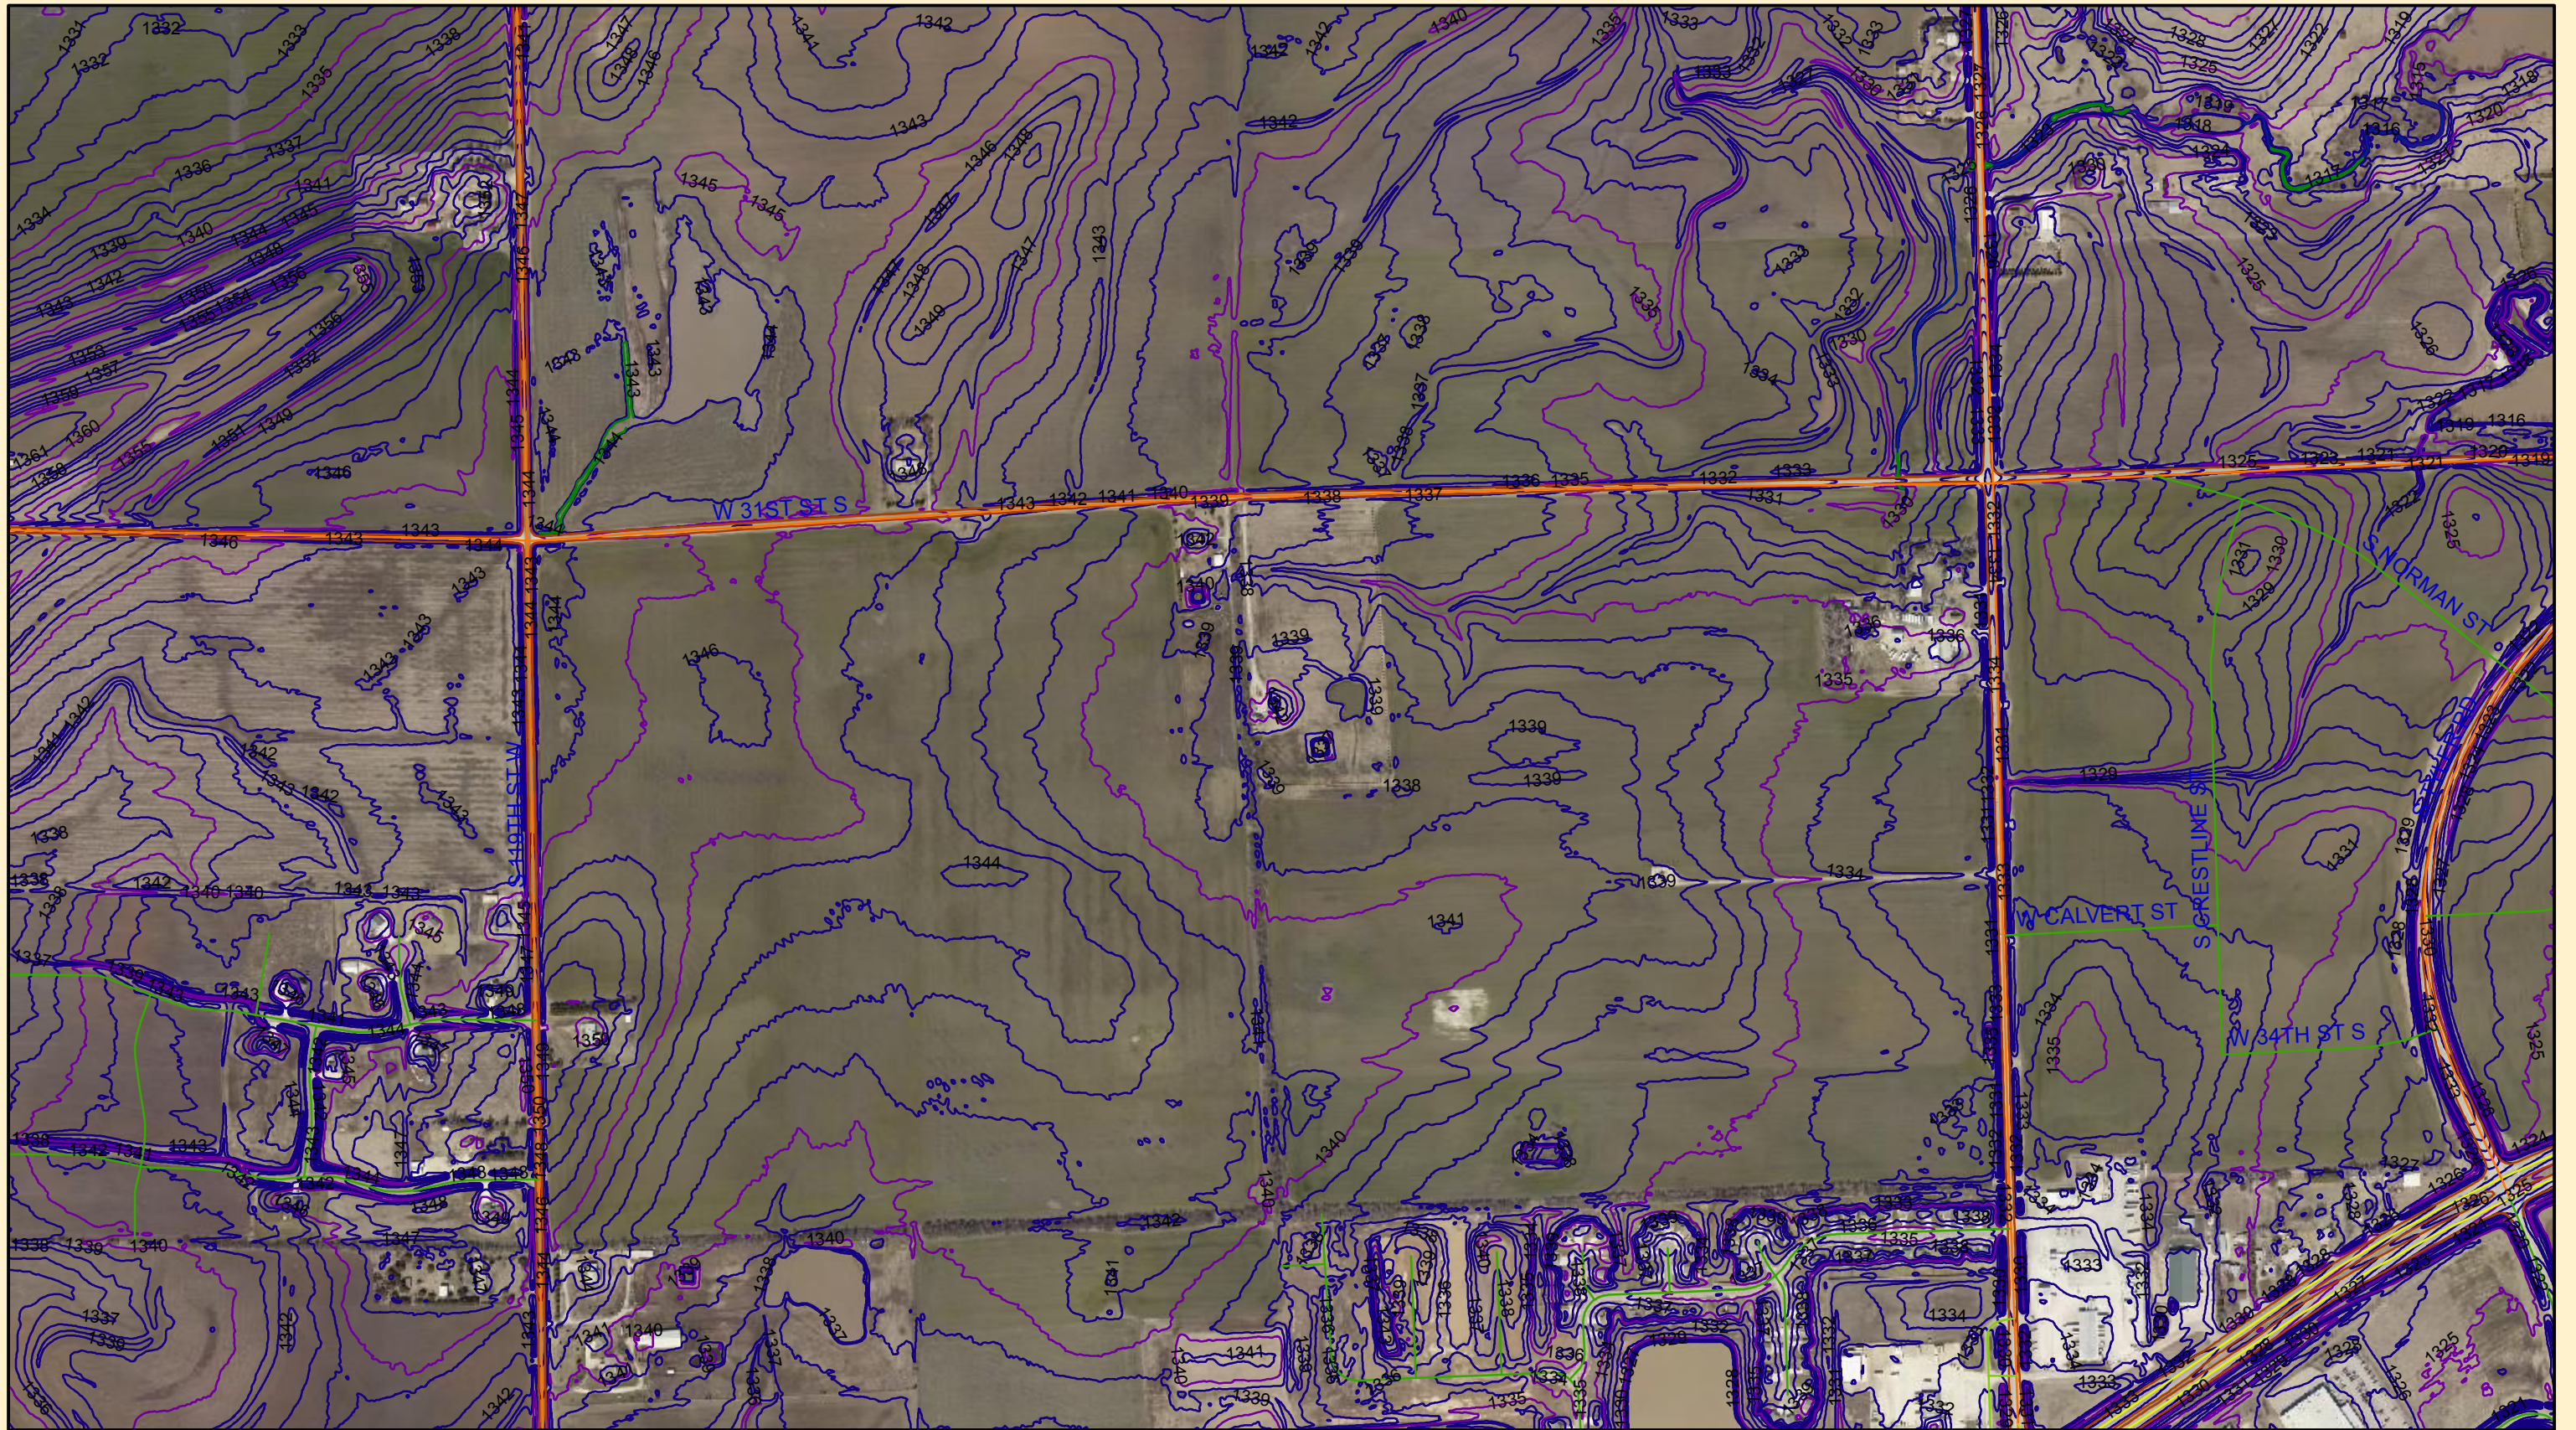

SKYWAY WEST 3RD ADDITION WICHITA, SEDGWICK COUNTY, KANSAS

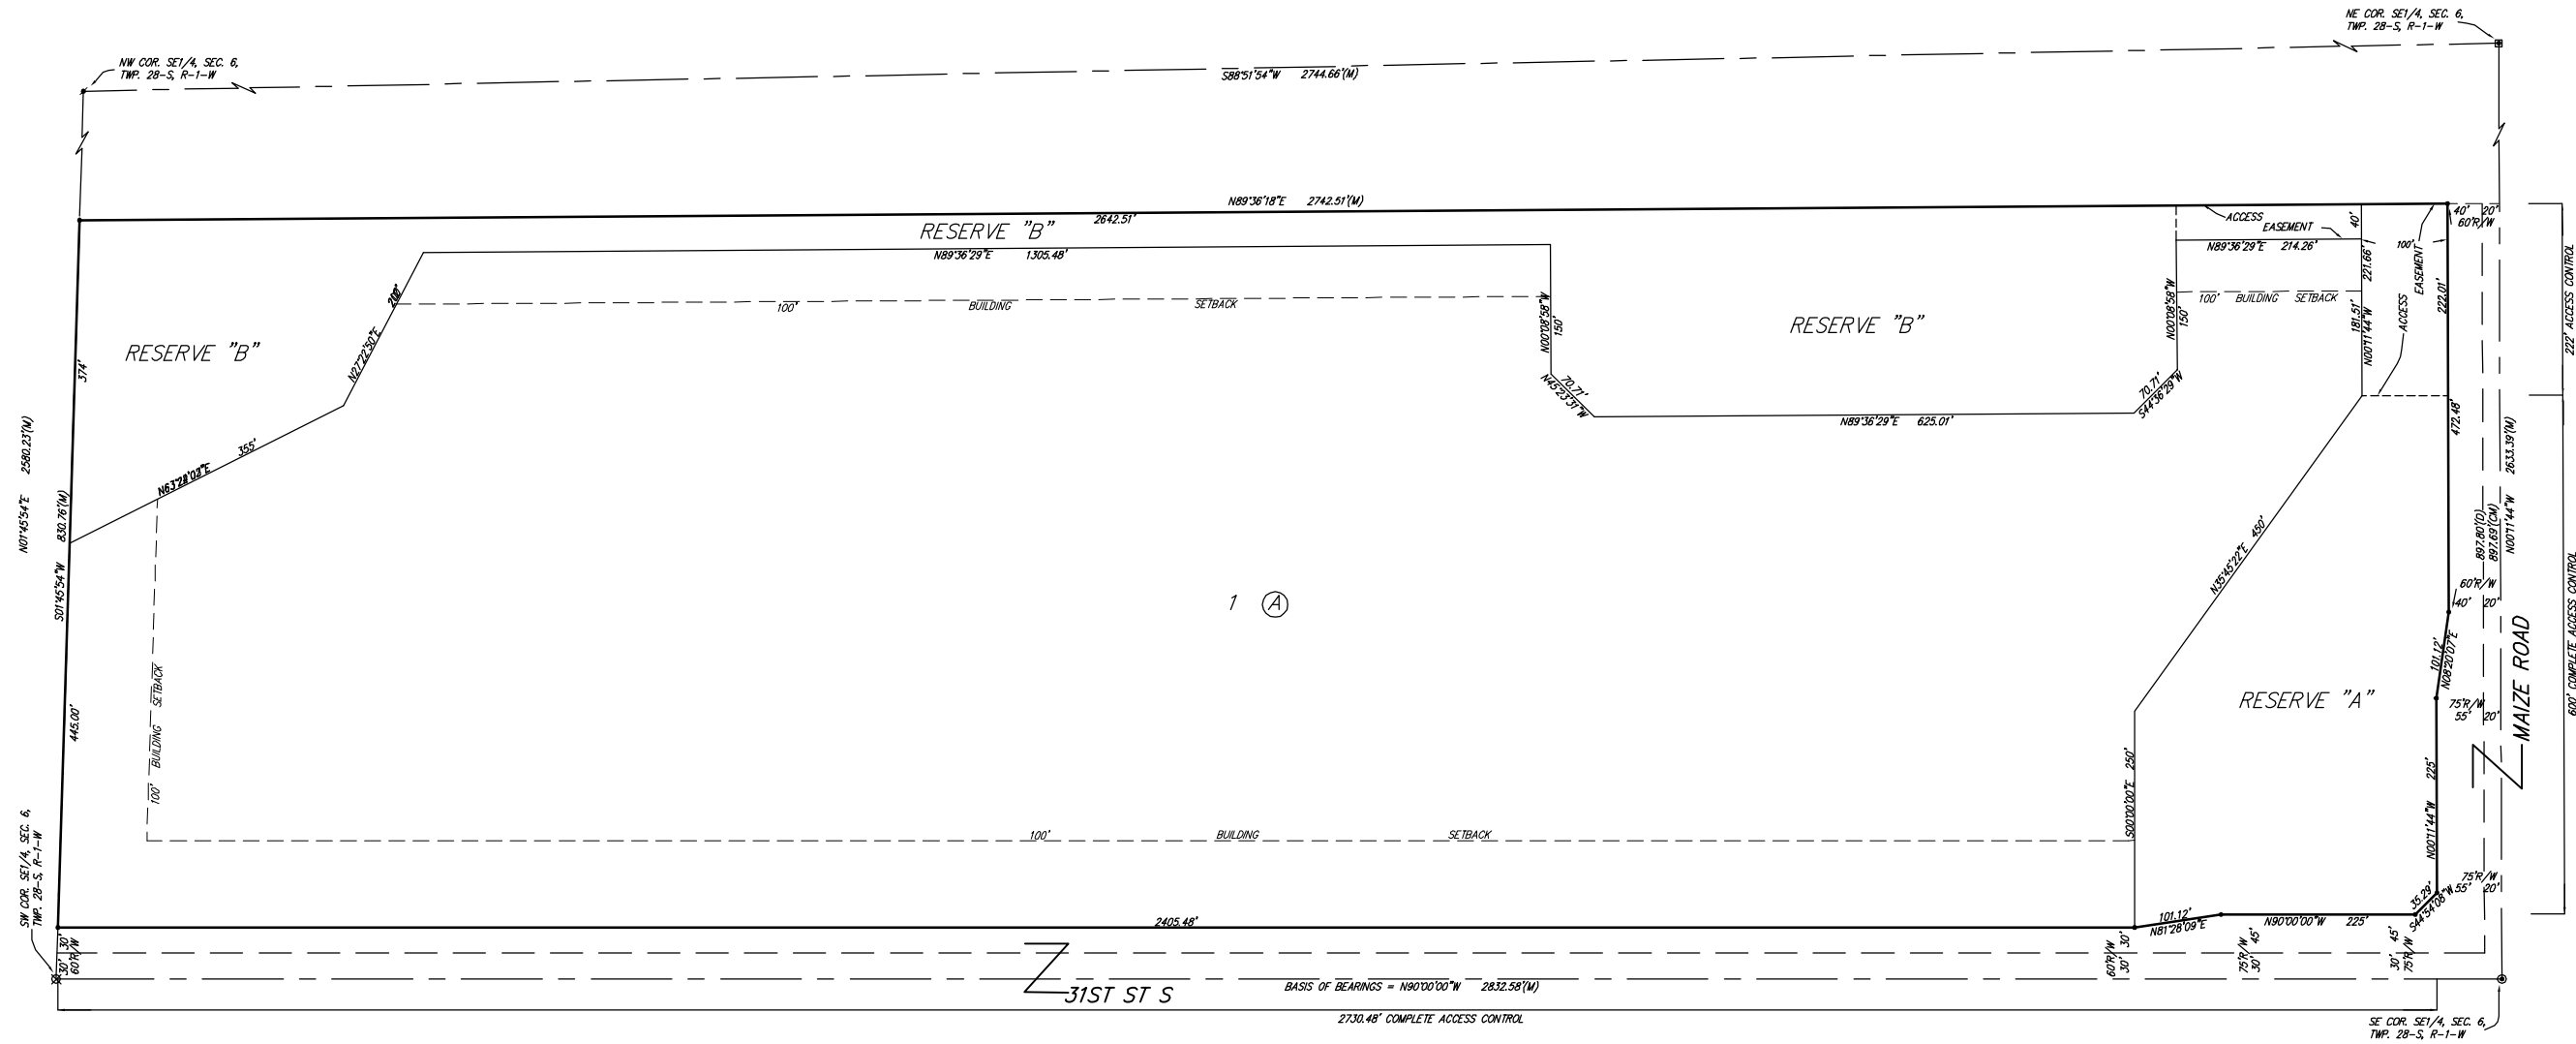

DATE OF PREPARATION: 24 OCTOBER 2011

- = #4 REBAR W/ "BAUGHMAN" CAP (SET)
- ⊗ = 3/4" IRON (FOUND)
- = 1" IRON (FOUND)
- = 1" IRON PIPE IN TRENCH (FOUND)
- (M) = MEASURED
- (D) = DESCRIBED
- (P) = PLATTED

MINIMUM BUILDING PAD ELEVATIONS FOR LOWEST OPENING TO THE STRUCTURES		
LOT	BLOCK	ELEVATION
		NAVD88
EAST HALF, LOT 1	A	1,334.0
WEST HALF, LOT 1	A	1,339.0

BENCHMARK:
MAIZE ROAD & 31ST SOUTH—CITY OF WICHITA
BENCHMARK DISC. 200' WEST OF INTERSECTION,
SOUTHEAST CORNER OF HUBGUARD OF R.C.B.C.
ELEV. = 1,331.82 NGVD88

NOTE:
A drainage plan has been developed for this subdivision and is on file with the City of Wichita, Kansas. Drainage intent shall remain as depicted or as modified with the approval of the City Engineer of the City of Wichita, Kansas. No obstructions which impede the flow of this drainage plan shall be allowed.

- = #4 REBAR (FOUND)
- = #4 REBAR W/ "BAUGHMAN" CAP (SET)
- ⊗ = #4 REBAR W/ "SEDGWICK COUNTY" CAP (FOUND)
- ⊗ = 1" IRON (FOUND)
- ⊗ = #4 REBAR (FOUND)
- (M) = MEASURED
- (D) = DESCRIBED
- (P) = PLATTED
- (C) = CALCULATED

State of Kansas) SS
Sedgwick County) We, Baughman Company, P.A., Surveyors in aforesaid county and state do hereby certify that we have surveyed and platted "SKYWAY WEST 3RD ADDITION", Wichita, Sedgwick County, Kansas and that the accompanying plat is a true and correct exhibit of the property surveyed, described as Beginning at a point on the East line of Section 6, Township 28 South, Range 1 West of the Sixth Principal Meridian, Sedgwick County, Kansas, a distance of 30 feet north of the Southeast corner of said Section; thence going northerly along the East line of the Section, a distance of 867.8 feet; thence turning left and going westerly to the Half Section line at a point 880.6 feet north of the South Quarter corner of the Section; thence turning left and going southerly, a distance of 850.6 feet; thence turning left and going easterly parallel to the South Section line to the point of beginning.

Existing public easements and dedications being vacated by virtue of K.S.A. 12-512(b).

Baughman Company, P.A.

_____, Surveyor
Michael G. Conrey

Know all men by these presents that we, the undersigned, have caused the land in the surveyors certificate to be platted into a Lot, a Block, Streets, and Reserves to be known as "SKYWAY WEST 3RD ADDITION", Wichita, Sedgwick County, Kansas. The utility easements are hereby granted as indicated for the construction and maintenance of all public utilities. The drainage and utility easements are hereby granted as indicated for drainage purposes and for the construction and maintenance of all public utilities. The drainage easements are hereby granted as indicated for drainage purposes. The streets are hereby dedicated to and for the use of the public. Reserve "A" is reserved for open space, landscaping, berms, entry monuments, signs, lakes, private drives, access purposes, drainage purposes, and utilities as confined to easements. Reserve "B" is reserved for open space, landscaping, berms, signs, lakes, private drives, access purposes, drainage purposes, and utilities as confined to easements. Reserves "A", and "B" shall be owned and maintained by the owner/owners of Lot 1. Access controls shall be as depicted on the face of the plat and are hereby granted to the City of Wichita, Kansas. The permitted opening locations shall be as determined by the City Engineer of the City of Wichita, Kansas. The Minimum Building Pad Elevations for the lowest opening to the structures shall be as indicated on the face of the plat.

John E. Dugan Family Partnership, L.P.

_____, Partner
John E. Dugan

State of Kansas) SS
Sedgwick County) The foregoing instrument acknowledged before me, this _____ day of _____, 2011, by John E. Dugan, Partner of the John E. Dugan Family Partnership, L.P., on behalf of the limited partnership.

_____, Notary Public

My App't. Exp. _____

This plat of "SKYWAY WEST 2ND ADDITION", Wichita, Sedgwick County, Kansas has been submitted to and approved by the Wichita-Sedgwick County Metropolitan Area Planning Commission, Wichita, Kansas.

Dated this _____ day of _____, 2011.
Wichita-Sedgwick County Metropolitan Area Planning Commission

_____, Chair
Shawn Farney

_____, Secretary
John L. Schlegel

This plat approved and all dedications shown hereon accepted by the City Council of the City of Wichita, Kansas, this _____ day of _____, 2011.

_____, Mayor
Carl Brewer

_____, City Clerk
Karen Sublett

Reviewed in accordance with K.S.A. 58-2005 on this _____ day of _____, 2011.

_____,
Tricia L. Robello, L.S. #1246
Deputy County Surveyor
Sedgwick County, Kansas

Entered on transfer record this _____ day of _____, 2011.

_____, County Clerk
Kelly B. Arnold

State of Kansas) SS
Sedgwick County) This is to certify that this plat has been filed for record in the office of the Register of Deeds, this _____ day of _____, 2011 at _____ o'clock _____ M., and is duly recorded.

_____, Register of Deeds
Bill Meek

_____, Deputy
Tonya Buckingham

SKYWAY WEST 3RD ADDITION

24 OCTOBER 2011

Baughman Company, P.A.
315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149


ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

E:\PROJECTS\SKYWAYWEST2ND\SKYWAY2NDAND3RD.DWG\RK

DRAINAGE PLAN

SKYWAY WEST 3RD ADDITION

WICHITA, SEDGWICK COUNTY, KANSAS

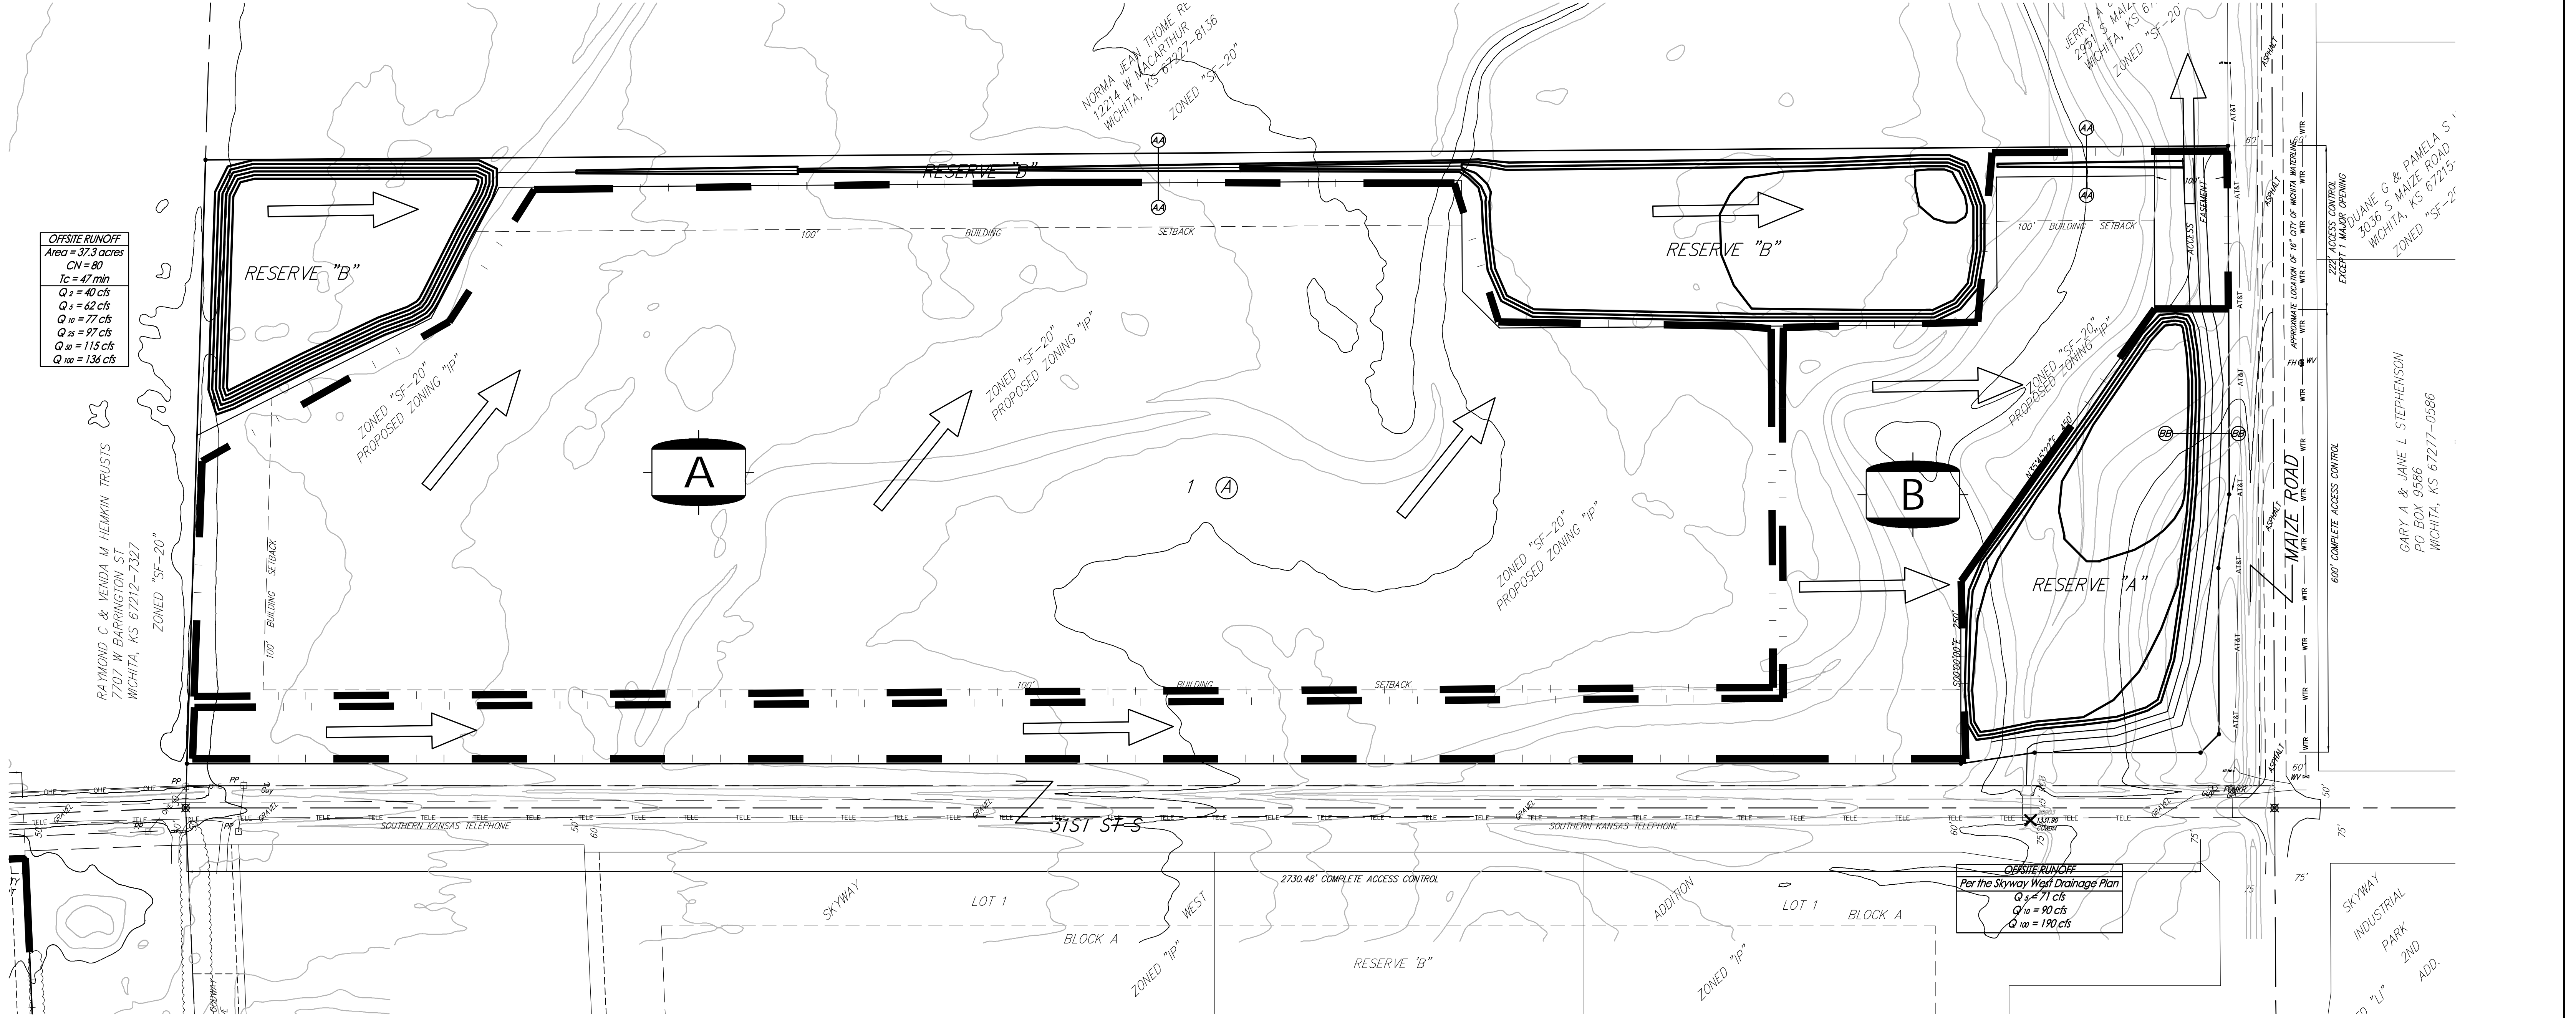

OFFSITE RUNOFF
Area = 37.3 acres
CN = 80
Tc = 47 min

Q ₂	= 40 cfs
Q ₅	= 62 cfs
Q ₁₀	= 77 cfs
Q ₂₅	= 97 cfs
Q ₅₀	= 115 cfs
Q ₁₀₀	= 136 cfs

Per the Skyway West Drainage Plan

Q ₂	= 90 cfs
Q ₁₀₀	= 190 cfs

Basin A
Developed Basin A
Area = 30 acres
CN = 91
Tc = 39 min

Q ₂	= 57 cfs
Q ₅	= 77 cfs
Q ₁₀	= 91 cfs
Q ₂₅	= 110 cfs
Q ₁₀₀	= 144 cfs

RESERVE B Upper Detention (Bottom = 1334.0)

STAGE	INFLOW	OUTFLOW	ELEVATION
2 yr	40 cfs	14 cfs	1335.8
5 yr	62 cfs	13 cfs	1336.5
10 yr	77 cfs	24 cfs	1336.9
25 yr	97 cfs	41 cfs	1337.3
100 yr	136 cfs	75 cfs	1338.0

PROPOSED POND



ELEVATION	AREA (sq ft)
1334	64000
1335	98000
1336	75000
1337	81000
1338	87000
1339	93000

RESERVE A Detention (Bottom = 1327.0)

STAGE	INFLOW	OUTFLOW	ELEVATION
2 yr	38 cfs	1.1 cfs	1328.1
5 yr	51 cfs	2.9 cfs	1328.3
10 yr	60 cfs	4.6 cfs	1328.4
25 yr	72 cfs	6.2 cfs	1328.6
100 yr	94 cfs	8.3 cfs	1329.1

PROPOSED POND

ELEVATION	AREA (sq ft)
1327	37000
1328	98000
1329	113000
1330	120000
1331	145000

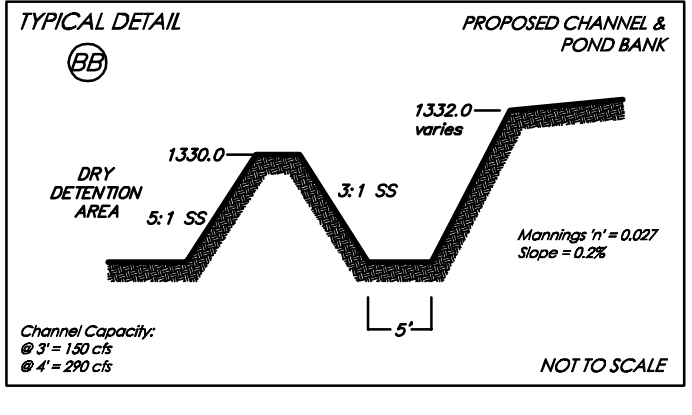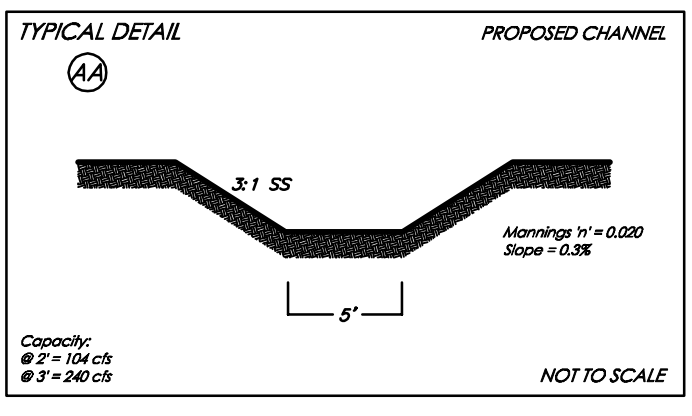

Total Site Existing
Area = 51 acres
CN = 88
Tc = 82 min

Q ₂	= 51 cfs
Q ₅	= 72 cfs
Q ₁₀	= 87 cfs
Q ₂₅	= 105 cfs
Q ₁₀₀	= 141 cfs

RESERVE B Lower Detention (Bottom = 1327.0)

STAGE	INFLOW	OUTFLOW	ELEVATION
2 yr	57 cfs	11 cfs	1329.4
5 yr	77 cfs	25 cfs	1329.8
10 yr	92 cfs	34 cfs	1330.1
25 yr	114 cfs	52 cfs	1330.5
100 yr	158 cfs	93 cfs	1331.4

PROPOSED POND

ELEVATION	AREA (sq ft)
1327	4000
1328	61000
1329	126000
1330	135000
1331	143000
1332	152000

Basin B
Developed Basin B
Area = 12 acres
CN = 91
Tc = 15 min

Q ₂	= 38 cfs
Q ₅	= 51 cfs
Q ₁₀	= 60 cfs
Q ₂₅	= 72 cfs
Q ₁₀₀	= 94 cfs

- FH ⊕ = Fire Hydrant
- GP ⊙ = Guy Pole
- Guy ⊙ = Guy Anchor
- MB ⊙ = Mail Box
- PM ⊙ = Pipeline Marker
- PP ⊙ = Power Pole
- Sign ⊙ = Sign
- SSMH ⊙ = Sanitary Sewer Manhole
- ATT Pad ⊙ = ATT Pedestal
- WM ⊙ = Water Meter
- WV ⊙ = Water Valve

- WTR --- WATER LINE
- AT&T --- SOUTHWESTERN BELL
- CAS --- CABLE TV
- GAS --- GAS
- CoTV --- COAXIAL TV
- FENCE --- FENCE
- OHE --- OVERHEAD ELECTRIC LINE
- EXSS --- SANITARY SEWER
- UGE --- UNDERGROUND ELECTRIC LINE
- PIPELINE --- PIPELINE



OWNER:
JOHN E. DUGAN FAMILY PARTNERSHIP, L.P.
ATTN: JOHN DUGAN
2416 MORNING DEW
WICHITA, KS 67205
316-721-2416

LEGAL DESCRIPTION:
BEGINNING AT A POINT ON THE EAST LINE OF SECTION 6, TOWNSHIP 28 SOUTH, RANGE 1 WEST OF THE SIXTH PRINCIPAL MERIDIAN, SEDGWICK COUNTY, KANSAS, A DISTANCE OF 30 FEET NORTH OF THE SOUTHWEST CORNER OF SAID SECTION; THENCE GOING NORTHERLY ALONG THE EAST LINE OF THE SECTION, A DISTANCE OF 867.8 FEET; THENCE TURNING LEFT AND GOING WESTERLY TO THE HALF SECTION LINE AT A POINT 880.6 FEET NORTH OF THE SOUTH QUARTER CORNER OF THE SECTION; THENCE TURNING LEFT AND GOING SOUTHERLY 880.6 FEET; THENCE TURNING LEFT AND GOING PARALLEL TO THE SOUTH SECTION LINE TO THE POINT OF BEGINNING.

BENCHMARK:
MAIZE ROAD & 31ST SOUTH—CITY OF WICHITA BENCHMARK DISC.
200 ± WEST OF INTERSECTION, SOUTHWEST CORNER OF HUBBARD OF R.C.B.C.
ELEV. = 1331.82 NGVD88

DRAINAGE PLAN

SKYWAY WEST 3RD ADDITION

25 OCT 11

Baughman Company, P.A.
315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149
ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

E:\PROJECTS\SKYWAYWEST2ND\SKYWAY2NDAND3RD.P.DWG-RKR

SUPPORTING CALCULATIONS


APPENDIX A: USGS Soils Survey

APPENDIX B : HydraFlow Hydrographs
Site Flow and Pond Routing

APPENDIX C : HydraFlow Express
Channel Sections AA & BB

USGS Soils Survey

Hydrologic Soil Group—Sedgwick County, Kansas
(Skyway West)

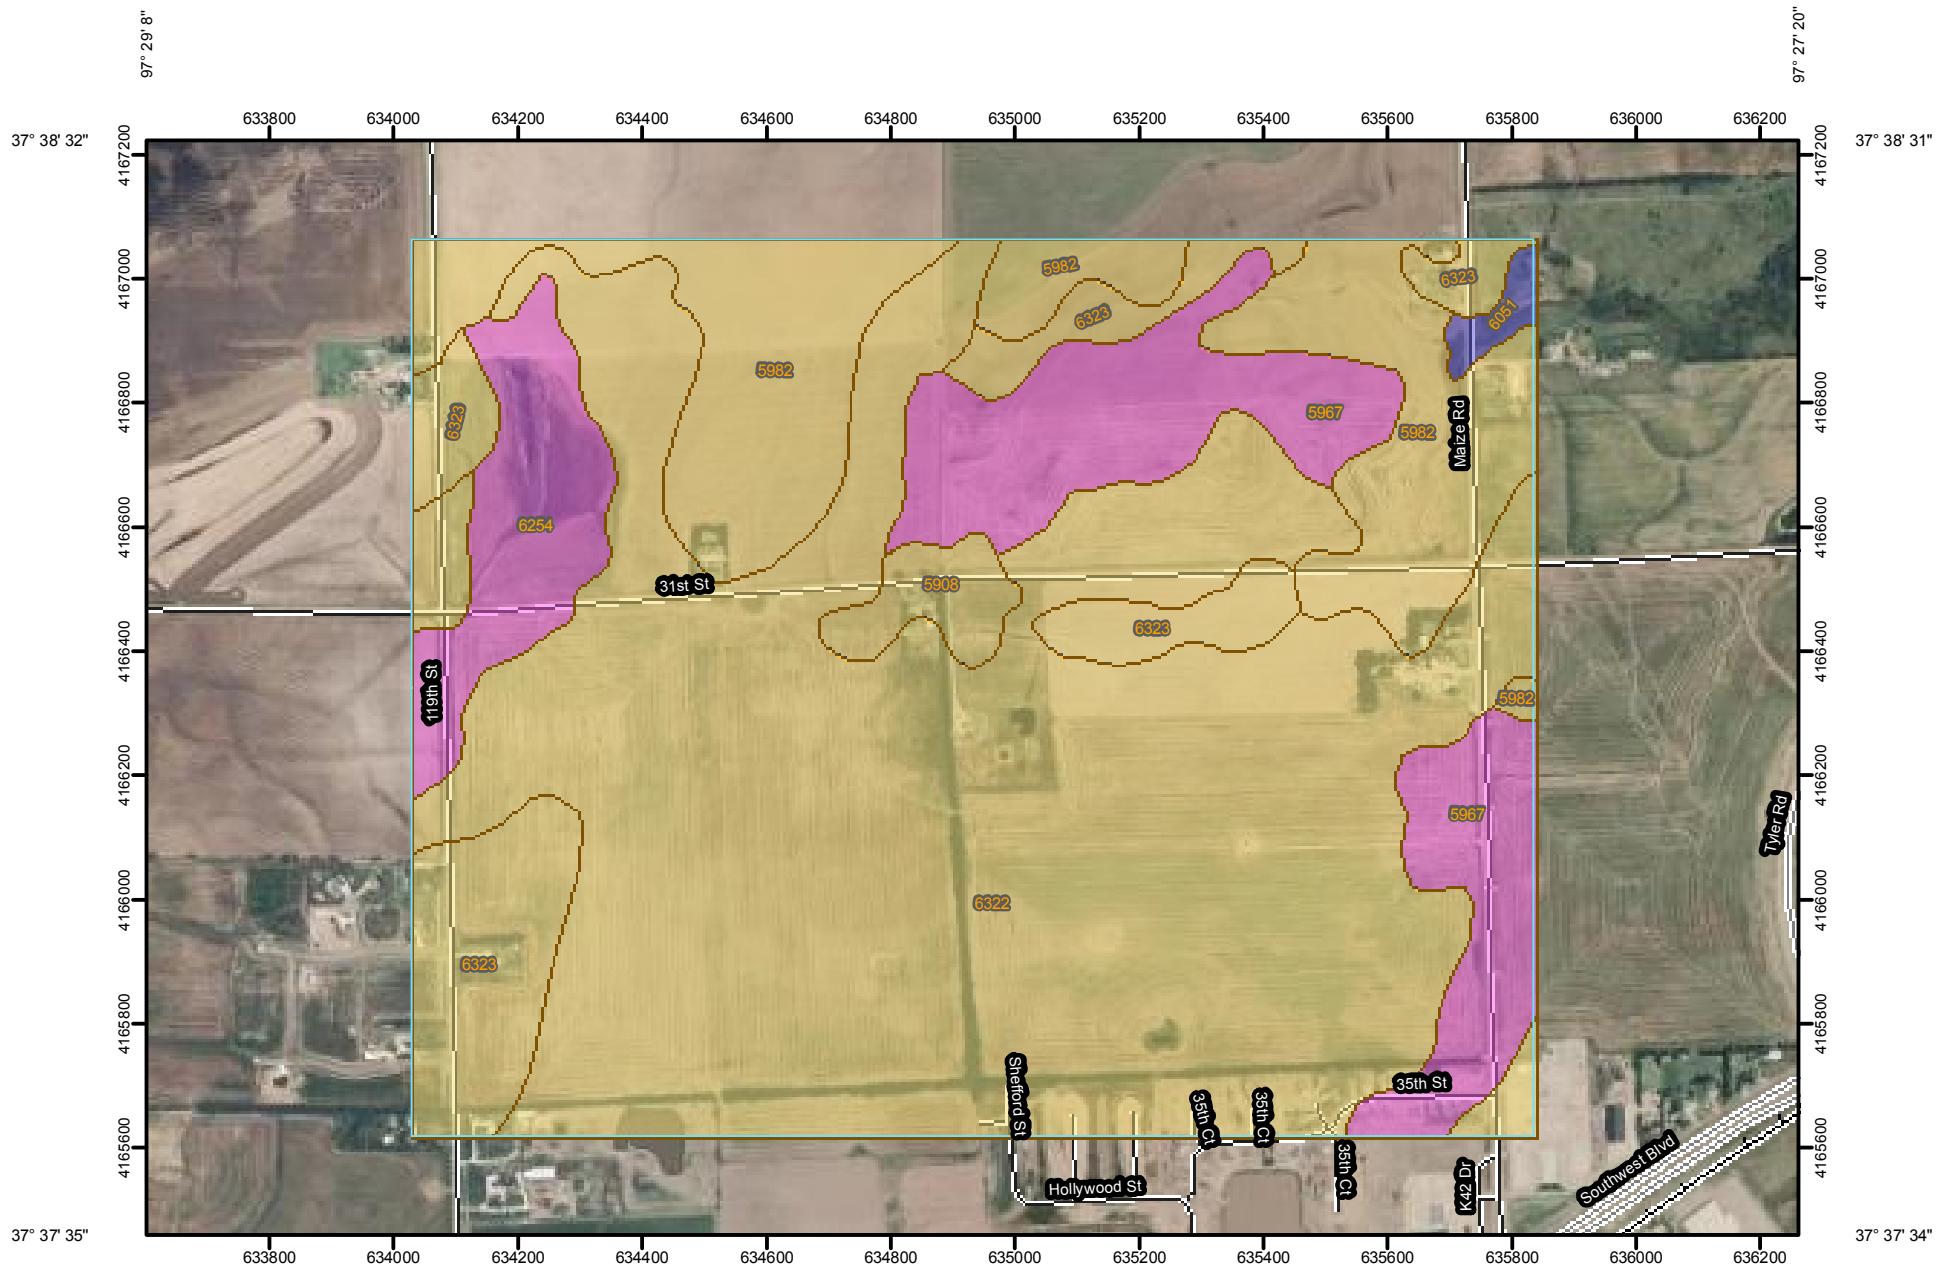

97° 29' 9"




Map Scale: 1:12,600 if printed on A size (8.5" x 11") sheet.



97° 27' 21"

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Units

Soil Ratings

 A

 A/D


 B

 B/D

 C

 C/D

 D

 Not rated or not available

Political Features

 Cities

Water Features

 Streams and Canals


Transportation

 Rails

 Interstate Highways

 US Routes

 Major Roads

 Local Roads

MAP INFORMATION

Map Scale: 1:12,600 if printed on A size (8.5" × 11") sheet.

The soil surveys that comprise your AOI were mapped at 1:24,000.

Please rely on the bar scale on each map sheet for accurate map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
Coordinate System: UTM Zone 14N NAD83

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Sedgwick County, Kansas
Survey Area Data: Version 7, Nov 30, 2010

Date(s) aerial images were photographed: 6/30/2006

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Hydrologic Soil Group— Summary by Map Unit — Sedgwick County, Kansas (KS173)				
Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
5908	Nalim loam, 0 to 1 percent slopes	C	9.9	1.5%
5967	Tabler silty clay loam, 0 to 1 percent slopes	D	70.5	10.9%
5982	Nalim loam, 1 to 3 percent slopes	C	95.7	14.8%
6051	Elandco silt loam, frequently flooded	B	3.4	0.5%
6254	Waurika silt loam, 0 to 1 percent slopes	D	30.6	4.7%
6322	Blanket silt loam, 0 to 1 percent slopes	C	378.2	58.7%
6323	Blanket silt loam, 1 to 3 percent slopes	C	56.3	8.7%
Totals for Area of Interest			644.6	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Aggregation is the process by which a set of component attribute values is reduced to a single value that represents the map unit as a whole.

A map unit is typically composed of one or more "components". A component is either some type of soil or some nonsoil entity, e.g., rock outcrop. For the attribute being aggregated, the first step of the aggregation process is to derive one attribute value for each of a map unit's components. From this set of component attributes, the next step of the aggregation process derives a single value that represents the map unit as a whole. Once a single value for each map unit is derived, a thematic map for soil map units can be rendered. Aggregation must be done because, on any soil map, map units are delineated but components are not.

For each of a map unit's components, a corresponding percent composition is recorded. A percent composition of 60 indicates that the corresponding component typically makes up approximately 60% of the map unit. Percent composition is a critical factor in some, but not all, aggregation methods.

The aggregation method "Dominant Condition" first groups like attribute values for the components in a map unit. For each group, percent composition is set to the sum of the percent composition of all components participating in that group. These groups now represent "conditions" rather than components. The attribute value associated with the group with the highest cumulative percent composition is returned. If more than one group shares the highest cumulative percent composition, the corresponding "tie-break" rule determines which value should be returned. The "tie-break" rule indicates whether the lower or higher group value should be returned in the case of a percent composition tie.

The result returned by this aggregation method represents the dominant condition throughout the map unit only when no tie has occurred.

Component Percent Cutoff: None Specified

Components whose percent composition is below the cutoff value will not be considered. If no cutoff value is specified, all components in the database will be considered. The data for some contrasting soils of minor extent may not be in the database, and therefore are not considered.

Tie-break Rule: Higher


The tie-break rule indicates which value should be selected from a set of multiple candidate values, or which value should be selected in the event of a percent composition tie.

HydraFlow Hydrographs

Site Flow & Pond Routing

Watershed Model Schematic

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

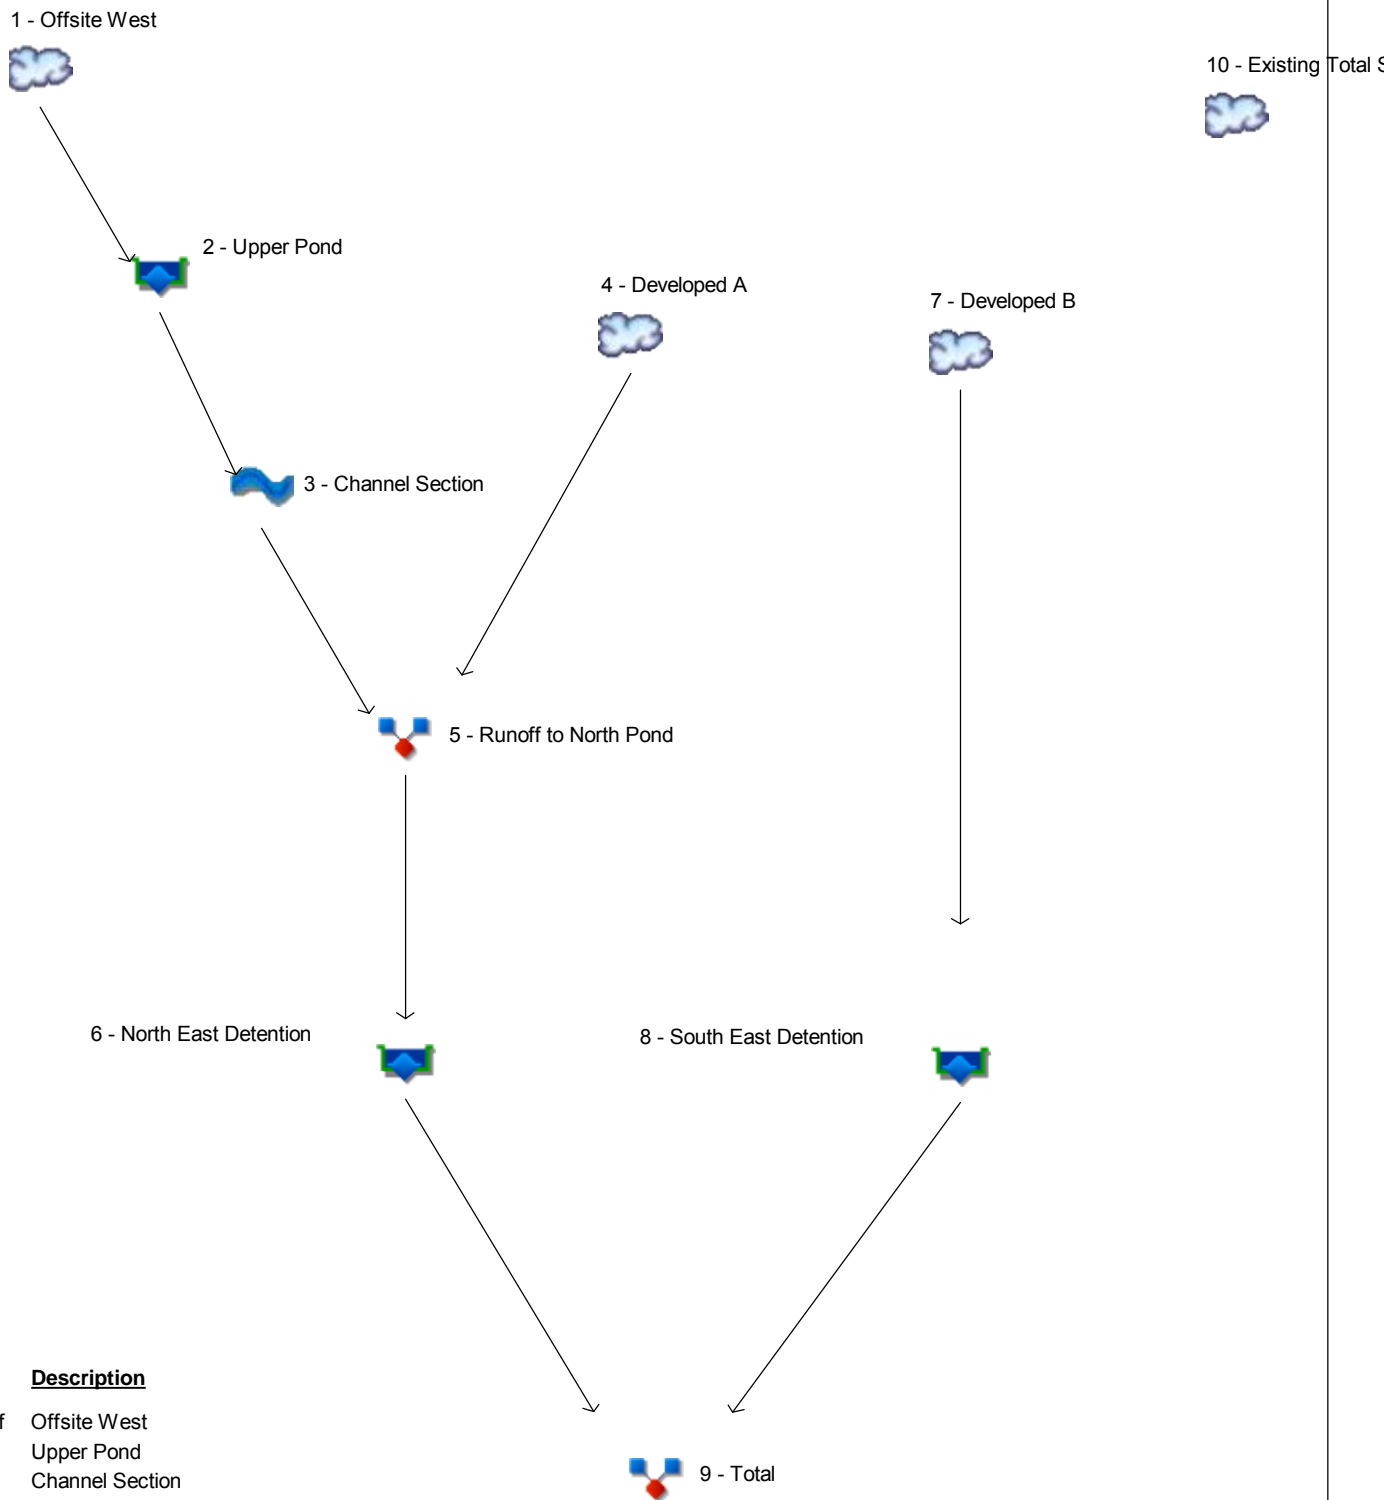

Legend

Hyd.	Origin	Description
1	SCS Runoff	Offsite West
2	Reservoir	Upper Pond
3	Reach	Channel Section
4	SCS Runoff	Developed A
5	Combine	Runoff to North Pond
6	Reservoir	North East Detention
7	SCS Runoff	Developed B
8	Reservoir	South East Detention
9	Combine	Total
10	SCS Runoff	Existing Total Site

Hydrograph Return Period Recap

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Inflow hyd(s)	Peak Outflow (cfs)								Hydrograph Description
			1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr	
1	SCS Runoff	-----	26.59	40.42	2.273	61.50	76.81	96.96	115.08	135.59	Offsite West
2	Reservoir	1	1.759	6.231	0.118	12.93	23.63	40.51	56.49	75.04	Upper Pond
3	Reach	2	1.755	6.186	0.117	12.80	23.08	39.78	55.62	74.12	Channel Section
4	SCS Runoff	-----	42.26	56.56	11.05	77.01	91.26	109.51	125.64	143.72	Developed A
5	Combine	3, 4	42.35	56.76	11.05	77.32	91.75	113.88	133.41	157.57	Runoff to North Pond
6	Reservoir	5	3.542	10.62	0.408	24.76	35.67	51.88	67.16	92.76	North East Detention
7	SCS Runoff	-----	28.21	37.58	7.548	50.93	60.22	72.11	82.62	94.39	Developed B
8	Reservoir	7	0.379	1.077	0.123	2.932	4.632	6.171	7.182	8.217	South East Detention
9	Combine	6, 8	3.913	11.59	0.530	27.66	40.26	57.96	74.27	100.86	Total
10	SCS Runoff	-----	19.57	29.94	1.807	45.85	57.44	72.65	86.36	101.89	Existing Total Site

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	26.59	2	742	147,889	-----	-----	-----	Offsite West	
2	Reservoir	1.759	2	980	129,902	1	1335.46	99,792	Upper Pond	
3	Reach	1.755	2	994	129,808	2	-----	-----	Channel Section	
4	SCS Runoff	42.26	2	736	205,337	-----	-----	-----	Developed A	
5	Combine	42.35	2	736	335,145	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	3.542	2	990	271,696	5	1329.20	144,711	North East Detention	
7	SCS Runoff	28.21	2	722	80,082	-----	-----	-----	Developed B	
8	Reservoir	0.379	2	1272	69,601	7	1327.98	63,931	South East Detention	
9	Combine	3.913	2	992	341,296	6, 8	-----	-----	Total	
10	SCS Runoff	19.57	2	780	203,232	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 1 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 26.59 cfs
Storm frequency	= 1 yrs	Time to peak	= 12.37 hrs
Time interval	= 2 min	Hyd. volume	= 147,889 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 2.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

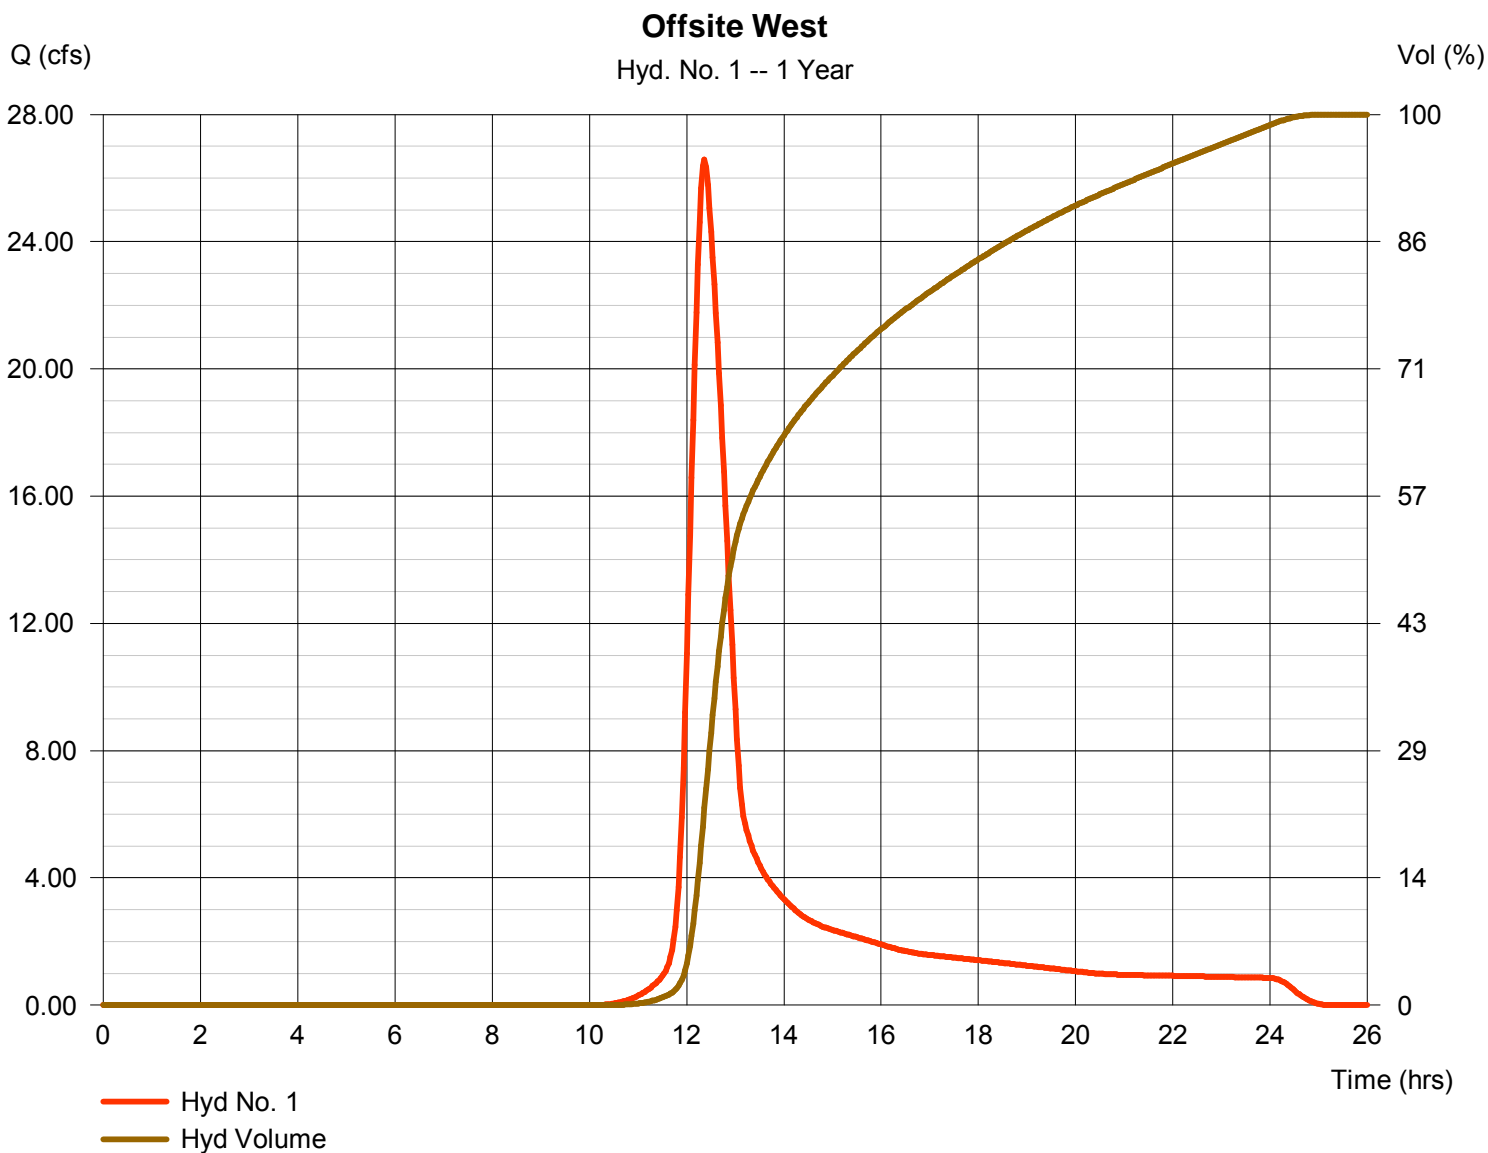

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 1.759 cfs
Storm frequency	= 1 yrs	Time to peak	= 16.33 hrs
Time interval	= 2 min	Hyd. volume	= 129,902 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1335.46 ft
Reservoir name	= Upper Pond	Max. Storage	= 99,792 cuft

Storage Indication method used.

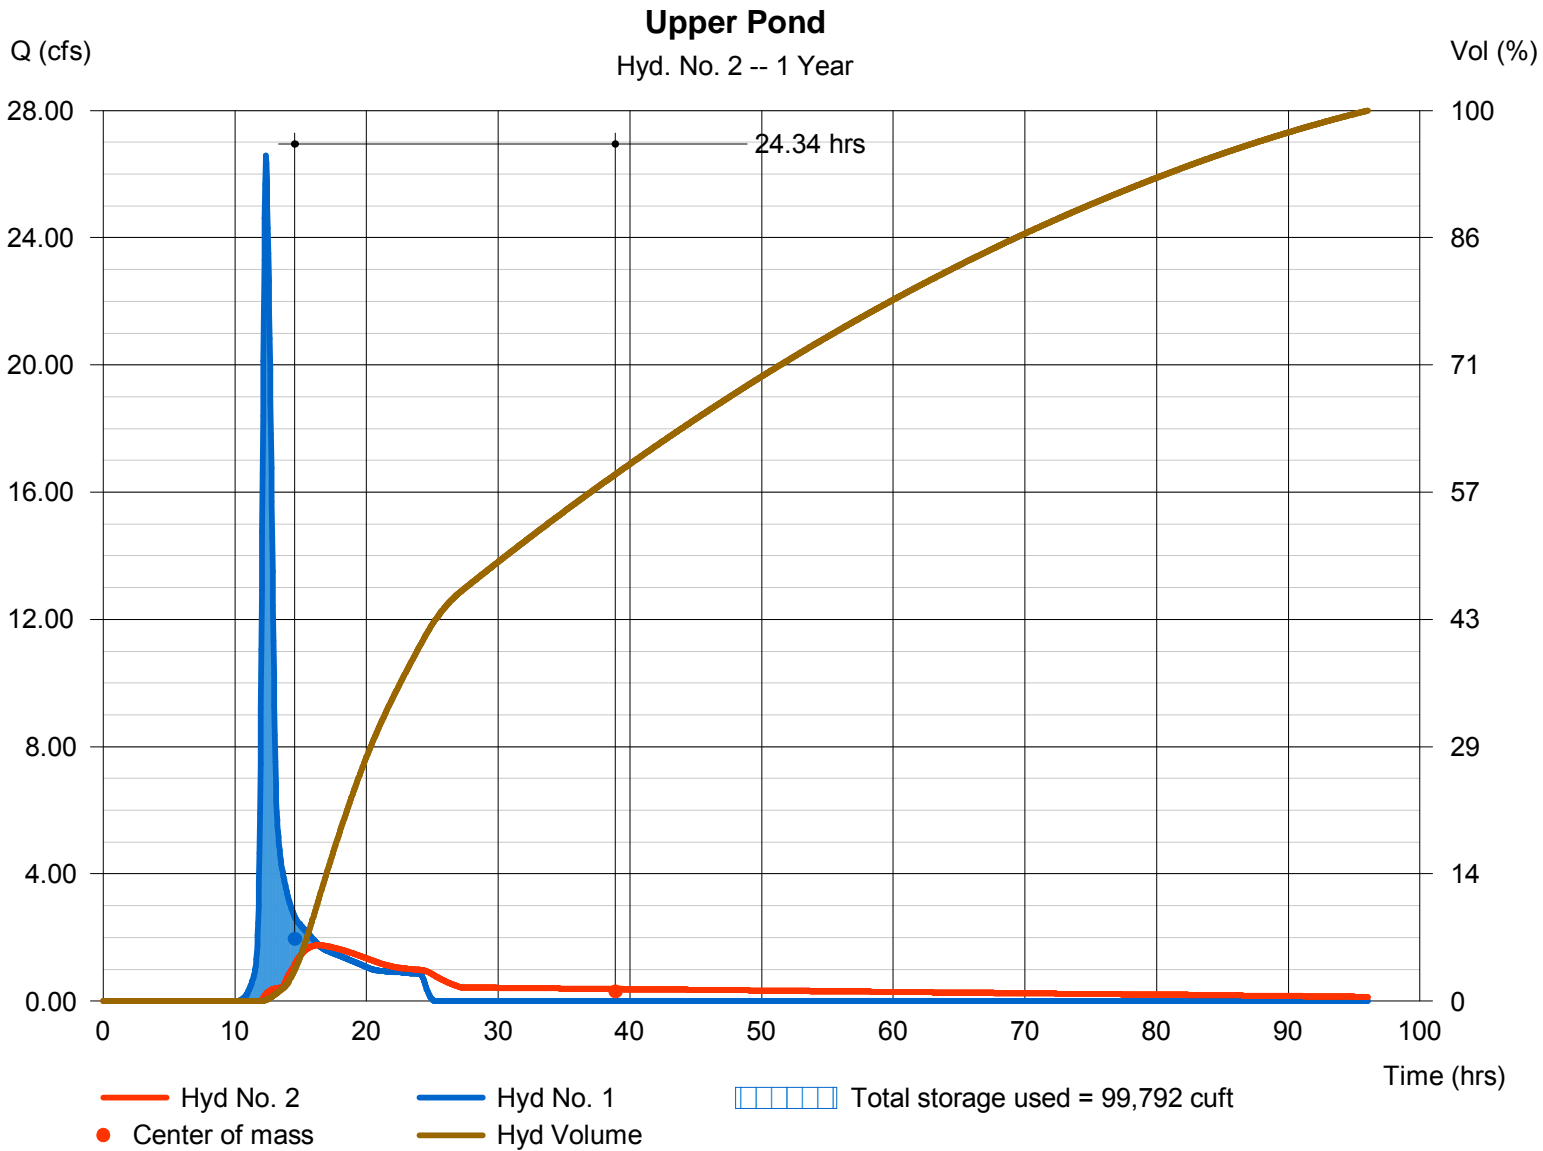

Pond No. 1 - Upper Pond

Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Beginning Elevation = 1334.00 ft

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	1334.00	64,000	0	0
1.00	1335.00	69,000	66,478	66,478
2.00	1336.00	75,000	71,972	138,450
3.00	1337.00	81,000	77,973	216,423
4.00	1338.00	87,000	83,974	300,396
5.00	1339.00	93,000	89,974	390,371


Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 24.00	4.00	0.00	0.00
Span (in)	= 24.00	4.00	0.00	0.00
No. Barrels	= 1	1	0	0
Invert El. (ft)	= 1334.00	1334.00	0.00	0.00
Length (ft)	= 50.00	0.00	0.00	0.00
Slope (%)	= 0.50	0.00	0.00	n/a
N-Value	= .013	.013	.013	n/a
Orifice Coeff.	= 0.60	0.60	0.60	0.60
Multi-Stage	= n/a	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 6.00	10.00	0.00	0.00
Crest El. (ft)	= 1335.30	1336.50	0.00	0.00
Weir Coeff.	= 3.33	2.60	3.33	3.33
Weir Type	= 1	Broad	---	---
Multi-Stage	= Yes	No	No	No
Exfil.(in/hr)	= 0.000 (by Wet area)			
TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

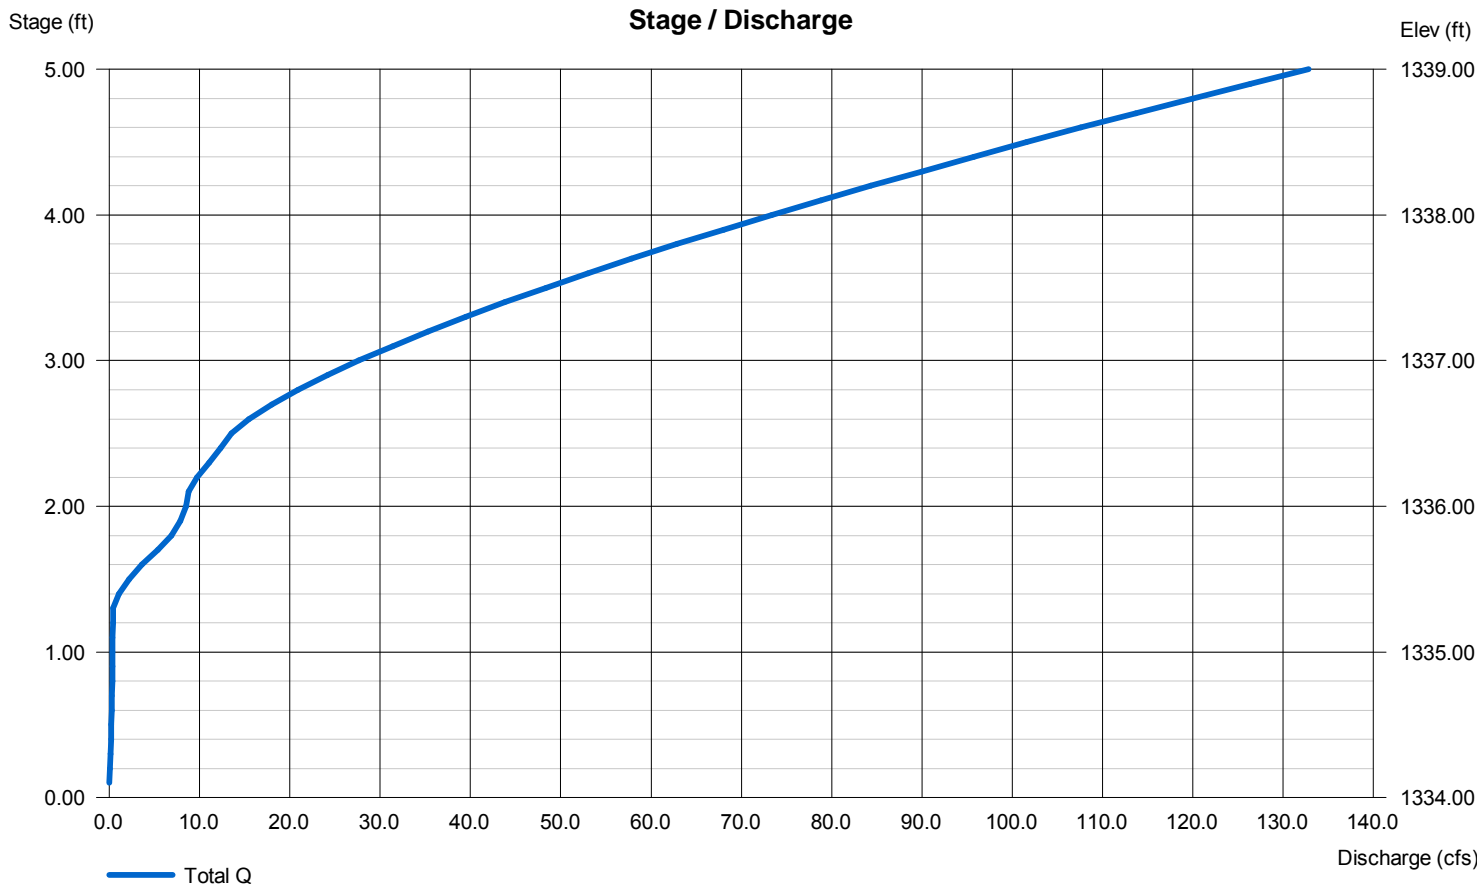

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 1.755 cfs
Storm frequency	= 1 yrs	Time to peak	= 16.57 hrs
Time interval	= 2 min	Hyd. volume	= 129,808 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.1678

Modified Att-Kin routing method used.

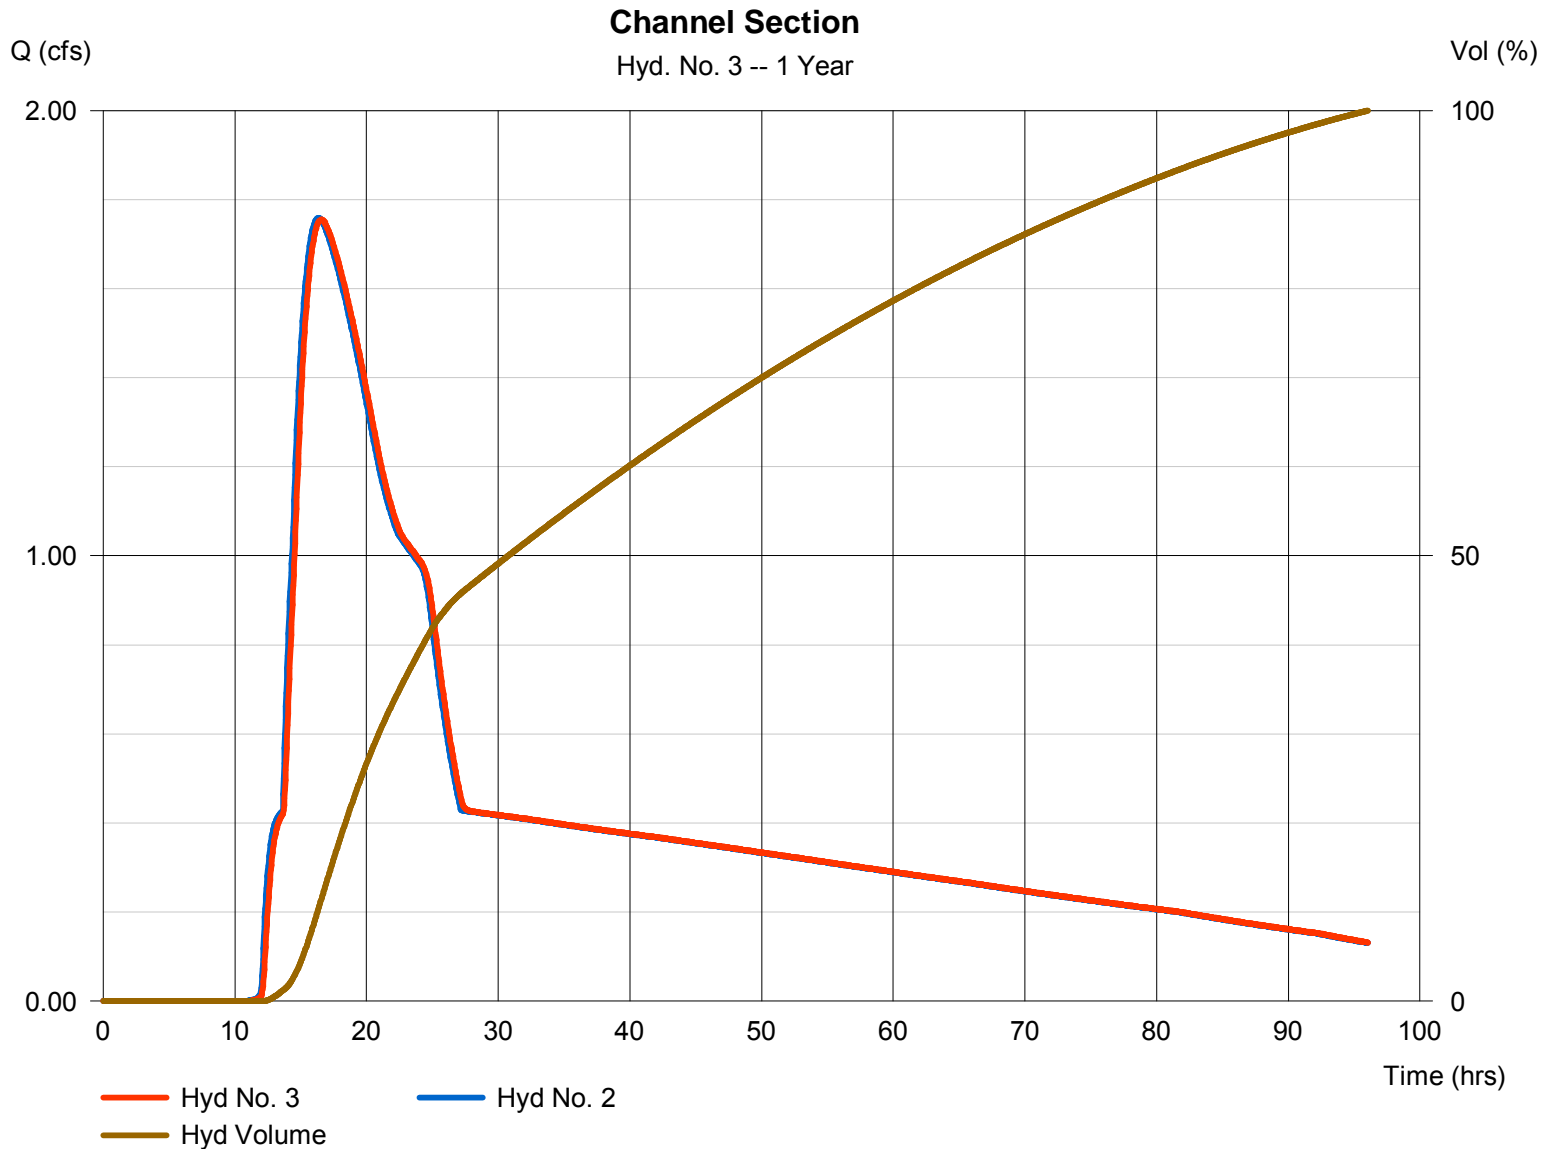

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 42.26 cfs
Storm frequency	= 1 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 205,337 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 2.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

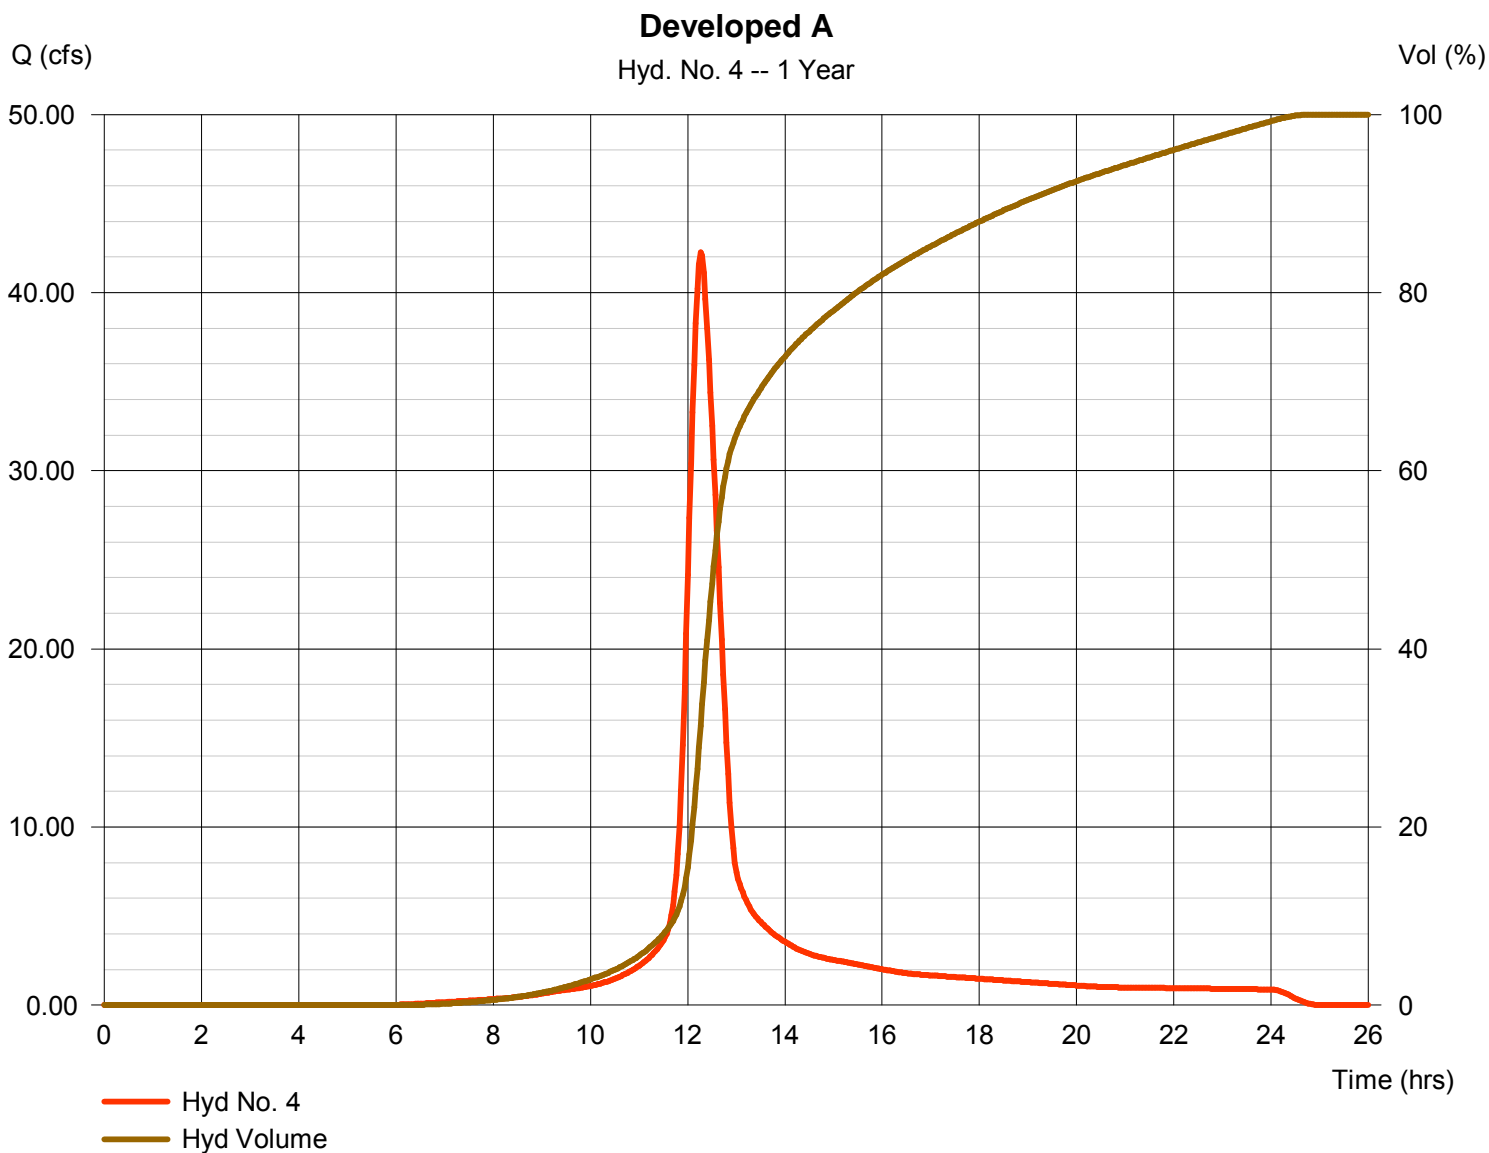

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 5

Runoff to North Pond

Hydrograph type	= Combine	Peak discharge	= 42.35 cfs
Storm frequency	= 1 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 335,145 cuft
Inflow hyds.	= 3, 4	Contrib. drain. area	= 30.000 ac

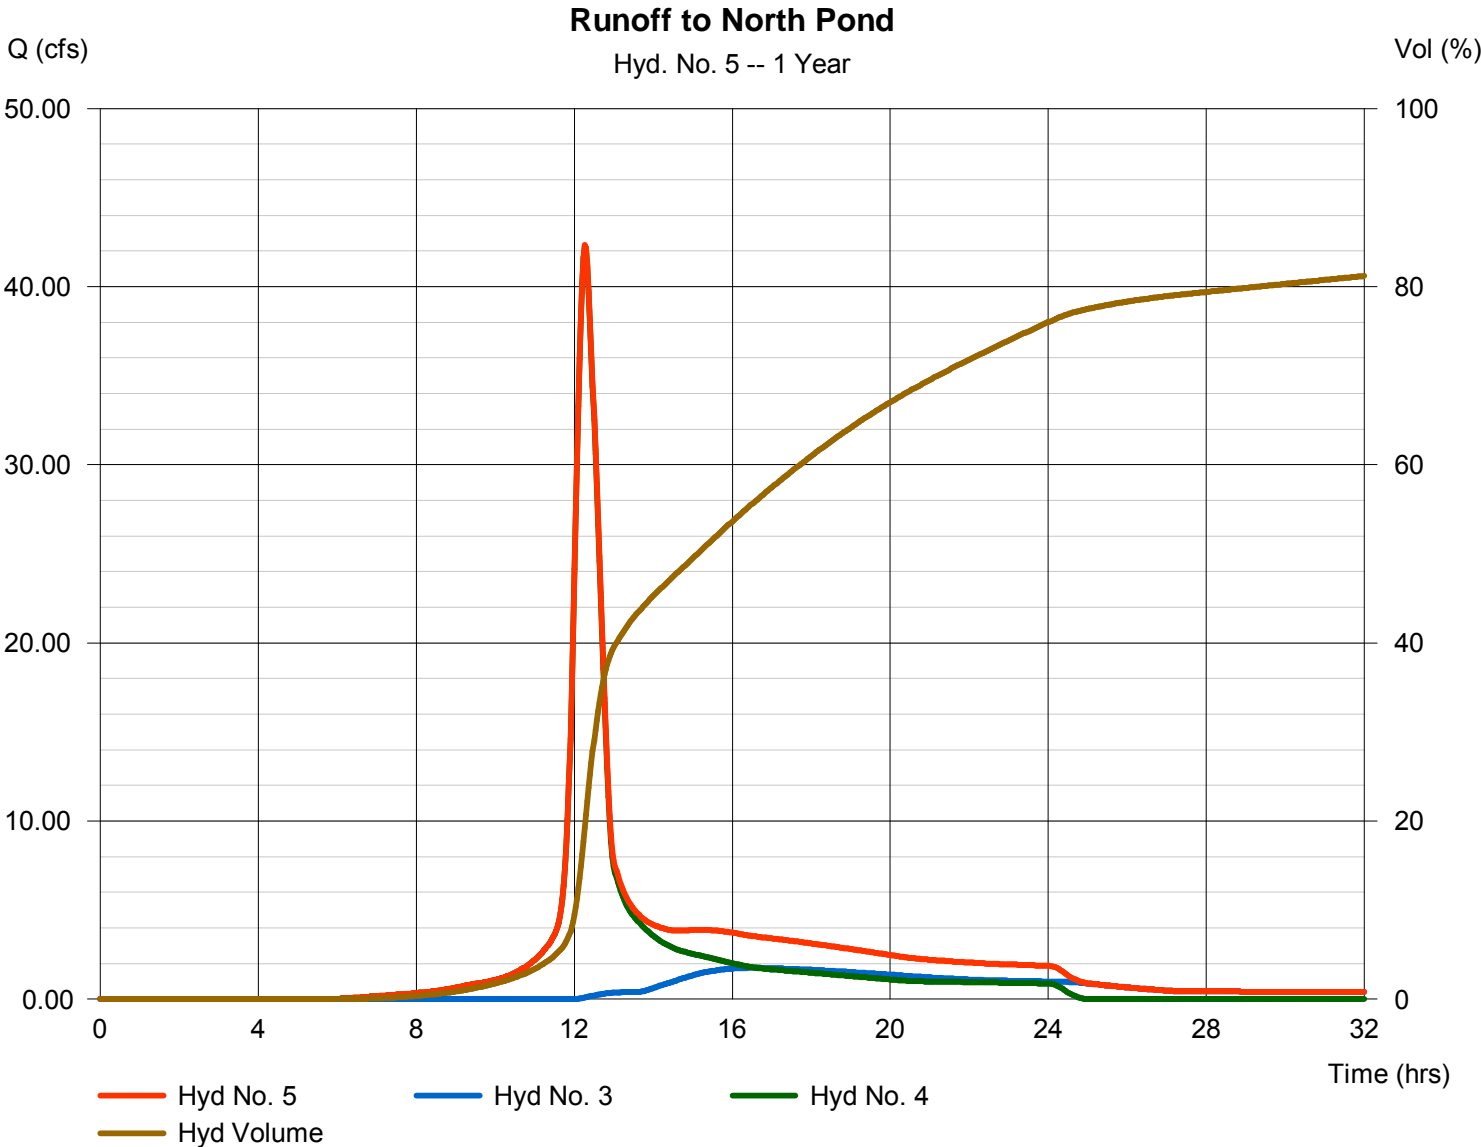

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 3.542 cfs
Storm frequency	= 1 yrs	Time to peak	= 16.50 hrs
Time interval	= 2 min	Hyd. volume	= 271,696 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1329.20 ft
Reservoir name	= North East Pond	Max. Storage	= 144,711 cuft

Storage Indication method used.

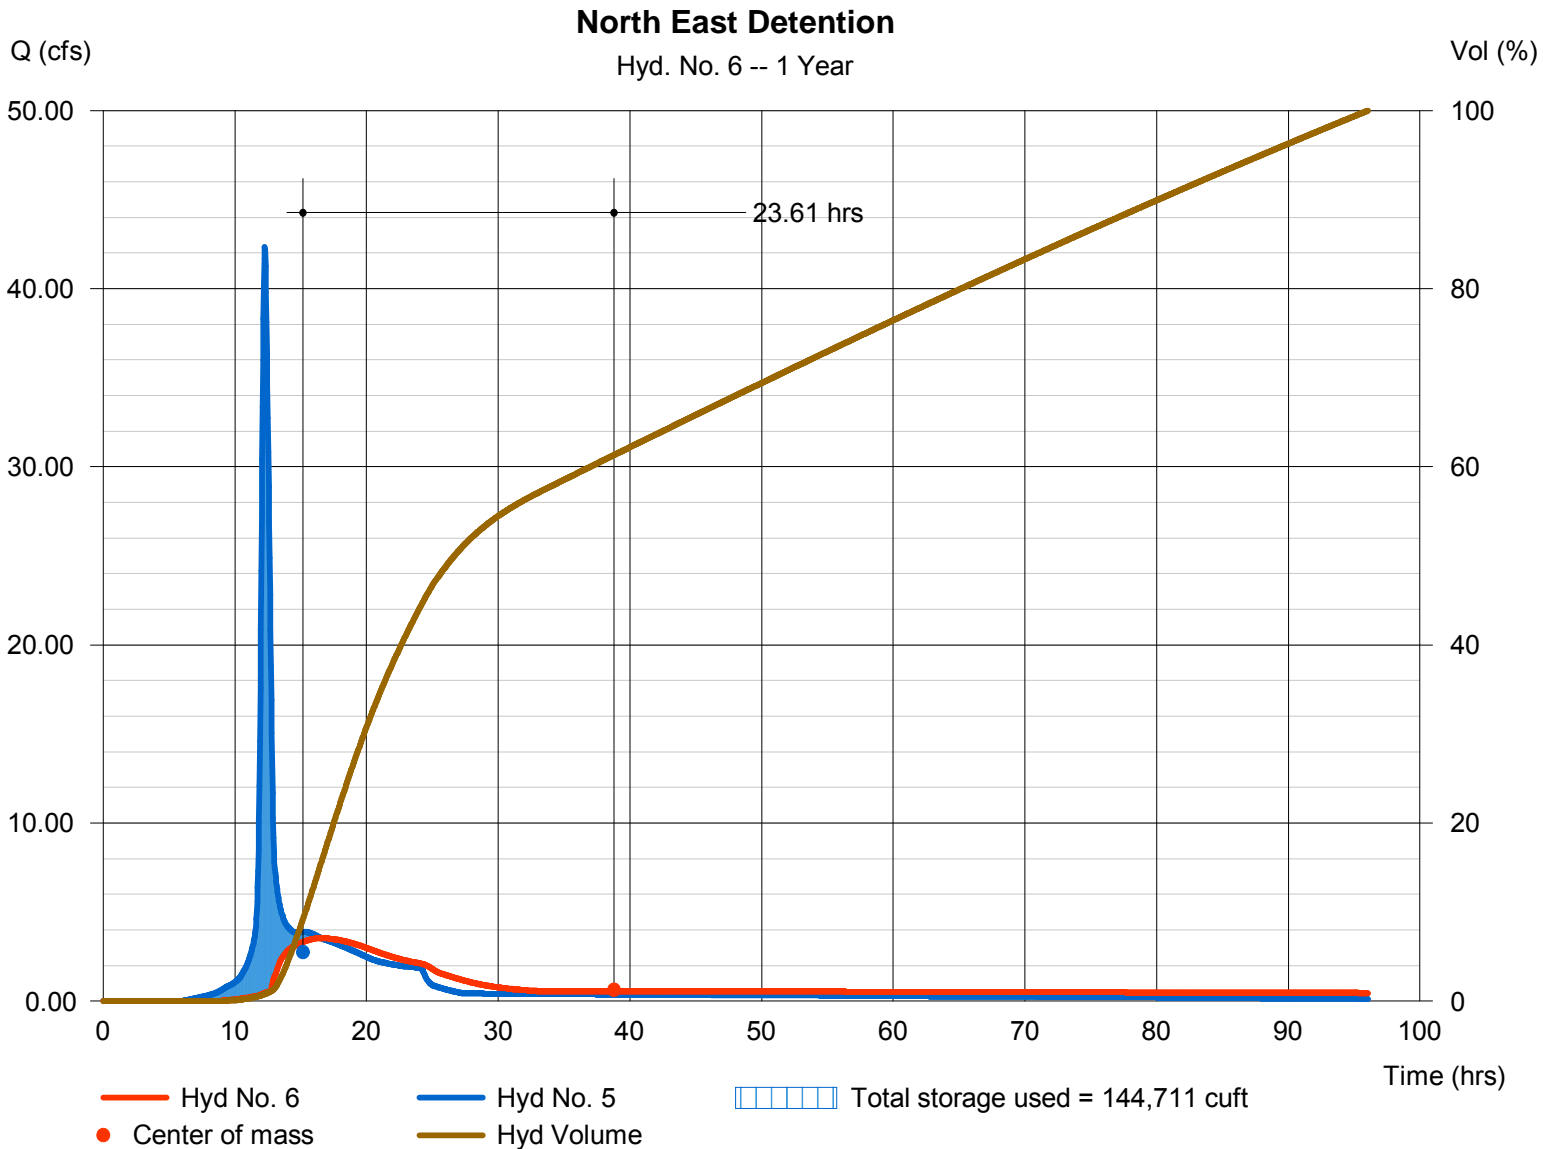

Pond No. 2 - North East Pond

Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Beginning Elevation = 1327.00 ft

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	1327.00	4,000	0	0
1.00	1328.00	61,000	26,871	26,871
2.00	1329.00	126,000	91,547	118,418
3.00	1330.00	135,000	130,461	248,879
4.00	1331.00	143,000	138,967	387,846
5.00	1332.00	152,000	147,462	535,309


Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 48.00	4.00	0.00	0.00
Span (in)	= 48.00	4.00	0.00	0.00
No. Barrels	= 1	1	0	0
Invert El. (ft)	= 1327.00	1327.00	0.00	0.00
Length (ft)	= 50.00	0.00	0.00	0.00
Slope (%)	= 0.50	0.00	0.00	n/a
N-Value	= .013	.013	.013	n/a
Orifice Coeff.	= 0.60	0.60	0.60	0.60
Multi-Stage	= n/a	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 10.00	5.00	0.00	0.00
Crest El. (ft)	= 1329.00	1329.50	0.00	0.00
Weir Coeff.	= 3.33	3.33	3.33	3.33
Weir Type	= 1	Rect	---	---
Multi-Stage	= Yes	No	No	No
Exfil.(in/hr)	= 0.000 (by Wet area)			
TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

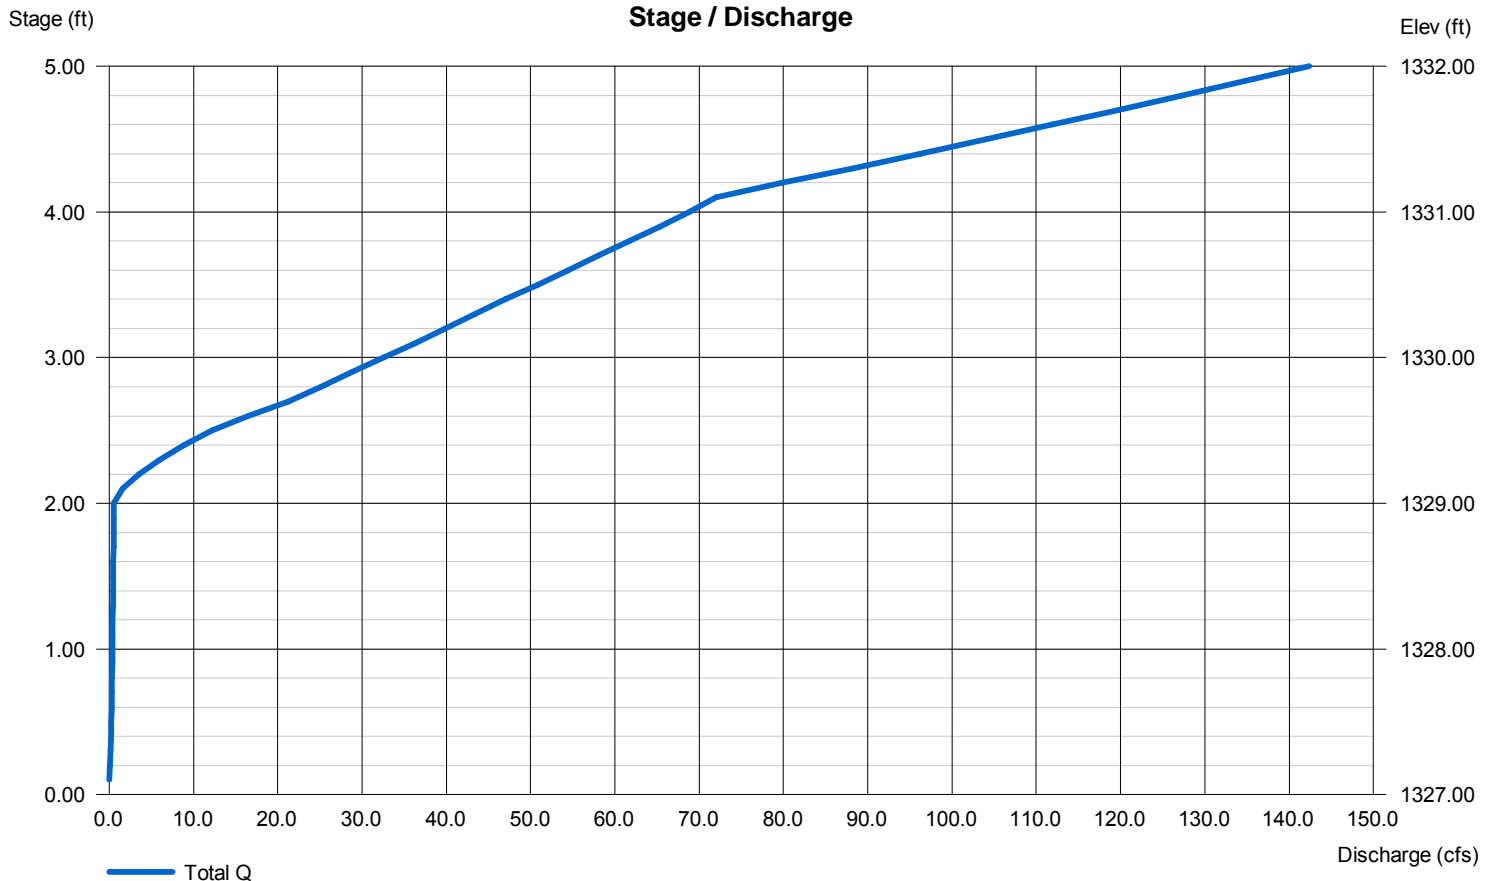

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 28.21 cfs
Storm frequency	= 1 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 80,082 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 2.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

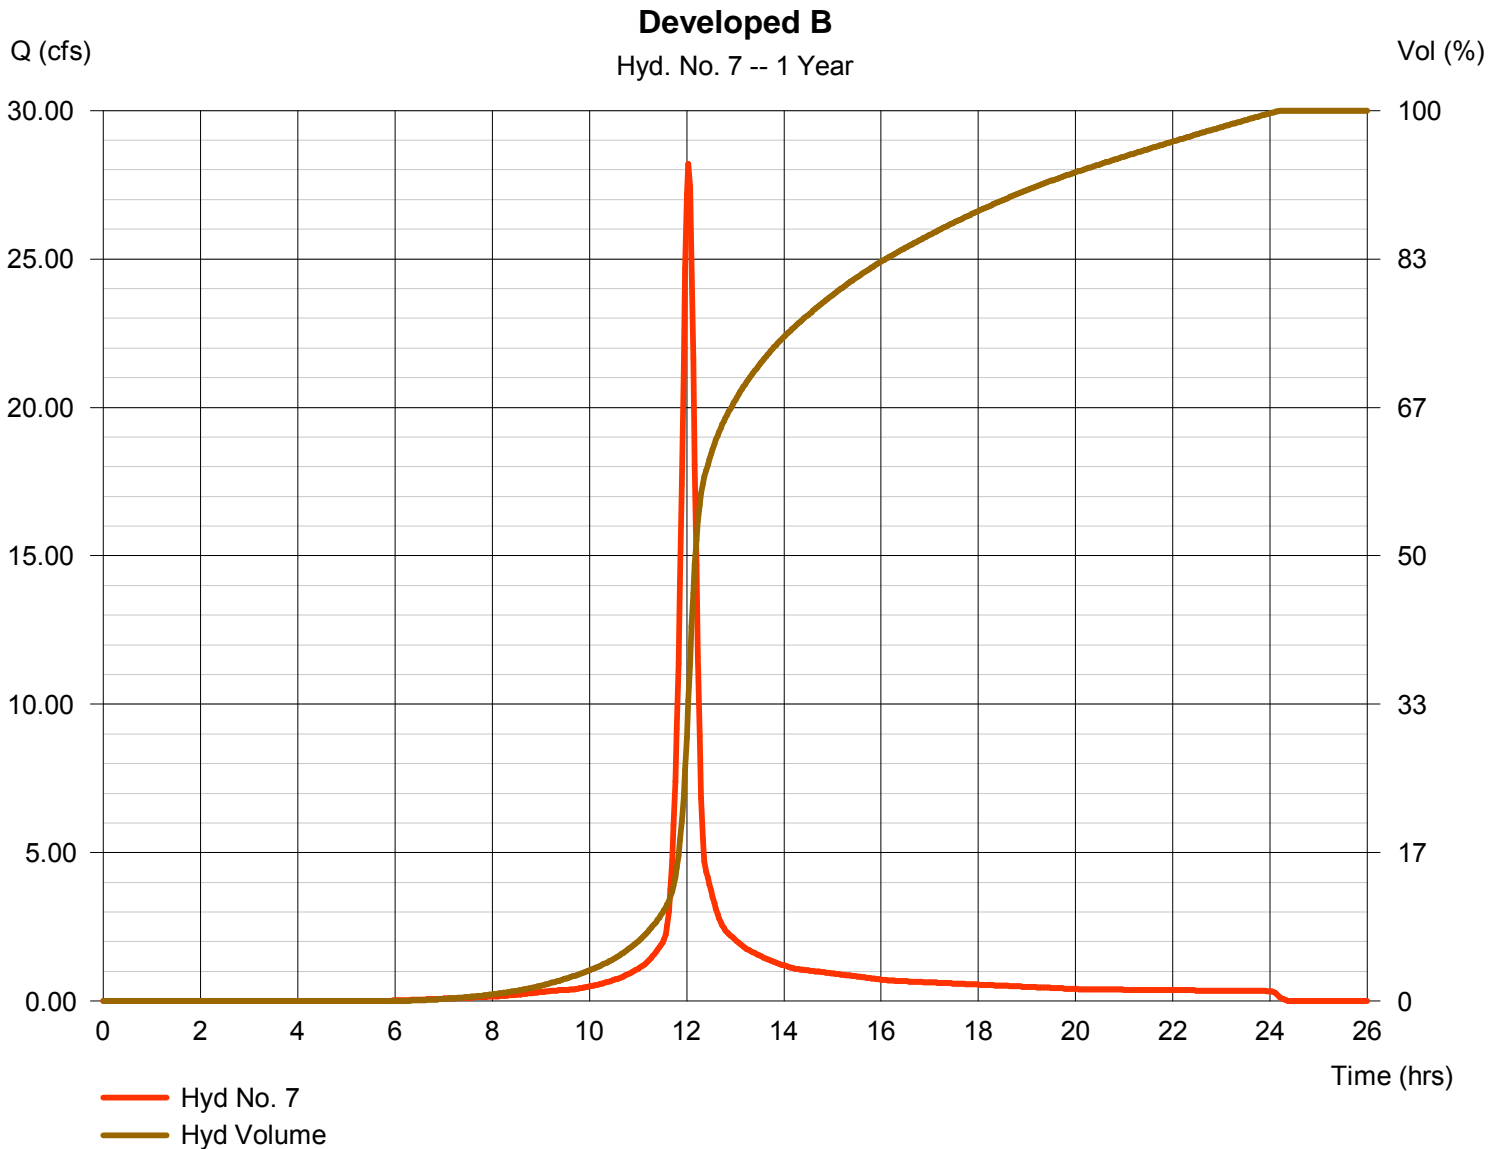

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 0.379 cfs
Storm frequency	= 1 yrs	Time to peak	= 21.20 hrs
Time interval	= 2 min	Hyd. volume	= 69,601 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1327.98 ft
Reservoir name	= South East Pond	Max. Storage	= 63,931 cuft

Storage Indication method used.

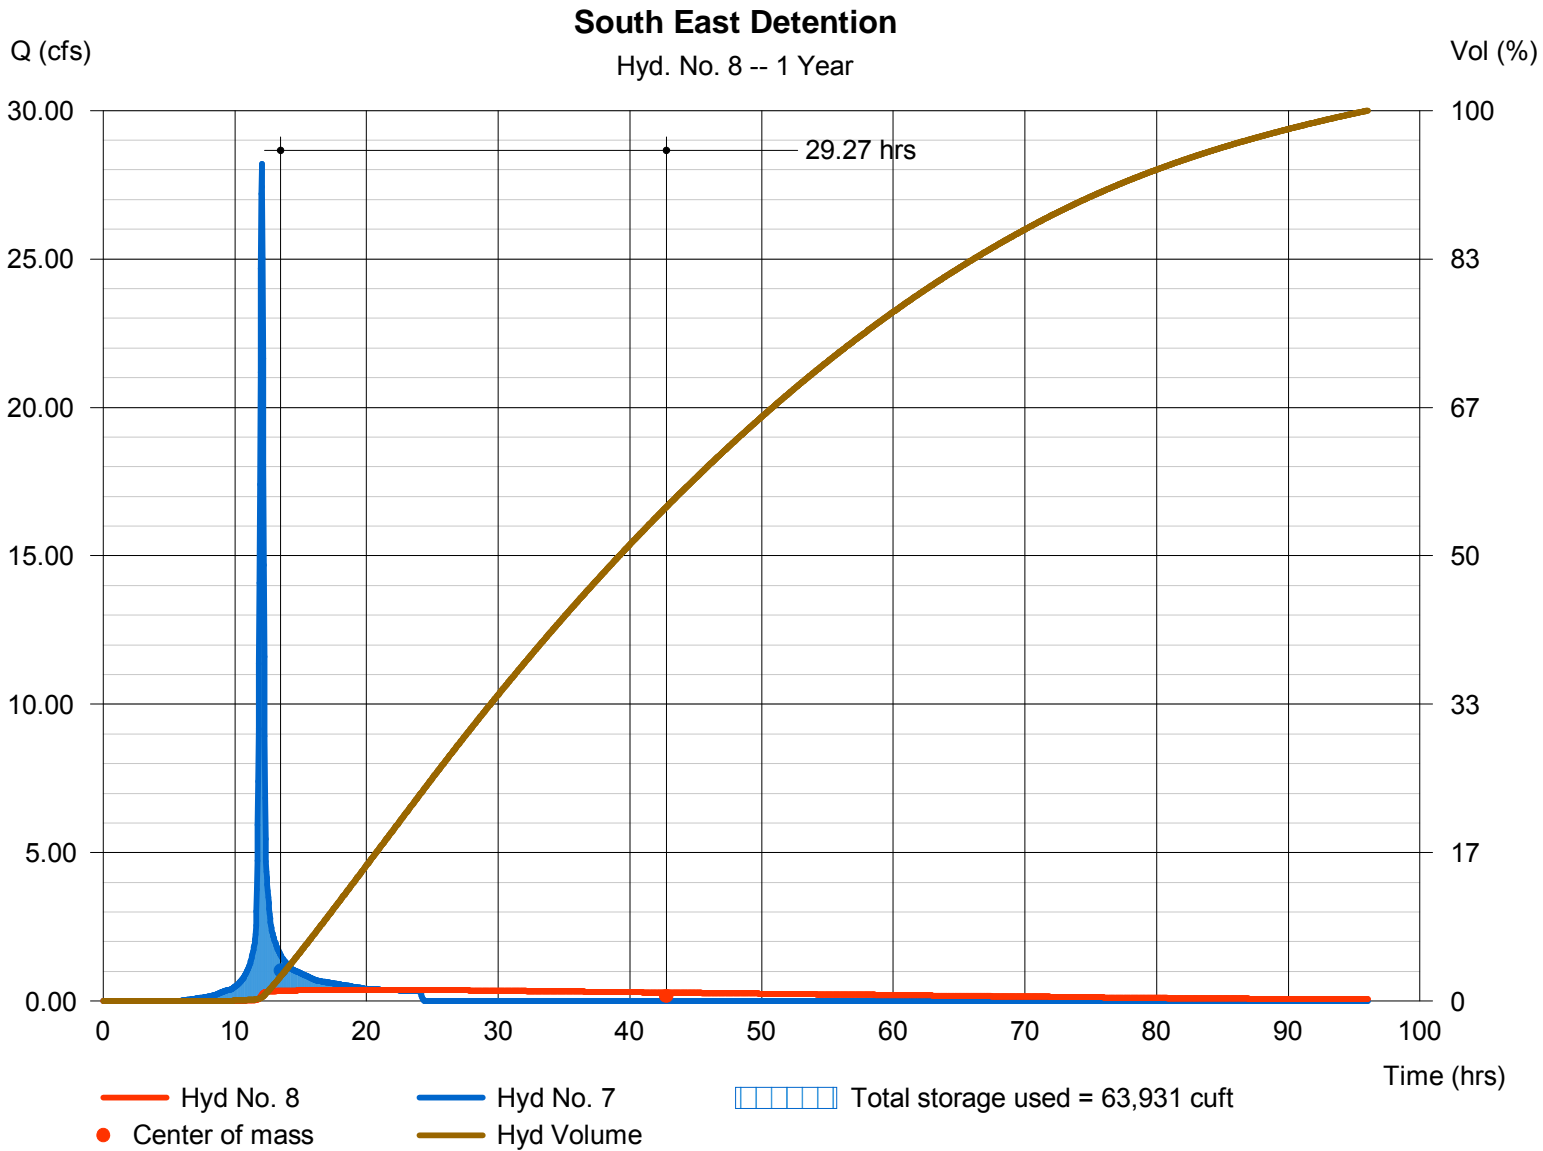

Pond No. 3 - South East Pond

Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Beginning Elevation = 1327.00 ft

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	1327.00	37,000	0	0
1.00	1328.00	98,000	65,066	65,066
2.00	1329.00	113,000	105,401	170,466
3.00	1330.00	120,000	116,471	286,937
4.00	1331.00	145,000	132,290	419,227


Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 24.00	4.00	0.00	0.00
Span (in)	= 24.00	4.00	0.00	0.00
No. Barrels	= 1	1	0	0
Invert El. (ft)	= 1327.00	1327.00	0.00	0.00
Length (ft)	= 30.00	0.00	0.00	0.00
Slope (%)	= 0.50	0.00	0.00	n/a
N-Value	= .013	.013	.013	n/a
Orifice Coeff.	= 0.60	0.60	0.60	0.60
Multi-Stage	= n/a	No	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 6.00	5.00	0.00	0.00
Crest El. (ft)	= 1328.00	1329.00	0.00	0.00
Weir Coeff.	= 2.60	3.33	3.33	3.33
Weir Type	= Broad	Rect	---	---
Multi-Stage	= Yes	No	No	No
Exfil.(in/hr)	= 0.000 (by Wet area)			
TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

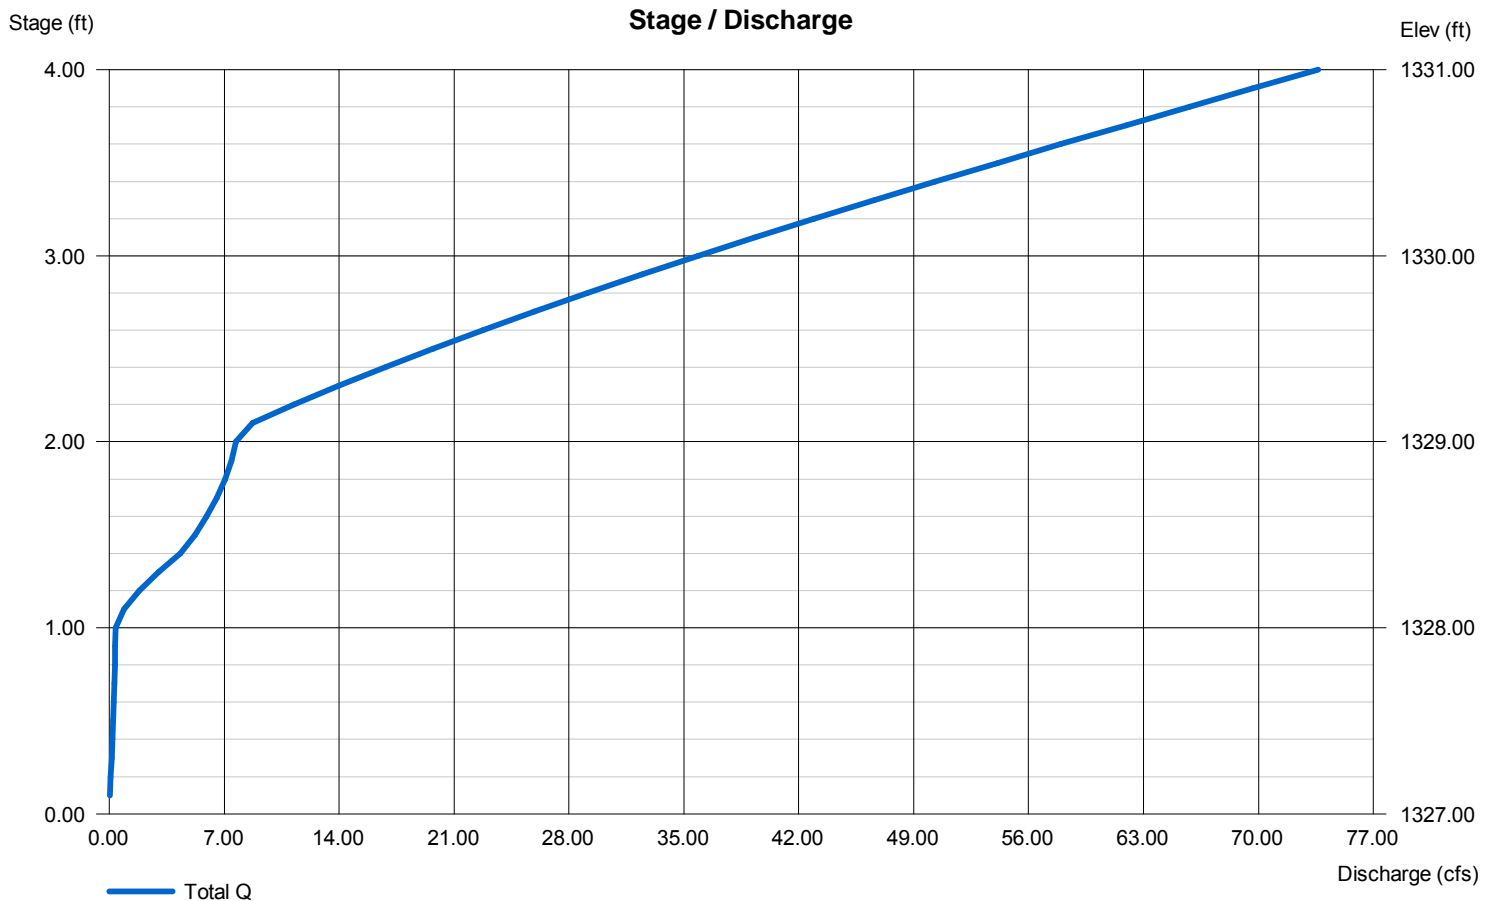

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 3.913 cfs
Storm frequency	= 1 yrs	Time to peak	= 16.53 hrs
Time interval	= 2 min	Hyd. volume	= 341,296 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

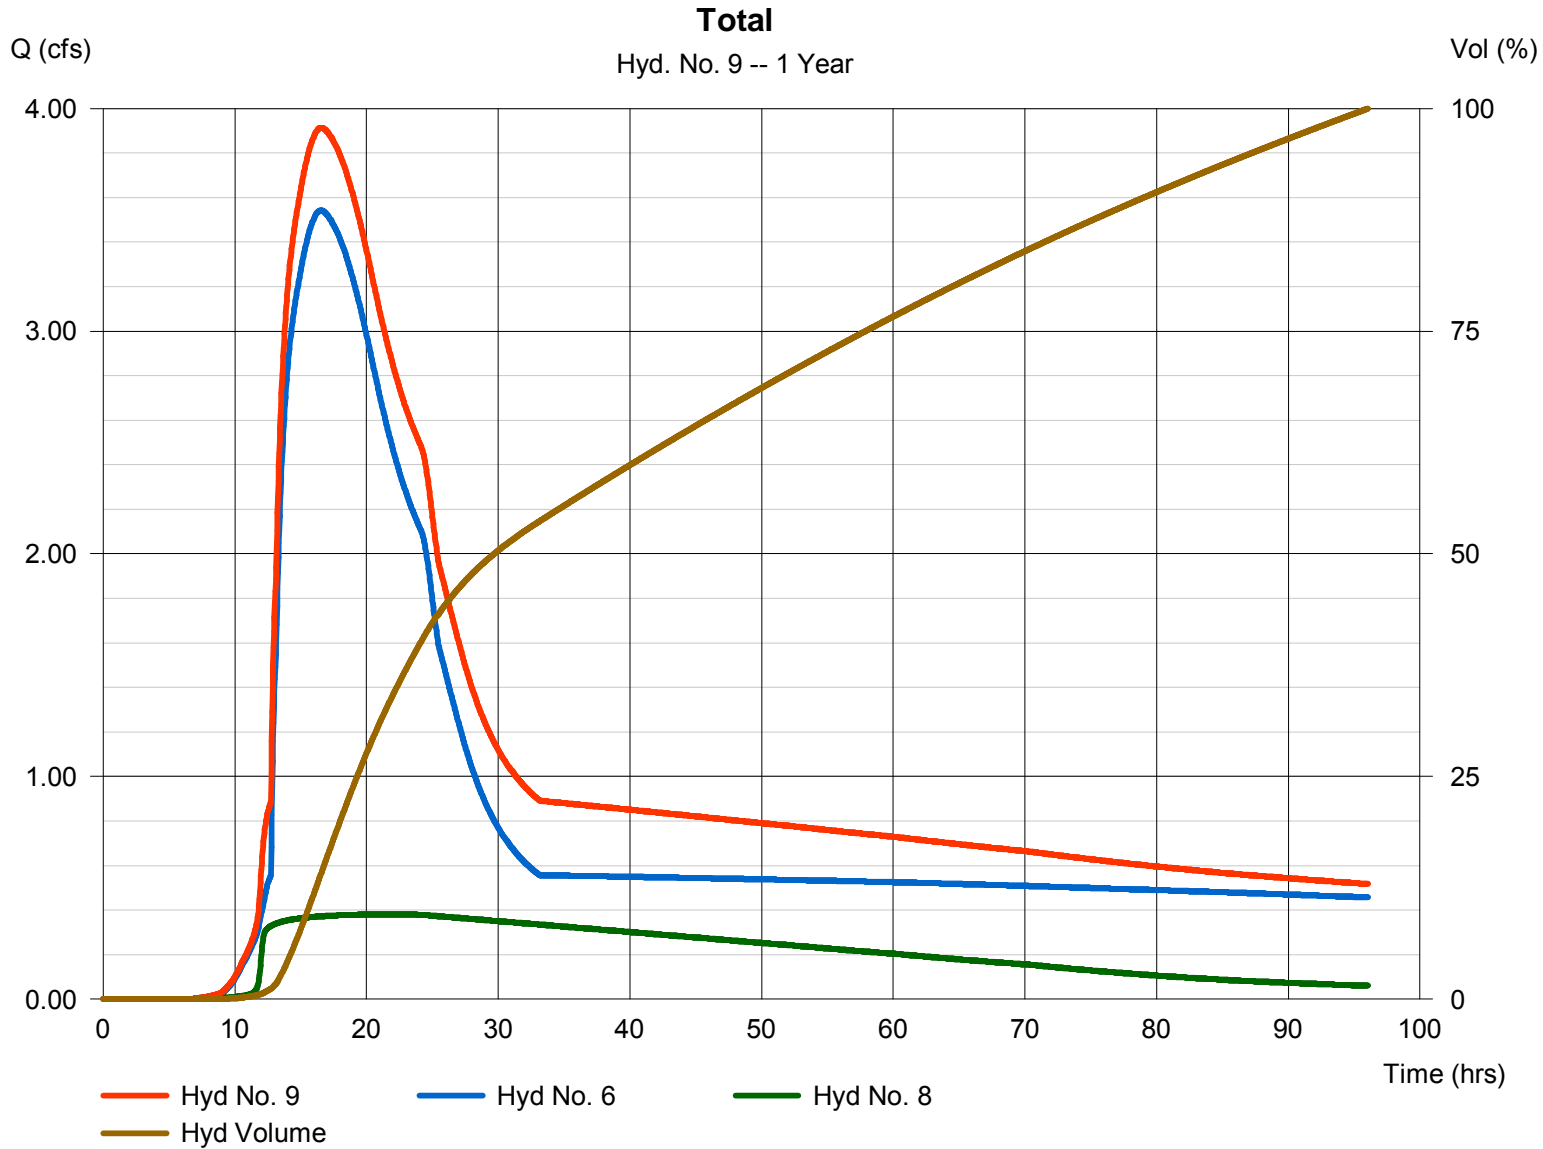

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 19.57 cfs
Storm frequency	= 1 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 203,232 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 2.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

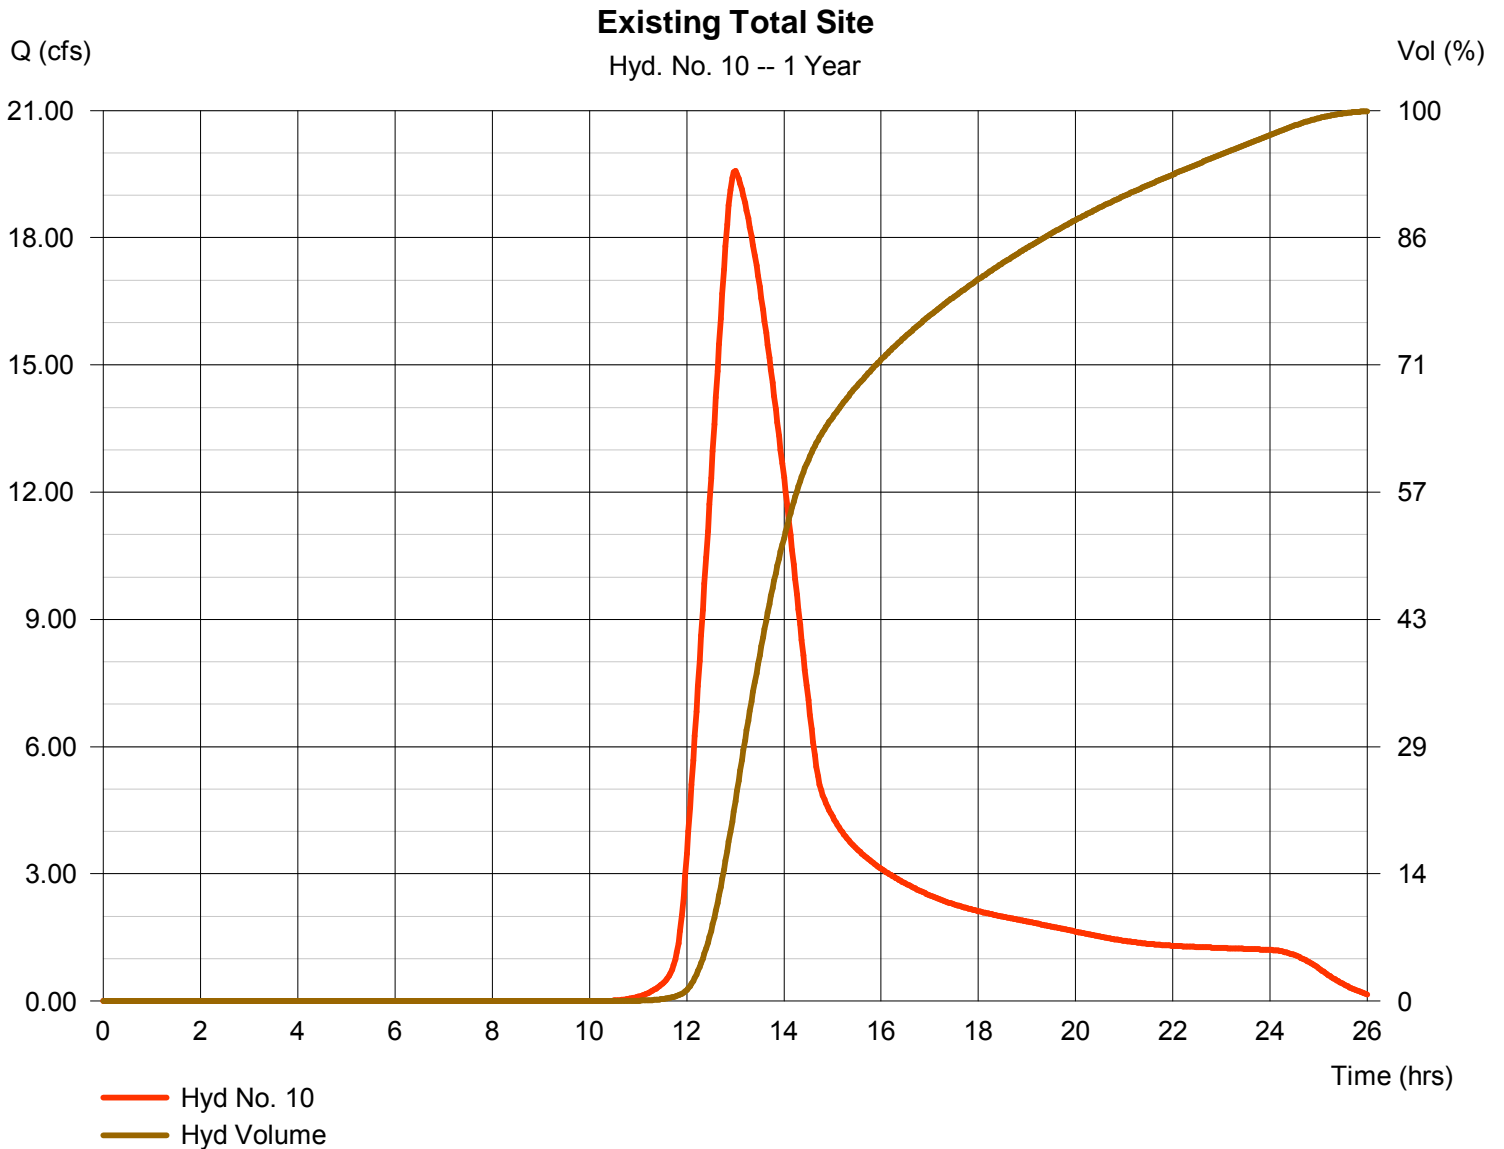

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	40.42	2	742	219,584	-----	-----	-----	Offsite West	
2	Reservoir	6.231	2	810	201,305	1	1335.76	120,939	Upper Pond	
3	Reach	6.186	2	820	201,233	2	-----	-----	Channel Section	
4	SCS Runoff	56.56	2	736	276,729	-----	-----	-----	Developed A	
5	Combine	56.76	2	736	477,962	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	10.62	2	840	413,777	5	1329.45	177,395	North East Detention	
7	SCS Runoff	37.58	2	722	107,924	-----	-----	-----	Developed B	
8	Reservoir	1.077	2	928	96,542	7	1328.12	77,643	South East Detention	
9	Combine	11.59	2	844	510,319	6, 8	-----	-----	Total	
10	SCS Runoff	29.94	2	778	301,756	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 2 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 40.42 cfs
Storm frequency	= 2 yrs	Time to peak	= 12.37 hrs
Time interval	= 2 min	Hyd. volume	= 219,584 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

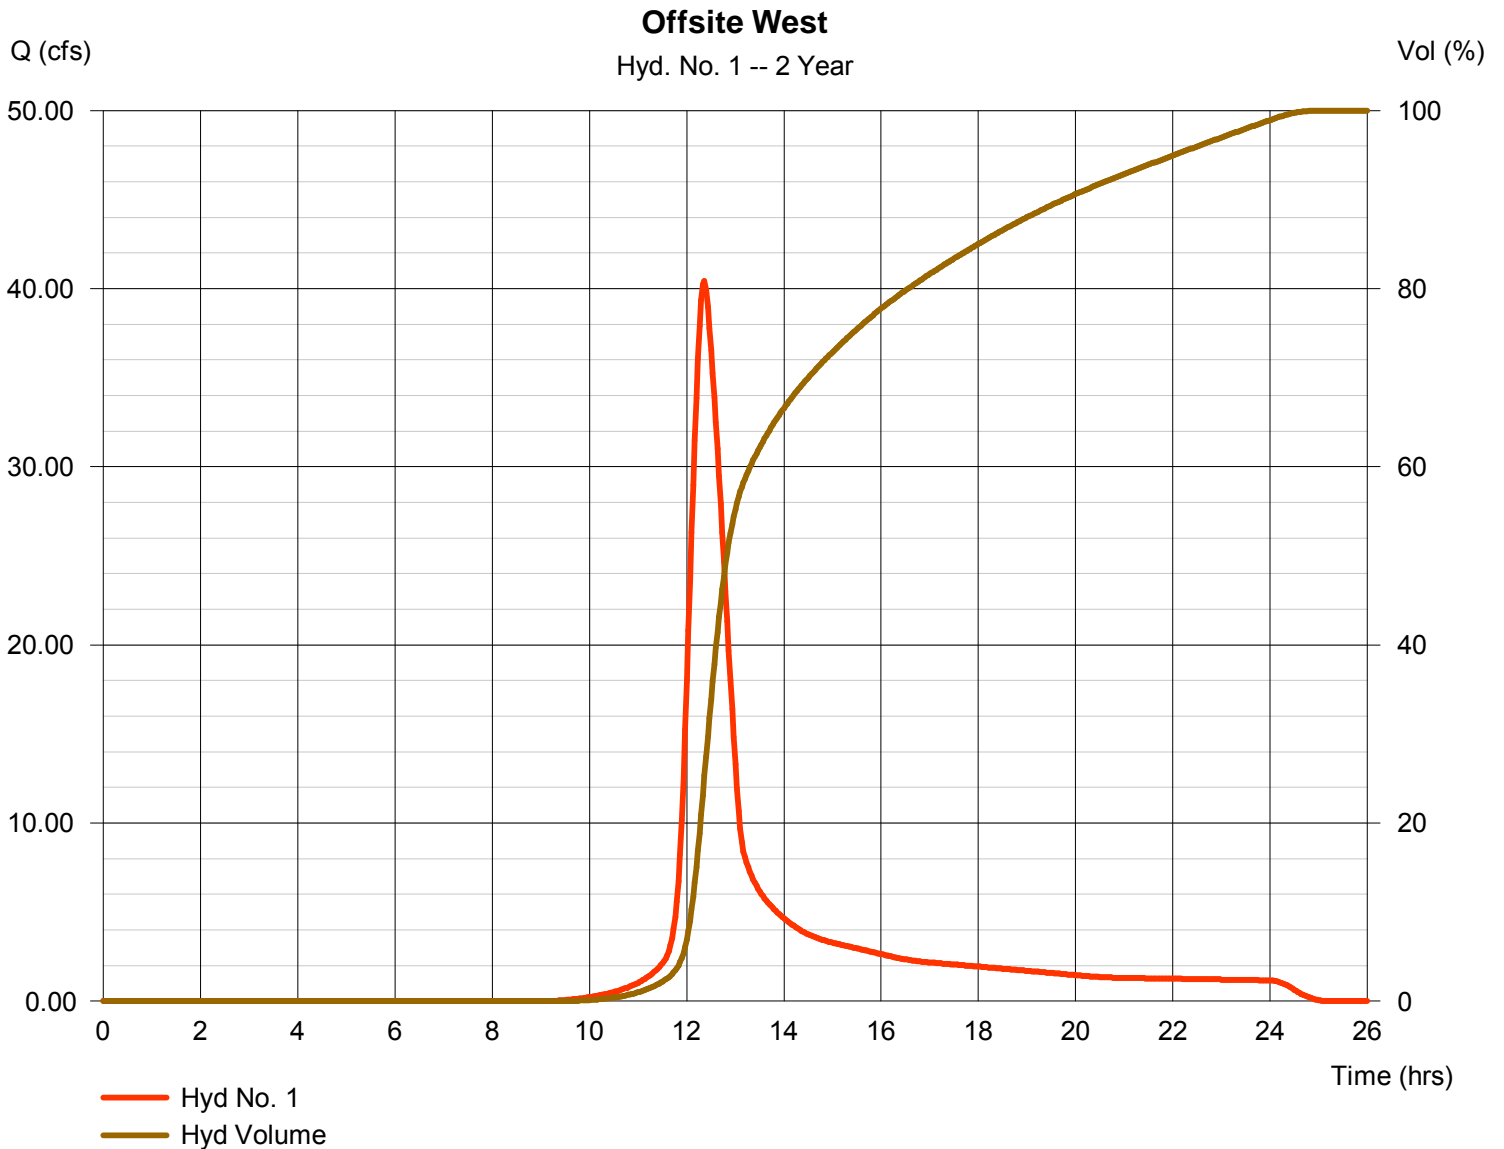

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 6.231 cfs
Storm frequency	= 2 yrs	Time to peak	= 13.50 hrs
Time interval	= 2 min	Hyd. volume	= 201,305 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1335.76 ft
Reservoir name	= Upper Pond	Max. Storage	= 120,939 cuft

Storage Indication method used.

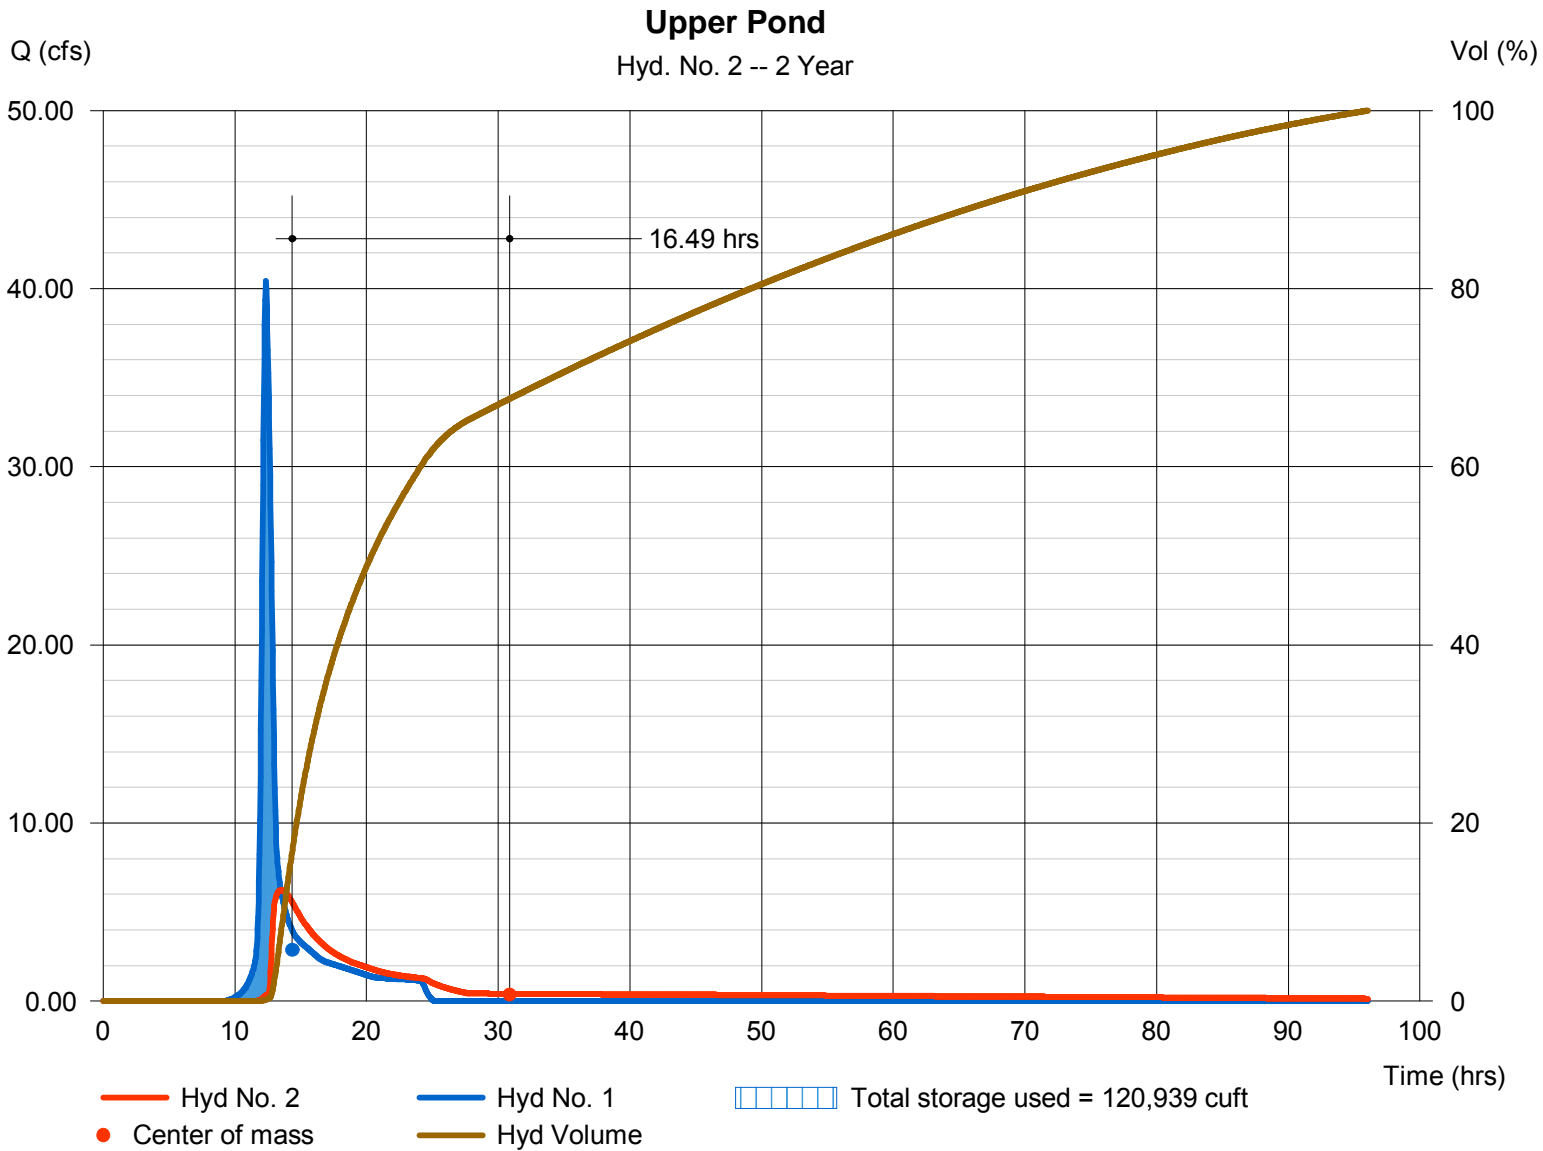

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 6.186 cfs
Storm frequency	= 2 yrs	Time to peak	= 13.67 hrs
Time interval	= 2 min	Hyd. volume	= 201,233 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.2243

Modified Att-Kin routing method used.

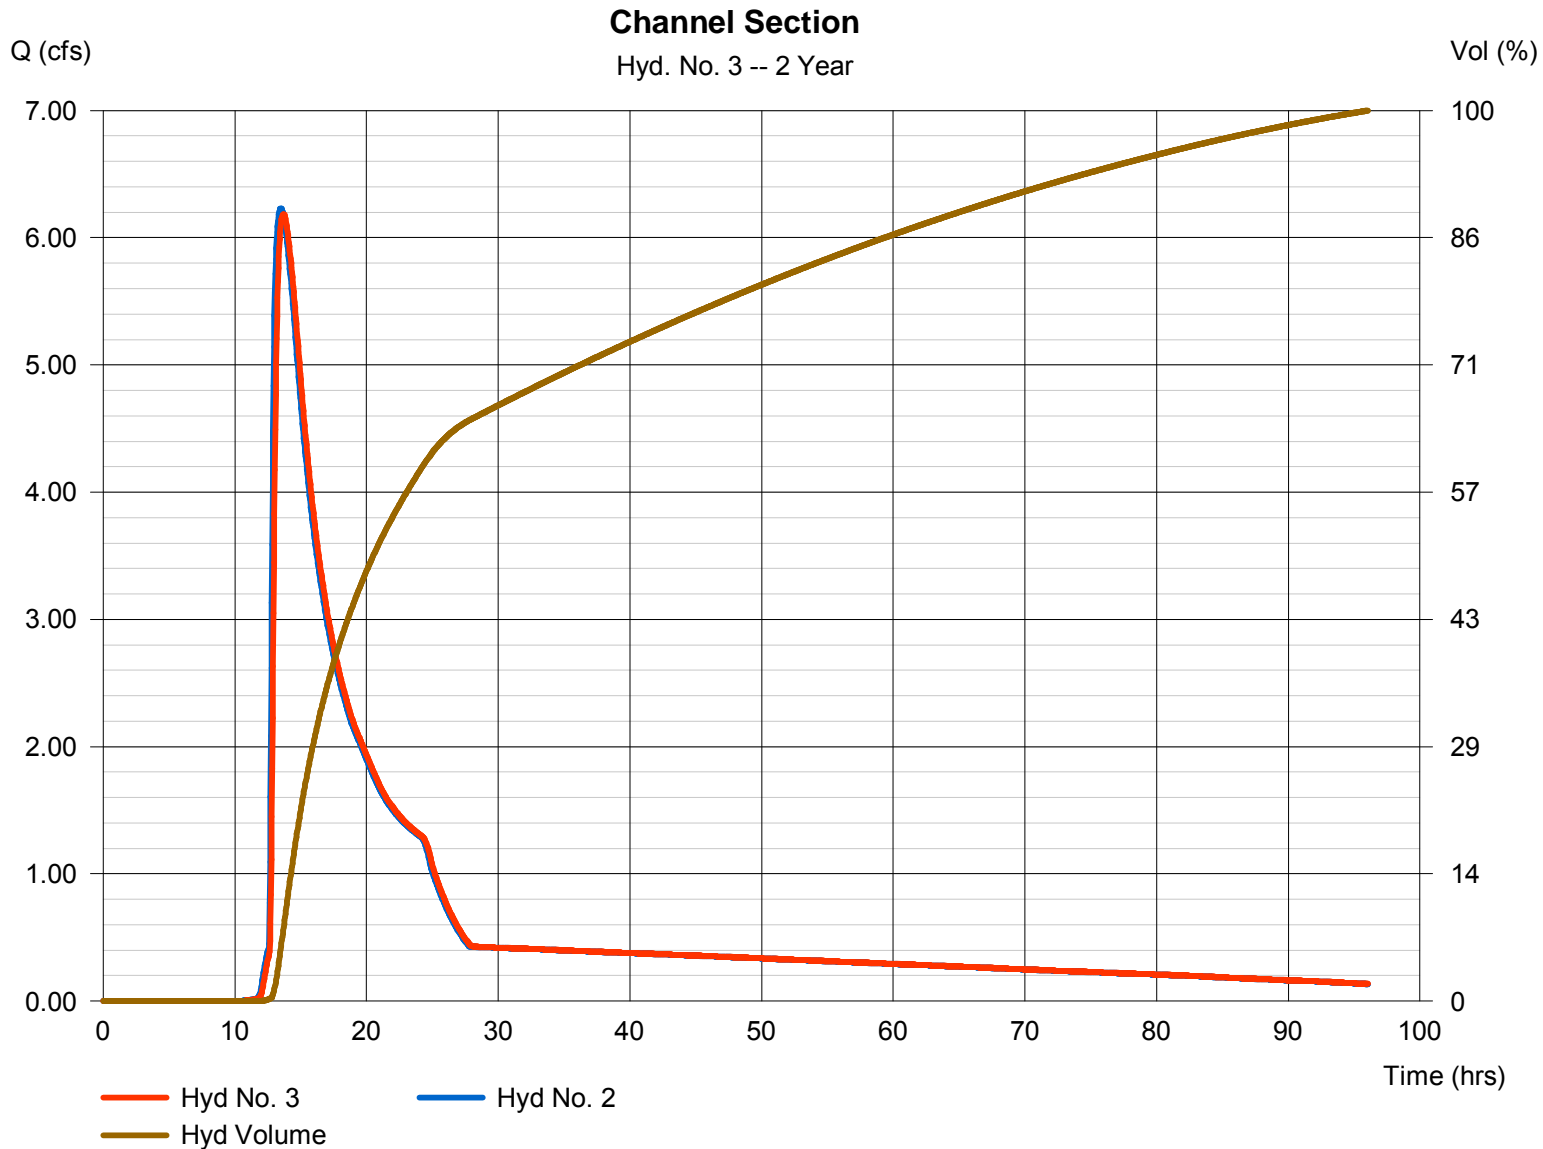

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 56.56 cfs
Storm frequency	= 2 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 276,729 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

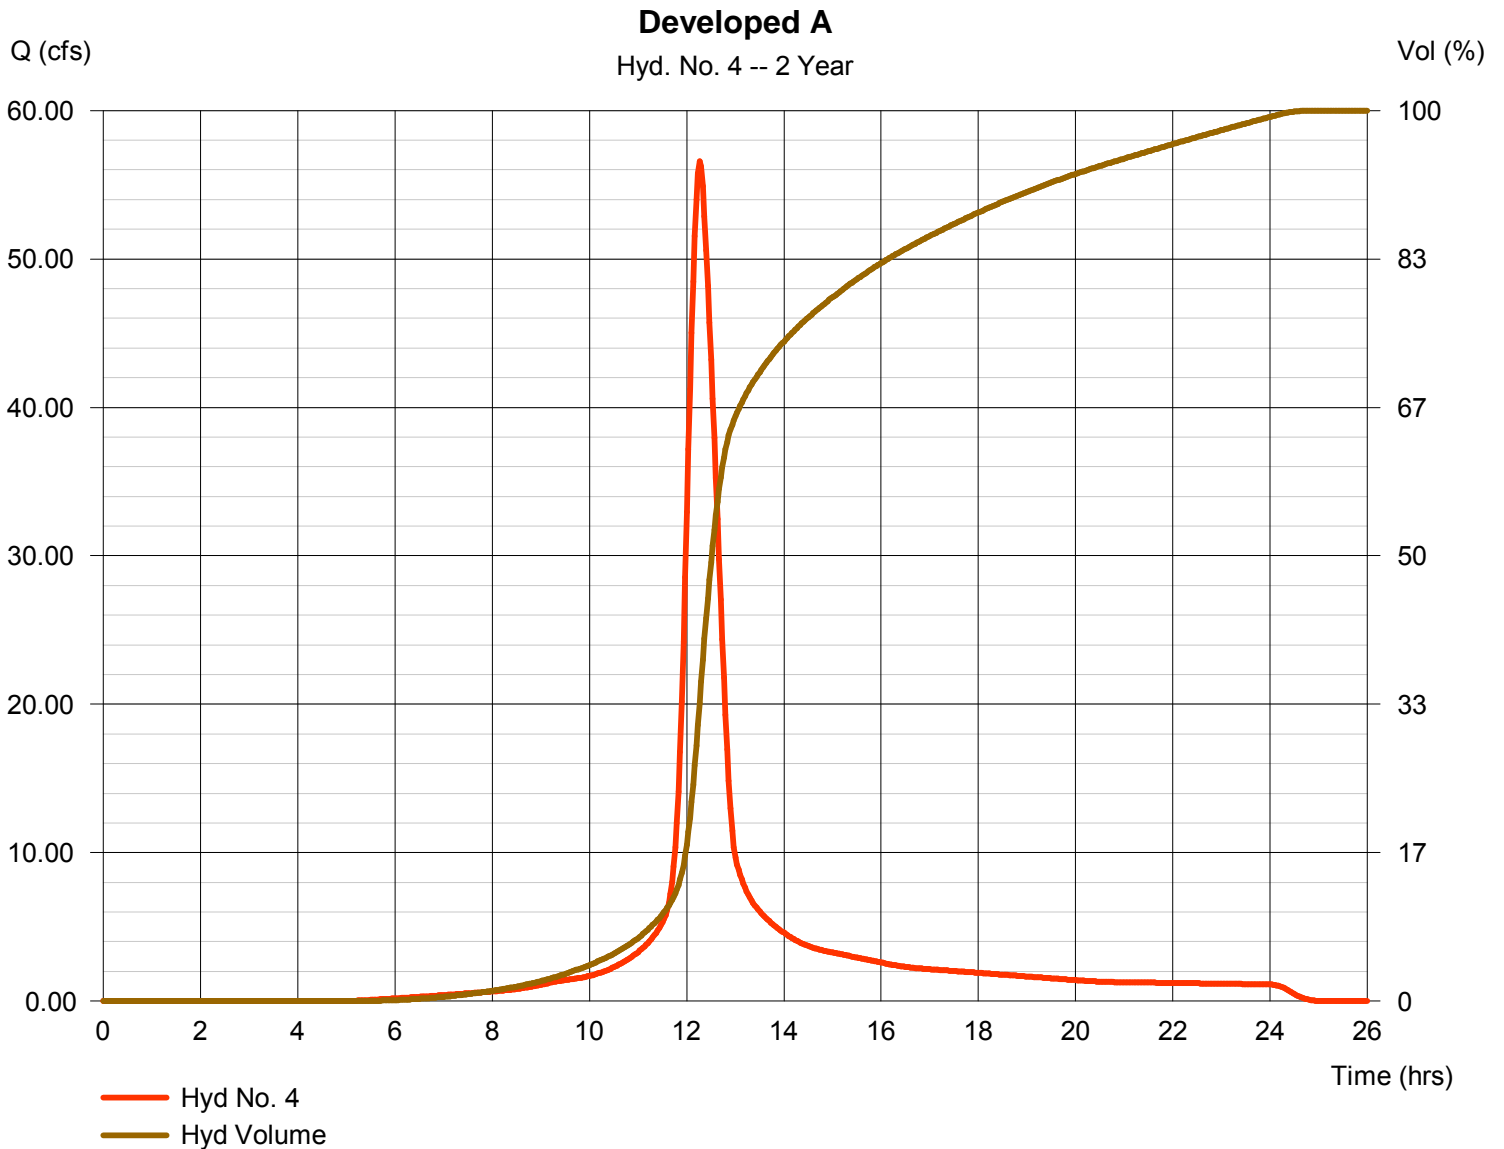

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 5

Runoff to North Pond

Hydrograph type = Combine
Storm frequency = 2 yrs
Time interval = 2 min
Inflow hyds. = 3, 4

Peak discharge = 56.76 cfs
Time to peak = 12.27 hrs
Hyd. volume = 477,962 cuft
Contrib. drain. area = 30.000 ac

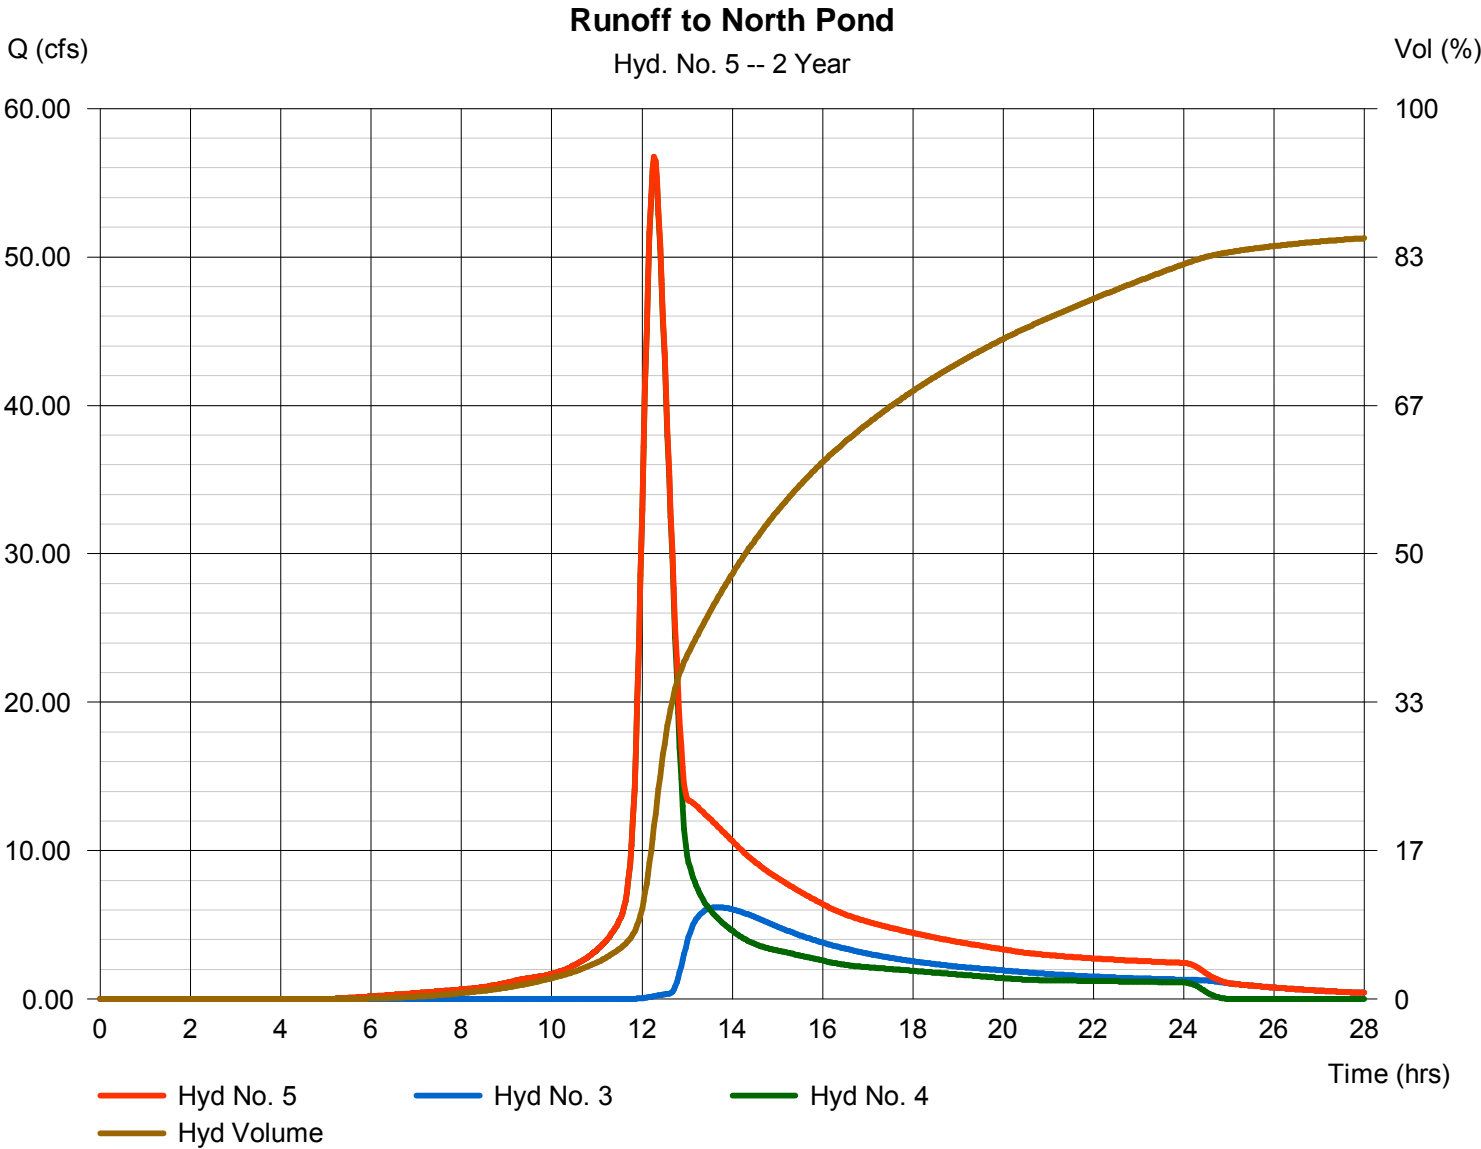

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 10.62 cfs
Storm frequency	= 2 yrs	Time to peak	= 14.00 hrs
Time interval	= 2 min	Hyd. volume	= 413,777 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1329.45 ft
Reservoir name	= North East Pond	Max. Storage	= 177,395 cuft

Storage Indication method used.

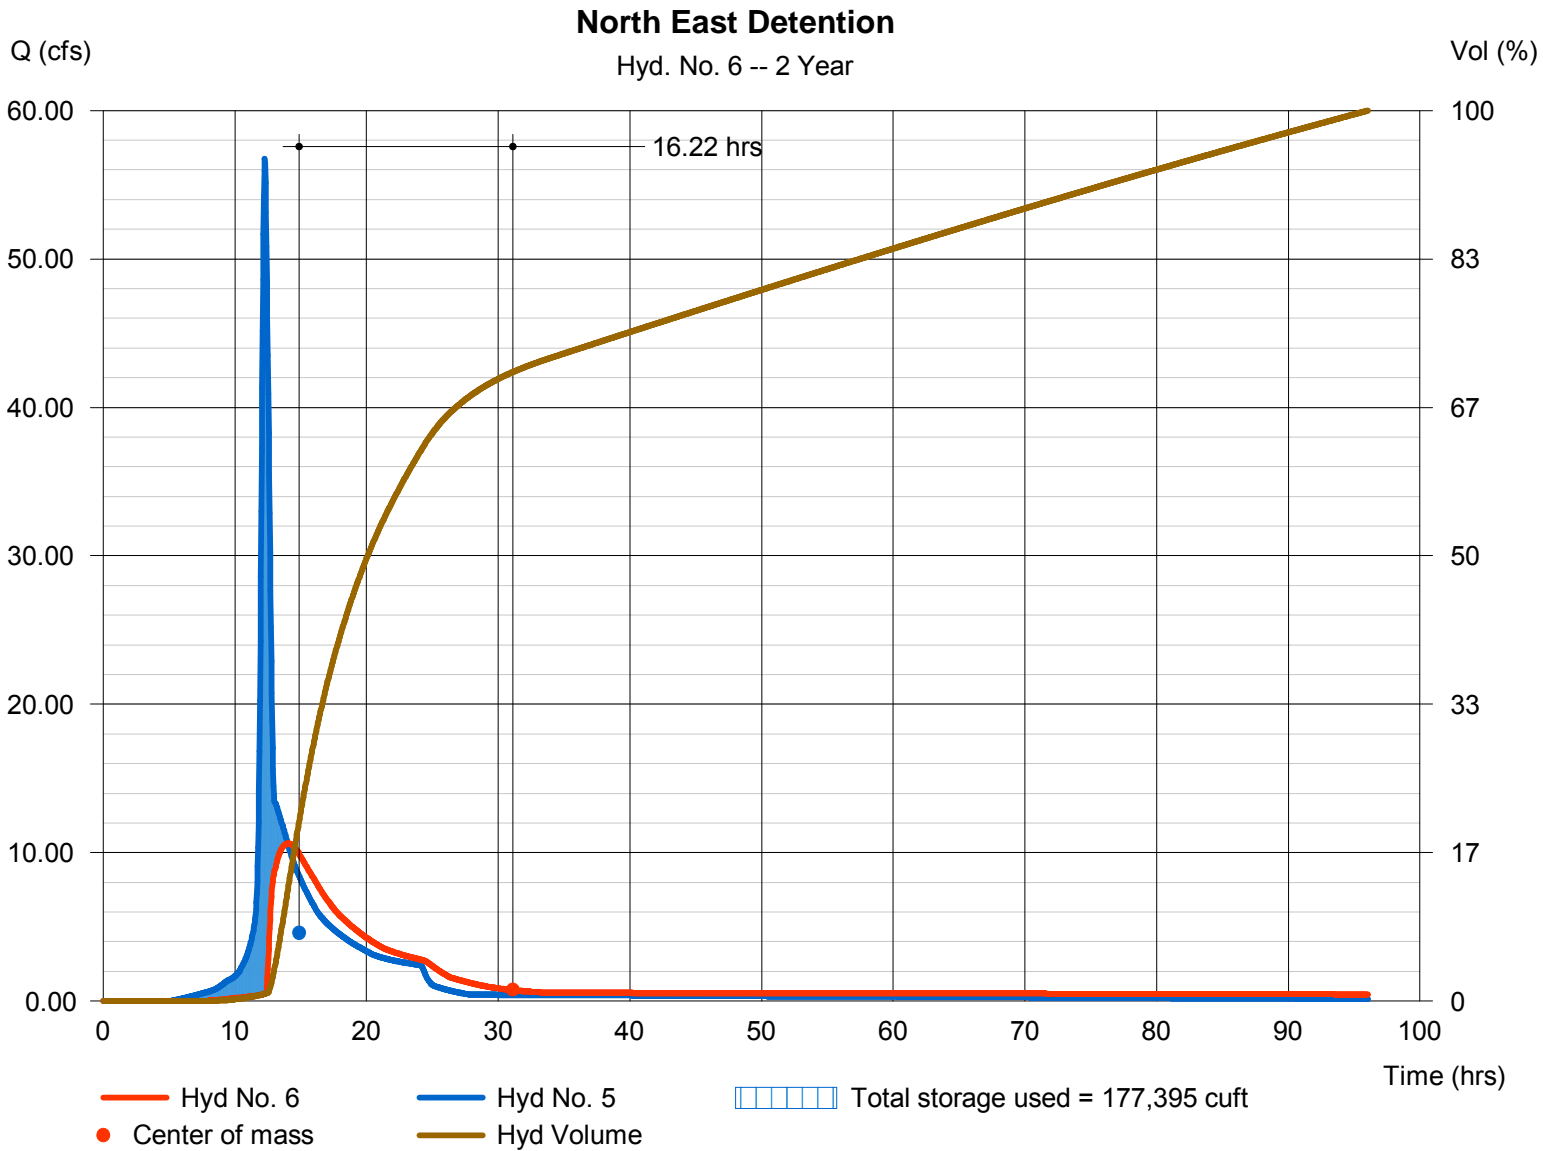

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 37.58 cfs
Storm frequency	= 2 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 107,924 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

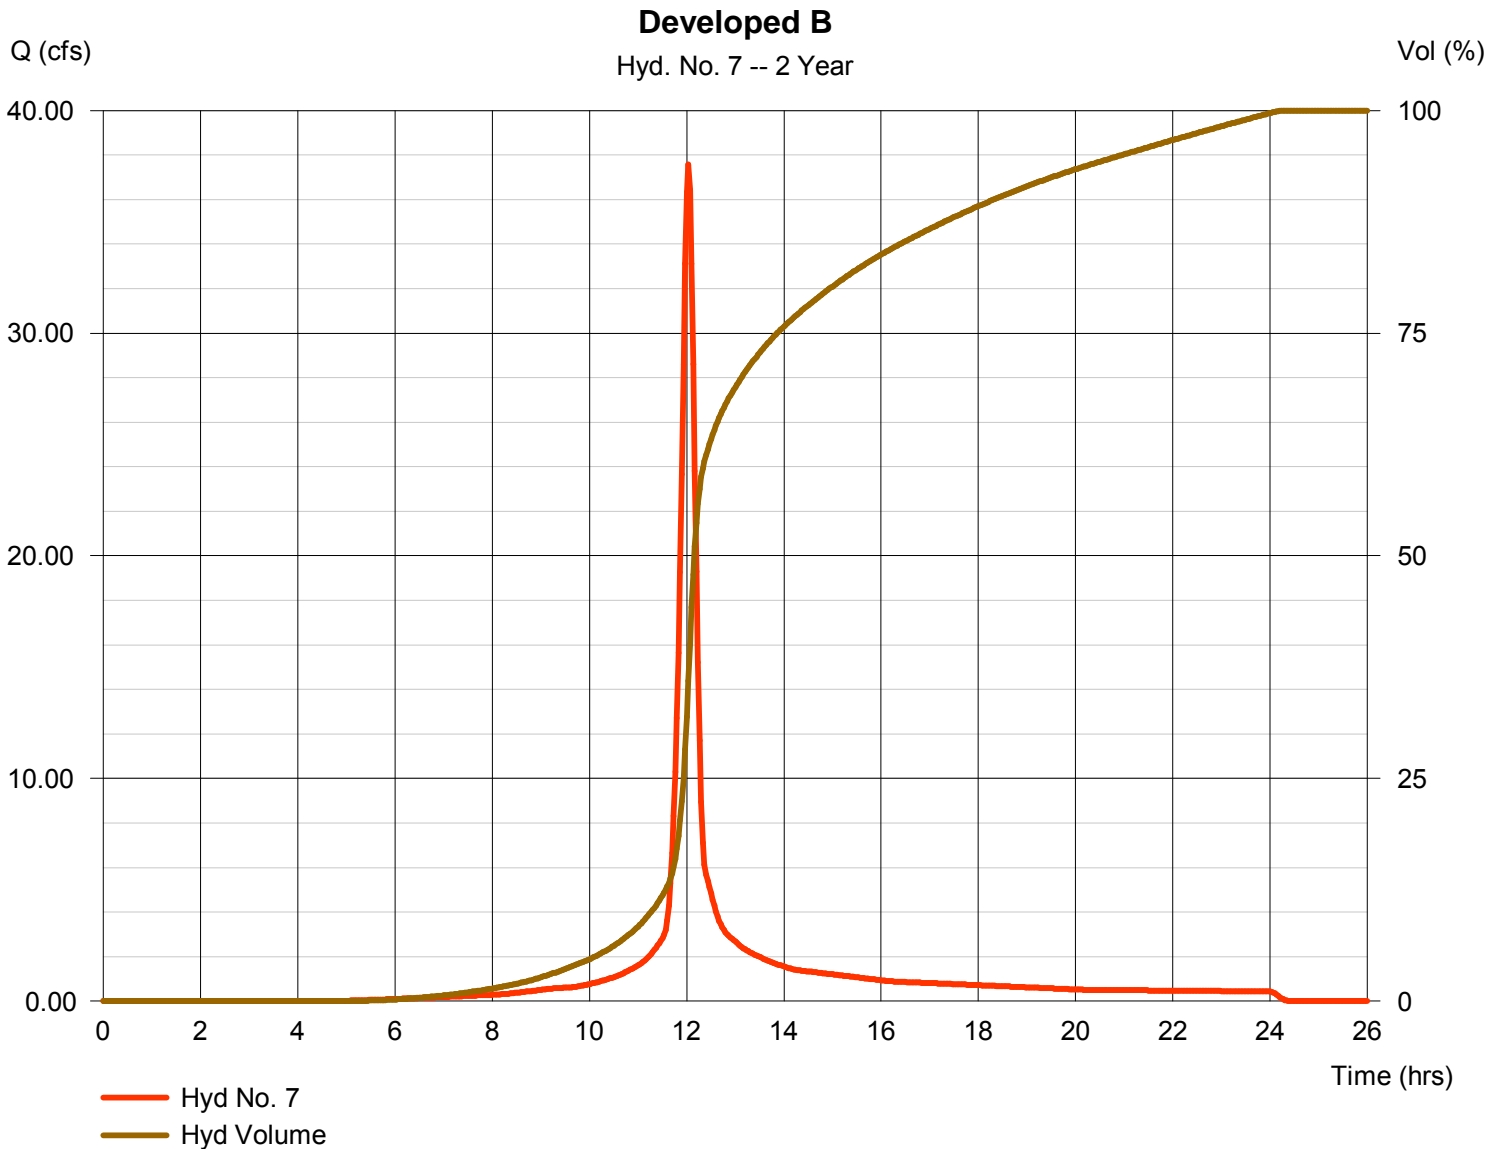

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 1.077 cfs
Storm frequency	= 2 yrs	Time to peak	= 15.47 hrs
Time interval	= 2 min	Hyd. volume	= 96,542 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1328.12 ft
Reservoir name	= South East Pond	Max. Storage	= 77,643 cuft

Storage Indication method used.

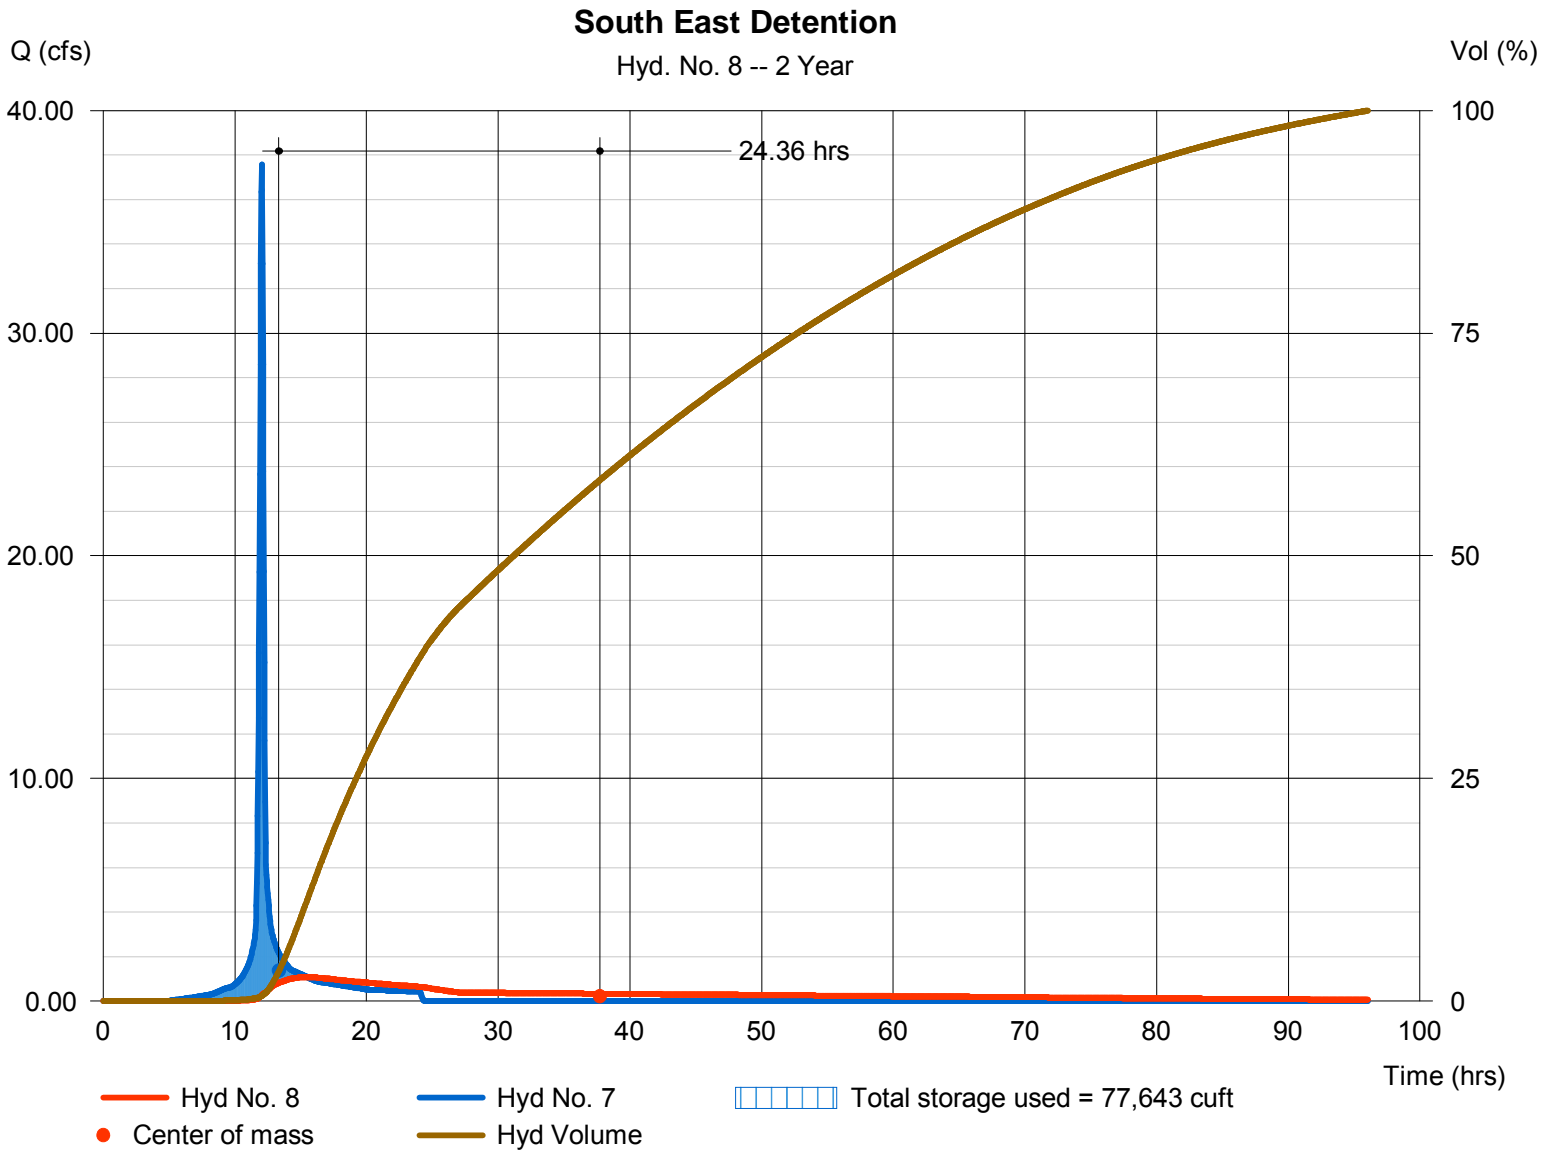

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 11.59 cfs
Storm frequency	= 2 yrs	Time to peak	= 14.07 hrs
Time interval	= 2 min	Hyd. volume	= 510,319 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

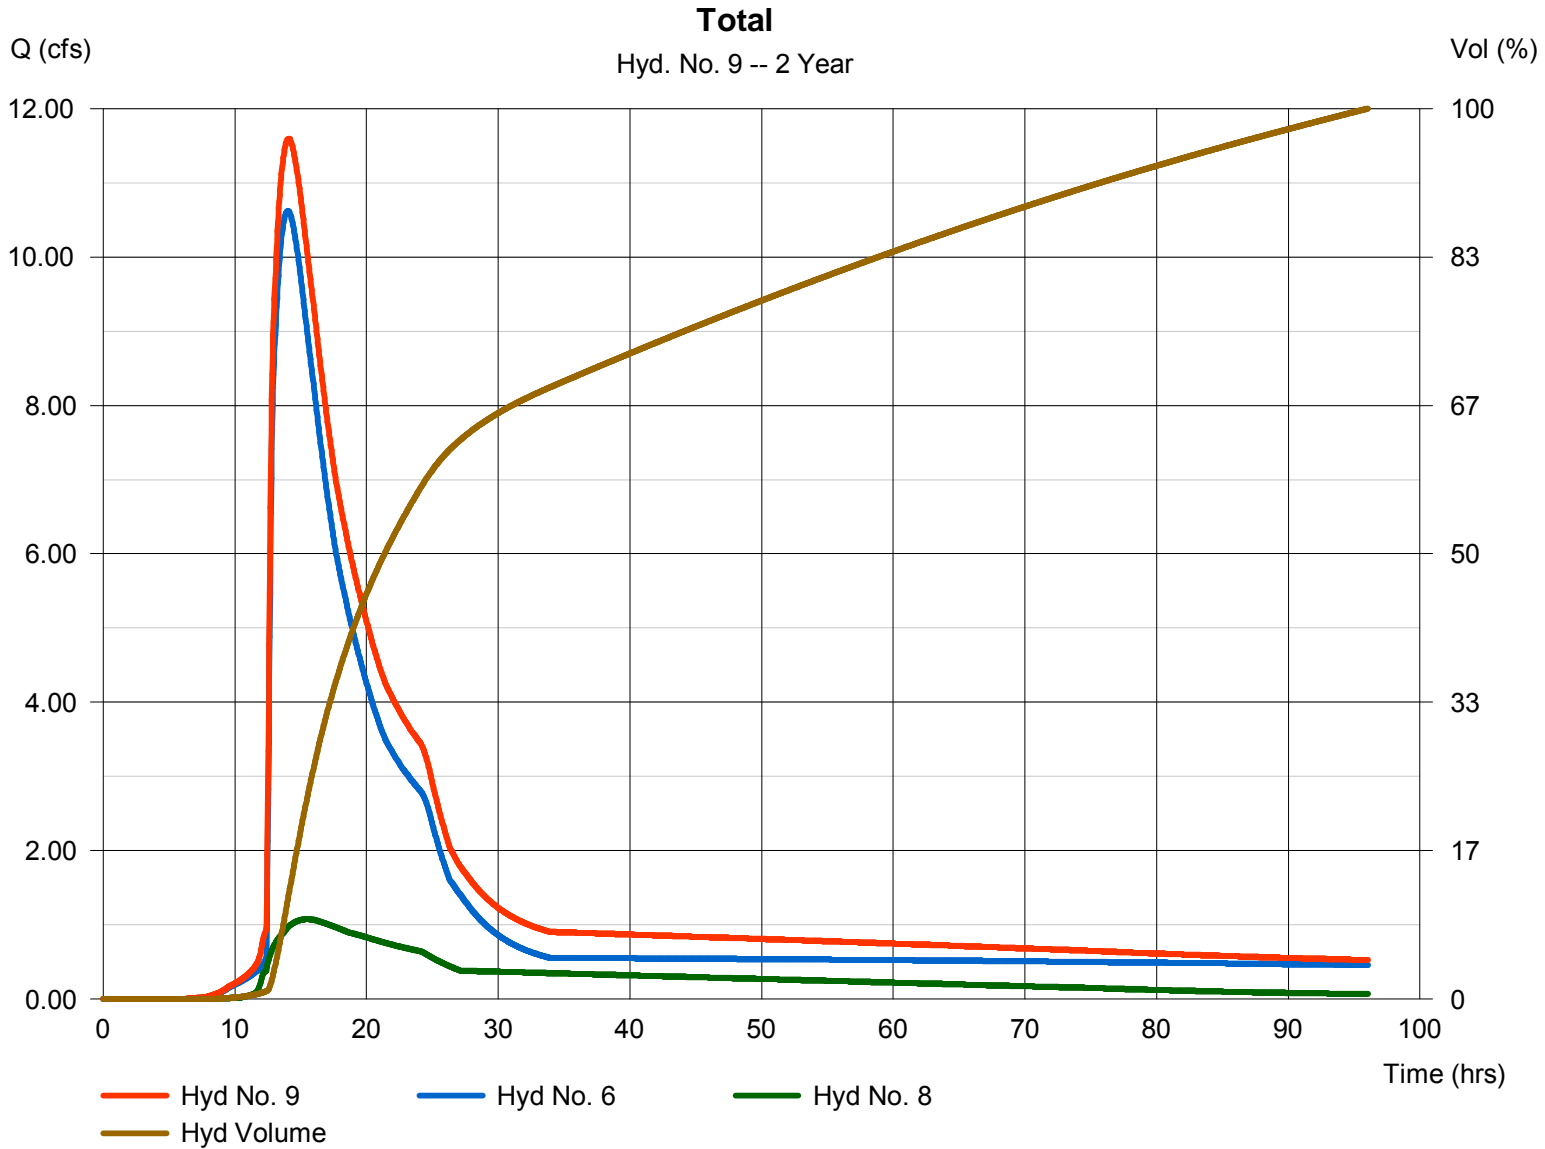

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 29.94 cfs
Storm frequency	= 2 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 301,756 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

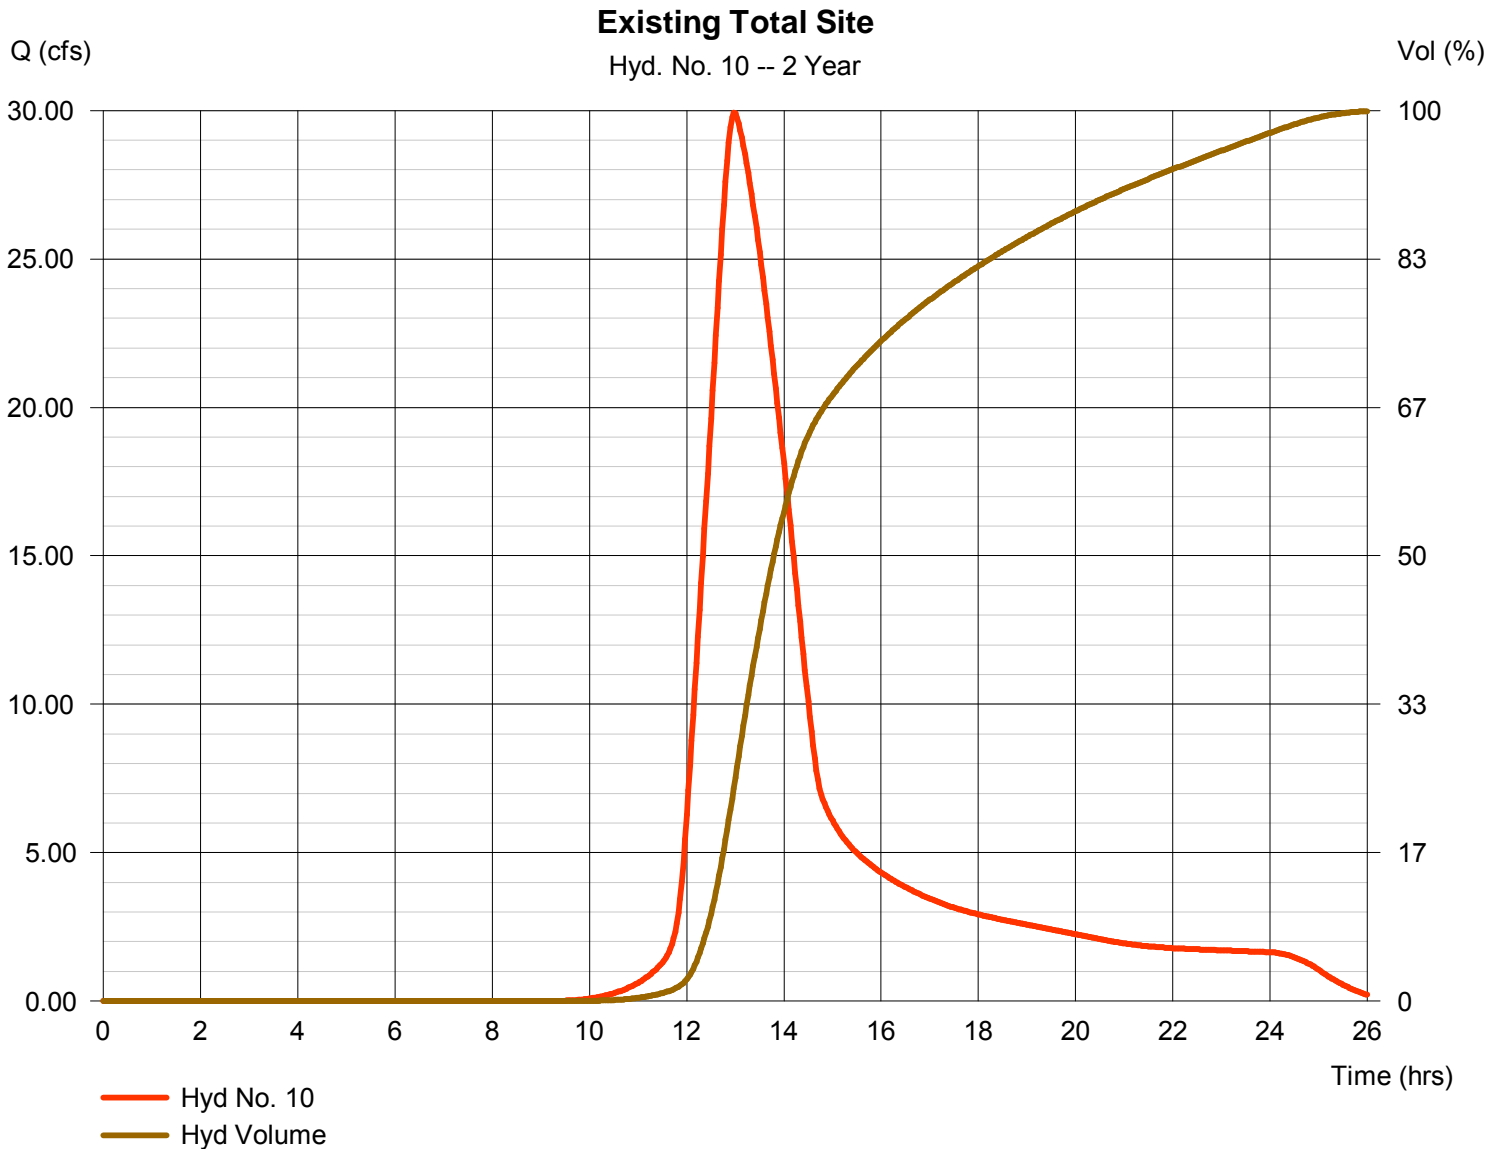

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	2.273	2	746	20,533	-----	-----	-----	Offsite West	
2	Reservoir	0.118	2	1468	15,291	1	1334.25	16,814	Upper Pond	
3	Reach	0.117	2	1486	15,268	2	-----	-----	Channel Section	
4	SCS Runoff	11.05	2	738	54,931	-----	-----	-----	Developed A	
5	Combine	11.05	2	738	70,199	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	0.408	2	1448	67,330	5	1328.15	40,676	North East Detention	
7	SCS Runoff	7.548	2	722	21,423	-----	-----	-----	Developed B	
8	Reservoir	0.123	2	1384	16,665	7	1327.26	16,619	South East Detention	
9	Combine	0.530	2	1426	83,995	6, 8	-----	-----	Total	
10	SCS Runoff	1.807	2	798	28,216	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 3 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 2.273 cfs
Storm frequency	= 3 yrs	Time to peak	= 12.43 hrs
Time interval	= 2 min	Hyd. volume	= 20,533 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 1.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

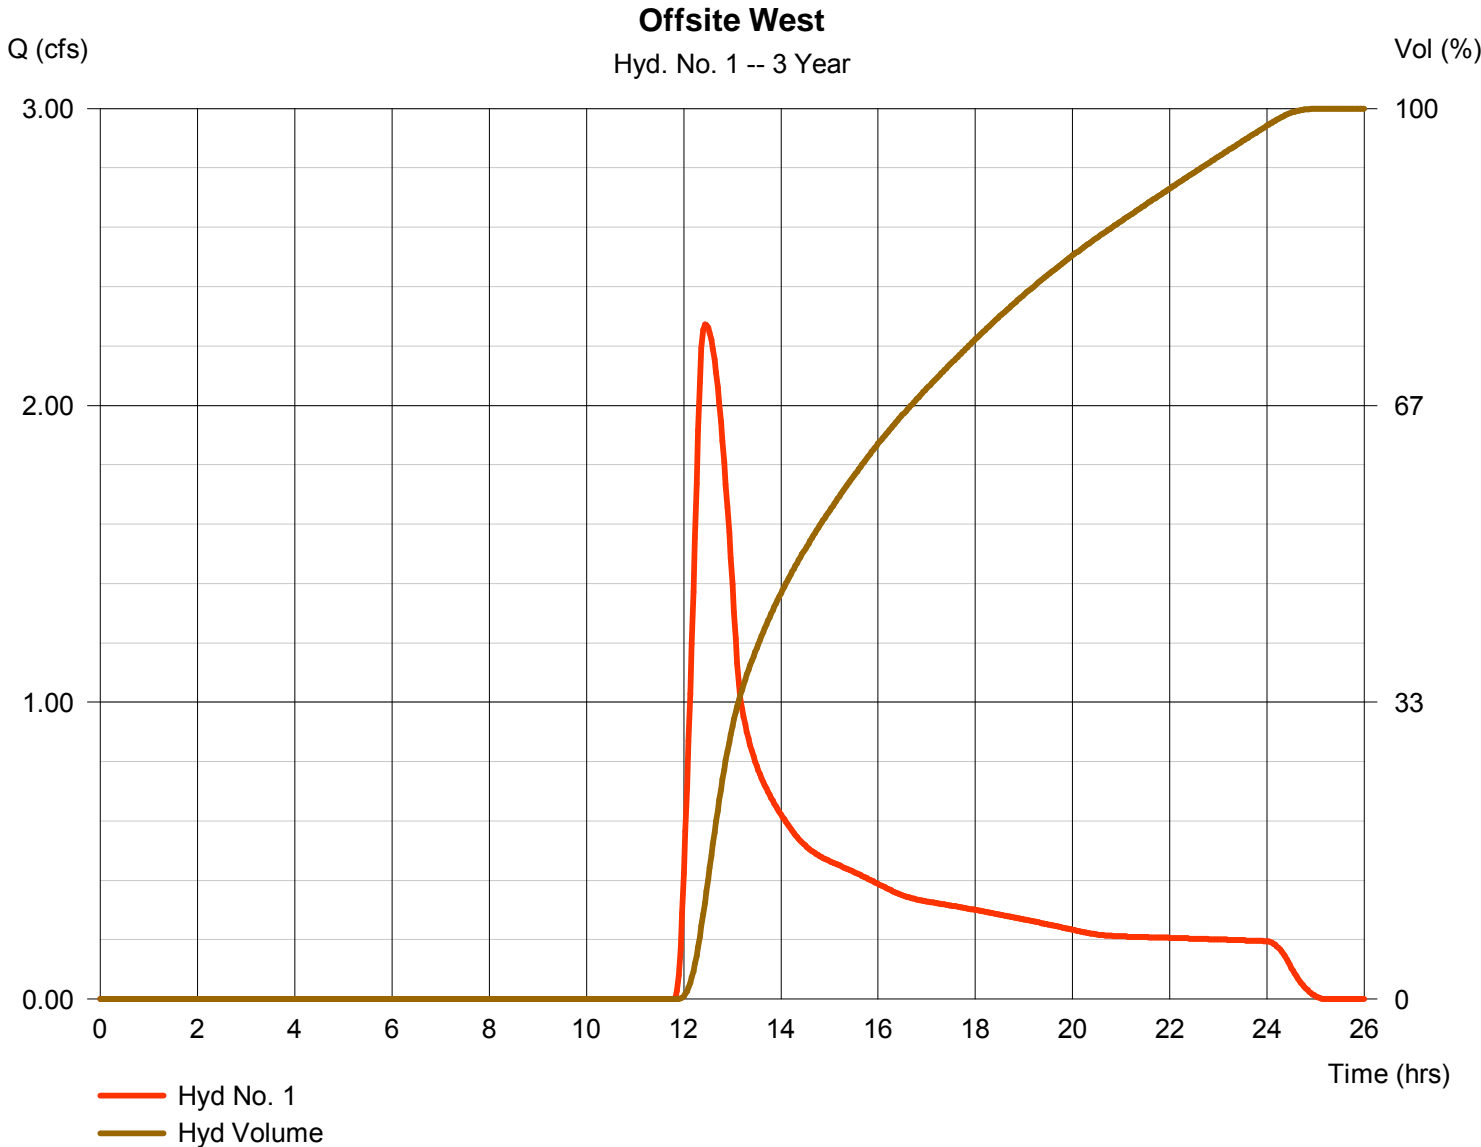

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 0.118 cfs
Storm frequency	= 3 yrs	Time to peak	= 24.47 hrs
Time interval	= 2 min	Hyd. volume	= 15,291 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1334.25 ft
Reservoir name	= Upper Pond	Max. Storage	= 16,814 cuft

Storage Indication method used.

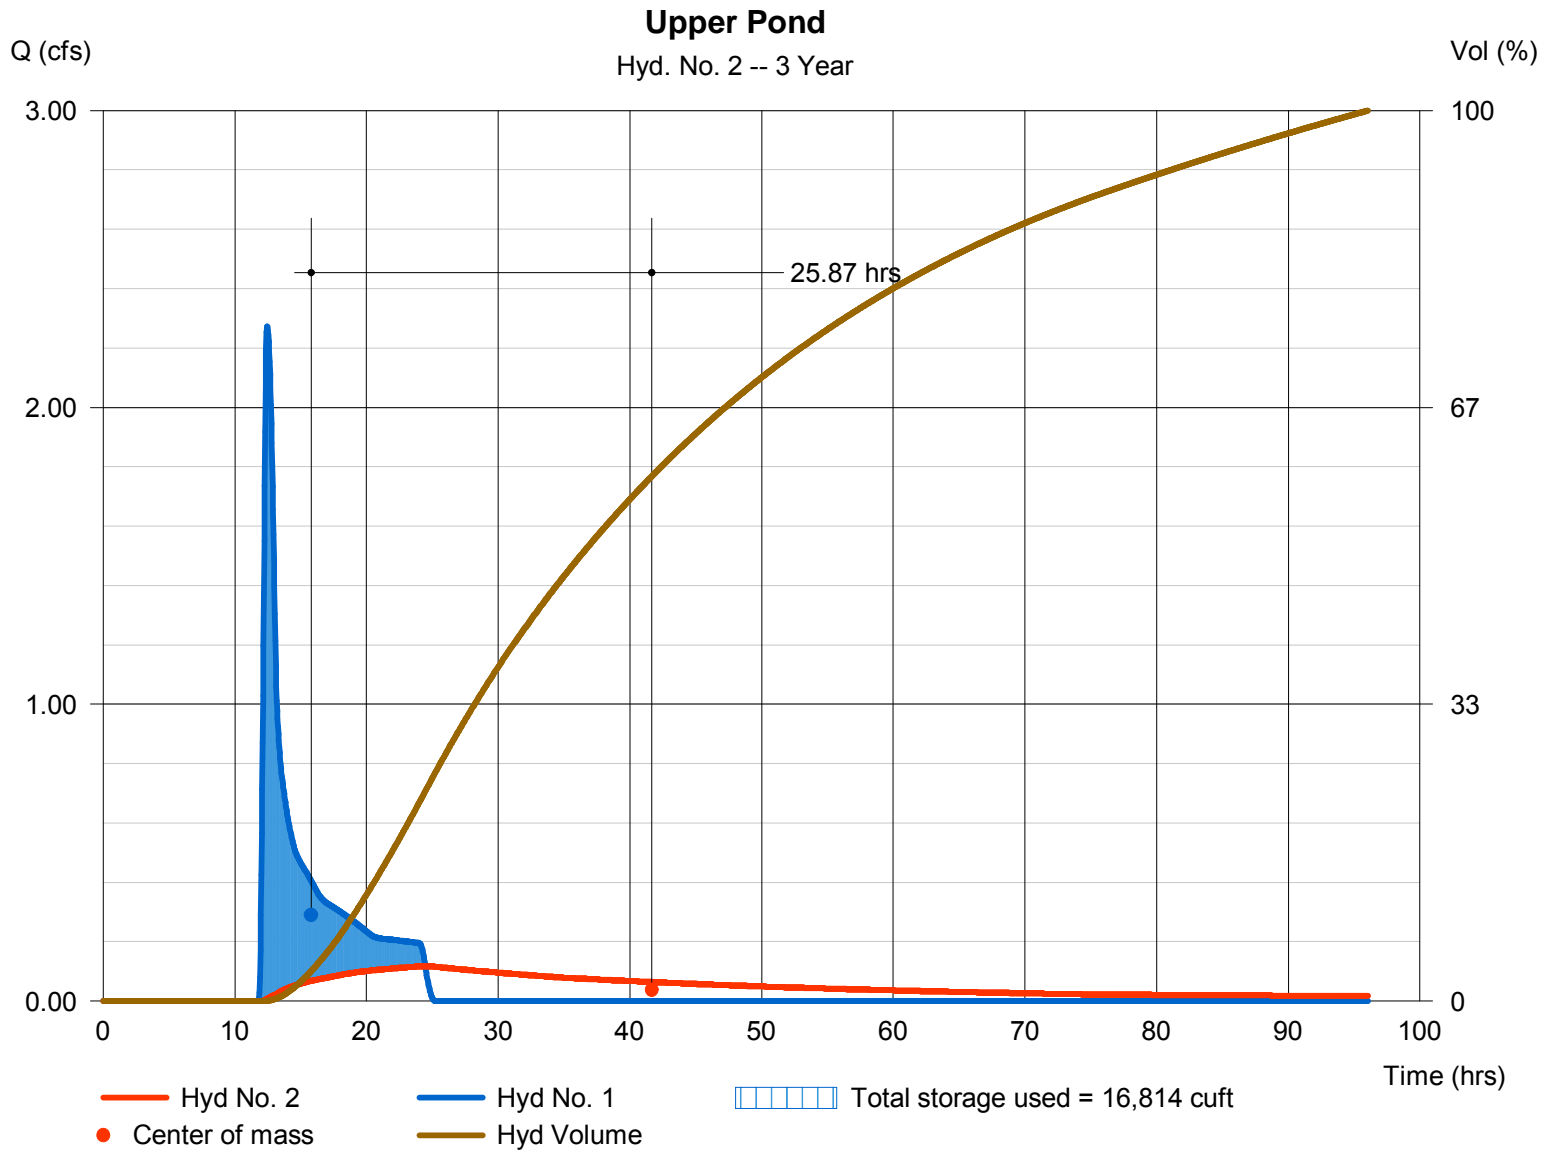

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 0.117 cfs
Storm frequency	= 3 yrs	Time to peak	= 24.77 hrs
Time interval	= 2 min	Hyd. volume	= 15,268 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.0880

Modified Att-Kin routing method used.

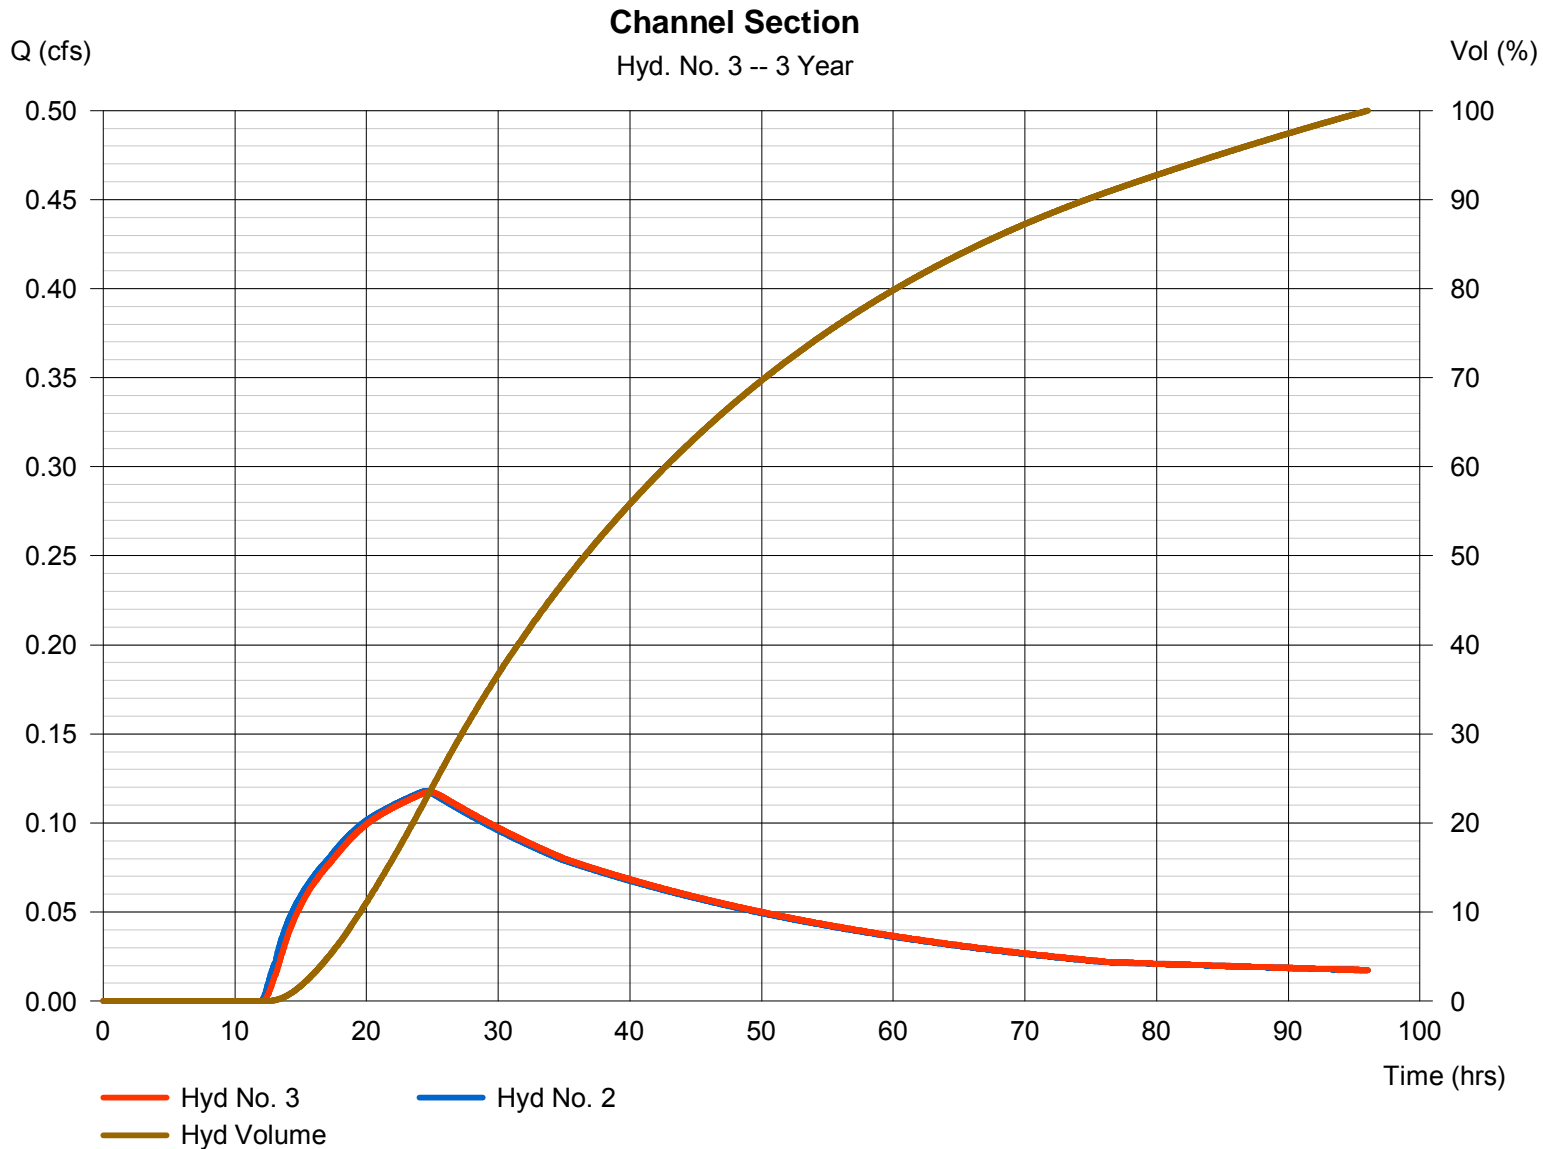

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 11.05 cfs
Storm frequency	= 3 yrs	Time to peak	= 12.30 hrs
Time interval	= 2 min	Hyd. volume	= 54,931 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 1.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

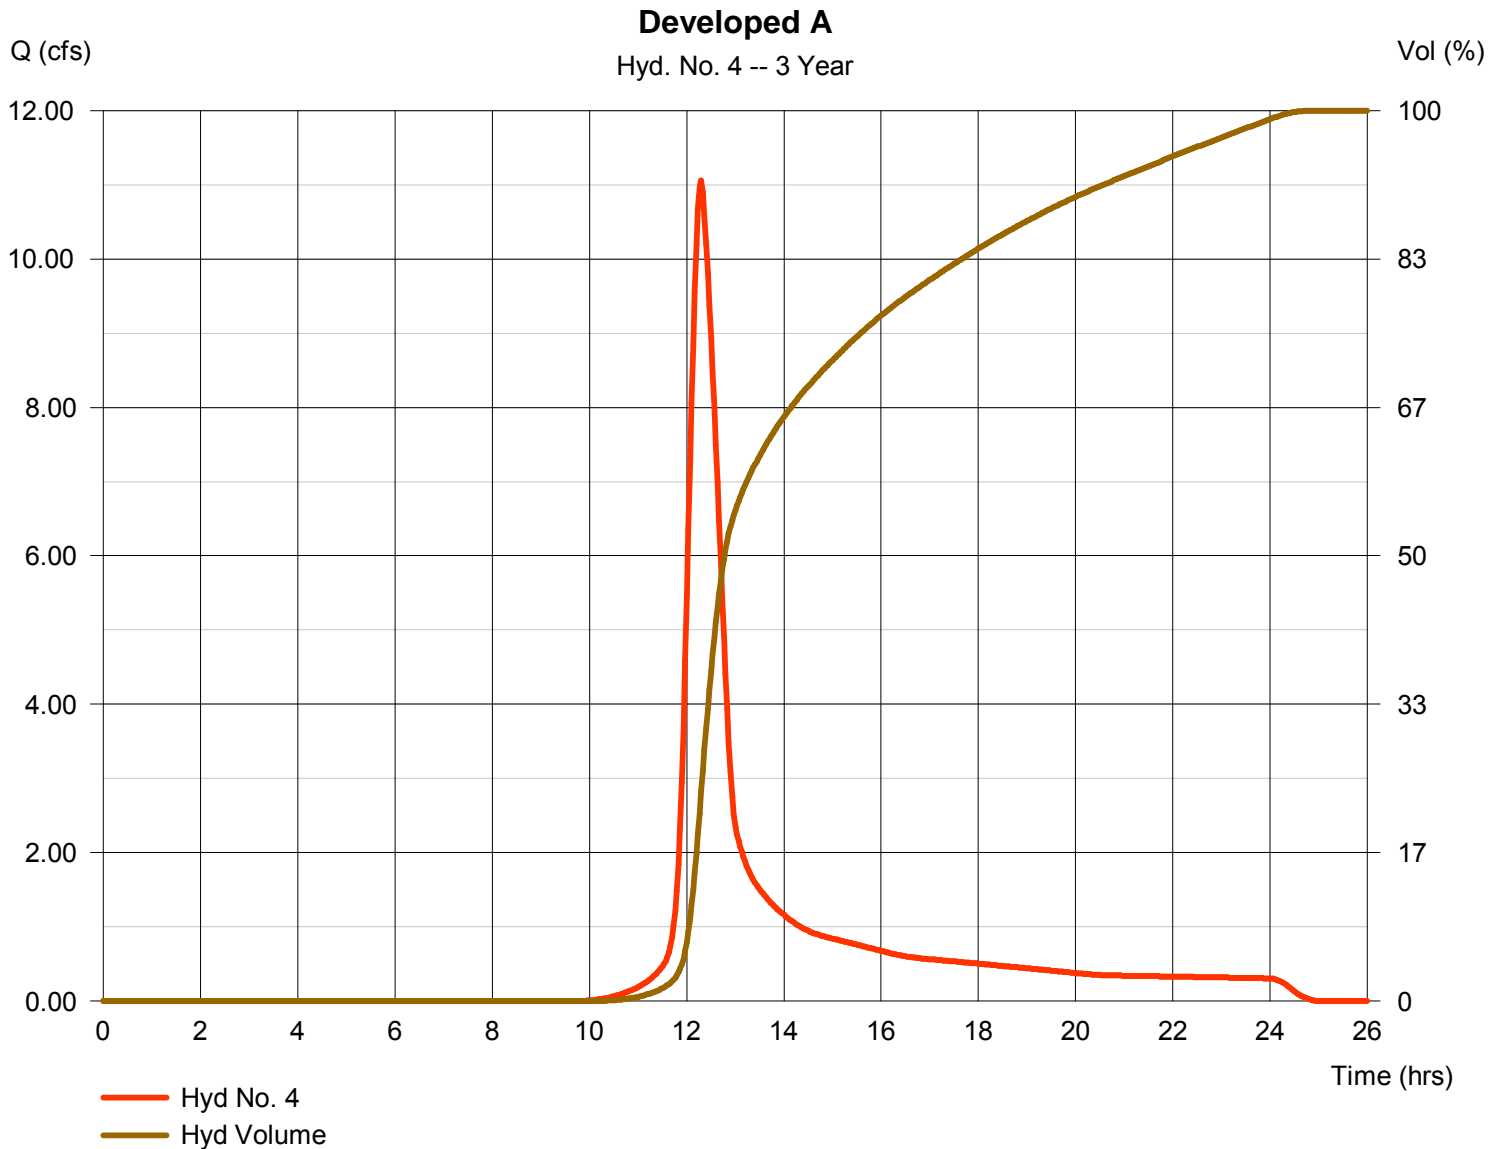

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 5

Runoff to North Pond

Hydrograph type = Combine
 Storm frequency = 3 yrs
 Time interval = 2 min
 Inflow hyds. = 3, 4

Peak discharge = 11.05 cfs
 Time to peak = 12.30 hrs
 Hyd. volume = 70,199 cuft
 Contrib. drain. area = 30.000 ac

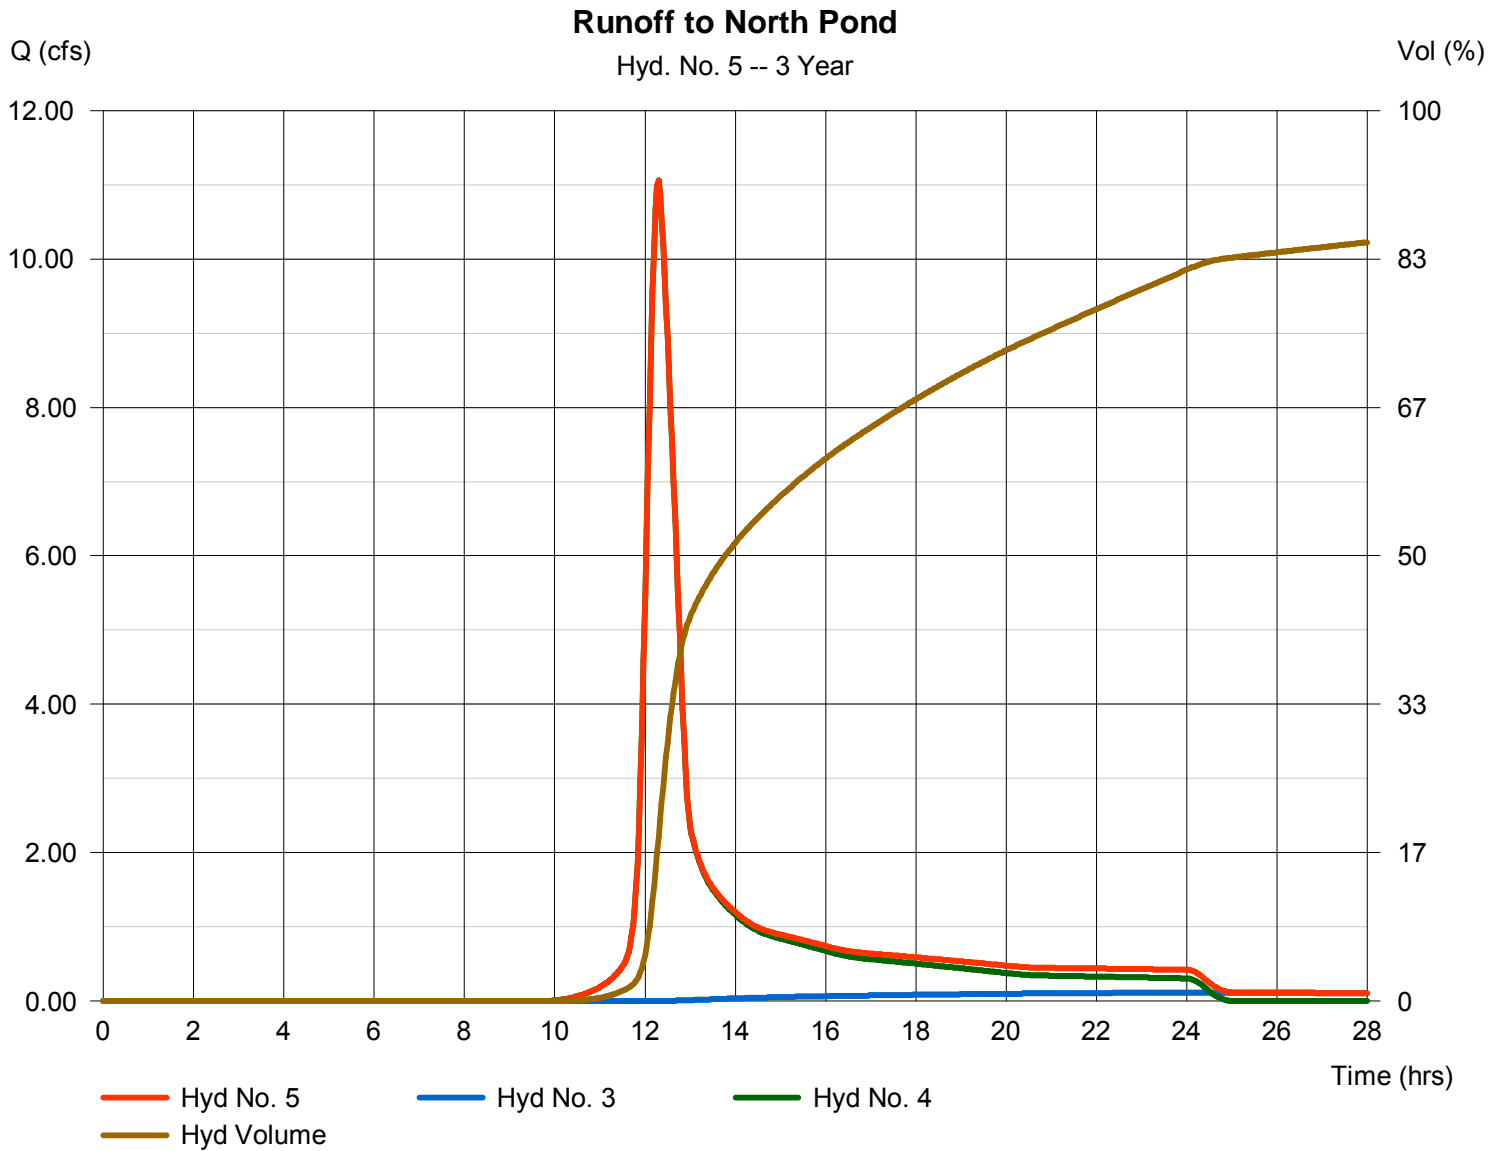

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 0.408 cfs
Storm frequency	= 3 yrs	Time to peak	= 24.13 hrs
Time interval	= 2 min	Hyd. volume	= 67,330 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1328.15 ft
Reservoir name	= North East Pond	Max. Storage	= 40,676 cuft

Storage Indication method used.

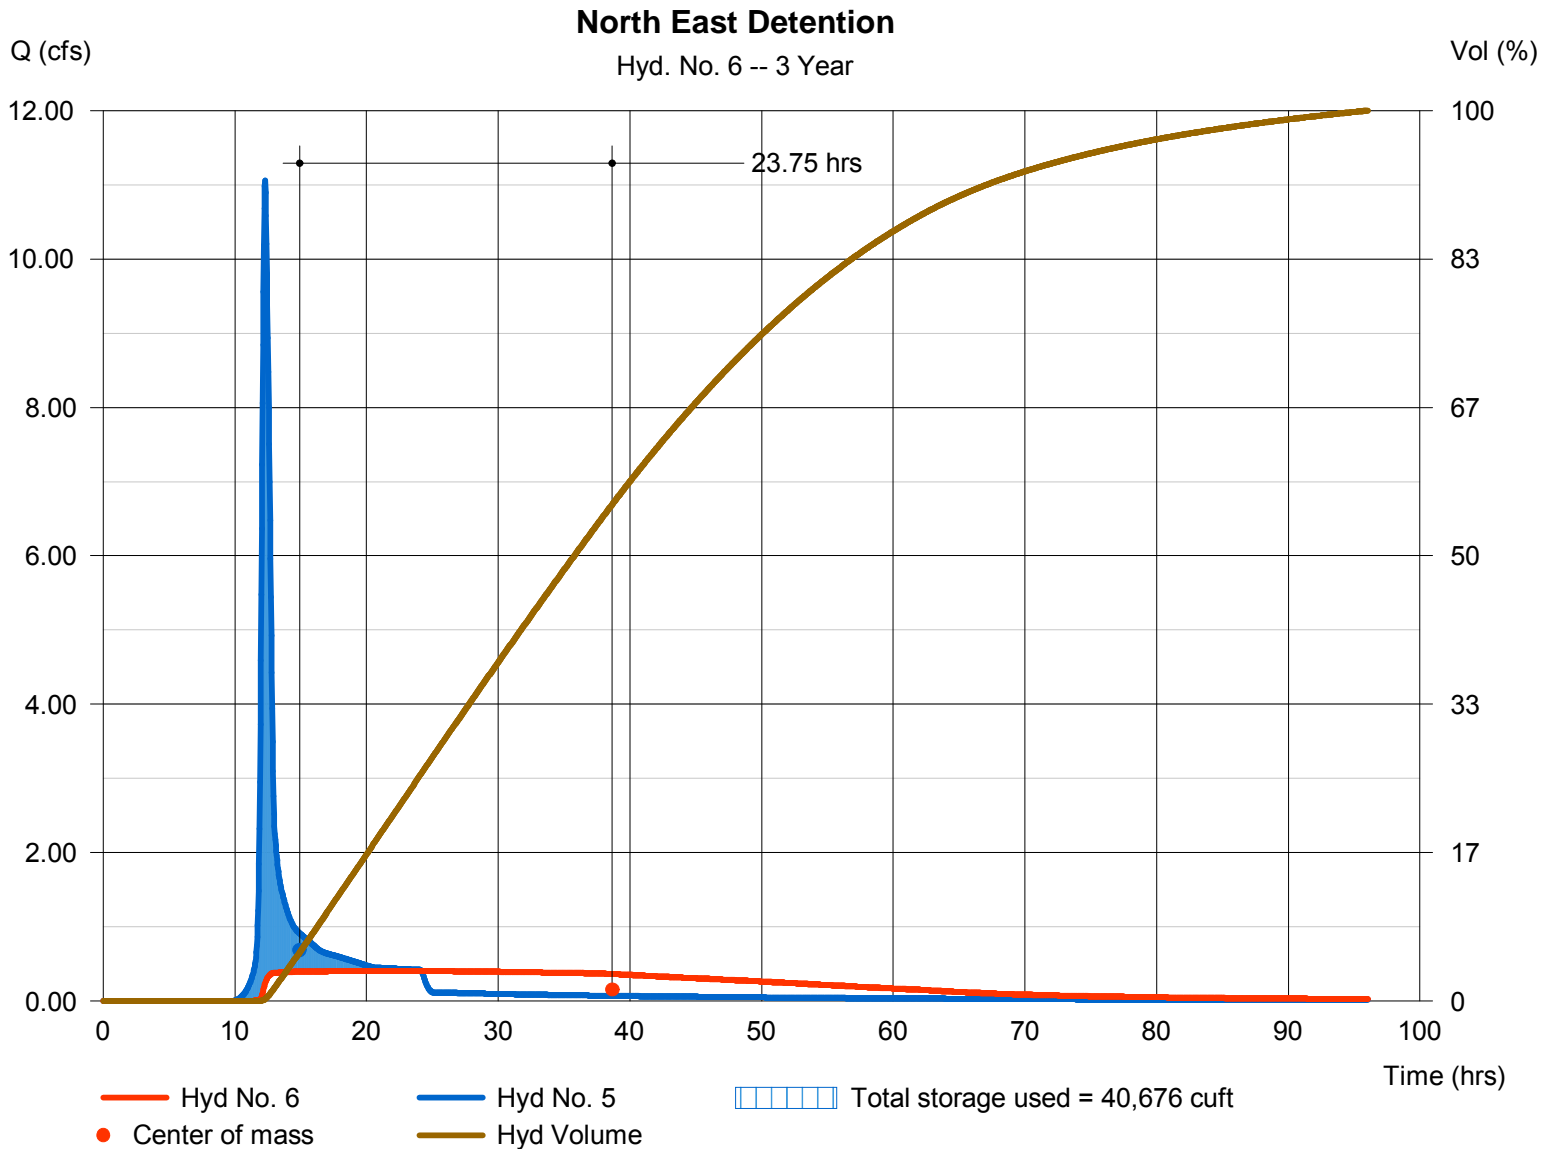

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 7.548 cfs
Storm frequency	= 3 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 21,423 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 1.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

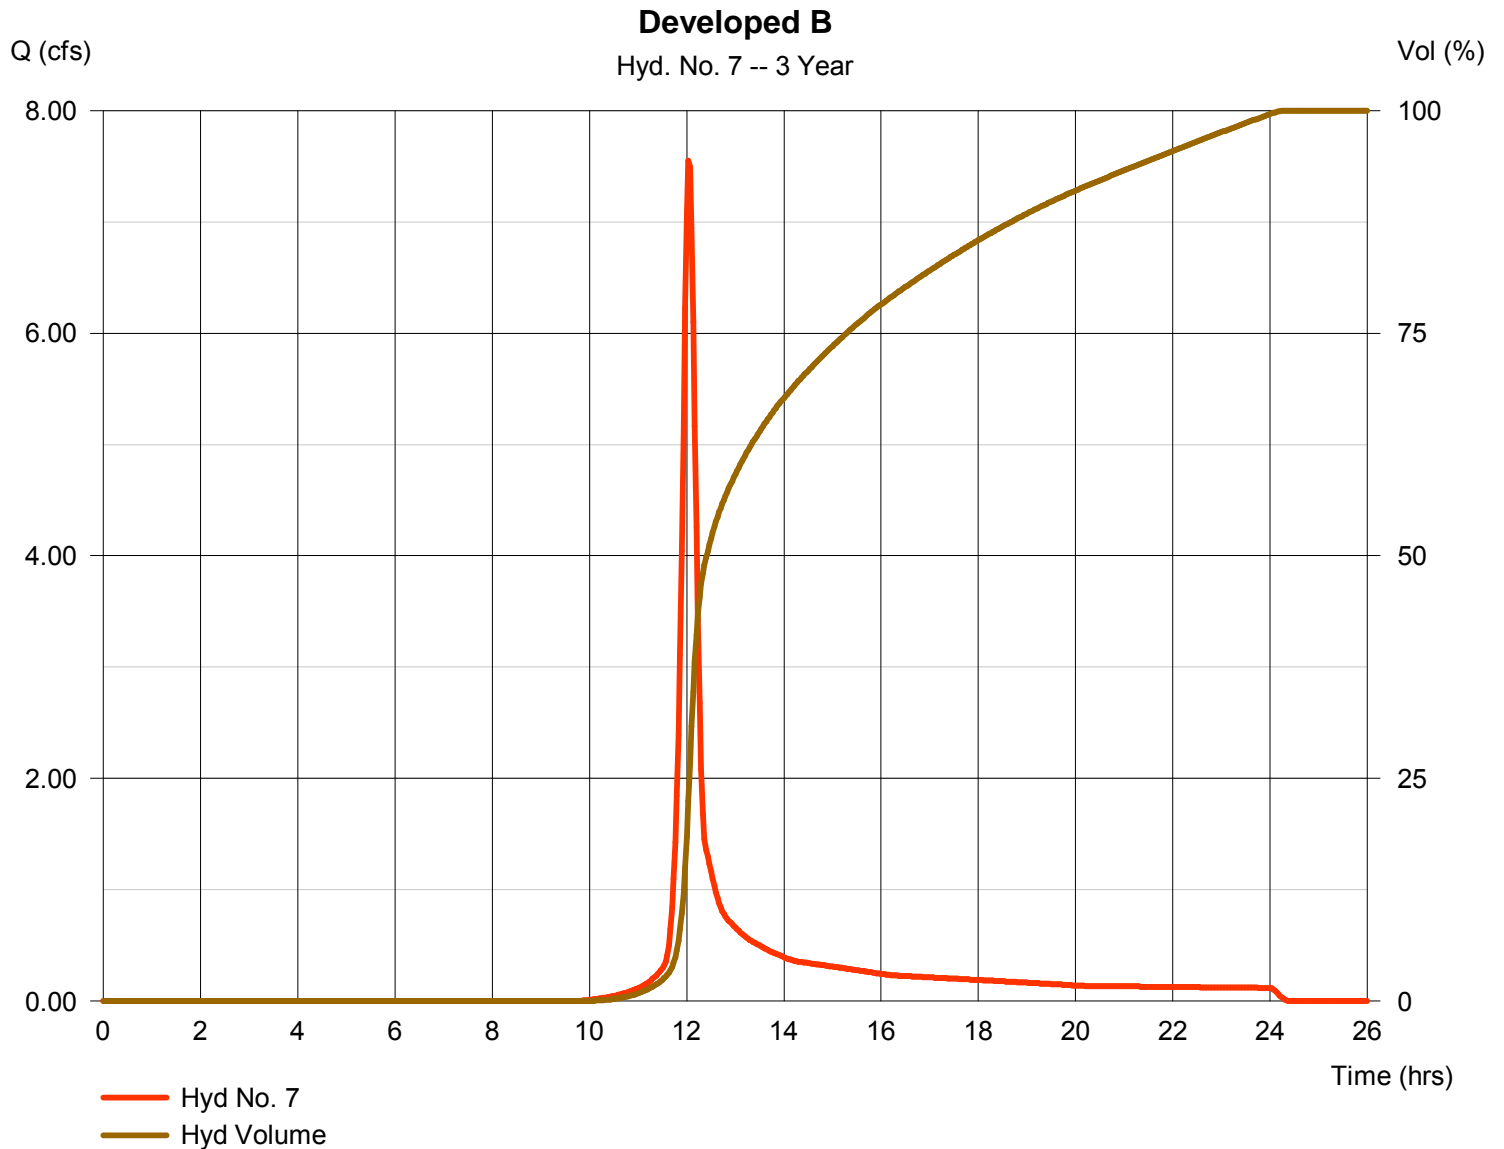

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 0.123 cfs
Storm frequency	= 3 yrs	Time to peak	= 23.07 hrs
Time interval	= 2 min	Hyd. volume	= 16,665 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1327.26 ft
Reservoir name	= South East Pond	Max. Storage	= 16,619 cuft

Storage Indication method used.

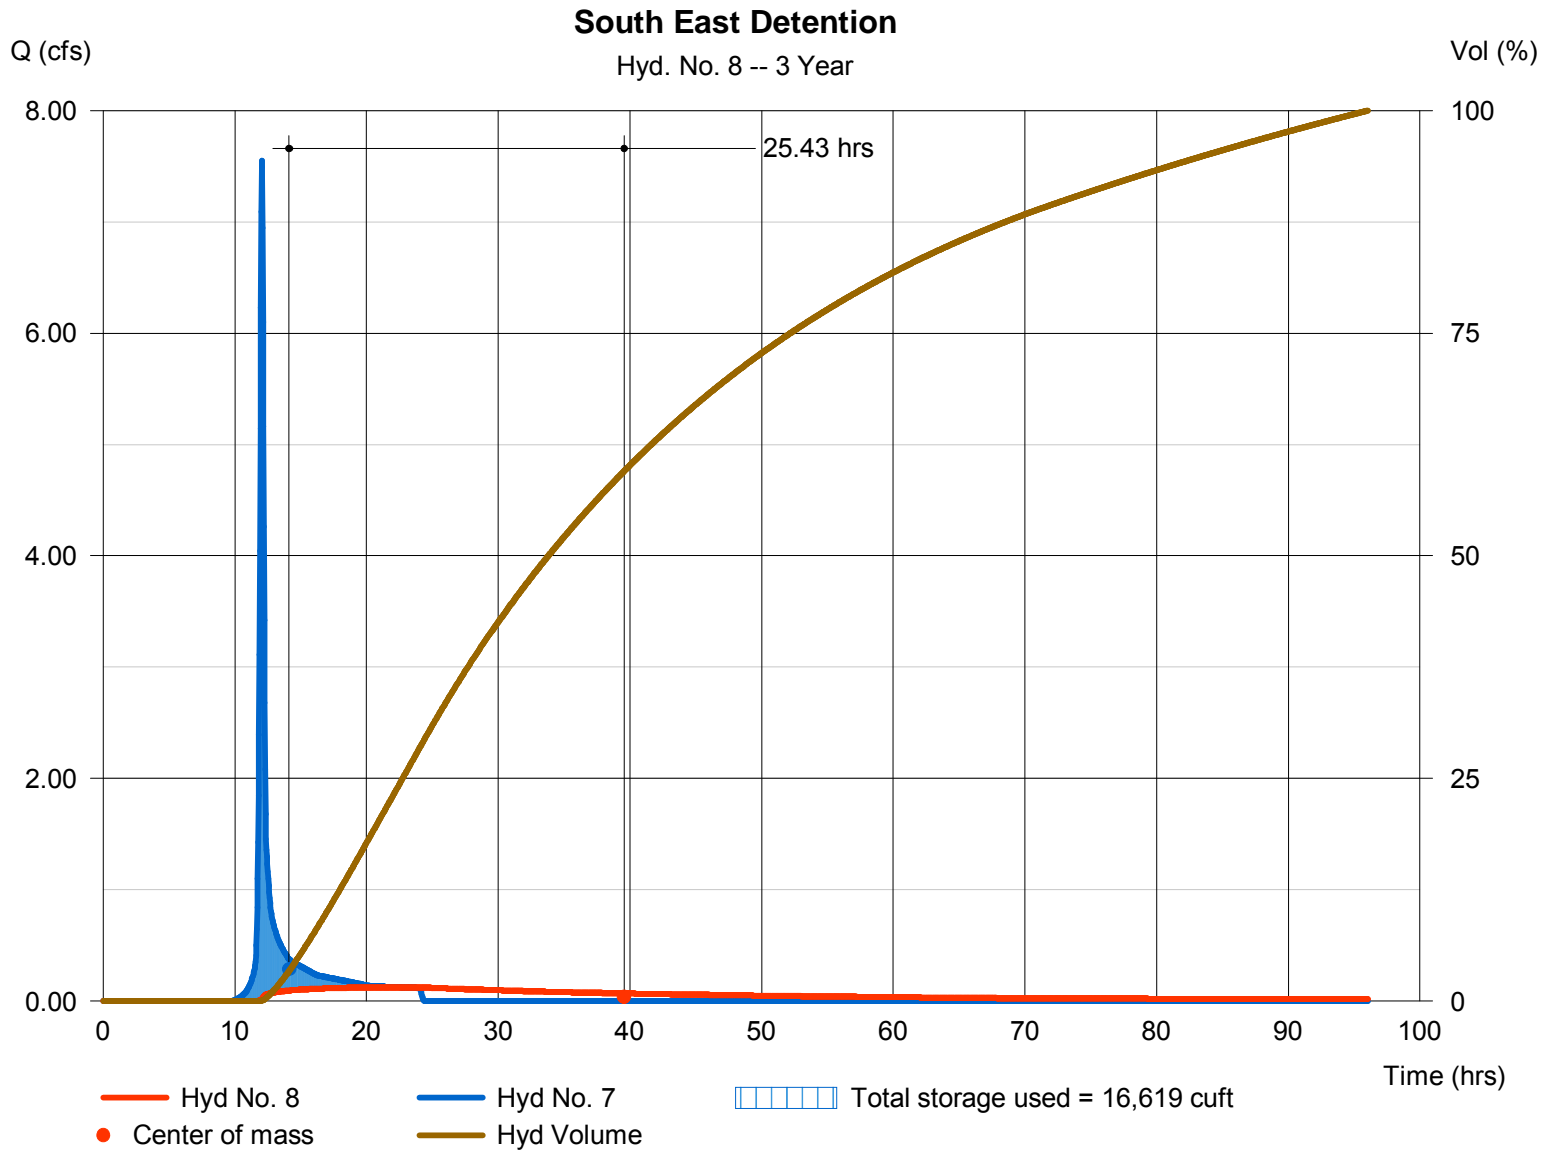

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 0.530 cfs
Storm frequency	= 3 yrs	Time to peak	= 23.77 hrs
Time interval	= 2 min	Hyd. volume	= 83,995 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

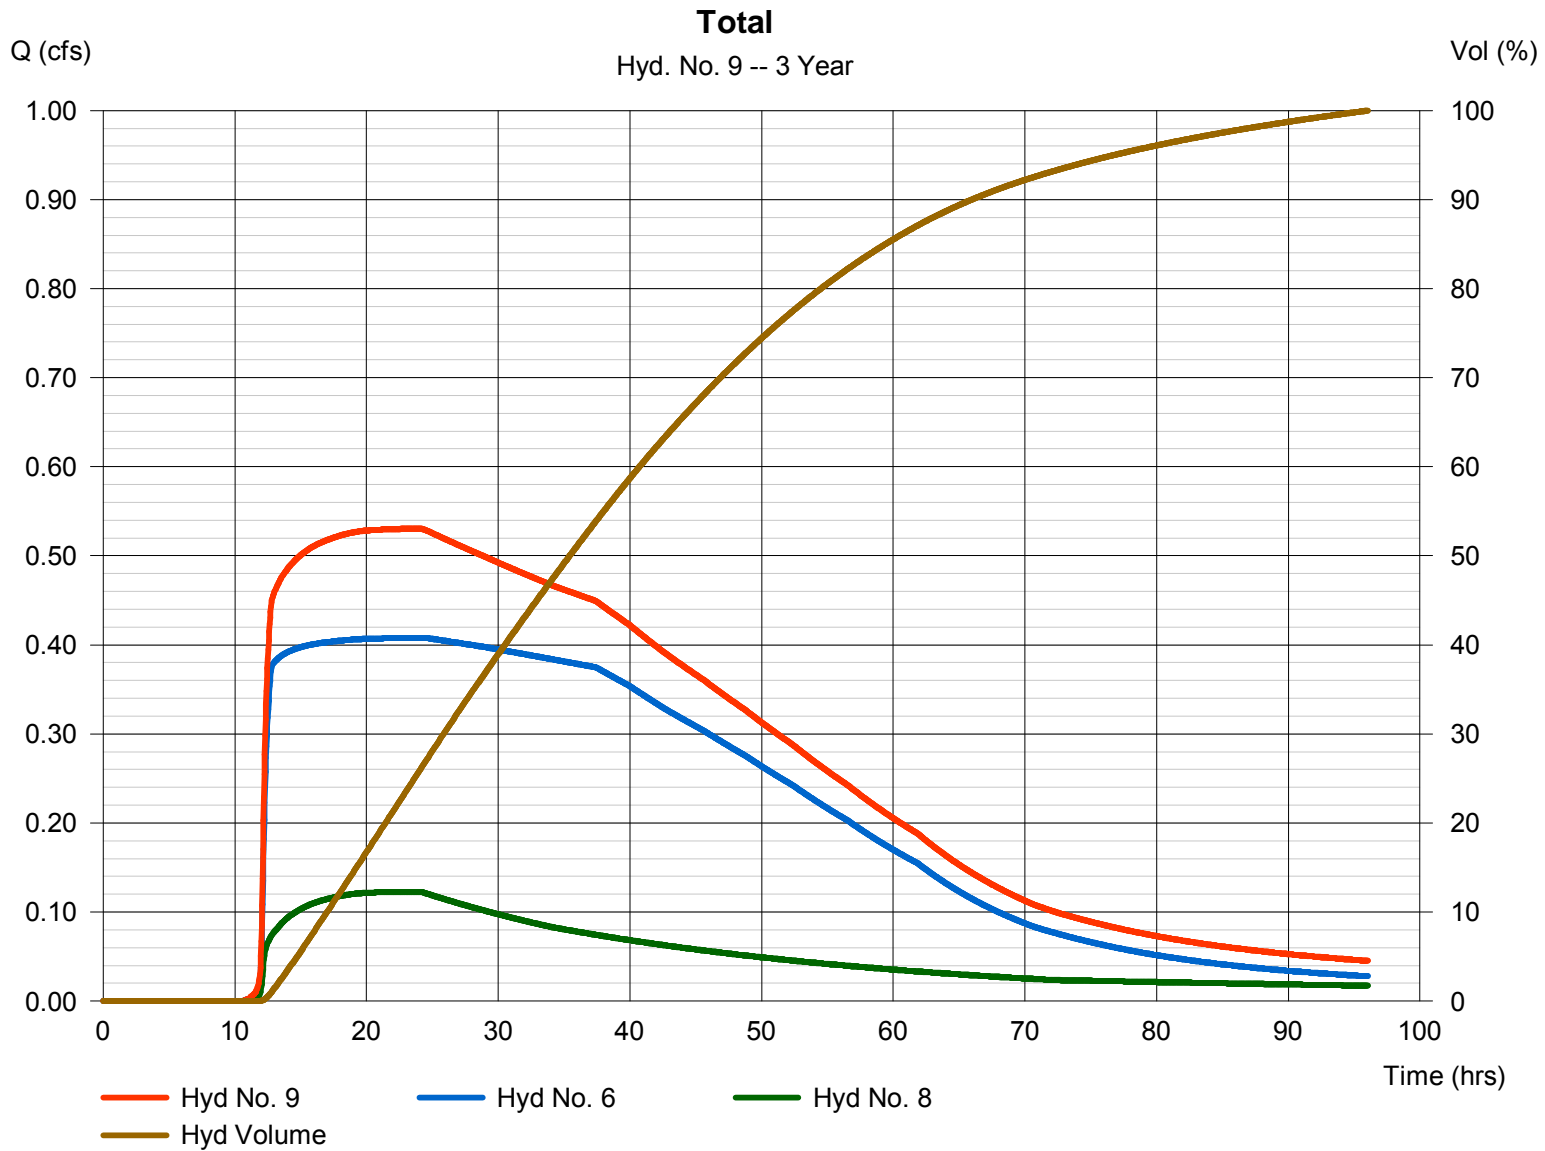

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 1.807 cfs
Storm frequency	= 3 yrs	Time to peak	= 13.30 hrs
Time interval	= 2 min	Hyd. volume	= 28,216 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 1.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

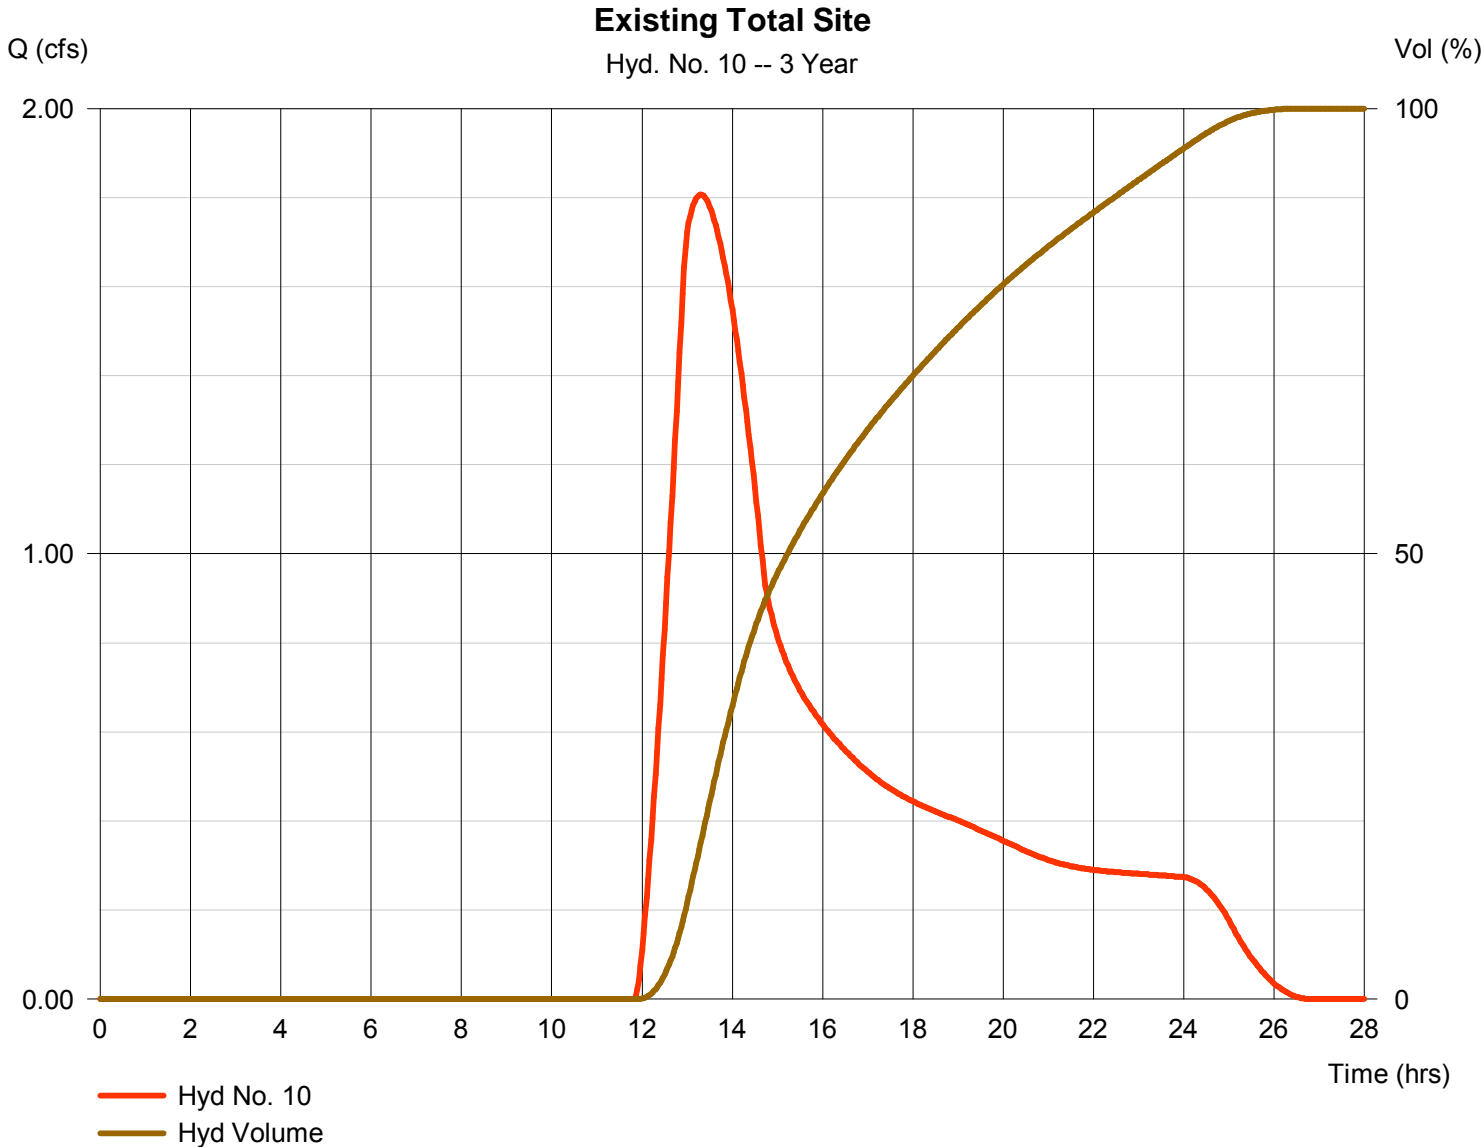

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	61.50	2	742	330,314	-----	-----	-----	Offsite West	
2	Reservoir	12.93	2	788	311,759	1	1336.45	173,631	Upper Pond	
3	Reach	12.80	2	798	311,697	2	-----	-----	Channel Section	
4	SCS Runoff	77.01	2	736	380,938	-----	-----	-----	Developed A	
5	Combine	77.32	2	736	692,634	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	24.76	2	780	627,751	5	1329.79	221,404	North East Detention	
7	SCS Runoff	50.93	2	722	148,566	-----	-----	-----	Developed B	
8	Reservoir	2.932	2	798	136,835	7	1328.29	95,999	South East Detention	
9	Combine	27.66	2	780	764,586	6, 8	-----	-----	Total	
10	SCS Runoff	45.85	2	778	453,924	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 5 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 61.50 cfs
Storm frequency	= 5 yrs	Time to peak	= 12.37 hrs
Time interval	= 2 min	Hyd. volume	= 330,314 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 4.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

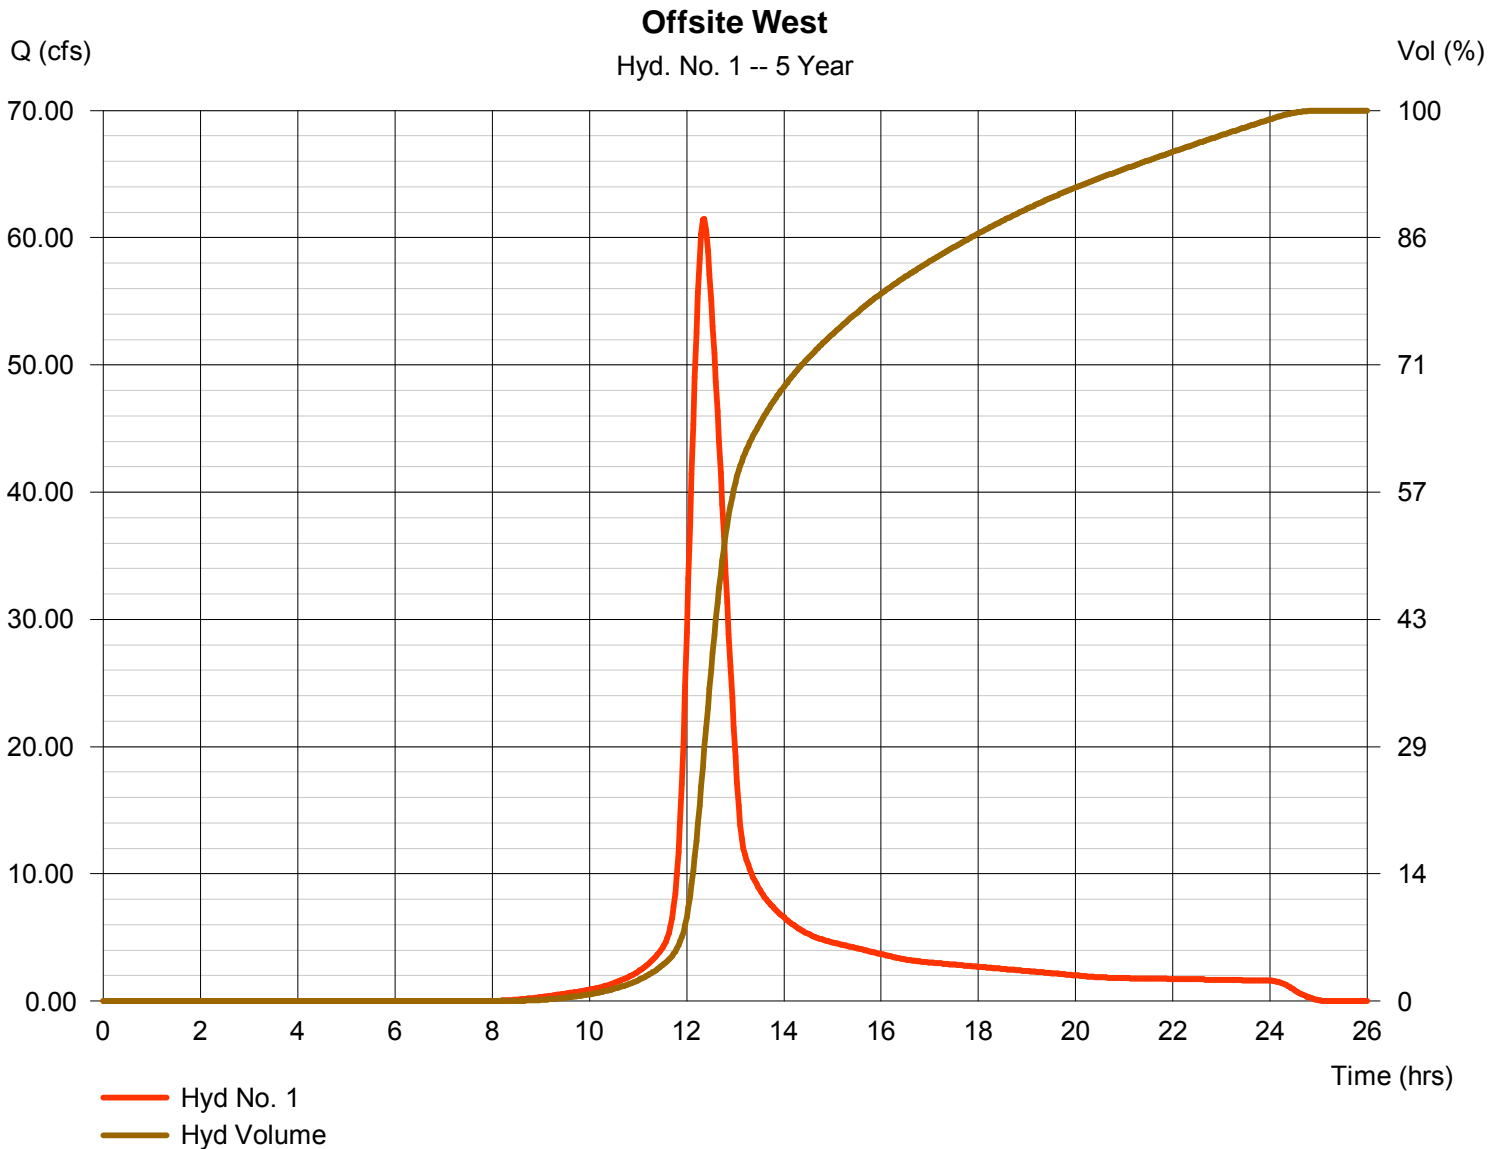

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 12.93 cfs
Storm frequency	= 5 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 311,759 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1336.45 ft
Reservoir name	= Upper Pond	Max. Storage	= 173,631 cuft

Storage Indication method used.

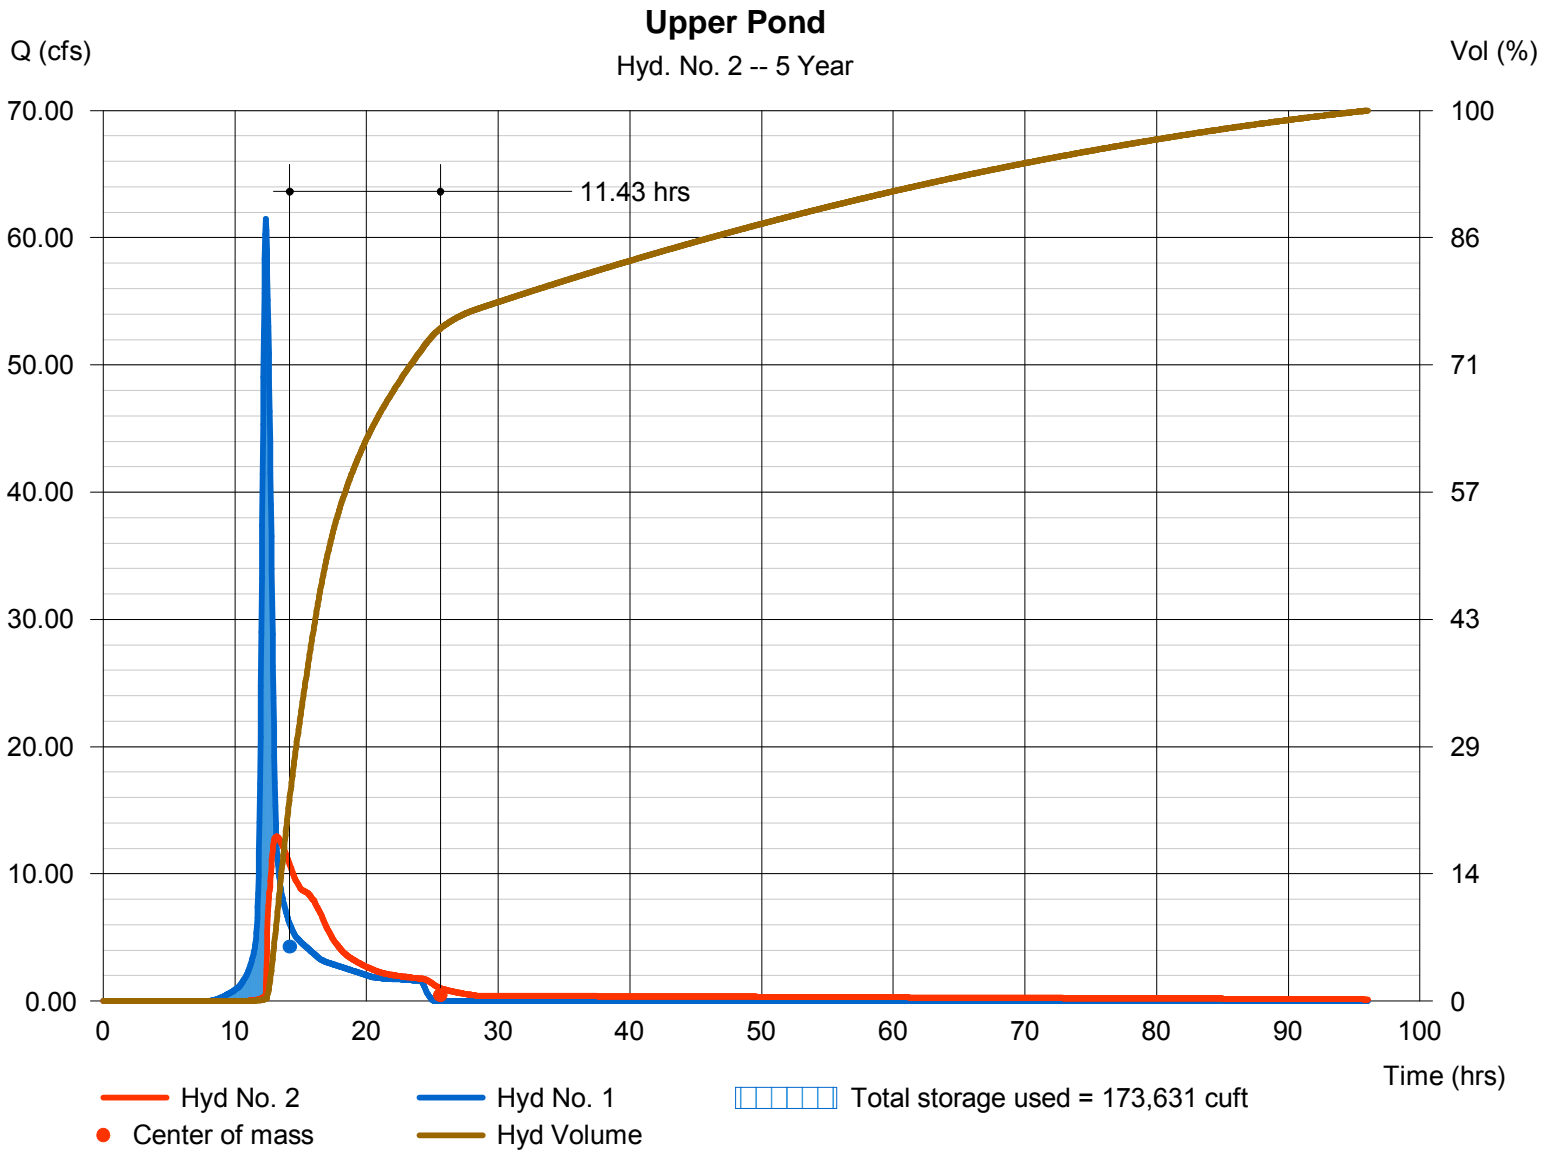

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 12.80 cfs
Storm frequency	= 5 yrs	Time to peak	= 13.30 hrs
Time interval	= 2 min	Hyd. volume	= 311,697 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.2641

Modified Att-Kin routing method used.

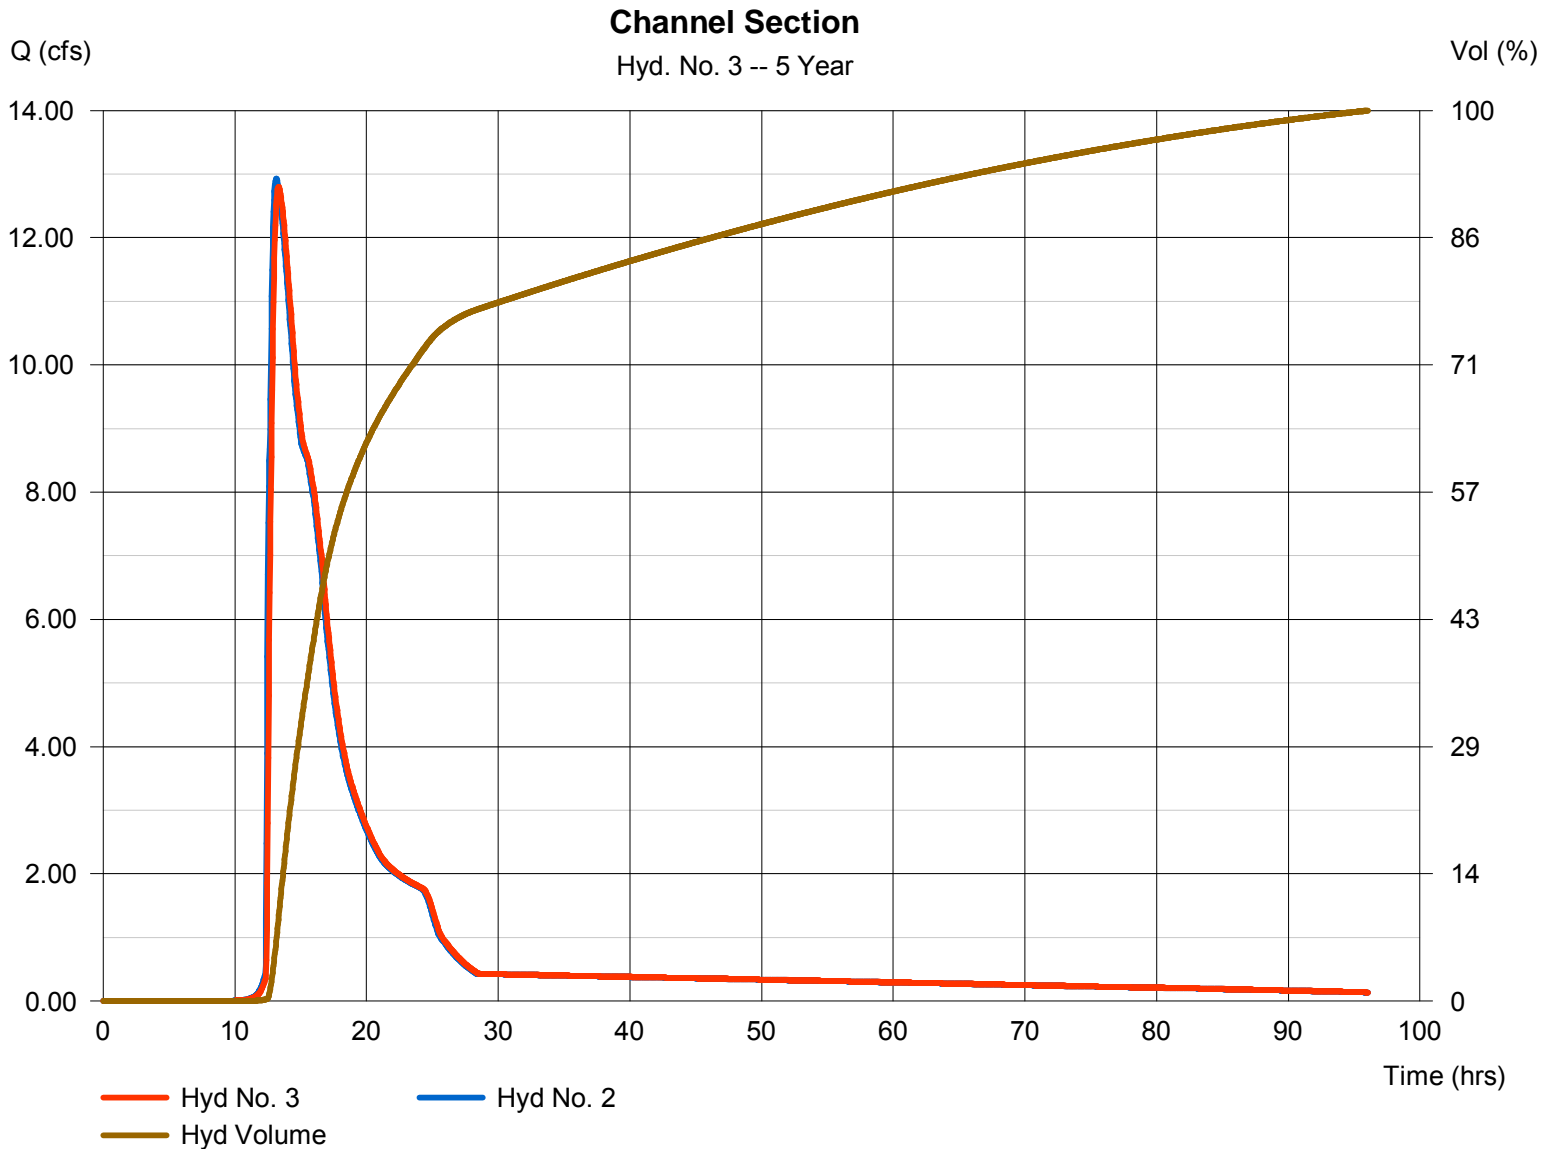

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 77.01 cfs
Storm frequency	= 5 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 380,938 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 4.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

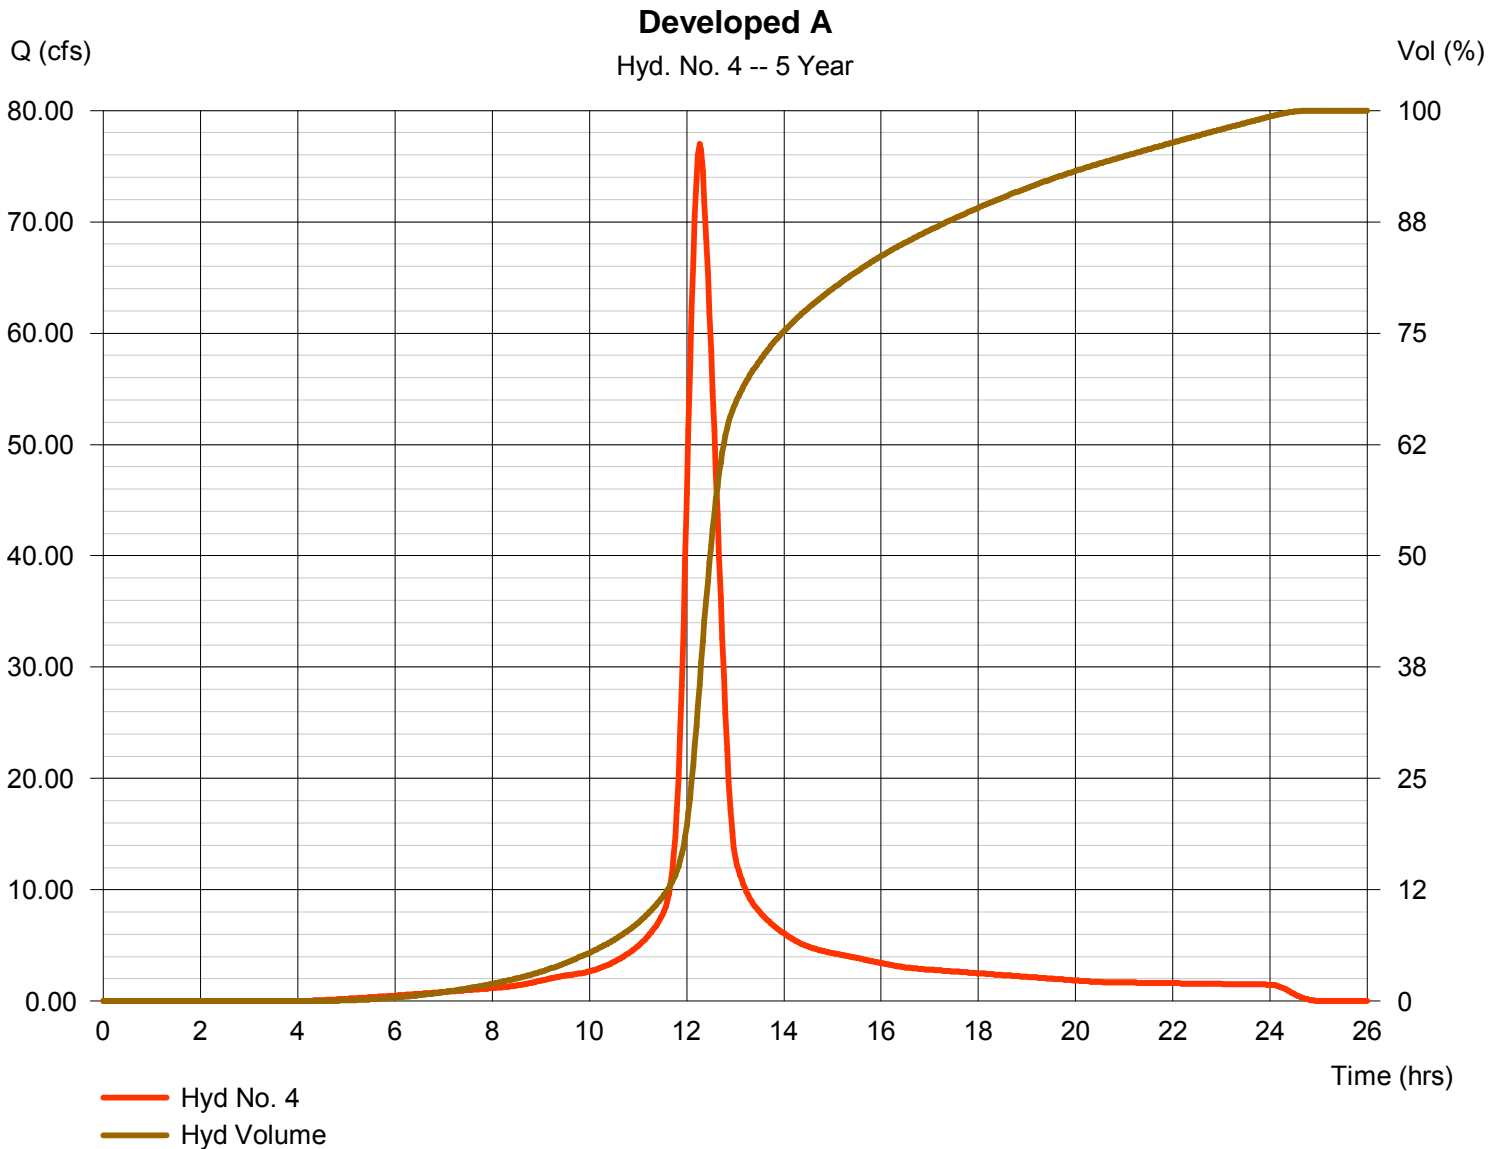

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 5

Runoff to North Pond

Hydrograph type = Combine
 Storm frequency = 5 yrs
 Time interval = 2 min
 Inflow hyds. = 3, 4

Peak discharge = 77.32 cfs
 Time to peak = 12.27 hrs
 Hyd. volume = 692,634 cuft
 Contrib. drain. area = 30.000 ac

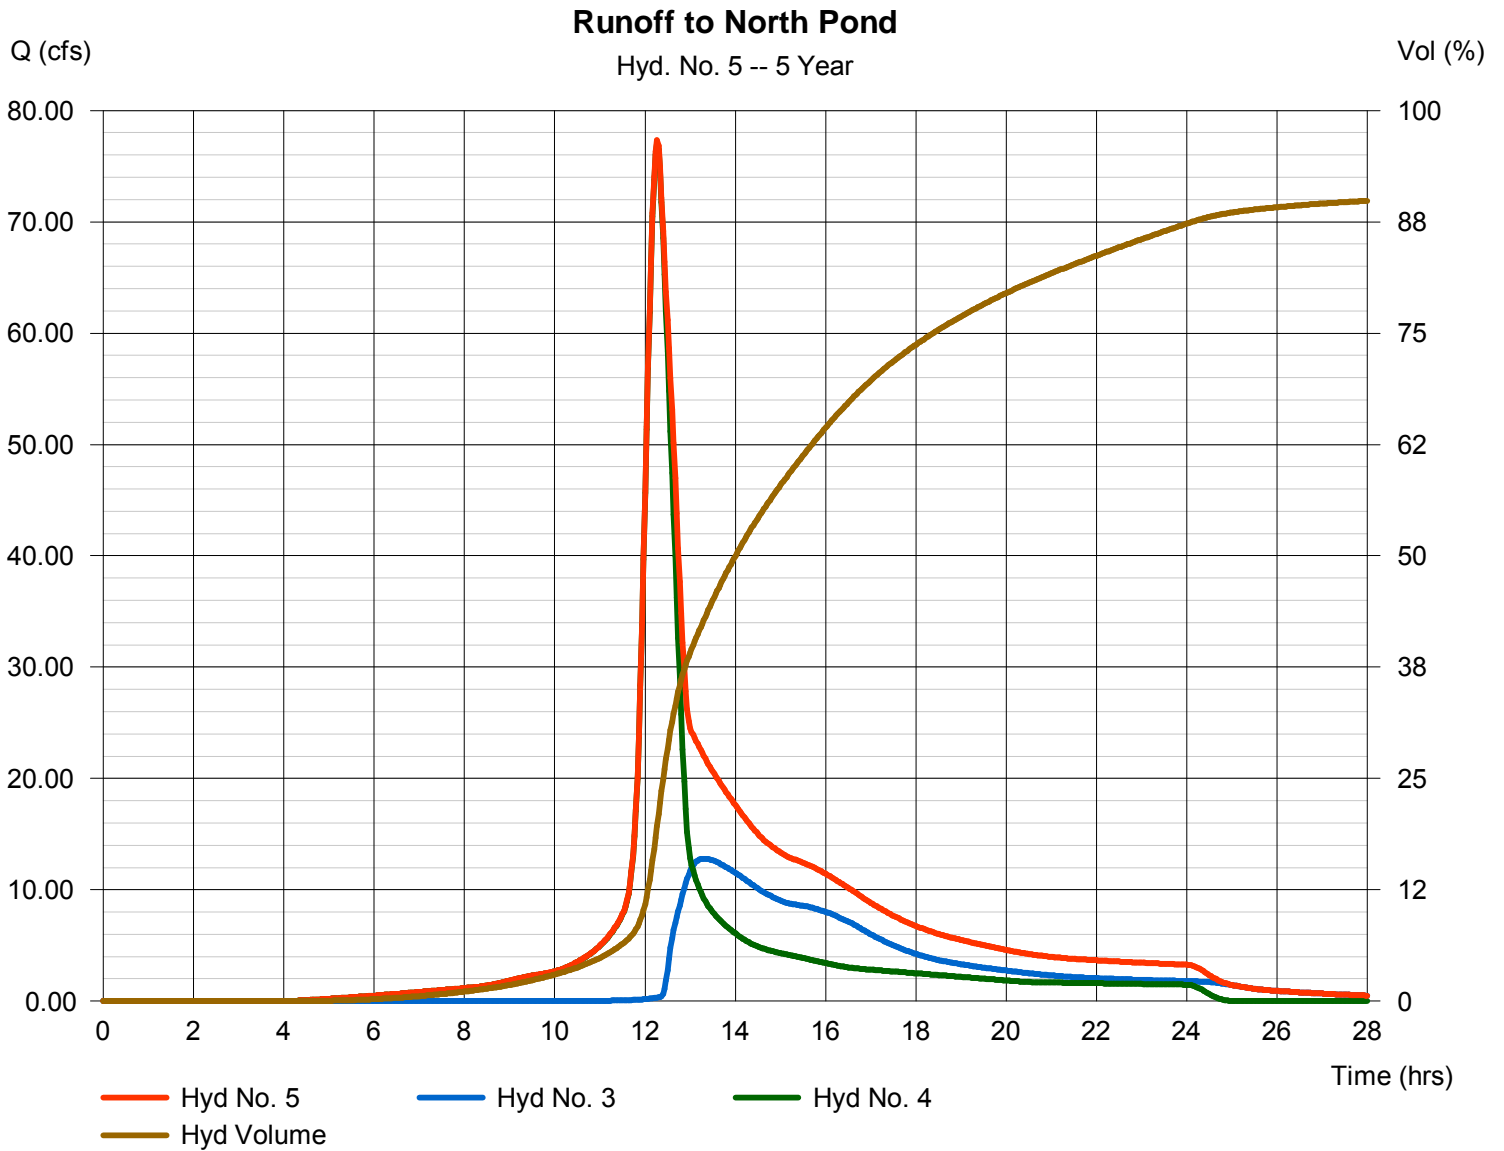

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 24.76 cfs
Storm frequency	= 5 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 627,751 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1329.79 ft
Reservoir name	= North East Pond	Max. Storage	= 221,404 cuft

Storage Indication method used.

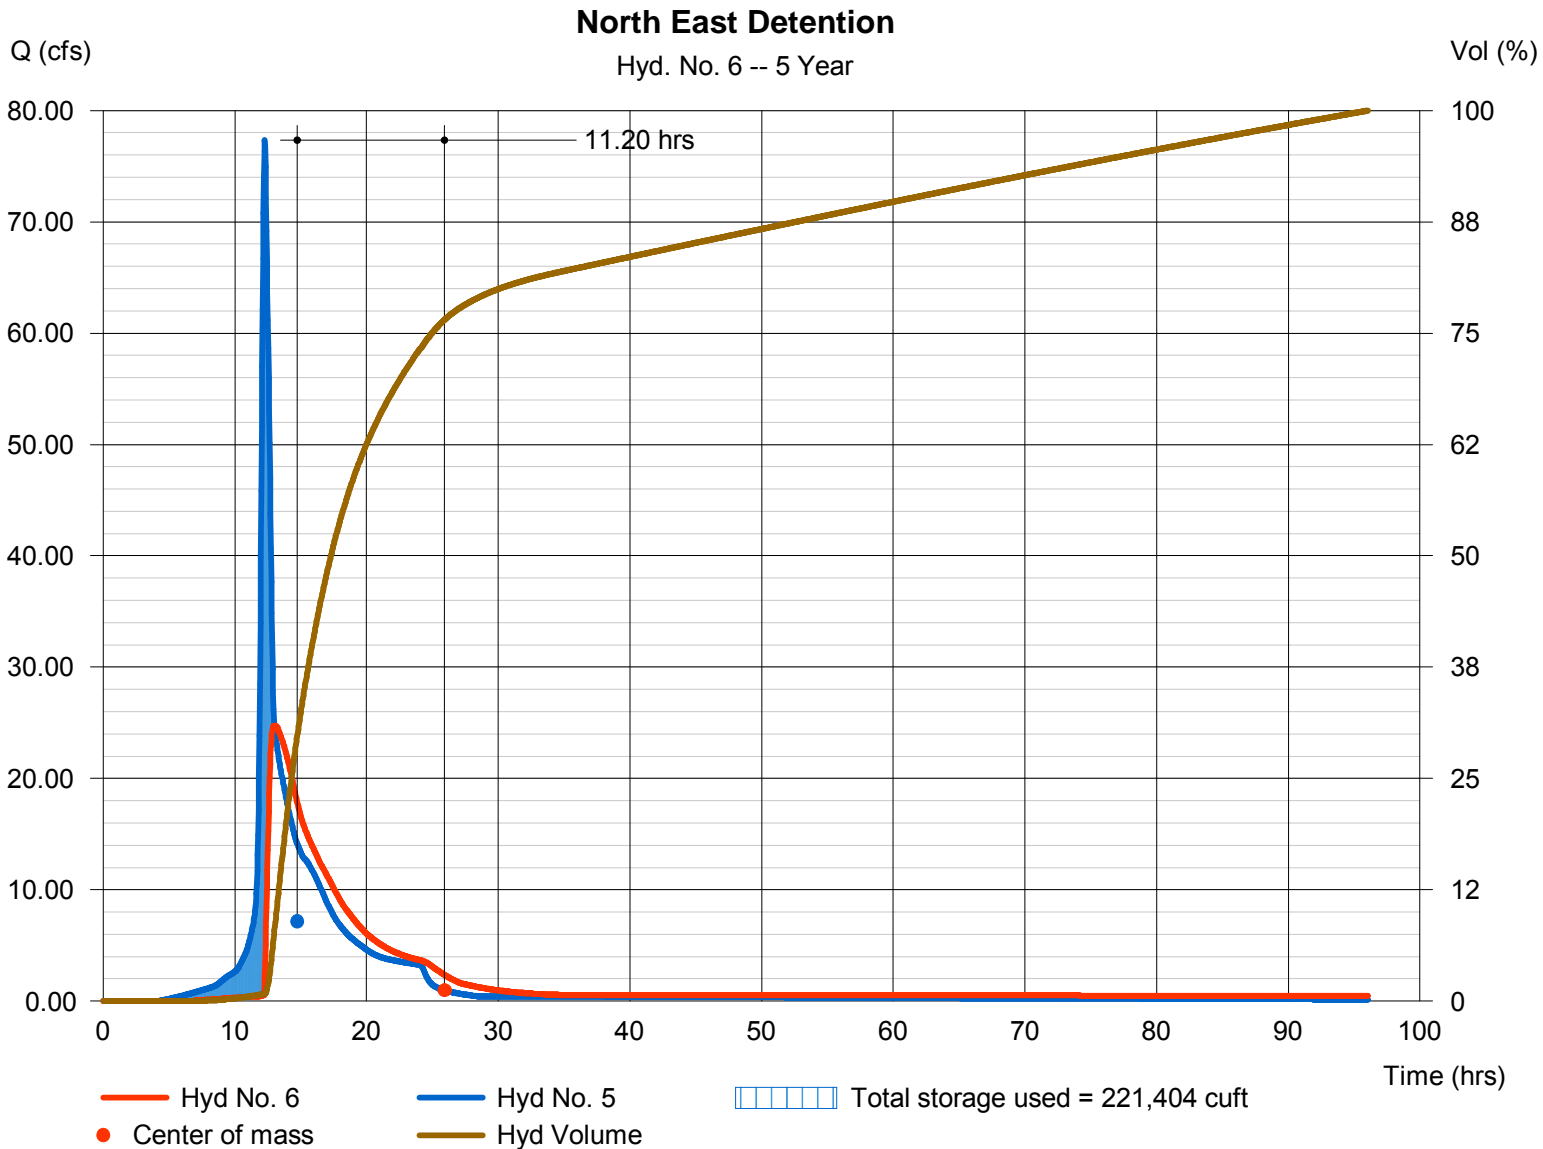

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 50.93 cfs
Storm frequency	= 5 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 148,566 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 4.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

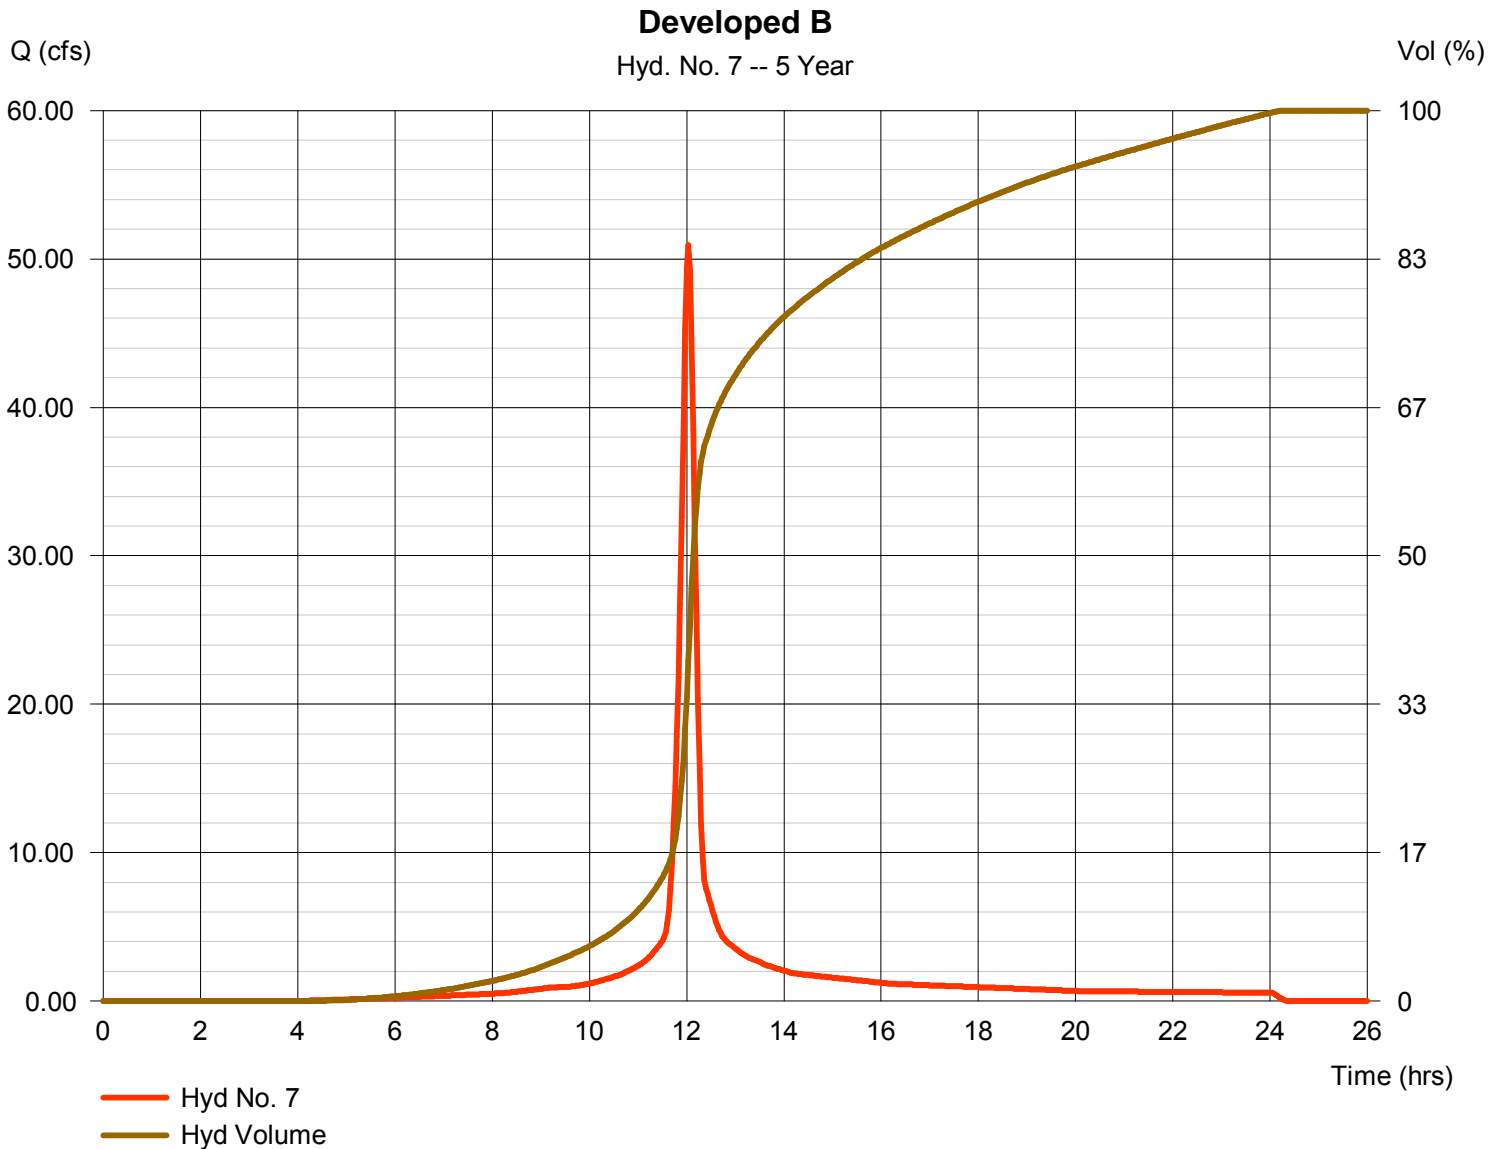

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 2.932 cfs
Storm frequency	= 5 yrs	Time to peak	= 13.30 hrs
Time interval	= 2 min	Hyd. volume	= 136,835 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1328.29 ft
Reservoir name	= South East Pond	Max. Storage	= 95,999 cuft

Storage Indication method used.

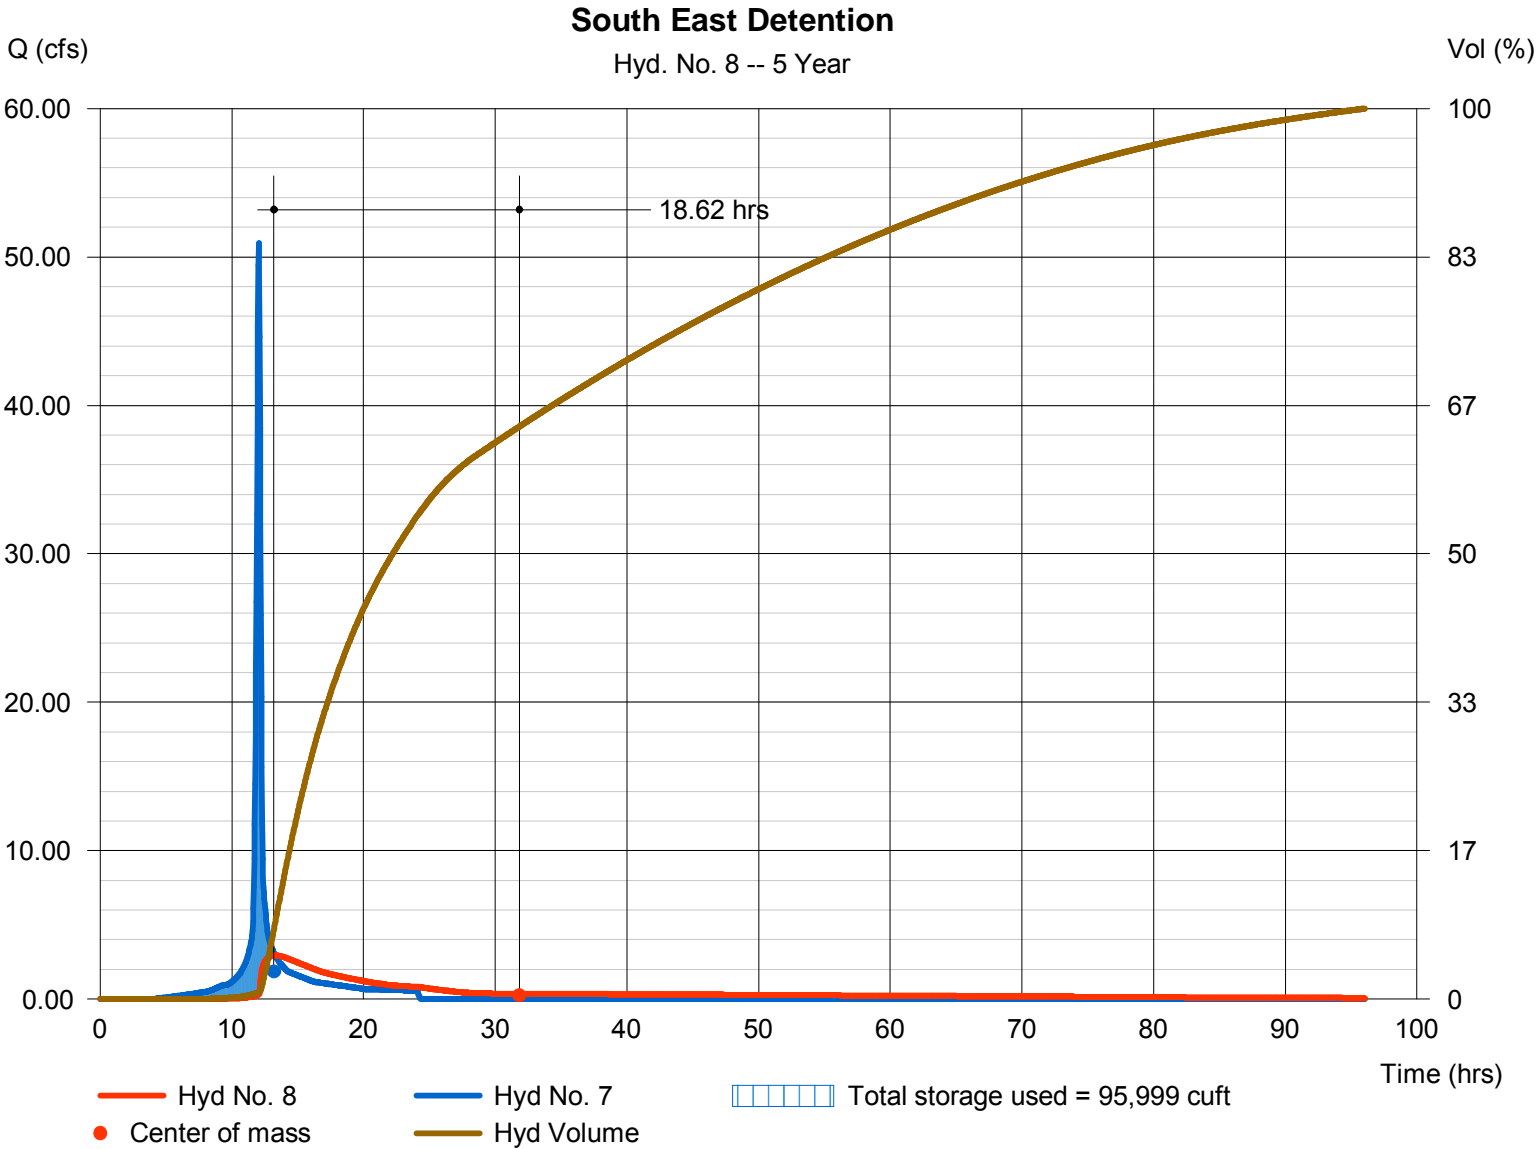

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 27.66 cfs
Storm frequency	= 5 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 764,586 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

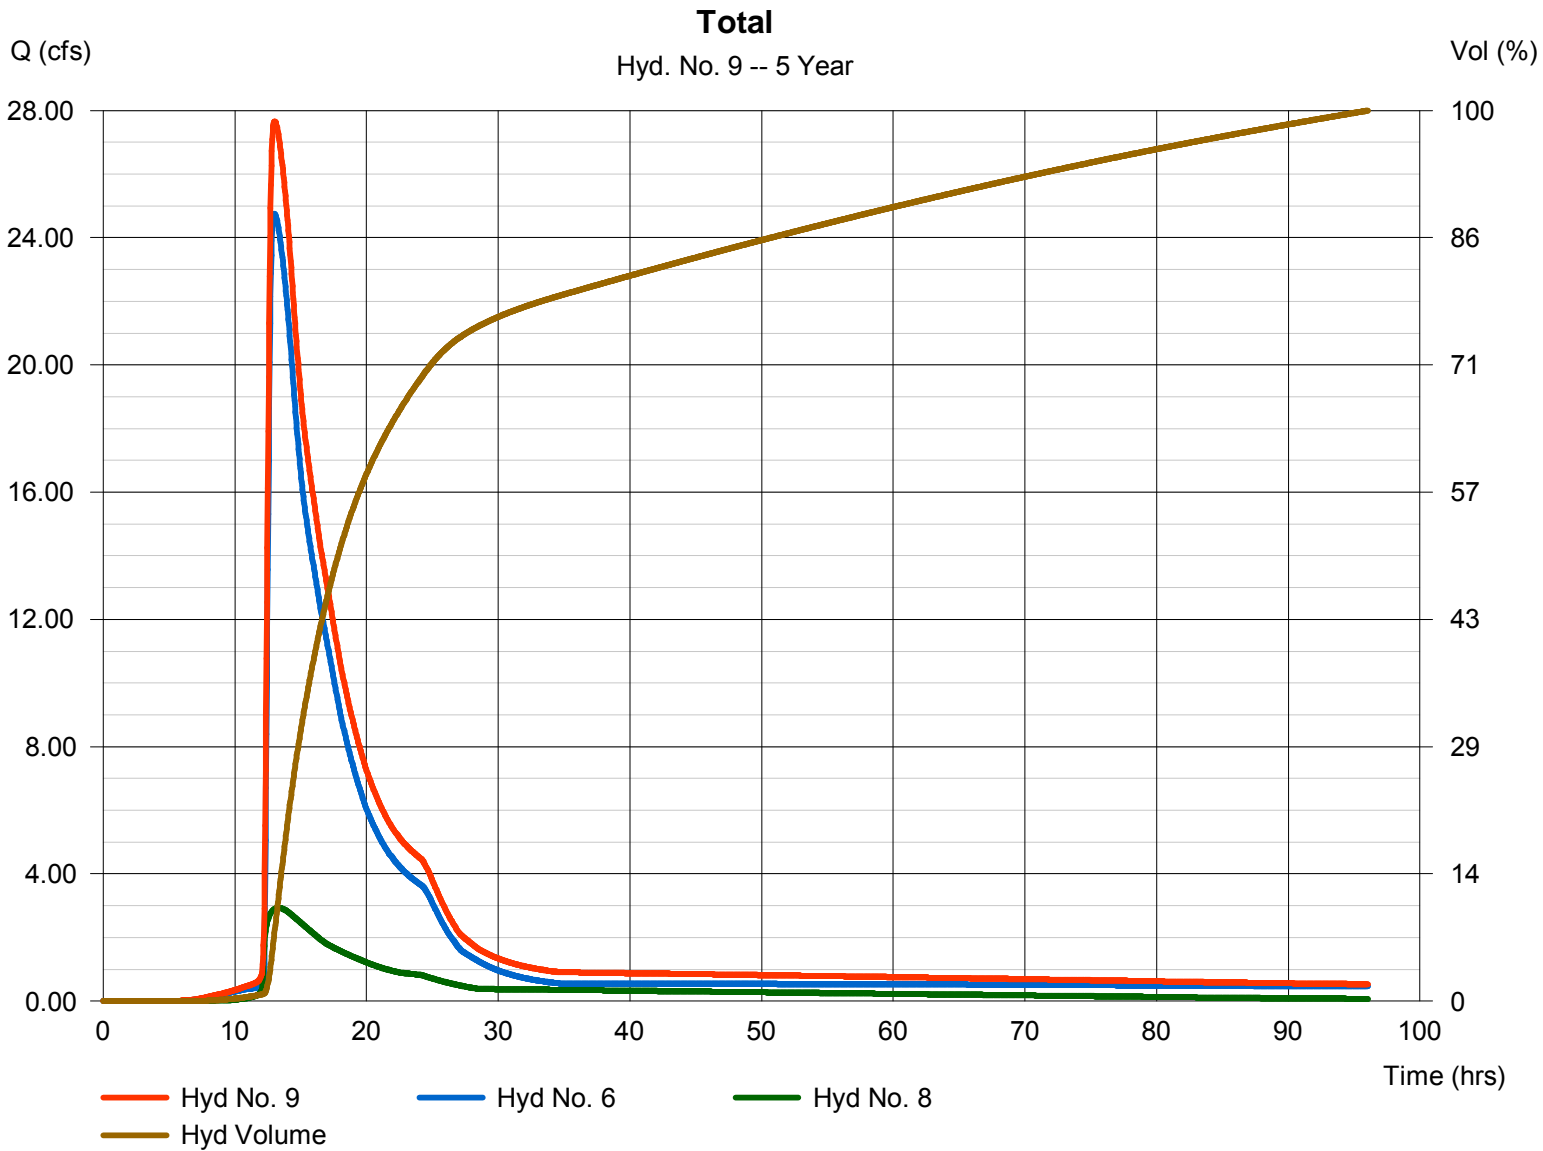

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 45.85 cfs
Storm frequency	= 5 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 453,924 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 4.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

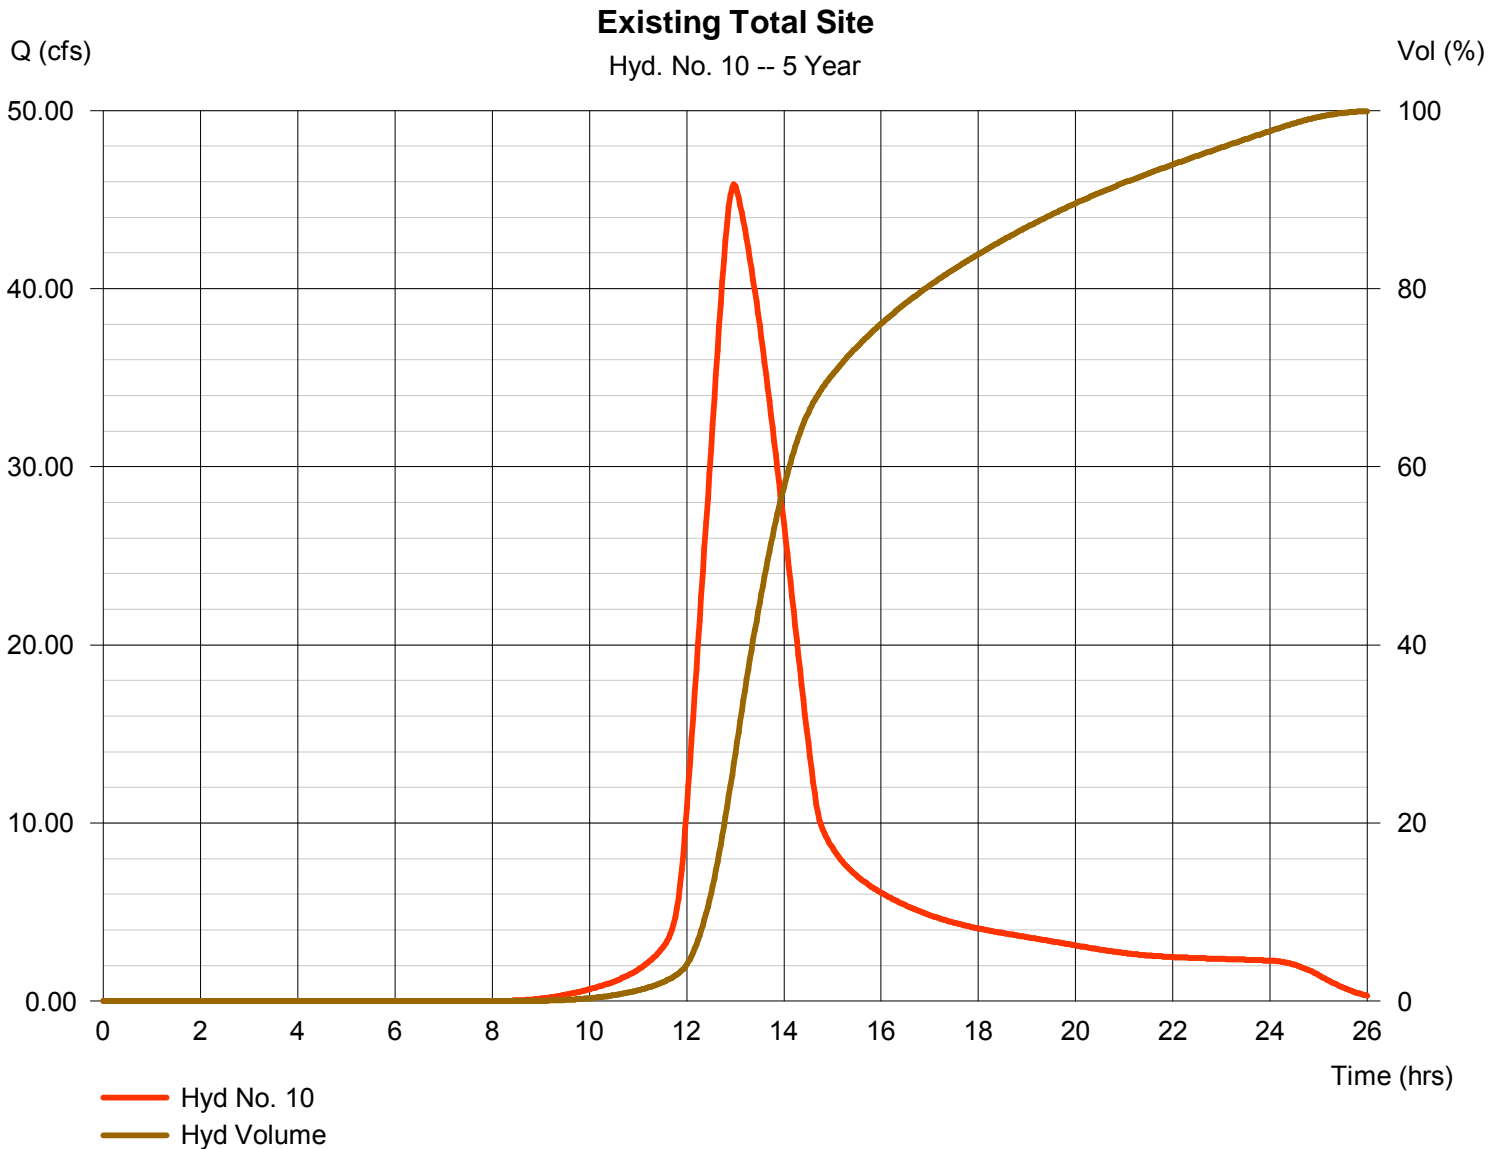

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	76.81	2	740	411,703	-----	-----	-----	Offsite West	
2	Reservoir	23.63	2	780	393,002	1	1336.88	207,395	Upper Pond	
3	Reach	23.08	2	788	392,947	2	-----	-----	Channel Section	
4	SCS Runoff	91.26	2	736	454,816	-----	-----	-----	Developed A	
5	Combine	91.75	2	736	847,764	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	35.67	2	788	782,532	5	1330.08	260,464	North East Detention	
7	SCS Runoff	60.22	2	722	177,378	-----	-----	-----	Developed B	
8	Reservoir	4.632	2	770	165,503	7	1328.43	110,641	South East Detention	
9	Combine	40.26	2	788	948,036	6, 8	-----	-----	Total	
10	SCS Runoff	57.44	2	778	565,770	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 10 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 76.81 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.33 hrs
Time interval	= 2 min	Hyd. volume	= 411,703 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 5.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

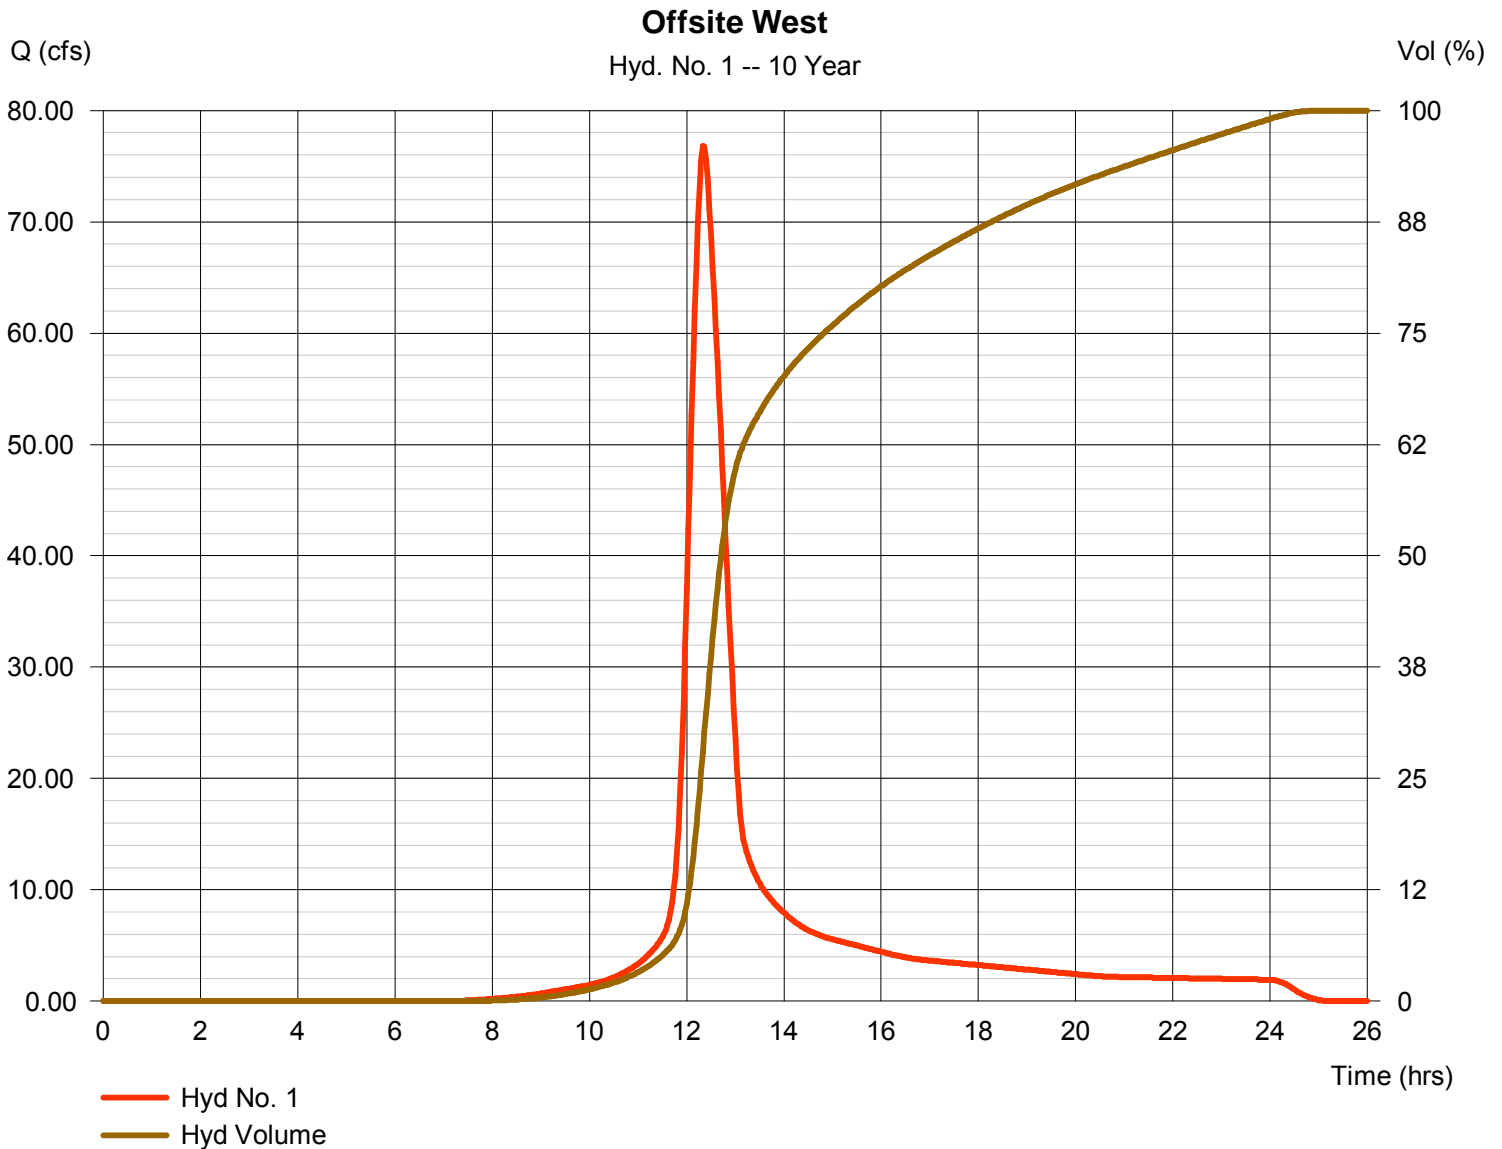

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 23.63 cfs
Storm frequency	= 10 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 393,002 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1336.88 ft
Reservoir name	= Upper Pond	Max. Storage	= 207,395 cuft

Storage Indication method used.

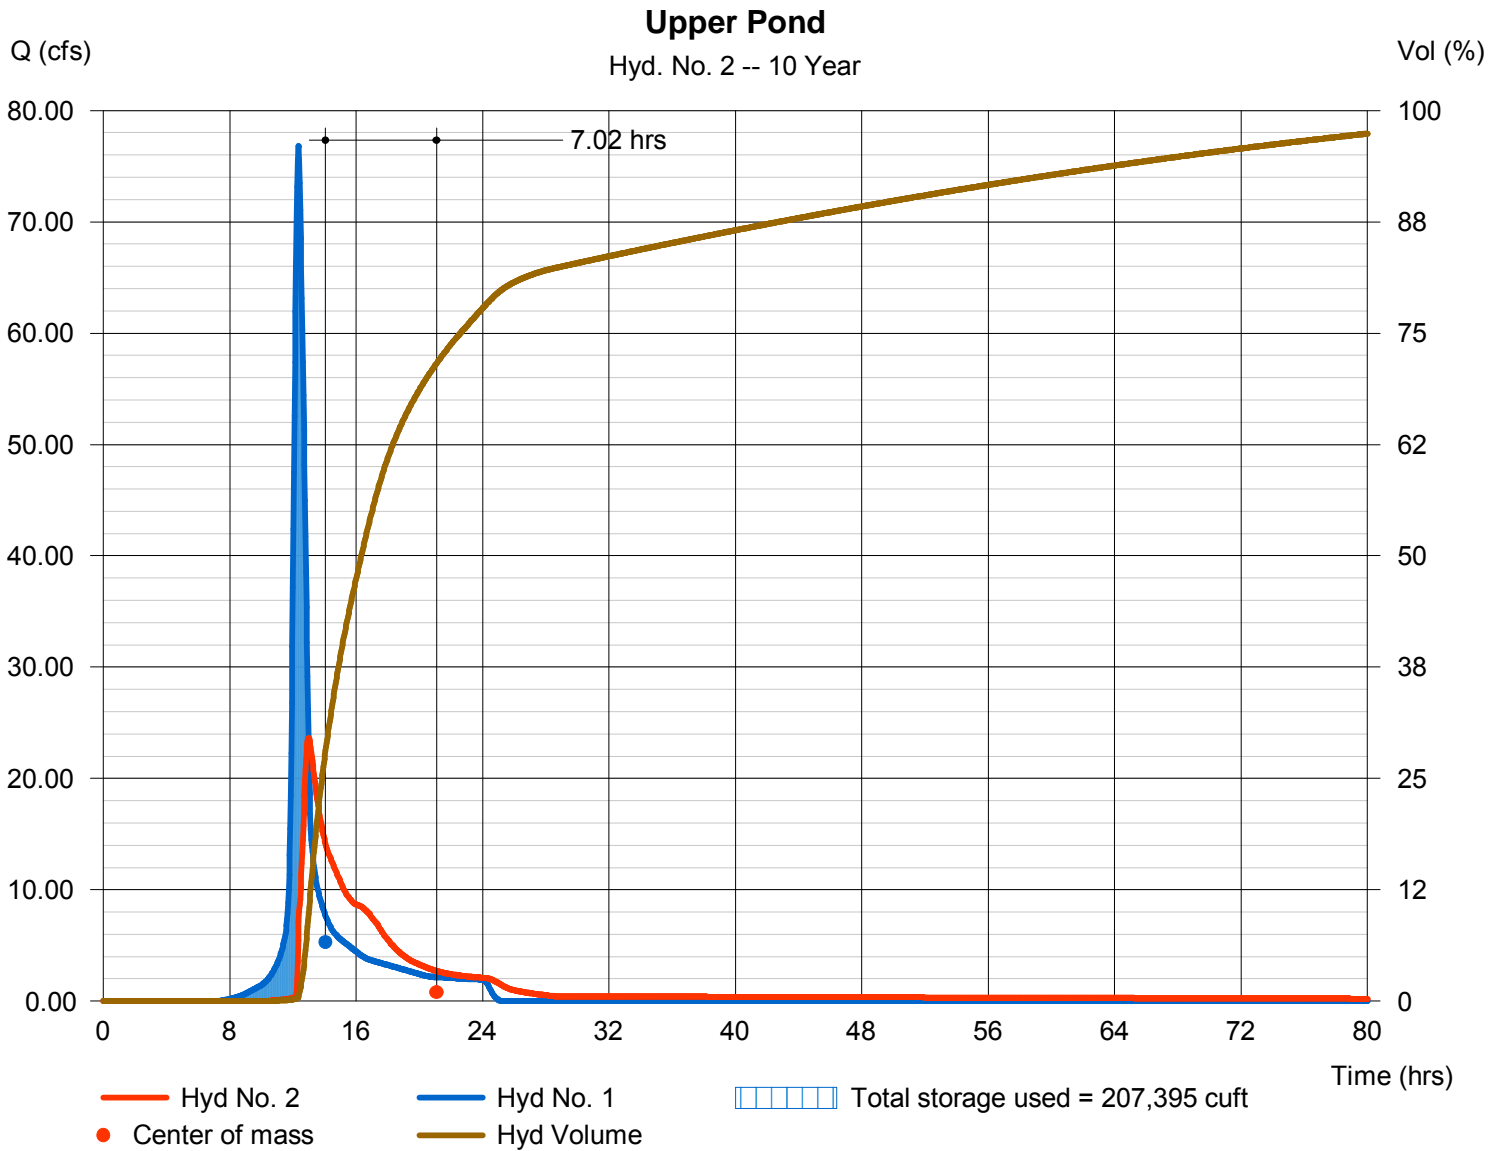

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 23.08 cfs
Storm frequency	= 10 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 392,947 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.3012

Modified Att-Kin routing method used.

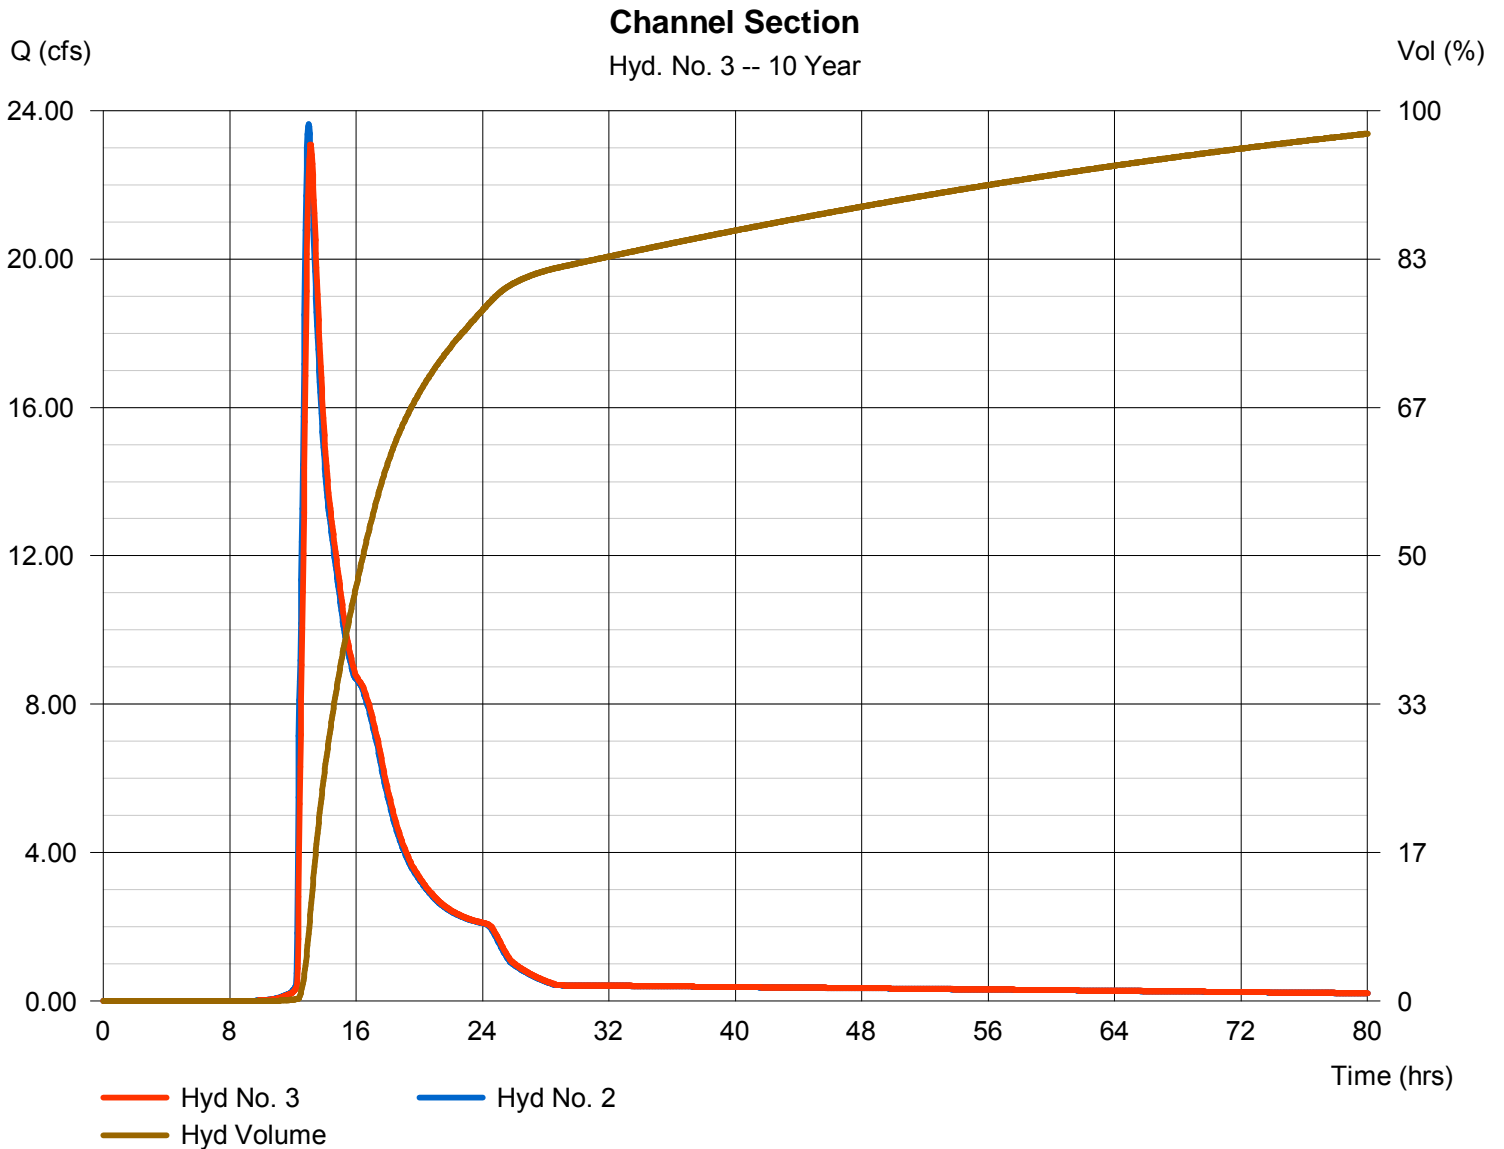

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 91.26 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 454,816 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 5.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

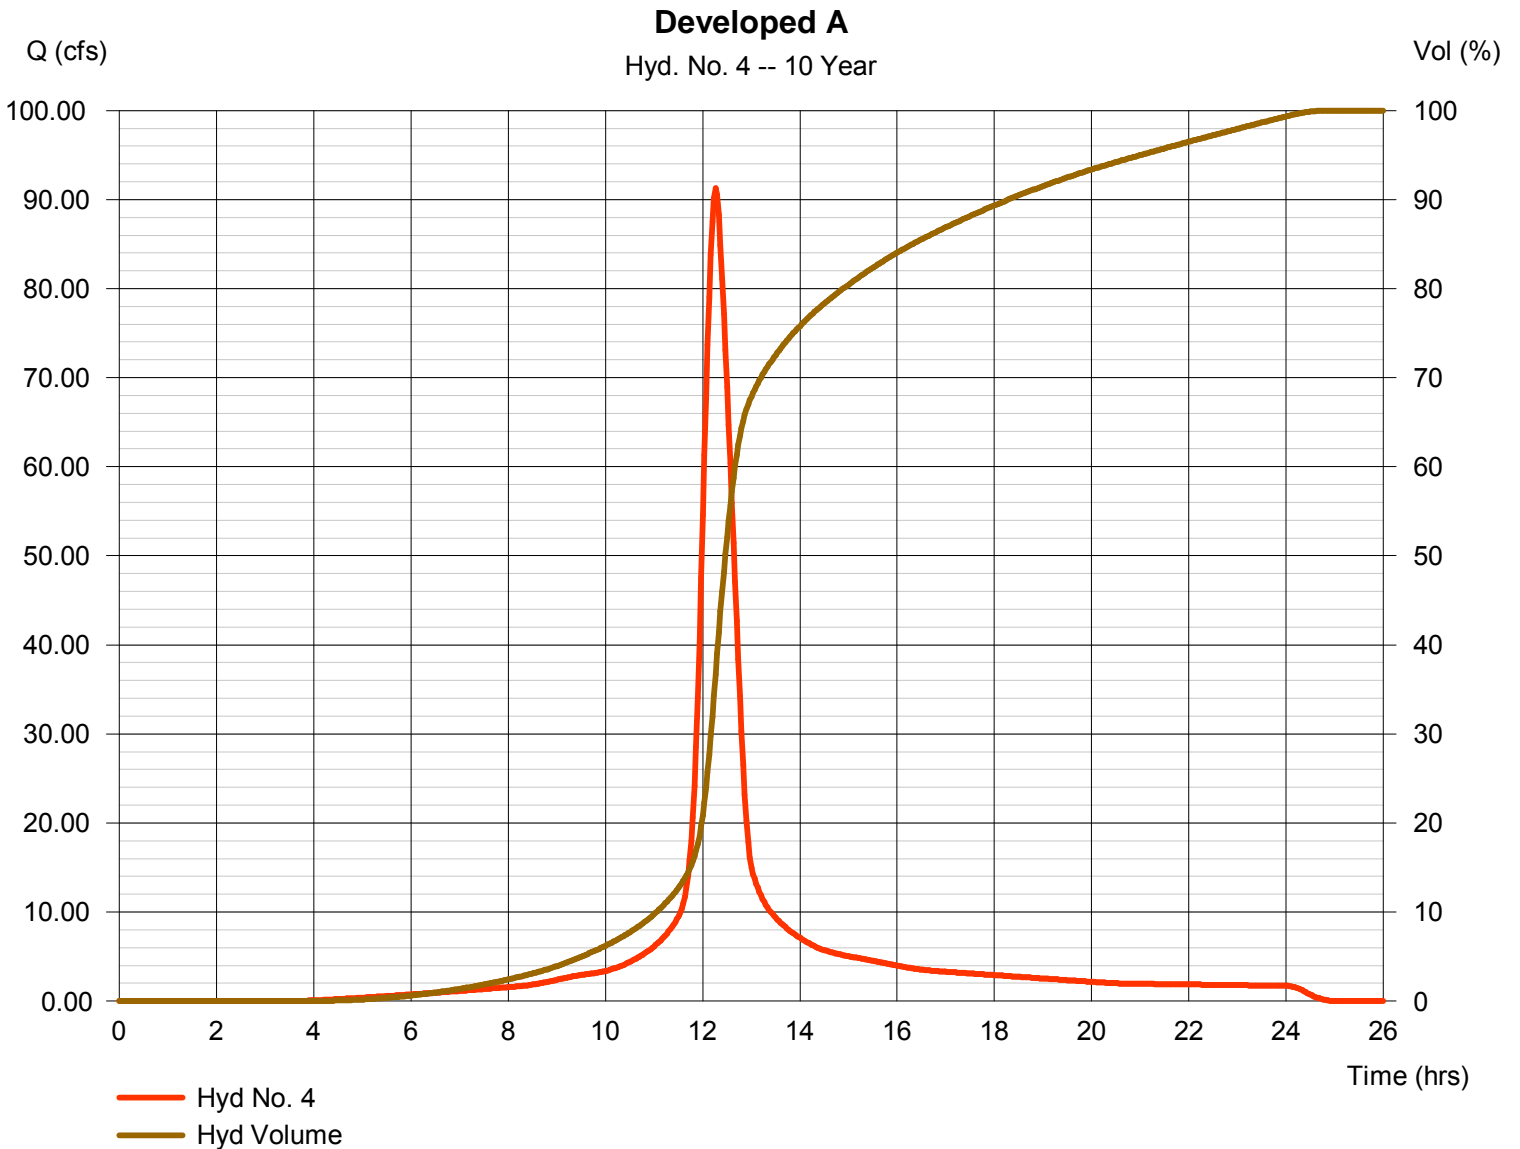

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 5

Runoff to North Pond

Hydrograph type = Combine
 Storm frequency = 10 yrs
 Time interval = 2 min
 Inflow hyds. = 3, 4

Peak discharge = 91.75 cfs
 Time to peak = 12.27 hrs
 Hyd. volume = 847,764 cuft
 Contrib. drain. area = 30.000 ac

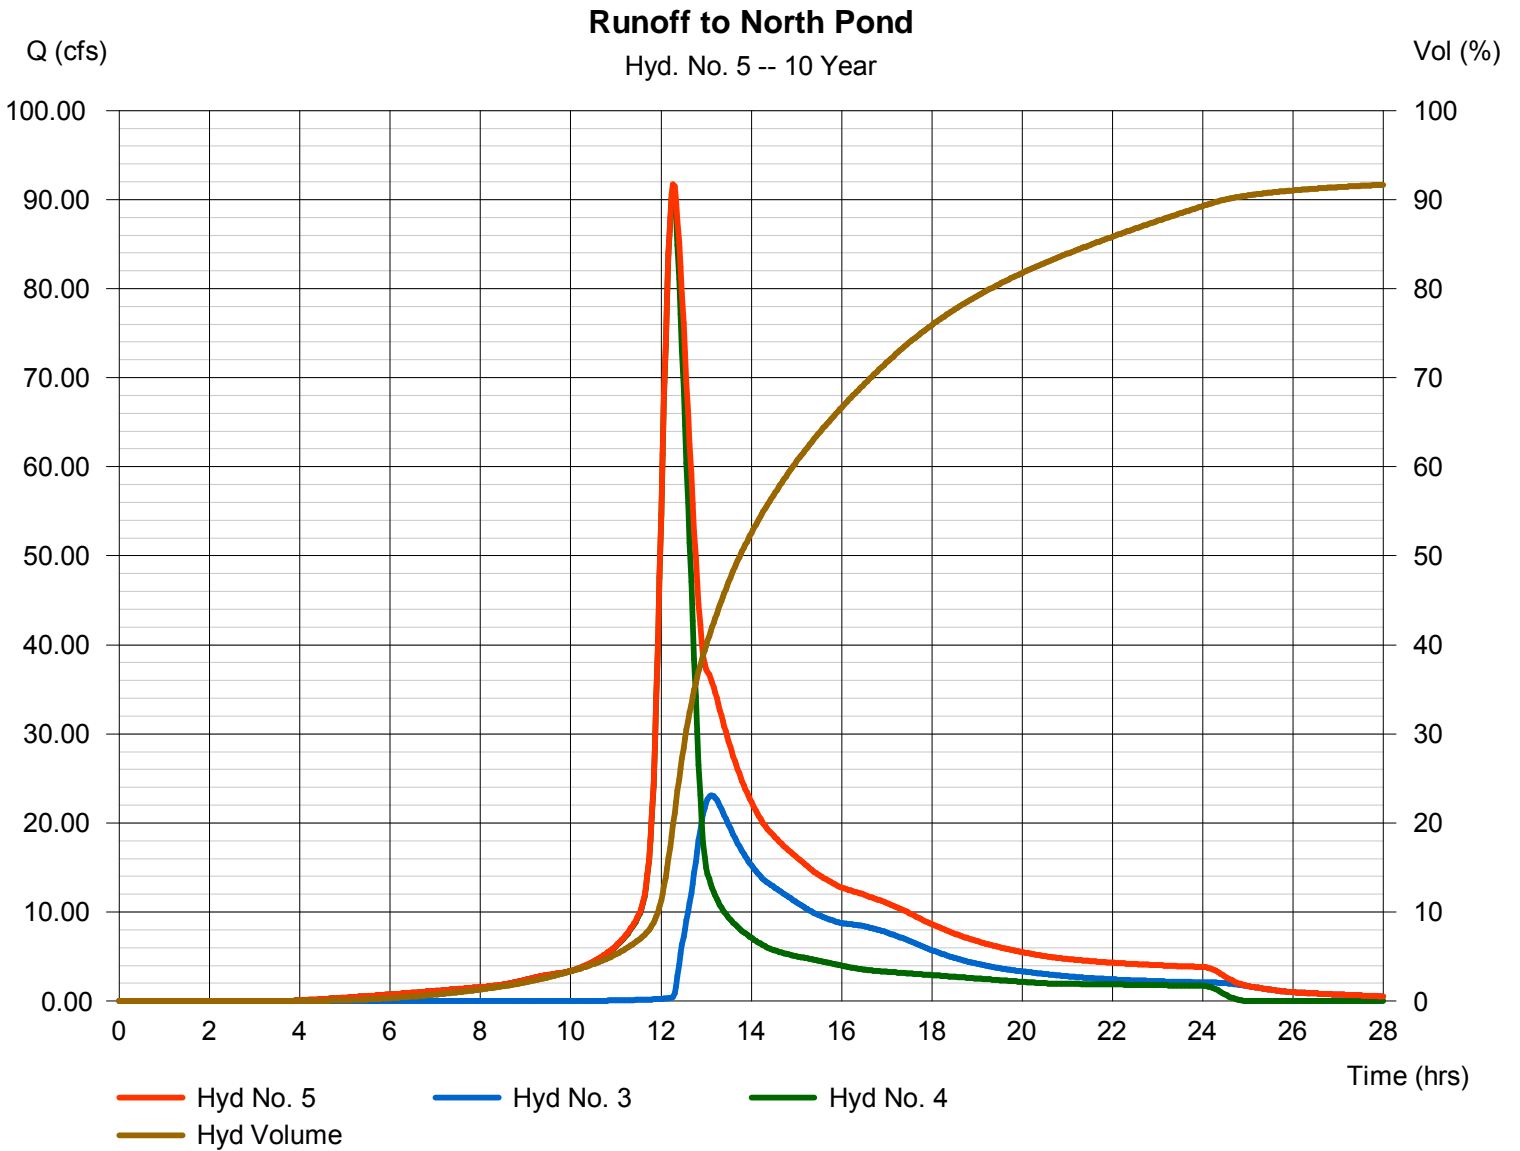

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 35.67 cfs
Storm frequency	= 10 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 782,532 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1330.08 ft
Reservoir name	= North East Pond	Max. Storage	= 260,464 cuft

Storage Indication method used.

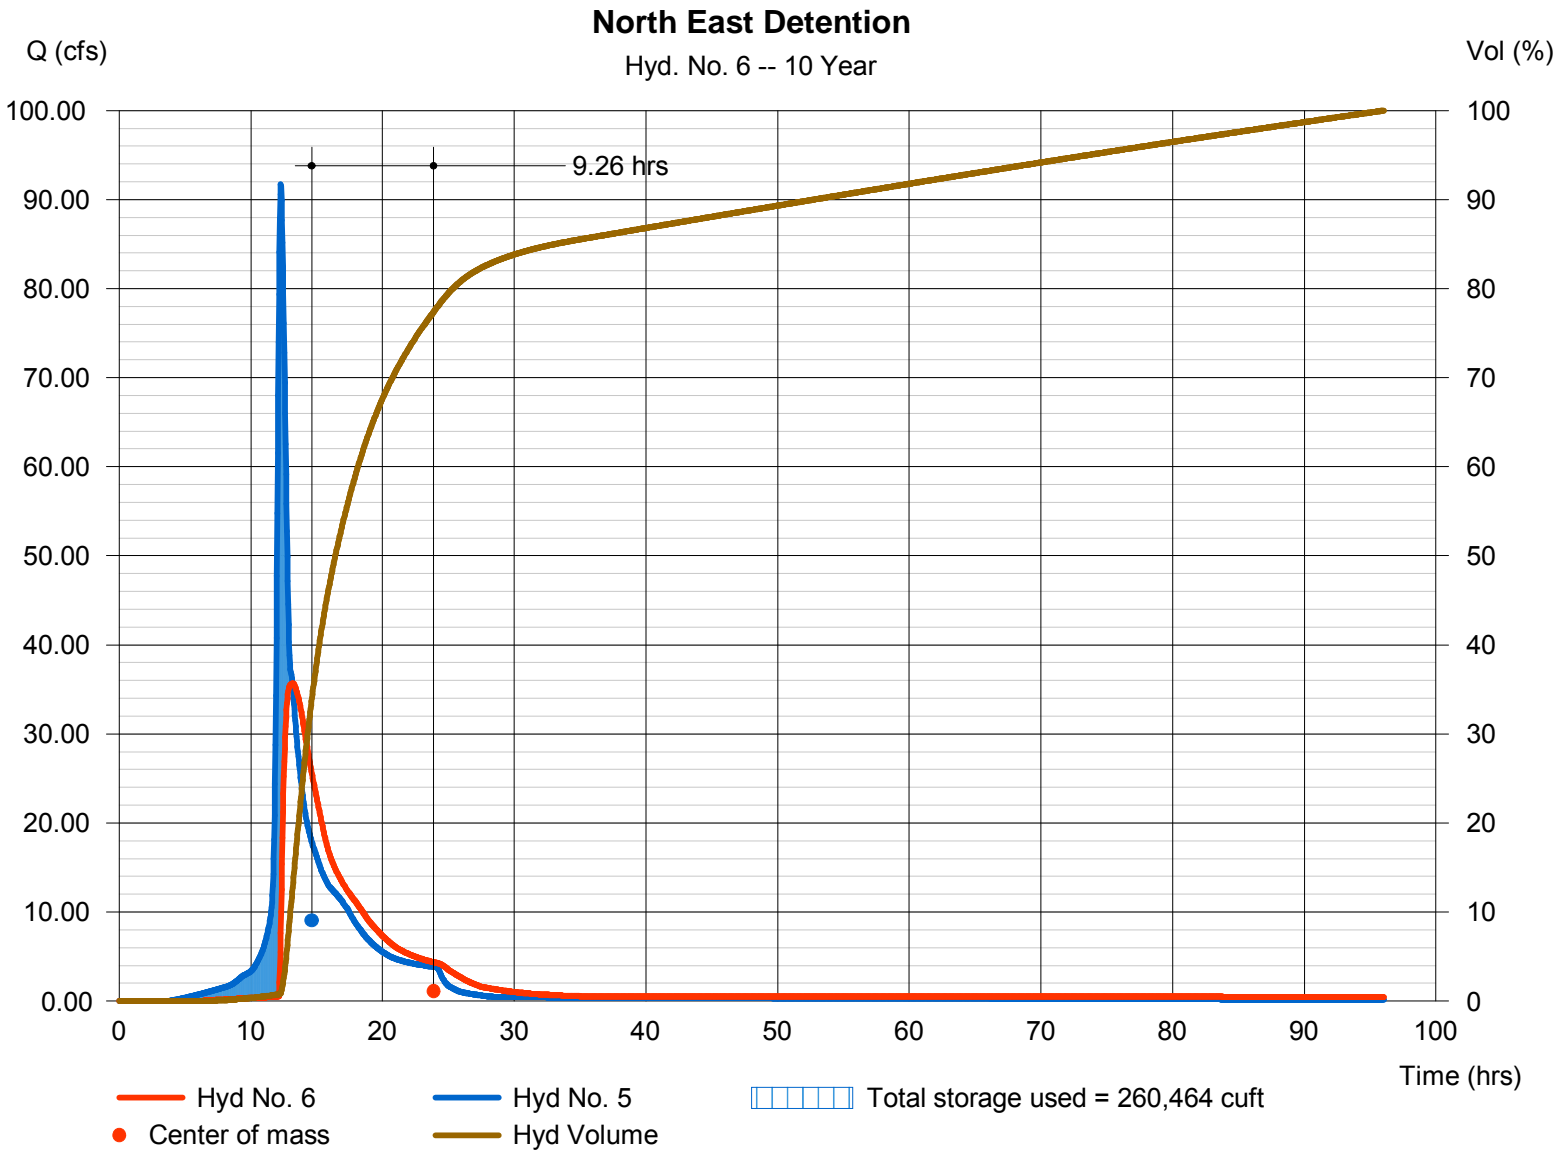

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 60.22 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 177,378 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 5.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

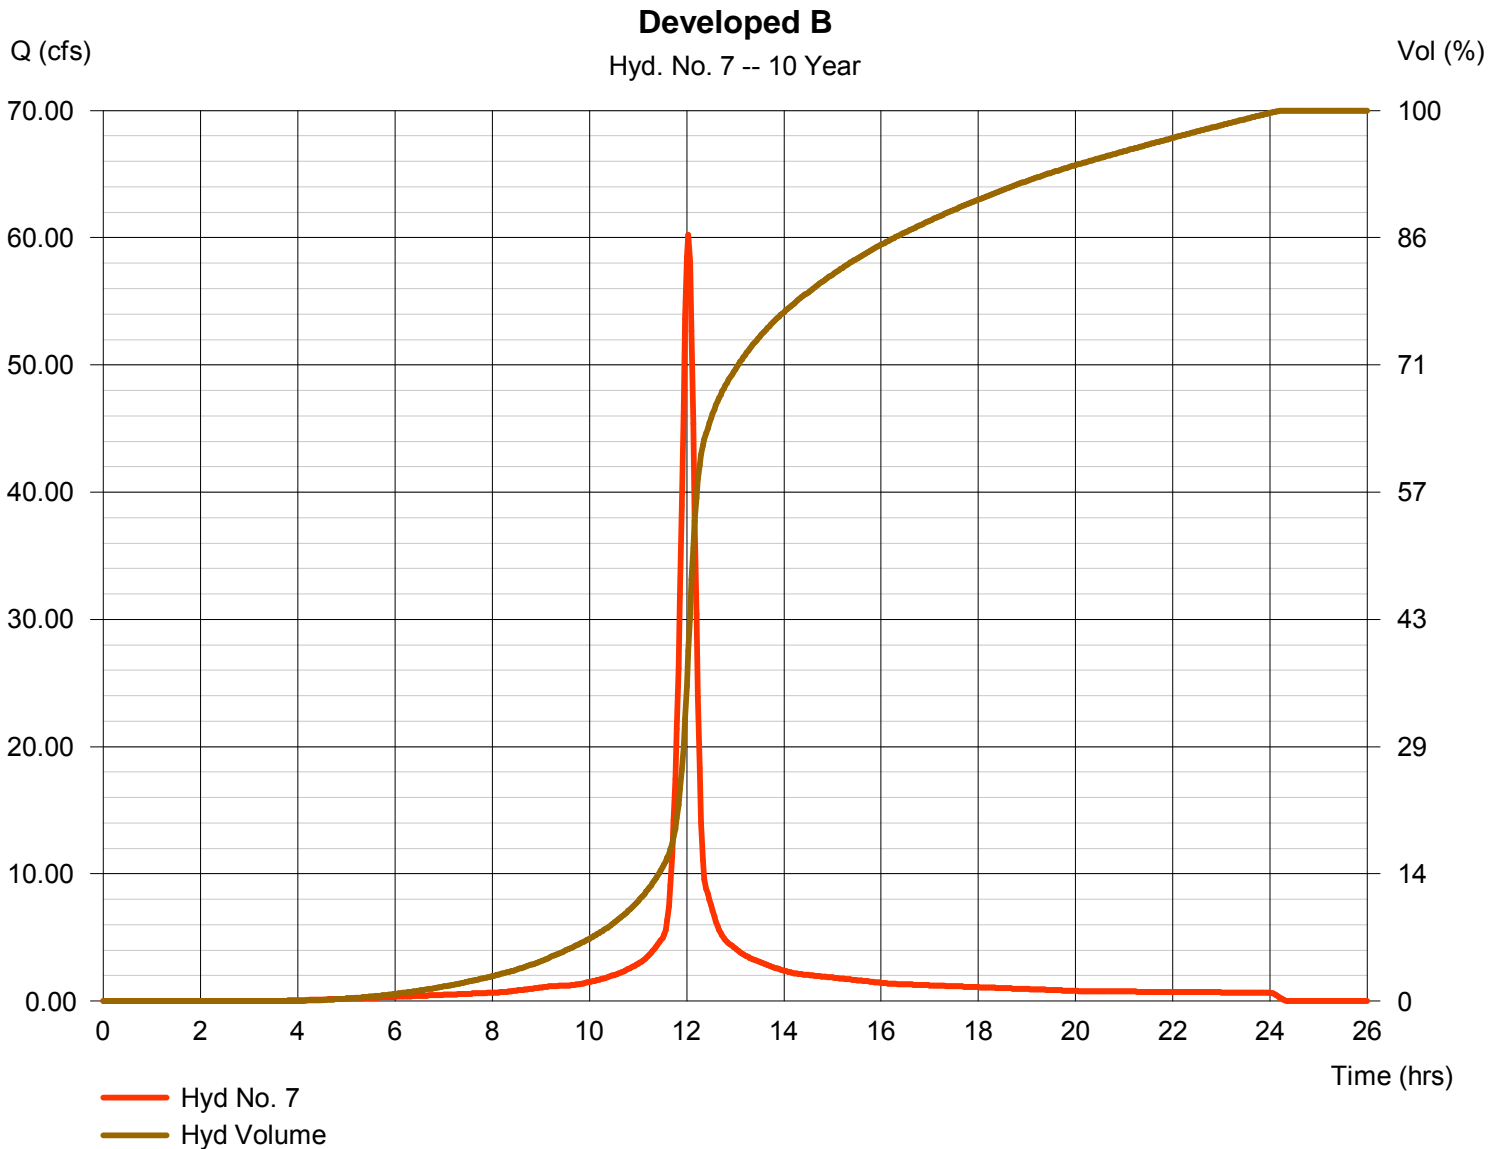

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 4.632 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.83 hrs
Time interval	= 2 min	Hyd. volume	= 165,503 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1328.43 ft
Reservoir name	= South East Pond	Max. Storage	= 110,641 cuft

Storage Indication method used.

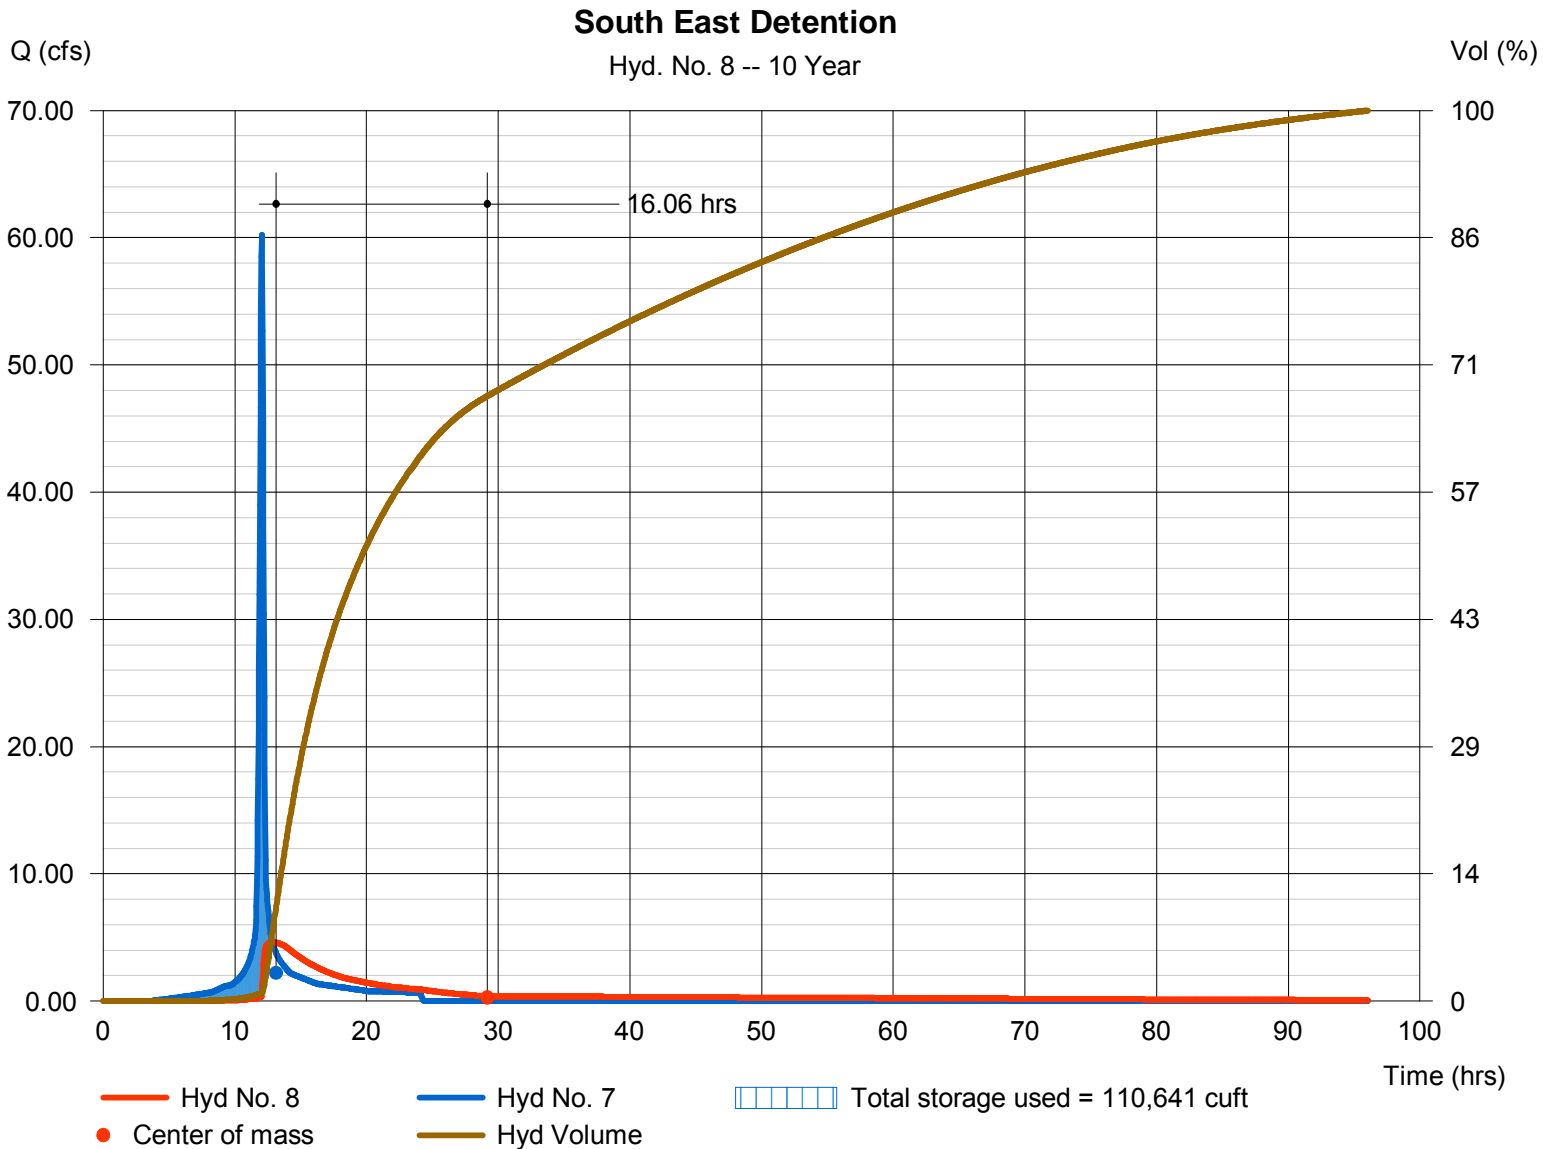

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 40.26 cfs
Storm frequency	= 10 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 948,036 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

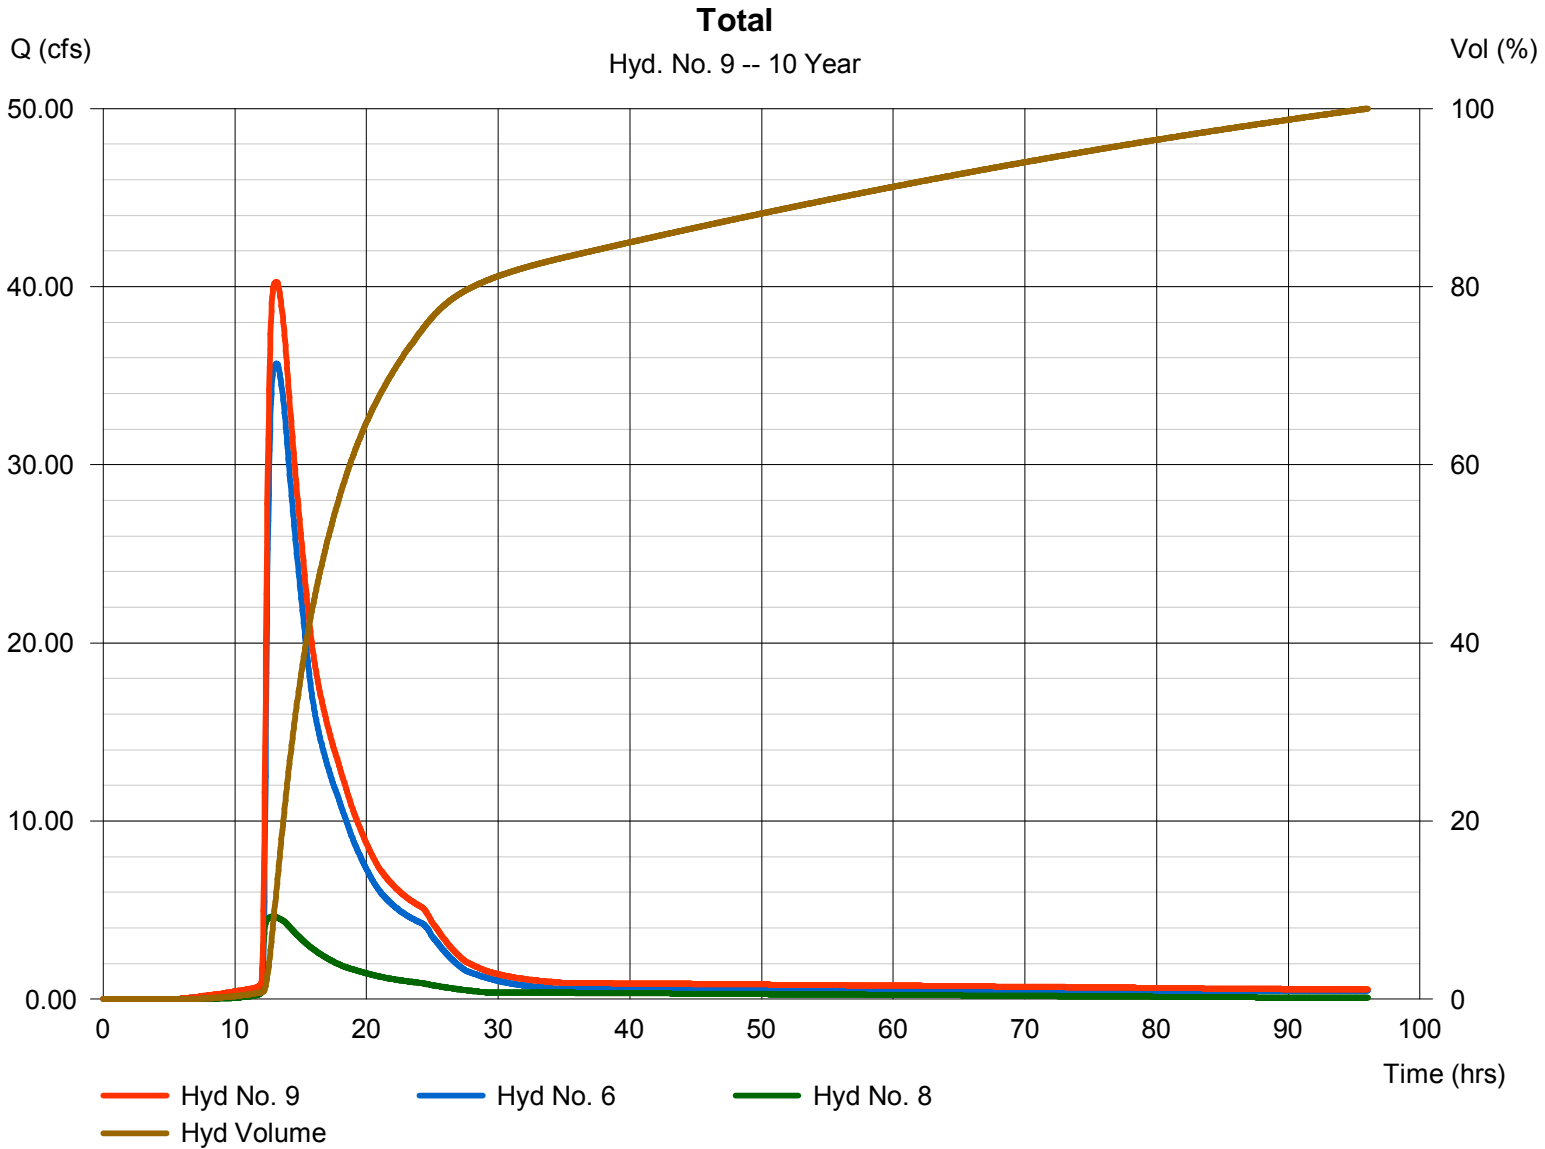

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 57.44 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 565,770 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 5.20 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

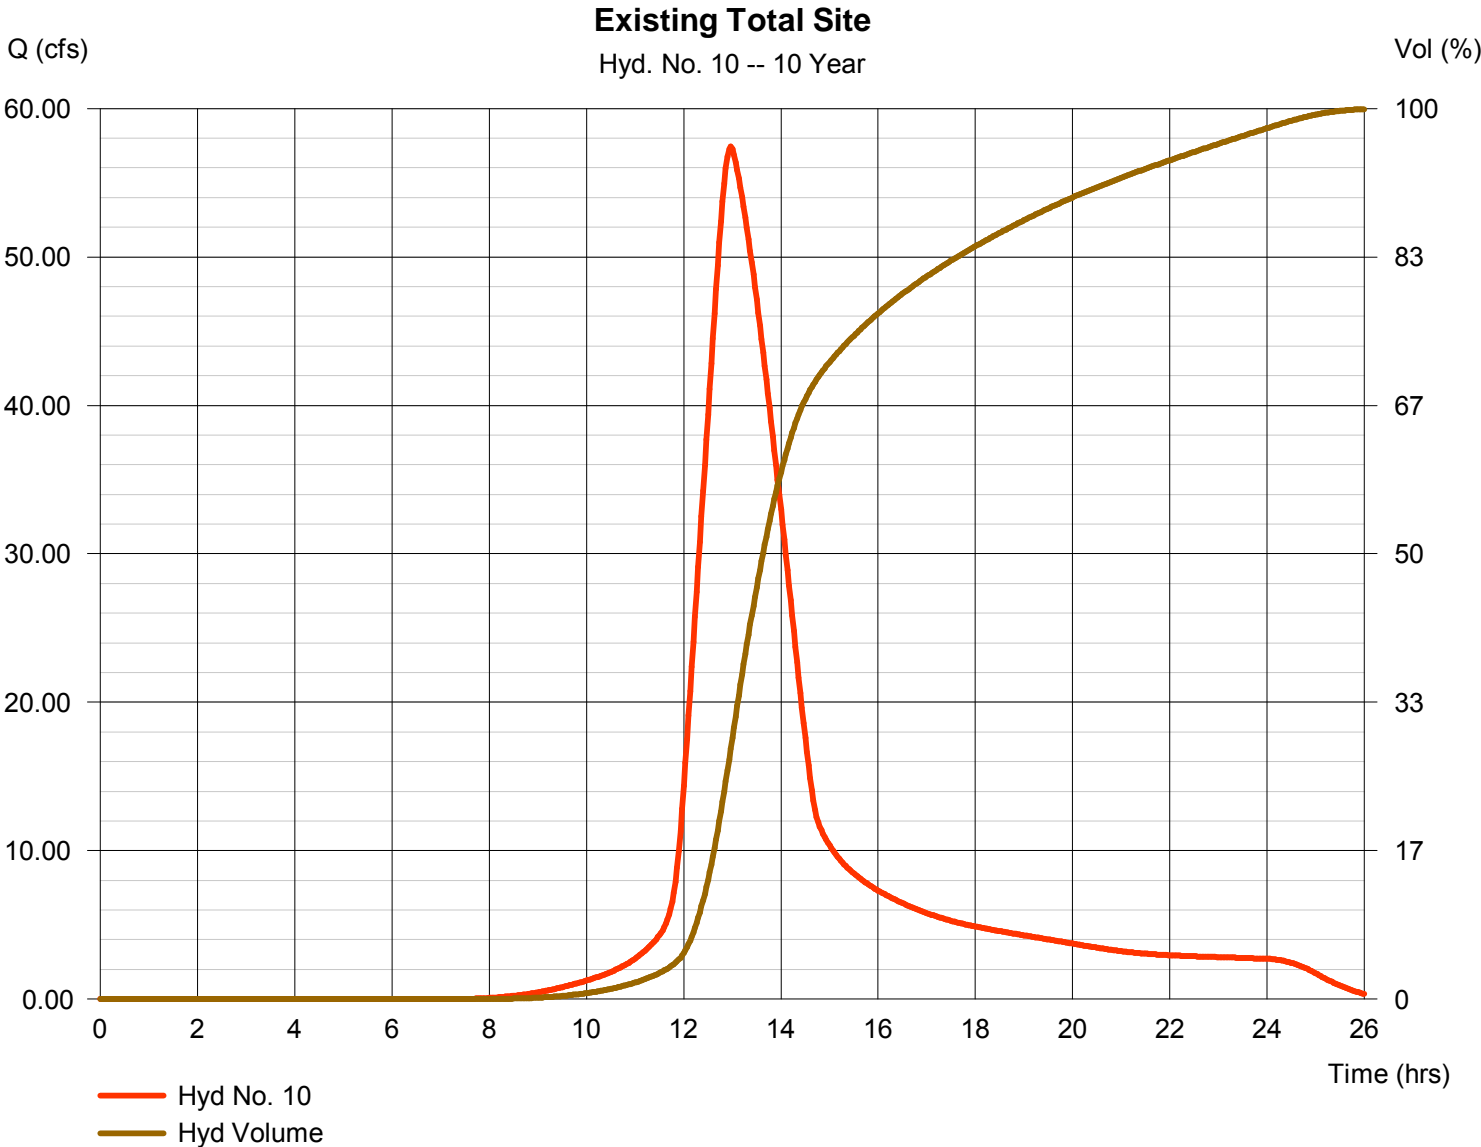

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	96.96	2	740	519,531	-----	-----	-----	Offsite West	
2	Reservoir	40.51	2	774	500,694	1	1337.32	243,639	Upper Pond	
3	Reach	39.78	2	780	500,645	2	-----	-----	Channel Section	
4	SCS Runoff	109.51	2	736	550,503	-----	-----	-----	Developed A	
5	Combine	113.88	2	738	1,051,148	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	51.88	2	790	985,590	5	1330.53	322,466	North East Detention	
7	SCS Runoff	72.11	2	722	214,696	-----	-----	-----	Developed B	
8	Reservoir	6.171	2	764	202,672	7	1328.64	132,375	South East Detention	
9	Combine	57.96	2	790	1,188,262	6, 8	-----	-----	Total	
10	SCS Runoff	72.65	2	778	713,950	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 25 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 96.96 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.33 hrs
Time interval	= 2 min	Hyd. volume	= 519,531 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 6.10 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

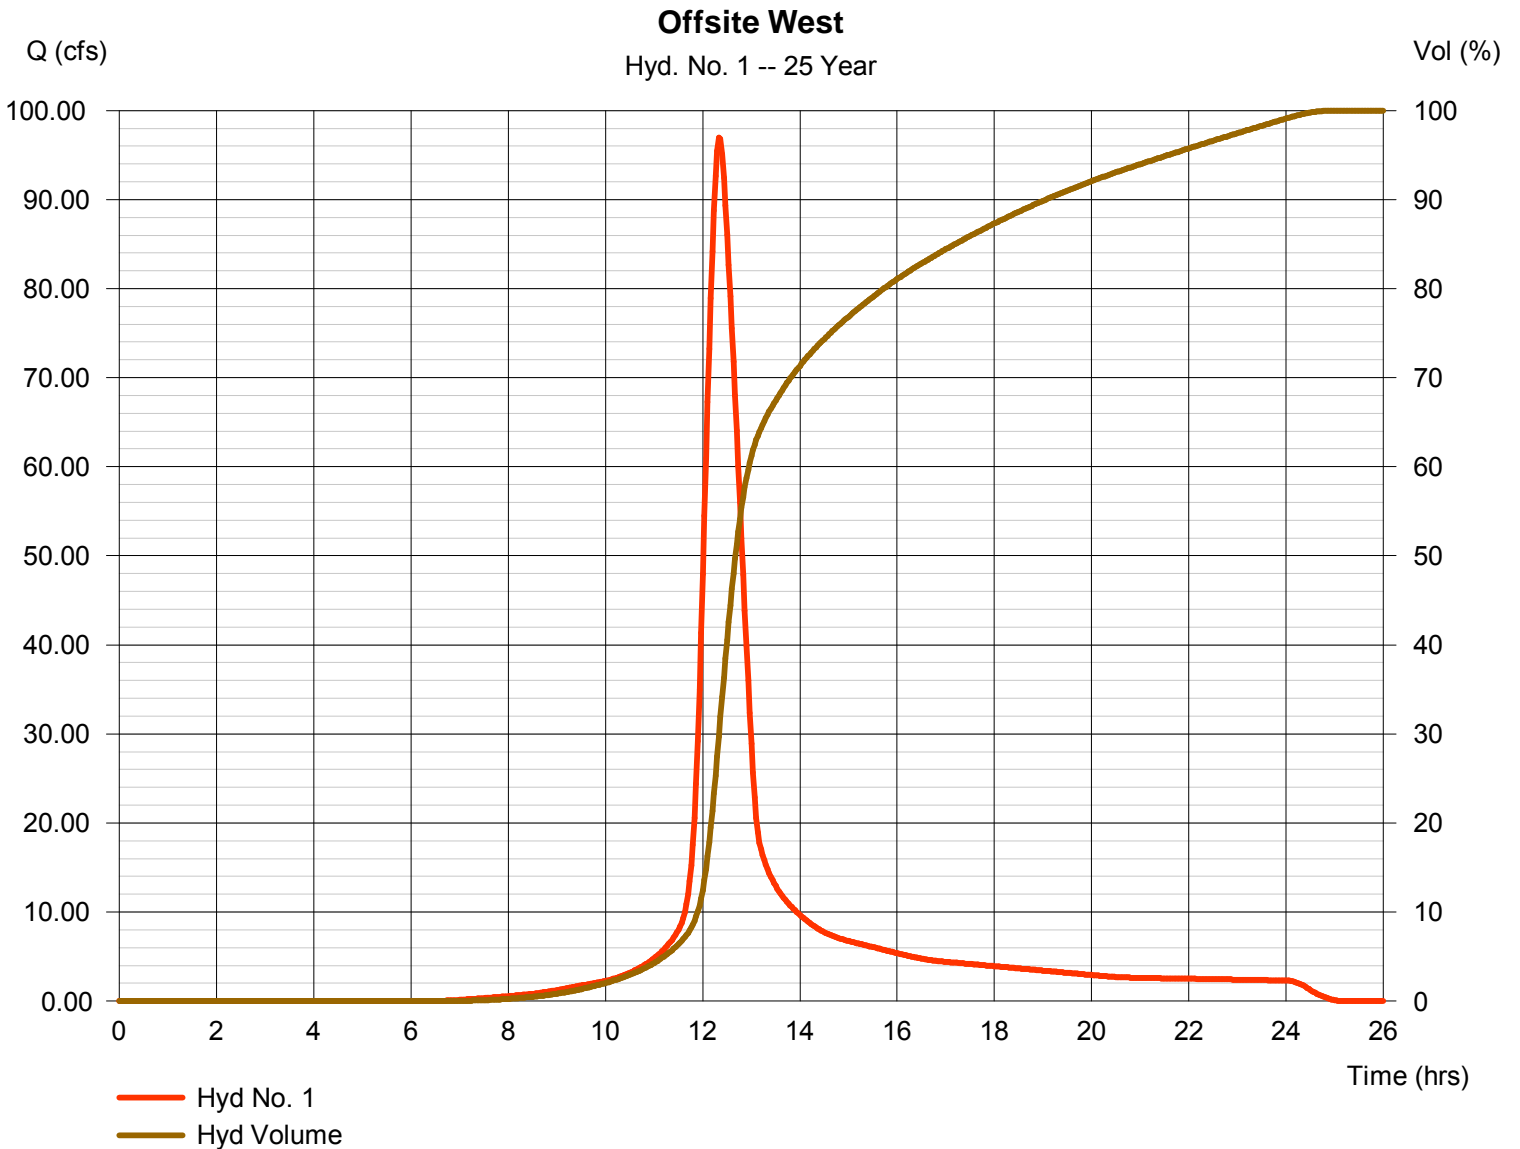

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 40.51 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.90 hrs
Time interval	= 2 min	Hyd. volume	= 500,694 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1337.32 ft
Reservoir name	= Upper Pond	Max. Storage	= 243,639 cuft

Storage Indication method used.

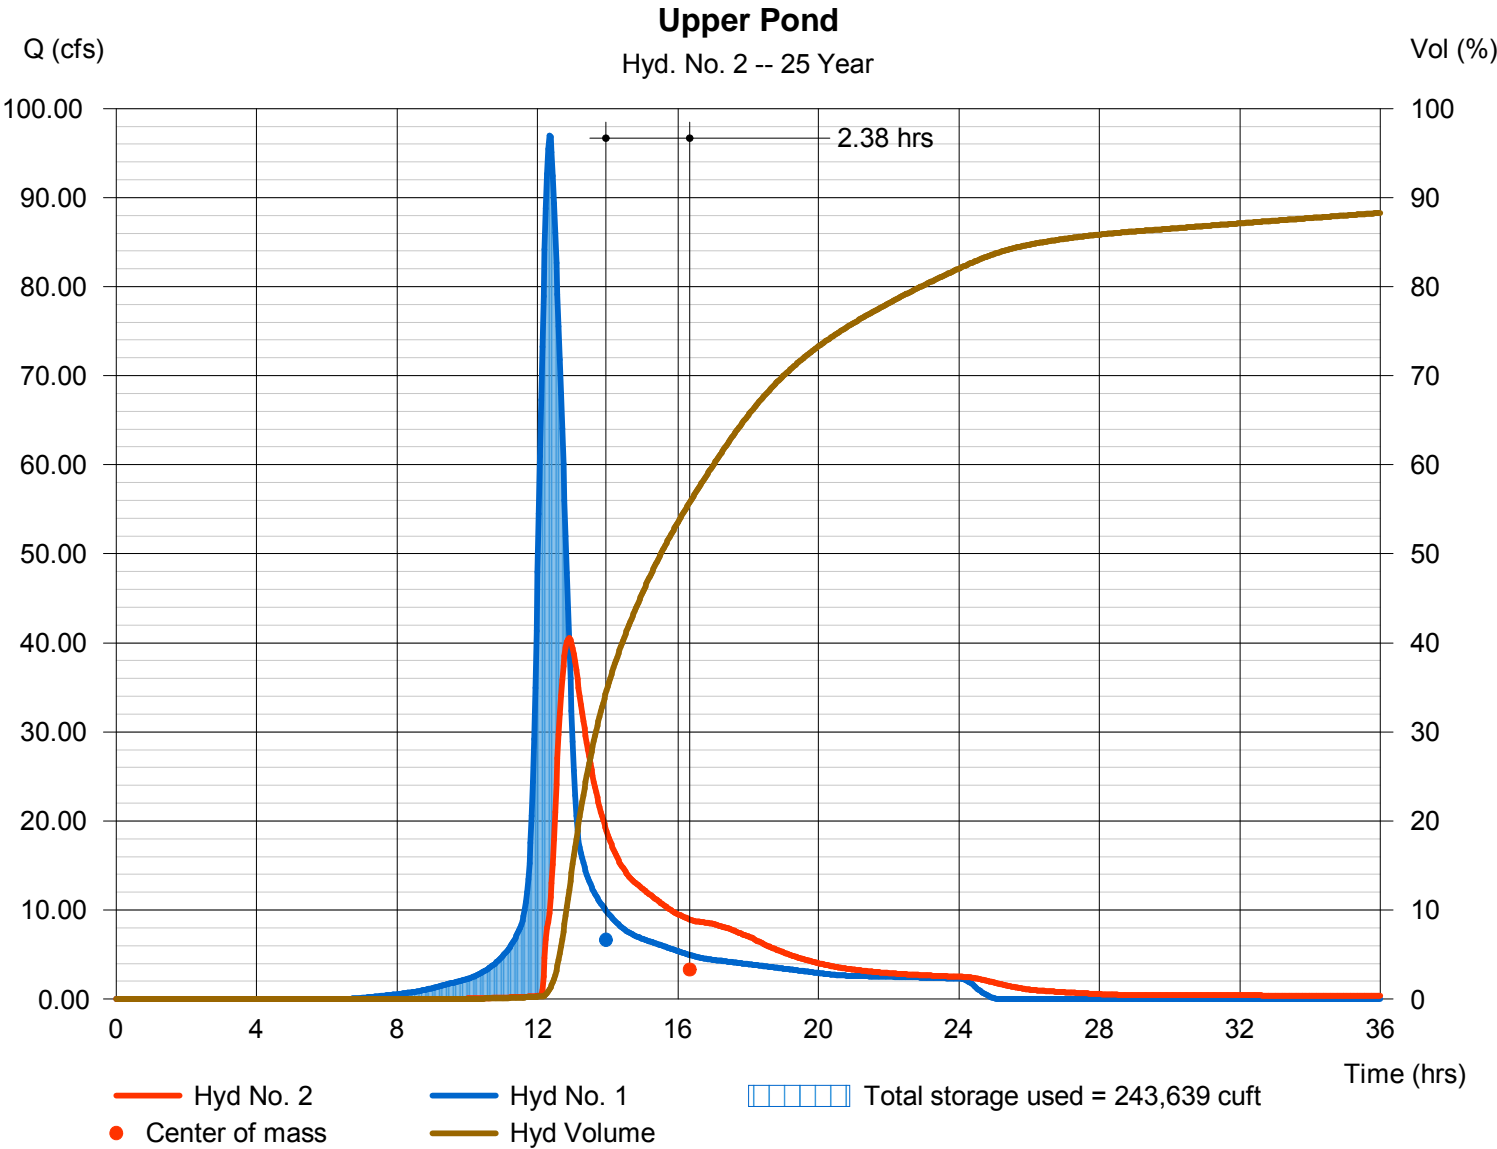

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 39.78 cfs
Storm frequency	= 25 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 500,645 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.3380

Modified Att-Kin routing method used.

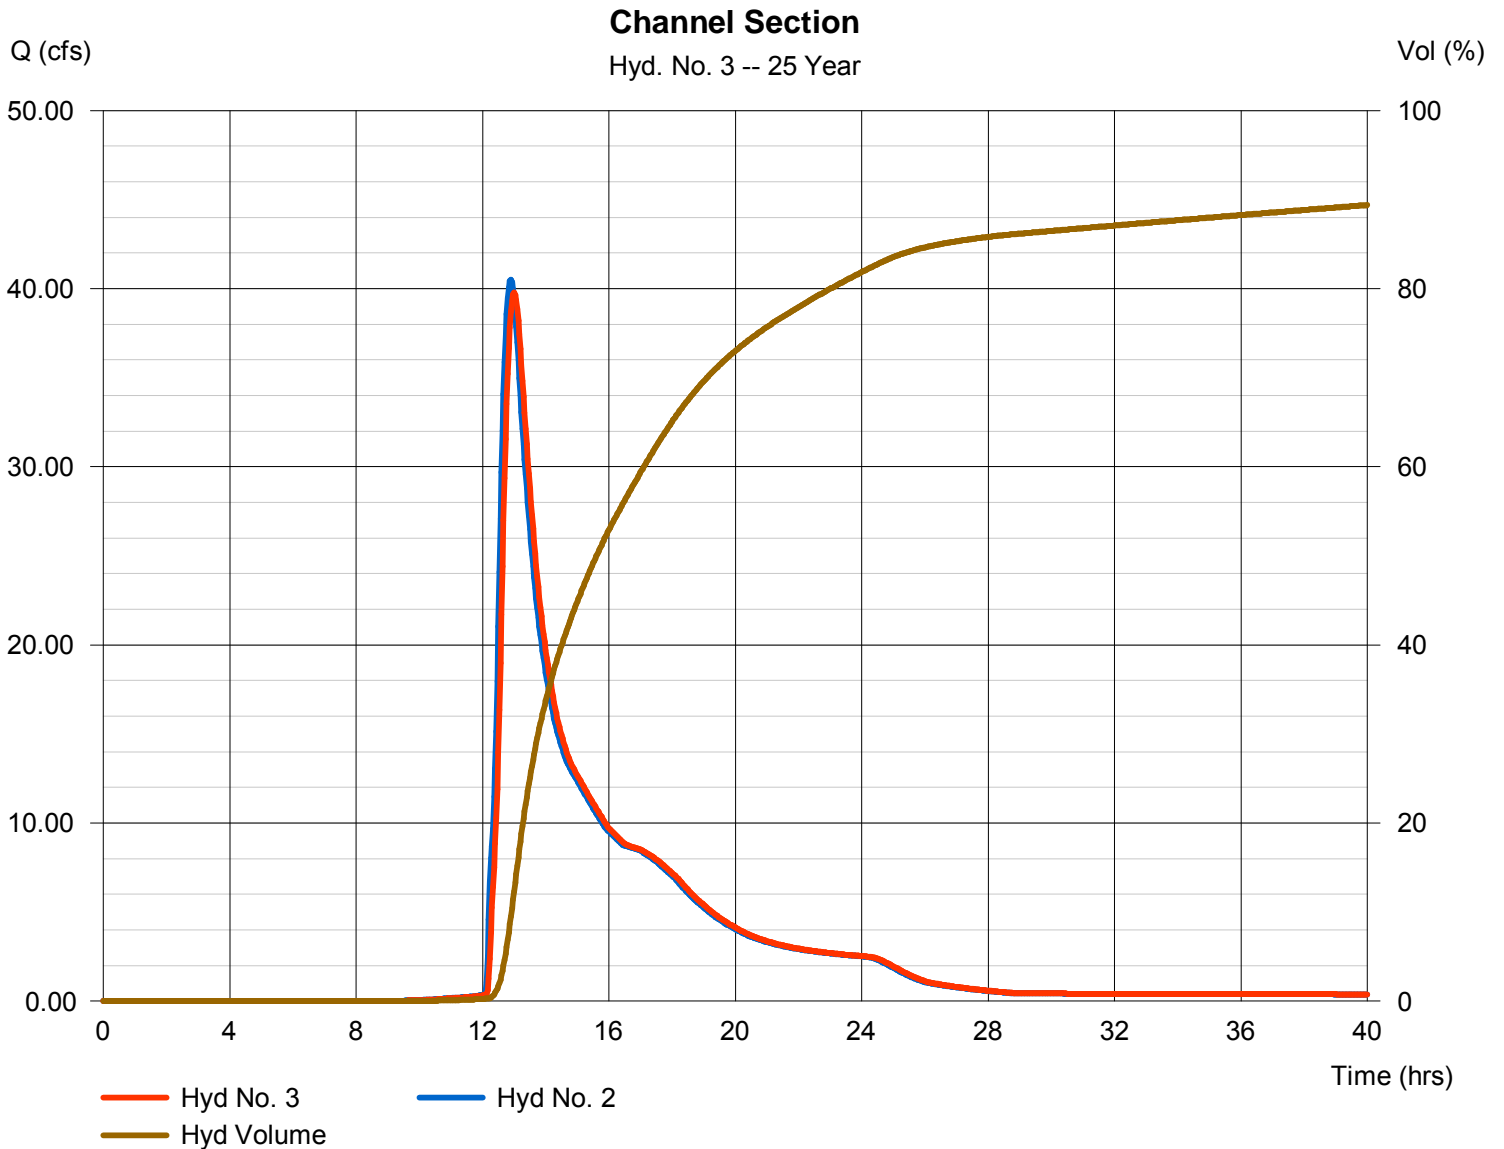

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 109.51 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 550,503 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 6.10 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

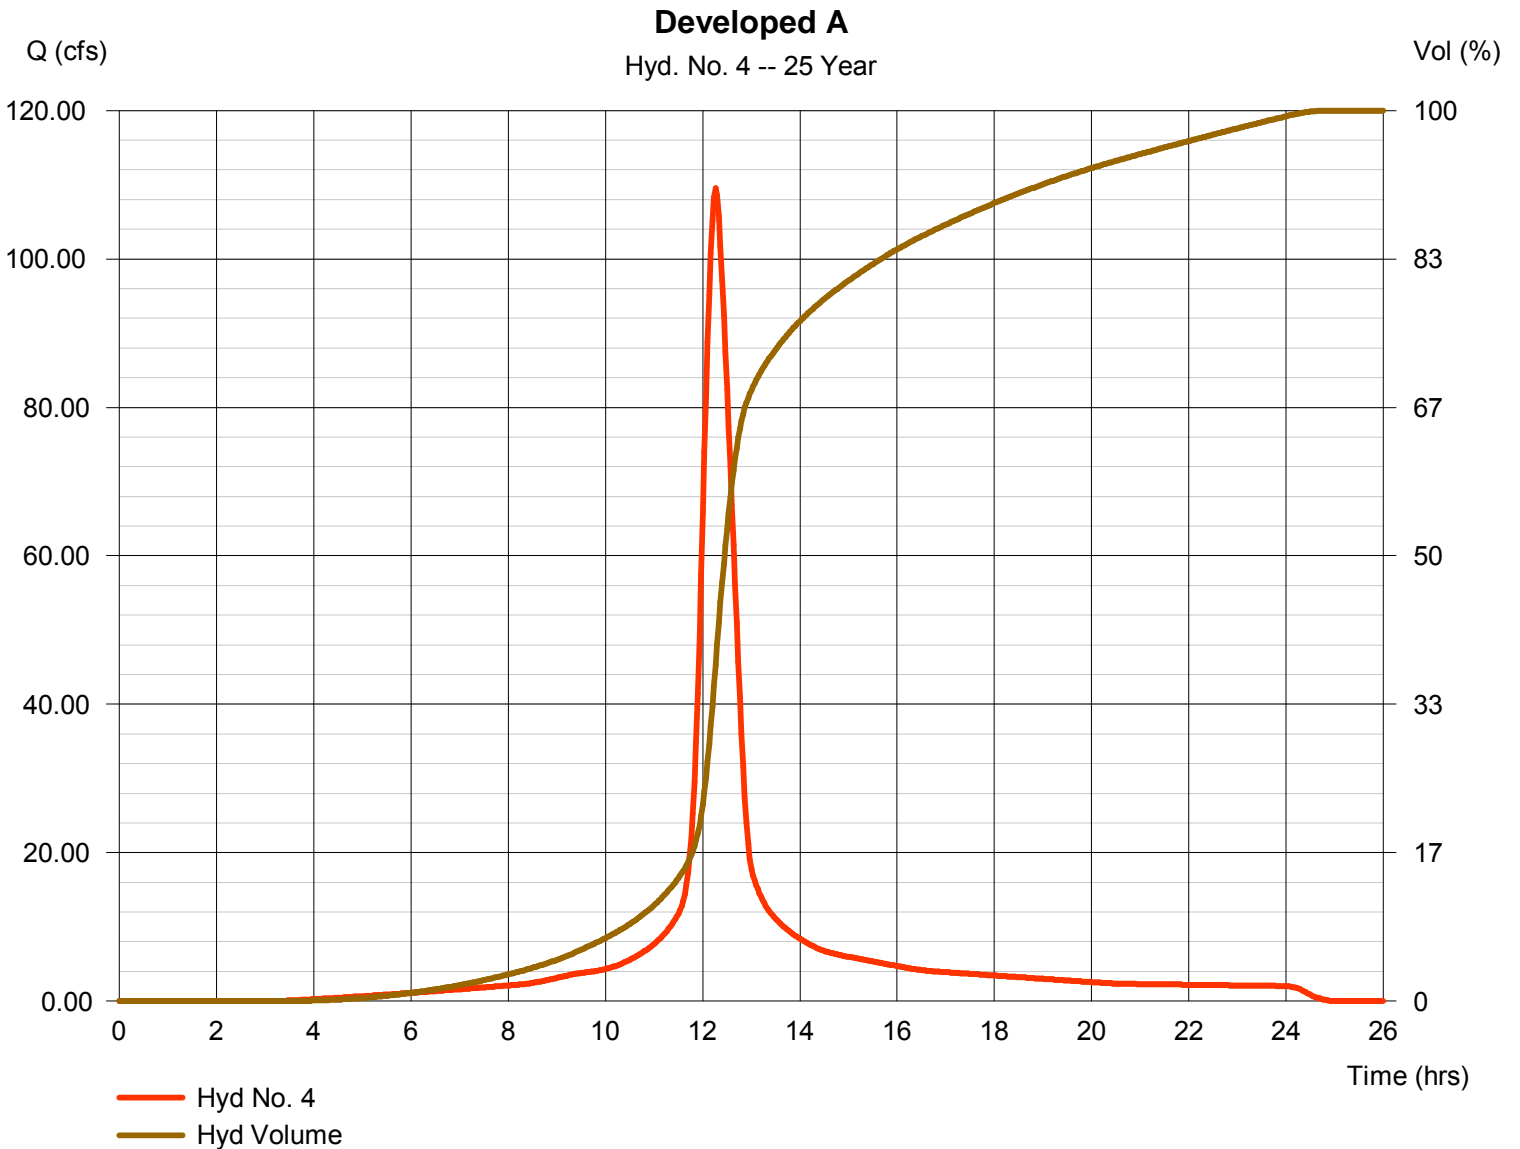

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011


Hyd. No. 5

Runoff to North Pond

Hydrograph type	= Combine	Peak discharge	= 113.88 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.30 hrs
Time interval	= 2 min	Hyd. volume	= 1,051,148 cuft
Inflow hyds.	= 3, 4	Contrib. drain. area	= 30.000 ac

Runoff to North Pond

Hyd. No. 5 -- 25 Year

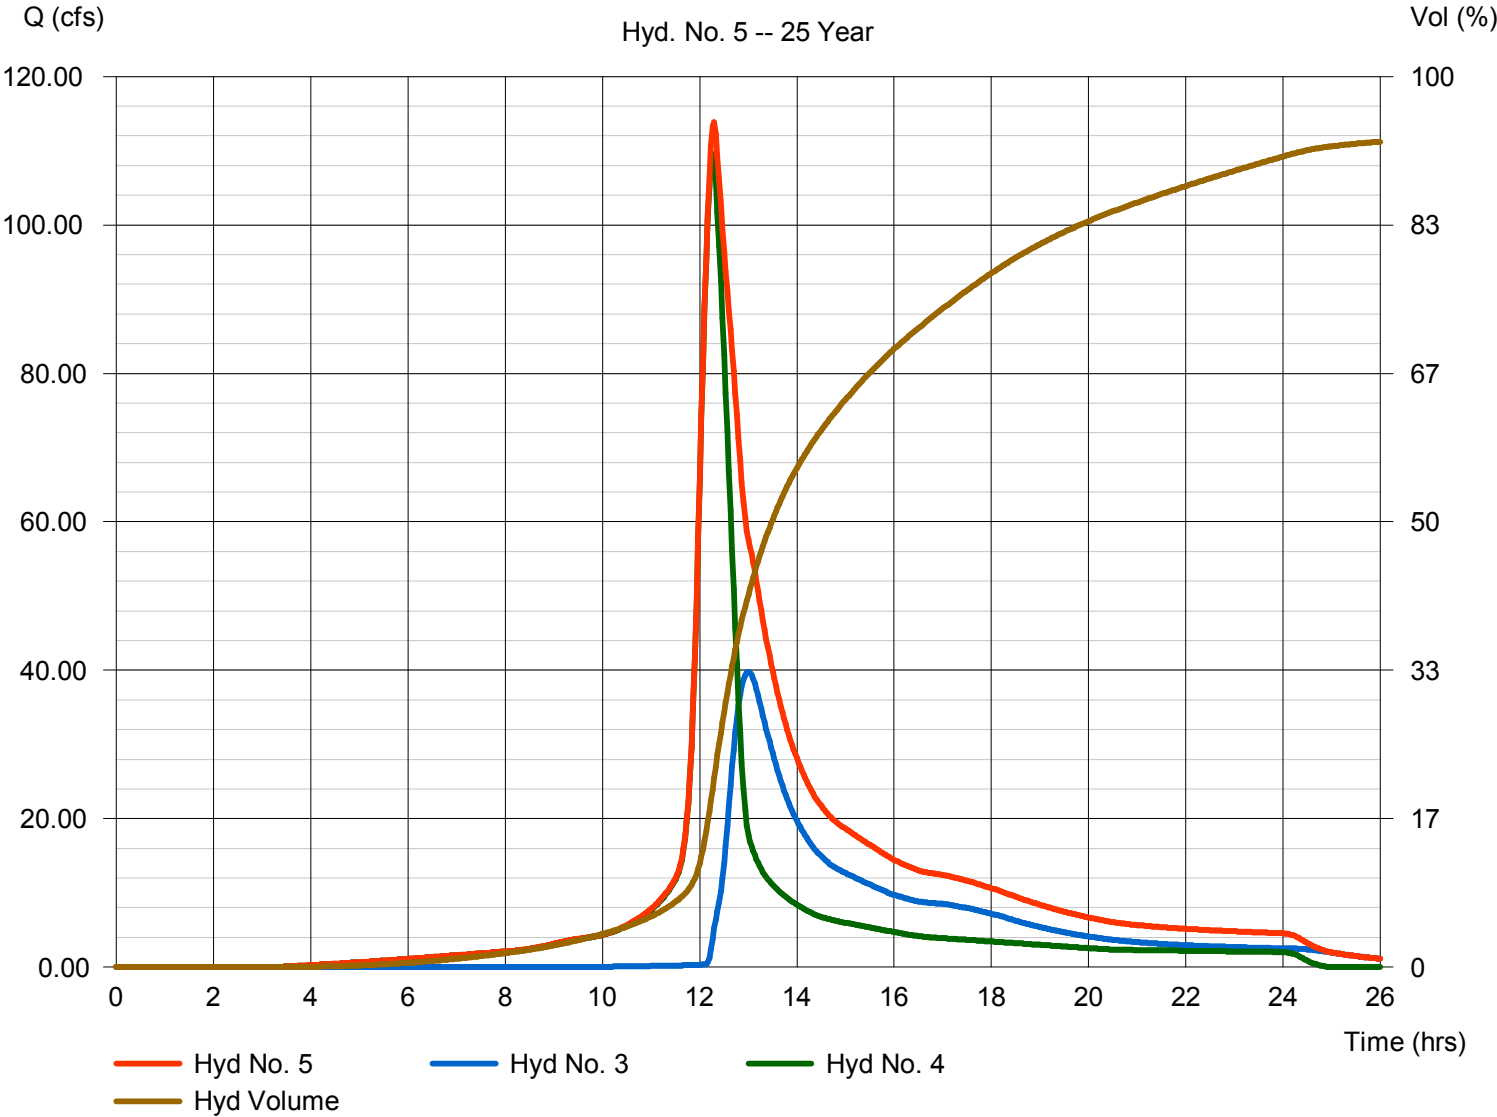

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 51.88 cfs
Storm frequency	= 25 yrs	Time to peak	= 13.17 hrs
Time interval	= 2 min	Hyd. volume	= 985,590 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1330.53 ft
Reservoir name	= North East Pond	Max. Storage	= 322,466 cuft

Storage Indication method used.

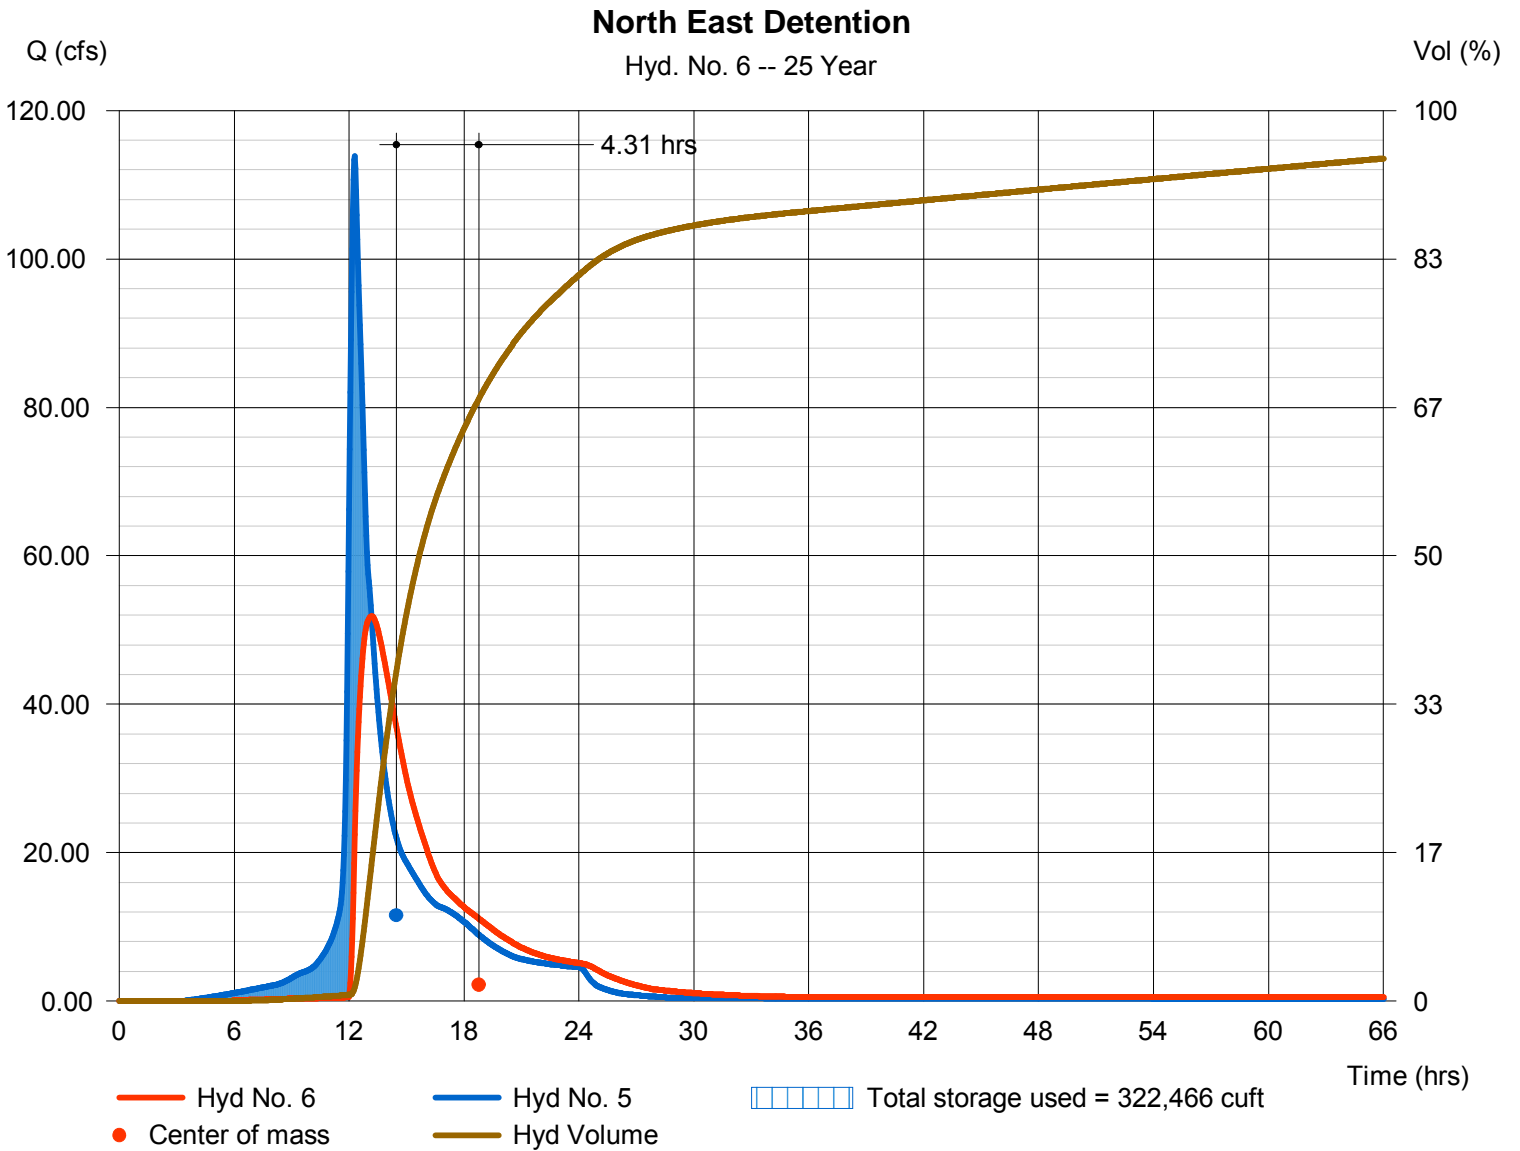

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 72.11 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 214,696 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 6.10 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

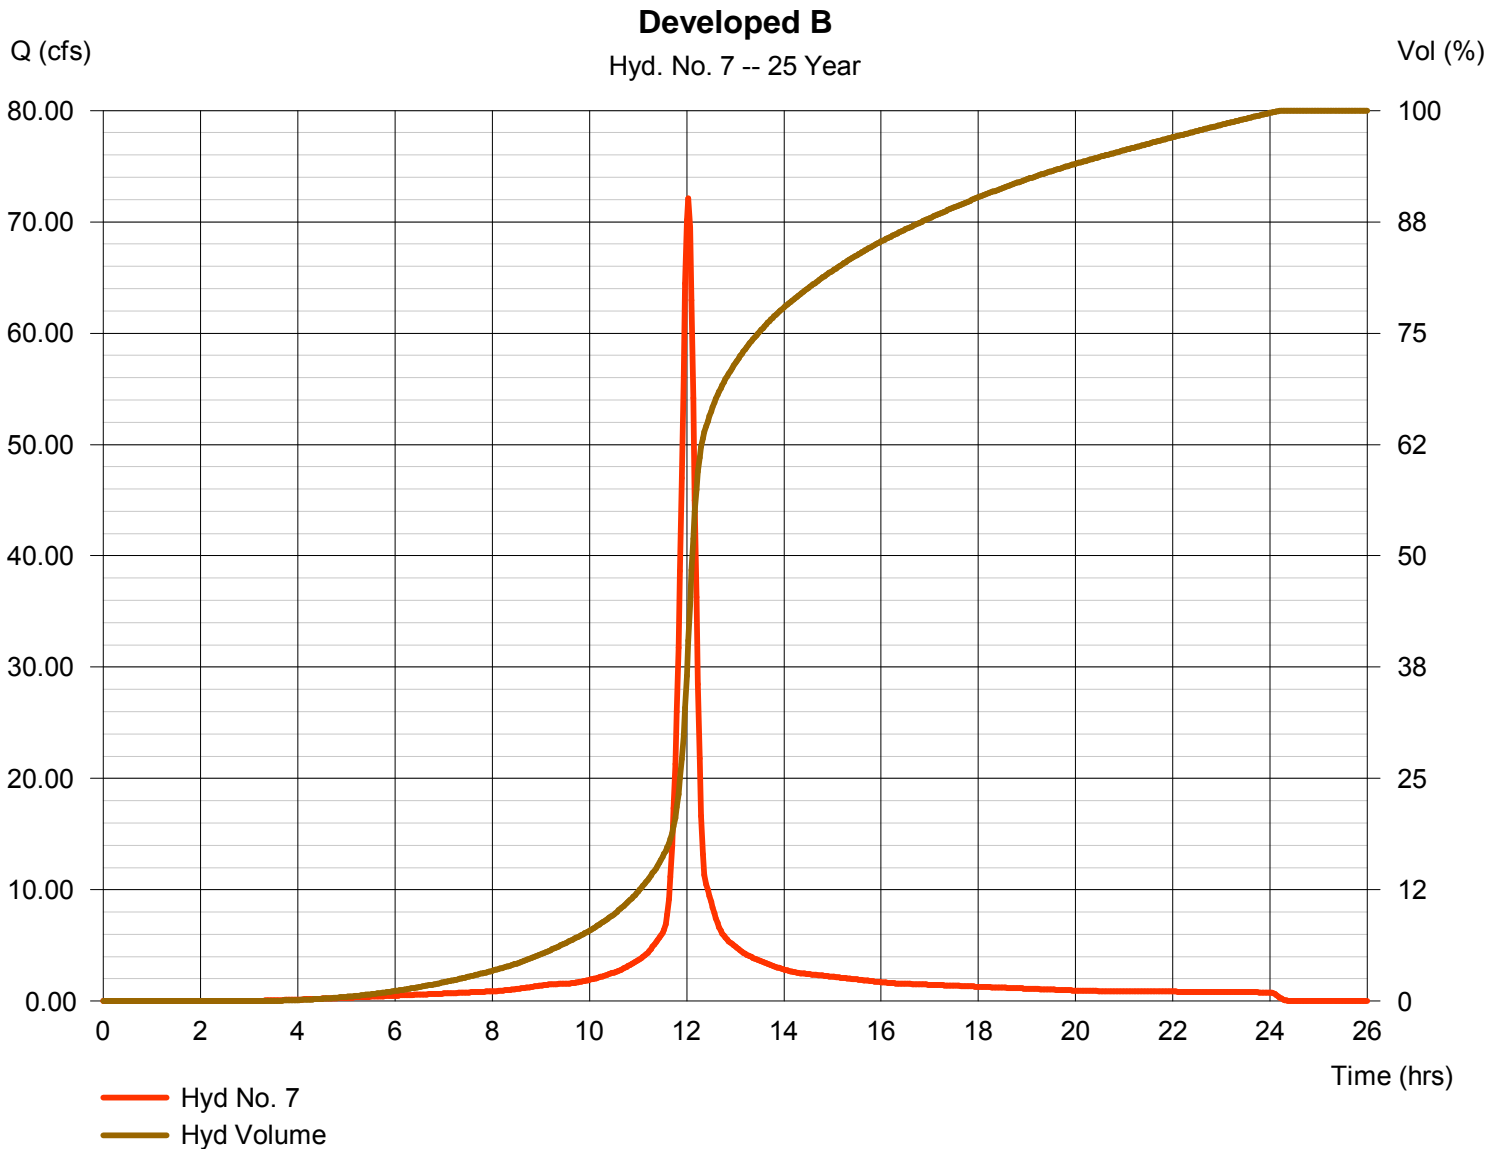

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 6.171 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.73 hrs
Time interval	= 2 min	Hyd. volume	= 202,672 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1328.64 ft
Reservoir name	= South East Pond	Max. Storage	= 132,375 cuft

Storage Indication method used.

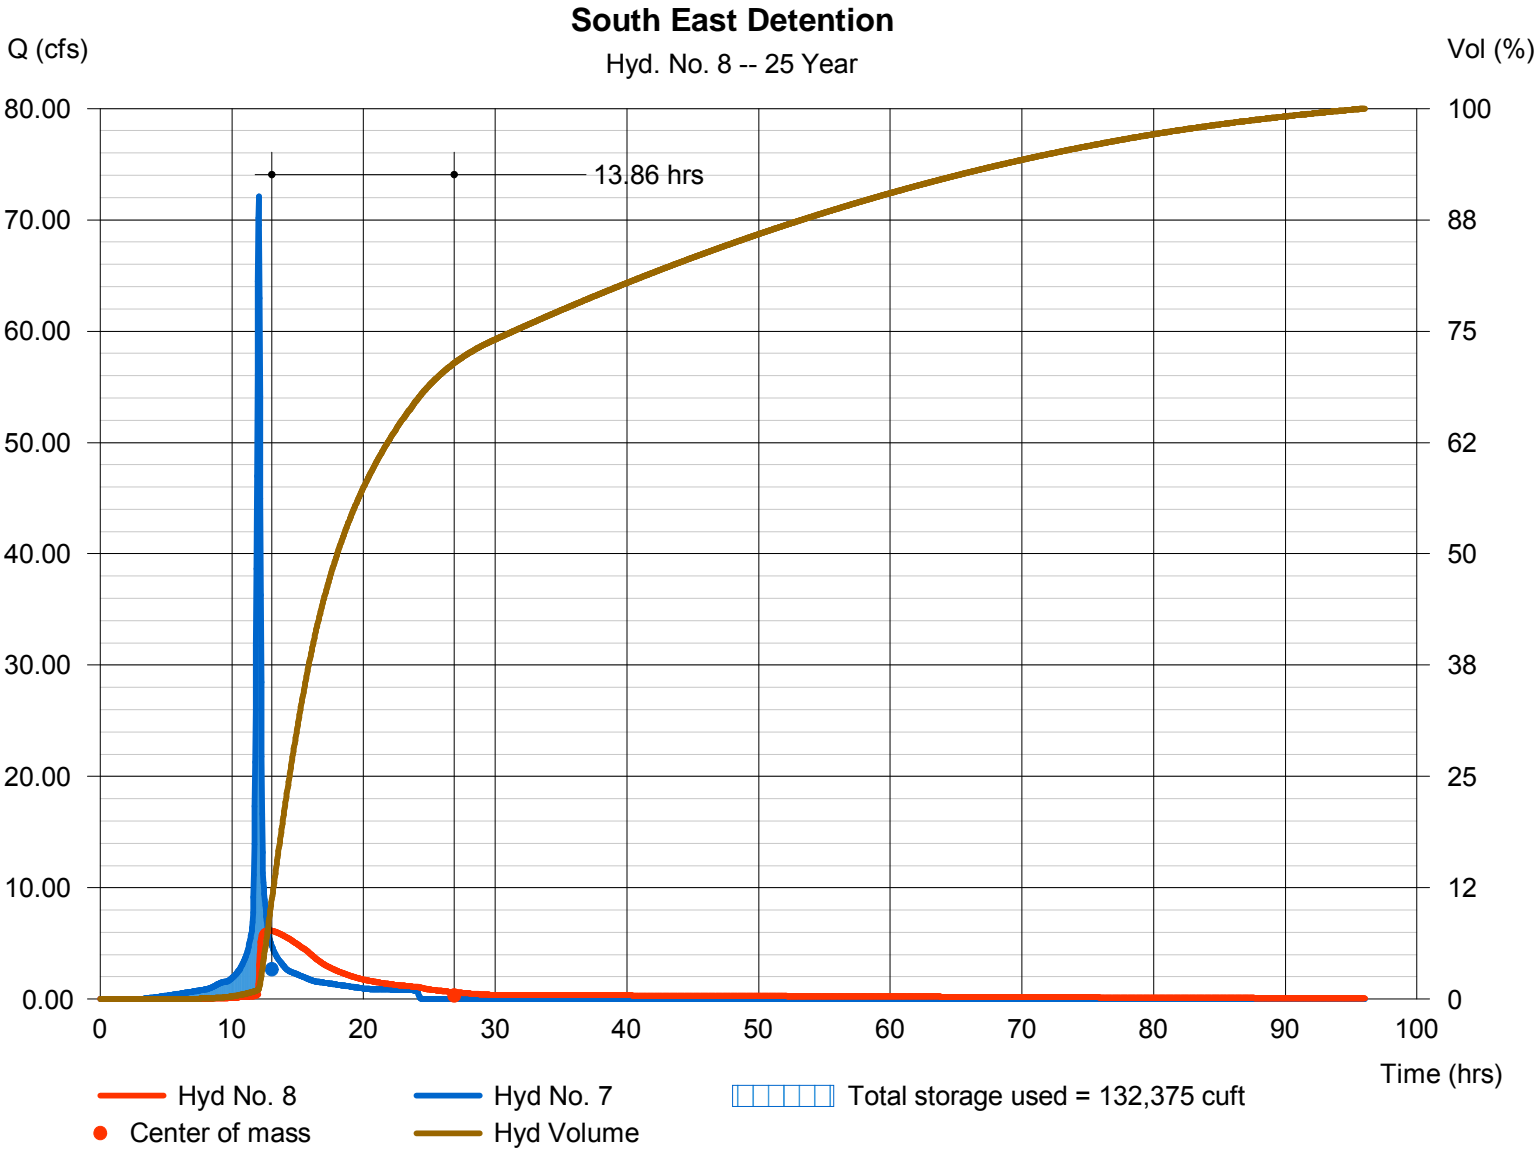

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 57.96 cfs
Storm frequency	= 25 yrs	Time to peak	= 13.17 hrs
Time interval	= 2 min	Hyd. volume	= 1,188,262 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

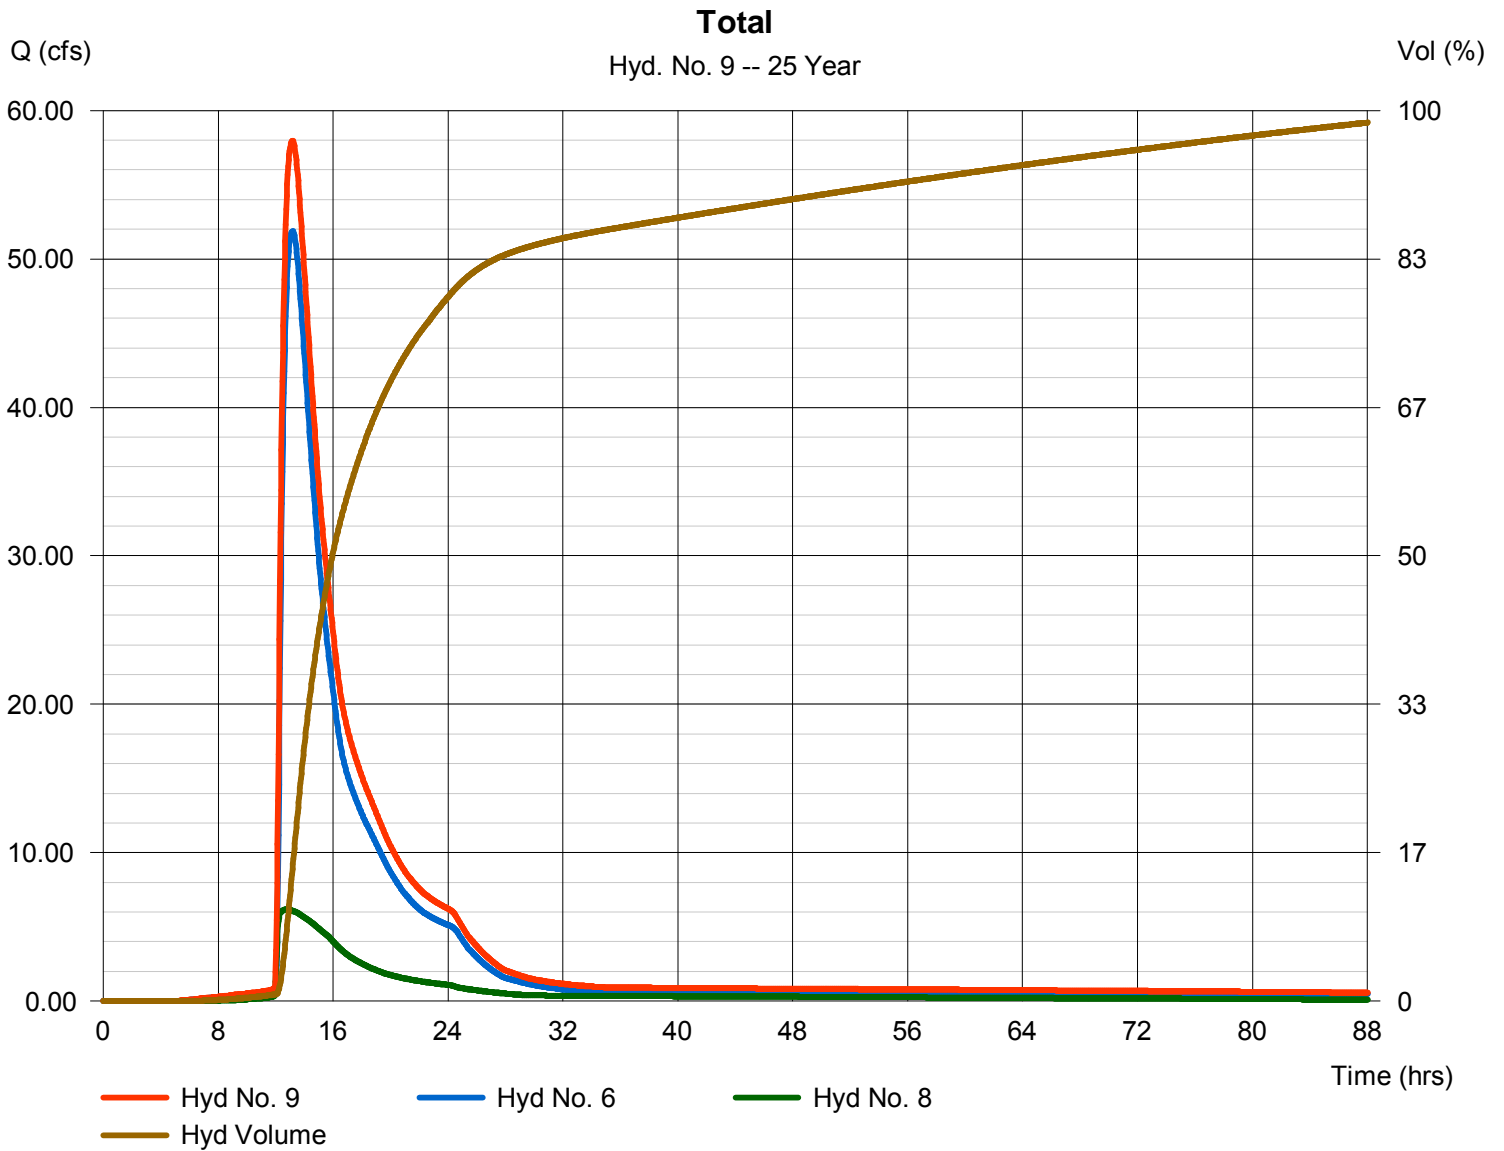

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 72.65 cfs
Storm frequency	= 25 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 713,950 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 6.10 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

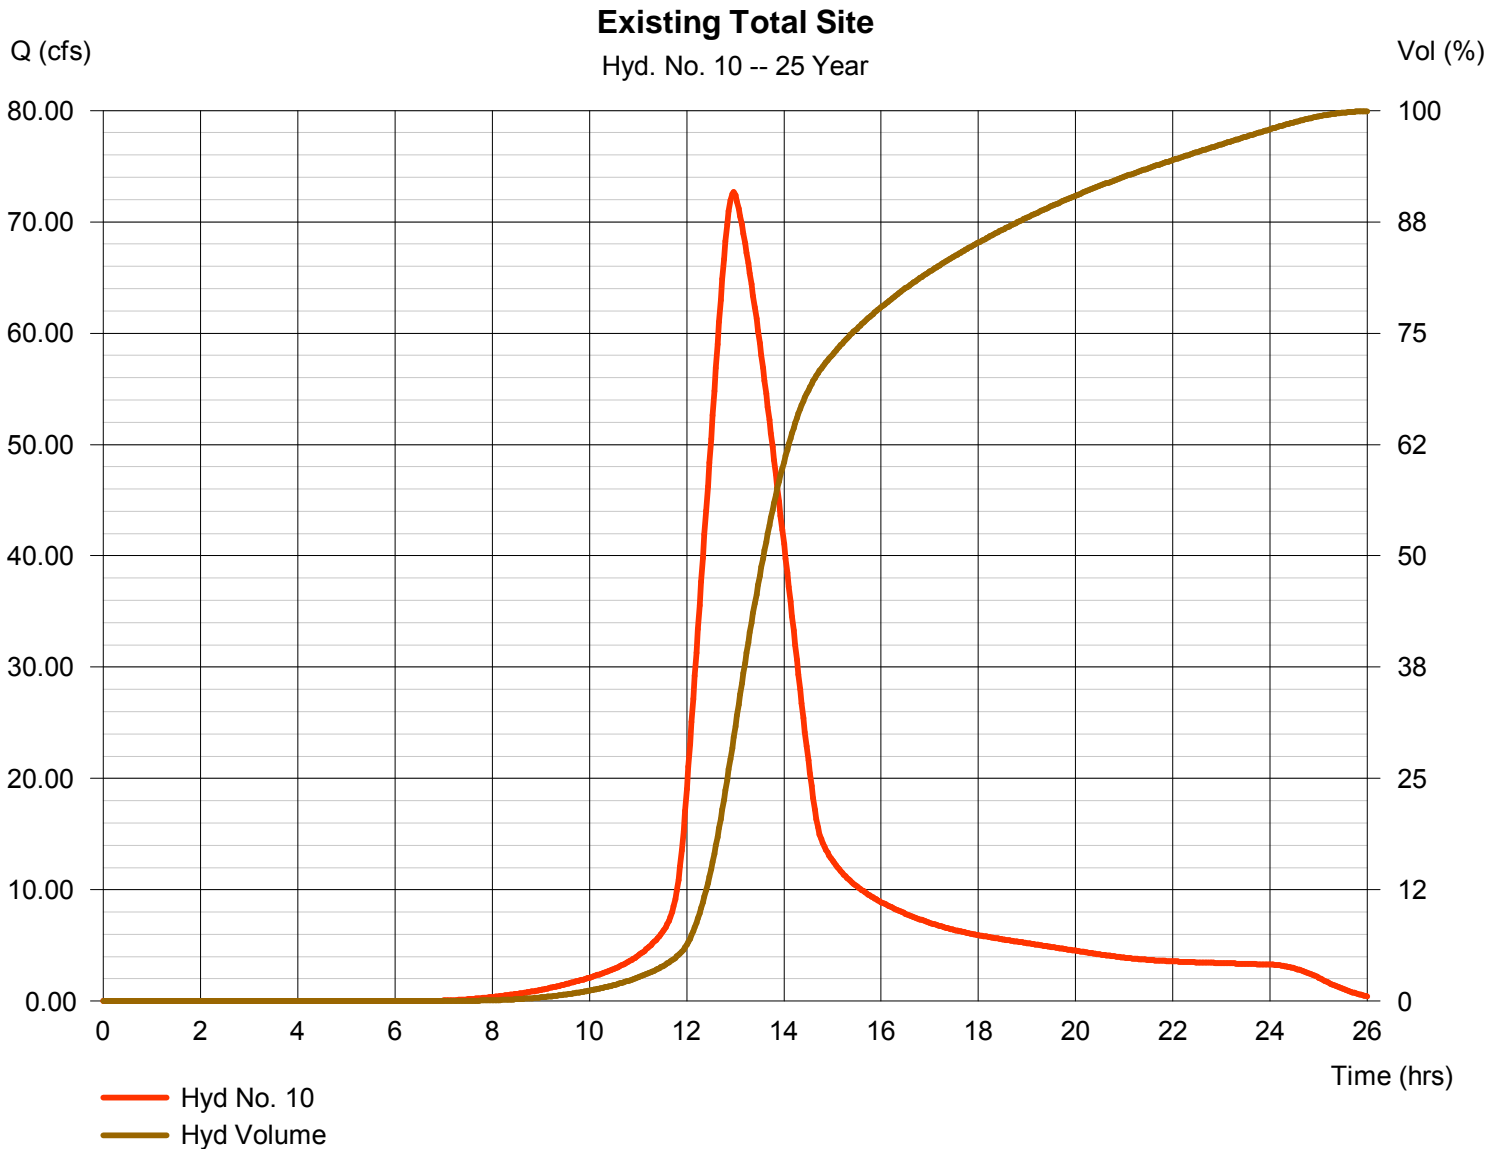

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	115.08	2	740	617,576	-----	-----	-----	Offsite West	
2	Reservoir	56.49	2	770	598,642	1	1337.67	272,836	Upper Pond	
3	Reach	55.62	2	776	598,596	2	-----	-----	Channel Section	
4	SCS Runoff	125.64	2	736	636,016	-----	-----	-----	Developed A	
5	Combine	133.41	2	738	1,234,613	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	67.16	2	788	1,168,816	5	1330.95	381,327	North East Detention	
7	SCS Runoff	82.62	2	722	248,046	-----	-----	-----	Developed B	
8	Reservoir	7.182	2	762	235,901	7	1328.83	152,760	South East Detention	
9	Combine	74.27	2	788	1,404,716	6, 8	-----	-----	Total	
10	SCS Runoff	86.36	2	778	848,686	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 50 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 115.08 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.33 hrs
Time interval	= 2 min	Hyd. volume	= 617,576 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 6.90 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

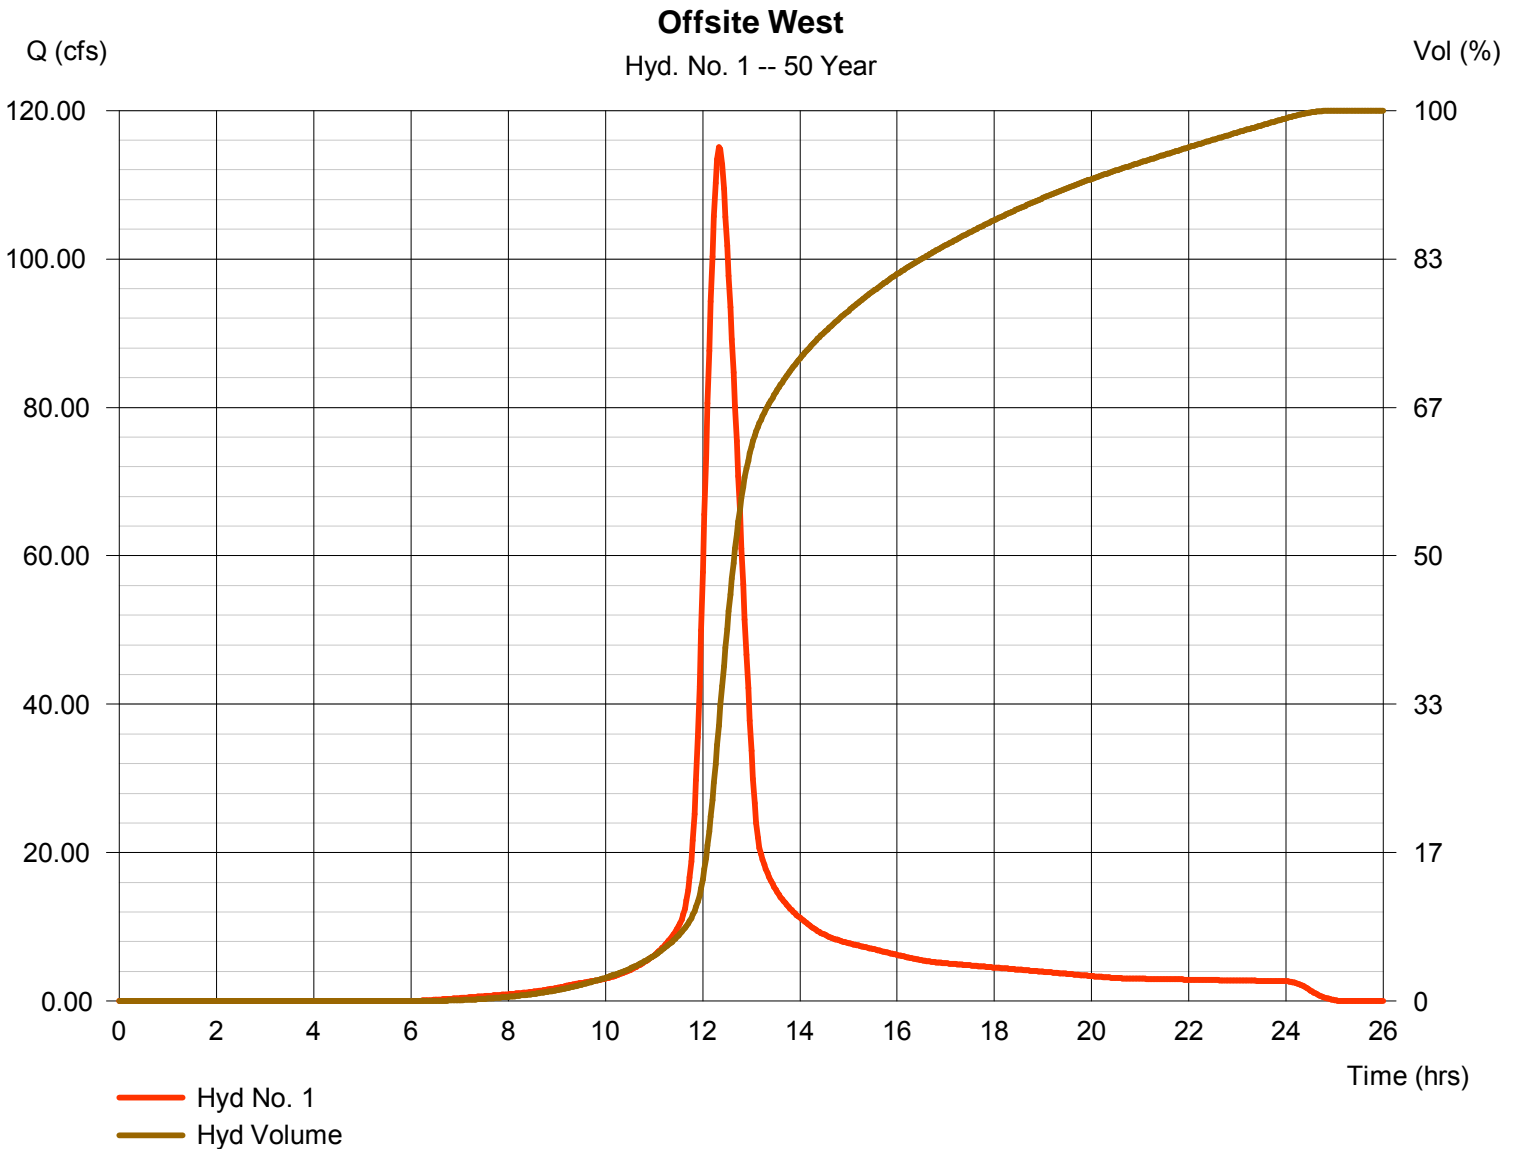

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 56.49 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.83 hrs
Time interval	= 2 min	Hyd. volume	= 598,642 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1337.67 ft
Reservoir name	= Upper Pond	Max. Storage	= 272,836 cuft

Storage Indication method used.

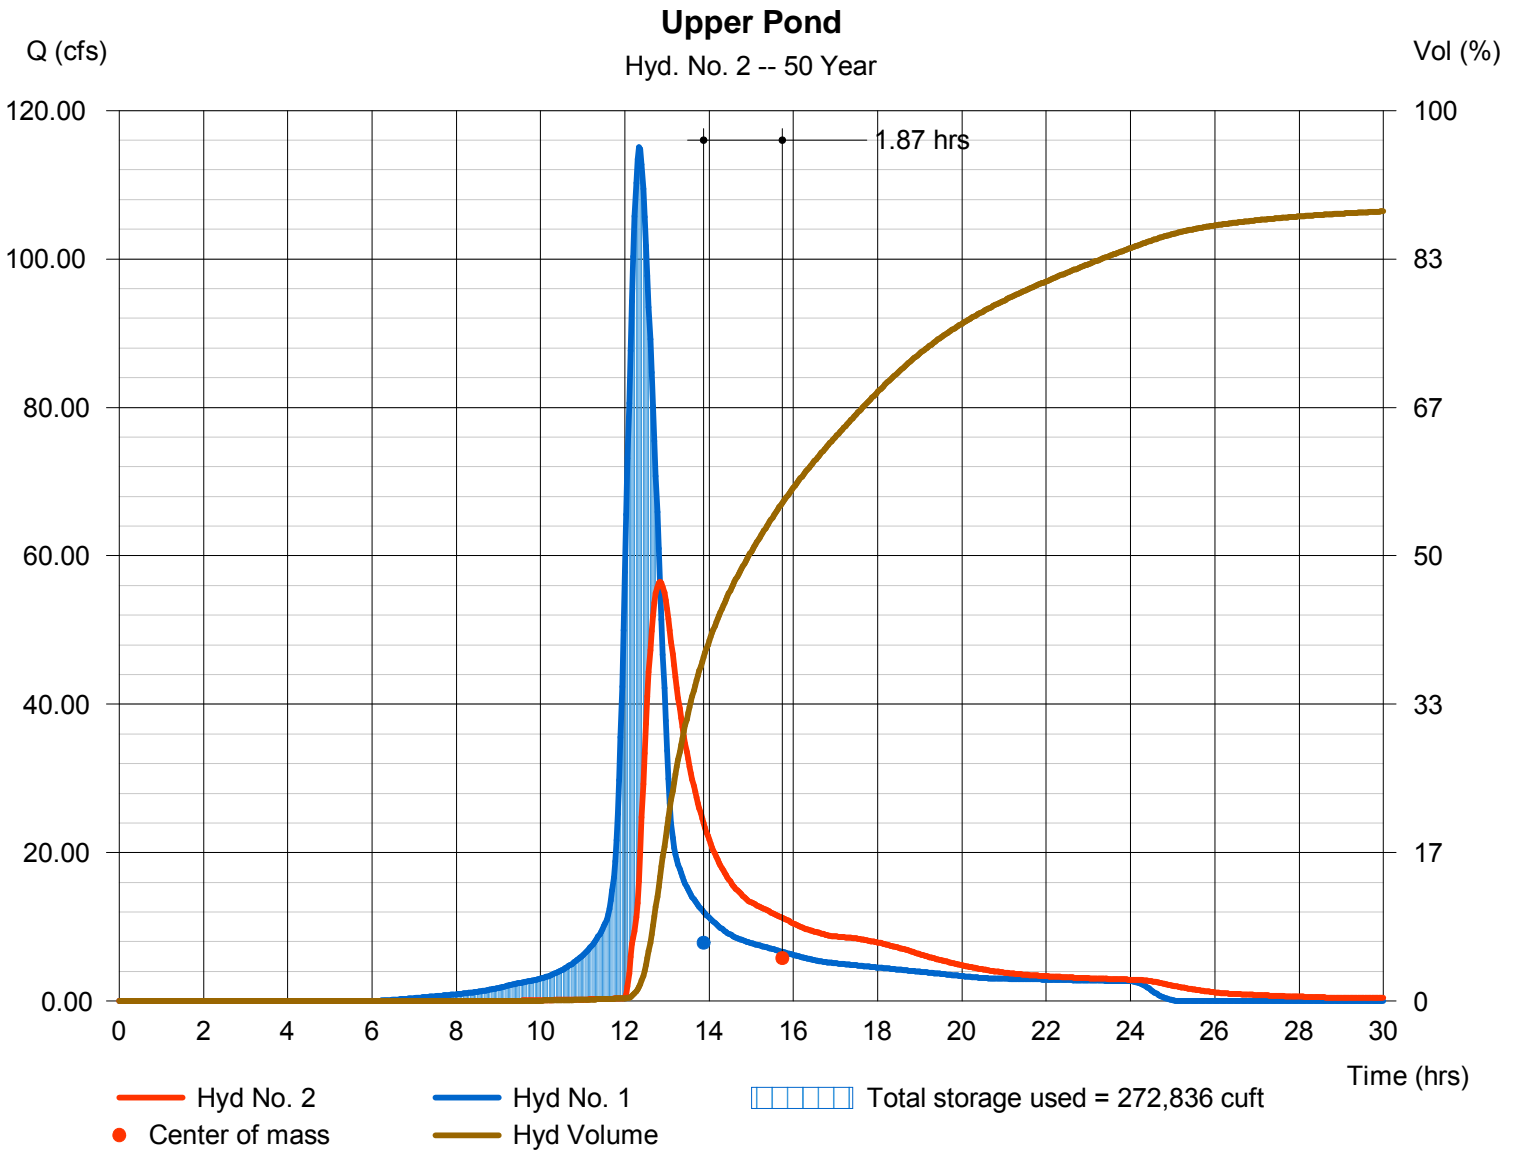

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 55.62 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.93 hrs
Time interval	= 2 min	Hyd. volume	= 598,596 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.3624

Modified Att-Kin routing method used.

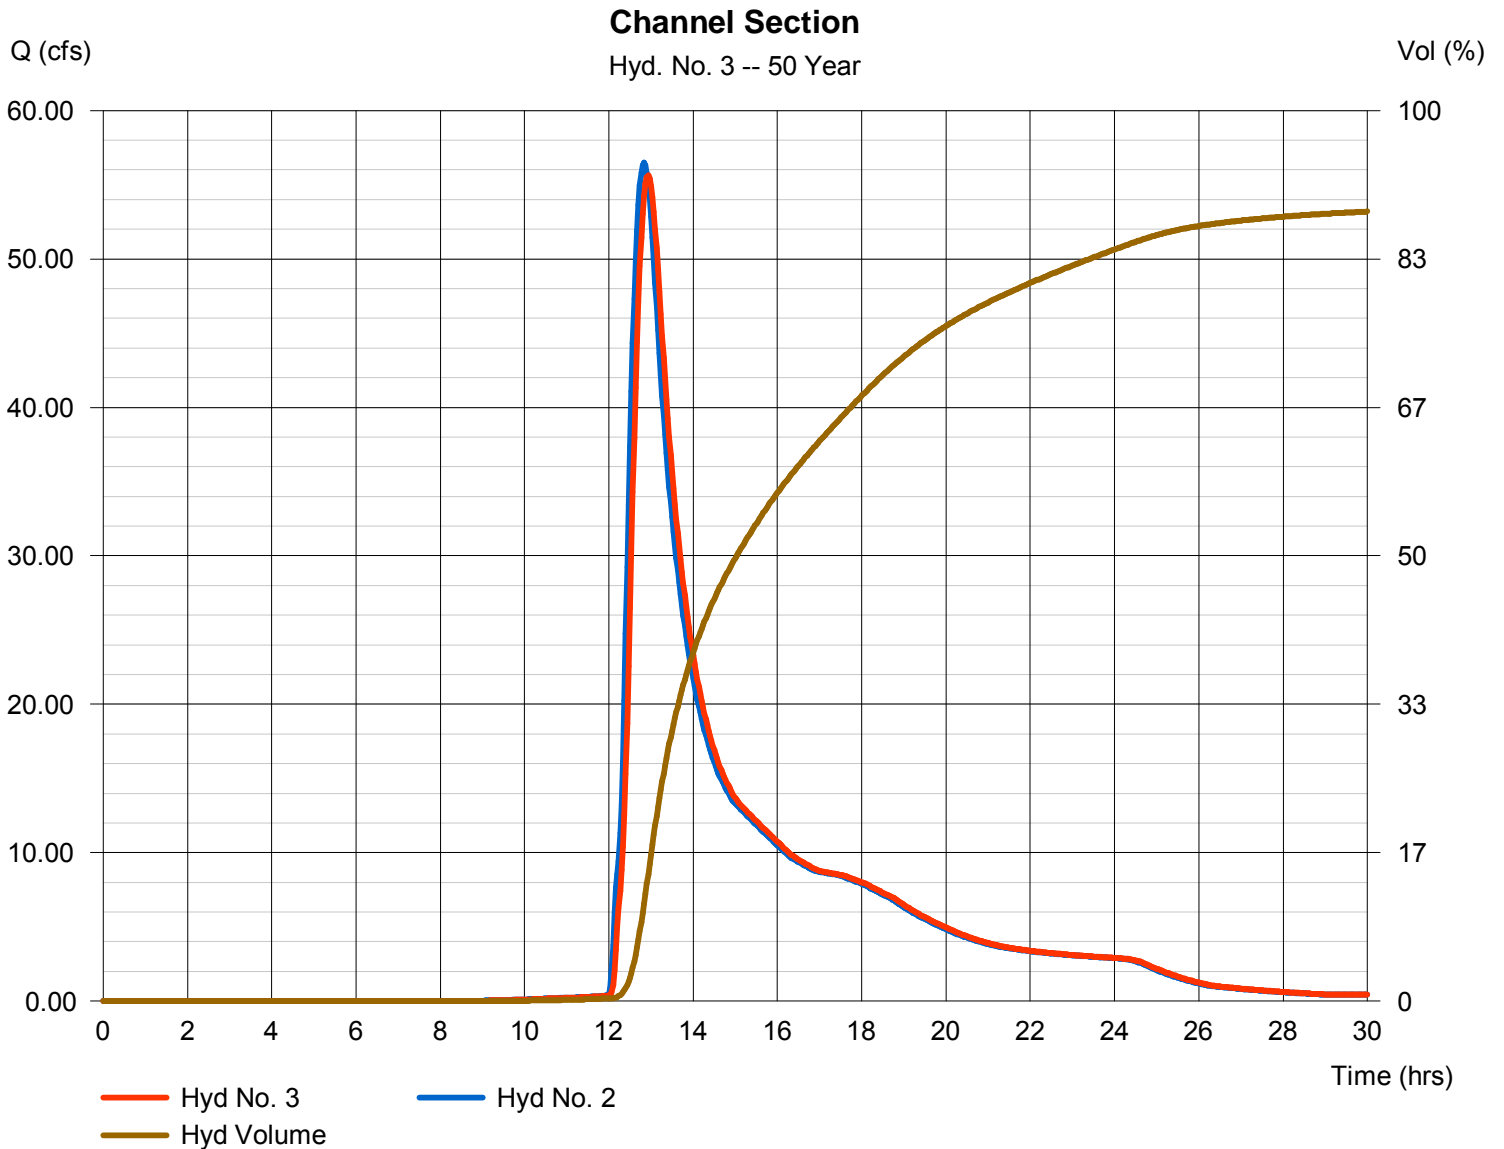

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 125.64 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 636,016 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 6.90 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

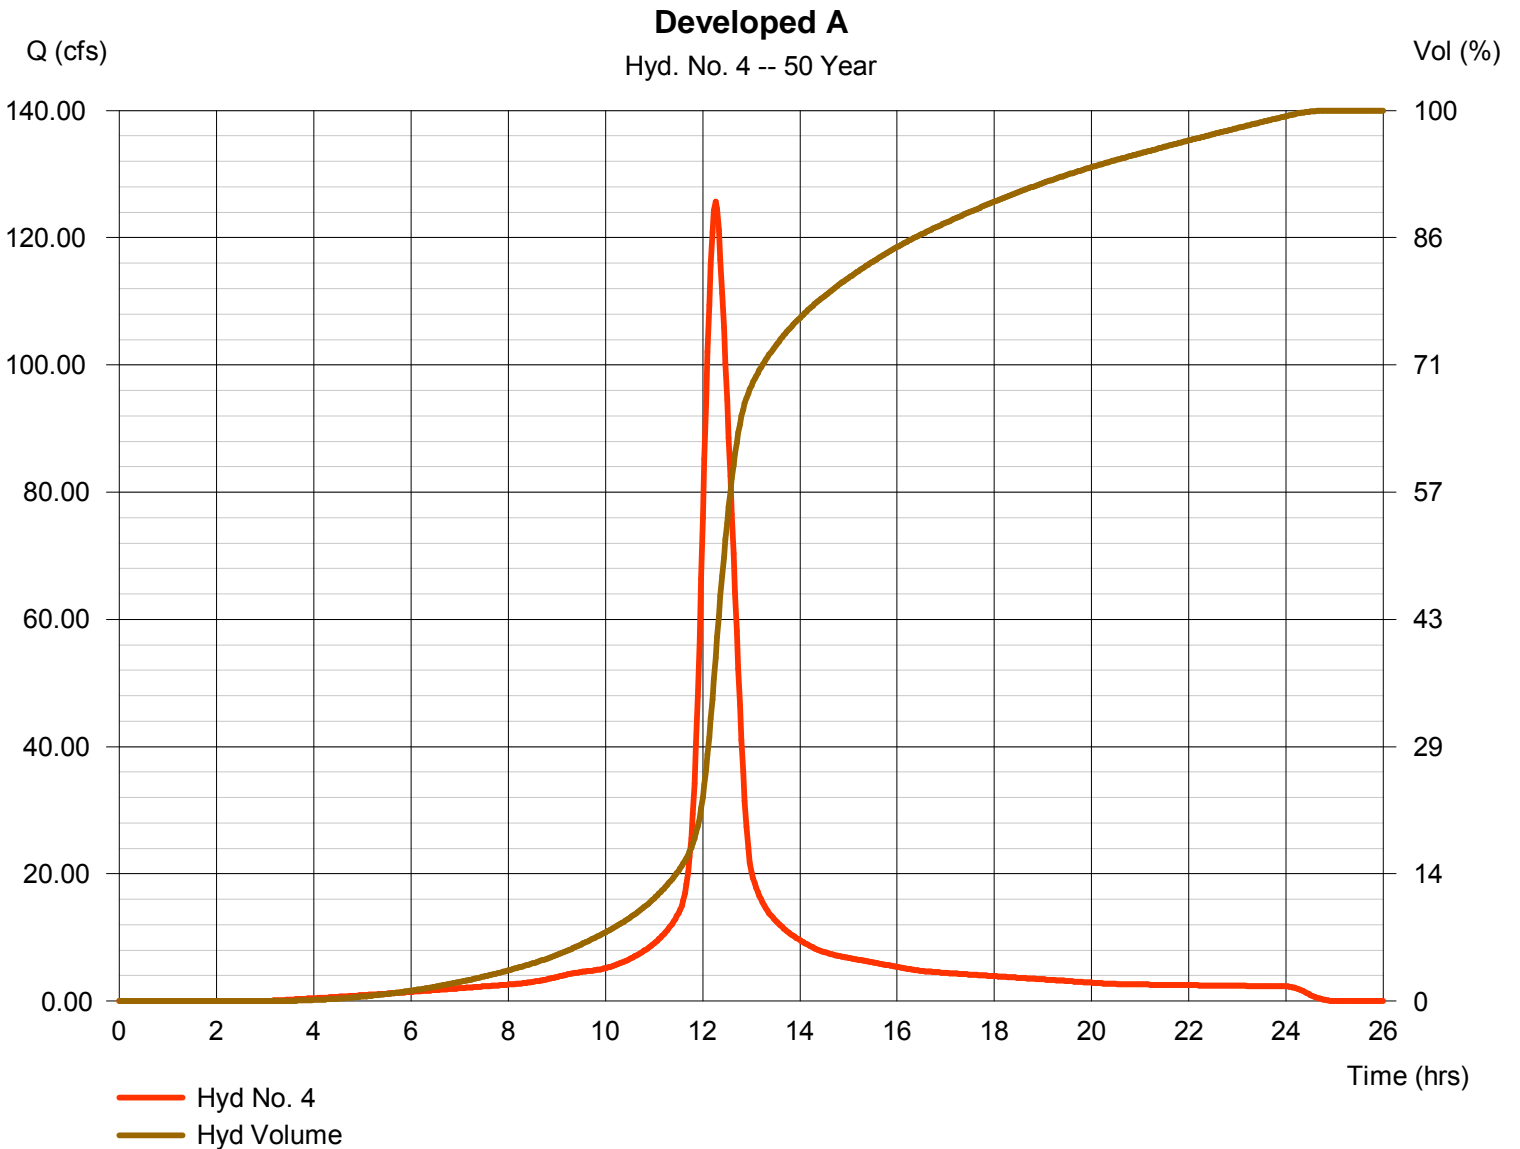

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011


Hyd. No. 5

Runoff to North Pond

Hydrograph type	= Combine	Peak discharge	= 133.41 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.30 hrs
Time interval	= 2 min	Hyd. volume	= 1,234,613 cuft
Inflow hyds.	= 3, 4	Contrib. drain. area	= 30.000 ac

Runoff to North Pond

Hyd. No. 5 -- 50 Year

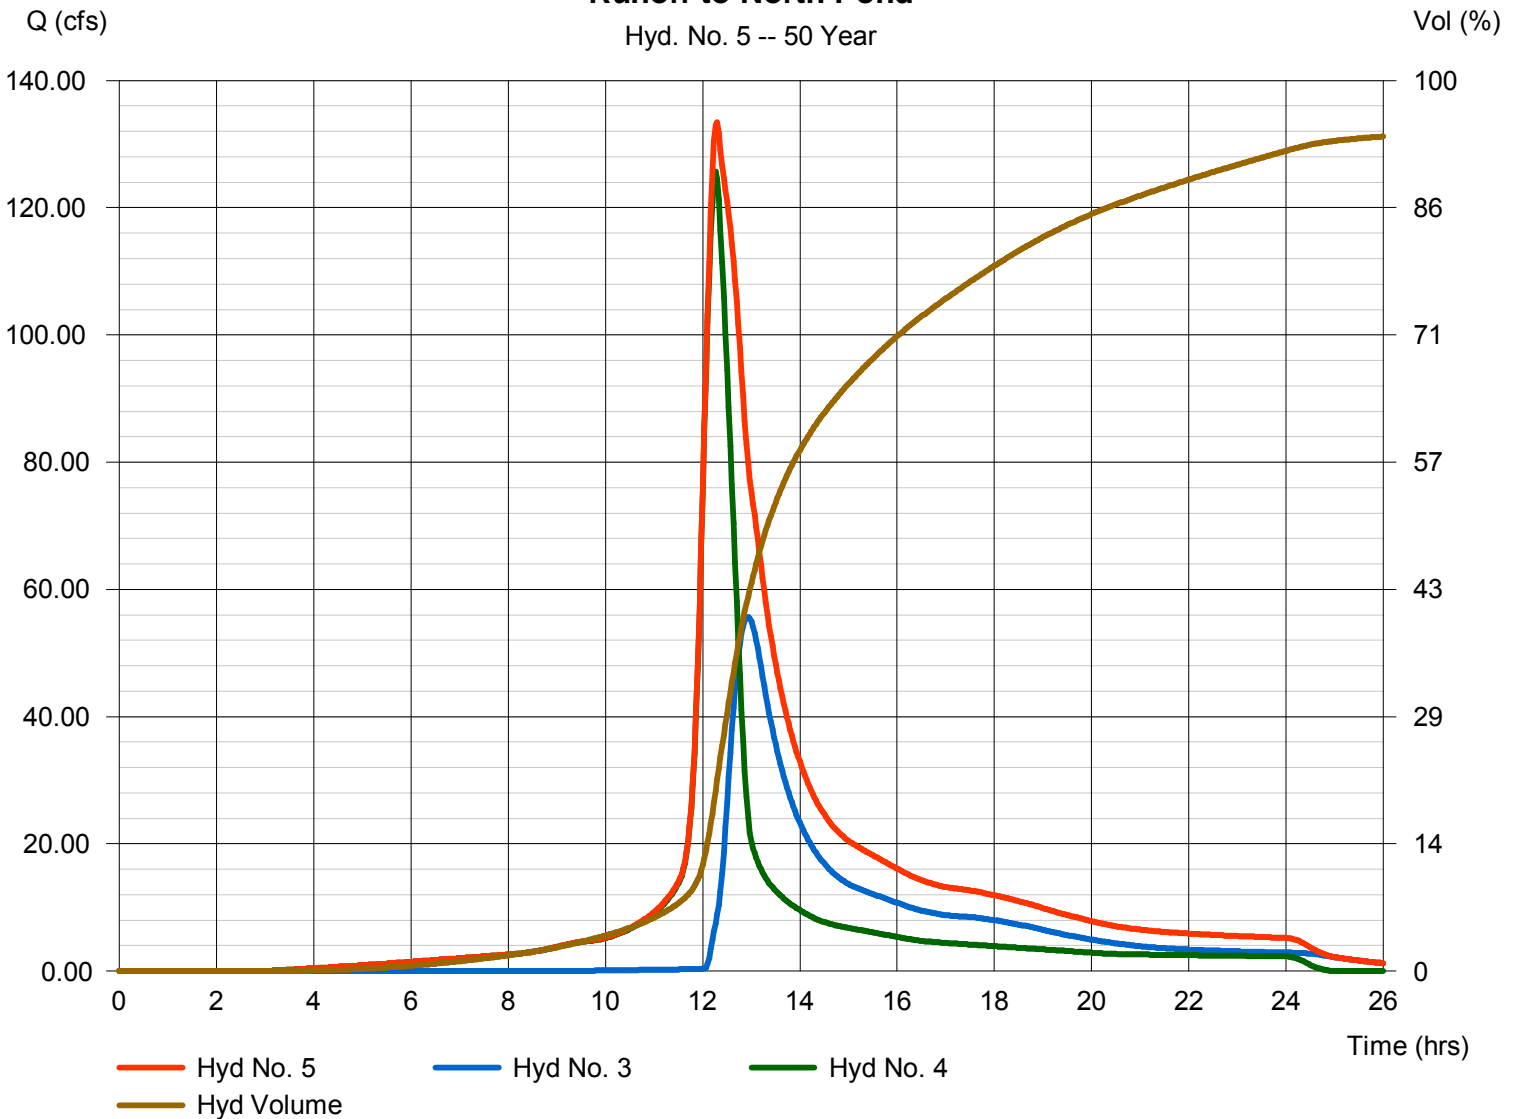

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 67.16 cfs
Storm frequency	= 50 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 1,168,816 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1330.95 ft
Reservoir name	= North East Pond	Max. Storage	= 381,327 cuft

Storage Indication method used.

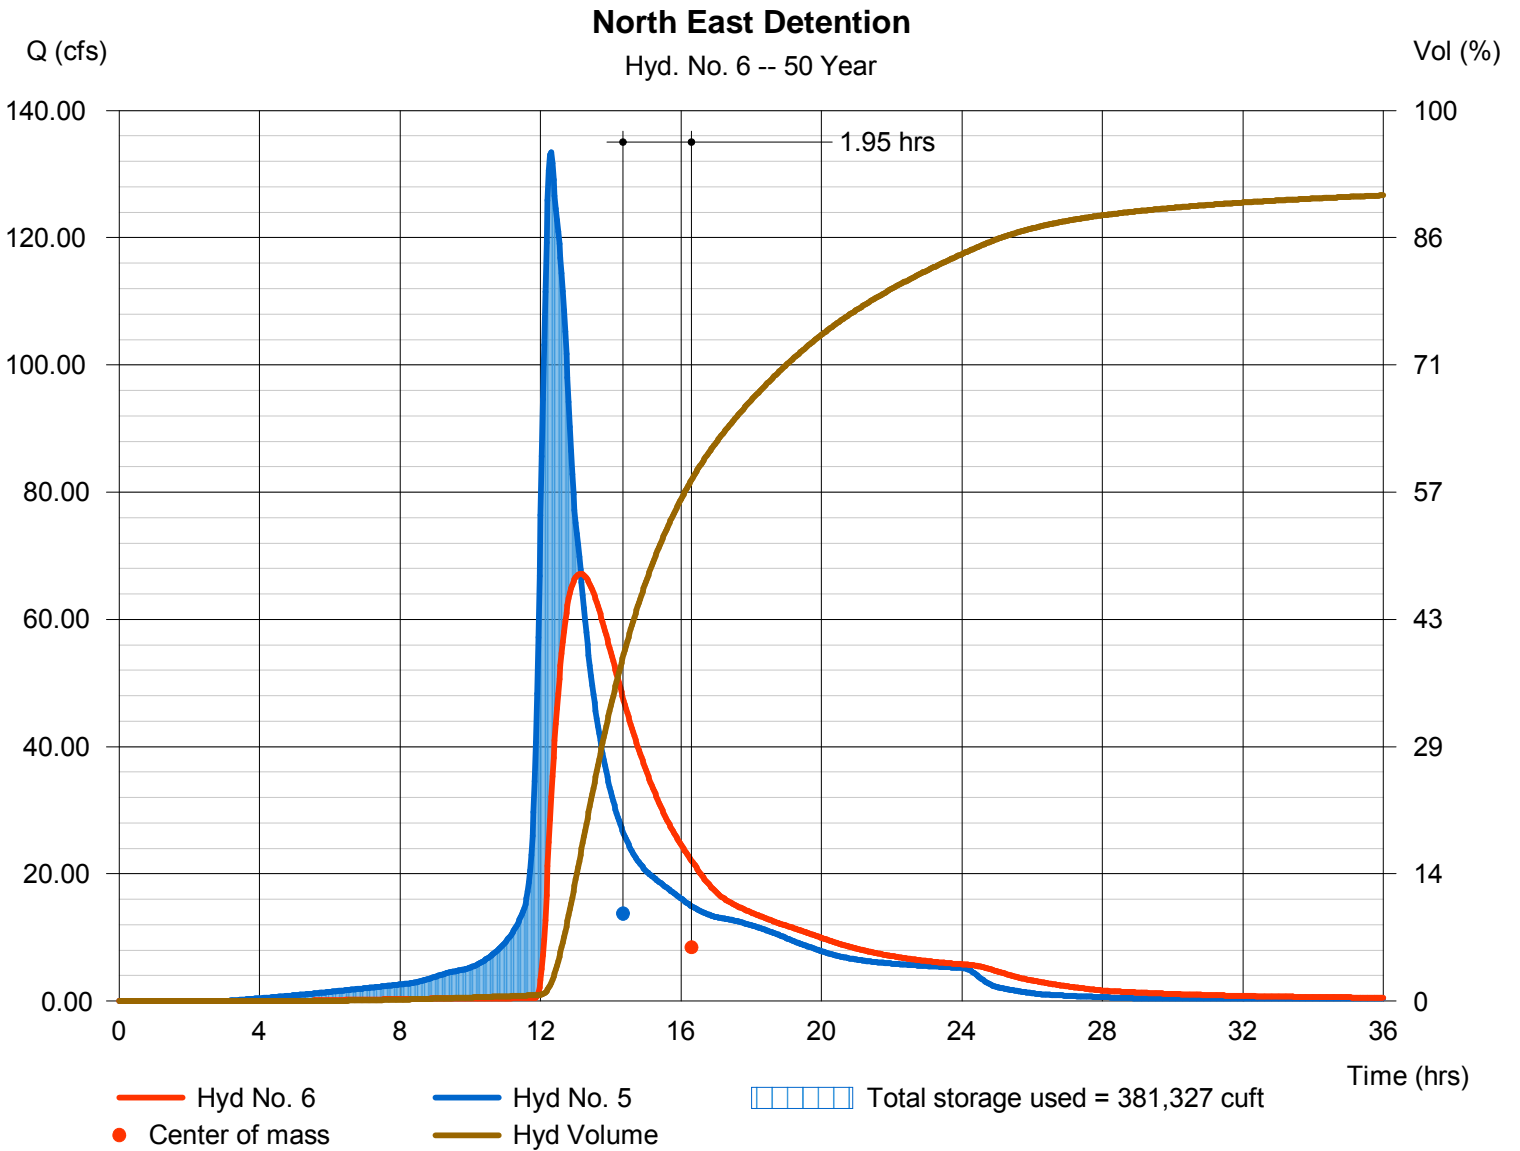

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 82.62 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 248,046 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 6.90 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

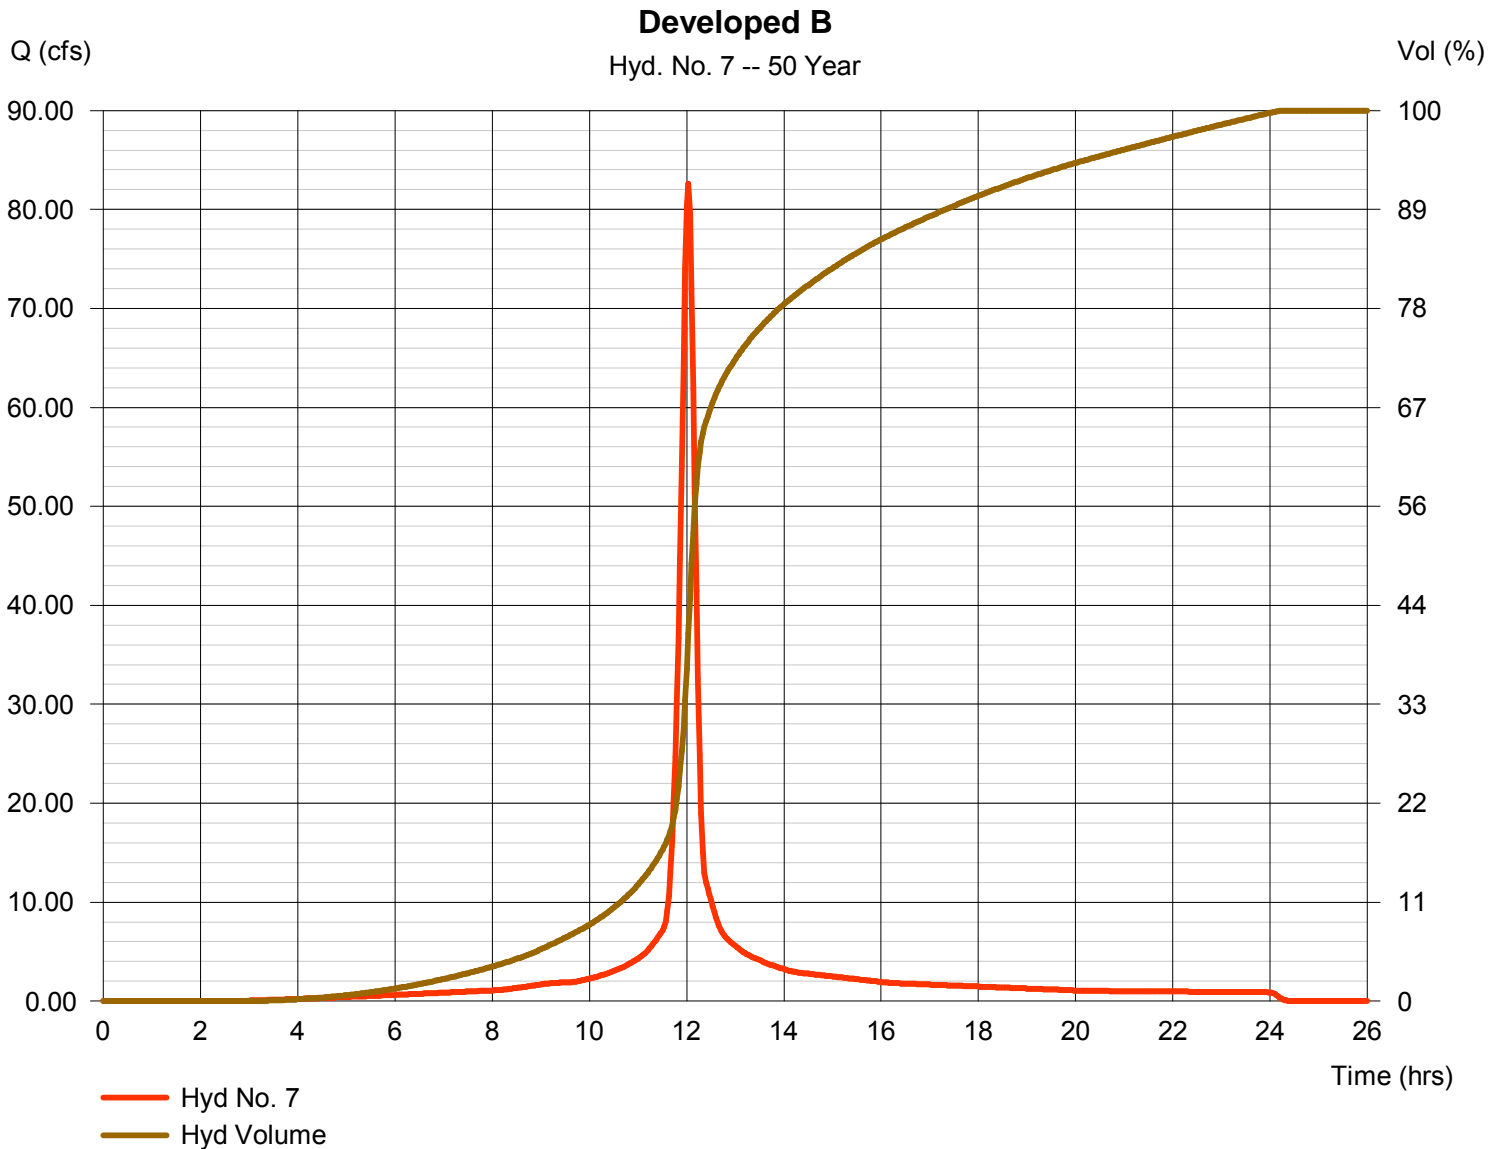

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 7.182 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.70 hrs
Time interval	= 2 min	Hyd. volume	= 235,901 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1328.83 ft
Reservoir name	= South East Pond	Max. Storage	= 152,760 cuft

Storage Indication method used.

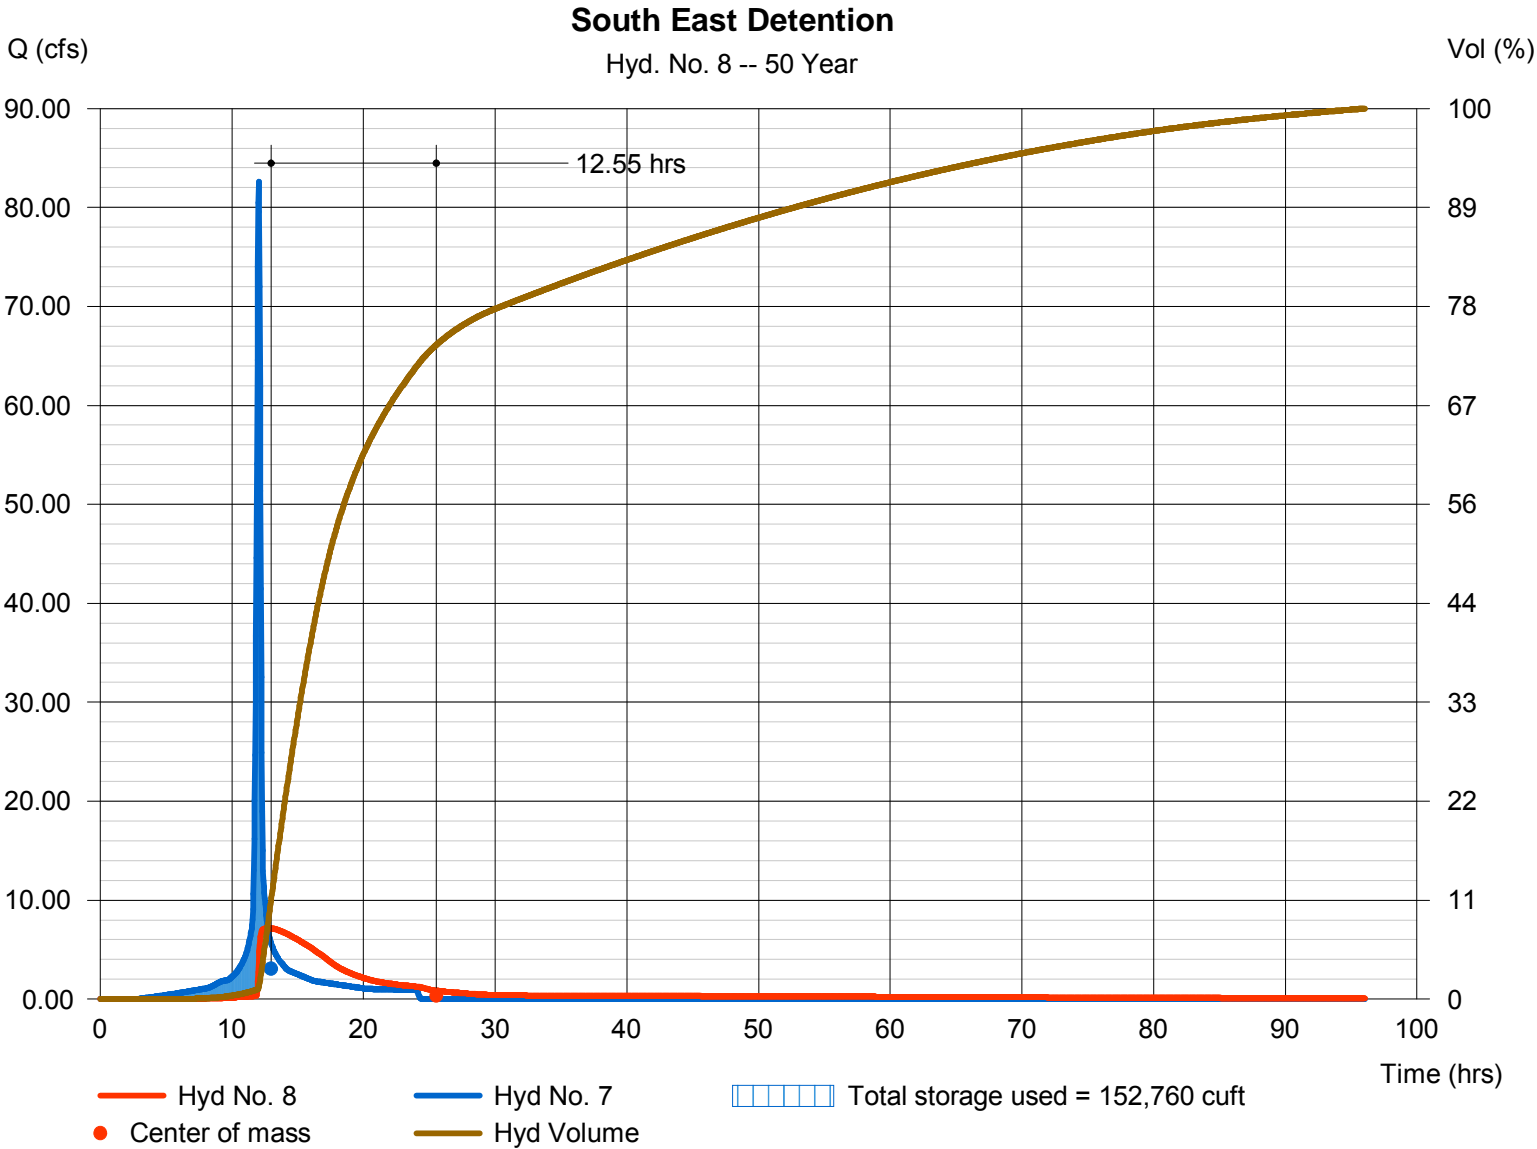

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total

Hydrograph type	= Combine	Peak discharge	= 74.27 cfs
Storm frequency	= 50 yrs	Time to peak	= 13.13 hrs
Time interval	= 2 min	Hyd. volume	= 1,404,716 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

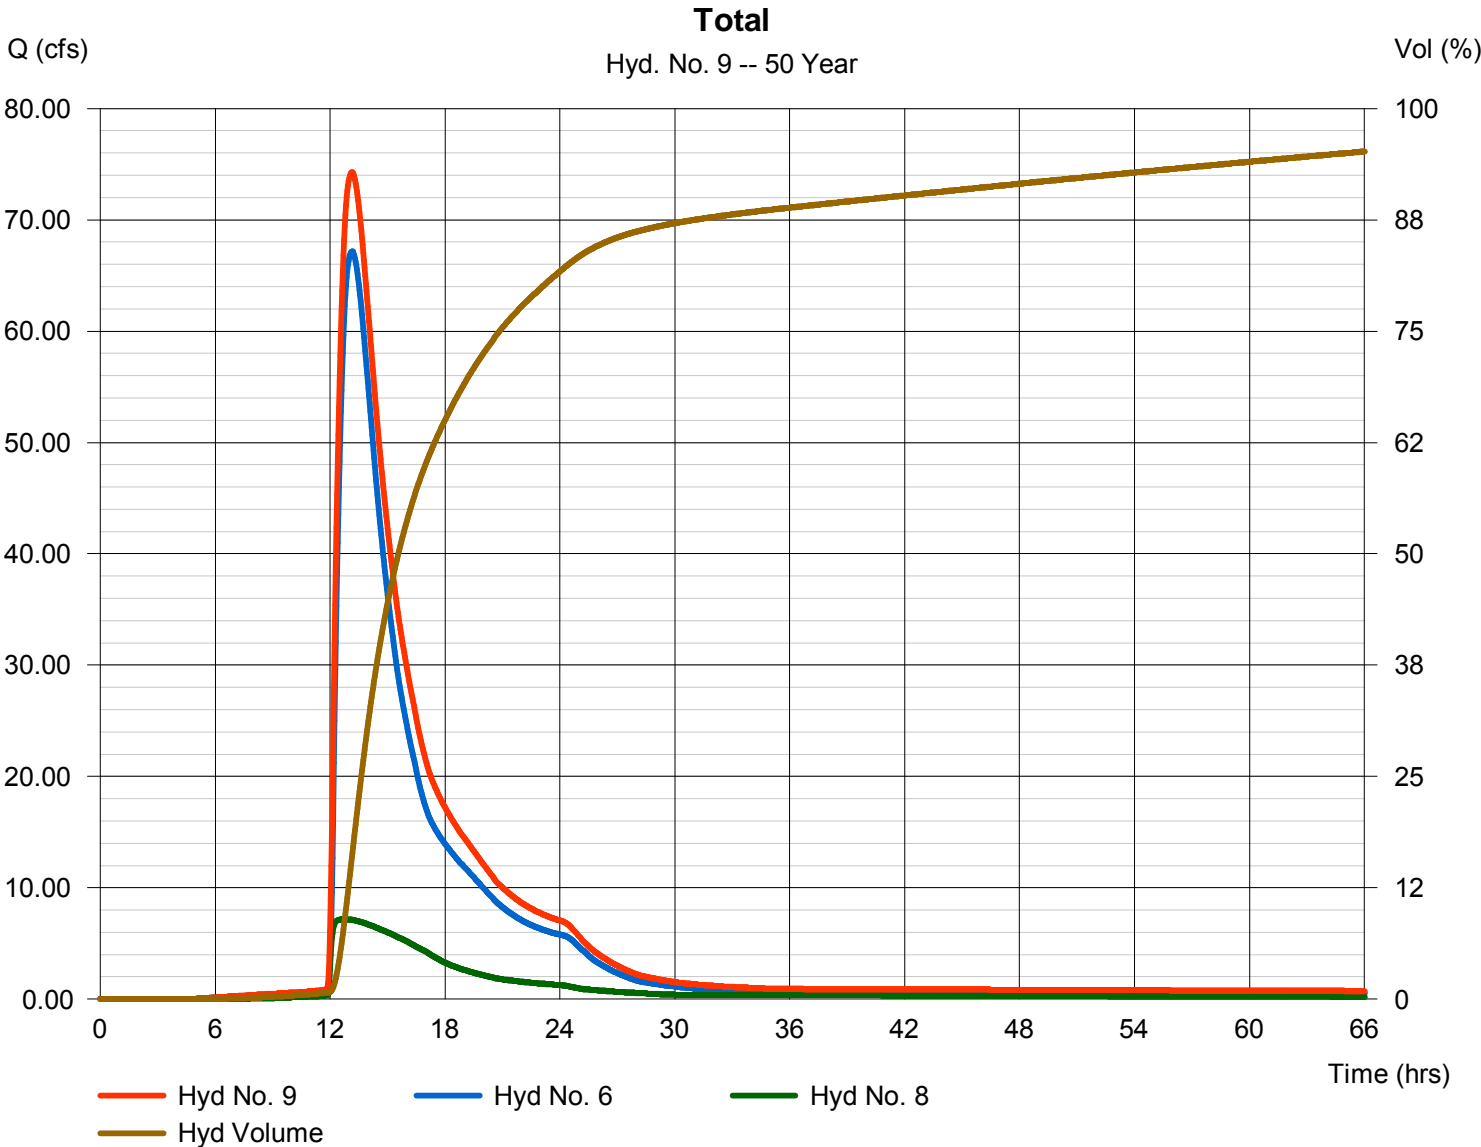

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 86.36 cfs
Storm frequency	= 50 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 848,686 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 6.90 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

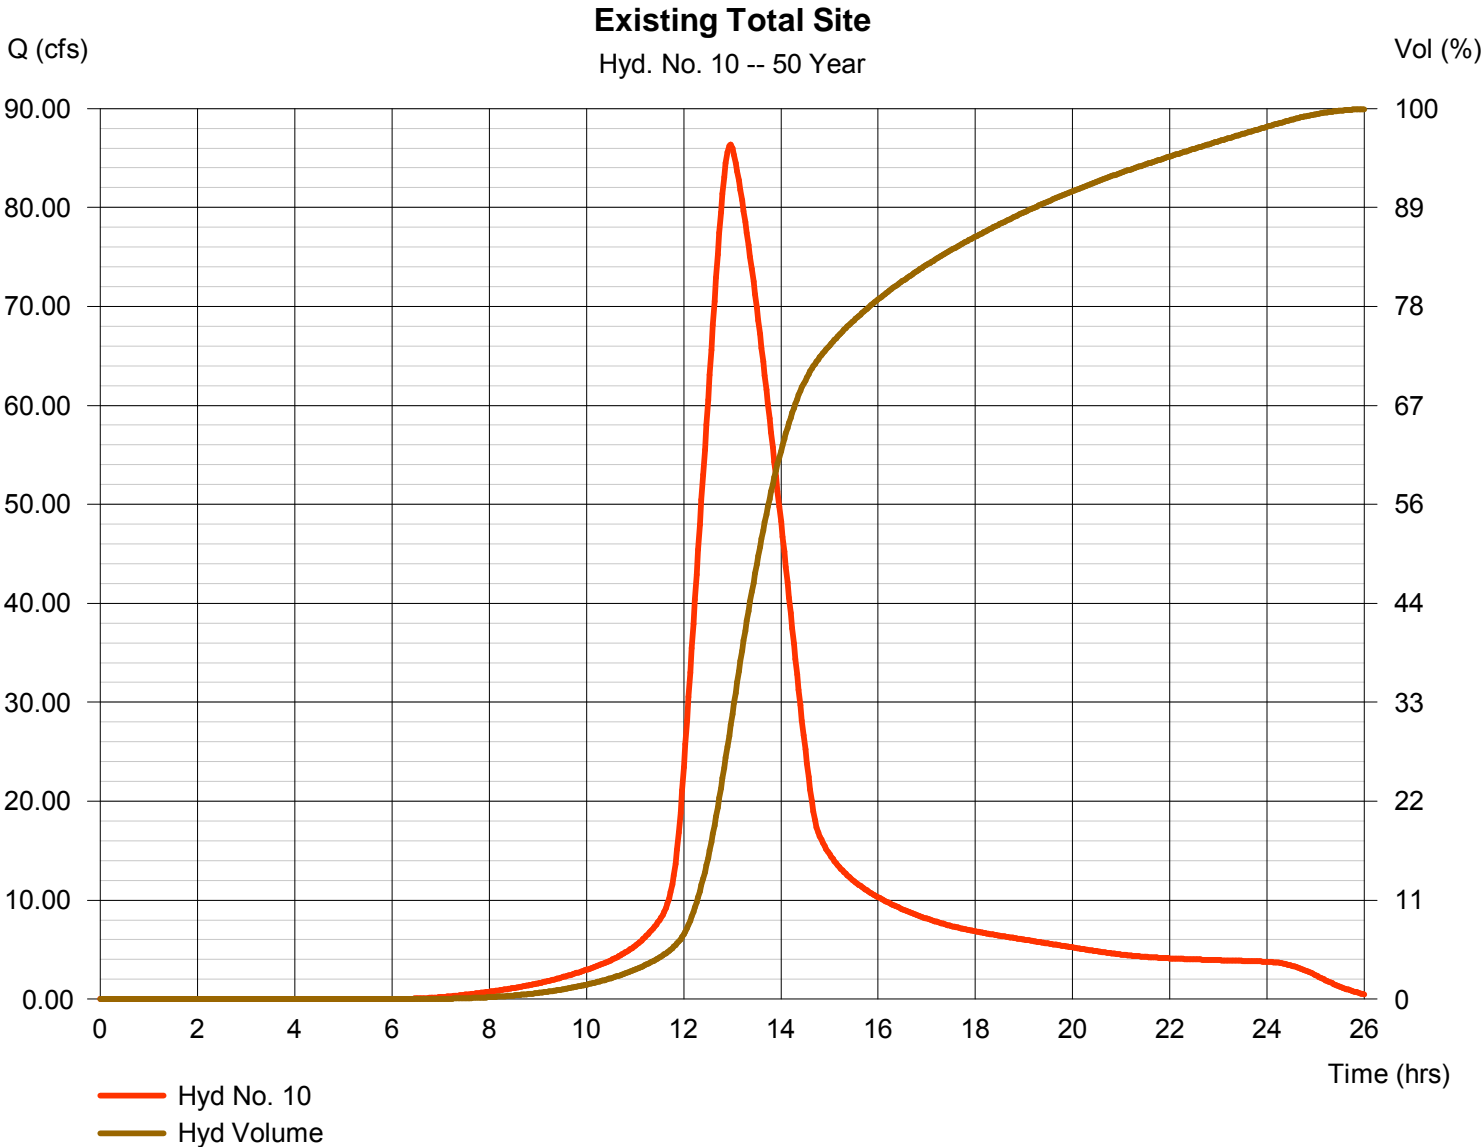

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	135.59	2	740	729,693	-----	-----	-----	Offsite West	
2	Reservoir	75.04	2	766	710,663	1	1338.03	303,211	Upper Pond	
3	Reach	74.12	2	772	710,619	2	-----	-----	Channel Section	
4	SCS Runoff	143.72	2	736	732,575	-----	-----	-----	Developed A	
5	Combine	157.57	2	740	1,443,195	3, 4	-----	-----	Runoff to North Pond	
6	Reservoir	92.76	2	782	1,377,173	5	1331.36	440,498	North East Detention	
7	SCS Runoff	94.39	2	722	285,704	-----	-----	-----	Developed B	
8	Reservoir	8.217	2	762	273,430	7	1329.05	176,345	South East Detention	
9	Combine	100.86	2	780	1,650,604	6, 8	-----	-----	Total	
10	SCS Runoff	101.89	2	778	1,002,759	-----	-----	-----	Existing Total Site	
Skyway 3rd Total Site test.gpw					Return Period: 100 Year			Monday, Dec 19, 2011		

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 1

Offsite West

Hydrograph type	= SCS Runoff	Peak discharge	= 135.59 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.33 hrs
Time interval	= 2 min	Hyd. volume	= 729,693 cuft
Drainage area	= 37.300 ac	Curve number	= 80
Basin Slope	= 0.7 %	Hydraulic length	= 1300 ft
Tc method	= LAG	Time of conc. (Tc)	= 46.94 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

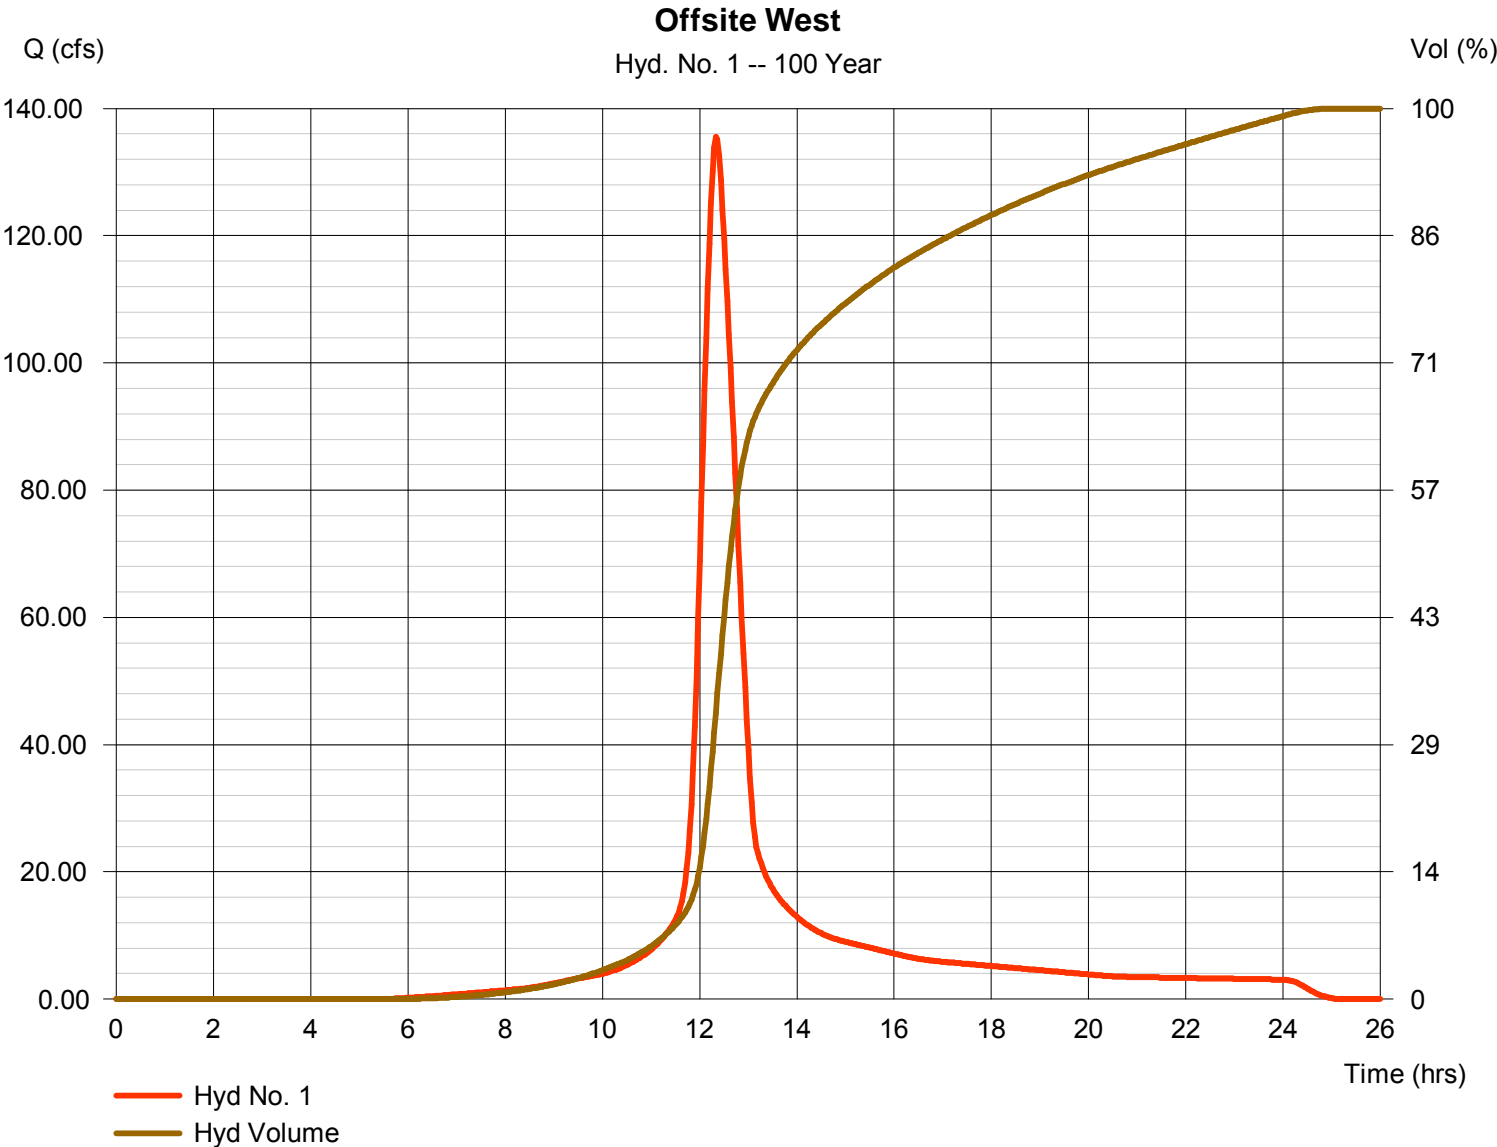

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 2

Upper Pond

Hydrograph type	= Reservoir	Peak discharge	= 75.04 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.77 hrs
Time interval	= 2 min	Hyd. volume	= 710,663 cuft
Inflow hyd. No.	= 1 - Offsite West	Max. Elevation	= 1338.03 ft
Reservoir name	= Upper Pond	Max. Storage	= 303,211 cuft

Storage Indication method used.

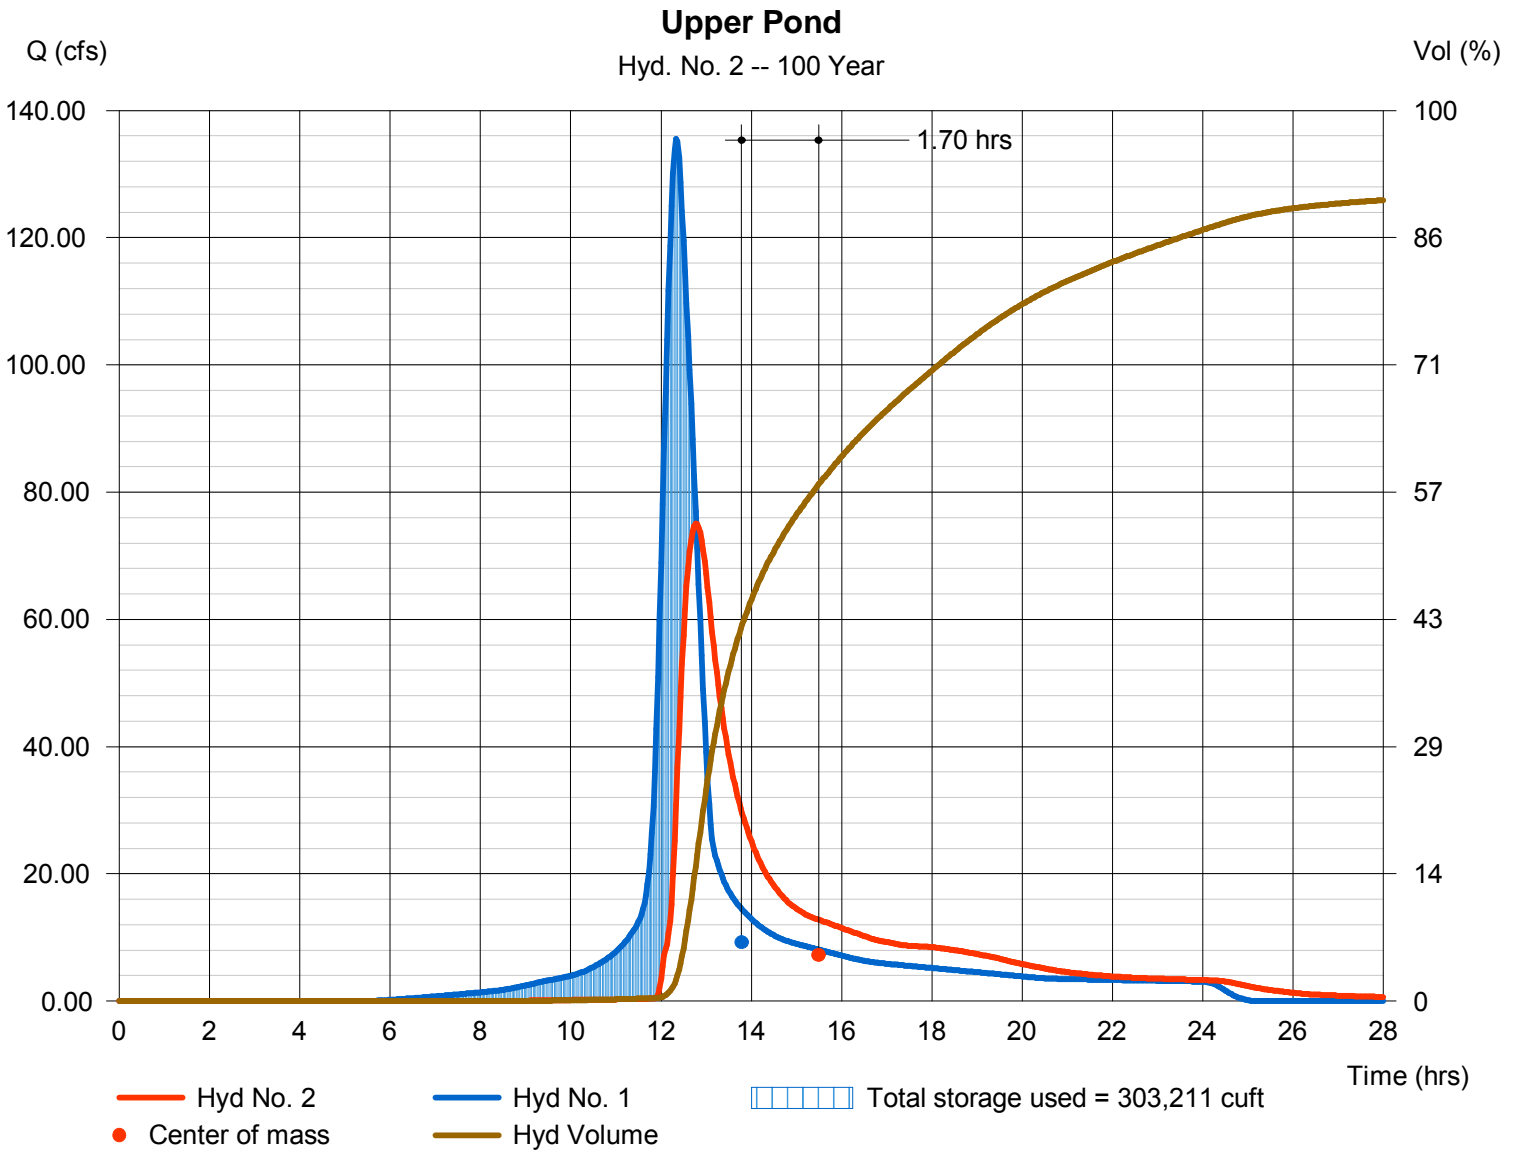

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 3

Channel Section

Hydrograph type	= Reach	Peak discharge	= 74.12 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.87 hrs
Time interval	= 2 min	Hyd. volume	= 710,619 cuft
Inflow hyd. No.	= 2 - Upper Pond	Section type	= Trapezoidal
Reach length	= 1300.0 ft	Channel slope	= 0.3 %
Manning's n	= 0.020	Bottom width	= 5.0 ft
Side slope	= 3.0:1	Max. depth	= 5.0 ft
Rating curve x	= 1.395	Rating curve m	= 1.341
Ave. velocity	= 0.00 ft/s	Routing coeff.	= 0.3844

Modified Att-Kin routing method used.

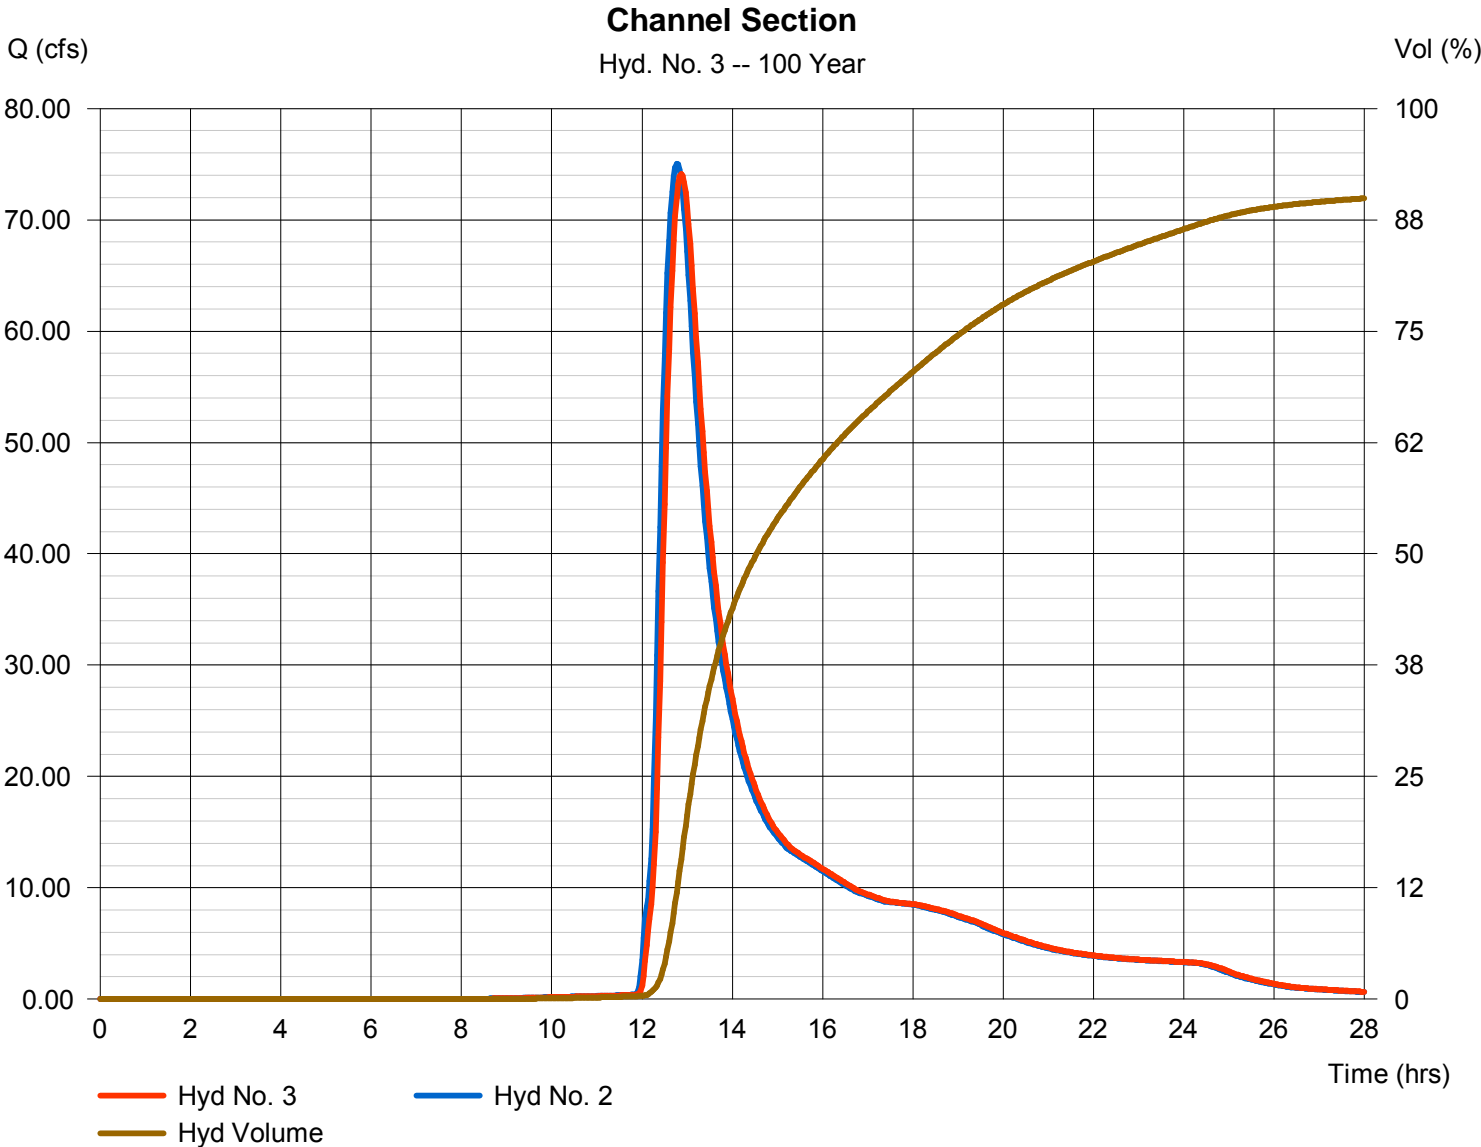


Hydrograph Report

Hyd. No. 4

Developed A

Hydrograph type	= SCS Runoff	Peak discharge	= 143.72 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.27 hrs
Time interval	= 2 min	Hyd. volume	= 732,575 cuft
Drainage area	= 30.000 ac	Curve number	= 91
Basin Slope	= 0.4 %	Hydraulic length	= 1200 ft
Tc method	= LAG	Time of conc. (Tc)	= 39.22 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

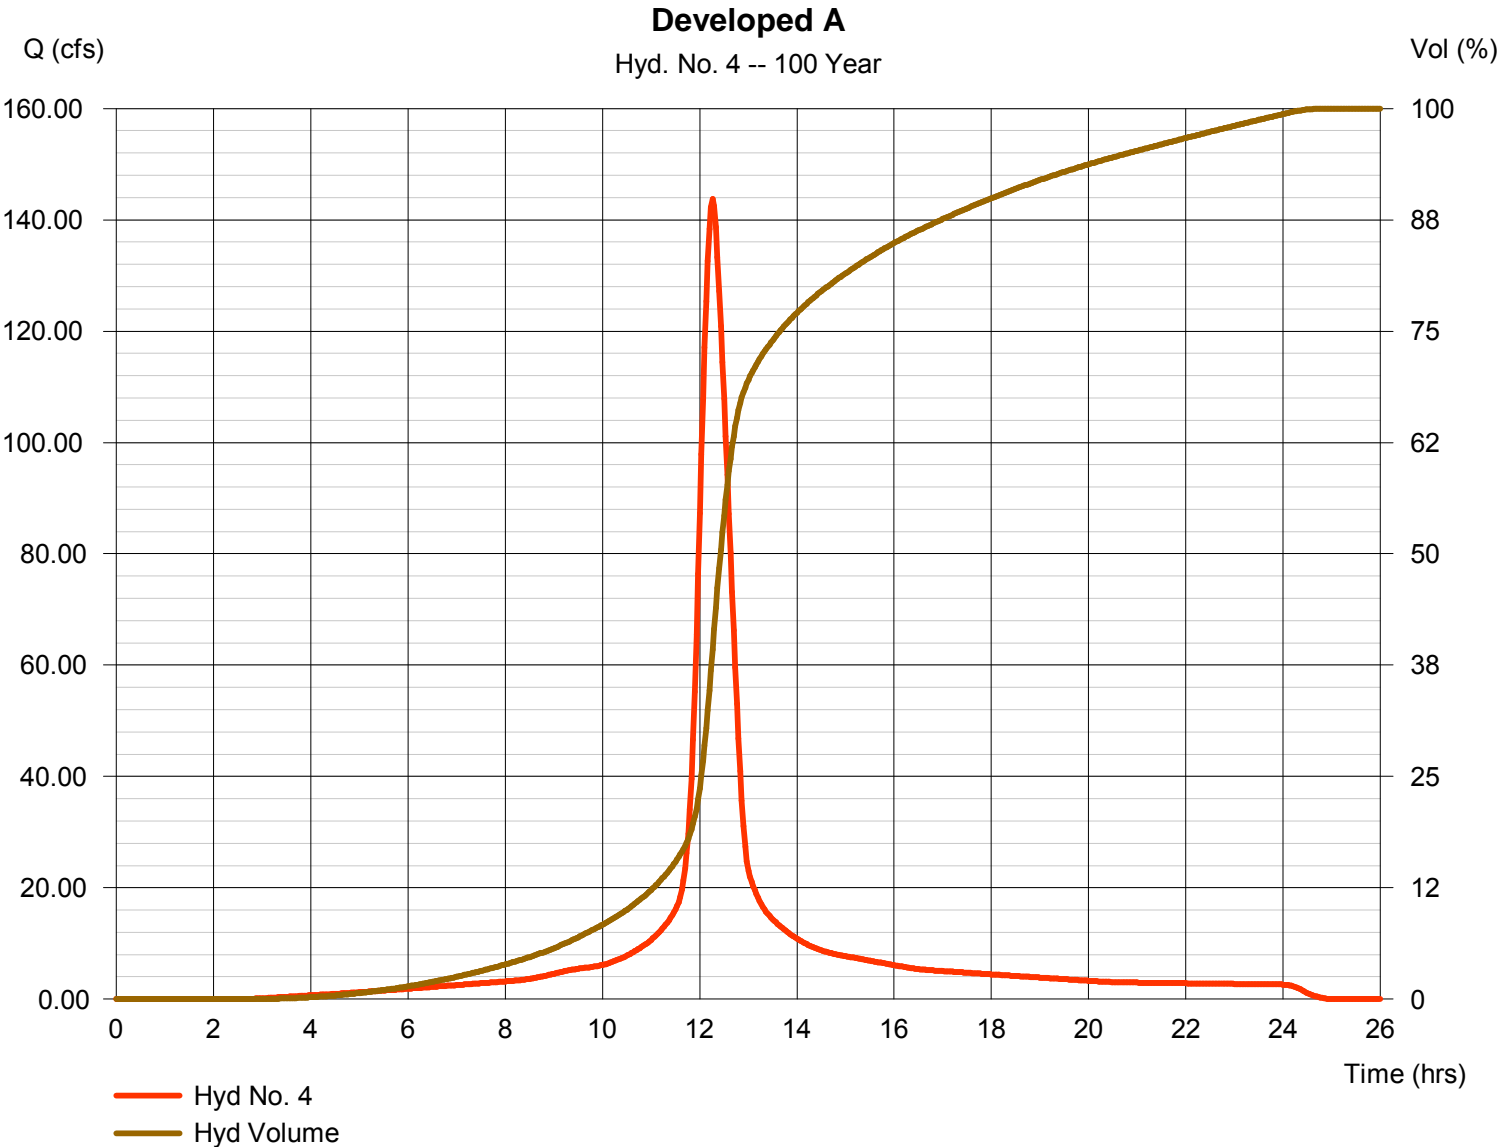

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011


Hyd. No. 5

Runoff to North Pond

Hydrograph type	= Combine	Peak discharge	= 157.57 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.33 hrs
Time interval	= 2 min	Hyd. volume	= 1,443,195 cuft
Inflow hyds.	= 3, 4	Contrib. drain. area	= 30.000 ac

Runoff to North Pond

Hyd. No. 5 -- 100 Year

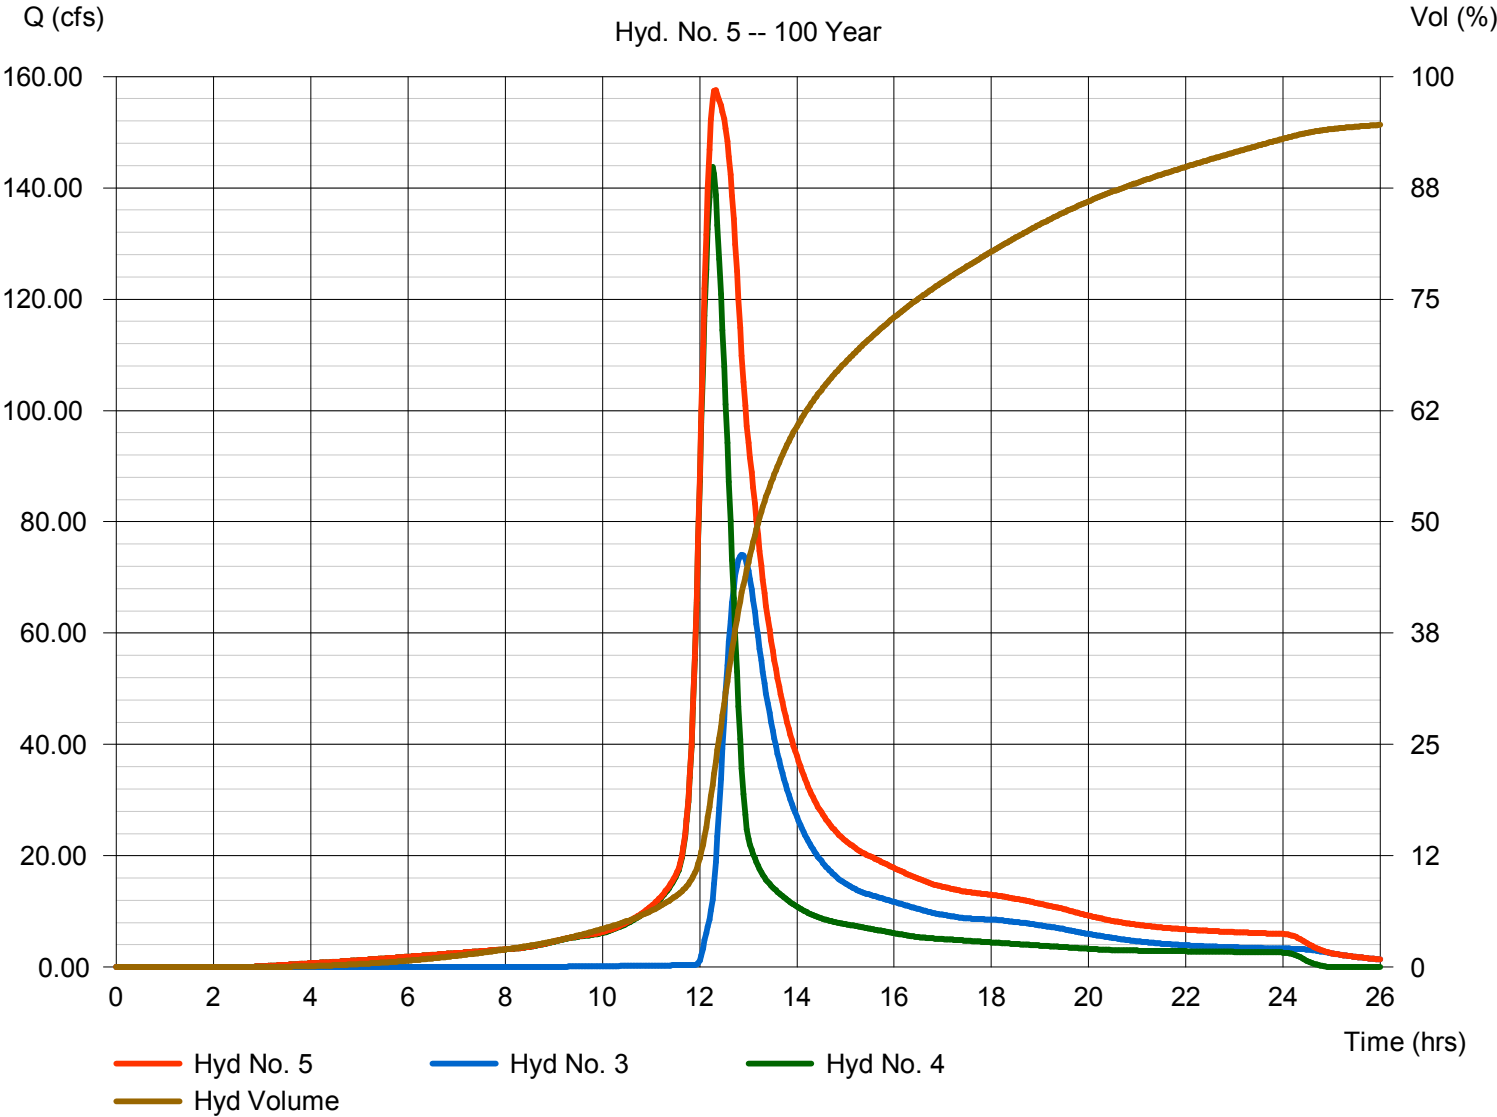

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 6

North East Detention

Hydrograph type	= Reservoir	Peak discharge	= 92.76 cfs
Storm frequency	= 100 yrs	Time to peak	= 13.03 hrs
Time interval	= 2 min	Hyd. volume	= 1,377,173 cuft
Inflow hyd. No.	= 5 - Runoff to North Pond	Max. Elevation	= 1331.36 ft
Reservoir name	= North East Pond	Max. Storage	= 440,498 cuft

Storage Indication method used.

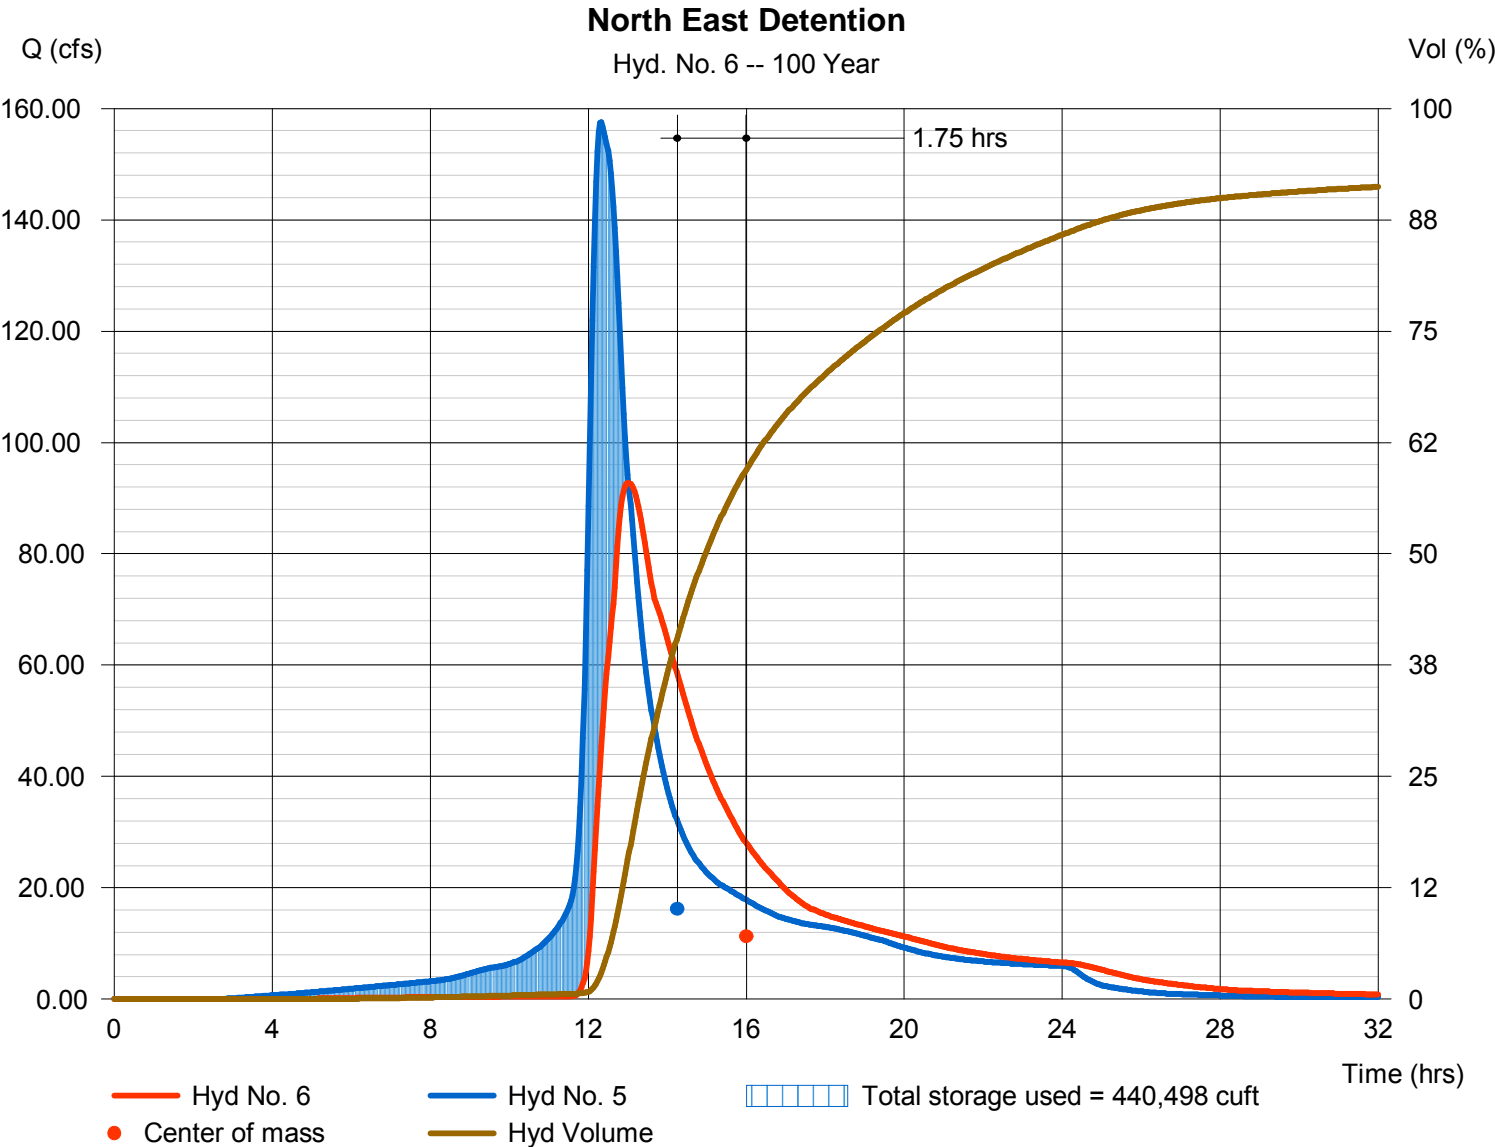

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 7

Developed B

Hydrograph type	= SCS Runoff	Peak discharge	= 94.39 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.03 hrs
Time interval	= 2 min	Hyd. volume	= 285,704 cuft
Drainage area	= 12.000 ac	Curve number	= 91
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 15.00 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

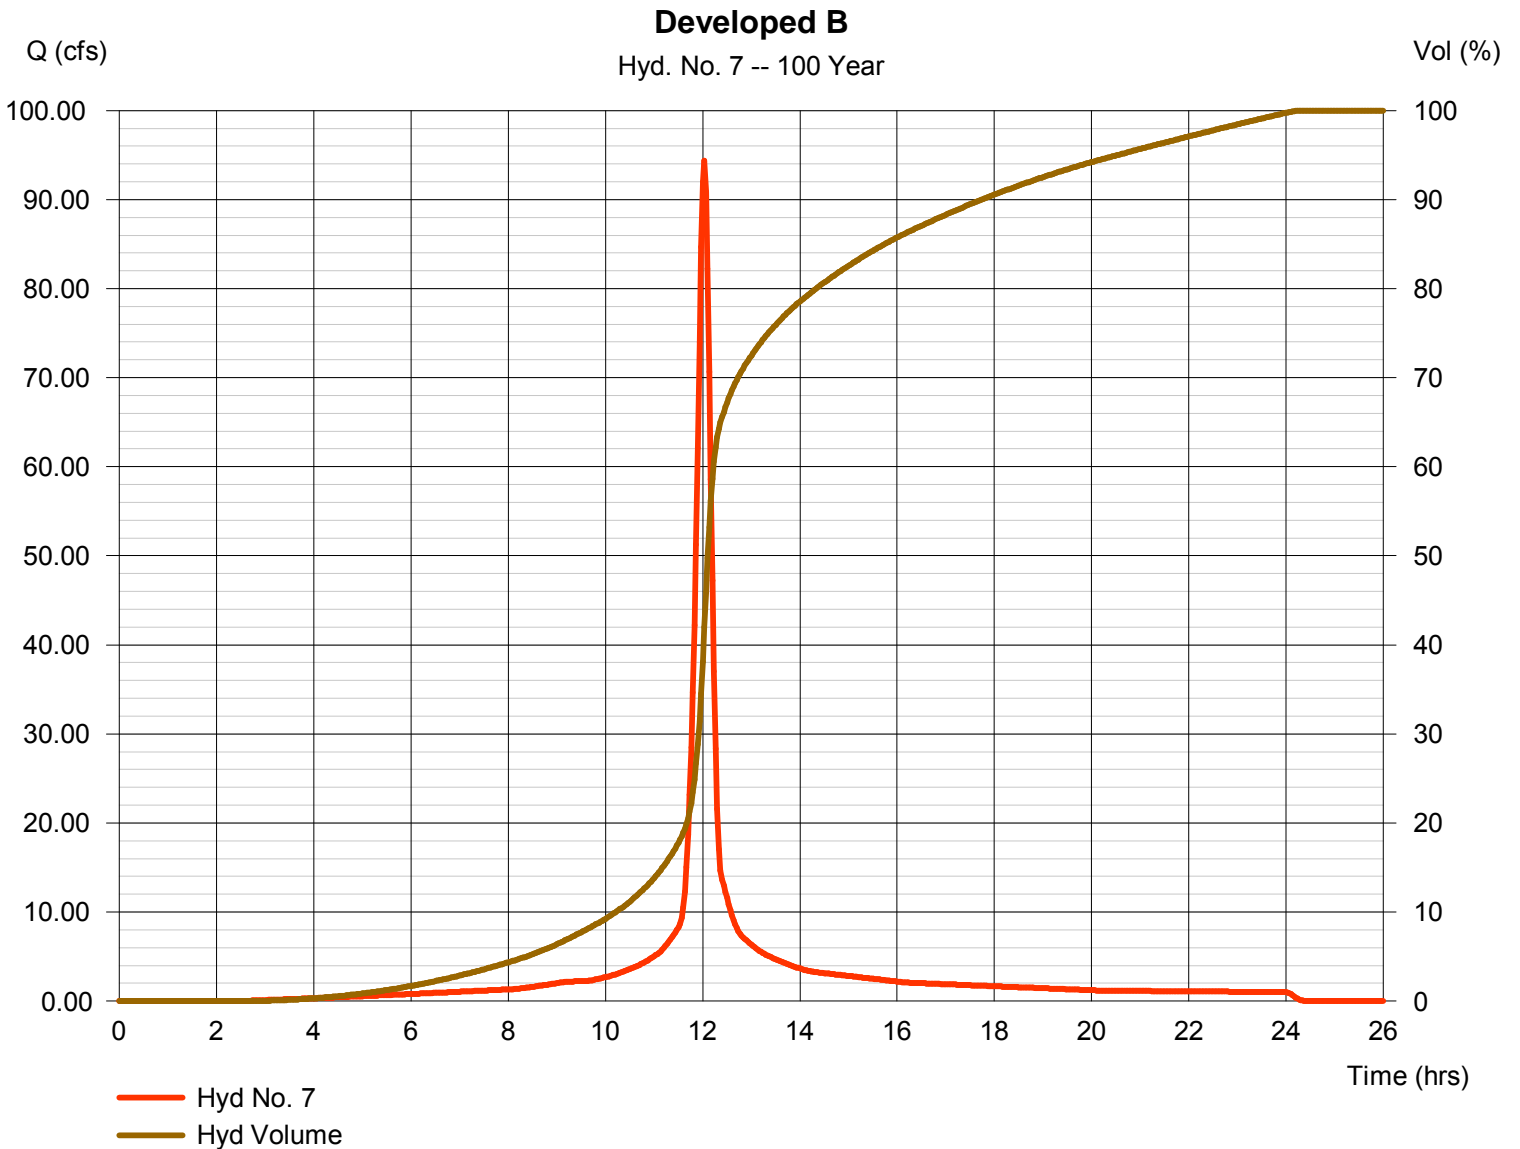

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8


Monday, Dec 19, 2011

Hyd. No. 8

South East Detention

Hydrograph type	= Reservoir	Peak discharge	= 8.217 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.70 hrs
Time interval	= 2 min	Hyd. volume	= 273,430 cuft
Inflow hyd. No.	= 7 - Developed B	Max. Elevation	= 1329.05 ft
Reservoir name	= South East Pond	Max. Storage	= 176,345 cuft

Storage Indication method used.

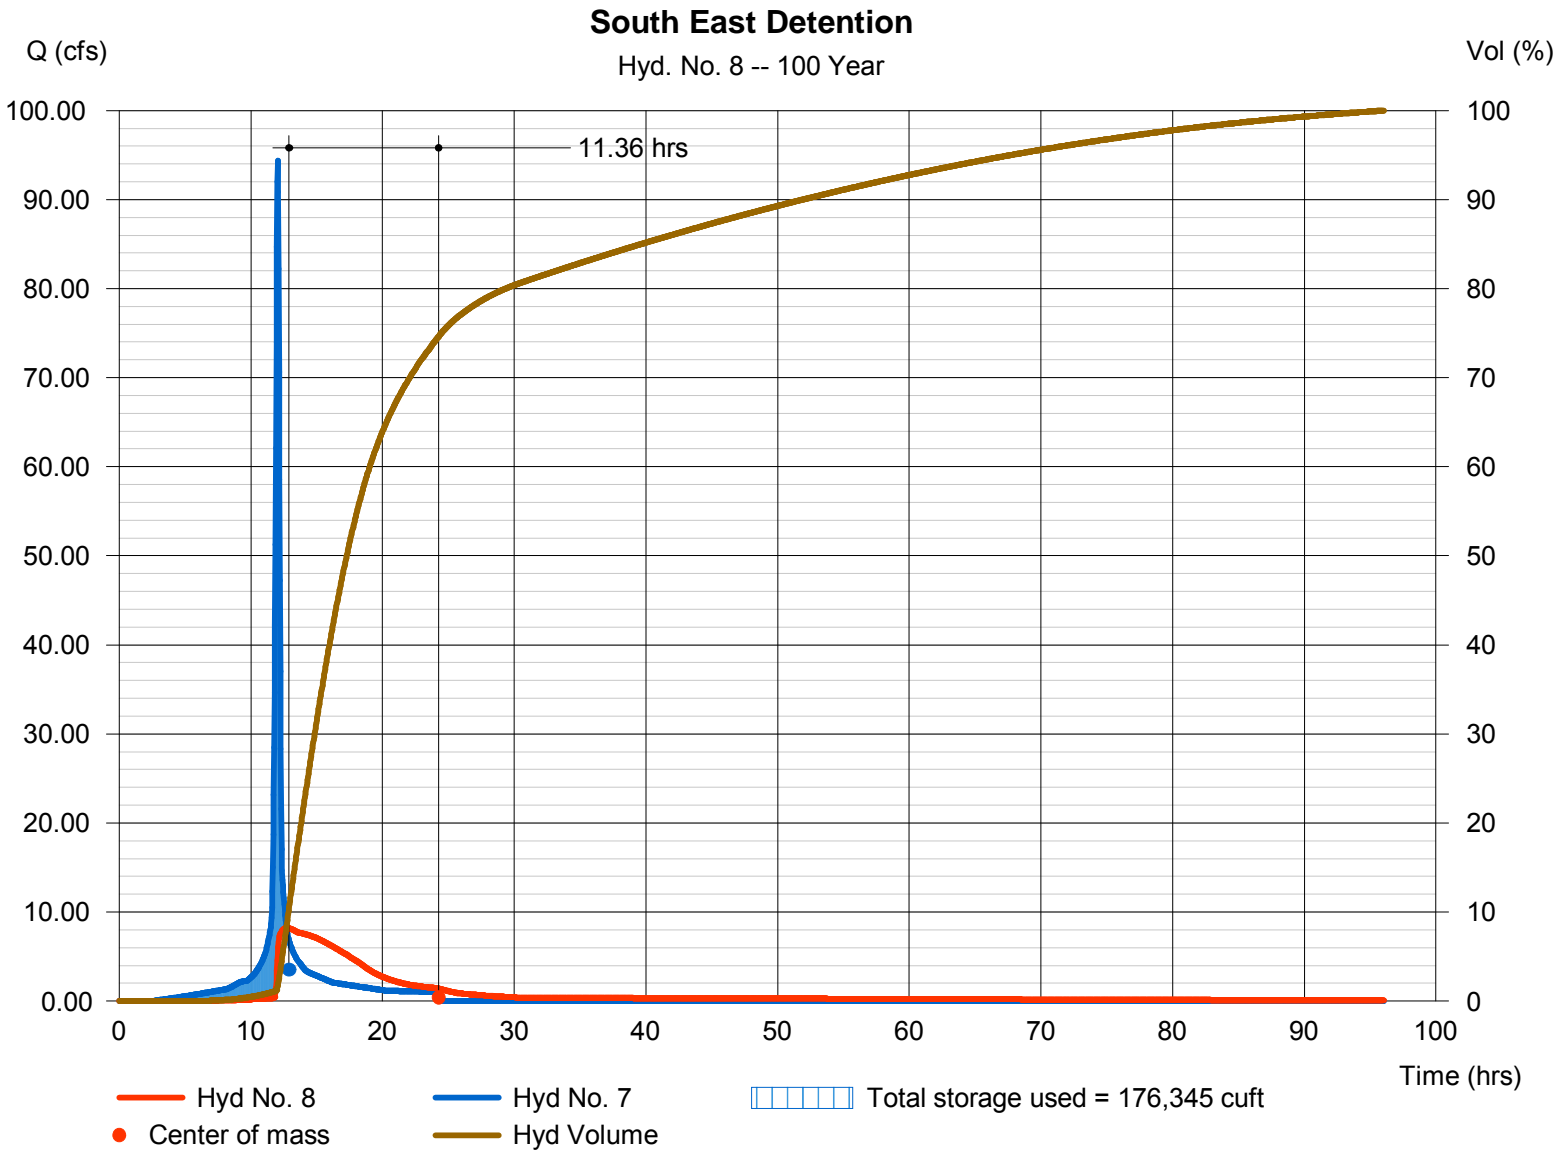


Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 9

Total			
Hydrograph type	= Combine	Peak discharge	= 100.86 cfs
Storm frequency	= 100 yrs	Time to peak	= 13.00 hrs
Time interval	= 2 min	Hyd. volume	= 1,650,604 cuft
Inflow hyds.	= 6, 8	Contrib. drain. area	= 0.000 ac

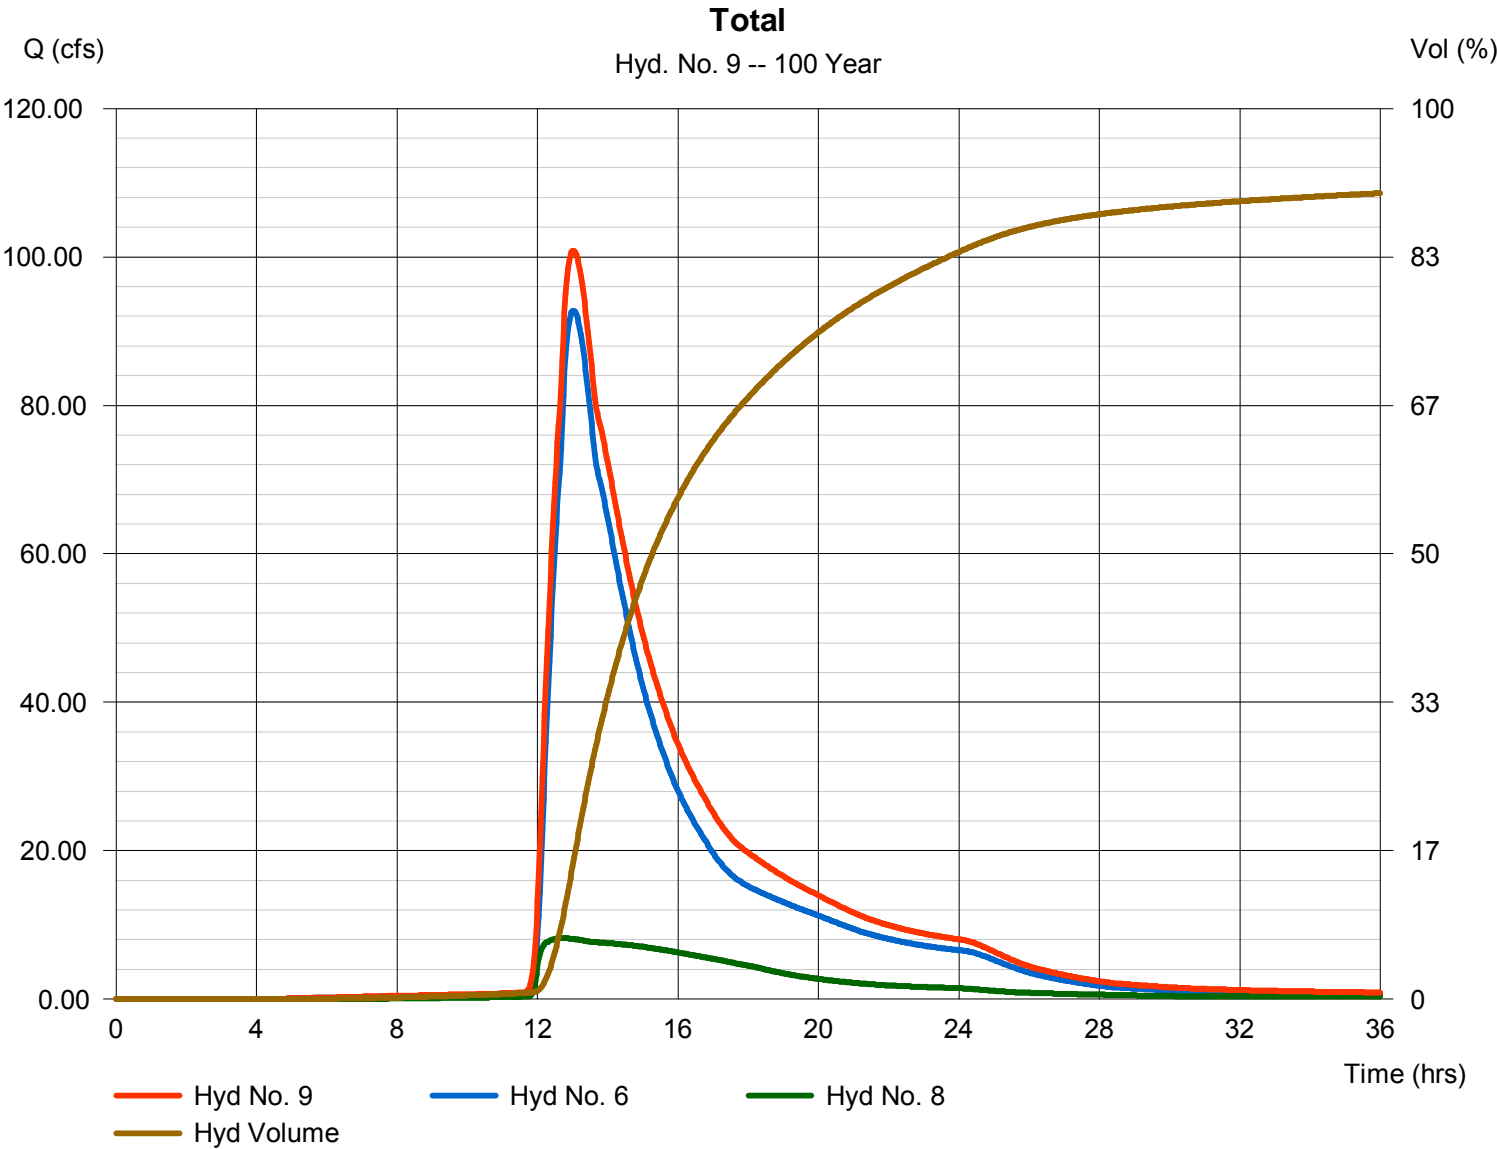

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Hyd. No. 10

Existing Total Site

Hydrograph type	= SCS Runoff	Peak discharge	= 101.89 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.97 hrs
Time interval	= 2 min	Hyd. volume	= 1,002,759 cuft
Drainage area	= 51.000 ac	Curve number	= 80
Basin Slope	= 0.4 %	Hydraulic length	= 2600 ft
Tc method	= LAG	Time of conc. (Tc)	= 108.12 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

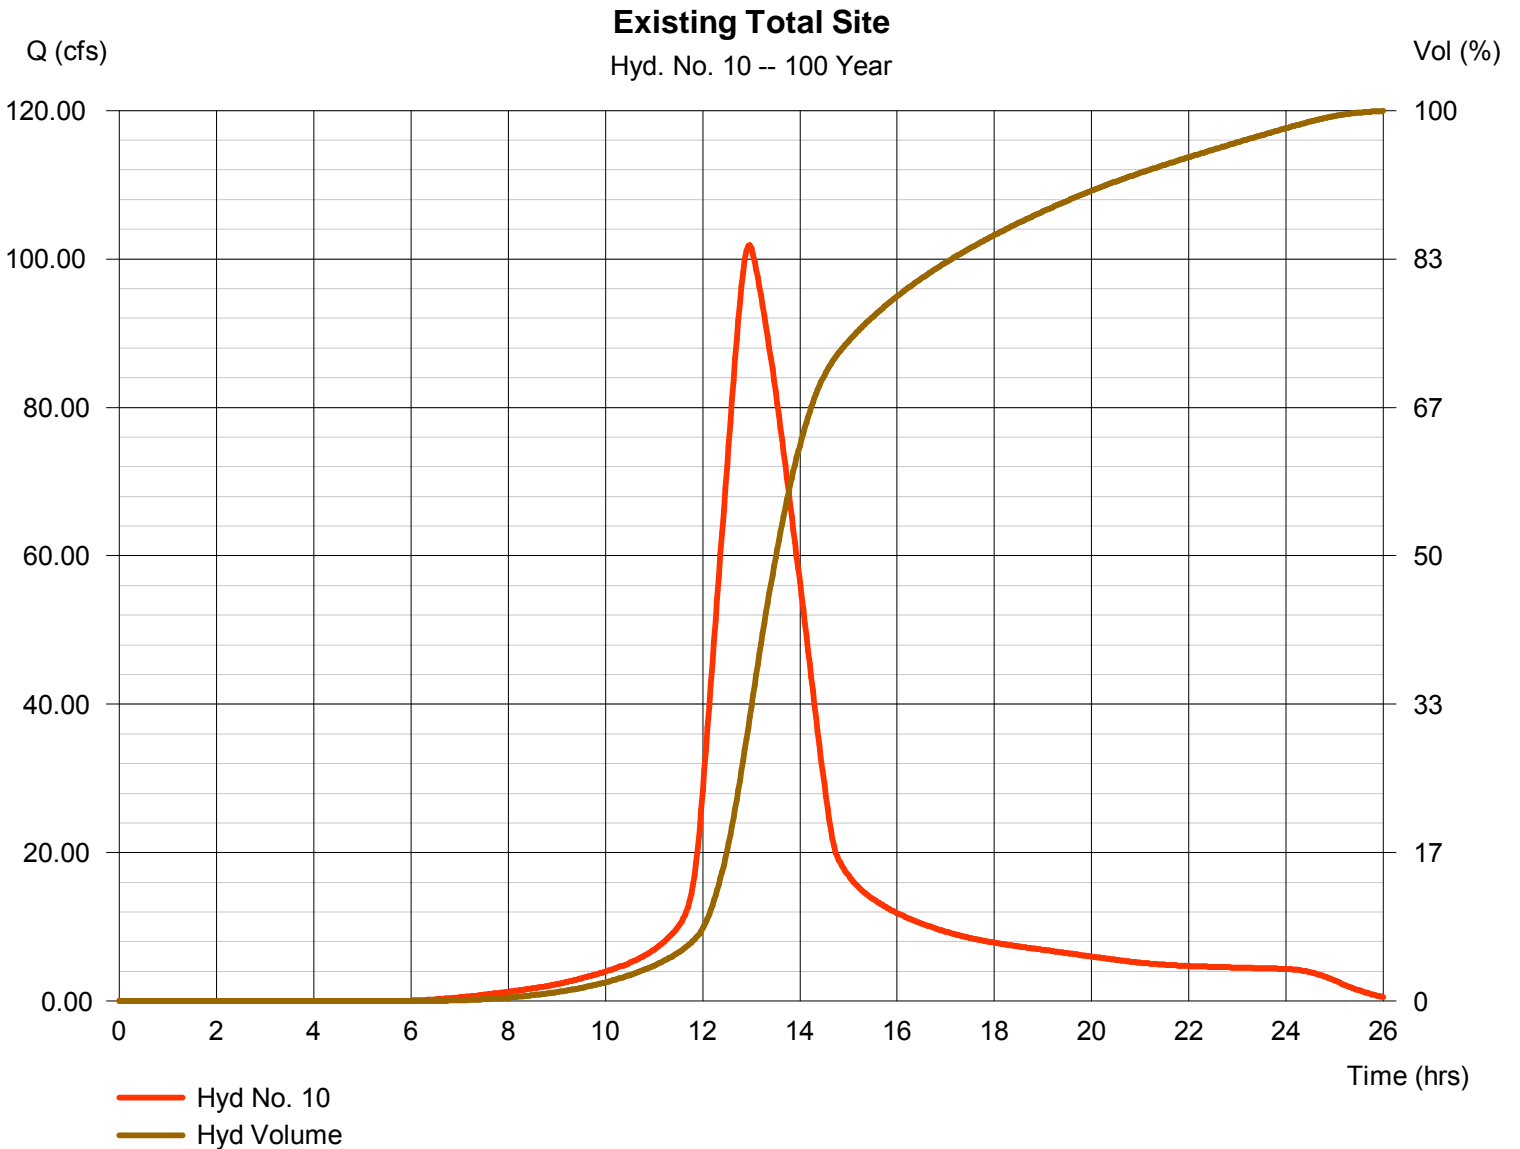

Hydraflow Rainfall Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2011 by Autodesk, Inc. v8

Monday, Dec 19, 2011

Return Period (Yrs)	Intensity-Duration-Frequency Equation Coefficients (FHA)			
	B	D	E	(N/A)
1	27.8967	9.8000	0.7047	-----
2	76.3137	14.3000	0.8844	-----
3	1.2000	0.1000	0.0000	-----
5	52.6224	11.2000	0.7497	-----
10	55.1841	11.1000	0.7229	-----
25	60.7012	11.1000	0.7068	-----
50	66.9222	11.3000	0.7004	-----
100	62.2794	10.1000	0.6624	-----

File name: wich_IDF.IDF

$$\text{Intensity} = B / (T_c + D)^E$$

Return Period (Yrs)	Intensity Values (in/hr)											
	5 min	10	15	20	25	30	35	40	45	50	55	60
1	4.18	3.40	2.90	2.55	2.29	2.08	1.91	1.78	1.66	1.56	1.48	1.40
2	5.57	4.54	3.85	3.35	2.97	2.67	2.43	2.23	2.06	1.92	1.80	1.69
3	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20
5	6.52	5.33	4.55	3.99	3.57	3.24	2.97	2.75	2.57	2.41	2.27	2.15
10	7.40	6.09	5.22	4.60	4.13	3.76	3.46	3.21	3.00	2.82	2.67	2.53
25	8.51	7.03	6.05	5.35	4.81	4.39	4.05	3.76	3.52	3.32	3.14	2.98
50	9.47	7.86	6.78	6.00	5.41	4.94	4.56	4.24	3.98	3.75	3.55	3.37
100	10.31	8.53	7.37	6.53	5.90	5.40	5.00	4.66	4.37	4.13	3.92	3.73

T_c = time in minutes. Values may exceed 60.

Precip. file name: wich_24hr.pcp

Storm Distribution	Rainfall Precipitation Table (in)							
	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr
SCS 24-hour	2.80	3.50	1.20	4.50	5.20	6.10	6.90	7.80
SCS 6-Hr	0.00	1.80	0.00	0.00	2.60	0.00	0.00	4.00
Huff-1st	0.00	1.55	0.00	2.75	4.00	5.38	6.50	8.00
Huff-2nd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-3rd	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-4th	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Huff-Indy	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Custom	0.00	1.75	0.00	2.80	3.90	5.25	6.00	7.10

Watershed Model Schematic	1
Hydrograph Return Period Recap	2
1 - Year	
Summary Report.....	3
Hydrograph Reports.....	4
Hydrograph No. 1, SCS Runoff, Offsite West.....	4
Hydrograph No. 2, Reservoir, Upper Pond.....	5
Pond Report - Upper Pond.....	6
Hydrograph No. 3, Reach, Channel Section.....	7
Hydrograph No. 4, SCS Runoff, Developed A.....	8
Hydrograph No. 5, Combine, Runoff to North Pond.....	9
Hydrograph No. 6, Reservoir, North East Detention.....	10
Pond Report - North East Pond.....	11
Hydrograph No. 7, SCS Runoff, Developed B.....	12
Hydrograph No. 8, Reservoir, South East Detention.....	13
Pond Report - South East Pond.....	14
Hydrograph No. 9, Combine, Total.....	15
Hydrograph No. 10, SCS Runoff, Existing Total Site.....	16
2 - Year	
Summary Report.....	17
Hydrograph Reports.....	18
Hydrograph No. 1, SCS Runoff, Offsite West.....	18
Hydrograph No. 2, Reservoir, Upper Pond.....	19
Hydrograph No. 3, Reach, Channel Section.....	20
Hydrograph No. 4, SCS Runoff, Developed A.....	21
Hydrograph No. 5, Combine, Runoff to North Pond.....	22
Hydrograph No. 6, Reservoir, North East Detention.....	23
Hydrograph No. 7, SCS Runoff, Developed B.....	24
Hydrograph No. 8, Reservoir, South East Detention.....	25
Hydrograph No. 9, Combine, Total.....	26
Hydrograph No. 10, SCS Runoff, Existing Total Site.....	27
3 - Year	
Summary Report.....	28
Hydrograph Reports.....	29
Hydrograph No. 1, SCS Runoff, Offsite West.....	29
Hydrograph No. 2, Reservoir, Upper Pond.....	30
Hydrograph No. 3, Reach, Channel Section.....	31
Hydrograph No. 4, SCS Runoff, Developed A.....	32
Hydrograph No. 5, Combine, Runoff to North Pond.....	33
Hydrograph No. 6, Reservoir, North East Detention.....	34
Hydrograph No. 7, SCS Runoff, Developed B.....	35
Hydrograph No. 8, Reservoir, South East Detention.....	36
Hydrograph No. 9, Combine, Total.....	37
Hydrograph No. 10, SCS Runoff, Existing Total Site.....	38

5 - Year

Summary Report..... 39
Hydrograph Reports..... 40
 Hydrograph No. 1, SCS Runoff, Offsite West..... 40
 Hydrograph No. 2, Reservoir, Upper Pond..... 41
 Hydrograph No. 3, Reach, Channel Section..... 42
 Hydrograph No. 4, SCS Runoff, Developed A..... 43
 Hydrograph No. 5, Combine, Runoff to North Pond..... 44
 Hydrograph No. 6, Reservoir, North East Detention..... 45
 Hydrograph No. 7, SCS Runoff, Developed B..... 46
 Hydrograph No. 8, Reservoir, South East Detention..... 47
 Hydrograph No. 9, Combine, Total..... 48
 Hydrograph No. 10, SCS Runoff, Existing Total Site..... 49

10 - Year

Summary Report..... 50
Hydrograph Reports..... 51
 Hydrograph No. 1, SCS Runoff, Offsite West..... 51
 Hydrograph No. 2, Reservoir, Upper Pond..... 52
 Hydrograph No. 3, Reach, Channel Section..... 53
 Hydrograph No. 4, SCS Runoff, Developed A..... 54
 Hydrograph No. 5, Combine, Runoff to North Pond..... 55
 Hydrograph No. 6, Reservoir, North East Detention..... 56
 Hydrograph No. 7, SCS Runoff, Developed B..... 57
 Hydrograph No. 8, Reservoir, South East Detention..... 58
 Hydrograph No. 9, Combine, Total..... 59
 Hydrograph No. 10, SCS Runoff, Existing Total Site..... 60

25 - Year

Summary Report..... 61
Hydrograph Reports..... 62
 Hydrograph No. 1, SCS Runoff, Offsite West..... 62
 Hydrograph No. 2, Reservoir, Upper Pond..... 63
 Hydrograph No. 3, Reach, Channel Section..... 64
 Hydrograph No. 4, SCS Runoff, Developed A..... 65
 Hydrograph No. 5, Combine, Runoff to North Pond..... 66
 Hydrograph No. 6, Reservoir, North East Detention..... 67
 Hydrograph No. 7, SCS Runoff, Developed B..... 68
 Hydrograph No. 8, Reservoir, South East Detention..... 69
 Hydrograph No. 9, Combine, Total..... 70
 Hydrograph No. 10, SCS Runoff, Existing Total Site..... 71

50 - Year

Summary Report..... 72
Hydrograph Reports..... 73
 Hydrograph No. 1, SCS Runoff, Offsite West..... 73
 Hydrograph No. 2, Reservoir, Upper Pond..... 74
 Hydrograph No. 3, Reach, Channel Section..... 75
 Hydrograph No. 4, SCS Runoff, Developed A..... 76

Hydrograph No. 5, Combine, Runoff to North Pond.....	77
Hydrograph No. 6, Reservoir, North East Detention.....	78
Hydrograph No. 7, SCS Runoff, Developed B.....	79
Hydrograph No. 8, Reservoir, South East Detention.....	80
Hydrograph No. 9, Combine, Total.....	81
Hydrograph No. 10, SCS Runoff, Existing Total Site.....	82

100 - Year

Summary Report.....	83
Hydrograph Reports.....	84
Hydrograph No. 1, SCS Runoff, Offsite West.....	84
Hydrograph No. 2, Reservoir, Upper Pond.....	85
Hydrograph No. 3, Reach, Channel Section.....	86
Hydrograph No. 4, SCS Runoff, Developed A.....	87
Hydrograph No. 5, Combine, Runoff to North Pond.....	88
Hydrograph No. 6, Reservoir, North East Detention.....	89
Hydrograph No. 7, SCS Runoff, Developed B.....	90
Hydrograph No. 8, Reservoir, South East Detention.....	91
Hydrograph No. 9, Combine, Total.....	92
Hydrograph No. 10, SCS Runoff, Existing Total Site.....	93

IDF Report.....	94
------------------------	-----------

HydraFlow Express
Channel Sections AA & BB

Channel Report

<Name>

Trapezoidal


Bottom Width (ft) = 5.00
Side Slopes (z:1) = 3.00, 3.00
Total Depth (ft) = 4.00
Invert Elev (ft) = 1326.00
Slope (%) = 0.30
N-Value = 0.020

Highlighted

Depth (ft) = 2.13
Q (cfs) = 118.81
Area (sqft) = 24.32
Velocity (ft/s) = 4.89
Wetted Perim (ft) = 18.49
Crit Depth, Yc (ft) = 1.58
Top Width (ft) = 17.80
EGL (ft) = 2.50

Calculations

Compute by: Q vs Depth
No. Increments = 15

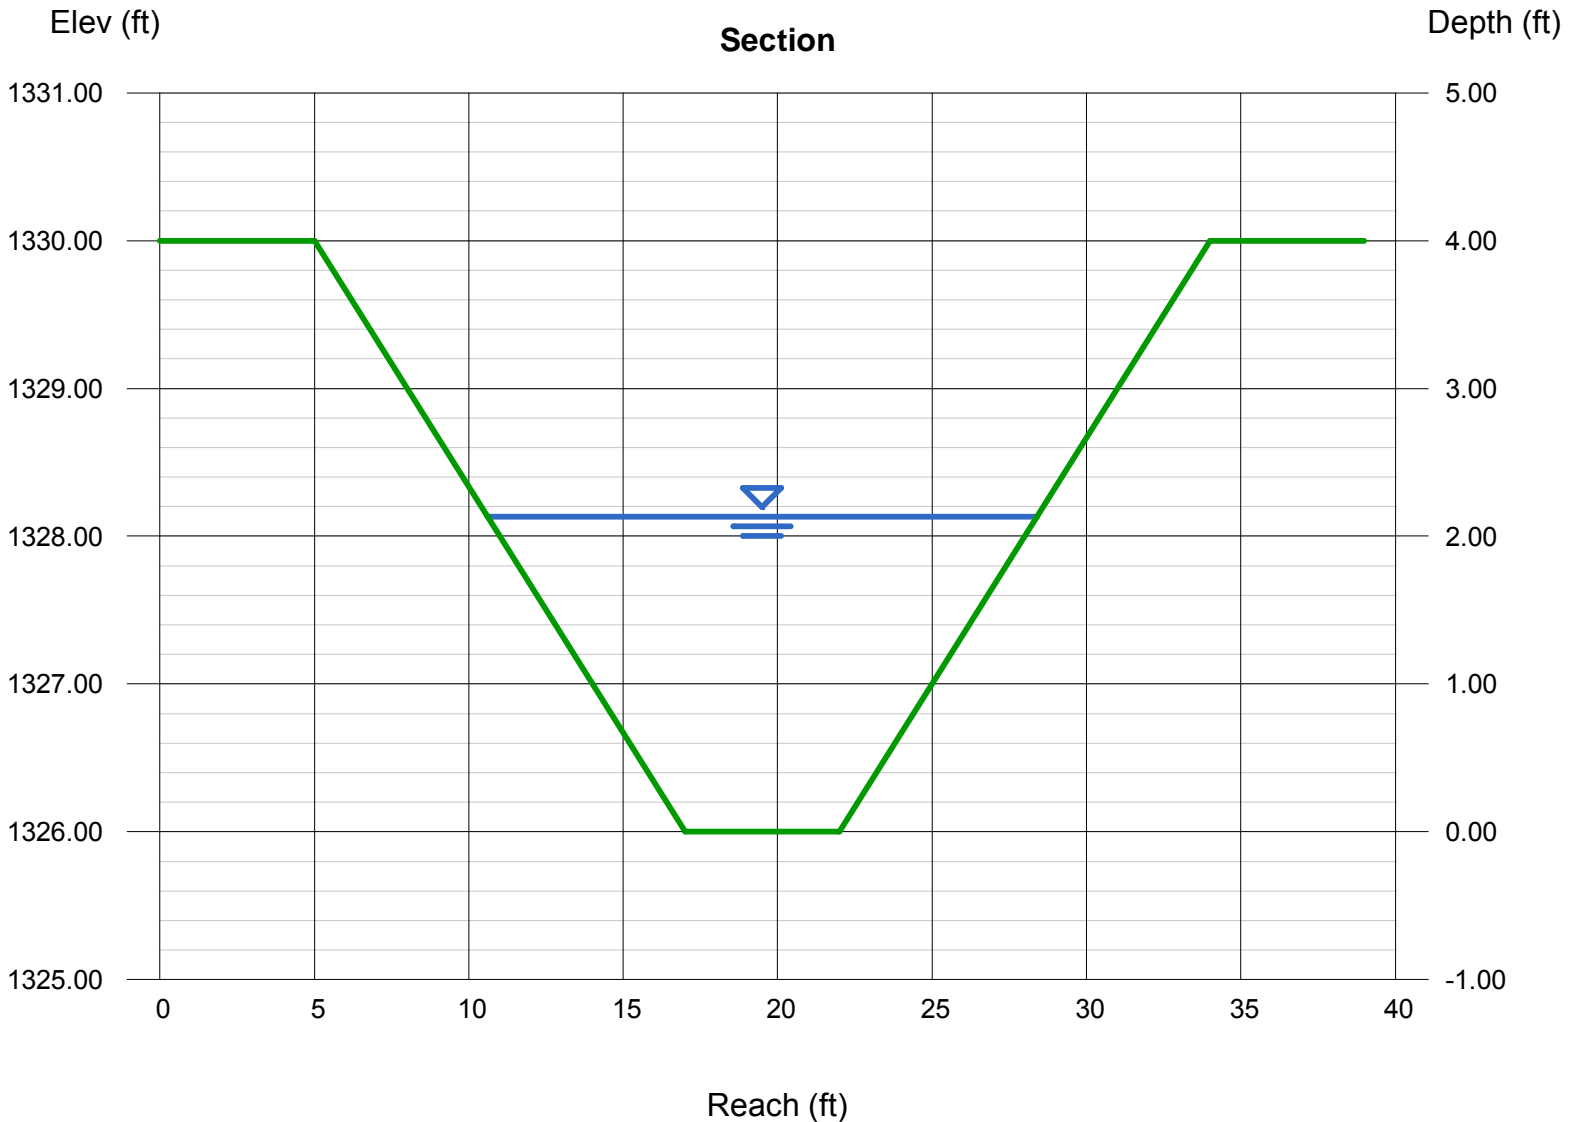

Channel Report

Channel BB

Trapezoidal


Bottom Width (ft) = 5.00
Side Slopes (z:1) = 3.00, 3.00
Total Depth (ft) = 4.00
Invert Elev (ft) = 1326.30
Slope (%) = 0.20
N-Value = 0.027

Highlighted

Depth (ft) = 4.00
Q (cfs) = 286.98
Area (sqft) = 68.00
Velocity (ft/s) = 4.22
Wetted Perim (ft) = 30.30
Crit Depth, Yc (ft) = 2.63
Top Width (ft) = 29.00
EGL (ft) = 4.28

Calculations

Compute by: Q vs Depth
No. Increments = 15

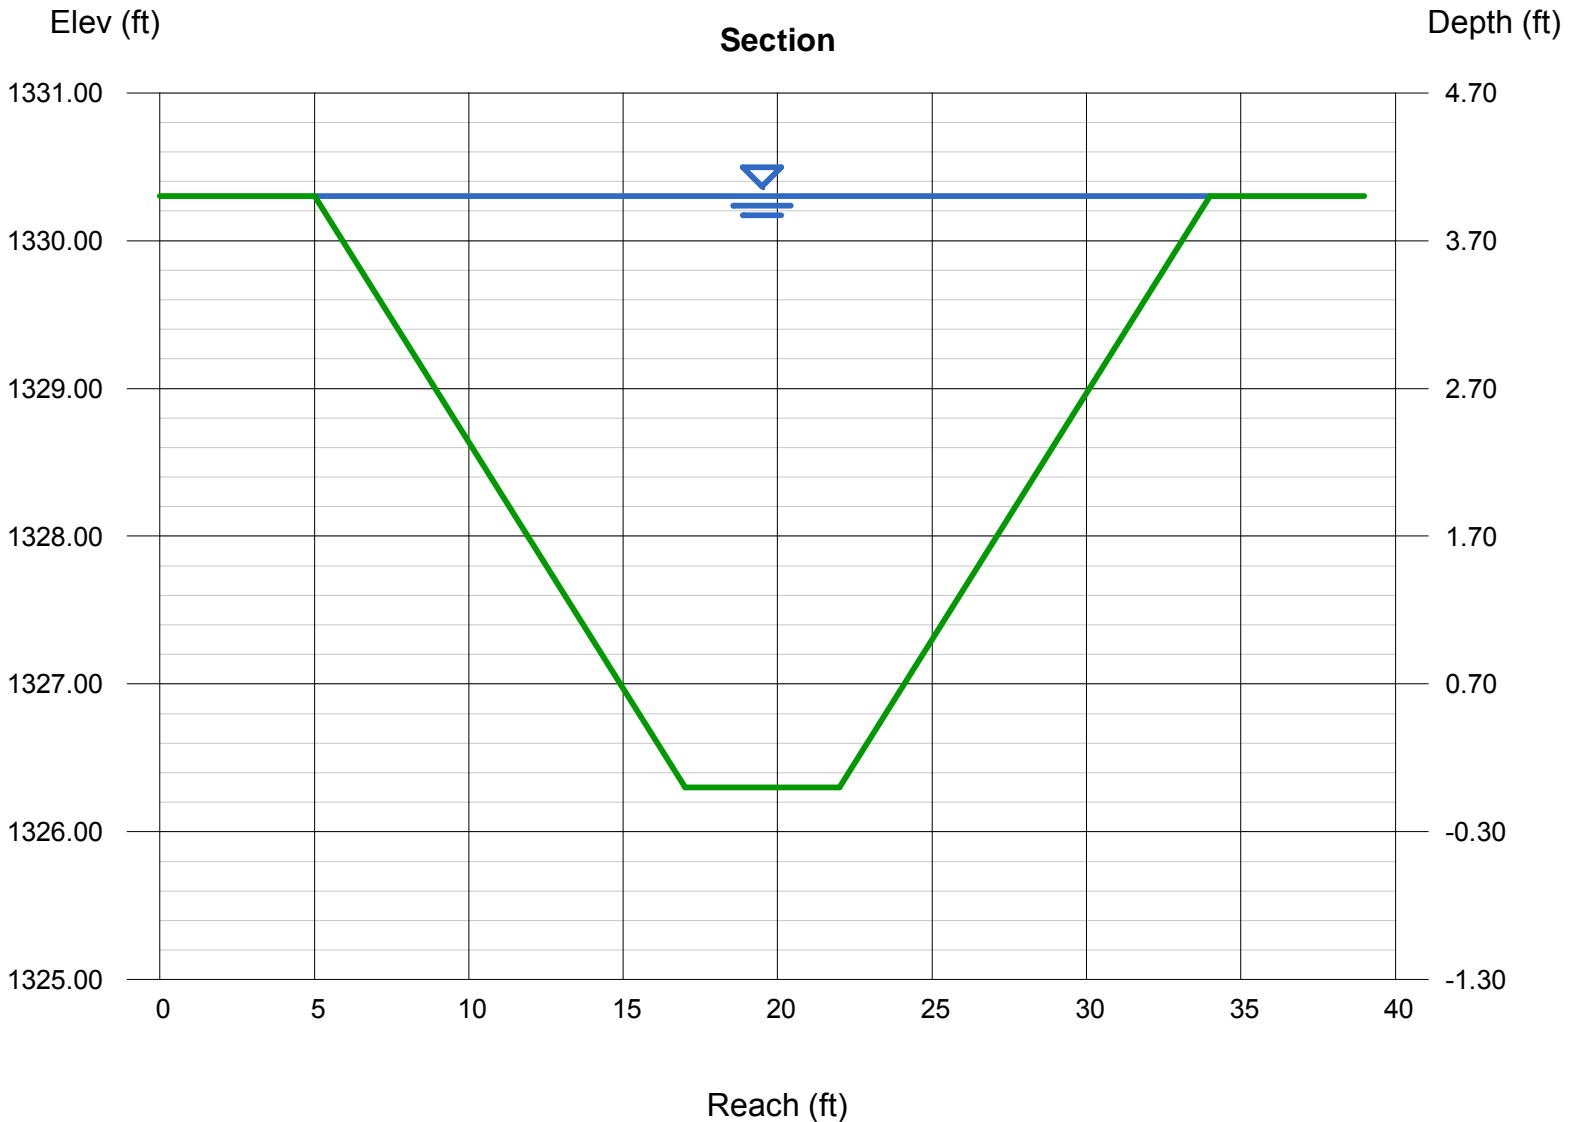

Drainage Plan
1:100 Scale