

SANITARY SEWER FORCE MAIN
to serve
PEGASUS ADDITION LIFT STATION
(LIFT STATION #71)
CITY OF WICHITA, KANSAS

Paul Gunzelman, P.E. City Engineer
Project Number: 468-2024-011711
Org Code number: 53200124
Munis Number: S4004

Engineer: Ever Villalobos
Contractor: Mies Construction, Inc.
Inspector: Garver
Release Date: 09-25-2026

6144D
Basin: F-SE-02

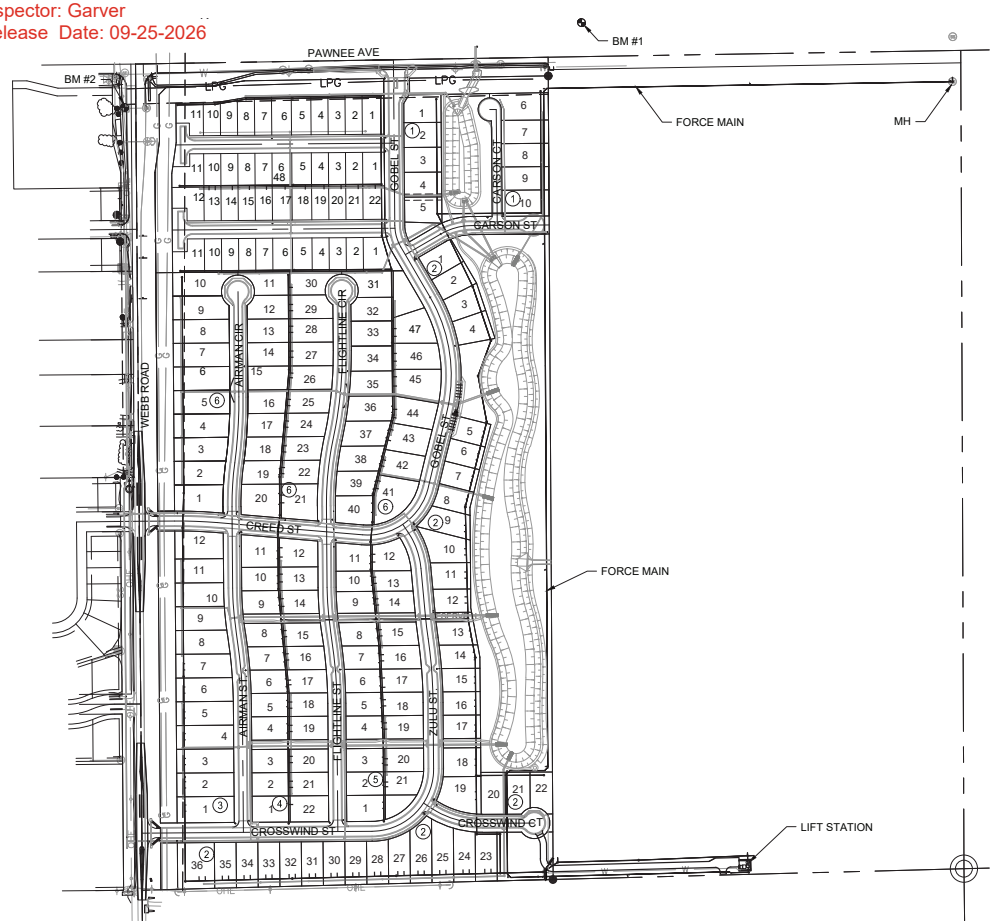

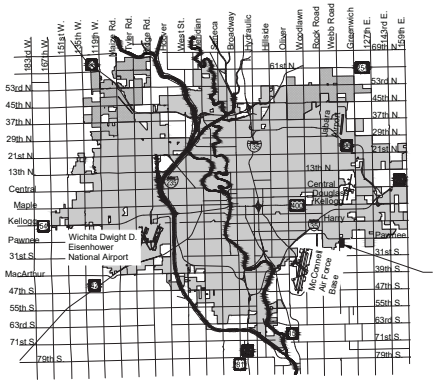


Vicinity Map

Sheet List Table

Sheet Number	Sheet Title
1	COVERSHEET
2	GENERAL NOTES Revised
2A	SEEDING & TESTING NOTES Sheet Added
3	PRE-CAST SS MH
4	MH FRAME & COVER
5	TRACER WIRE & WARNING SIGN DETAILS
6	STANDARD DRIVE ENTRANCE DETAILS Added Sheet 6A "Misc. Water Details"
7	SOIL BORING
8	SS GRAVITY LINE Revised
9	FORCE MAIN (1 OF 5)
10	FORCE MAIN (2 OF 5)
11	FORCE MAIN (3 OF 5)
12	FORCE MAIN (4 OF 5)
13	FORCE MAIN (5 OF 5)
14	FORCE MAIN COORDINATES
15	EROSION CONTROL PLAN Added Sheet 15A "Reinforced Concrete Details"
16	LIFT STATION ROAD (1 of 2)
17	LIFT STATION ROAD (2 of 2)
18	OVERALL SITE PLAN
19	LIFT STATION PLAN
20	SITE PLAN
21	PLAN DETAIL AND SECTION
22	DETAILS I
23	DETAILS II
24	DETAILS III
25	DETAILS IV
26	PROCESS & INST. DIAGRAM NOTES, LEGEND, ABBREV.
27	LIFT STATION P&ID
28	ELECTRICAL SYMBOLS LEGEND
29	ELECTRICAL NOTES AND ABBREVIATIONS
30	ONELINE DIAGRAM AND PANEL ELEVATION DRAWING
31	LIFT STATION ELECTRICAL SITE PLAN
32	LIFT STATION UTILITY SHELTER ELECTRICAL PLAN
33	WETWELL ELEVATION DIAGRAM AND MPZ01 PANEL SCHEDULE
34	ELECTRICAL DETAILS I
35	ELECTRICAL DETAILS II
36	ELECTRICAL DETAILS III
37	ELECTRICAL DETAILS IV
38	PLAT SS LIFT





0 100' 200' 400' 600'
(IN FEET)

Benchmarks

BENCHMARK #1:
CHISELED SQUARE WITH DIVOT ON NW CORNER OF STORM INLET ON WEST SIDE OF WEBB ROAD
ELEVATION = 1391.76 (NAVD88, G18)

BENCHMARK #2:
CHISELED SQUARE WITH DIVOT ON NORTH CURB OF ENTRANCE ISLAND TO BRENTWOOD SOUTH ADDITION
ELEVATION = 1390.37 (NAVD88, G18)

NOTE: All coordinates listed are modified NAD83 Kansas State Plane Zone South unless otherwise noted. To convert listed coordinates to NAD83 Kansas State Plane Zone South coordinates multiply the northing and easting by the project scale factor of 0.99990477. Elevation datum is NAVD88 Geoid 12B unless otherwise noted.

MAY 2025

PLANS PREPARED BY

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008
www.GarverUSA.com
Project No. 2400521

GENERAL NOTES:

1. The Contractor shall comply with all applicable safety regulations. All construction shall be completed following current City Standard Specifications and Special Provisions.

2. Contractor will be required to provide notice to utility companies a minimum of seventy-two (72) hours prior to any excavation, as follows:

   Kansas One-Call 687-2470

   The Contractor must notify the following in case of an emergency:

AT&T	1-800-246-8464
Black Hills Energy	1-800-694-8989
City of Wichita Water & Sewer Dept.	1-316-219-8921
City of Wichita Stormwater	1-316-268-4090
City of Wichita Traffic	1-316-268-4034
Conoco Pipe Line Co.	1-877-267-2290
Cox Communications	1-888-249-3530
Evergy	1-800-544-4857
Kansas Gas Service (ONEOK)	1-888-482-4950
Sedgwick County Electric Cooperative	1-866-542-4732
Southern Star Central Gas	1-800-324-9696

3. Utility service lines, poles, etc. are to be adjusted as necessary by others prior to construction unless the plans specifically call for their adjustment by the Contractor or unless the plans specifically identify a utility to be adjusted by its owner during construction. Existing utilities and their location, as shown on the plans, represent the best information obtainable for design. The Contractor will be required to work around existing utilities within the right-of-way which do not conflict with proposed construction.

4. Rubble from the removal of miscellaneous structures and excess excavation which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations, in the opinion of the Engineer, that will leave an unsightly appearance will not be approved. All disposal sites must be approved by the Kansas Department of Health and Environment. Material either stockpiled or disposed of in a flood plain will require a Kansas State Board of Agriculture permit. Any material dumped in waters of the United States or wetlands is subject to U.S. Corps. of Engineers permitting regulations. Any material buried or stockpiled beyond approved construction limits will require additional archaeological investigations unless buried in a previously approved borrow location.

5. Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in direct conflict with proposed new construction shall be saved and protected from damage.

6. The Contractor shall give all property owners and/or tenants of developed property abutting the construction of this project a minimum of ten (10) days notice prior to start of construction.

7. The Contractor shall be responsible for preserving property irons. The Contractor will be required to re-establish any property irons which are damaged or destroyed by his construction operations. Such irons shall be re-established by a licensed land surveyor in accordance with state laws.

8. If traffic will be impacted by construction, a traffic control plan must be submitted and approved by the City Traffic Engineer, at traffic@wichita.gov before construction can begin. The Contractor shall be responsible for all traffic control measures to facilitate construction. All construction zone markings and signage shall conform to the latest version of the Manual on Uniform Traffic Control Devices (MUTCD) as published by the US Dept. of Transportation, Federal Highway Administration. All costs associated with construction markings and signage shall be the Contractors responsibly.

10. All elevations shown are NAVD 88, G12A.

11. All areas disturbed during construction that will not be under proposed pavement shall be restored to match existing conditions.

12. The Contractor shall protect from damage and support existing utilities through constructions as approved by the utility owner and the Engineer at the contractors expense.

13. Contractor shall limit the extent of trench openings overnight and weekends to less than 50 feet.

14. Any sidewalk, drive approach, curb, or street pavement removed to construct project must have a pavement cut permit and be replaced by the City contractor. Permits can be obtained by calling 316-268-4501 or 316-268-4480.

15. All stubs and plugged pipes shall be located with green plastic tape in the same manner as risers.

16. Connecting to Existing Manholes:

    Prior to laying sewer lines using existing stubs in existing manholes, the Contractor shall expose and verify the elevation, grade and alignment of existing stubs and notify the Engineer of any deviation from the plans. Where connection to an existing manhole that does not have an existing stub or the stub is unusable due to elevation grade or alignment, the Contractor shall bore cut into existing manhole wall to make connection using approved water stop gasket, and reshape the existing manhole invert to provide smooth flow. The cost to connecting to existing manholes is incidental to the project.

17. Contractor shall provide positive drainage away from all manhole covers when adjacent grade allows.

18. The Contractor shall prevent any construction debris from entering the existing sanitary sewer during construction.

19. The Contractor shall be responsible for maintaining continuous flow of sewage through construction. Contractors proposed method for maintaining sewage flow shall be submitted and approved by the Sewer Maintenance Division (316-268-4073) prior to starting and by-passing of sewage flows.

20. No shrink or swell factors have been applied to the earthwork quantities shown on this project. All earthwork quantities are based on raw surface volume comparisons.

21. Excess dirt generated from installation of underground sanitary sewer due to flowable fill and sand backfill is to remain on site and coordinated with companion SWD Project.

22. All disturbed areas on this project shall be seeded with temporary seeding per City of Wichita Specifications.

23. Due to the depths of some of the SS lines on this project, areas that require flowable fill at depths greater than 15' shall be placed in two separate lifts and allowed to cure overnight between lifts.

24. Tree Trimming shall be done using equipment specifically designed for the task. Equipment Buckets and other devices shall not be used to trim trees. Cost of tree trimming and removal shall be subsidiary to the bid item "Site Clearing". Brush, limbs, and other debris generated by tree trimming and tree removal shall be disposed of at an off-site location selected by the Contractor.


25. Developer:

    Bryon Lagaly (316) 295-7782 bryanlagaly@gmail.com

    Kirk Richards (316) 390-2219
    kirk@k2propertieswichita.com

26. Lift Station Address:


    1009 E CROSSWIND CT
    WICHITA, KS 67207

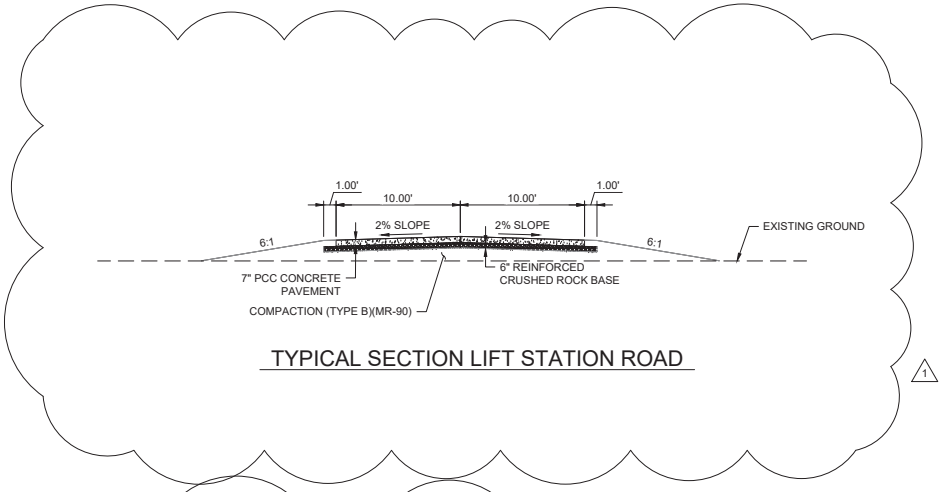

TYPICAL SECTION LIFT STATION ROAD

1

CONTRACTOR SHALL INSTALL (2) 3M DBI SALA REMOVABLE CONCRETE DETENT ANCHORS 310 LBS.WEIGHT CAPACITY INSTALLED PER MANUFACTURER INSTRUCTIONS (TYP. 2)



ANCHOR SOCKET DETAIL
SCALE: NONE

1

3M SALA Fall Protection


ANSI Z359.18 Type A | OSHA 1926.502 OSHA 1910.140

CONCRETE BOLT
Anchorage Connector


USER INSTRUCTIONS
5902288 Rev. E

1

			ANSI	OSHA	A	B	C	D
2104560	x1	x1	✓	✓	4.44 in. (11.28 cm)	1.09 in. (2.77 cm)	3.02 in. (7.67 cm)	5.83 in. (14.81 cm)
2104568	x1	x1		✓	4.44 in. (11.28 cm)	1.09 in. (2.77 cm)	3.02 in. (7.67 cm)	5.83 in. (14.81 cm)
2100041	x0	x1			4.44 in. (11.28 cm)	---	---	---
2100066	x0	x10			4.44 in. (11.28 cm)	---	---	---

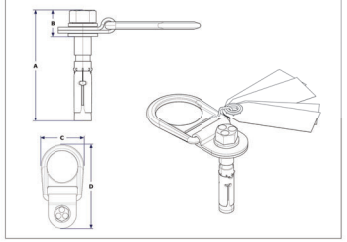

© 3M 2020

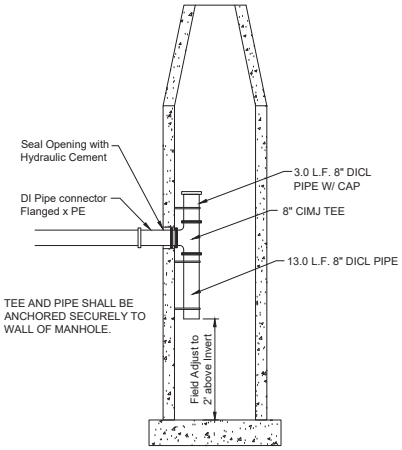

FORCE MAIN CONNECTION DETAIL

NOTE: Interior of manhole to be coated with Zebron or other approved liner. Coating and all other parts and labor installing shall be considered incidental to the bid item for "Connection to Existing MH".

Field adjust connection to manhole below the top of cone section of manhole.

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION	BY
1	5/8/2025	TYPICAL SECTION THICKNESS CHANGED FROM 5" TO 6".	DRS
1	5/8/2025	ADDED 3M BOLT ANCHOR DETAILS	DRS

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

GENERAL NOTES

JOB NO.: 2400521
DATE: MAY 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER

SHEET NUMBER 2 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\Titlesheet and Details.dwg Last Save: 5/8/2025 5:02 PM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R. Plot Style: -- Plot Scale: 1.2465 Plot Date: 5/8/2025 5:02 PM Plotter Used: None

GENERAL SEED NOTES FOR ALL MIXES

1. THE CONTRACTOR SHALL PROVIDE GRASS SEED OF THE VARIETY AND AT THE RATES AS REQUIRED TO PRODUCE THE LIVE SEED RATES SHOWN BELOW OR AS SPECIFIED ON THE PLANS. THE VENDOR'S CERTIFIED STATEMENT FOR EACH SPECIES OF GRASS AND GRASS MIXTURE STATING EACH VARIETY, PERCENTAGE BY WEIGHT, AND PERCENTAGES OF PURITY, GERMINATION, AND WEED SEED SHALL BE FURNISHED. LIVE SEED FOR EACH GRASS SPECIES IS THE PRODUCT OF THE PERCENTAGE OF PURITY AND THE PERCENTAGE OF GERMINATION.

1.1. THE SEED SHALL BE NEW-CROP SEED COMPLYING WITH AND LABELED IN ACCORDANCE WITH U.S. DEPARTMENT OF AGRICULTURE "RULES AND REGULATIONS UNDER THE FEDERAL SEED ACT" IN EFFECT AT DATE OF PURCHASE OF SEED. ALL SEED SHALL BE FURNISHED IN STANDARD CONTAINERS. SEED WHICH HAS BECOME MOLDY, WET, OR OTHERWISE DAMAGED IN TRANSIT OR STORAGE SHALL NOT BE ACCEPTED.

1.2. A CERTIFICATE SHALL BE FURNISHED TO THE ENGINEER SHOWING THE DATE THAT THE SEED WAS TREATED. THE TREATED SEED SHALL BE PLANTED WITHIN TWENTY-FOUR (24) MONTHS AFTER TREATMENT AND ANY TREATED BUFFALO GRASS SEED HELD BY THE CONTRACTOR OR SUPPLIED BEYOND THIS PERIOD SHALL NOT BE USED.

1.3. THE SEED SHALL BE STORED IN A COOL DRY PLACE UNTIL SEEDING TIME.

2. FERTILIZER.

2.1. FERTILIZER SHALL BE PROPORTIONED AS SPECIFIED ON THE PLANS OR SHOWN BELOW AND SHALL BE OF COMMERCIAL GRADE, UNIFORM IN COMPOSITION, FREE-FLOWING AND SUITABLE FOR APPLICATION WITH APPROVED EQUIPMENT, DELIVERED TO THE SITE IN BAGS OR OTHER CONVENIENT CONTAINERS, EACH FULLY LABELED, CONFORMING TO THE APPLICABLE STATE FERTILIZER LAWS, AND BEARING THE SAME TRADE NAME OR TRADE MARK, ANALYSIS AND WARRANTY OF THE PRODUCER. FERTILIZER SHALL BE APPLIED AT THE RATE OF .5 POUNDS OF ACTUAL NITROGEN, 1.0 POUNDS OF ACTUAL PHOSPHORUS, AND .5 POUNDS OF ACTUAL POTASSIUM PER 1,000 SQUARE FEET.

2.2. WHEN APPLYING FERTILIZER, THE CONTRACTOR SHALL AVOID APPLICATION PRIOR TO HEAVY RAIN OR INTENSE STORMS.

3. WATER.

3.1. WATER SHALL NOT CONTAIN SUBSTANCES IN THE AMOUNTS CONSIDERED HARMFUL FOR THE NORMAL GROWTH OF VEGETATION. THE CONTRACTOR SHALL SUPPLY WATER AND WATERING EQUIPMENT AS REQUIRED FOR THE ESTABLISHMENT AND MAINTENANCE OF GRASSED AREAS.

4. SITE PREPARATION

4.1. PROJECT COORDINATION. AFTER THE CONSTRUCTION HAS BEEN COMPLETED, (EXCEPT AS PROVIDED BELOW), THE SITE HAS BEEN BROUGHT TO FINAL GRADES AS SHOWN ON THE PLANS, AND OTHER PLANTINGS HAVE BEEN ACCOMPLISHED, THE CONTRACTOR SHALL PREPARE THE AREAS TO BE GRASSED AS SPECIFIED. WHEN SO DIRECTED OR PERMITTED BY THE ENGINEER, PORTIONS OF THE CONSTRUCTION SITE MAY BE GRASSED AT DIFFERENT PERIODS OF TIME PROVIDED THAT THE PLANTING OCCURS IN PROPER SEASONS AS SPECIFIED. ANY GRASSED AREAS DAMAGED BY SUBSEQUENT OPERATIONS OF THE CONTRACTOR SHALL BE REPLANTED AS DIRECTED BY THE ENGINEER AT NO ADDITIONAL COST TO THE OWNER.

4.2. NO-TILL. IT IS PREFERRED FOR THE AREAS OUTSIDE OF THE GRADING LIMITS TO BE NO-TILLED INTO THE EXISTING STUBBLE. NO SITE PREPARATION IS REQUIRED BEFORE NO-TILL SEEDING. AREAS TO BE TILLED (WITHIN GRADING LIMITS) SHALL BE PREPARED PER THE FOLLOWING NOTES.

4.3. TILLAGE. THE AREAS REQUIRED TO BE GRASSED SHALL BE PREPARED FOR PLANTING BY CULTIVATION, REMOVAL OF ALL OBJECTIONABLE MATERIAL, AND FILLING OF GULLIES OR DEPRESSIONS. THE SOIL PREPARATION SHALL BE ACCOMPLISHED BY DISKING, HARROWING AND FIRMING. (PLOWING WILL ALSO BE REQUIRED IF SO INDICATED ON THE PLANS.) THE MINIMUM DEPTH OF SOIL PREPARATION SHALL BE THREE (3) INCHES. EXISTING WEED STUBBLE, SMALL WEEDS AND GRASS THAT CAN BE DISKED SHALL BE CUT BY THE DISK AND PARTIALLY INCORPORATED INTO THE SOIL.

4.4. SEVERAL DISKINGS AND HARROWINGS OVER SOME AREAS MAY BE REQUIRED TO PROVIDE A SATISFACTORY SEEDBED. AREAS TOO STEEP OR OTHERWISE INACCESSIBLE FOR DISKING SHALL BE PREPARED BY HAND METHODS. THE MINIMUM DEPTH OF PREPARATION OF THE SEEDBED WHERE HAND METHODS MUST BE EMPLOYED SHALL BE TWO (2) INCHES. DISKING, HARROWING AND RAKING SHALL BE DONE LONGITUDINALLY ON SLOPE AREAS.

4.5. THE SOIL PREPARATION ON ALL SLOPE AREAS SHALL BE PERFORMED WITH DISKS AND HARROWS UNLESS DEMONSTRATION SHOWS SUCH METHODS IMPRACTICABLE AND THAT HAND METHODS MUST BE USED.

4.6. DURING THE PROCESS OF SOIL PREPARATION, EXTREME CARE SHALL BE EXERCISED TO AVOID INJURY TO ALL TREES THAT HAVE BEEN PLANTED OR DESIGNATED BY THE ENGINEER TO BE SAVED.

4.7. THE ENGINEER MAY DESIGNATE LOCAL AREAS OF DESIRABLE NATIVE PERENNIAL GRASSES TO BE OMITTED DURING THE SOIL PREPARATION. AREAS OF ANNUAL GRASSES SUCH AS CHEAT, CRAB GRASS, TRIPLE-AWN, ETC., SHALL BE DESTROYED BY THOROUGH DISKING PRIOR TO SEEDING.

4.8. APPLICATION OF FERTILIZER. FERTILIZER SHALL BE DISTRIBUTED UNIFORMLY AT RATES SHOWN IN THE SEED MIX NOTES ON THIS PAGE AND OVER THE AREA TO BE PLANTED, AND SHALL BE INCORPORATED INTO THE SOIL TO A DEPTH OF AT LEAST 2 INCHES BY DISKING, HARROWING OR OTHER METHODS APPROVED BY THE ENGINEER. DISTRIBUTION BY MEANS OF AN APPROVED SEED DRILL OR HYDRO SEEDER EQUIPPED TO SOW SEED AND DISTRIBUTE FERTILIZER AT THE SAME TIME WILL BE ACCEPTABLE UNLESS OTHERWISE NOTED ON THE PLANS.

4.9. ADDITIONAL SOIL CONDITIONERS SHALL BE MIXED INTO THE SOIL BY DISKING, HARROWING, ETC., WHEN SPECIFIED ON THE PLANS, OR AS DIRECTED BY THE ENGINEER AND FURNISHED BY THE OWNER.

5. SEEDING

5.1. TIME OF SEEDING. THE TWO GENERAL SEEDING SEASONS SHALL BE AS DEFINED FOR TEMPORARY AND PERMANENT SEEDING. THE PERMISSIBLE SEEDING PERIODS FOR VARIOUS SEEDS MAY BE EXTENDED A FEW DAYS IN SPECIAL CASES WHEN MULCHING IS SPECIFIED TO FOLLOW THE DRILLING OF SEEDS AND FERTILIZER.

5.2. THE ENGINEER RESERVES THE RIGHT TO DELAY THE DRILLING OR SEEDING OF ANY SEEDS OR TO VARY THE PERMISSIBLE SEEDING SEASONS LISTED ABOVE DUE TO WEATHER OR SOIL CONDITIONS OR FOR OTHER CAUSES.

5.3. SEED APPLICATION. SEEDS SHALL BE UNIFORMLY DISTRIBUTED WITH ACCEPTABLE DRILLS, HYDRAULIC SLURRY, OR OTHER EQUIPMENT APPROVED BY THE ENGINEER. BROADCASTING WITH A STANDARD GRASS SEEDER WILL BE REQUIRED ON AREAS WHERE IT IS IMPOSSIBLE TO OPERATE A DRILL AND THIS METHOD MAY ALSO BE REQUIRED FOR CERTAIN SMALL SEEDS.

5.4. WHEN A STANDARD DRILL WITH FERTILIZER ATTACHMENT IS USED, CERTAIN MIXED SEEDS MAY BE PLACED IN THE SEED BOX AND THE FERTILIZER PLACED IN THE FERTILIZER COMPARTMENT. BOTH MAY BE APPLIED DURING ONE (1) OPERATION, UNLESS NOTES ON THE PLANS REQUIRE SEPARATE APPLICATIONS. FERTILIZER MAY BE DRILLED INTO THE SOIL OR APPLIED BY HYDRAULIC-SLURRY. BROADCASTING FERTILIZERS IS PERMISSIBLE ON ROUGH, ROCKY SLOPES WHERE DRILLS CANNOT OPERATE.

5.5. ALL DRILLS SHALL BE FULLY ADJUSTABLE SO THAT THEY WILL DELIVER THE SEEDS AND FERTILIZER AT THE RATES SPECIFIED ON THE PLANS OR ORDERED BY THE ENGINEER. DRILLS THAT ARE IN POOR REPAIR OR THAT DO NOT DELIVER THE SEEDS AND FERTILIZER UNIFORMLY IN EACH DRILL FURROW, SHALL NOT BE USED. DRILLS SHALL BE ADJUSTABLE SO THAT THE SEEDS CAN BE PLANTED AND COVERED A MAXIMUM DEPTH OF 1/2 INCH.

5.6. MOST OF THE SEEDS SHOULD BE DRILLED ABOUT ONE-HALF (1/2) INCH DEEP IN A WELL- PREPARED AND FIRM SEEDBED. WHEN THE FERTILIZING AND SEEDING OPERATIONS START ON AN AREA, THAT AREA SHALL BE COMPLETED AS SOON AS POSSIBLE. NO SEEDING SHALL BE DONE DURING WINDY WEATHER OR WHEN THE GROUND IS WET OR OTHERWISE NON-TILLABLE. THE GRASS SEED SHALL THEN BE COVERED, USING A FLEXIBLE TOOTHED WEEDER OR OTHER SUITABLE EQUIPMENT. AS SOON AS THIS COVERING OPERATION HAS BEEN COMPLETED, THE SEEDED AREA SHALL BE ROLLED AGAIN WITH THE CULTI-PACKER, THE CULTI-PACKER BEING RUN OVER THE AREA ONLY ONCE PARALLEL WITH THE CONTOURS OF THE GROUND.

6. MULCHING.

6.1. APPLYING HAY MULCH - HAY MULCH SHALL BE THE REQUIRED MULCHING MATERIAL FOR PERMANENT SEEDING, UNLESS SPECIFIED OTHERWISE ON THE PLANS OR DIRECTED BY THE ENGINEER. THE HAY SHALL NOT CONTAIN AN EXCESSIVE QUANTITY OF NOXIOUS WEED SEEDS. THE MULCH SHALL BE A SHARP GRADE PRAIRIE HAY, SEDAN GRASS HAY OR BROOM SEDGE OR ANY OTHER TYPE OF NATIVE HAY OR GRASS. STRAW SHALL BE 8 INCHES MINIMUM; 50% SHALL BE 10 INCHES IN LENGTH OR LONGER.

6.2. AFTER SEEDING OPERATIONS ARE COMPLETE THE MULCH SHALL BE SPACED UNIFORMLY BY HAND, MANURE SPREADER, OR OTHER SUITABLE EQUIPMENT. THE MULCH SHALL BE ANCHORED TO THE SOIL BY A V-TYPE WHEEL LAND PACKER, A DISK HARROW SET TO CUT SLIGHTLY, OR OTHER SUITABLE EQUIPMENT WHICH WILL SECURE THE MULCH FIRMLY INTO THE GROUND 2 INCHES OR MORE TO FORM A SOIL-BINDING MULCH AND PREVENT LOSS OR BUNCHING BY WIND. SPACING BETWEEN DISKS SHALL NOT EXCEED 8 INCHES. APPLY HAY MULCH AT THE RATE OF 2 TONS PER ACRE OR 90 LBS. PER 1000 SQ. FT.

6.3. APPLYING WOOD CELLULOSE FIBER MULCH - WOOD CELLULOSE FIBER MULCH MAY BE USED IN LIEU OF HAY MULCH WHEN THE CONTRACTOR ELECTS TO USE A HYDRO SEEDER AND THE METHOD IS APPROVED BY THE ENGINEER. WOOD CELLULOSE FIBER MULCH SHALL BE APPLIED AT THE MINIMUM RATE OF 2500 POUNDS PER ACRE, UNLESS SPECIFIED OTHERWISE.

7. WATERING.

7.1. THE CONTRACTOR SHALL WATER THE SEEDED AREAS AS REQUIRED TO ASSURE AN ACCEPTABLE STAND OF GRASS.

8. PROTECTION AND MAINTENANCE.

8.1. THE GRASSED AREA SHALL BE PROTECTED AGAINST TRAFFIC OR OTHER USE IMMEDIATELY AFTER PLANTING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER CARE OF THE GRASSED AREA UNTIL ALL WORK ON THE ENTIRE CONTRACT HAS BEEN COMPLETED AND ACCEPTED, OR A MINIMUM PERIOD OF 30 DAYS, WHICHEVER IS THE LONGEST DURATION. THE CONTRACTOR WILL BE RELIEVED FROM WATERING GRASSED AREAS ACCEPTED BY THE ENGINEER AND THE OWNER.

8.2. ALL PLANTED AREAS SHALL BE GROWING WHEN ACCEPTED. AREAS NOT SHOWING A STAND OF GRASS OR EVIDENCE OF GROWTH SHALL BE REPLANTED IN ACCORDANCE WITH THESE SPECIFICATIONS. ALL COSTS IN CONNECTION WITH REPLANTING GRASSED AREAS SHALL BE BORNE BY THE CONTRACTOR UNTIL AN ACCEPTABLE STAND OF GRASS IS OBTAINED, WITH NO ADDITIONAL COST TO THE PROJECT.

9. PAYMENT

9.1. ALL SEEDING OPERATIONS THROUGHOUT THE ENTIRE COURSE OF THE PROJECT FOR TEMPORARY AND PERMANENT SEEDING, SOIL PREPARATION, FERTILIZER APPLICATION, MULCHING, WATERING, AND ALL OTHER ASSOCIATED WORK, DESCRIBED ON THE SEEDING SHEETS, SHALL BE PAID FOR AS THE BID ITEM "PROJECT SEEDING, L.S." THIS BID ITEM INCLUDES ALL RE-SEEDING ACTIVITIES AND ANY ASSOCIATED WORK NECESSARY.

TEMPORARY SEEDING

TEMPORARY SEED NOTES

1. TEMPORARY SEEDING SHALL BE INSTALLED AS TEMPORARY COVER AFTER GRADING AND/OR CONSTRUCTION ACTIVITIES HAVE BEEN COMPLETED IN AN AREA OF THE PROJECT. TEMPORARY SEED SHALL BE INSTALLED WHEN:

   1.1. CONSTRUCTION ACTIVITY WILL CEASE FOR AT LEAST 28 DAYS; OR
   1.2. WITHIN 21 DAYS FROM THE LAST CONSTRUCTION ACTIVITY IN THAT AREA; OR,
   1.3. WHEN PERMANENT SEEDING CANNOT TAKE PLACE WITHIN THE SPECIFIED PLANTING WINDOW.

2. TEMPORARY SEEDING SHALL BE PLACED VIA APPROPRIATE SEED DRILL. THE TEMPORARY SEED MIX IS AS FOLLOWS:

   ANNUAL RYE 20#/ ACRE

3. TEMPORARY SEED MAY BE PLACED ANY TIME DURING CONSTRUCTION.

4. PROTECT SEEDED AREAS FROM EROSION BY SPREADING WEED-FREE STRAW MULCH TO FORM A CONTINUOUS BLANKET 1-1/2" LOOSE DEPTH AND CRIMP IN TO SOIL BY SUITABLE METHODS.

5. DO NOT SEED OR WORK SOIL WHEN THERE IS STANDING OR RUNNING WATER PRESENT IN DISTURBED AREAS.

6. SEEDING PROCESS: REFER TO SEEDING NOTES.

TESTING REQUIREMENTS FOR THIS PROJECT

* TV / MANDREL TESTING
* AIR TESTING (PIPE)
* VACUUM TESTING (MANHOLES)

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION	BY
1	5/8/2025	SHEET ADDED	DRS

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

SEEDING & TESTING NOTES


JOB NO.: 2400521
DATE: MAY 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.


DRAWING NUMBER
-

SHEET NUMBER 2A OF 38


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\Seeding Notes.dwg Last Save: 5/8/2025 1:36 PM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R. Plot Style: -- Plot Scale: 1:2.5447 Plot Date: 5/8/2025 1:37 PM Plotter Used: None

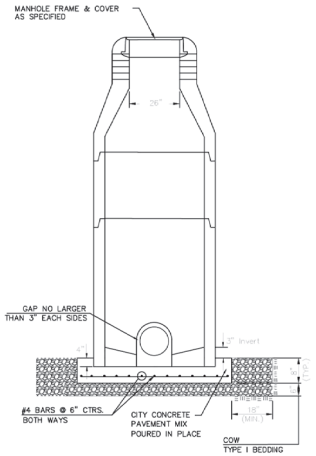


DOG HOUSE MANHOLE
(OVER EXISTING PIPE)
Not to Scale

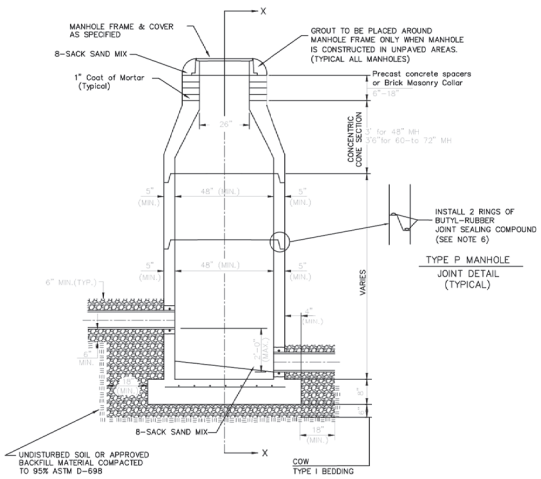

STANDARD MANHOLE
Not to Scale

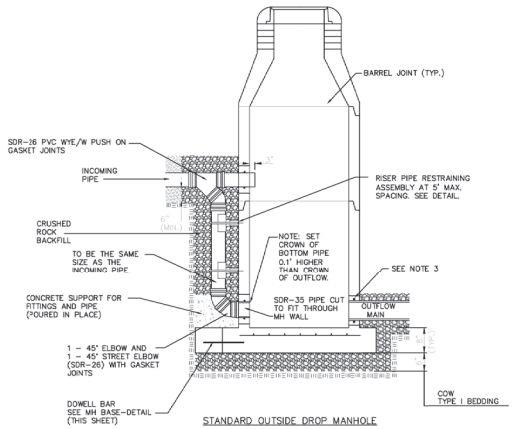


STANDARD OUTSIDE DROP MANHOLE
Not to Scale

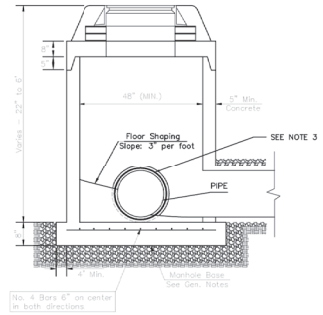

SHALLOW MANHOLE
Not to Scale

= COW TYPE I BEDDING = UNDISTURBED SOIL

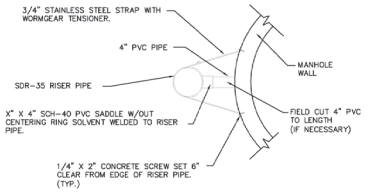


RISER PIPE RESTRAINING ASSEMBLY
Not to Scale

SANITARY SEWER MANHOLE DIAMETERS

DIAMETER	DEPTH	PIPE SIZE
4'	0'-15'	8"-18"
5'	>15'-30'	21"-30"
6'	>30'	36"-60"

PRECAST MANHOLE GENERAL NOTES

1. ALL PRECAST CONCRETE MANHOLE SECTIONS SHALL CONFORM TO THE LATEST REVISIONS OF A.S.T.M. C478 AS MODIFIED BY THE SPECIFICATIONS.
2. NON-SHRINK GROUT SHALL BE NON-METALLIC TYPE.
3. APPROVED FLEXIBLE WATERSTOP SHALL BE INSTALLED TO JOIN THE SEWER PIPE TO THE MANHOLE WALL. THE SEWER PIPE SHALL BE SUPPORTED WITH CRUSHED ROCK A MINIMUM OF 3 FEET FROM THE MANHOLE WALL AND TO THE FIRST JOINT FOR V.C.P. SUCH THAT THE JOINT REMAINS FLEXIBLE.
4. ALL INSIDE SURFACES OF THE CONCRETE MANHOLE WHICH WOULD BE EXPOSED TO SEWER GAS SHALL BE COATED PER SECTION 804.4 OF STANDARD SPECIFICATIONS.
5. EXTERIOR MANHOLE WALLS SHALL BE COATED PER SECTION 804.4 OF STANDARD SPECIFICATIONS.
6. JOINT SEALING COMPOUND SHALL BE PER 804.4 OF STANDARD SPECIFICATIONS.
7. ALL MANHOLE SECTION JOINTS THAT WILL BE IN GROUNDWATER OR GREATER THAN 12' DEEP SHALL BE WRAPPED WITH AN EXTERNAL JOINT SEAL PER SECTION 804.4 OF STANDARD SPECIFICATIONS. AS INDICATED BY THE PLANS.
8. PRECAST MANHOLES SHALL BE SET AT LEAST 4 INCHES INTO THE MANHOLE BASE FOR DOG HOUSE MANHOLES.
9. TOP OF MANHOLE FLOOR SLAB SHALL BE AT LEAST 3 INCHES BELOW THE FLOW LINE OF THE OUTLET PIPE TO INSURE SUFFICIENT MINIMUM THICKNESS OF SHAPED INVERT.
10. LIFTING HOLES SHALL BE FILLED WITH NON-SHRINK GROUT AND THE INTERIOR SURFACE COATED AS SPECIFIED.
11. MORTAR USED IN MASONRY CONSTRUCTION SHALL CONTAIN 8 SACKS OF CEMENT PER CUBIC YARD. CONCRETE USED IN MANHOLE BASES SHALL CONFORM TO THE REQUIREMENTS OF CONCRETE FOR CONCRETE PAVEMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS USING CITY CONCRETE PAVEMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACE AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.
12. REINFORCING STEEL SHALL BE INSTALLED IN THE MANHOLE BASES AND SHALL CONSIST OF NO.4 BARS PLACED ON 6" CENTERS IN BOTH DIRECTIONS. THE MANHOLE BASE REINFORCEMENT SHALL BE PLACED AT LEAST 3" ABOVE THE BOTTOM OF THE MANHOLE BASE. ALL COSTS FOR FURNISHING AND INSTALLING REINFORCING STEEL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
13. WALL THICKNESS SHALL BE 1" GREATER THAN MANHOLE DIAMETER IN FEET.
14. OPENINGS SHALL BE CORE DRILLED INTO THE MANHOLE WALL WHEN OUTSIDE DROPS ARE CONSTRUCTED ON EXISTING MANHOLES. SUCH OPENINGS DRILLED INTO EXISTING MANHOLES SHALL BE AS SMALL AS PRACTICAL TO FACILITATE INSTALLING AND GROUTING THE NEW PIPE IN PLACE. WATERSTOP GASKETS SHALL BE USED WITH P.V.C. PIPE. THE NEW PIPE SHALL BE GROUTED INTO THE OPENING USING AN APPROVED NONSHRINK GROUT FOR THE FULL MANHOLE WALL THICKNESS. THE EXTERIOR OF THE COMPLETED CONNECTION SHALL BE SEALED WITH AN APPROVED BITUMINOUS COATING SUCH THAT THE CONNECTION WILL BE WATER TIGHT. FLOOR OF MANHOLE SHALL BE MODIFIED TO FORM NEW FLOW CHANNEL FOR THE NEW CONNECTION AS INDICATED BY THE DRAWING. THIS WORK, INCLUDING MODIFICATION OF MANHOLE FLOOR, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR OUTSIDE DROP STACK CONSTRUCTED ON EXISTING MANHOLE.
15. THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF CLEANING AND FREE OF AREAS WHERE SOLIDS COULD BE DEPOSITED AS SEWAGE FLOWS THROUGH THE MANHOLE FROM ALL INLET PIPES TO THE OUTLET PIPE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE AS SHOWN BY THE DRAWINGS. MANHOLE FLOORS SHALL HAVE SLOPES OF 3 INCHES PER FOOT IN THE AREAS OUTSIDE OF THE FLOW CHANNELS SLOPED TOWARD THE FLOW CHANNELS. PIPES LAID THROUGH MANHOLES SHALL HAVE THE TOP HALF REMOVED TO NEAT LINES FOR THE FULL INSIDE DIAMETER OF THE MANHOLE. MANHOLE FLOORS SHALL THEN BE SHAPED AROUND THE BOTTOM HALF OF THE PIPE WHICH FORMS THE FLOW CHANNEL.
16. MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWING.
17. THE VERTICAL DROP IN STANDARD MANHOLES SHALL NOT EXCEED 2' REGARDLESS OF PIPE SIZE. THE CROWNS OF INFLOWING PIPES SHALL NEVER BE SET LOWER THAN THE CROWN OF THE OUTFLOWING PIPE.
18. STANDARD MANHOLES SHALL BE BID AS STANDARD MANHOLES FOR THE TYPE AND DIAMETER INDICATED. OUTSIDE DROP MANHOLES SHALL BE BID AS STANDARD OUTSIDE DROP MANHOLES FOR THE TYPE AND DIAMETER INDICATED. ALL MANHOLE DIAMETERS WILL BE 4' UNLESS INDICATED OTHERWISE.
19. PRECAST CONCRETE SPACERS OR BRICK MASONRY COLLAR SHALL BE INSTALLED BETWEEN THE CAST IRON FRAME AND THE CONCENTRIC CONE. THE COLLAR WILL HAVE 8" WALLS AND A VERTICAL HEIGHT OF 6" MINIMUM AND 18" MAXIMUM. A 1" COAT OF MORTAR WILL BE PLASTERED ON THE OUTSIDE OF THE COLLAR. THE USE OF PRE-CAST CONCRETE SPACERS FOR MANHOLE TOP ADJUSTMENT IS ALSO ALLOWED.
20. THE FULL DIAMETER OF THE MANHOLE SHALL EXTEND THE ENTIRE DEPTH OF THE MANHOLE TO THE CONE SECTION. NO REDUCTION IN MANHOLE DIAMETER WILL BE ALLOWED.

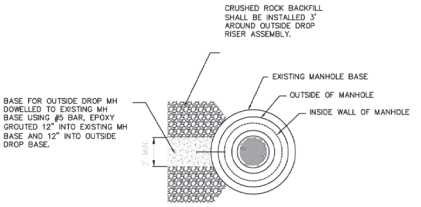

MH BASE DETAIL
Not to Scale

REVISION NOVEMBER 2019	RISER PIPE RETAINING ASSEMBLY REVISED ON MANHOLE DRAWING

CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

PRECAST SANITARY SEWER MANHOLE


CITY ENGINEER
GARY JANZEN, P.E.

PROJECT NUMBER	OCA NUMBER	DATE
2400521	.	

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET 3 / 38

SS-101

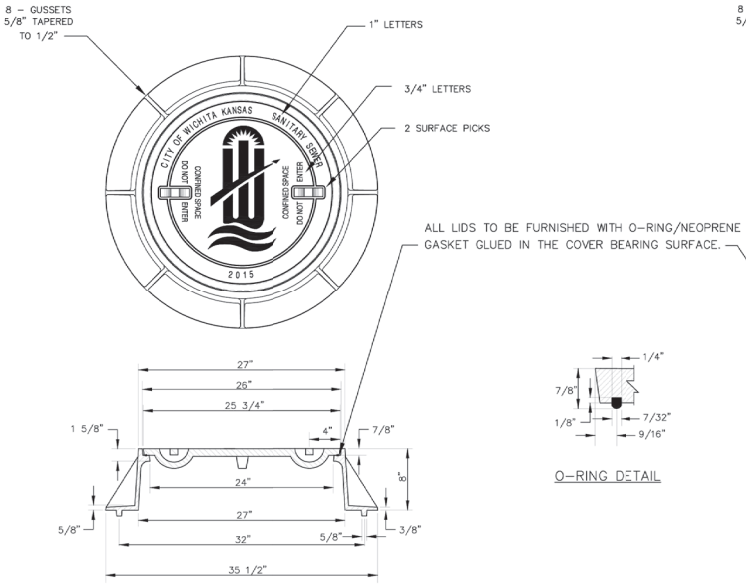


STANDARD MANHOLE FRAME & COVER

DEETER #1261 OR EJW #1936–Z1

NOTE:
1. FURNISHED WITH MACHINED HORIZONTAL BEARING SURFACE.


O–RING DETAIL

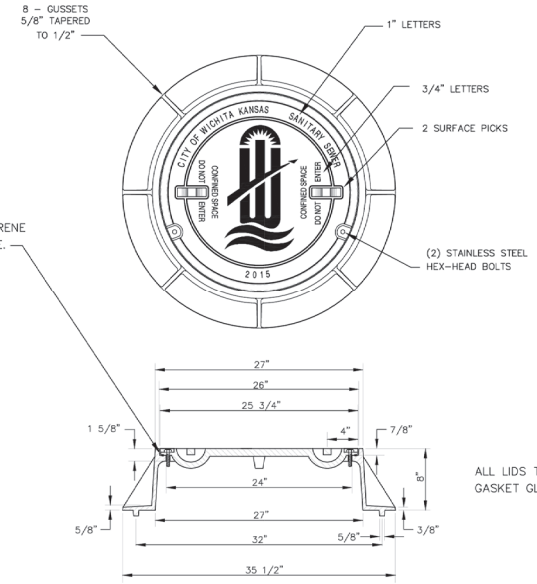

BOLT DOWN MANHOLE FRAME & COVER

DEETER #1261 OR EJW #1936–Z1

NOTE:
1. FURNISHED WITH MACHINED HORIZONTAL BEARING SURFACE.

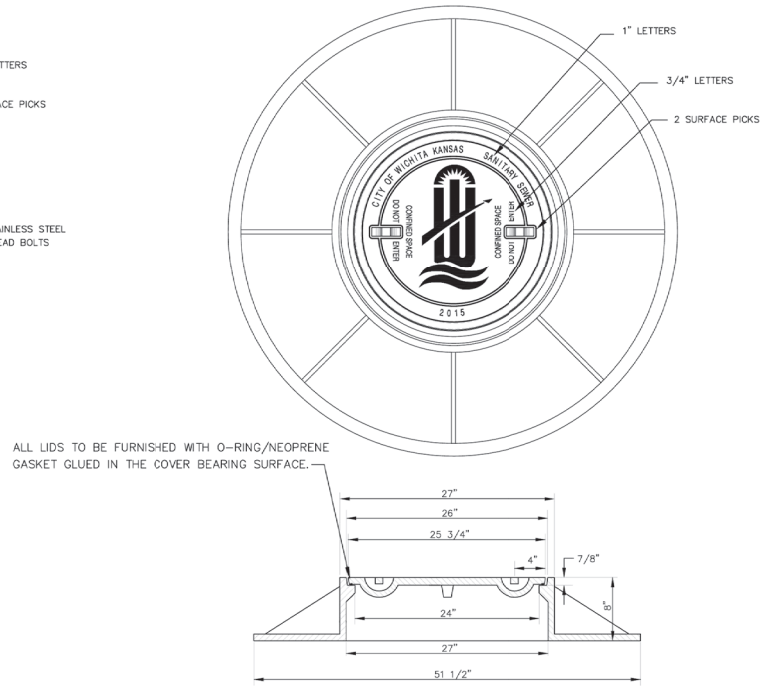

WIDE FLANGED FRAME & COVER

DEETER #1261A

NOTE:
1. FURNISHED WITH MACHINED HORIZONTAL BEARING SURFACE.

GENERAL NOTES

1. MANHOLE CASTINGS SHALL BE MANUFACTURED USING GOOD QUALITY GRAY IRON CONFORMING TO CLASS 30 OF A.S.T.M. DESIGNATION A–48. DIMENSIONS SHOWN ON THE DETAILED DRAWINGS SHALL BE CONSIDERED AS MINIMUM REQUIREMENTS AND ANY DEVIATIONS FROM THE DIMENSIONS SHOWN MUST BE SPECIFICALLY APPROVED. THE FINISHED CASTINGS SHALL BE OF UNIFORM QUALITY, FREE FROM BLOWHOLES, POROSITY, HARD SPOTS, SHRINKAGE DISTORTIONS OR OTHER DEFECTS.

2. MANHOLE CASTINGS SHALL BE MANUFACTURED SUCH THAT A COVER MANUFACTURED BY ANY ONE FOUNDARY WILL FIT INTERCHANGEABLY INTO A FRAME MANUFACTURED BY ANOTHER FOUNDRY AND STILL MEET ALLOWABLE CLEARANCES AND NON–ROCKING REQUIREMENTS. THIS WILL REQUIRE MANUFACTURING OF THE MATCHING FACES ON THE COVER AND THE FRAME TO CLOSE TOLERANCES.

3. THE OUTSIDE CIRCUMFERENCE OF THE VERTICAL FACE OF THE COVER AND THE INSIDE CIRCUMFERENCE OF THE VERTICAL FACE IN THE FRAME RECESS SHALL BE MANUFACTURED TO TOLERANCES SUCH THAT THE CLEARANCE BETWEEN THE COVER AND FRAME WILL NOT EXCEED 1/8" AT ANY POINT AROUND THE CIRCUMFERENCE OF THE COVER. THE SEATING SURFACES BETWEEN THE COVER AND FRAME SHALL BE MACHINED SUCH THAT THESE SEATING SURFACES SHALL MAKE FULL CONTACT FOR THEIR FULL CIRCUM–FERENCE TO PRECLUDE THE COVER FROM ROCKING IN THE FRAME.

4. THE MANHOLE FRAME AND COVER SHALL BE MARKED WITH LETTERING INDICATING THE NAME OF THE MANUFACTURER AND THE YEAR WHEN THE COVER OR FRAME WAS CAST. THE COVER SHALL BE FURTHER IDENTIFIED WITH REGARDS TO OWNERSHIP USING LETTERS AT LEAST 1"IIN HEIGHT. THIS IDENTIFICATION SHALL BE "CITY OF WICHITA SANITARY SEWER".
THE TOP SURFACE OF THE COVER SHALL BE MANUFACTURED IN WITH CITY OF WICHITA DESIGN AS INDICATED ON THE DRAWINGS. SMOOTH BLOCKOUTS SHALL BE UTILIZED TO HIGHLIGHT THE LETTERING ON THE COVER SURFACE. THE TOTAL AREA OF SMOOTH SURFACE BLOCKOUT SHALL NOT EXCEED THE AREA AS INDICATED ON THE DRAWING. POSITIONING OF SMOOTH BLOCKOUTS AND LETTERING MAY VARY FROM THAT SHOWN ON THE DETAILED DRAWING.

REVISED: MARCH 2018

CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

MANHOLE
FRAME AND COVER
(SANITARY SEWER)


CITY ENGINEER
GARY JANZEN, P.E

PROJECT NUMBER	OCA NUMBER	DATE
2400521	.	

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET 4 / 38

SS-I02

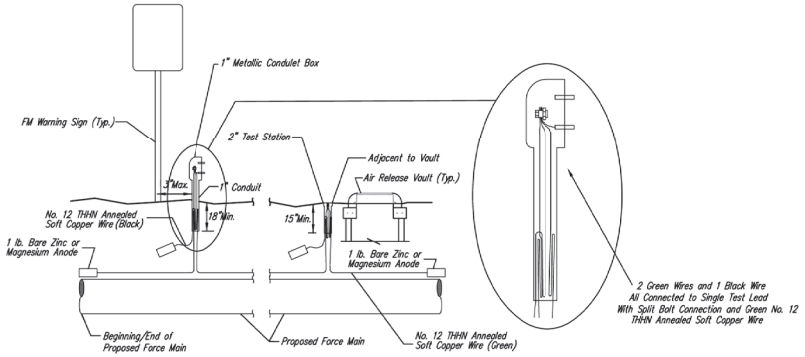

TRACER WIRE

Conductive type pipe locator/tracer wire shall be installed to locate all sanitary sewer force main pipe regardless of pipe material. The wire shall extend the entire length of the proposed pipe. The wire shall be taped to the force mains and pulled with the pipe. Split-bolt connectors shall be used at splice locations. Electrical tape shall cover all splices so no bare wire is exposed. Test stations shall be installed adjacent to all air release vaults and force main warning signs. Any exceptions to the location of test stations shall be approved by the engineer. At each test station, the tracer wire shall be connected to a 1 lb. Zinc or magnesium anode. Anodes shall also be attached to the tracer wire at both the beginning and the end of the proposed sewer line. A typical layout of the tracer wire and test station is provided in the above figure.

WIRE

The tracer wire shall be Green No. 12 THHN annealed soft copper wire with thermal plastic insulation. The insulation shall be heat, oil, and gasoline resistant as manufactured by Temple Electric or approved equal. To allow for grade adjustment, a minimum of 12" of excess wire shall be coiled at the bottom of the test station for all wires. The insulaiion sheathing shall be removed such that 1" bare copper wire is exposed at all points of connection.

TEST STATIONS


The test station for the force main warning signs applications shall be a 1 inch galvanized "conduiet" style test station as manufactured by AGRA Industries with a removable solid cover having two leads extending from the face or approved equal. The test station for air release vault applications shall be 2 inch flush style test station T2PSJB as manufactured by HANDLEY Industries or approved equal. The conduit style shall be attached to a 1 inch rigid galvanized conduit with a minimum length of 36" and plastic end bushing. The flush style shall have the word "Sewer" stamped or molded into the lid. All test stations shall be manufactured using molded green tops or sufficiently coated with green enamel paint. The tracer wire and the anode wire shall be installed to allow 10 inches of wire within the test station. In concrete environments such as sidewalks or in the downtown area the contractor shall use the flush style test station. The location of all test stations shall be approved by the engineer, recorded, and shown in the as-built drawings.

ANODES

The anodes shall be 1 lb. bare zinc or magnesium. The anodes shall be buried at the same elevation as the sanitary sewer force main at each test station. The anodes shall be connected to Black No. 12 THHN annealed soft copper wire which shall be extended to the test station.

SEWER TRACER WIRE DETAIL

COST IS SUBSIDIARY TO PIPE INSTALLATION

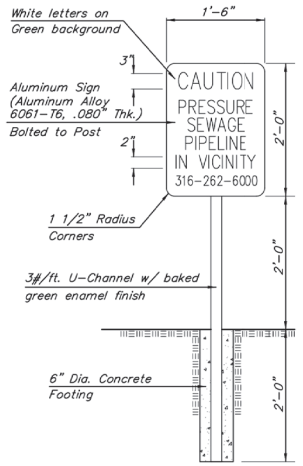

FORCE MAIN WARNING SIGN DETAIL

Note: Install Metal Warning Signs at Locations as Shown on the Plans. Exact Locations of Warning Signs shall be Approved by the Engineer.

GARY L. JANZEN LICENSED 18208 KANSAS PROFESSIONAL ENGINEER 04/16/13

CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION


TRACER WIRE & WARNING SIGN FOR SANITARY SEWER FORCE MAIN


CITY ENGINEER: GARY JANZEN, P.E.


PROJECT NUMBER	OCA NUMBER	DATE
2400521	.	12/2012


CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET 5 / 38

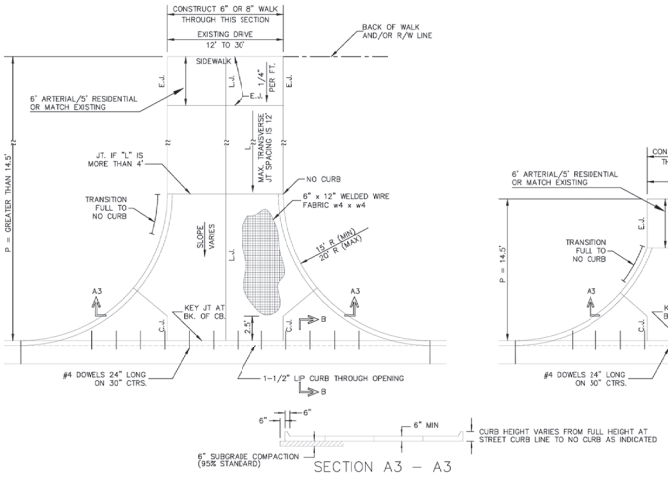

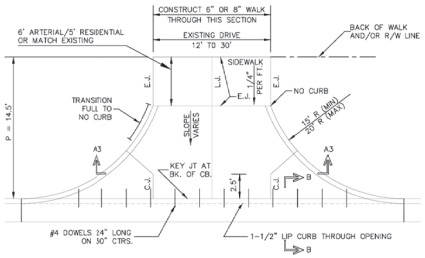


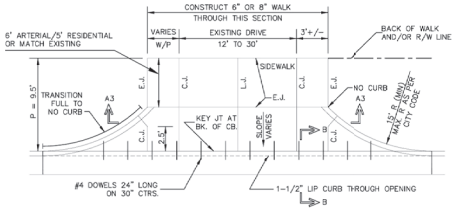




SECTION B – B

ALT. LONGITUDINAL CONSTRUCTION JOINT




BACK OF CURB DETAIL

FULL RADIUS DRIVES (ARTERIAL/COLLECTOR DRIVEWAY)

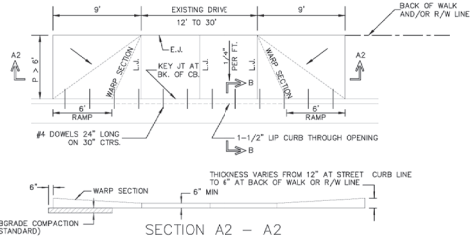

SECTION A2 – A2

FULL RAMP DRIVES (P = 4.0' & 6.5')

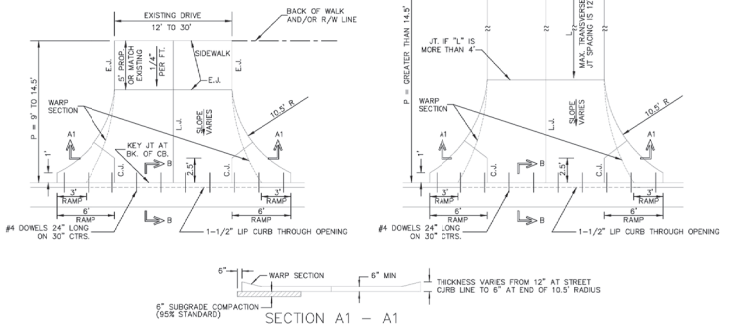

SECTION A1 – A1

RADIUS RAMP DRIVES (RESIDENTIAL DRIVEWAY)

GENERAL NOTES

1. DRIVEWAY CONSTRUCTION DETAILED ON THIS SHEET IS FOR USE WITH FULL HEIGHT STREET CURBS AND IN AREAS WITHOUT FULL WALK CONSTRUCTION IN THE PARKING. SEE OTHER DETAIL SHEETS FOR DRIVEWAY CONSTRUCTION WITH ROLL CURB AND/OR FULL WALK.
2. ONE LONGITUDINAL JOINT SHALL BE CONSTRUCTED ALONG THE CENTERLINE OF DRIVES HAVING A WIDTH DIMENSION OF 24' OR LESS. TWO LONGITUDINAL JOINTS SHALL BE CONSTRUCTED WITH EQUAL SPACINGS NOT TO EXCEED 10' FOR DRIVES WITH A WIDTH DIMENSION GREATER THAN 24'.
3. DRIVEWAY WIDTH DENOTED AS WIDTH ON THE DETAIL DRAWINGS SHALL BE A MINIMUM OF 12' AND A MAXIMUM OF 30'. THE MAXIMUN OPENING FOR RADIUS TYPE DRIVES WITH CURBS THROUGH THE RADIUS SHALL NOT EXCEED 52' AT THE STREET CURB LINE.
4. CONTRACTION JOINT SPACING IN THE DRIVEWAY WALK SECTION SHALL BE A MINIMUM OF 3' AND A MAXIMUM OF 6' AND ARE TO BE EQUALLY SPACED WITHIN THIS RANGE. WALK SECTION SHALL BE CONSTRUCTED TO THE SAME THICKNESS AS THE DRIVEWAY.
5. ADDITIONAL THICKNESS OF DRIVE AS INDICATED IN THE DRAWINGS WILL NOT BE PAID FOR DIRECTLY AND THIS COST SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE DRIVEWAY CONSTRUCTION.
6. ONE HALF INCH EXPANSION JOINTS SHALL BE INSTALLED WHEREVER DRIVE CONSTRUCTION ABUTS SIDEWALK. ONE HALF INCH EXPANSION JOINTS SHALL ALSO BE INSTALLED ALONG THE PROPERTY LINE AND/OR BACK OF WALK LINE WHEN DRIVE CONSTRUCTION ALONG THIS LINE ABUTS CONCRETE PARKING LOTS OR CONCRETE DRIVE EXTENSION.
7. DRIVEWAYS ONLY ON RESIDENTIAL PROPERTIES ONLY CAN BE CONSTRUCTED WITH 6" IN THICKNESS AND CAN BE WITHOUT REINFORCEMENT.
8. ALL DRIVEWAYS TO NONRESIDENTIAL PROPERTY SHALL BE A MINIMUM OF 8" IN THICKNESS AND SHALL HAVE REINFORCEMENT WITH 6"x12", W4xW4.

REVISED: NOVEMBER 2015

CITY OF WICHITA
PUBLIC WORKS & UTILITIES ENGINEERING DIVISION

STANDARD DRIVE ENTRANCES FULL HEIGHT CURB


CITY ENGINEER
GARY JANZEN, P.E.

PROJECT NUMBER	OCA NUMBER	DATE
2400521	.	


CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET 6 / 38


PV-126




TEE

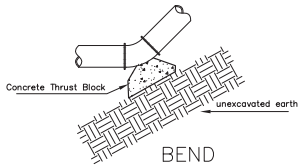

BEND




VERTICAL BEND




PLUG

PIPE SIZE	THRUST AT FITTINGS IN TONS–AT 150#/IN²P					
	PLUG	90°	45°	22 1/2°	11 1/4°	TEE
6"	2.8	3.95	2.15	1.09	.55	2.8
8"	4.9	6.95	3.75	1.90	.96	4.9
12"	11.4	16.1	8.75	4.45	2.25	11.4
16"	20.15	28.5	15.4	7.85	3.95	20.15
20"	31.15	44.0	23.85	12.15	6.10	31.15
24"	44.55	63.0	34.1	17.4	8.75	44.55


TYPICAL THRUST BLOCKS

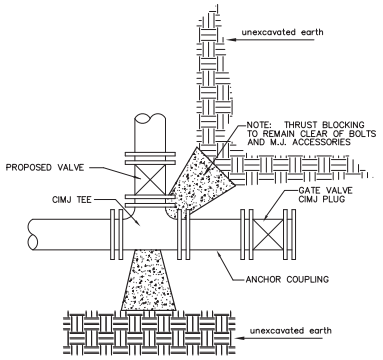

KEY BLOCK DETAIL

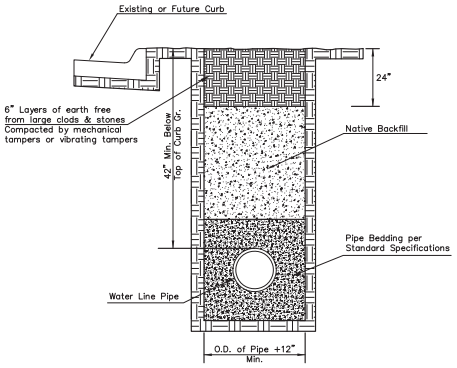

TRENCH COMPACTION IN ROAD RIGHT–OF–WAY

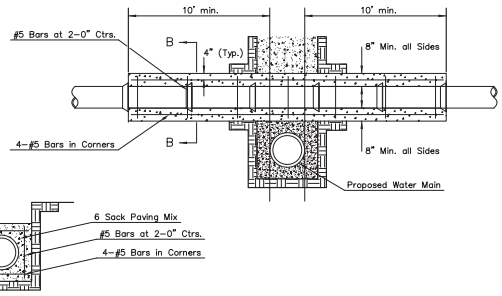


Note: Encasement to begin and end at a Bell on Sanitary Sewer Pipe.

SECTION B–B


REINFORCED CONCRETE ENCASEMENT OF SANITARY SEWER

SIDE VIEW

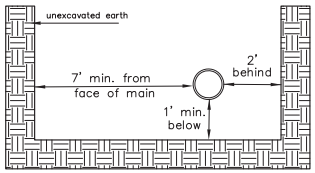


Note: When shoring is required it is to be per The City of Wichita Standard Specifications.

TOP VIEW

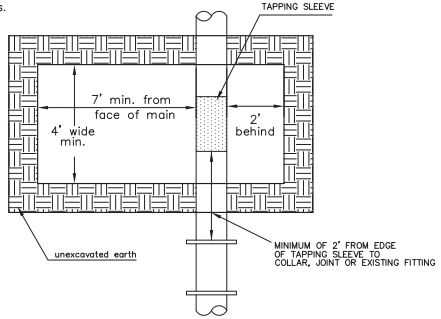

EXCAVATION FOR WET TAP

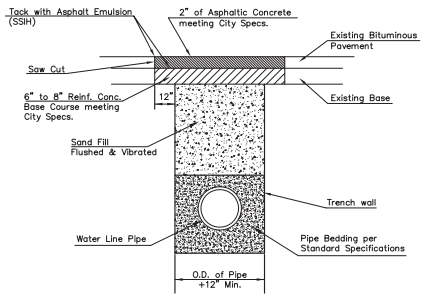

PAVEMENT REPLACEMENT & TRENCH COMPACTION UNDER EXISTING AND PROPOSED CITY ROADS

* PLANS GOVERN
UNLESS OTHERWISE NOTED ON PLANS

GARY L. JANZEN — LICENSED — 16294 — KANSAS — PROFESSIONAL ENGINEER
07/21/15

REVISED: JULY 2015

CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

MISCELLANEOUS WATER DETAILS

CITY ENGINEER
GARY JANZEN, P.E..

PROJECT NUMBER	OCA NUMBER	DATE

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET 6A

WL-104



UES	PREPARED BY	PROJECT	LOCATION	SYMBOL KEY
	GSI Engineering, LLC a UES Company Wichita, Kansas	Name: Pegasus Addition Number: A24125.00708.000	37.642954, -97.221686 Wichita, KS	Soil Boring

SEE STORM WATER DRAIN PLANS FOR SOIL BORINGS 1-6

Pegasus Addition
Wichita, Kansas
Project No.: A24125.00708.000

Soil Boring: B-7
Sheet 1 of 1

DRILLING FIRM: UES	**DATE COMPLETED:** 12/02/2024	**REMARKS:** -
DRILLER: P. Pulkrabek	**DEPTH:** 30'	
LOGGED BY: M. Linsted	**SURFACE ELEVATION:** 1367'	
RIG TYPE: Diedrich D-90	**ELEVATION DATUM:** WGS84	
HAMMER TYPE: Auto	**GEOLOGY:** Flint Hills	**GWT (ATD):** N.E. **GWT (AD):** N.E.
METHOD: 3.25-inch Inside Diameter Hollow Stem Augers	**COORDINATES:** 37.643060, -97.219468	

Depth (ft)	Sample Graphic	Sample Number	Uncorrected N-Value	Recovery / RQD	Graphic Log	Soil Description and Remarks	USCS	Moisture Content (%)	Wet Density (pcf)	Compressive Strength (ksf)	Fines Content (%)	Atterberg Limits (LL-PL-PI)	Elevation (ft)
						TOPSOIL 0.5							
		S-1	6			FAT CLAY - brown, moist, medium stiff, trace sand and roots 2.5		23.4					
		S-2	19			FAT CLAY with SAND - olive brown, moist, very stiff, trace iron 5.0	CH	16.2					
5		U-3	N/A			SHALE - olive, decomposed, very soft rock 8.5		25.5	136.4				
		S-4	29			SHALE - olive, decomposed, very soft rock 13.5							
10		U-5	N/A			SHALE - olive, decomposed, very soft rock 18.5		26.90	121	2.15			
		S-6	34			SHALE - olive, decomposed, very soft rock 23.5							
15		S-7	20			SHALE - olive, decomposed, very soft rock, some interbedded sand lenses 28.5							
		S-8	17			SHALE - olive, decomposed, very soft rock, some interbedded sand lenses 30.0							
20						End of boring at 30'							
25													
30													

1365 1360 1355 1350 1345 1340

FIGURE B-7
Pegasus Addition
Wichita, Kansas
A24125.00708.000 | 12/24

GSI Engineering, LLC a UES Company - 4503 E. 47th Street South, Wichita, Kansas 67210

Page 1 of 1

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

SOIL BORING


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: .
DRAWN BY: .


BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
-

SHEET NUMBER 7 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\SOIL BORING.dwg Last Save: 2/11/2025 9:33 AM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R. Plot Style: — Plot Scale: 1:2.5849 Plot Date: 2/11/2025 3:19 PM Plotter used: None

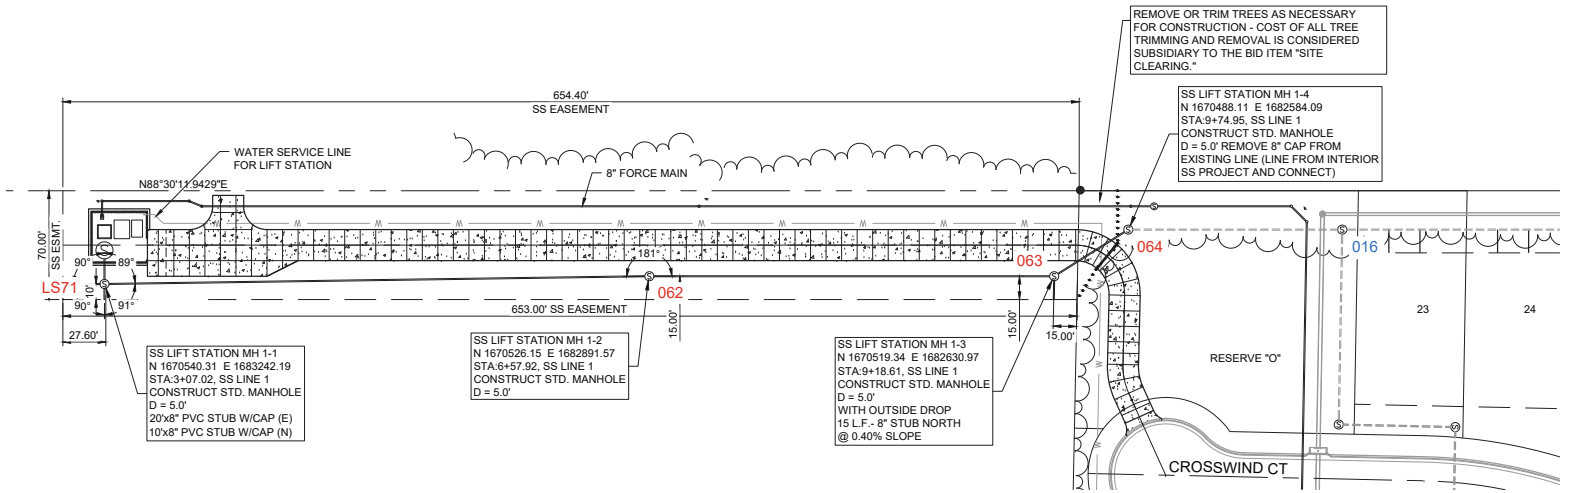

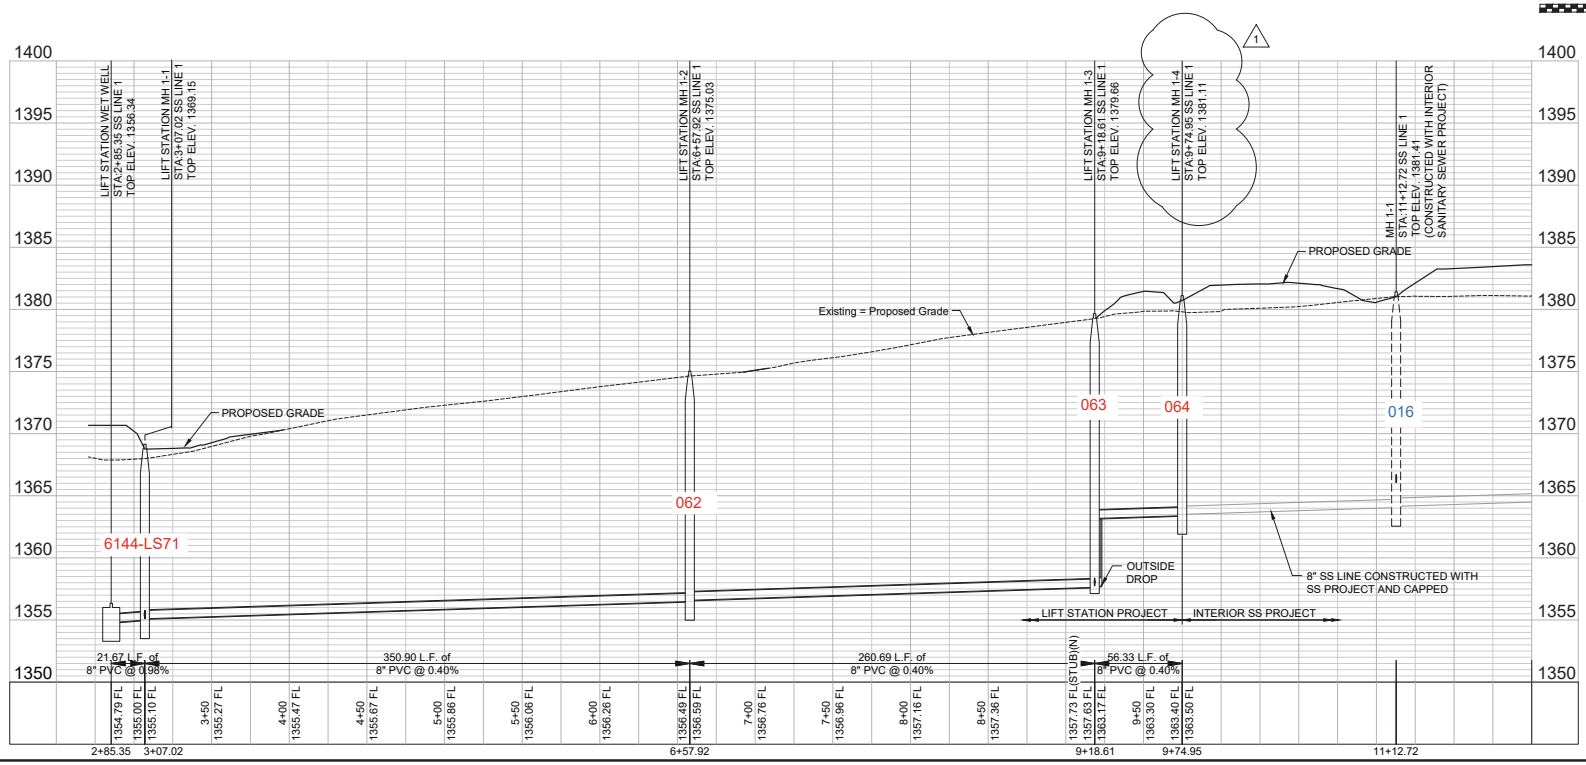

0 20' 40' 80' 120'
(IN FEET)
VERTICAL

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION	BY
1	5/8/2025	ADD TOP ELEV.'S 1381.11 TO LIFT STATION MH 1-2	XXX

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

SS GRAVITY LINE


JOB NO.: 2400521
DATE: MAY 2025
DESIGNED BY: EJG
DRAWN BY: DRS


BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER

SHEET NUMBER 8 OF 38

File: L:\2024\T41\2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\SS GRAVITY LINE.dwg Last Save: 2/6/2025 1:16 PM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R. Plot Style: — Plot Scale: 1:2.5644 Plot Date: 5/8/2025 3:12 PM Plotter Used: None

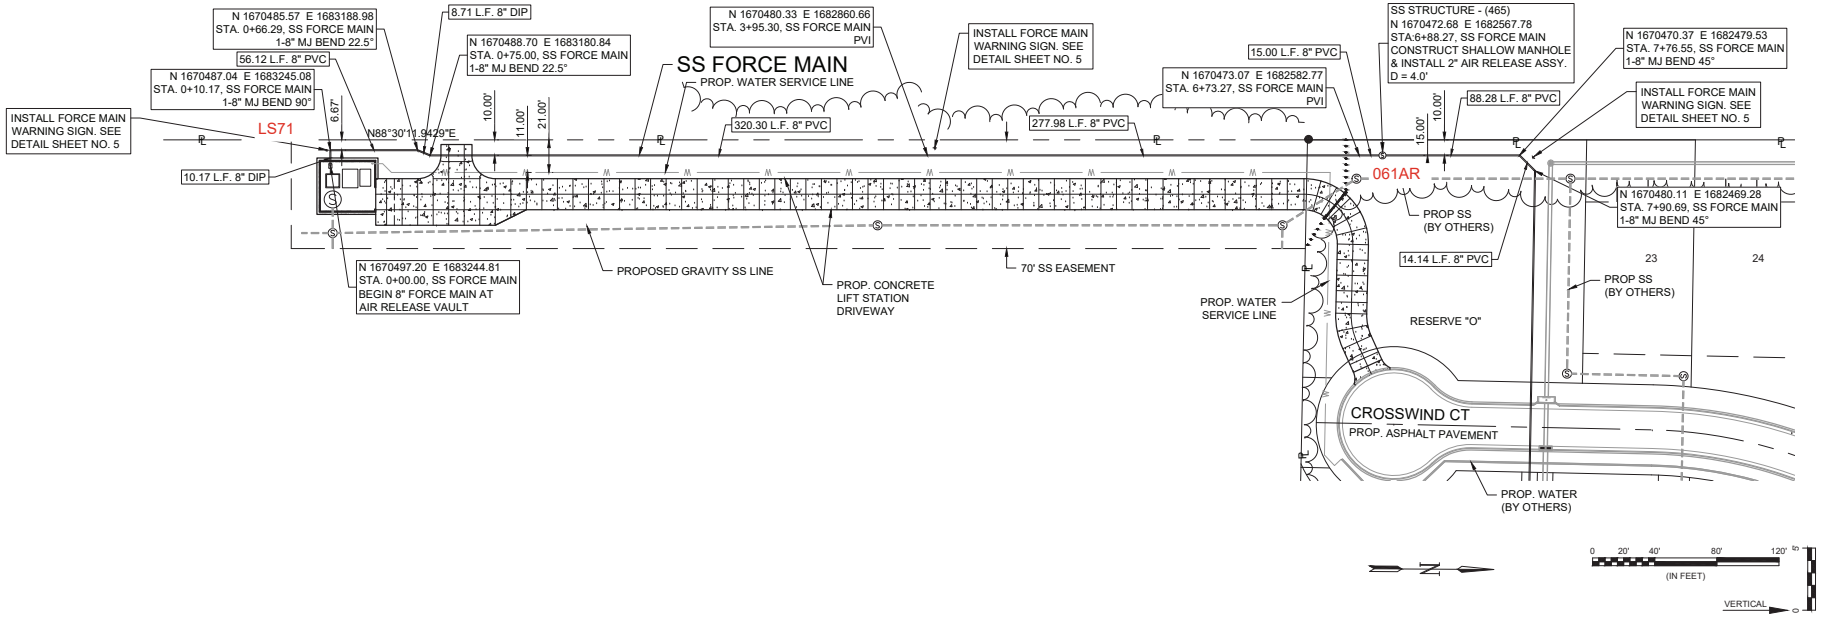

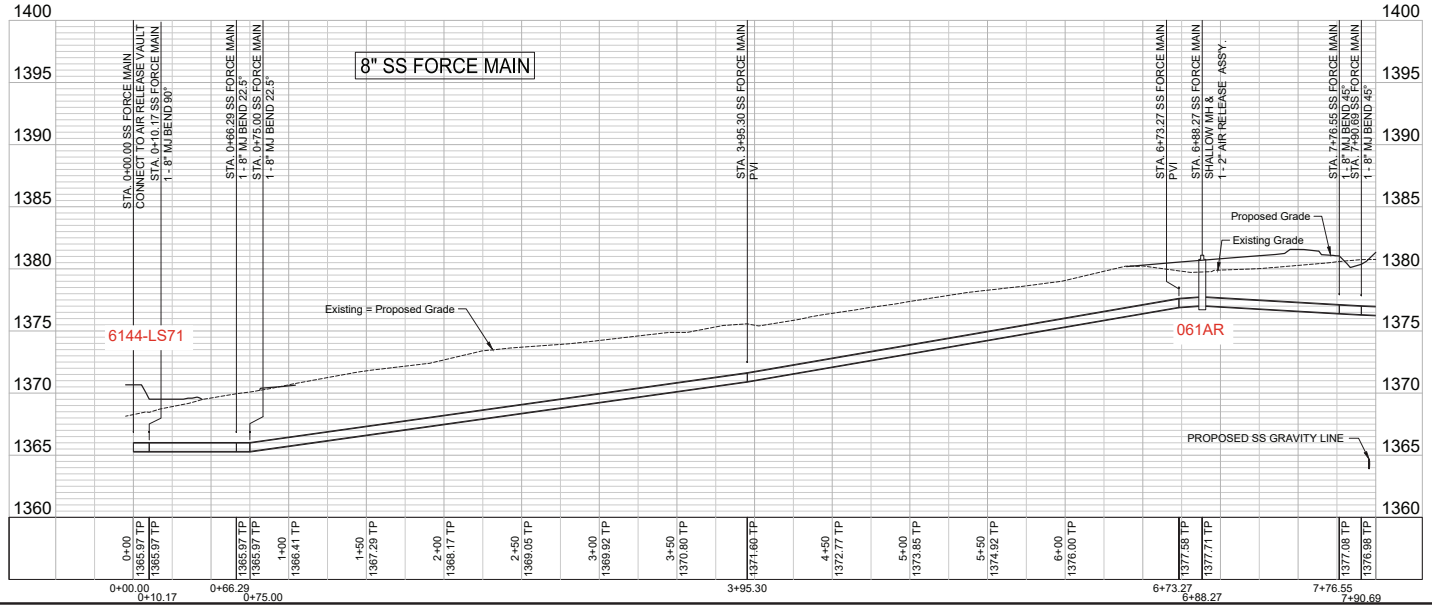

NOTE:
ALL BENDS OVER 11.25° SHALL EITHER HAVE REACTION BLOCKING OR SHALL BE RESTRAINED JOINTS.

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN
(1 OF 5)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
-

SHEET NUMBER 9 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\FORCE MAIN 1 OF 5.dwg Last Save: 2/6/2025 12:58 PM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R Plot Style: — Plot Scale: 1:2.5644 Plot Date: 2/7/2025 3:23 PM Plotter used: None

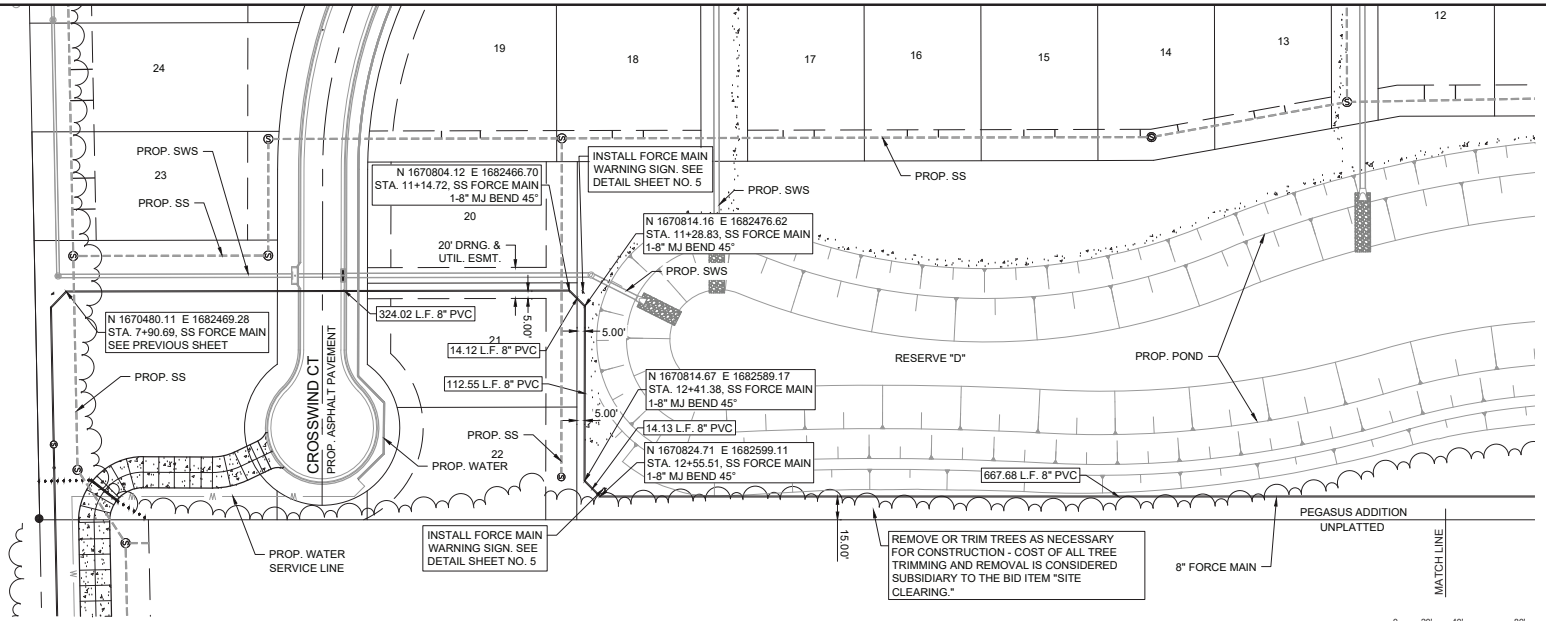

NOTE:
ALL BENDS OVER 11.25° SHALL EITHER HAVE REACTION BLOCKING OR SHALL BE RESTRAINED JOINTS.

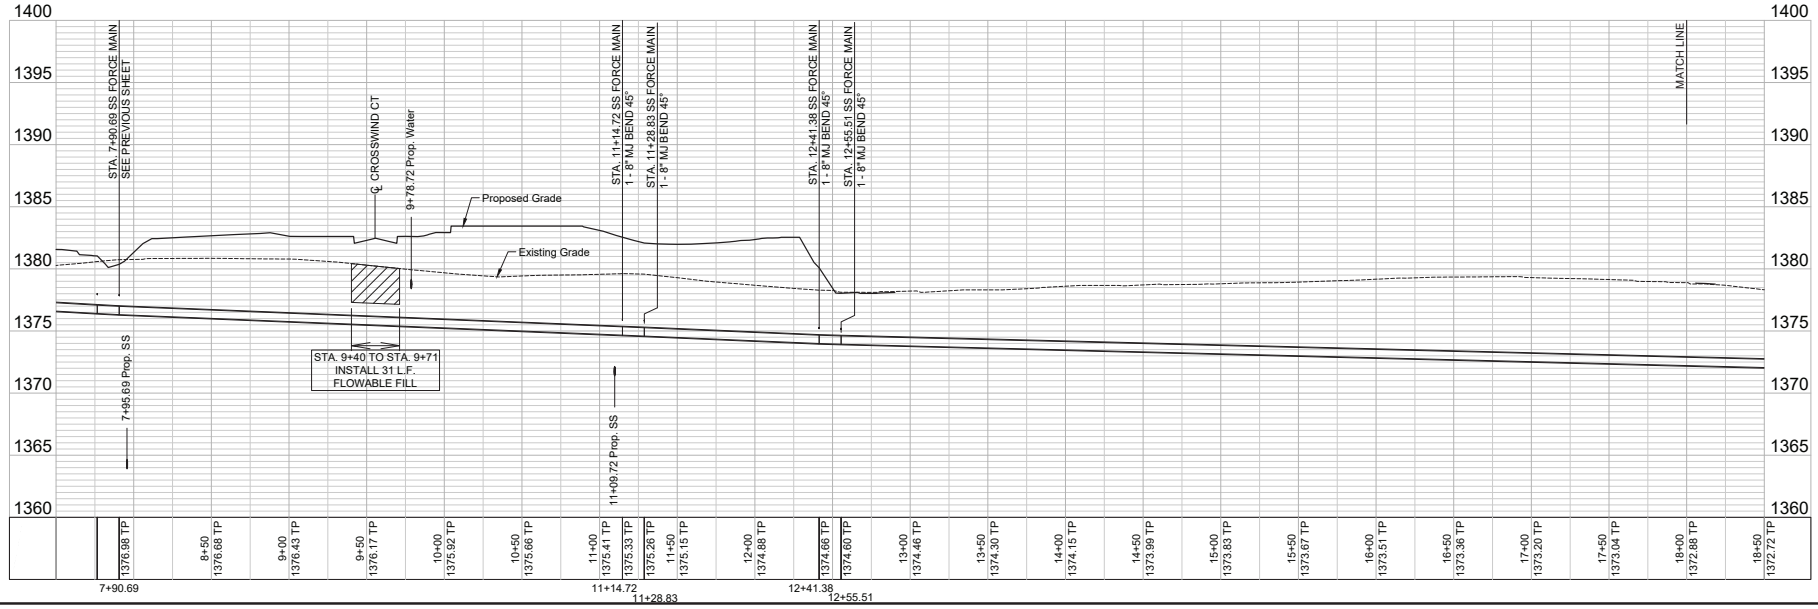

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

ERIC JOHN GLEICH
Current Date
20-25
KANSAS
PROFESSIONAL ENGINEER

REV	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN
(2 OF 5)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
-

SHEET NUMBER 10 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\FORCE MAIN 2 OF 5.dwg Last Save: 2/6/2025 11:37 AM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R Plot Style: — Plot Scale: 1:2.5648 Plot Date: 2/11/2025 3:20 PM Plotter used: None

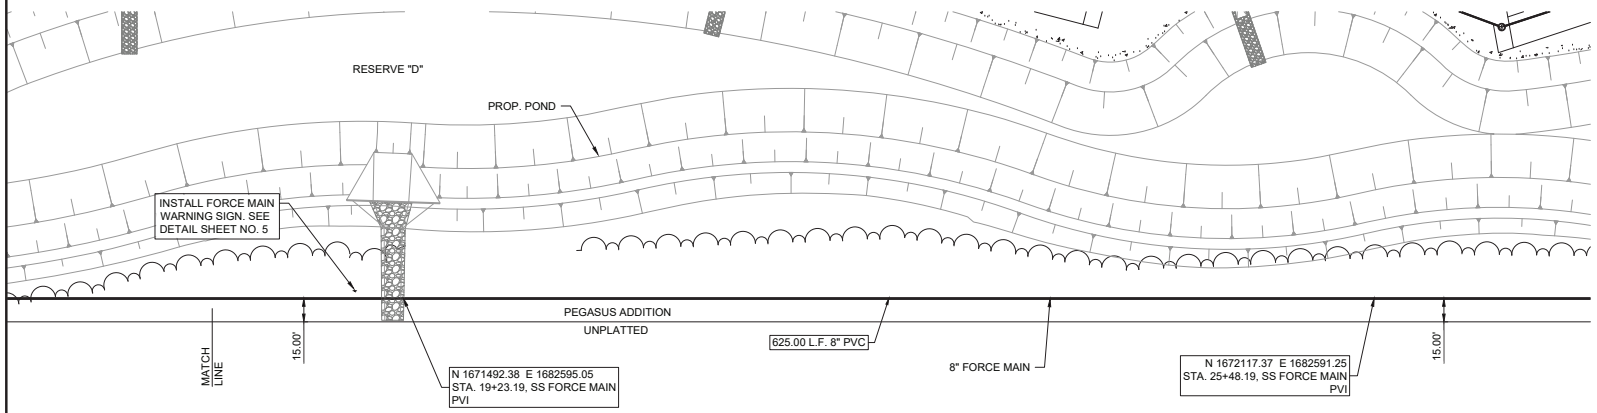

NOTE:
ALL BENDS OVER 11.25° SHALL EITHER HAVE REACTION BLOCKING OR SHALL BE RESTRAINED JOINTS.

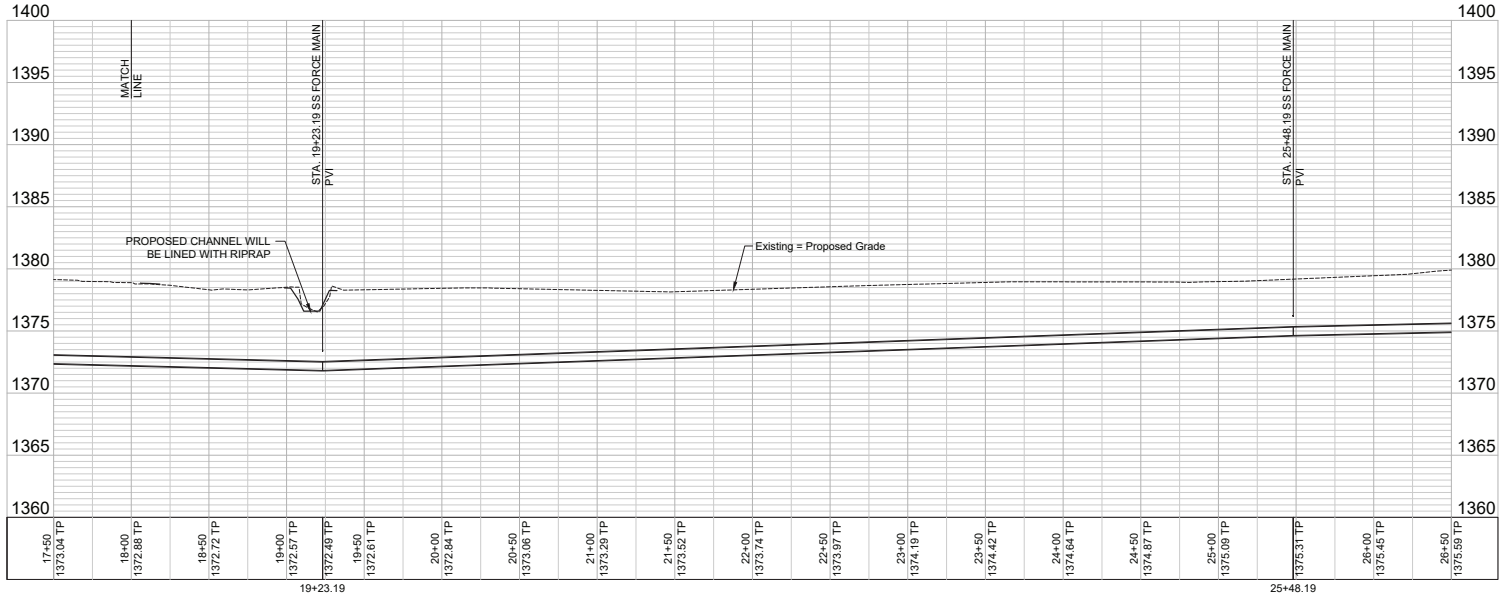

N

0 20' 40' 80' 120'
(IN FEET)

VERTICAL

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

EJG 19744 2-28-25 KANSAS PROFESSIONAL ENGINEER

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN
(3 OF 5)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS


BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER

SHEET NUMBER 11 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\FORCE MAIN 3 OF 5.dwg Last Save: 2/6/2025 11:38 AM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R Plot Style: — Plot Scale: 1:2.5644 Plot Date: 2/11/2025 3:21 PM Plotter used: None

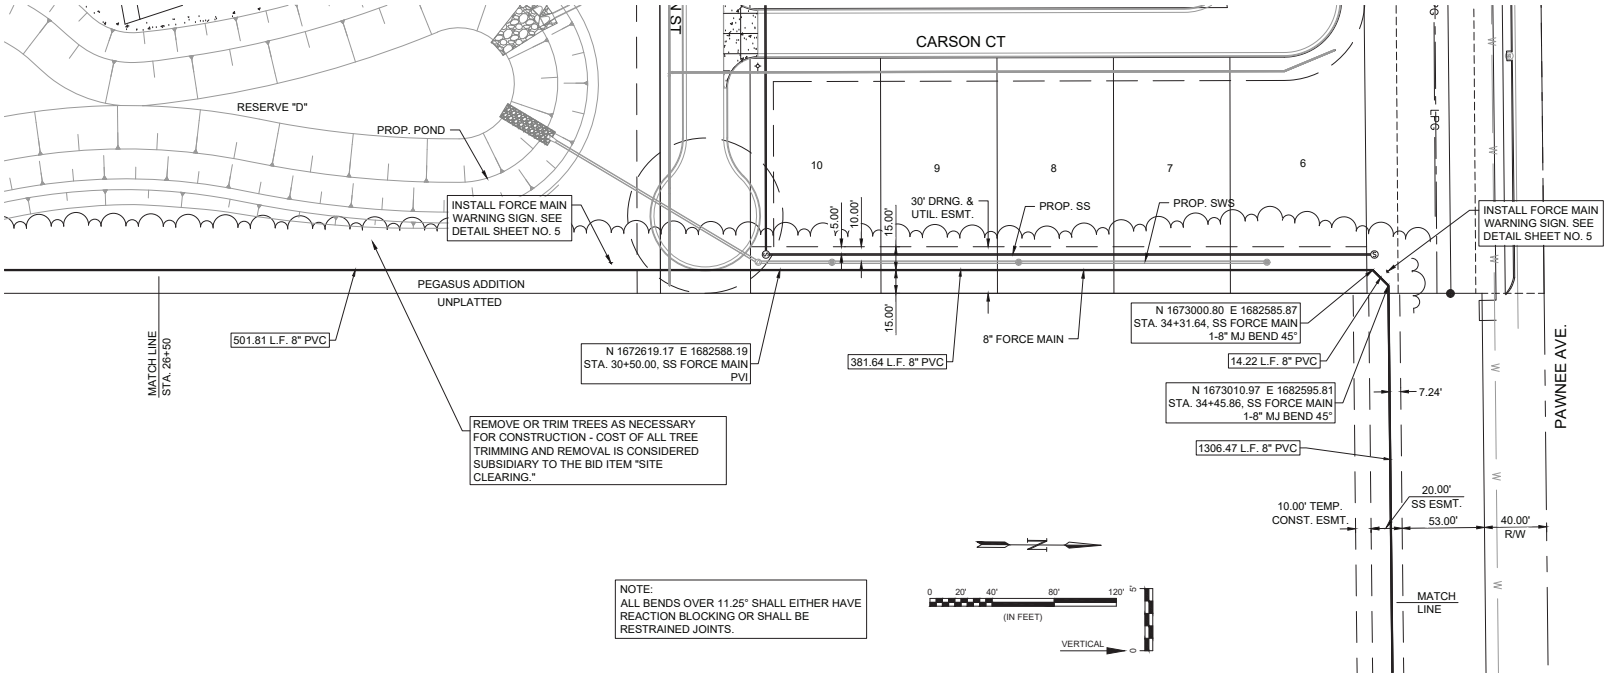

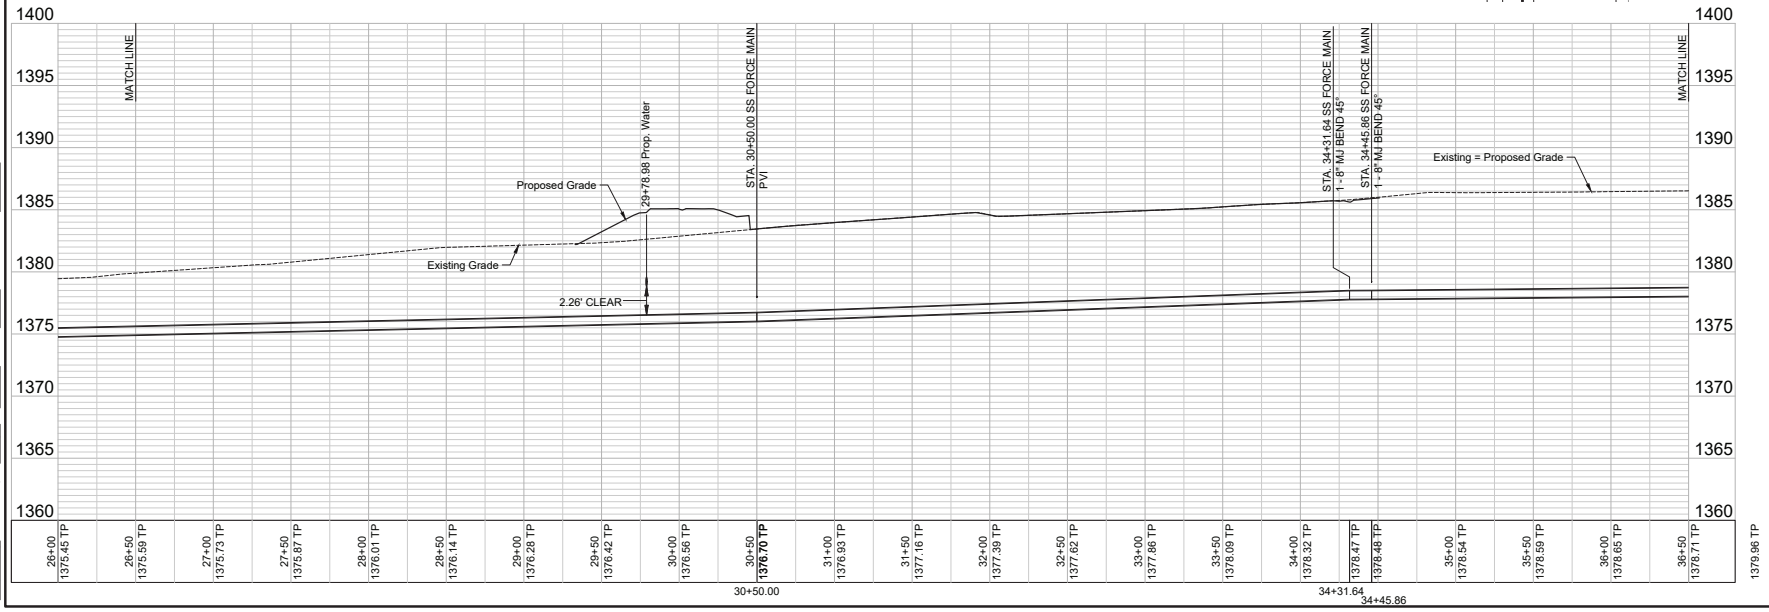

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

ERIC JOHN GLEICH
Current Date
24-25
PROFESSIONAL ENGINEER

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN
(4 OF 5)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS


BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER

SHEET NUMBER 12 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\FORCE MAIN 4 OF 5.dwg Last Save: 2/6/2025 11:39 AM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R Plot Style: — Plot Scale: 1:2.5644 Plot Date: 2/7/2025 3:21 PM Plotter used: None

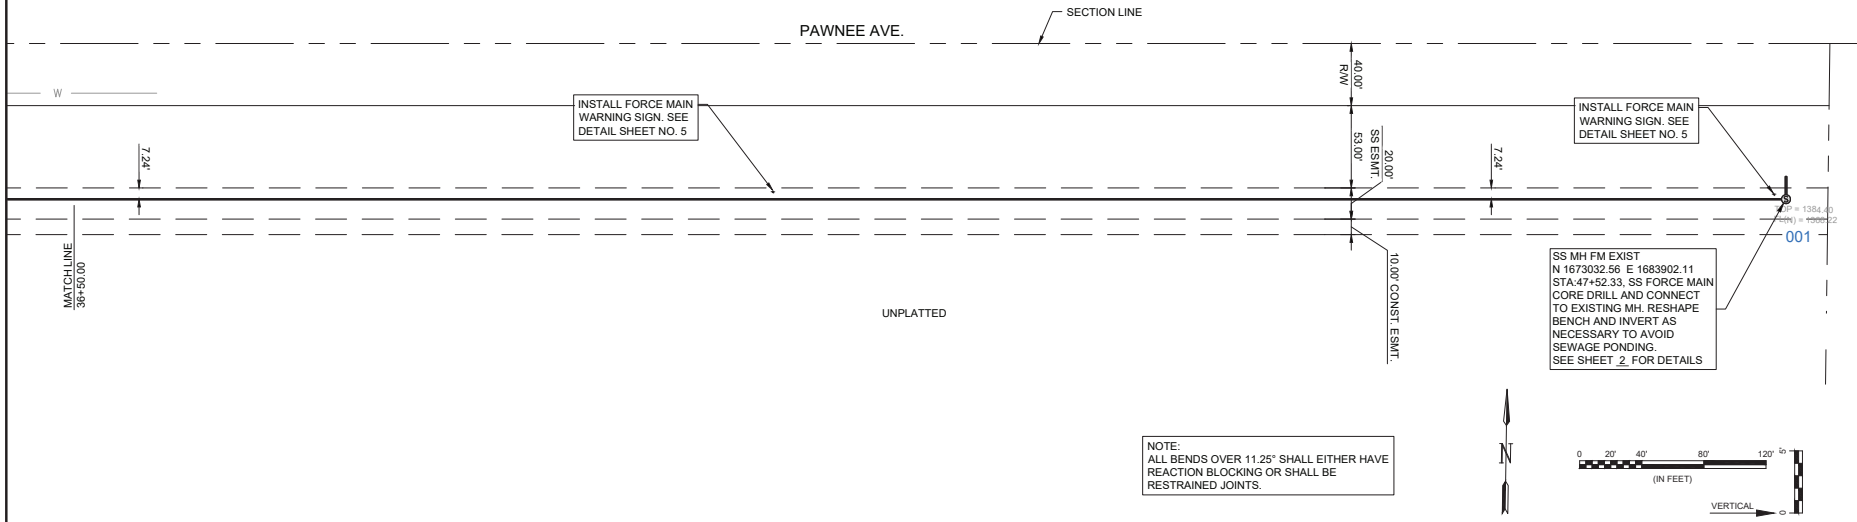

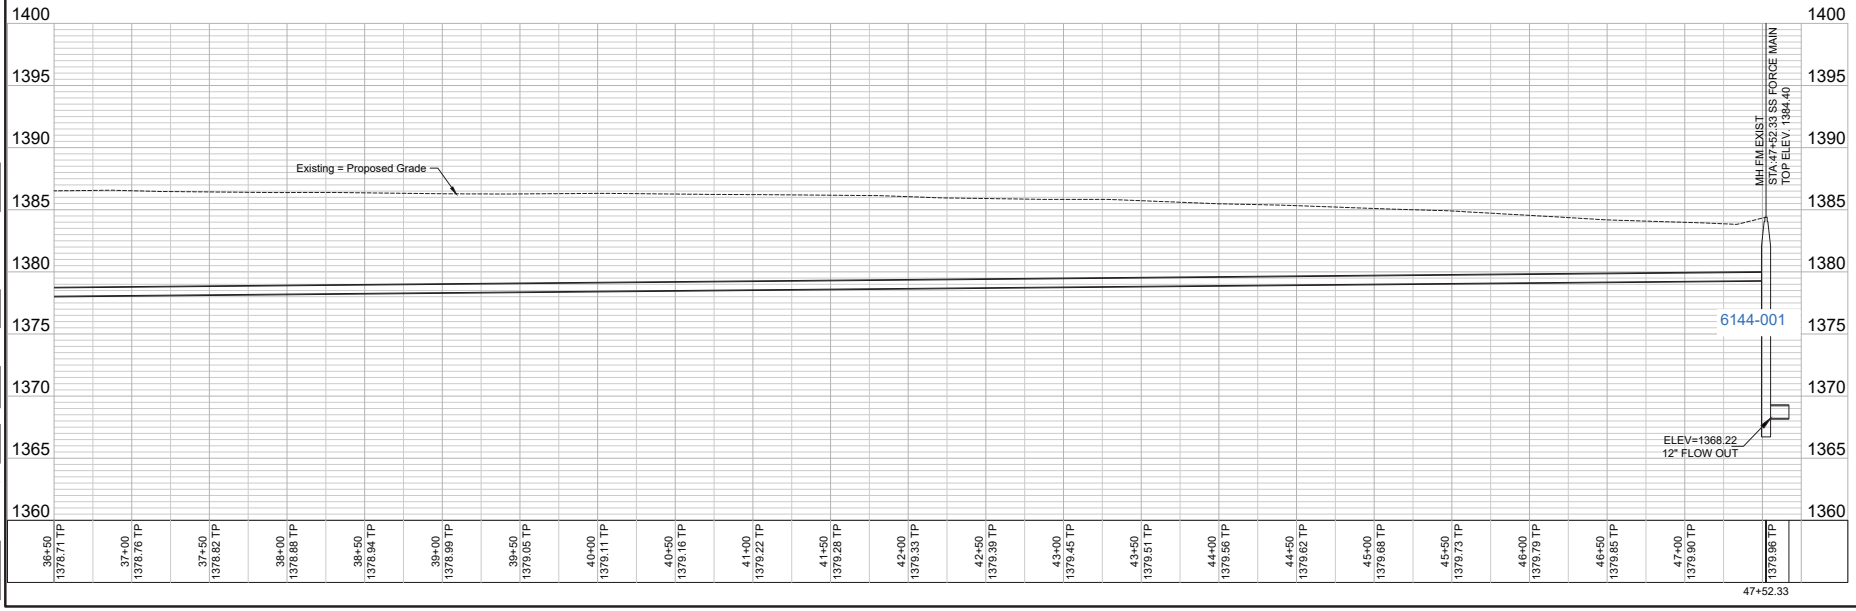

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN
(5 OF 5)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER

SHEET NUMBER 13 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\FORCE MAIN 5 OF 5.dwg Last Save: 2/6/2025 11:40 AM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R. Plot Style: — Plot Scale: 1:2.5644 Plot Date: 2/11/2025 3:22 PM Xrefs used: None

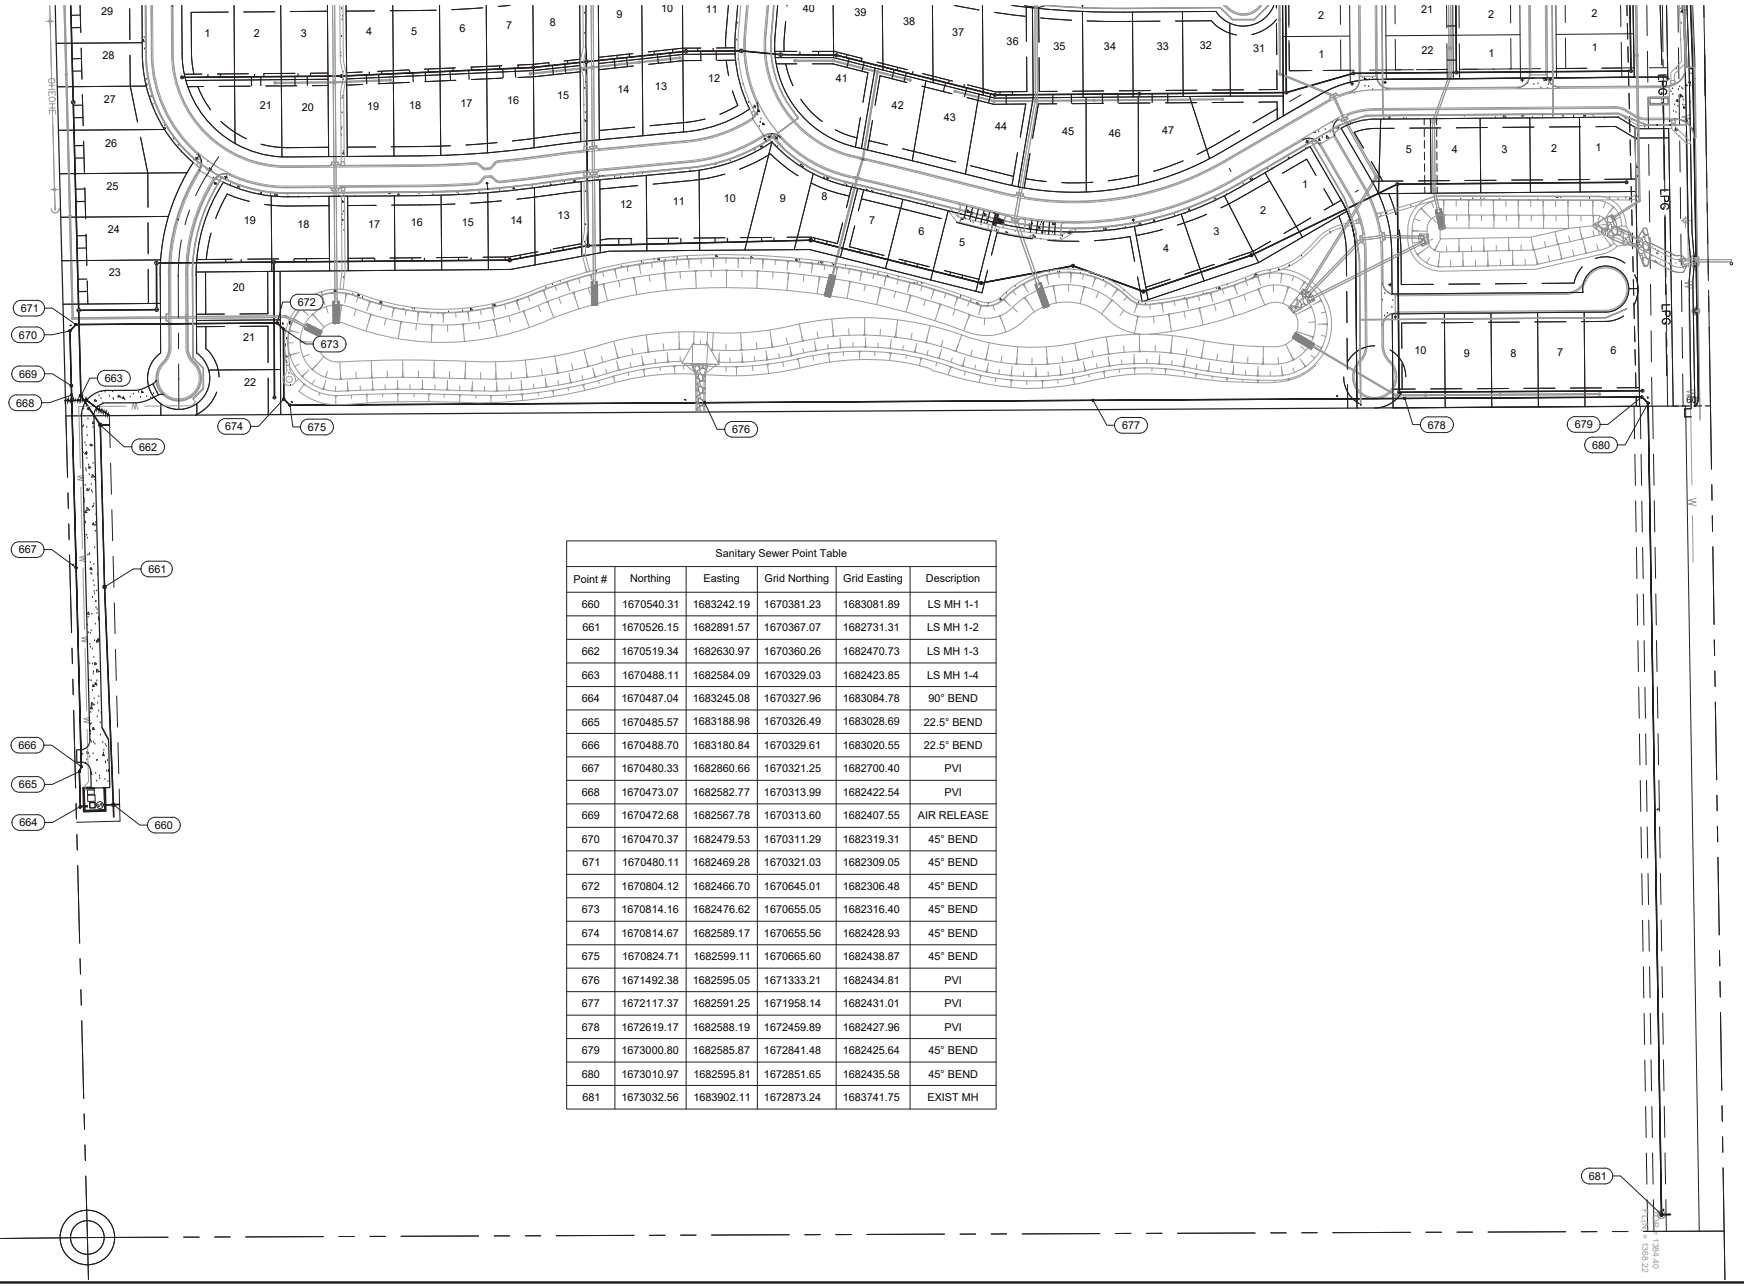

Sanitary Sewer Point Table					
Point #	Northing	Easting	Grid Northing	Grid Easting	Description
660	1670540.31	1683242.19	1670381.23	1683081.89	LS MH 1-1
661	1670526.15	1682891.57	1670367.07	1682731.31	LS MH 1-2
662	1670519.34	1682630.97	1670360.26	1682470.73	LS MH 1-3
663	1670488.11	1682584.09	1670329.03	1682423.85	LS MH 1-4
664	1670487.04	1683245.08	1670327.96	1683084.78	90° BEND
665	1670485.57	1683188.98	1670326.49	1683028.69	22.5° BEND
666	1670488.70	1683180.84	1670329.61	1683020.55	22.5° BEND
667	1670480.33	1682860.66	1670321.25	1682700.40	PVI
668	1670473.07	1682582.77	1670313.99	1682422.54	PVI
669	1670472.68	1682567.78	1670313.60	1682407.55	AIR RELEASE
670	1670470.37	1682479.53	1670311.29	1682319.31	45° BEND
671	1670480.11	1682469.28	1670321.03	1682309.05	45° BEND
672	1670804.12	1682466.70	1670645.01	1682306.48	45° BEND
673	1670814.16	1682476.62	1670655.05	1682316.40	45° BEND
674	1670814.67	1682589.17	1670655.56	1682428.93	45° BEND
675	1670824.71	1682599.11	1670665.60	1682438.87	45° BEND
676	1671492.38	1682595.05	1671333.21	1682434.81	PVI
677	1672117.37	1682591.25	1671958.14	1682431.01	PVI
678	1672619.17	1682588.19	1672459.89	1682427.96	PVI
679	1673000.80	1682585.87	1672841.48	1682425.64	45° BEND
680	1673010.97	1682595.81	1672851.65	1682435.58	45° BEND
681	1673032.56	1683902.11	1672873.24	1683741.75	EXIST MH

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV | DATE | DESCRIPTION | BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

FORCE MAIN COORDINATES


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: .
DRAWN BY: .

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
-

SHEET NUMBER 14 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings\T41-2400521-COORDINATES.dwg Last Save: 2/3/2025 1:18 PM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R Plot Style: — Plot Scale: 1:2.0849 Plot Date: 2/11/2025 3:23 PM Xrefs used: None

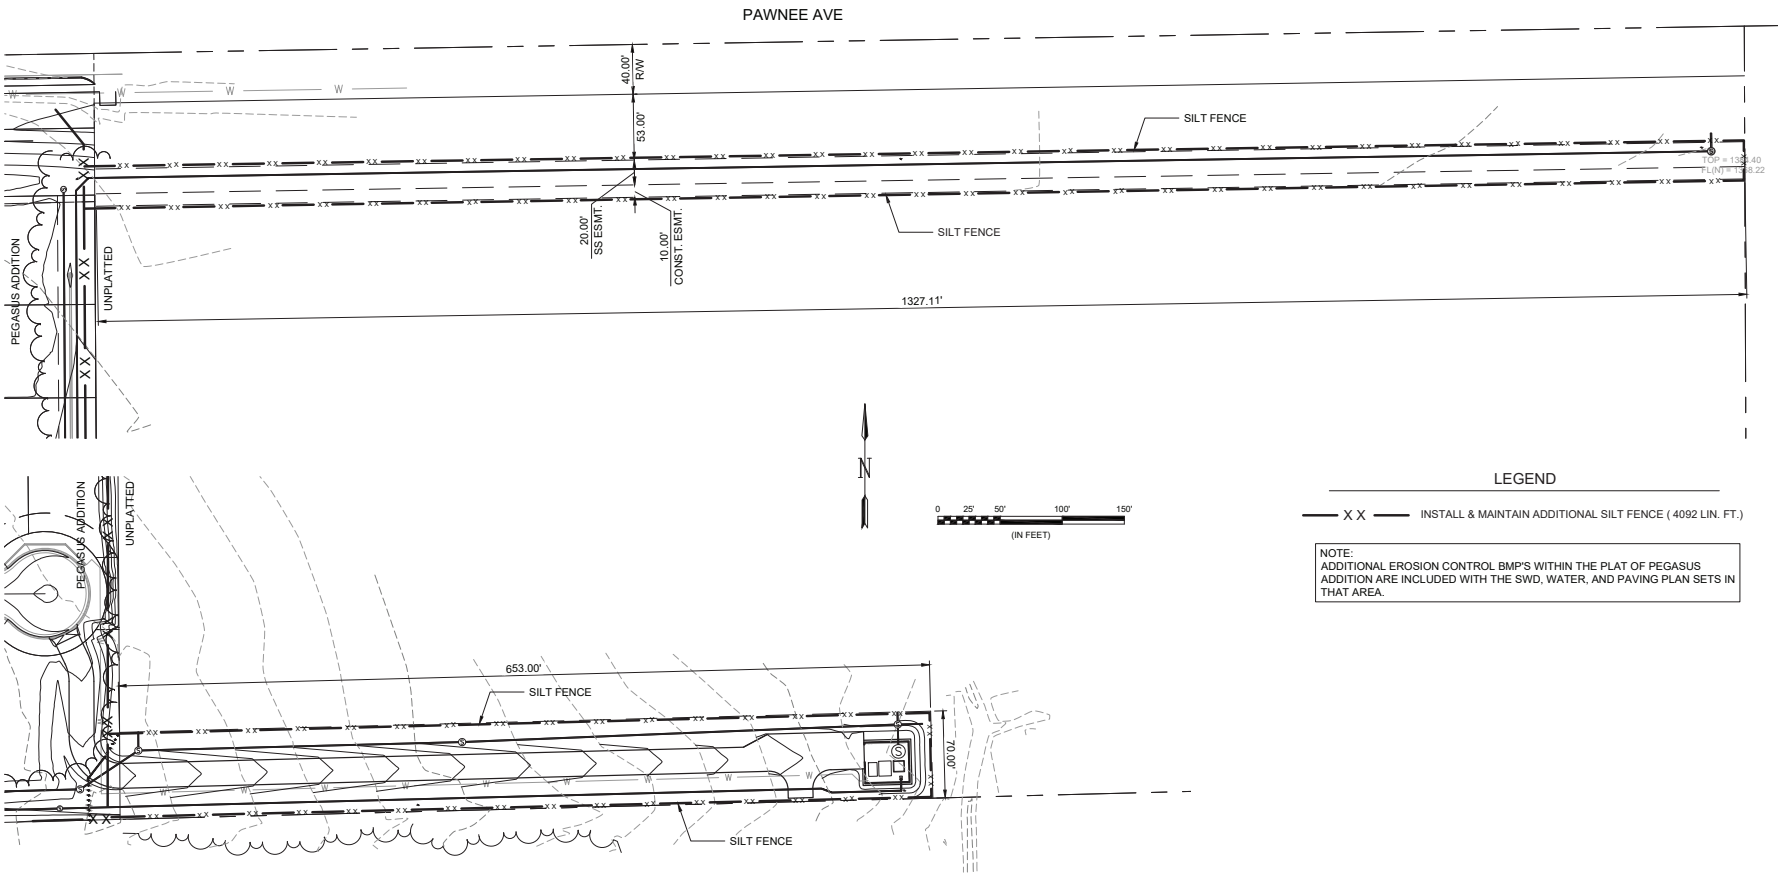

LEGEND

XX INSTALL & MAINTAIN ADDITIONAL SILT FENCE (4092 LIN. FT.)

NOTE:
ADDITIONAL EROSION CONTROL BMP'S WITHIN THE PLAT OF PEGASUS ADDITION ARE INCLUDED WITH THE SWD, WATER, AND PAVING PLAN SETS IN THAT AREA.

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV.	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

EROSION CONTROL PLAN


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: .
DRAWN BY: .

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.


DRAWING NUMBER
-

SHEET NUMBER 15 OF 38


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings\T41-2400521-EROSION CONTROL.dwg Last Save: 1/31/2025 12:45 PM Last saved by: DRSandrich
Last edited by: Sandrich, Daryl R Plot Style: — Plot Scale: 1:2.0849 Plot Date: 2/11/2025 3:23 PM Plotter used: None

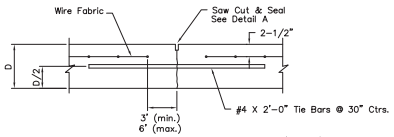


LONGITUDINAL JOINT DETAIL (L.J.)

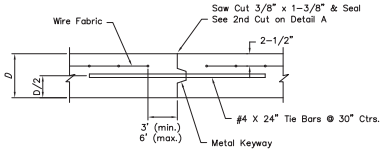


OPT. LONGITUDINAL JOINT DETAIL (L.J.)



CONTRACTION JOINT DETAIL (C.J.)

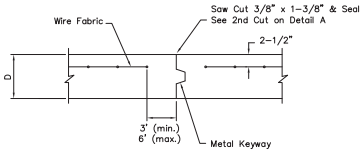


OPTIONAL CONTRACTION JOINT




EXPANSION (ISOLATION) JOINT

NOTE: Extra Thickness to be Subsidiary to Price of Square Yards Pavement

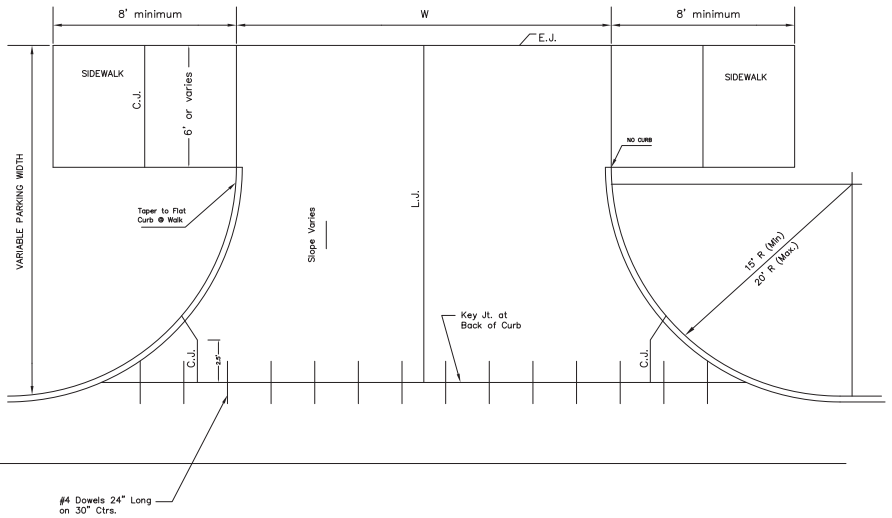


Use Ramp-Type Approach when distance between fc. wk. & bk. cb. is 8'-0" or less. Where parking width is 8'-0" or less ramp shall be constructed full width.


ALLEY APPROACH DETAIL

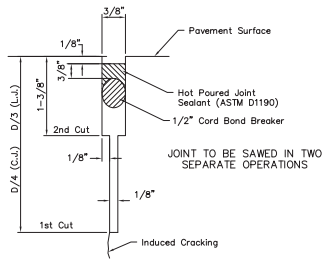


SAW JOINT DETAIL
(Detail A)

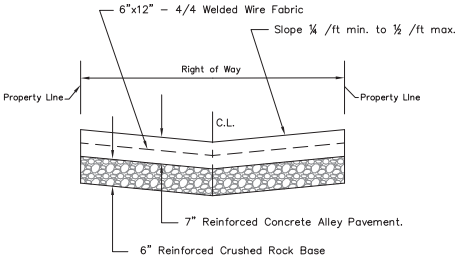

TYPICAL PAVEMENT SECTION

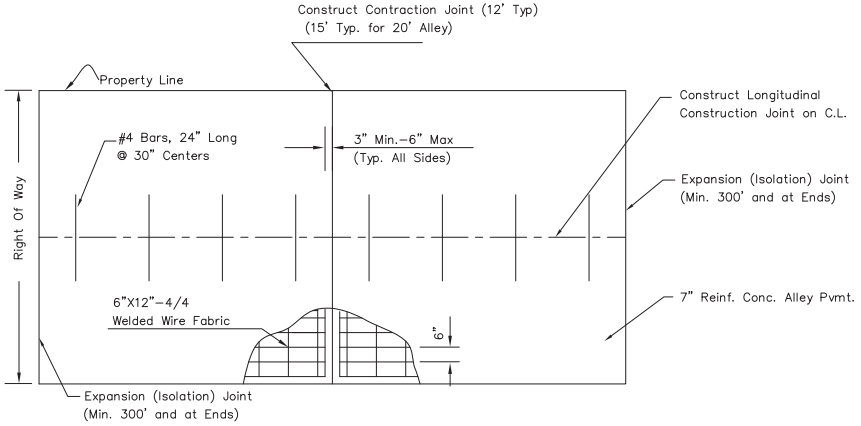

SLAB REINFORCEMENT DETAIL



KEYWAY DETAIL

REVISED: NOVEMBER 2015

CITY OF WICHITA

PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

REINFORCED CONCRETE ALLEY PAVING DETAIL


CITY ENGINEER
GARY JANZEN, P.E.


PROJECT NUMBER	OCA NUMBER	DATE

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET
15A

PV-108

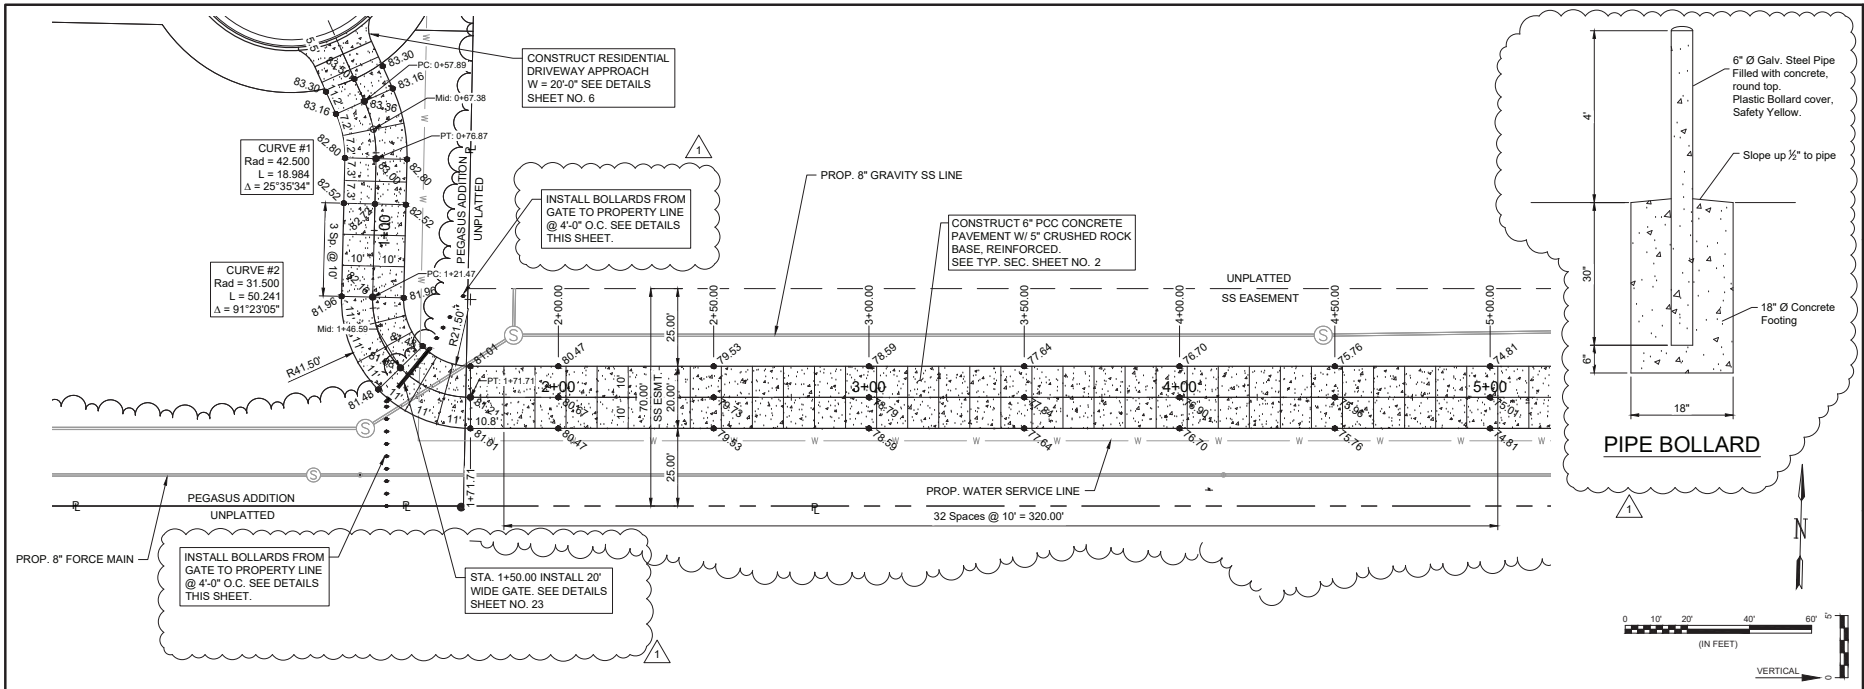

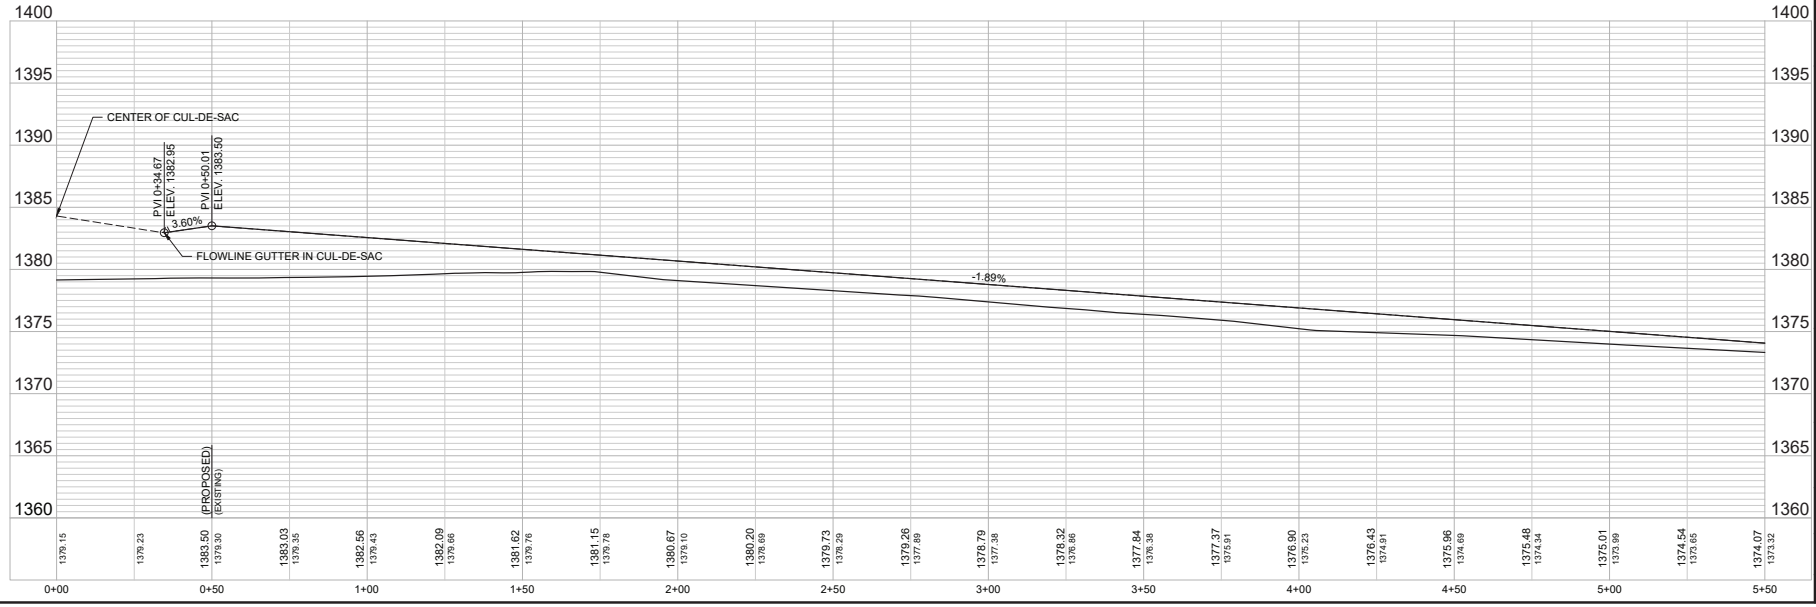

GARVER
1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

REV	DATE	DESCRIPTION	BY
1	5/8/2025	ADDED BOLLARD DETAIL & SHT NUMBER FOR GATE DETAIL	DRS

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

LIFT STATION
ROAD (1 of 2)


JOB NO.: 2400521
DATE: MAY 2025
DESIGNED BY: EJG
DRAWN BY: DRS


BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER

SHEET NUMBER 16 OF 38

File: L:\2024\T41\2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\LIFT STATION ROAD 1-2.dwg Last Save: 5/8/2025 4:13 PM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R. Plot Style: — Plot Scale: 1:2.5849 Plot Date: 5/8/2025 4:13 PM Plotter Used: None

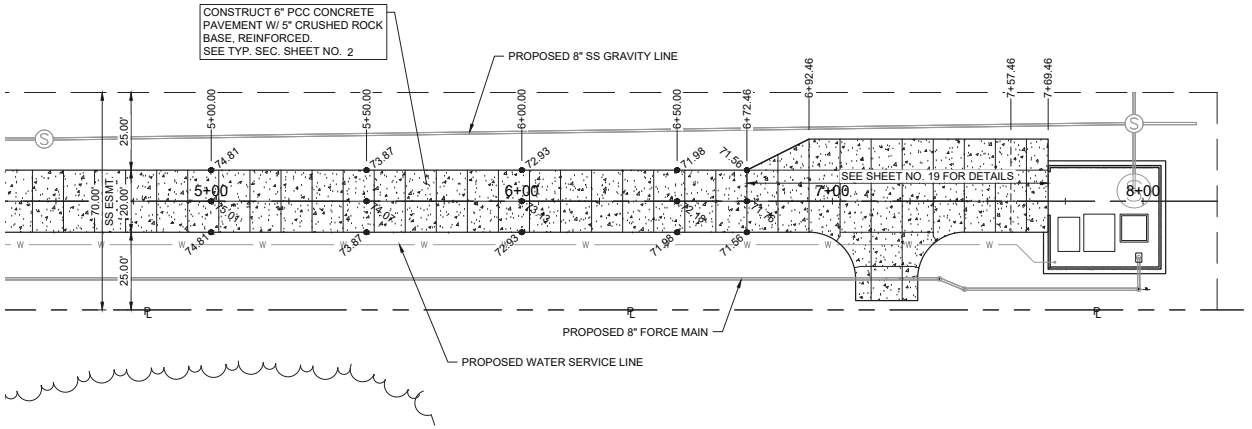



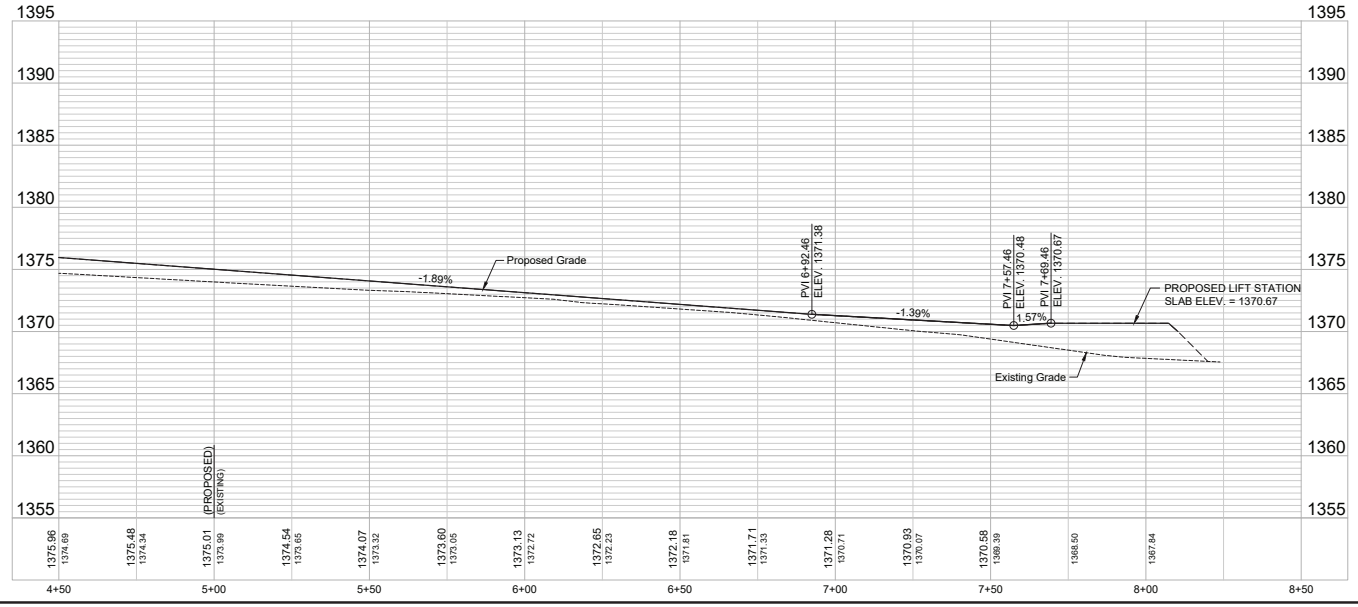

File: L:\2024\T41\2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\LIFT STATION ROAD 2-2.dwg Last Save: 12/19/2024 12:53 PM Last saved by: DRSlandrich
Last plotted by: Slandrich, Daryl R Plot Style: — Plot Scale: 1:2.5648 Plot Date: 2/11/2025 3:24 PM Plotter used: None

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)


LIFT STATION
ROAD (2 of 2)


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
-

SHEET NUMBER 17 OF 38

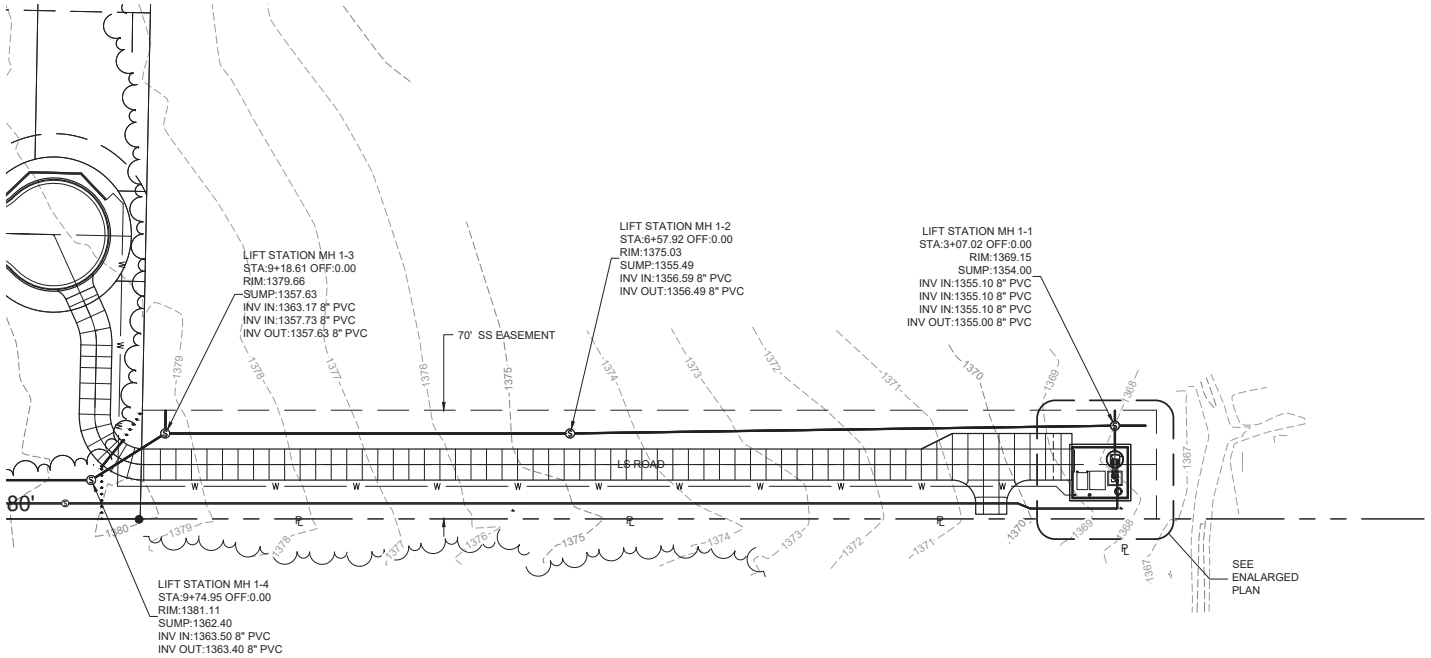



NOTES

1. THE PRICES BID ON THE BID FORM FOR FURNISHING AND INSTALLING THE LIFT STATION, INCLUDING THE WET WELL, VALVE VAULT, AND OTHER MISCELLANEOUS APPURTENANCES, SHALL INCLUDE ALL COSTS FOR FURNISHING AND INSTALLING THE LIFT STATION AS INDICATED IN THE PLANS COMPLETE IN PLACE AND IN OPERATION. THIS PRICE SHALL INCLUDE BUT NOT BE LIMITED TO THE COST OF CONSTRUCTING AND/OR INSTALLING: COMPACTED SUBGRADE, CONCRETE PAVEMENT, ELECTRICAL CONDUIT, ELECTRICAL WIRING, DISCONNECT SWITCH, PUMP CONTROLS, ELECTRICAL POWER SUPPLY, FINISHED GRADING, LANDSCAPING, FENCING, AND ANY OTHER INCIDENTALS NECESSARY TO COMPLETE THE WORK AND PLACE THE LIFT STATION INTO SATISFACTORY OPERATION. THE PRICE BID SHALL INCLUDE ALL SANITARY SEWER PIPE AND FORCE MAIN EXTENDED OUTSIDE THE SLAB AS SHOWN IN THE SITE PLAN AND DETAILS.
2. ALL PROCESS PIPING ON THE LIFT STATION SITE SHALL BE DUCTILE IRON WITH P401 EPOXY LINING.
3. PIPE PENETRATIONS THROUGH THE WET WELL, VALVE VAULT, AND CONCRETE PAD SHALL BE GROUTED WATERTIGHT WITH NON-SHRINK GROUT AND WATER STOP GASKETS OR LINK SEAL, AS REQUIRED.
4. THE CONTRACTOR SHALL PERFORM AN EXFILTRATION TEST ON THE COMPLETE WET WELL. THE WET WELL SHALL BE TESTED INDIVIDUALLY BY SECURELY PLUGGING ALL INLET AND OUTLET PIPES. THE WET WELL SHALL BE FILLED TO ITS FULL DEPTH AND THEN OBSERVED FOR AT LEAST SIX HOURS. EXFILTRATION LOSS FROM THE 10-FOOT DIAMETER WET WELL SHALL NOT EXCEED THE RATE OF 2.5 GALLONS PER FOOT OF WET WELL DEPTH PER DAY. IF EXFILTRATION EXCEEDS THE MAXIMUM LIMITS, THE CONTRACTOR SHALL REPAIR THE LEAKS AND DEFECTS, AND THEN RETEST.
5. THE CONTRACTOR TO INSTALL PERMANENT PIPE SUPPORTS.
6. ALL HARDWARE INSIDE THE WETWELL AND VALVE VAULT, INCLUDING BUT NOT LIMITED TO THE GUIDE BAR, HOIST CHAIN, CHAIN CATCH, HOOKS, NUTS, BOLTS, ETC. SHALL BE STAINLESS STEEL. NYLON ROPE WILL NOT BE ALLOWED IN THE WET WELL.
7. WET WELL AND VALVE VAULT DESIGN SHALL BE SUBJECT TO THE SAME DESIGN REQUIREMENTS AS PRECAST MANHOLES.
8. THE INTERIOR OF THE WET WELL SHALL BE COATED WITH A SANITARY SEWER MANHOLE EPOXY COATING PER SPECIFICATION SECTION 09 97 26.13
9. BACKFILL UNDER AND AROUND THE WET WELL AND UNDER THE VALVE VAULT AND PAD SHALL BE A LOW VOLUME CHANGE MATERIAL COMPACTED TO 95% ASTM D-1557.
10. ALL PIPING INSIDE WET WELL SHALL BE COATED IN ACCORDANCE WITH HIGH PERFORMANCE COATINGS SPECIFICATION 09 96 00.
11. THE CONTRACTOR SHALL COORDINATE WITH WESTAR ENERGY AND KANSAS GAS SERVICE TO EXTEND ELECTRIC AND GAS SERVICES TO THE PUMP STATION SITE. THE CONTRACTOR SHALL VERIFY THE ELECTRICAL AND GAS SERVICE COSTS & REQUIREMENTS PRIOR TO BIDDING. THE CONTRACTOR SHALL ALLOW A MINIMUM OF 3 WEEKS FOR THESE SERVICES TO BE COMPLETED. ALL COST INCURRED TO COORDINATE THESE SERVICES TO THE SITE SHALL BE INCIDENTAL TO OTHER ITEMS IN THE PROJECT.
12. THE CONTRACTOR SHALL VERIFY ALL REQUIREMENTS AND DIMENSIONS OF THE CONCRETE PADS FOR THE GENERATOR AND PRE-FAB CONTROL BUILDING PRIOR TO CONSTRUCTION.
13. NO ELECTRICAL CONNECTIONS WILL BE ALLOWED WITHIN THE WET WELL.
14. CONTACT THE CITY OF WICHITA SEWER TREATMENT PLANT AT (316) 303-8701 PRIOR TO LIFT STATION START-UP.
15. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMIT AND REVIEW FEES.
16. THE UTILITY SHELTER SHALL BE PAINTED TO BLEND IN WITH THE SURROUNDINGS AND PAINTED A COLOR THAT IS SELECTED AND APPROVED BY THE OWNER.
17. THE CONTRACTOR SHALL CONTACT THE WICHITA SEWER TREATMENT PLANT TO COORDINATE TYPE OF QUICK CONNECT TO BE USED.
18. THE CONTRACTOR SHALL VERIFY THAT THE VALVE VAULT HATCH SIZE IS ADEQUATE FOR EASY ACCESS TO EMERGENCY PUMPING CONNECTION.

GARVER

© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. NUNING LICENSED 25622 PROFESSIONAL ENGINEER 02/12/2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

OVERALL SITE PLAN


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
C-101

SHEET NUMBER 18 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRPelvin
Last plotted by: Shanahan, Daryl R Plot Style: -- Plot Scale: 1:2.545 Plot Date: 2/11/2025 3:26 PM Plotter Used: None

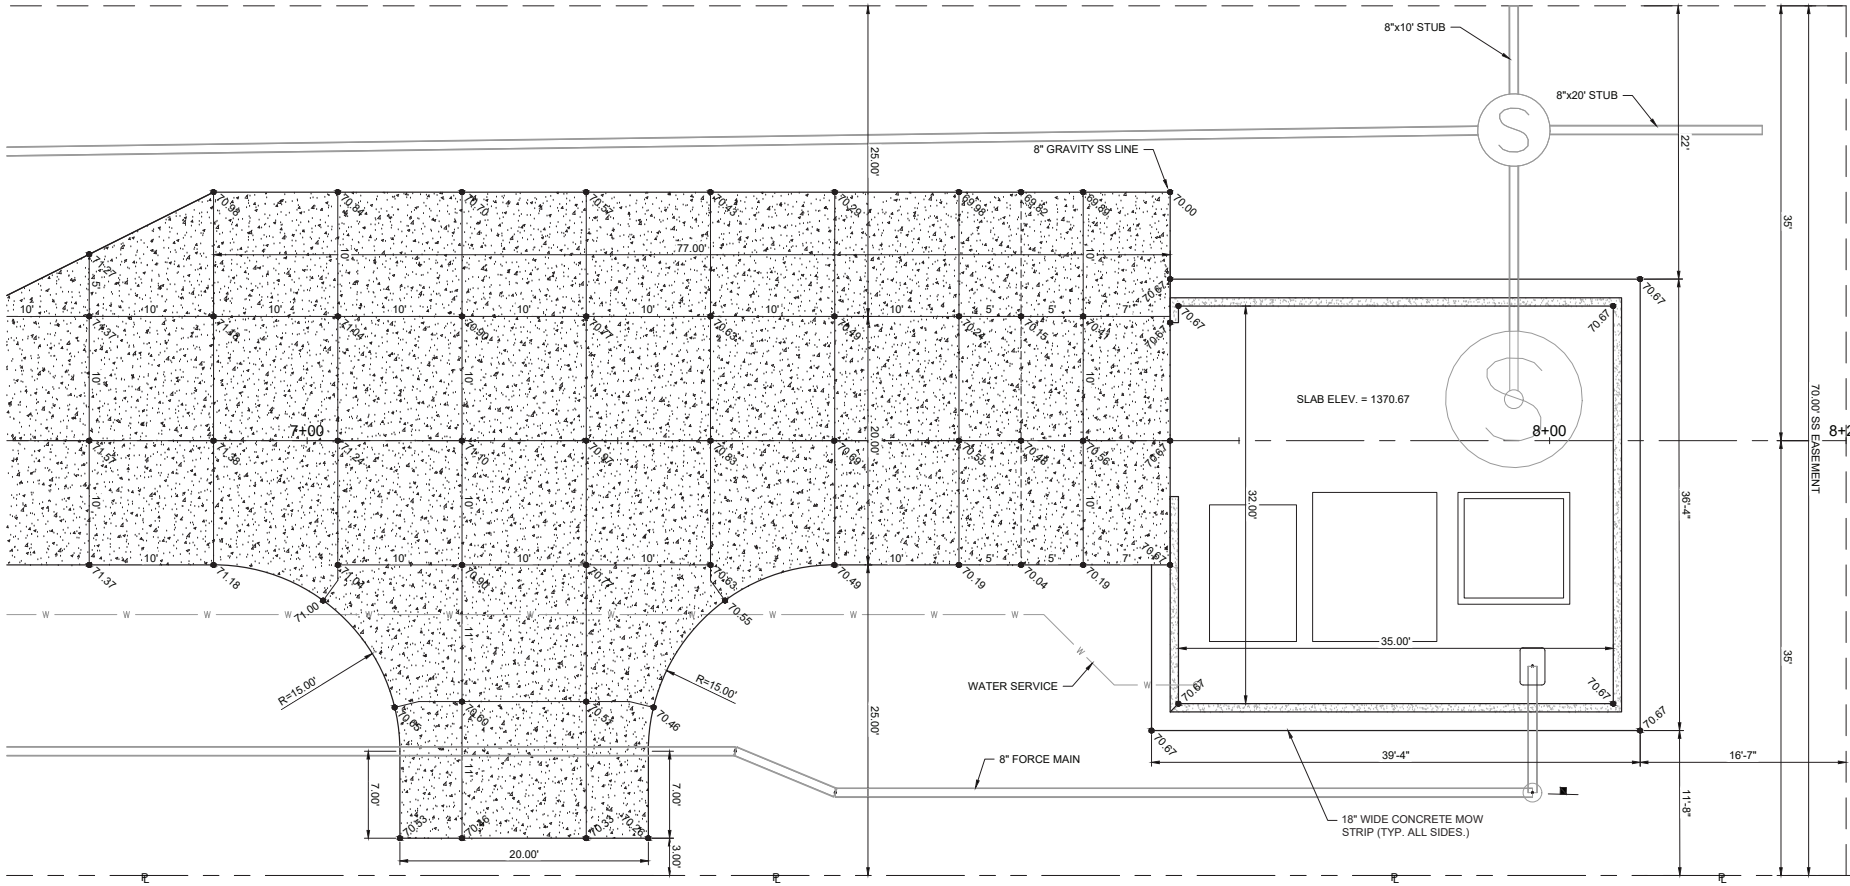

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

1995 Midfield Road
Wichita, KS 67209
(316) 264-8008

REV	DATE	DESCRIPTION
1		

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS ADDITION
LIFT STATION - FORCE MAIN
(LIFT STATION #71)

LIFT STATION PLAN


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: EJG
DRAWN BY: DRS

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
C-102

SHEET NUMBER 19 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\LIFT STATION PLAN.dwg Last Save: 12/19/2024 12:32 PM Last saved by: DRSandrich
Last plotted by: Sandrich, Daryl R Plot Styles: — Plot Scale: 1:2.5644 Plot Date: 2/11/2025 3:27 PM Plotter used: None

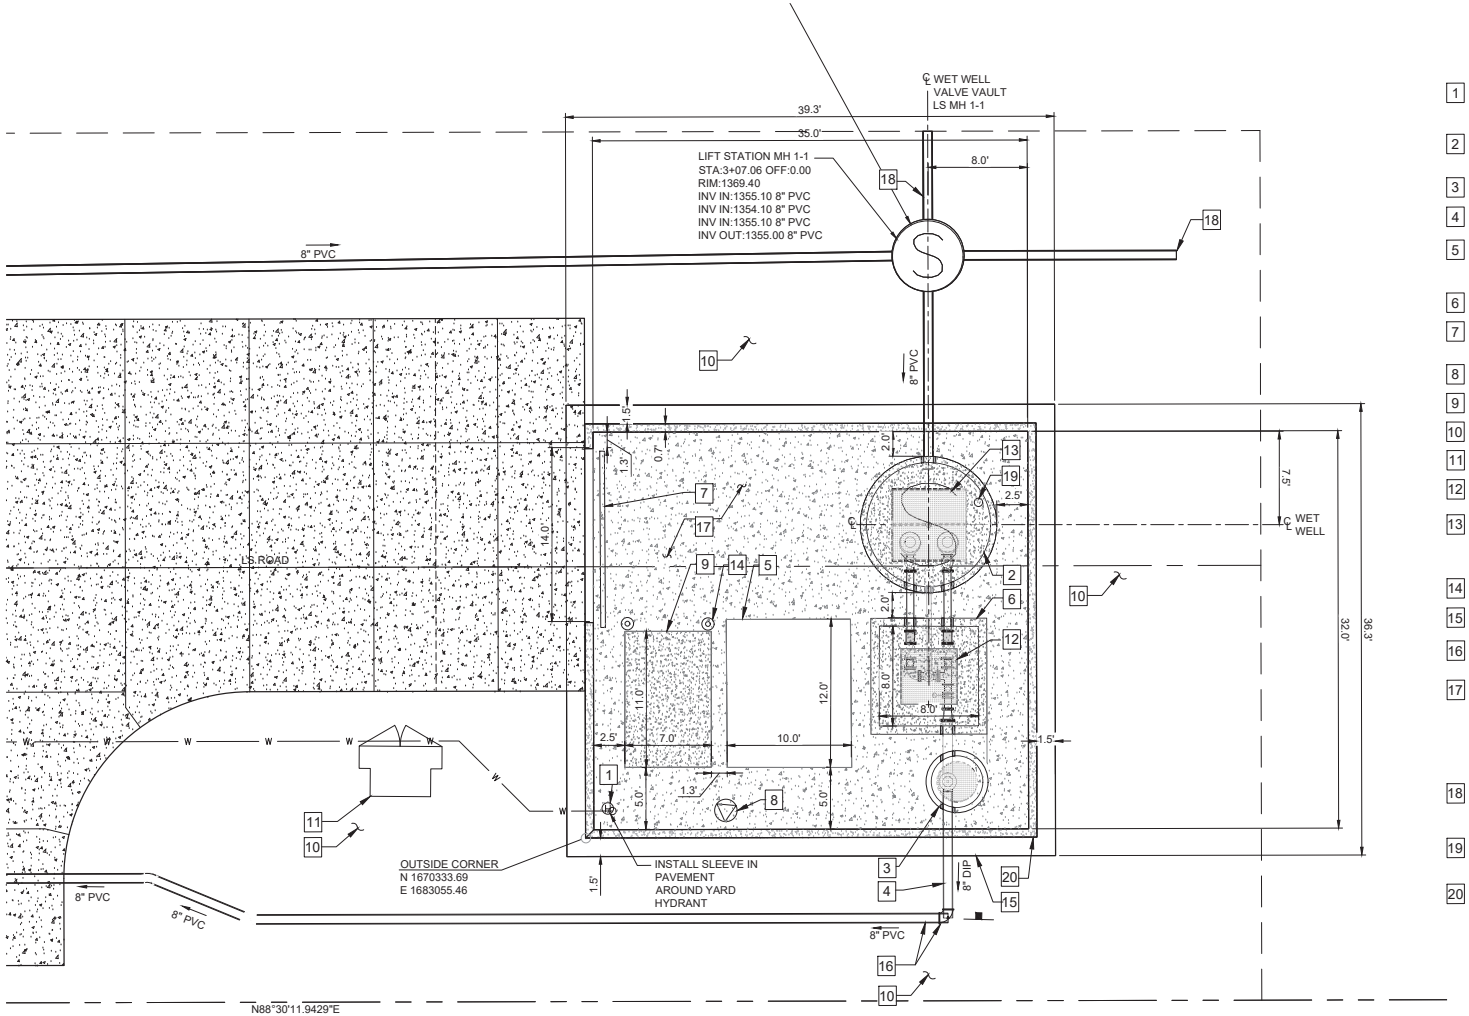

KEYNOTES

1. YARD HYDRANT, SEE DETAIL 1/C-501. CONTRACTOR TO COORDINATE ROUTING AND CONNECTION OF 1 INCH WATER SERVICE LINE WITH CITY OF WICHITA.
2. WET WELL, 10 FOOT INTERIOR DIAMETER PRE-CAST WITH EPOXY COATING IN ACCORDANCE WITH SPEC 09 97-23.
3. 4' ID PRECAST MANHOLE FOR ARV, SEE DETAIL 6/C-501
4. ALL DUCTILE IRON PIPE (DIP) TO BE RESTRAINED JOINT.
5. 10 X 12 CONTROL SHED AND CONCRETE PAD - JACOBS MANUFACTURING PRE FAB. TOP OF SLAB ELEVATION OF CONCRETE PAD TO BE SET 6" ABOVE GRADE,
6. PRECAST VALVE VAULT 8 X 8 X 8
7. 14' ACCESS GATE, SEE DETAIL 2/C-502
8. TELEMETRY TOWER, SEE ELECTRICAL DRAWINGS.
9. 11' X 7' GENERATOR PAD, SEE ELECTRICAL DRAWINGS.
10. SEE GRADING DRAWINGS FOR FINISHED GRADE.
11. NEW PAD MOUNTED TRANSFORMER WITH METER.
12. 54" X 54" DOUBLE LEAF HATCH - PEDESTRIAN RATED.
13. 6' X 4' DOUBLE LEAF HATCH - H20 TRAFFIC RATED W/ FIBERGLASS SAFETY GRATE (COMPOSITE/FIBERGLASS) CONTRACTOR TO SUPPLY TWO (2) D-RINGS CAST INTO WET WELL TOP FOR PERSONNEL TIE- OFF.
14. SAFETY BOLLARD, SEE DETAIL 7/C-501
15. MOW STRIP, SEE DETAIL 3/C-501
16. 8 INCH DIP FM TO 90°. PVC BY OTHERS BEYOND.
17. 8" THICK STEEL REINFORCED CONCRETE SLAB. TOC EL 1370.67. CONCRETE PAVING TO BE SLOPED TO CREATE POSITIVE STORM WATER WATER DRAINAGE OFF THE PAD SEE DETAIL. CONTRACTOR TO SUBMIT CONCRETE PAVING PLAN TO INCLUDE PROPOSED JOINTS. 3/C-503
18. FUTURE GRAVITY STUB OUTS TO INCLUDE CAPS. LENGTH OF STUB OUT TO BE COORDINATED WITH THE CITY OF WICHITA.
19. WET WELL VENT PIPE. SEE DETAIL. 1/C-502
20. SCREENING WALL, SEE DETAIL 1/C-504 FOOTER FOR SCREENING WALL TO BE MODIFIED IN THE VICINITY OF PRECAST STRUCTURES IF REQUIRED

N

0 2.5' 5' 10' 15'
(IN FEET)

GARVER

© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. HAZINEC — 25622 — LICENSED PROFESSIONAL ENGINEER — OKLAHOMA

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

SITE PLAN


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
C-103

SHEET NUMBER 20 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRNavin
Last plotted by: Shanahan, Daryl R Plot Style: — Plot Scale: 1:2.545 Plot Date: 2/11/2025 3:28 PM Plotter Used: None

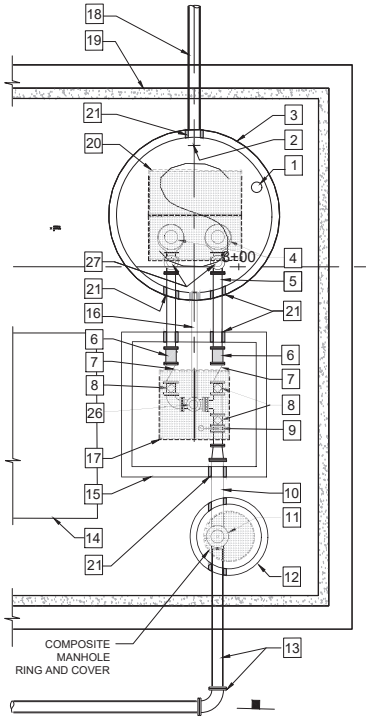

1 C-301 PLAN DETAIL
SCALE 1" = 4'-0"

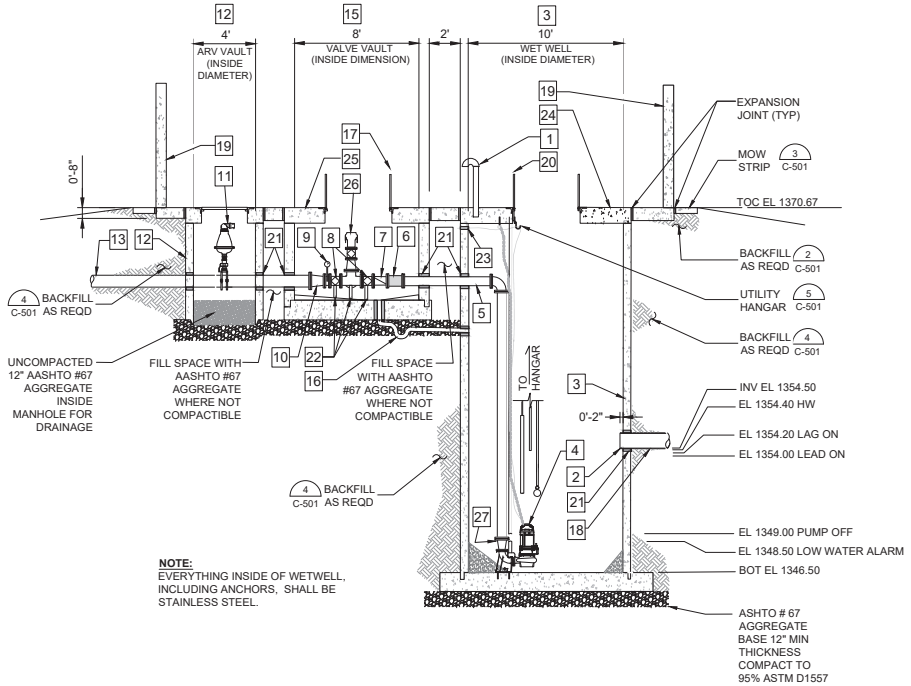


NOTE:
EVERYTHING INSIDE OF WETWELL, INCLUDING ANCHORS, SHALL BE STAINLESS STEEL.

A C-301 | C-301 SECTION - LIFT STATION - LOOKING WEST
SCALE: 1" = 4'-0"

KEYNOTES

1. VENT PIPE 01 C-502
2. 8 INCH GRAVITY SEWER. INV EL AT WET WELL CONNECTION = 1354.50. MAINTAIN 2" PROTRUSION INTO WETWELL
3. WET WELL PRE-CAST 10 '-0" INTERIOR DIAMETER. RIM EL= 1369.00 BOTTOM EL = 1346.50
4. KSB SUBMERSIBLE PUMPS (2) BOTTOM OF SUMP EL = = 1347.25 "KSB-KRT F100-254/224XEG-S 30HP, 460V, 215MM IMPELLER DESIGN CONDITION = 360 GPM @ 49' TDH. PUMP TO BE INSTALLED WITH ADEQUATE CLEAR SPACE OFF WET WELL FLOOR IN ACCORDANCE WITH MANUFACTURER REQUIREMENTS.
5. 6 INCH DIP DISCHARGE PIPING. ELEVATION EXITING WET WELL / INTO VALVE VAULT = 1364.00
6. 6 INCH DIP DISMANTLING JOINTS
7. 6 INCH CHECK VALVE
8. 6 INCH PLUG VALVE
9. PRESSURE GAUGE
10. 8 X 6 CONCENTRIC REDUCER
11. AIR RELEASE VALVE 06 C-501
12. ARV VAULT. 4' ID PRECAST MANHOLE 03 004
13. 8 INCH DIP FM TO 90°. PVC BY OTHERS BEYOND
14. 10 X 12 CONTROL SHED - JACOBS MANUFACTURING PRE FAB
15. PRECAST VALVE VAULT 8 X 6 X 8
16. 4 INCH DRAIN LINE FROM VAULT BACK TO WET WELL WITH DUCK BILL VALVE IN WET WELL
17. 54" x 54" PEDESTRIAN RATED ALUMINUM HATCH
18. 8" PVC FROM LIFT STATION MH 1-1
19. SCREENING WALL, SEE DETAIL 1 E-104 FOOTER FOR SCREENING WALL TO BE MODIFIED IN THE VICINITY OF PRECAST STRUCTURES IF REQUIRED.
20. 6' X 4' ALUMINUM HATCH - H20 TRAFFIC RATED W/ FIBERGLASS SAFETY GRATE
21. PIPE SEALS 05 C-502
22. PIPE SUPPORTS 04 C-502
23. TO PUMP CONTROL PANEL 1 E-104 5 C-501 SEE ELECTRICAL DETAIL
24. WET WELL LID SHOULD BE PRECAST WITH TOP ELEVATION OF 1371.00
25. VALVE BOX LID SHOULD BE PRECAST WITH TOP ELEVATION OF 1371.00
26. 4" FEMALE CAMLOCK EMERGENCY PUMPING CONNECTION. VERIFY IN FIELD COMPATIBILITY WITH PORTABLE CITY PUMP.
27. 6" X 4" CONCENTRIC REDUCER



GARVER
© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.



REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

PLAN DETAIL AND SECTION


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
C-104


SHEET NUMBER 21 OF 38


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRNelvin
Last plotted by: Shanahan, Daryl R Plot Style: — Plot Scale: 1:2.565 Plot Date: 2/11/2025 3:29 PM Plotter Used: None

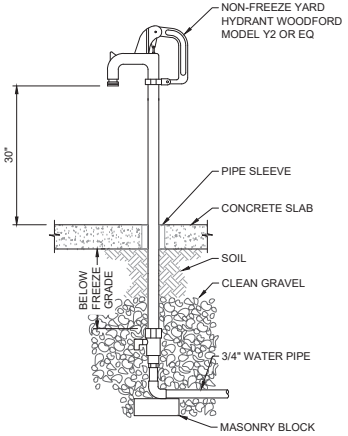



NOTES:


1. ALL YARD HYDRANTS SHALL BE PROVIDED WITH HOSE RACK.

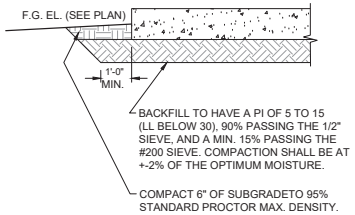

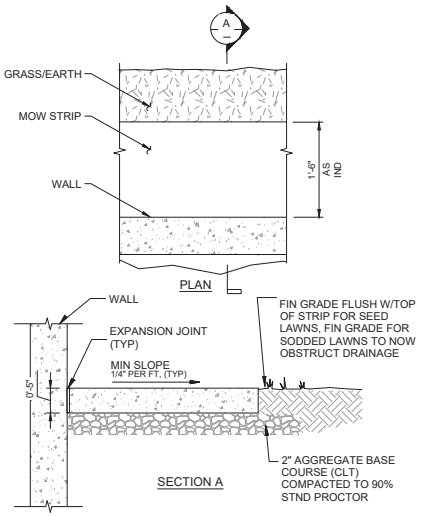

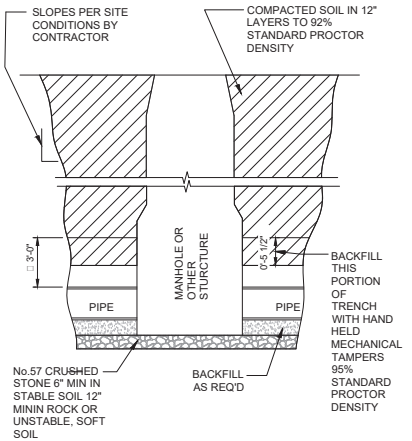


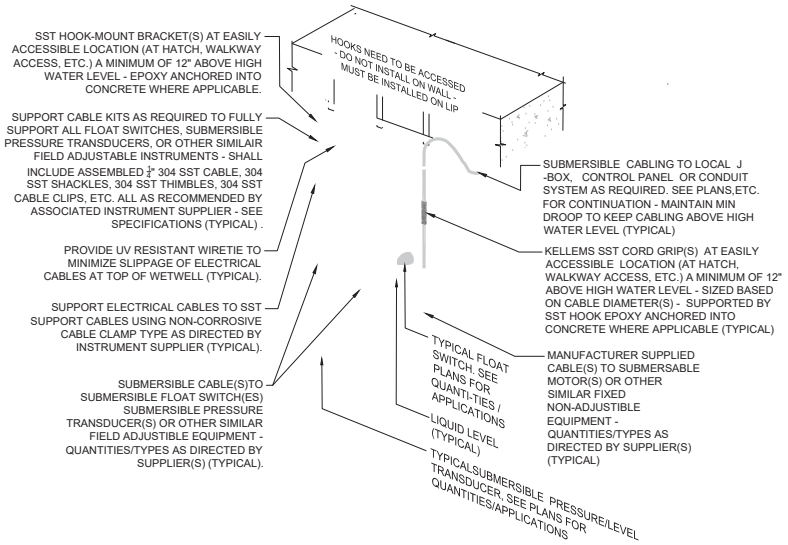

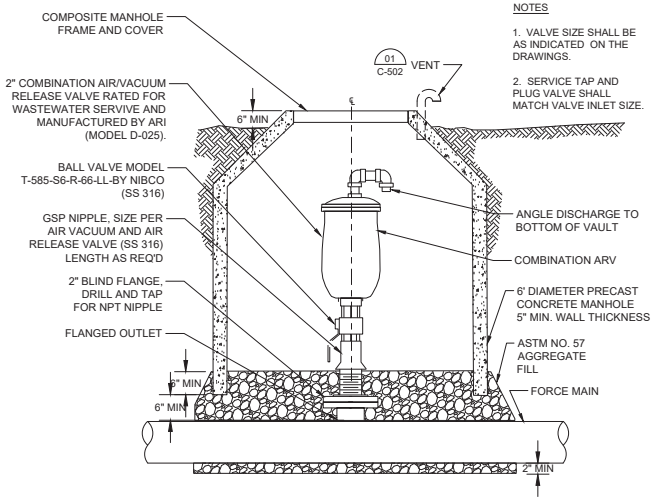

NOTES

1. VALVE SIZE SHALL BE AS INDICATED ON THE DRAWINGS.
2. SERVICE TAP AND PLUG VALVE SHALL MATCH VALVE INLET SIZE.

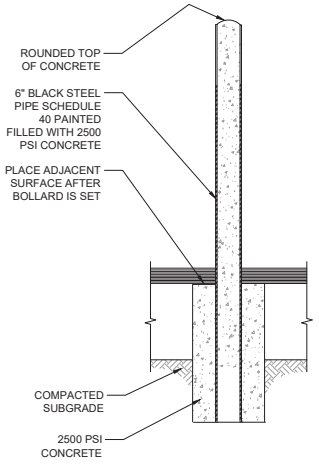

GARVER
© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. KUDNIG — 25022 — PROFESSIONAL ENGINEER — 02/14/2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

DETAILS I


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP


BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
C-501


SHEET NUMBER 22 OF 38


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRPatwin
Last plotted by: Shanahan, Daryl R. Plot Style: -- Plot Scale: 1:2.565 Plot Date: 2/11/2025 3:30 PM Plotter Used: None

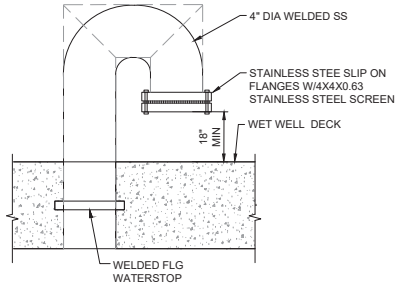



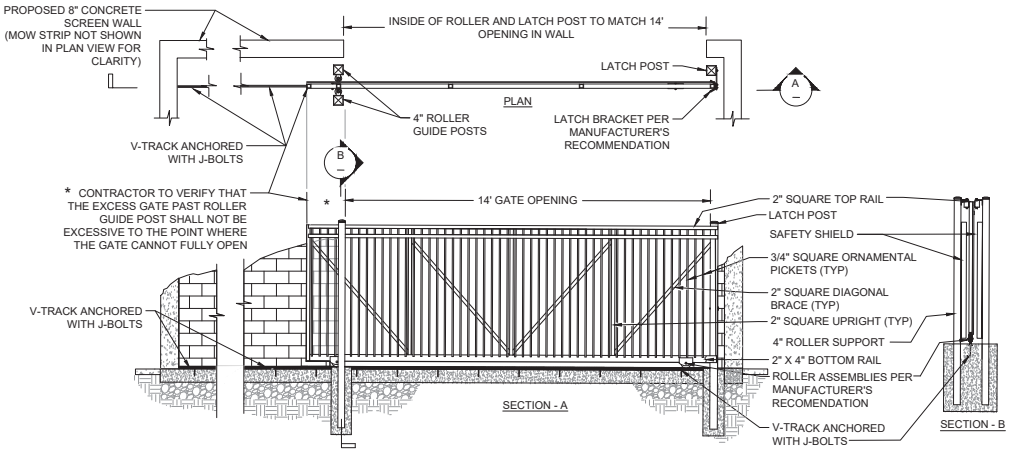


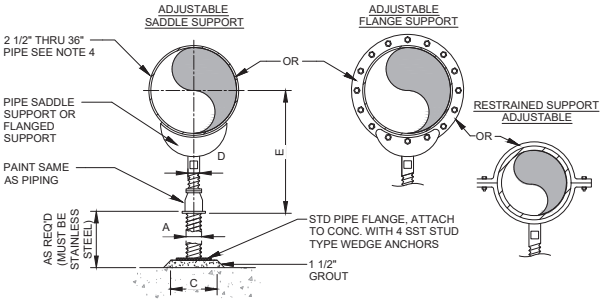

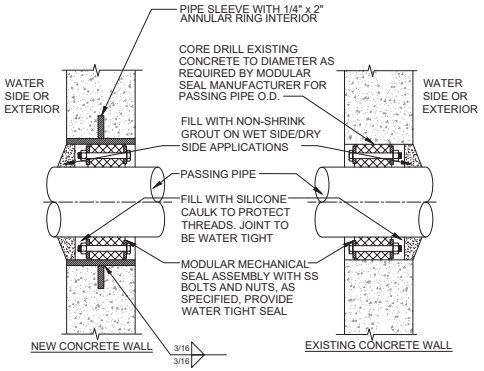

KEY NOTES:

1. 2" GATE FRAME (SQUARE OR ROUND) 11 GAUGE APPROVED COLOR - CHROME YELLOW.
2. 6" MINIMUM POST (SQUARE OR ROUND) . ROUND POST - SCHEDULE 40. SQUARE POST 1/4" STOCK. POSTS 7FT W/CAP. APPROVED COLOR - CHROME YELLOW.
3. 24' X 36" CONCRETE POST FOOTINGS.
4. SEALED 5" HEAVY DUTY BARREL HINGES (TYPICAL 2 PLACES).

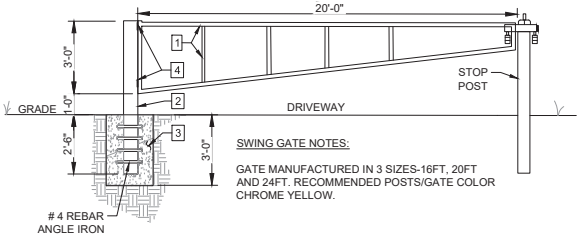

SWING GATE NOTES:

GATE MANUFACTURED IN 3 SIZES-16FT, 20FT AND 24FT. RECOMMENDED POSTS/GATE COLOR CHROME YELLOW.

DIMENSION TABLE						
PIPE SIZE	A	B	C	D	E	
					MIN	MAX
2-1/2"	2-1/2"	3-1/2"	6"	1-1/2"	8"	13"
3"	2-1/2"	3-3/4"	8"	1-1/2"	8-1/4"	13-1/4"
3-1/2"	2-1/2"	4"	8"	1-1/2"	8-1/2"	13-1/2"
4"	3"	4-1/4"	8"	2-1/2"	9-1/4"	14"
5"	3"	4-7/8"	8"	2-1/2"	10"	14-3/4"
6"	3"	5-1/2"	10"	2-1/2"	10-1/2"	15-1/4"
8"	3"	6-7/8"	10"	2-1/2"	11-3/4"	15-1/2"
10"	3"	8-1/2"	14"	2-1/2"	13-1/2"	18-1/4"
12"	3"	9-15/16"	18"	2-1/2"	15"	19-3/4"
14"	4"	10-15/16"	18"	3"	16-1/4"	20-3/4"
16"	4"	12-3/8"	20"	3"	17-3/4"	22-1/4"
18"	6"	13-7/8"	22"	3-1/2"	19-1/2"	24"
20"	6"	15-3/8"	22"	3-1/2"	21"	25-1/2"
24"	6"	17-15/16"	24"	4"	23-3/4"	28-1/4"
30"	6"	21-5/16"	30"	4"	27"	31-1/2"
32"	6"	22-1/2"	30"	4"	28-1/4"	32-3/4"
36"	6"	24-1/2"	30"	4"	30-1/4"	34-3/4"

NOTES:

1. PROVIDE HALF ROUND RIGID INSULATION AND INSULATION PROTECTION SHIELD WHERE PIPING IS INSULATED.
2. PROVIDE NEOPRENE WAFFLE INSULATION PAD, SIMILAR TO MASON TYPE "W" OR KORFUND 40, UNDER SUPPORT FOOT WHEN PIPING IS ISOLATED OR SUPPORT IS ADJACENT TO MECHANICAL EQUIPMENT.
3. FOR BASE, HEIGHT AND FLANGE DIMENSIONS, SEE TABLE.
4. USE 2 1/2" SUPPORTS FOR PIPES LESS THAN 2 1/2" DIAMETER.

NOTES:

1. WHERE EXISTING CONCRETE STRUCTURE IS TO BE CORE DRILLED, THE CONTRACTOR SHALL ULTRASONIC TEST OR X-RAY THE AREA FOR EMBEDDED ITEMS BEFORE CORE DRILLING CAN PROCEED. IF EMBEDDED ITEMS ARE FOUND, NOTIFY THE ENGINEER IMMEDIATELY.
2. FOR NEW CONSTRUCTION, SLEEVES SHALL BE CAST INTO WALL. BLOCKOUTS AND SUBSEQUENT GROUTED IN SLEEVES WILL NOT BE PERMITTED UNLESS A KEYED WATERSTOP JOINT IS PROVIDED.
3. 6" DIAMETER SLEEVES AND SMALLER SHALL BE SCHEDULE 40 STEEL PIPE.
4. SLEEVES LARGER THAN 6" DIAMETER SHALL BE 1/4" THICK STEEL PIPE.
5. IN WALLS THICKER THAN 12", LINK SEAL SHALL BE INSTALLED AT BOTH ENDS OF THE WALL SLEEVE. SLEEVE DIAMETER SHALL BE PER LINK SEAL MANUFACTURER'S RECOMMENDATION.
6. SLEEVE SHALL BE HOT-DIP GALVANIZED AFTER FABRICATION.
7. FOR NEW CONCRETE STRUCTURE WHERE AN EXISTING PIPE WILL PENETRATE A NEW CONCRETE WALL, SLEEVES SHALL BE SPLIT WALL SLEEVES WELDED AROUND THE EXISTING PIPE AND POSITIONED IN THE FORM TO CENTER THE PIPE. SLEEVE DIAMETER AND THICKNESS SHALL BE PER MANUFACTURER'S RECOMMENDATION.

GARVER

© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. NASHVILLE LICENSED 22622 PROFESSIONAL ENGINEER STATE OF KANSAS

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

DETAILS II


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
C-502

SHEET NUMBER 23 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRNelvin
Last plotted by: Shanahan, Daryl A Plot Style: -- Plot Scale: 1:2.565 Plot Date: 2/11/2025 3:31 PM Plotter Used: None



PLAN




NOTE:
CONCRETE MUST BE POURED AGAINST UNDISTURBED SOIL


SECTION A

TYPICAL CONCRETE BRACING FOR 45° BENDS

PIPE DIA.	A	B	C	D	E	MIN COVER
4"	4 1/2"	3 1/2"	1'-0"	6"	1'-1"	2'-6"
6"	4 1/2"	6 1/2"	9"	9"	1'-2"	2'-6"
8"	4 1/2"	10"	3"	1'-0"	1'-2"	2'-6"
10"	4 1/2"	1'-1 1/2"	-	1'-3"	1'-4"	3'-0"
12"	6"	1'-4 1/2"	-	1'-6"	1'-8"	3'-0"
14"	6"	1'-4 1/2"	-	1'-9"	1'-8"	3'-0"
16"	6"	1'-7"	-	2'-0"	1'-10"	3'-0"
18"	6"	1'-9 1/2"	-	2'-3"	2'-4"	3'-0"
20"	6"	1'-11"	-	2'-6"	2'-4"	3'-6"
24"	7"	2'-3"	-	3'-0"	2'-10"	3'-6"
30"	8"	2'-6"	-	3'-3"	2'-10"	4'-0"
36"	8"	2'-10"	-	3'-6"	3'-3"	4'-6"
48"	8"	3'-1"	-	3'-9"	3'-6"	4'-6"
54"	9"	3' 4"	-	4'-0"	4'-0"	5'-0"




PLAN




SECTION B

TYPICAL CONCRETE BRACING FOR TEES

PIPE DIA.	A	B	C	MIN COVER
4"	5"	5"	6"	2'-6"
6"	6"	8"	9"	2'-6"
8"	7"	1'-1"	1'-0"	2'-6"
10"	9"	1'-6"	1'-3"	3'-0"
12"	10"	1'-10"	1'-6"	3'-0"
14"	11 1/2"	1'-9"	1'-9"	3'-0"
16"	1'-0 1/2"	2'-0"	2'-0"	3'-0"
18"	1'-2"	2'-4"	2'-3"	3'-0"
20"	1'-3 1/2"	2'-6"	2'-6"	3'-6"
24"	1'-7 1/2"	3'-0"	3'-0"	3'-6"
30"	1'-10"	3'-4"	3'-9"	4'-0"
36"	2'-1"	3'-6"	4'-6"	4'-6"
48"	2'-7"	4'-0"	5'-0"	4'-6"
54"	3'-3"	4'-3"	5'-4"	5'-0"




PLAN




SECTION D

TYPICAL CONCRETE BRACING FOR 11 1/4° AND 22 1/2° BENDS


	22 1/2° BENDS				11 1/4° BENDS			
PIPE DIA.	A	B	C	MIN COVER	A	B	C	MIN COVER
4"	2"	1'-1"	4"	2'-6"	2"	1'-0"	3"	2'-6"
6"	4"	1'-0"	6"	2'-6"	2"	1'-0"	4"	2'-6"
8"	6"	1'-0"	8"	3'-0"	4"	1'-0"	5"	3'-0"
10"	8"	1'-1"	10"	3'-0"	5"	1'-0"	6"	3'-0"
12"	11"	1'-7"	1'-0"	5'-0"	6"	1'-0"	7"	3'-0"
14"	12"	2'-1"	1'-2"	5'-0"	8"	1'-0"	8"	3'-0"
16"	1'-1"	2'-5"	1'-8"	5'-0"	10"	1'-0"	9"	3'-0"
18"	1'-0"	2'-1"	1'-10"	5'-0"	1'-0"	1'-0"	10"	3'-6"
20"	1'-2"	2'-1"	2'-1"	5'-0"	1'-1"	1'-0"	1'-0"	3'-6"
24"	1'-5"	2'-10"	2'-6"	5'-0"	1'-3"	1'-0"	1'-3"	4'-0"
30"	1'-9"	2'-10"	2'-8"	5'-0"	1'-7"	1'-3"	1'-5"	4'-6"
36"	2'-0"	3'-2"	3'-1"	5'-0"	1'-10"	1'-3"	1'-9"	4'-6"
48"	2'-6"	3'-10"	3'-6"	5'-0"	2'-4"	1'-6"	2'-2"	5'-0"
54"	2'-10"	4'-0"	3'-10"	5'-0"	2'-8"	1'-6"	2'-5"	5'-0"

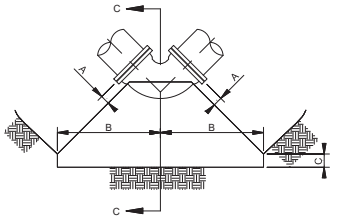

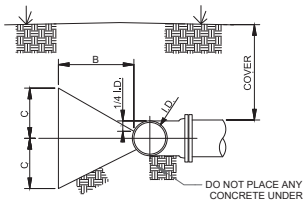

TYPICAL CONCRETE BRACING FOR 90° BENDS

PIPE DIA.	A	B	C	D	E	MIN COVER
4"	4 1/2"	6"	1'-8"	6"	1'-10"	2'-6"
6"	4 1/2"	1'-0"	1'-7"	9"	1'-9"	2'-6"
8"	4 1/2"	1'-6"	1'-6"	1'-0"	1'-9"	2'-6"
10"	4 1/2"	2'-1"	1'-1"	1'-3"	1'-11"	3'-0"
12"	4 1/2"	2'-6"	1'-0"	1'-6"	1'-11"	3'-0"
14"	6"	2'-6"	1'-2"	1'-9"	2'-0"	3'-0"
16"	6"	2'-11"	1'-0"	2'-0"	2'-1"	3'-0"
18"	6"	3'-4"	10"	2'-3"	2'-2"	3'-0"
20"	6"	3'-6"	11"	2'-6"	2'-3"	3'-6"
24"	7"	4'-3"	8"	3'-0"	2'-5"	3'-6"
30"	8"	4'-7"	6"	3'-3"	2'-5"	4'-0"
36"	8"	5'-0"	6"	3'-6"	2'-10"	4'-6"
48"	9"	5'-4"	4"	3'-9"	3'-1"	4'-6"
54"	9"	5'-6"	4"	4'-0"	3'-7"	5'-0"

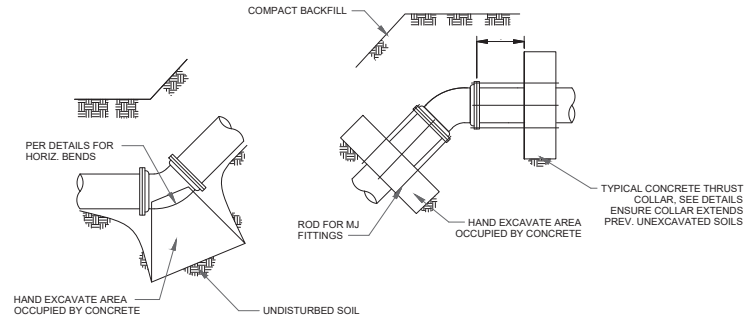

CONCRETE BRACING FOR VERTICAL BENDS

GENERAL NOTES:

1. GENERAL DIMENSIONS SHALL BE CONSIDERED AS MINIMUMS, CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADDITIONAL AS REQUIRED FOR ACTUAL FIELD CONDITIONS ENCOUNTERED. CONTRACTOR TO ENSURE ALL THRUST RESTRAINT IS ADEQUATE
2. ALL CONCRETE FOR THRUST RESTRAINT SHALL BEAR AGAINST FIRM UNDISTURBED SOILS
3. CONTRACTOR SHALL WRAP ALL ACCESSORIES BOLTS, NUTS, CONNECTIONS, ETC. IN PLASTIC SUCH THAT THEY CAN BE REMOVED WITHOUT THE NEED FOR CONCRETE REMOVAL
4. UNLESS INDICATED OTHERWISE IN PLANS, ALL FITTINGS SHALL BE RJ OR MJ WITH RESTRAINING FOLLOWER GLANDS. RESTRAINING FOLLOWER GLANDS SHALL BE MEGA-LUG, ROMAC, OR EQUAL. RETAINER GLANDS NOT ALLOWED.

GARVER

© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. NAGLE LICENSED 25622 PROFESSIONAL ENGINEER

REV.	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

DETAILS III

JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY


DRAWING NUMBER
C-503

SHEET NUMBER 24 OF 38


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Saved: 2/11/2025 3:03 PM Last saved by: TRPelvin
Last plotted by: Shanahan, Daryl R. Plot Style: — Plot Scale: 1:2.465 Plot Date: 2/11/2025 3:31 PM Plotter Used: None


STRUCTURAL GENERAL NOTES

1. THE WALL SHALL HAVE A FORM LINER WITH APPEARANCE OF A 4"x16" SLUMP BLOCK, SPLIT FACE OR SIMILAR APPEARANCE. CONCRETE SHALL BE COLORED CONCRETE WITH BEIGE, TAN OR BUFF-TYPE COLOR. PAINTED OR STAINED CONCRETE WILL NOT BE ACCEPTED. EXACT FORM LINER AND COLOR SHALL BE SUBMITTED TO THE CITY FOR REVIEW AND APPROVAL. THE CONCRETE SHALL THEN BE SEALED WITH A CLEAR SEALANT PER THE MANUFACTURER'S RECOMMENDATION.
2. CONCRETE:
   F'c = 4,500 PSI @ 28 DAYS
   WATER TO CEMENT RATIO: 0.45 MAX.
3. REINFORCING:
   ASTM A615 GR. 60 FY = 60 KSI

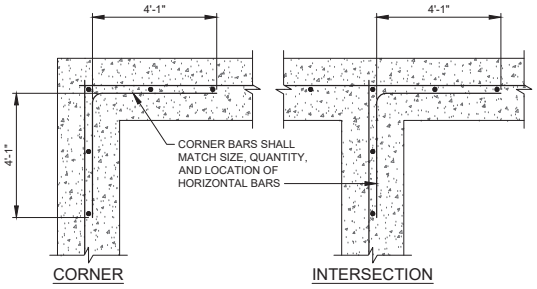


NOTE:
FOOTING CORNER BARS SIMILAR.

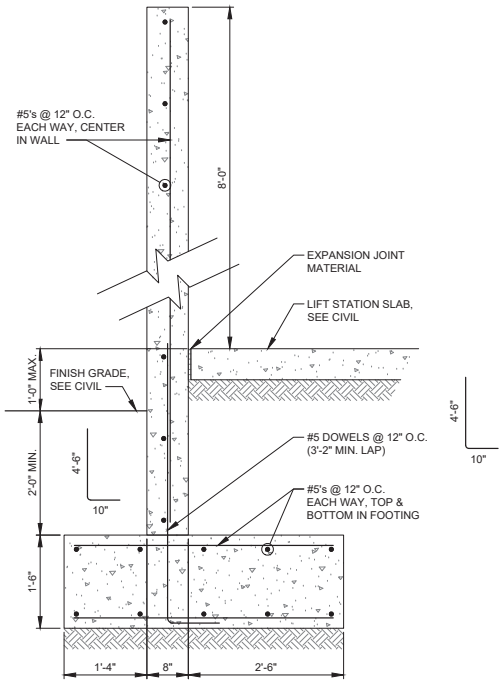


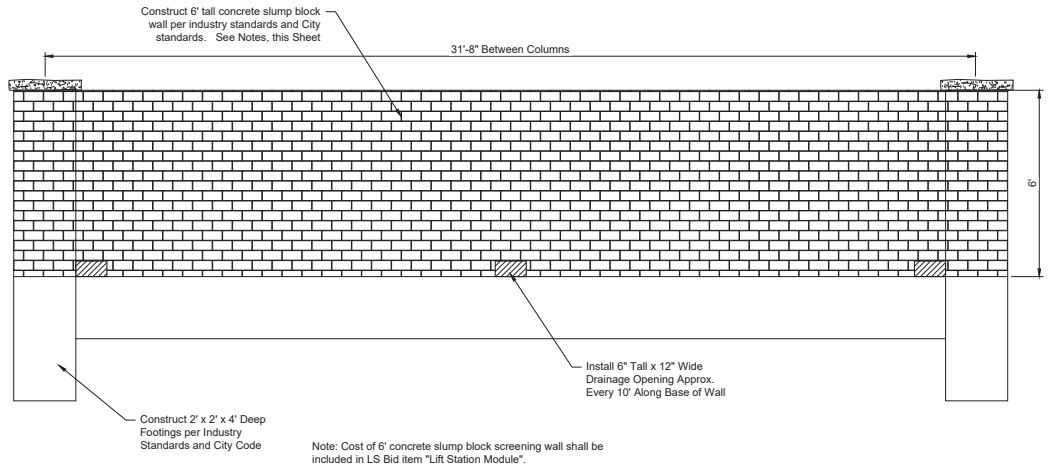


Note: Cost of 6' concrete slump block screening wall shall be included in LS Bid item "Lift Station Module".

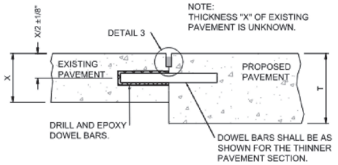


DOWELED CONSTRUCTION JOINT

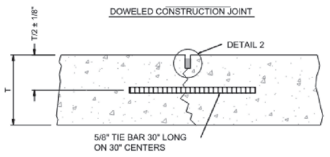

LONGITUDINAL CONTRACTION JOINT

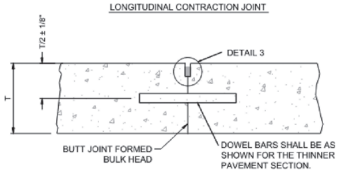

TRANSVERSE CONSTRUCTION JOINT

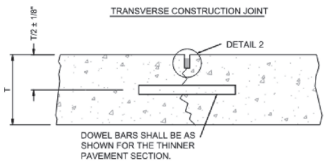


TRANSVERSE CONTRACTION JOINT

CONCRETE PAVEMENT JOINTS:
1. PROVIDE LONGITUDINAL CONTRACTION JOINT ALONG CENTER OF ALL DRIVES
2. PROVIDE TRANSVERSE CONTRACTION JOINTS AT 15' CENTERS MAX.
3. PROVIDE CONSTRUCTION JOINTS AT EDGES WHERE EXISTING PAVEMENT MEETS PROPOSED PAVEMENT
4. PROVIDE JOINT LAYOUT PLAN TO ENGINEER FOR APPROVAL BEFORE BEGINNING CONSTRUCTION
5. INSTALL ISOLATION JOINT AT PAVEMENT INTERACTION WITH ALL CONCRETE FIXED STRUCTURES INCLUDED BUT NOT LIMITED TO LIGHT FOUNDATIONS, INLETS, MANHOLES, VAULTS AND BUILDING.


DOWEL BAR SPECIFICATIONS

SLAB THICKNESS	DOWEL DIAMETER	DOWEL LENGTH	DOWEL SPACING
6" TO 7"	3/4"	18"	12"
8" TO 12"	1"	19"	12"

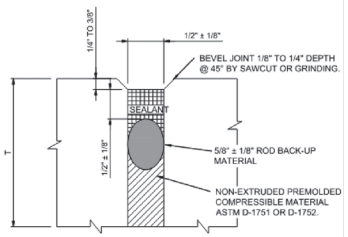


NOTE:
THICKEN PAVEMENT MINIMUM OF 2" AT ISOLATION JOINT. TRANSITION THICKENED EDGE OVER 36" MINIMUM.

DETAIL 1-ISOLATION JOINTS

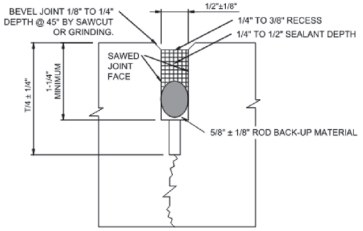

DETAIL 2-CONTRACTION JOINTS

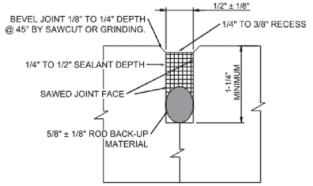

DETAIL 3-CONSTRUCTION JOINTS

GARVER
© 2024 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

WILLIAM W. NAGLE LICENSED PROFESSIONAL ENGINEER 25022 DATE OF LICENSURE

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION
LIFT STATION #71

DETAILS IV

JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: WWN
DRAWN BY: TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
C-504

SHEET NUMBER **25** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\T41-2400521 SITE PLAN - PUMP STATION DETAILS.dwg Last Save: 2/11/2025 3:03 PM Last saved by: TRPelvin
Last plotted by: Shanahan, Daryl R Plot Style: -- Plot Scale: 1:2.465 Plot Date: 2/11/2025 3:34 PM Plotter Used: None

EQUIPMENT

SYMBOL	DESCRIPTION
M	ELECTRIC MOTOR
V	VARIABLE SPEED DRIVE
RV SS	REDUCED VOLTAGE SOFT STARTER
FV NR	FULL VOLTAGE NON-REVERSING STARTER
FV R	FULL VOLTAGE REVERSING STARTER
CAS	SUBMERSIBLE PUMP CONTROL AND STATUS MODULE
OIT	OPERATOR INTERFACE TERMINAL
GDT	GRAPHIC DISPLAY TERMINAL (VFD)
G	ELECTRIC GENERATOR
	HYDRAULIC MOTOR
	AIR MOTOR
I	SHAFT
	COUPLING
	DYNAMIC PUMP
	SCREW PUMP OR CONVEYOR
	DYNAMIC COMPRESSOR
	POSITIVE DISPLACEMENT PUMP
	POSITIVE DISPLACEMENT COMPRESSOR
	EDUCTOR/EJECTOR
	HEATER, GENERAL
	HEATER W/FAN (INDUCED DRAFT)
	HEATER W/FAN (FORCED DRAFT)
	HEAT EXCHANGER, GENERAL
	HYDRAULIC CYLINDER
	AIR CYLINDER
	MIXER

SIGNAL CONDITIONERS

SYMBOL	DESCRIPTION
A/D	ANALOG TO DIGITAL
D/A	DIGITAL TO ANALOG
I/P	CURRENT TO PRESSURE
P/I	PRESSURE TO CURRENT
F/I	FREQUENCY TO CURRENT
I/I	CURRENT BOOST/ REPEATER
Σ	SUM
Δ	DIFFERENCE
√	SQUARE ROOT
F(X)	CHARACTERIZATION
∫	INTEGRATION

ACCESSORIES AND APPURTENANCES

SYMBOL	DESCRIPTION
	UNION
	PLUG
	BLIND FLANGE
	HOSE CONNECTION
	SPRAY NOZZLE/DIFFUSER
	DRAIN
	FLEXIBLE CONNECTION, GENERAL
	FLEXIBLE HOSE
	QUICK CONNECTOR
1"	THREADED TAP
	FILTER
	`Y' TYPE STRAINER
	STRAINER
	EXPANSION JOINT
FCO	FLOOR CLEANOUT
P	GAUGE P = PRESSURE V = VACUUM T = TEMPERATURE DP = PRESSURE DIFFERENTIAL
	SILENCER

VALVES

SYMBOL	DESCRIPTION
	CHECK VALVE
	GATE VALVE
	BUTTERFLY VALVE
	BALL CHECK
	BALL VALVE
	PLUG VALVE
	NEEDLE VALVE
	ROTARY VALVE
	KNIFE GATE VALVE
	MUD VALVE
	PINCH VALVE
	THREE-WAY VALVE
	FOUR-WAY VALVE
	GLOBE VALVE
	CHARACTERIZED OR VEE-BALL VALVE
	STOP CHECK VALVE
	DIAPHRAGM VALVE (SELF CONTAINED)
	AIR RELIEF
	PRESSURE CONTROL
	PRESSURE RELIEF VALVE
	VACUUM RELIEF VALVE
	STOP GATE
	SLIDE GATE
	HOSE VALVE (HV-X) OR (V-X) X = NO. IN SPECS
S	SAMPLE
	TELESCOPING VALVE

VALVE OPERATORS

SYMBOL	DESCRIPTION
	HAND OPERATOR
	HAND OPERATOR (LONG)
	CHAIN OPERATOR
F	FLOAT OPERATOR
	AIR DIAPHRAGM OPERATOR
	POSITIONER
S	SOLENOID OPERATOR
	CYLINDER OPERATOR
	PRESSURE BALANCED DIAPHRAGM OPERATOR
M	MOTOR OPERATOR
D	DIGITAL OPERATOR
E/H	ELECTRO-HYDRAULIC OPERATOR
	FAIL ARROWS INDICATE OPEN PORTS
	LIMIT SWITCH
M	MOTOR OPERATOR WITH INTEGRAL CONTROL DEVICES

INSTRUMENT PRIMARY ELEMENTS

SYMBOL	DESCRIPTION
	THREADED TAP
	THERMOWELL
	WEIR
	SIGHT FLOW INDICATOR
	ROTAMETER
	FLOW ORIFICE
	FLOW ORIFICE IN QUICK CHANGE FITTING
	SINGLE PORT PITOT
	AVERAGING PITOT STATION
	VENTURI TUBE
	FLUME
	POSITIVE DISPLACEMENT FLOWMETER
MASS	MASS FLOWMETER
	SONIC FLOWMETER
M	MAGNETIC FLOWMETER
M	INSERTION MAGNETIC FLOWMETER
	PH ELECTRODE ASSEMBLY
P	SUBMERSIBLE PRESSURE SENSOR
	ULTRASONIC LEVEL TRANSMITTER
R	RADAR LEVEL TRANSMITTER
	CONDUCTIVITY LEVEL PROBE
	FLOAT SWITCH
	TURBINE ELEMENT
	VORTEX SENSOR
	TARGET ELEMENT
	WATER HAMMER ARRESTER

DIGITAL SYSTEM INTERFACES

SYMBOL	DESCRIPTION
	ANALOG INPUT
	ANALOG OUTPUT
	DISCRETE INPUT
	DISCRETE OUTPUT

INSTRUMENTS OR FUNCTIONS

SYMBOL	DESCRIPTION
	HMI SCREEN DISPLAY ELEMENT
	PANEL MOUNTED DEVICE
	FIELD DEVICE


AUX INSTRUMENTS OR FUNCTIONS

SYMBOL	DESCRIPTION
	TEST POINT, TERMINAL BLOCK WITH SLIDING LINK AND MINI-BANANA SOCKETS
P	PURGE OR FLUSHING DEVICE
I	INTERLOCK LOGIC WITH REFERENCE
	ANNULAR SEAL
	DIAPHRAGM SEAL
R	RESET FOR LATCH TYPE OPERATOR
+ - PS	LOOP POWER SUPPLY

GENERAL IDENTIFICATION

SYMBOL	DESCRIPTION
20LP1	EQUIPMENT TAG

SHEET INTERFACE



NON-SHEET INTERFACE



EQUIPMENT LINE TYPES

LINE	DESCRIPTION
	PROPOSED OR NEW EQUIPMENT
	EXISTING EQUIPMENT

PIPING LINE TYPES

LINE	DESCRIPTION
	PROCESS LINE - PRIMARY
	PROCESS LINE - SECONDARY
	PROCESS LINE - EXISTING
	PACKAGE BOUNDARY
	AREA/BUILDING BOUNDARY
	SHOWN ELSEWHERE
	AIR

PIPING, MISCELLANEOUS

SYMBOL	DESCRIPTION
	SLOPE ARROW, ARROW DIRECTION DOWN
	OUTSIDE GRADE LEVEL
ST	LINE HEAT TRACED AND INSULATED ST = STEAM TRACED ET = ELECTRIC TRACED

INSTRUMENT LINE TYPES

LINE	DESCRIPTION
	PROCESS CONNECTION
	UNDEFINED SIGNAL
	PNEUMATIC SIGNAL
	ELECTRIC SIGNAL
	HYDRAULIC SIGNAL
	CAPILLARY OR FILLED TUBE
	ELECTROMAGNETIC OR SONIC SIGNAL (GUIDED)
	ELECTROMAGNETIC OR SONIC SIGNAL (UNGUIDED)
	INTERNAL SYSTEM LINK (SOFTWARE OR DATA LINK)
	MECHANICAL LINK

MEANING OF FUNCTIONAL INSTRUMENT IDENTIFICATION LETTERS

	FIRST LETTER		SUCCEEDING LETTERS		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
B	BURNER FLAME		USER CHOICE	USER CHOICE	USER CHOICE
C	CONDUCTIVITY (ELECTRICAL)			CONTROL	
D	DENSITY (MASS) OR SPECIFIC GRAVITY	DIFFERENTIAL			
E	VOLTAGE (EMF)		PRIMARY ELEMENT		
F	FLOW RATE	RATIO(FRACTION)			
G	GAUGING(DIMENSIONAL)		GLASS		
H	HAND(MANUALLY INITIATED)				HIGH
I	CURRENT(ELECTRICAL)		INDICATE		
J	POWER	SCAN			
K	TIME OR TIME-SCHEDULE			CONTROL STATION	
L	LEVEL		LIGHT(PILOT)		LOW
M	MOTION	MOMENTARY			MIDDLE OR INTERMEDIATE
N	USER CHOICE		USER CHOICE	USER CHOICE	USER CHOICE
O	USER CHOICE		ORIFICE(RESTRICTION)		
P	PRESSURE OR VACUUM		POINT(TEST POINT)		
Q	QUANTITY OR EVENT	INTEGRATE OR TOTALIZE			
R	RADIATION		RECORD OR PRINT		
S	SPEED OR FREQUENCY	SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
U	MULTIVARIABLE		MULTIFUNCTION	MULTIFUNC.	MULTIFUNCTION
V	VIBRATION OR MECHANICAL ANALYSIS			VALVE, DAMPER, OR LOUVER	
W	WEIGHT OR FORCE		WELL		
X	UNCLASSIFIED		UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED
Y	EVENT, STATE OR PRESENCE			RELAY OR COMPUTE	
Z	POSITION			DRIVE, ACTUATE OR UNCLASSIFIED FINAL CONTROL ELEMENT	

EQUIPMENT AND INSTRUMENTATION TAGGING

AABCCCDEX

CODE	DESCRIPTION	RANGE	COMMENT
AA	FACILITY NUMBER	01 - 99	FACILITY LOCATION OR EQUIPMENT
B	UNIT PROCESS NUMBER	1 - 9	OPTIONAL IDENTIFIER USED TO DIFFERENTIATE MULTIPLE UNIT PROCESSES WITHIN A SINGLE FACILITY
CCC	EQUIPMENT ABBREVIATION / INSTRUMENT IDENTIFICATION	A - ZZZ	ONE TO THREE LETER ABBREVIATION
D	TRAIN OR BRANCH NUMBER	0 - 9	0 USED FOR EQUIPMENT COMMON TO AN ENTIRE UNIT PROCESS 1-9 USED FOR EACH TRAIN/BRANCH WITHIN UNIT PROCESS
EE	SEQUENTIAL NUMBER IDENTIFIER	01 - 99	OPTIONAL IDENTIFIER IF NEEDED WHEN MULTIPLE EQUIPMENT WITHIN SAME TRAIN/BRANCH
X	ALPHABETIC IDENTIFIER	A - Z	OPTIONAL IDENTIFIER WHEN NEEDED FOR FURTHER DIFFERENTIATION

INSTRUMENT POWER SUPPLY

- POWER SUPPLY, TYPE AND LEVEL SHOWN, ABBREVIATIONS AS FOLLOWS:
  AS - AIR SUPPLY
  IA - INSTRUMENT AIR
  PA - PLANT AIR
  ES - ELECTRIC SUPPLY
  GS - GAS SUPPLY

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. SWANN — LICENSED — 30899 — KANSAS — PROFESSIONAL ENGINEER — 02-12-2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

PROCESS & INST. DIAGRAM NOTES, LEGEND, ABBREV.

JOB NO.: 2400521
DATE: FEB 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
I-101

SHEET NUMBER **26** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\I-101 PROCESS & INSTRUMENTATION DIAGRAM NOTES.dwg Last Saved: 1/14/2025 2:53 PM Last saved by: ASGinger
Last plotted by: Ginger, Adam S Plot Style: — Plot Scale: 12.56 Plot Date: 2/12/2025 1:49 AM Plotter used: None

GENERAL NOTES:

1. FOR EQUIPMENT TAGS WITH "X", INSERT CORRESPONDING EQUIPMENT NUMBER.
2. EQUIPMENT SHOWN TO BE PROVIDED AS PART OF A VENDOR-SUPPLIED PUMP STATION PACKAGE. THIS DIAGRAM IS REPRESENTATIVE OF STANDARD INSTRUMENTATION AND CONTROLS. VENDOR DESIGN MAY VARY. REFER TO VENDOR DRAWINGS.
3. CONTRACTOR TO COORDINATE WITH PUMP STATION VENDOR FOR REQUIRED CONTROL SIGNALS BETWEEN INSTRUMENTATION AND CONTROL PANEL. ALL SIGNALS MAY NOT BE SHOWN.

HMI LEVEL

LEVEL: LI / LE01

LEVEL ALARM: LAI / LSX — HIGH, LOW

TYP. OF P1010 & P1020

PUMP IN AUTO: YI / P10X0

PUMP RUNNING: YI / P10X0

PUMP RUN CMD.: YC / P10X0

PUMP ALARM: YAI / P10X0 — FAULT, OVERTEMP, MOISTURE

POWER SOURCE: YI / ATS01 — NORMAL, EMERGENCY

GEN. STATUS: YAI / G01 — RUNNING, FAULT

(1) GENERATOR CONTROLLED BY ATS. MINIMUM SIGNALS REQUIRED SHOWN. CONTRACTOR AND SUPPLIER TO DETERMINE ADDITIONAL IO AS NEEDED.

PLC LEVEL

TYP. OF P1010 - P1020: LEVEL, HIGH LEVEL, LOW LEVEL, OVERTEMP, MOISTURE, RUNNING, RUN, AUTO, FAULT

NORMAL, EMERGENCY (1), GEN. FAULT, GEN. RUNNING (1) — PLC01

MCC/CP LEVEL

LEVEL: LI — I

LEVEL HIGH: LAL — LEVEL LOW: LAL

CAS

RV SS

TYP. OF P1010 - P1020: H/O/A: HS — RUNNING: YL; RESET: HS — FAULT: YAL; OVERTEMP: TAL — MOISTURE: MAL

PCP01

NORMAL SOURCE: YL

EMERGENCY SOURCE: YL — ATS01

RUN (1)

OIT

G01

TO P10X0

4-INCH SEWER

6-INCH SEWER

PI 01

8-INCH SEWER

TO SEWER FORCE MAIN

V1002

V1001

V1004

V1003

6-INCH SEWER

6-INCH SEWER

FROM GRAVITY SEWER

LSH 01

LE 01 (P)

LSL 01

TO PCP01

M — TS 01 — MS 01

P1010

SUBMERSIBLE PUMP NO. 1
CAPACITY: 360 GPM
TDH: 50FT.
HP: 30

TO PCP01

M — TS 02 — MS 02

P1020

SUBMERSIBLE PUMP NO. 2
CAPACITY: 360 GPM
TDH: 50FT.
HP: 30

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. SMITH
LICENSED
30899
KANSAS
PROFESSIONAL ENGINEER
07.17.2025

REV	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

LIFT STATION P&ID

JOB NO.: 2400521
DATE: FEB 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
I-102

SHEET NUMBER 27 OF 38

File: L:\2024\T-41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\I-101 LIFT STATION P&ID.dwg Last Save: 1/14/2025 2:52 PM Last saved by: ASGinger
Last plotted by: Ginger, Adam S Plot Style: --- Plot Scale: 2.36 Plot Date: 7/24/2025 1:51 AM Plotter Used: None

CONTROL SCHEMATIC SYMBOLS

- TRANSFORMER, RATINGS AS SHOWN
- SURGE PROTECTION DEVICE (SPD)
- TRANSFER SWITCH (N, E)
  ATS - AUTOMATIC TRANSFER SWITCH
  MTS - MANUAL TRANSFER SWITCH
- GENERATOR (G)
- POWER METER (PM)
- PHASE MONITOR (PM)
- 600AF/3P, LSIG 400AT — CIRCUIT BREAKER, RATINGS AS NOTED.

L	LONG TIME
S	SHORT TIME
I	INSTANTANEOUS
G	GROUND

- VARIABLE FREQUENCY DRIVE (VFD) (V)
- REDUCED VOLTAGE SOFT-START (RV SS)
- OR — DISCONNECT
- OR (F) — FUSED DISCONNECT
- MOTOR (M), 40 HP — HORSEPOWER AS NOTED
- DRAW OUT CONSTRUCTION
- 1 OR (FV NR) — FULL VOLTAGE NON-REVERSING MOTOR STARTER. SIZE AS NOTED. — OL
- 1 OR (FV R) — FULL VOLTAGE REVERSING MOTOR STARTER. SIZE AS NOTED. — OL
- KEY INTERLOCK (K)
- GROUND
- INDUCTOR/LINE REACTOR
- 2 — CAPACITOR KVAR AS NOTED
- MEDIUM VOLTAGE CIRCUIT BREAKER
- CURRENT TRANSFORMER
- VOLTAGE TRANSFORMER

- WIRING WITHIN PANEL
- WIRING TO FIELD DEVICE
- ELECTRICALLY CONNECTED
- OR — NOT ELECTRICALLY CONNECTED
- ELECTRICAL CONNECTION
- TERMINAL BLOCK LOCAL
- TERMINAL BLOCK EXTERNAL

- CIRCUIT BREAKER SINGLE POLE
- CIRCUIT BREAKER THREE POLE
- 10A — FUSE, AMPERE RATING AS NOTED
- 1A — FUSED TERMINAL BLOCK, AMPERE RATING AS NOTED
- GROUND

- HS (MOMENTARY) PB NC
- HS (MOMENTARY) PB NO
- HS (MAINTAINED) PB WITH RED MUSHROOM HEAD OPERATOR
- HS THREE POSITION — XOO, OOX — X = CLOSED, O = OPEN
- HS TWO POSITION

- (M) MOTOR
- OVERLOAD ELECTRONIC
- OVERLOAD ELECTRONIC THREE POLE
- OVERLOAD THERMAL
- OVERLOAD THERMAL THREE POLE

- POTENTIOMETER
- (ETM) ELAPSED TIME METER
- HEATER
- VFD LINE REACTOR

- (A), PTT — PILOT LIGHT - COLOR AS INDICATED
  - A - AMBER
  - G - GREEN
  - R - RED
  - B - BLUE
  - W - WHITE
- PTT - PUSH-TO-TEST

- SOLENOID
- (CR) — RELAY COIL
  CR - CONTROL RELAY
  M - MOTOR STARTER COIL
- RELAY CONTACT NC
- RELAY CONTACT NO
- (TD) — TIME DELAY RELAY COIL
- NO TIME DELAY CLOSE WHEN ENERGIZED
- NC TIME DELAY OPEN WHEN ENERGIZED
- NO TIME DELAY OPEN WHEN DE-ENERGIZED
- NC TIME DELAY CLOSE WHEN DE-ENERGIZED

- SWITCH - THREE POLE
- SWITCH - LIMIT NORMALLY OPEN (NO)
- SWITCH - LIMIT NORMALLY OPEN HELD CLOSED (NOHC)
- SWITCH - LIMIT NORMALLY CLOSED (NC)
- SWITCH - LIMIT NORMALLY CLOSED HELD OPEN (NCHO)

A	B
	PRESSURE
	LEVEL
	TEMPERATURE
	FLOW

- A — NORMALLY OPEN, CLOSES ON RISING "B"
- A — NORMALLY CLOSED, OPENS ON RISING "B"
- A — HELD CLOSED, OPENS ON DROPPING "B"
- A — HELD OPEN, CLOSES ON DROPPING "B"

RECEPTACLE SYMBOLS

- WP, GFCI — 20 AMP DUPLEX RECEPTACLE. MTD. 18" AFF TO BOTTOM, UNLESS NOTED OTHERWISE, WITH #12 GROUND WIRE.
  - "GFCI" INDICATES GROUND FAULT CIRCUIT INTERRUPTER.
  - "WP" INDICATES HEAVY-DUTY, WEATHERPROOF WHILE-IN-USE ENCLOSURE AND COVER.
- BOX INDICATES FLOOR OUTLET WITH RECESSED CAST JUNCTION BOX
- DUPLEX FLOOR/CEILING RECEPTACLE

ELECTRICAL TAGS

CONDUIT WIRE TAG

2(3#14+#14G+4#14SPARE)

DENOTES TWO (2) SETS OF;
- THREE (3) NO. 14 AWG CONDUCTORS
- ONE (1) NO. 14 AWG GROUND CONDUCTOR
- FOUR (4) NO. 14 AWG SPARE CONDUCTORS.

CONDUIT RUN TAG

XXXX-Y##

XXXX = PANEL/EQUIPMENT IDENTIFIER

Y = CONDUIT FUNCTION
- P = (480VAC POWER)
- L = (240/120VAC POWER)
- C = (CONTROL/DISCRETE)
- S = (SIGNAL/ANALOG)
- N = (COMMUNICATION)

= SEQUENTIAL CIRCUIT NUMBER

CONDUIT HOME RUN TAG

CONDUIT TAG

HOME RUN TO PANEL IN DEDICATED CONDUIT, RECEPTACLES AND EQUIPMENT SHALL HAVE DEDICATED GREEN GROUND WIRE.

PULL BOX TAG

XXYPBZZA

XX = FACILITY NUMBER
Y = ELECTRICAL/CONTROLS
- P (480VAC/POWER)
- E (240/120VAC/CONTROL)
- S (SIGNAL)
- H (MEDIUM VOLTAGE)
- N (FIBER)

ZZ = SEQUENTIAL NUMBER
A = DUCT BANK PROFILE LETTER

GENERAL ELECTRICAL LINE STYLES

- EQUIPMENT PACKAGE
- GROUND
- ABOVE GRADE ELECTRICAL
- BELOW GRADE ELECTRICAL
- LIGHTNING PROTECTION CONDUCTORS
- WIRE CONTINUATION

SECURITY SYMBOLS

- SURVEILLANCE CAMERA
- (XX) — SECURITY & ACCESS:
  - DS = DOOR SWITCH
  - KP = KEY PAD
  - MD = MOTION DETECTOR
  - ML = MAGNETIC LOCK
  - OC = OCCUPANCY SENSOR
  - PC = PHOTO CELL
  - WS = WINDOW SWITCH

DATA & COMMUNICATION SYMBOLS

- PHONE OUTLET
- DATA OUTLET
- DATA AND TELEPHONE DUAL OUTLET
- TELEVISION OUTLET


LIGHTING SWITCH SYMBOLS

- $ — SWITCH, SINGLE POLE
- $3 — SWITCH, THREE WAY
- $4 — SWITCH, FOUR WAY
- $D — SWITCH, DIMMER

ELECTRICAL EQUIPMENT SYMBOLS

- ELECTRICAL PANEL OR EQUIPMENT CABINET, SURFACE MOUNTED, 5'-6" TO TOP OF ENCLOSURE
- ELECTRICAL PANEL OR EQUIPMENT CABINET, RECESSED MOUNTED, 5'-6" TO TOP OF ENCLOSURE
- (J) (J) — JUNCTION BOX
- SAFETY NON-FUSED DISCONNECT SWITCH
- (F) — SAFETY FUSED DISCONNECT SWITCH

CONDUIT & CABLE TRAY SYMBOLS

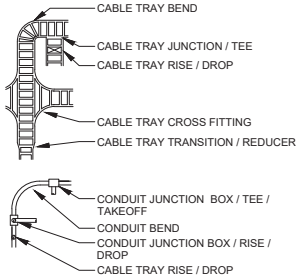


PHASE GRAPHICS

- EXISTING ELEMENTS
- NEW ELEMENTS
- EXISTING ELEMENTS TO BE REMOVED/DEMOLISHED
- FUTURE CONSTRUCTION NEW ELEMENT

GENERAL ELECTRICAL SYMBOLS

- 1 — REVISION CLOUD AND NUMBER SHOWN ON PLANS
- POINT OF CONNECTION - NEW TO EXISTING
- DEMO TO POINT
- 1 — KEYED NOTE REFERENCE
- ROOM NAME, 101, 150 SF — SYMBOL INDICATES A ROOM / AREA DESIGNATION, WITH ROOM NUMBER AND SQUARE FOOTAGE
- A — SYMBOL INDICATES A STRUCTURAL GRIDLINE OR DATUM
- 30-TOC, EL 288.50 — SYMBOL INDICATES A LEVEL DATUM IN A SECTION OR ELEVATION
- 1 / 35-E101 — CALLOUT DENOTES A VIEW REFERENCE ABOUT A MATCHLINE
- CENTERLINE
- D00, 0000-000 — CALLOUT DENOTES A STANDARD DETAIL REFERENCE.
  EXAMPLE: D03/0000-000
  SPECIFICATION DIVISION: 00
  SPECIFICATION SECTION: 0000
  DETAIL REFERENCE: 000
- DUCT-BANK SECTION CUT
  - SECTION "#"
  - DUCT BANK TAG "A"
  - BRANCH "1" OF DUCT BANK "A"
  - SHEET REFERENCE



GROUNDING & LIGHTNING PROTECTION

- GROUND ROD AND TEST WELL
- GROUND ROD
- LIGHTNING AIR TERMINAL

LIGHT FIXTURE ANNOTATIONS

- (#) — TYP LIGHT FIXTURE
- (#) — LIGHT FIXTURE WITH EMERGENCY BATTERY PACK

LIGHTING FIXTURE SYMBOLS

- (P) — RECESSED LIGHT
- (#) — EMERGENCY EXIT SIGN WITH LIGHTS
- EMERGENCY EXIT SIGN WITH DIRECTION
- (P) — POLE MOUNTED LIGHT
- (P) — WALL MOUNTED EXTERIOR LIGHT

ELECTRICAL SHEET NOTE

ALL GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL ELECTRICALL DRAWINGS IN THIS SET. SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THE CONTAINED REFERENCE DRAWINGS

GARVER

© 2026 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN N. STANG — LICENSED PROFESSIONAL ENGINEER — 30899 — KANSAS — 04.14.2025

REV.	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL SYMBOLS LEGEND

JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
E-101

SHEET NUMBER 28 OF 38

File: L:\2024\T41-240052 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-101 ELECTRICAL SYMBOLS LEGEND.dwg Last Save: 1/14/2025 1:41 PM Last saved by: ASGinger
Last plotted by: Shanahan, Daryl R. Plot Style: — Plot Scale: 1-2.465 Plot Date: 2/17/2025 5:34 PM Xrefs Used: None

GENERAL NOTES

1. THESE NOTATIONS ARE INTENDED TO BE GENERAL IN NATURE. THEY MAY OR MAY NOT APPLY TO SOME OR ALL OF THE PLAN SHEETS AND SPECIFICATIONS.

2. CONDUIT RUNS INDICATED ON THE PLAN SHEETS ARE INTENDED TO BE SCHEMATIC ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD ROUTING ALL CONDUIT RUNS AND SHALL COORDINATE ANY DEVIATION FROM ROUTING AS INDICATED HEREIN WITH THE ENGINEER. ALL CONDUIT SHALL BE INSTALLED IN SUCH A MANNER AS TO PREVENT CONFLICTS WITH EQUIPMENT. EXPOSED CONDUIT SHALL BE INSTALLED PARALLEL OR PERPENDICULAR TO BEAMS OR STRUCTURAL CONDITIONS.

3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD ROUTING ALL CONDUITS NOT INDICATED ON THE PLAN SHEETS. THIS INCLUDES CIRCUITS FOR LIGHTING, RECEPTACLES AND OTHER MISCELLANEOUS EQUIPMENT CIRCUITS.

4. ALL CONDUITS SHALL BE ROUTED AND SUPPORTED IN SUCH A MANNER AS TO NOT COMPROMISE THE STRUCTURAL INTEGRITY OF WALLS, FLOORS, CEILINGS, AND ROOFS. WHERE REQUIRED, THE CONTRACTOR SHALL PROVIDE ADDITIONAL STRUCTURAL SUPPORTING MEMBERS FOR THE INSTALLATION AND SHALL COORDINATE SUCH MEMBERS WITH ENGINEER.

5. ALL SURFACE MOUNTED PANELS AND PANELBOARDS ON THE INTERIOR OF EXTERIOR WALLS OR IN OTHER LOCATIONS CONSIDERED DAMP OR WET SHALL BE MOUNTED SO AS TO MAINTAIN A 1/4" MINIMUM AIR SPACE BETWEEN THE ENCLOSURE AND THE WALL.

6. PULLBOXES, IF SHOWN ON THE PLANS, ARE SCHEMATIC IN NATURE. THE CONTRACTOR SHALL PROVIDE ADDITIONAL PULLBOXES WHERE REQUIRED TO MAKE A WORKABLE INSTALLATION.

7. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE SPECIFICATIONS WHETHER OR NOT THEY ARE REFERENCED ON THE DRAWINGS.

8. ALL CONDUIT RUNS PASSING THROUGH EXPANSION JOINTS SHALL HAVE EXPANSION OR EXPANSION AND DEFLECTION TYPE FITTINGS. FOR LOCATIONS OF EXPANSION JOINTS, REFER TO THE STRUCTURAL DRAWINGS.

9. THE WIRING DIAGRAMS, QUANTITY AND SIZE OF WIRES AND CONDUITS REPRESENT SUGGESTED ARRANGEMENT BASED UPON SELECTED STANDARD COMPONENTS OF ELECTRICAL EQUIPMENT. IF EQUIPMENT SUPPLIED BY THE MANUFACTURER HAS A LARGER LOAD THAN THE VALUE SHOWN OR INDICATED, THE CABLE, CONDUIT AND ELECTRICAL EQUIPMENT MAY BE ENLARGED AS REQUIRED TO ACCOMMODATE THE HIGHER LOADING. HOWEVER, THE BASIC SEQUENCE AND METHOD OF CONTROL MUST BE MAINTAINED AS INDICATED ON THE DRAWINGS AND/OR SPECIFICATIONS.

10. ALL MOTOR STARTER CONTROL POWER TRANSFORMERS SHALL BE SIZED TO PROVIDE SUFFICIENT VOLT-AMPERE CAPACITY FOR OPERATING ALL LOCAL AND REMOTE ELECTRICAL DEVICES ASSOCIATED WITH CONTROL OF THE MOTOR IN ADDITION TO THE STARTER COIL. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL LOADING REQUIREMENTS FOR CONTROL POWER TRANSFORMERS.

11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING PROPERLY SIZED STARTER OVERLOADS FOR ALL EQUIPMENT INSTALLED.

12. MOTOR CONTROL CENTERS AND ALL FREE STANDING PANELS SHALL BE SET ON CONCRETE HOUSEKEEPING PADS.

13. IN GENERAL, SEPARATE POWER, CONTROL AND SIGNAL WIRING. PROVIDE SEPARATE CONDUIT, PULL AND JUNCTION BOXES. PROVIDE SUITABLE CABLE BARRIER WITHIN PULL OR JUNCTION BOXES WHERE SEPARATION OF WIRING IS NOT SHOWN ON THE DRAWINGS. CONTROL AND SIGNAL CONDUCTORS OF LIKE VOLTAGES MAY BE COMBINED INTO A SINGLE CONDUIT, AS LONG AS NEC CONDUIT FILL REQUIREMENTS ARE MET.

14. UNLESS OTHERWISE NOTED ALL CONDUIT TO BE ROUTED EXPOSED. ALL EXPOSED CONDUIT AND PORTIONS OF THE CONDUIT SYSTEM SHALL BE SURFACE MOUNTED. SEE SPECIFICATIONS FOR CONDUIT, BOXES, SUPPORTS, HANGAR, UNISTRUT AND OTHER PORTIONS OR THE CONDUIT SYSTEM MATERIAL REQUIREMENTS.

15. VERIFY LOCATION OF ALL EQUIPMENT PRIOR TO INSTALLATION.

16. PROVIDE SEPARATE CONDUITS FOR 480VAC POWER CIRCUITS. SIGNAL AND CONTROL CONDUCTORS OF LIKE VOLTAGES MAY BE COMBINED IN A SINGLE CONDUIT WHERE COMPLIANT WITH NEC CONDUIT FILL REQUIREMENTS.

17. CONTRACTOR TO SUBMIT CONDUIT ROUTING PLANS TO ENGINEER PRIOR TO CONSTRUCTION.

18. IN AREAS WHERE THERE ARE OVERHEAD BRIDGE CRANES, HOISTS, DOORS OR OTHER SIMILAR ITEMS, NO CONDUITS SHALL BE INSTALLED IN SUCH A MANNER AS TO CONFLICT WITH PROPER OPERATION OF SUCH EQUIPMENT.

19. CONTRACTOR SHALL FURNISH AND INSTALL ITEMS AS NECESSARY FOR COMPLETE AND FUNCTIONAL SYSTEMS. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND OTHER SECTIONS OF THE PLANS FOR ITEMS AS MAY BE REQUIRED AND SHALL PROVIDE CONDUIT, WIRING AND TERMINATIONS FOR ALL ITEMS AS REQUIRED.

20. CONTRACTOR SHALL REFER TO OTHER PLAN SHEETS FOR LOCATIONS OF FIREWALLS. ALL CONDUIT PENETRATIONS IN THESE WALLS SHALL BE ACCOMPLISHED IN SUCH A MANNER AS TO NOT REDUCE THE RATING OF THE FIREWALL THROUGH THE USE OF BOXES, SEALANTS AND OTHER ACCESSORIES AS MAY BE REQUIRED.

21. CONTRACTOR SHALL REFER TO MECHANICAL PLAN SHEETS AND SPECIFICATIONS FOR ITEMS RELATED TO THE MECHANICAL SYSTEMS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING ALL ITEMS AS NECESSARY FOR COMPLETE AND OPERABLE MECHANICAL HEREIN INCLUDING, BUT NOT LIMITED TO; CONTROL POWER TRANSFORMERS, STARTERS, THERMOSTATS, CONTROL STATIONS, AND OTHER ELECTRICAL ITEMS AS RELATED TO THE INSTALLATION OF THE MECHANICAL SYSTEMS.

22. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DISCONNECTS FOR ALL MECHANICAL MOTORS UNLESS THE EQUIPMENT IS FURNISHED WITH AN INTEGRAL DISCONNECT FROM THE MANUFACTURER. IN ADDITION, THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL CONDUIT, WIRING AND TERMINATIONS FOR ALL COMPONENTS AS MAY BE NECESSARY FOR THE MECHANICAL SYSTEMS.

23. ALL RECEPTACLES IN OUTDOOR AND ANTICIPATED WET AREAS SHALL BE GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLES WITH HEAVY-DUTY WEATHERPROOF COVERS.

24. EQUIPMENT LOCKOUTS SHALL BE IN STRICT ACCORDANCE WITH OWNER'S REQUIREMENTS.

25. ALL CONDUITS SHALL HAVE A GROUNDING CONDUCTOR, SIZED PER NEC.

26. ALL LIGHTING FIXTURES INSTALLED IN INSULATED LOCATIONS SHALL BE RATED FOR SUCH INSTALLATION REGARDLESS OF THE FIXTURE SCHEDULE DESIGNATION.

27. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION OF NEW SERVICE INSTALLATIONS WITH OWNER, ENGINEER AND SERVICE UTILITY. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL ITEMS AS REQUIRED BY SERVICE UTILITY FOR NEW SERVICE CONNECTIONS.

28. UNLESS NOTED OTHERWISE, ALL CONTROL PANELS SHALL BE FABRICATED SUCH THAT ALL OPERATORS AND INDICATING DEVICES INDICATED ON THE SCHEMATICS BE LOCATED ON THE FRONT DOOR OR COVER OF THE PANEL. OPERATING AND INDICATING DEVICES SHALL BE VISIBLE AND OPERABLE WITHOUT HAVING TO OPEN THE CONTROL PANEL UNLESS OTHERWISE IDENTIFIED ON THE DRAWING.

29. DUCT BANKS INDICATED AND THE BELOW GRADE CONDUIT ROUTING AS SHOWN IS DIAGRAMMATIC IN NATURE AND SHOWN FOR REFERENCE ONLY. THE CONTRACTOR SHALL REVIEW PLAN SHEETS RELATED TO INDIVIDUAL STRUCTURES AND VERIFY CONDUITS THAT MAY BE REQUIRED. THE CONTRACTOR SHALL VERIFY NUMBER OF CONDUITS AS INDICATED IN THE DUCT BANK PRIOR TO INSTALLATION WITH THE ENGINEER. PROVIDE AT A MINIMUM ONE SPARE CONDUIT EQUAL IN SIZE TO THE LARGEST CONDUIT IN USE, IN EACH DUCT BANK. FOR EACH SET OF FOUR USED CONDUITS IN EACH DUCT BANK PROVIDE A SPARE CONDUIT EQUAL TO THE LARGEST CONDUIT IN USE: (1-4 CONDUITS, 1 SPARE; 5-8 CONDUITS, 2 SPARE; AND SO ON).

30. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING HEAT TRACING FOR ALL EXPOSED WATER LINES TO BE INSTALLED UNDER THIS PROJECT. THE CONTRACTOR SHALL REVIEW OTHER SECTIONS OF THE PLANS AND SPECS AND PROVIDE SUITABLE HEAT TRACING COMPONENTS AS MAY BE REQUIRED, WHETHER INDICATED ON THE ELECTRICAL PLAN SHEETS OR NOT.

31. VERIFY LOCATION OF ALL LIGHTING FIXTURES WITH OWNER AND ENGINEER PRIOR TO INSTALLATION. COORDINATE LIGHT FIXTURE LOCATIONS AND MOUNTING HEIGHTS WITH HVAC DUCTS AND OVERHEAD CONDUIT RUNS. USE RIGID CONDUIT WHEN SUSPENDING LIGHT FIXTURES TO PREVENT SWAYING.

32. USE CRIMPED OR BOLTED CONNECTIONS FOR ALL BONDING CONNECTIONS BETWEEN CONDUCTORS AND BUILDING SYSTEM COMPONENTS. USE EXOTHERMIC WELDED CONNECTIONS FOR ALL UNDERGROUND PORTIONS OF THE GROUNDING SYSTEM WITH THE EXCEPTION OF GROUND ROD TEST WELLS.

33. MINIMUM LIGHTNING PROTECTION ITEMS WHERE SHOWN. FINAL LIGHTNING PROTECTION SYSTEM SHALL BE DEVELOPED AND SUBMITTED BY MASTER INSTALLER/DESIGNER CERTIFIED BY UL OR LPI AS REQUIRED IN SPECIFICATION SECTION 26 41 13.

ABBREVIATIONS

A, AMP	AMPERES
AC	ALTERNATING CURRENT
AF	AMP FRAME
AFF	ABOVE FINISHED FLOOR
AIC	AMPS INTERRUPTING CAPACITY
AM	AMP-METER
ARMS	ARC REDUCTION MAINTENANCE SWITCH
AT	AMP TRIP
ATS	AUTOMATIC TRANSFER SWITCH
AWG	AMERICAN WIRE GAUGE
BFI	BLOWN FUSE INDICATOR
C	CONDUIT, CONTROL/DISCRETE CIRCUIT
CAS	CONTROL AND STATUS RELAY
CB	CIRCUIT BREAKER
CCTV	CLOSED CIRCUIT TELEVISION
COM	COMMON
CP	CONTROL PANEL
CPT	CONTROL POWER TRANSFORMER
CR	CONTROL RELAY
CRI	COLOR RENDERING INDEX
CT	CURRENT TRANSFORMER
DB	DECIBEL
DC	DIRECT CURRENT
DISC	DISCONNECT
DP	DISTRIBUTION PANEL
DWG	DRAWING
EF	EXHAUST FAN
EG	EQUIPMENT GROUND
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
ETM	ELAPSED TIME METER
FACP	FIRE ALARM CONTROL PANEL
FDS	FUSED DISCONNECT SWITCH
FLA	FULL LOAD AMPERES
FOC, FO	FIBER OPTIC CABLE
FRP	FIBERGLASS REINFORCED POLYESTER
FS	FLOAT SWITCH
FVNR	FULL VOLTAGE NON-REVERSING STARTER
FVR	FULL VOLTAGE REVERSING STARTER
G, GEN	GENERATOR
GDT	GRAPHIC DISPLAY TERMINAL
G, GND	GROUND
GRS	GALVANIZED RIGID STEEL
HH	HANDHOLE
HID	HIGH INTENSITY DISCHARGE
HMI	HUMAN MACHINE INTERFACE
HOR	HAND-OFF-REMOTE
HR	HOUR
HS	HAND SWITCH
HV	HIGH VOLTAGE
HZ	HERTZ
IG	ISOLATED GROUND
JB	JUNCTION BOX
KAIC	KILOAMP INTERRUPTING CAPACITY
KVAR	KILOVOLT-AMPERE, REACTIVE
KWH	KILOWATT-HOUR
L	240/208/120VAC CIRCUIT
LA	LIGHTNING ARRESTER
LCP	LOCAL CONTROL PANEL
LLF	LIGHT LOSS FACTOR
LOR	LOCAL-OFF-REMOTE
LP	LIGHTING PANEL
LRA	LOCKED ROTOR AMPERES
LV	LOW VOLTAGE
MCA	MINIMUM CIRCUIT AMPACITY
MCB	MAIN CIRCUIT BREAKER
MCC	MOTOR CONTROL CENTER
MCP	MOTOR CIRCUIT PROTECTOR
MH	MANHOLE
MLO	MAIN LUG ONLY
MOCP	MAXIMUM OVER CURRENT PROTECTION
MS	MOTOR STARTER
MTD	MOUNTED
MV	MEDIUM VOLTAGE
N	COMMUNICATION CIRCUIT
NC	NORMALLY CLOSED
NCHC	NORMALLY CLOSED HELD OPEN
NCTC	NORMALLY CLOSED TIMED CLOSED
NCTO	NORMALLY CLOSED TIMED OPEN
NEC	NATIONAL ELECTRICAL CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEUT	NEUTRAL
NFDS	NON-FUSED DISCONNECT SWITCH
NO	NORMALLY OPEN
NOHC	NORMALLY OPEN HELD CLOSED
NOTC	NORMALLY OPEN TIMED CLOSED
NOTO	NORMALLY OPEN TIMED OPEN
OHE	OVERHEAD ELECTRIC
OIT	OPERATOR INTERFACE TERMINAL
OL	OVERLOAD
OOR	ON-OFF-REMOTE
P	480VAC POWER CIRCUIT, POLE
PP	POWER PANEL
PB	PUSH BUTTON OR PULLBOX
PCC	POINT OF COMMON COUPLING
PEC	PHOTO ELECTRIC CELL
PF	POWER FACTOR
PFCC	POWER FACTOR CORRECTION CAPACITOR
PH, Ø	PHASE
PL	PILOT LIGHT
PM	PHASE MONITOR
PTT	PUSH-TO-TEST
RECPT	RECEPTACLE
RVAT	REDUCED VOLTAGE AUTO-TRANSFORMER
RVSS	REDUCED VOLTAGE SOFT STARTER
S	SECOND, SIGNAL/ANALOG CIRCUIT
SS	STAINLESS STEEL
SA	SURGE ARRESTER
SDBC	SOFT DRAWN BARE COPPER
SE	SERVICE ENTRANCE
SPD	SURGE PROTECTION DEVICE
SSOL	SOLID STATE OVERLOAD RELAY
STP	SHIELDED TWISTED PAIR
SV	SOLENOID VALVE
SW	SWITCH
SWB, SWBD	SWITCHBOARD
SWGR	SWITCHGEAR
T, XFMR	TRANSFORMER
TC	TIME CLOCK
TD	TIME DELAY
TEL	TELEPHONE
THD	TOTAL HARMONIC DISTORTION
TM	THERMAL MAGNETIC TRIP
UG	UNDERGROUND
UGE	UNDERGROUND ELECTRIC
UH	UNIT HEATER
UL	UNDERWRITERS LABORATORIES, INC
UTP	UNSHIELDED TWISTED PAIR
V	VOLTS
VAC	VOLTAGE ALTERNATING CURRENT
VFD, V	VARIABLE FREQUENCY DRIVE
VM	VOLT-METER
WH	WEATHER HEAD
WM	WATT METER
WP	WEATHERPROOF
1P	SINGLE POLE
3P	THREE POLE

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. STAMPS
LICENSED
30899
KANSAS
PROFESSIONAL ENGINEER
02.12.2025

REV.	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL NOTES AND ABBREVIATIONS

JOB NO.: 2400521
DATE: JAN. 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-102

SHEET NUMBER **29** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-102 ELECTRICAL NOTES AND ABBREVIATIONS.dwg Last Saved: 1/14/2025 1:49 PM Last saved by: ASGringer
Last plotted by: Shanahan, Daryl R Plot Style: — Plot Scale: 1:2.465 Plot Date: 2/17/2025 3:35 PM Xrefs Used: None


GENERAL NOTES:

1. ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE NFPA 70 NATIONAL ELECTRICAL CODE, NFPA 101 LIFE SAFETY CODE, NFPA 70E ELECTRICAL SAFETY CODE, STATE ELECTRICAL CODE, AND LOCAL ELECTRICAL CODE.
2. THE CONTRACTOR SHALL MAKE ELECTRICAL CONNECTIONS TO EVERYTHING FURNISHED OR INSTALLED BY THIS CONTRACT, WHETHER INDICATED OR NOT ON THE ELECTRICAL DRAWINGS.
3. PROVIDE LUGS AS REQUIRED TO FIT WIRING.

KEY NOTES:


(1) VERIFY CIRCUIT BREAKER AND CONDUCTOR REQUIREMENTS WITH SUPPLIED EQUIPMENT. ADJUST SIZES AS REQUIRED.

(2) SEE ONELINE DIAGRAM FOR CONDUIT AND CONDUCTOR SIZES.

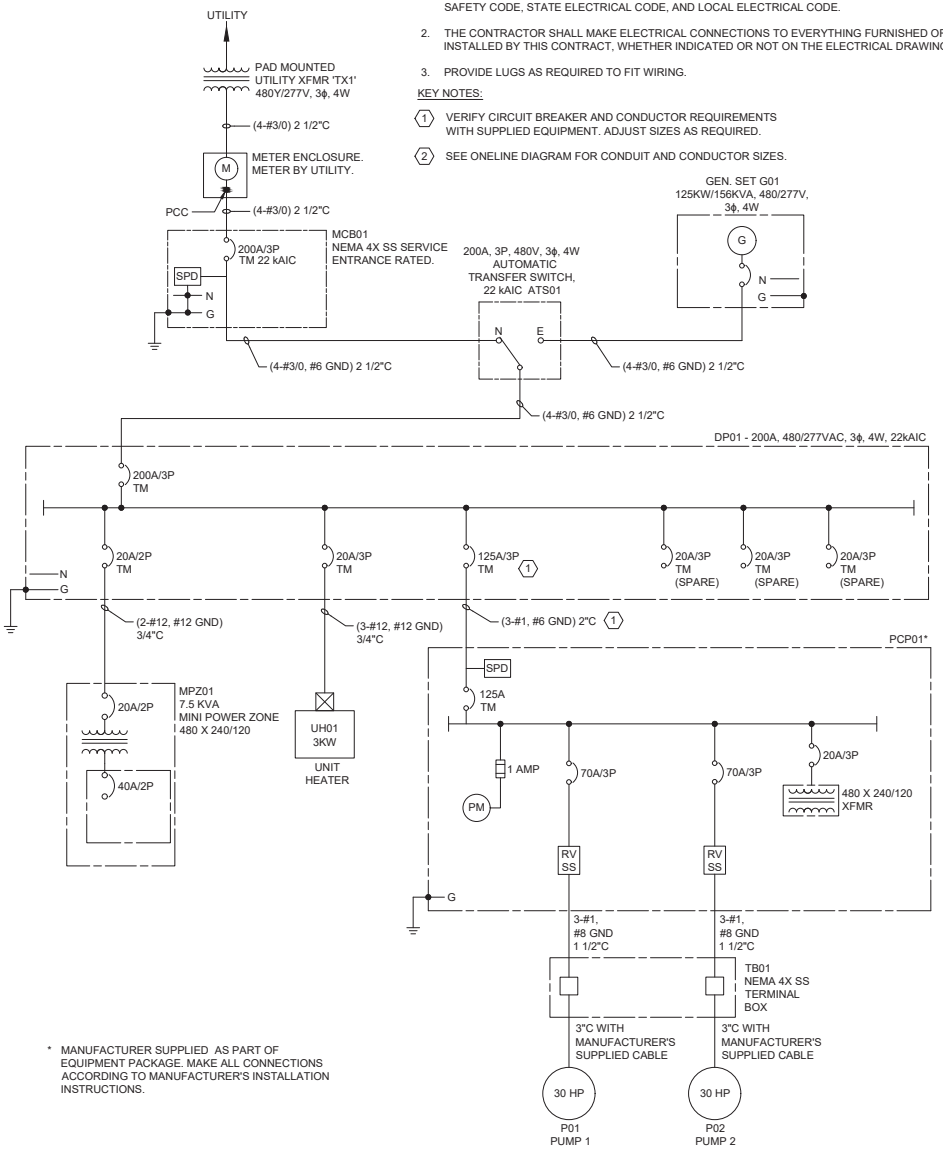

* MANUFACTURER SUPPLIED AS PART OF EQUIPMENT PACKAGE. MAKE ALL CONNECTIONS ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS.


1 / E-103 PEGASUS ADDITION LIFT STATION ONELINE DIAGRAM
SCALE: NONE

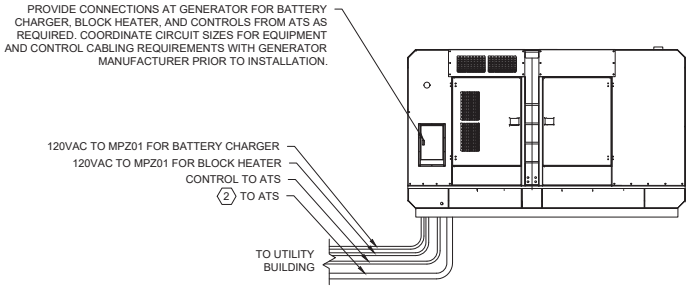

2 / E-101 PEGASUS ADDITION - GENERATOR ELEVATION
SCALE: NONE

GENERAL NOTE:

ELECTRICAL CONTRACTOR SHALL VERIFY CONDUIT QUANTITIES NEEDED. ALL CONDUITS REQUIRED MAY NOT BE SHOWN IN THIS RISER DIAGRAM.

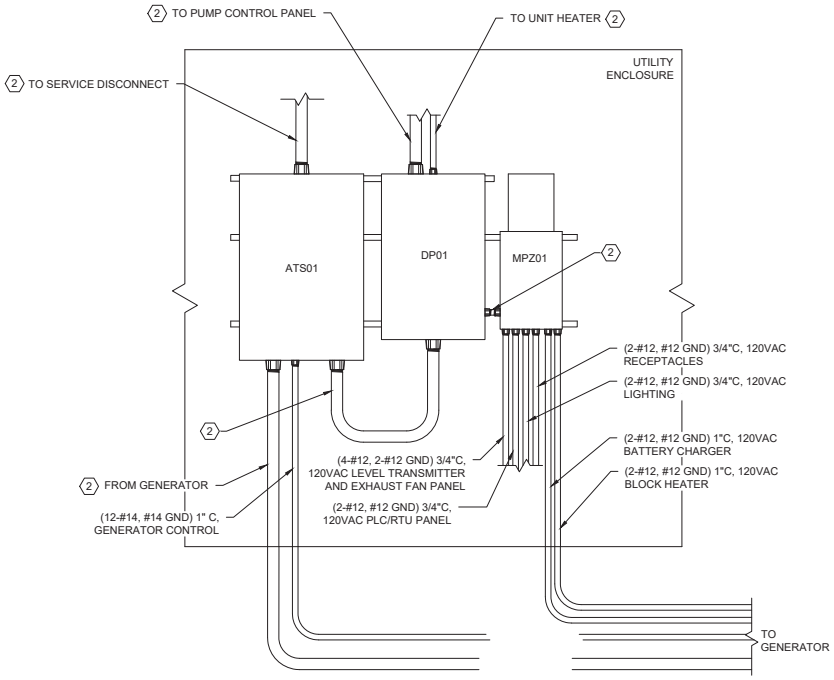

3 / E-103 PEGASUS ADDITION POWER PANELS ELEVATION
SCALE: NONE

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. SYMNS
LICENSED
30899
KANSAS
PROFESSIONAL ENGINEER
02.12.2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ONELINE DIAGRAM AND PANEL ELEVATION DRAWING


JOB NO.: 2400521
DATE: FEB 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-103

SHEET NUMBER **30** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-103 ONELINE DIAGRAM AND PANEL ELEVATION DRAWING.dwg Last Save: 2/12/2025 12:02 PM Last saved by: ASGringer
Last plotted by: Gringer, Adam S Plot Style: --- Plot Scale: 1:1.56 Plot Date: 2/12/2025 1:18 PM Plotter used: None

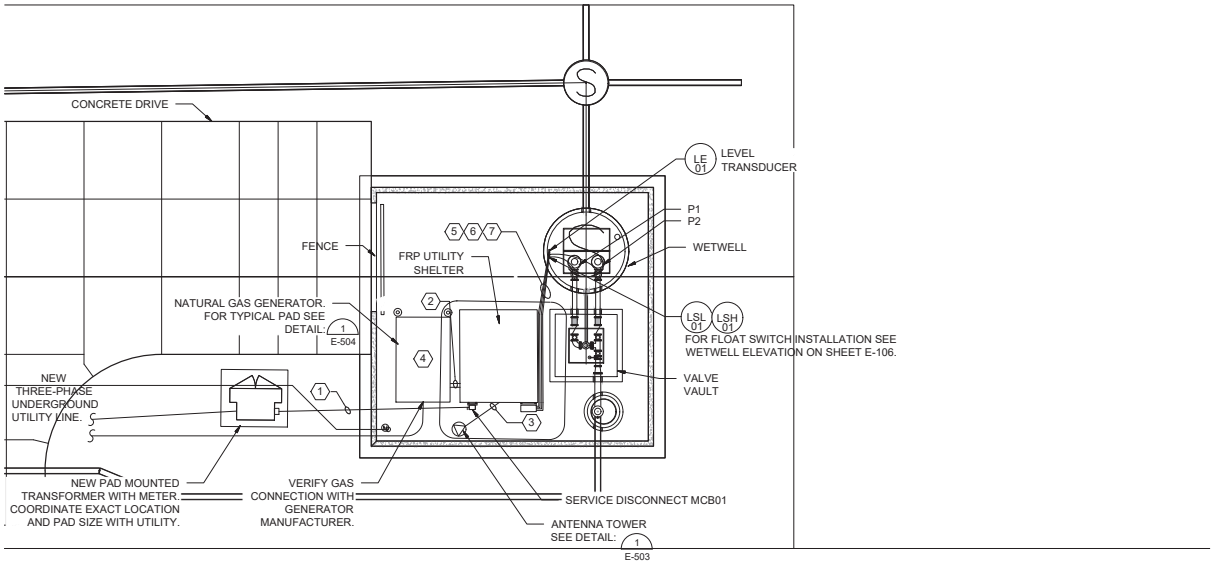

PROJECT NORTH

1 E-104 PEGASUS LIFT STATION ELECTRICAL SITE PLAN

SCALE: ⅛" = 1'-0"

KEY NOTES:

1. SEE ONELINE ON SHEET E1 FOR CONDUIT AND CONDUCTOR SIZING.
2. SEE ONELINE ON SHEET E1 FOR CONDUIT AND CONDUCTOR SIZING FROM GENERATOR TO EQUIPMENT IN UTILITY SHELTER.
3. (RF CABLE) 2" C, SIGNAL. FROM ANTENNA TO PLC/RTU CONTROL PANEL.
4. MAKE ALL REQUIRED CONNECTIONS BETWEEN GENERATOR, AUTOMATIC TRANSFER SWITCH, AND MINI POWER ZONE ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS.
5. (2) (MANUFACTURER'S SUPPLIED PUMP CORDS) 3" C, 480 VAC, FROM WET WELL, THROUGH VENTRIB TROUGH, TO JUNCTION BOX TB01.
6. (MANUFACTURER'S SUPPLIED CABLES) 2" C, SIGNAL. FROM FLOAT SWITCHES LSL01 AND LSH01 AT WETWELL, THROUGH VINTRIB TROUGH, TO TB01.
7. (MANUFACTURER SUPPLIED CABLE) 2"C, SIGNAL. FROM LEVEL TRANSDUCER LE01, THROUGH VENTRIB TROUGH, TO JUNCTION BOX TB01.

GENERAL NOTES:

1. UNLESS OTHERWISE NOTED, ALL CONDUIT AND PORTIONS OF THE CONDUIT SYSTEM SHALL BE SURFACE MOUNTED AND THE CONDUIT SYSTEM WITHIN THE FRP UTILITY SHELTER SHALL BE GALVANIZED RIGID STEEL, ALL OTHERS SHALL BE PVC COATED RIGID STEEL. ALL BOXES, SUPPORTS, HANGERS, UNISTRUT AND ALL OTHER PORTIONS OF THE CONDUIT SYSTEM WITHIN THE FRP UTILITY SHELTER SHALL BE GALVANIZED STEEL, ALL OTHERS SHALL BE PVC COATED OR STAINLESS STEEL. ALL BELOW GRADE CONDUIT FROM THE WET WELL TO THE ELECTRICAL ENCLOSURE SHALL BE PVC COATED RIGID STEEL, ALL OTHERS SHALL BE SCHEDULE 40 PVC WITH GALVANIZED ELBOWS.
2. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUIT, WIRING, TERMINATIONS, DISCONNECTS, CONTROL RELAYS, CONTROL ENCLOSURES AND OTHER ITEMS AS NECESSARY FOR COMPLETE AND FUNCTIONAL LIFT STATION. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND OTHER SECTIONS OF THE PLANS FOR ITEMS AS MAY BE REQUIRED.
3. COORDINATE ALL CONDUIT ROUTING WITH ENGINEER PRIOR TO INSTALLATION.
4. FIELD LOCATE FINAL LOCATIONS OF ALL DIRECT BURIED CONDUITS AND PULLBOXES (IF REQUIRED). PROVIDE PULLBOXES AS REQUIRED FOR A WORKABLE INSTALLATION. ALL PULLBOXES SHALL BE APPROPRIATELY SIZED BY THE CONTRACTOR AS REQUIRED BY THE NUMBER OF CONDUITS FOR A WORKABLE INSTALLATION WITH MINIMUM SIZES AS INDICATED WITHIN THE DETAILS. COORDINATE ALL WORK WITH APPLICABLE UTILITY COMPANIES, MATERIAL SUPPLIERS, AND OWNER REPRESENTATIVES.
5. ALL LOCATIONS WITHIN THE WET WELL AS INDICATED ON THIS PLAN SHEET SHALL BE CONSIDERED A CLASS 1, DIVISION 2 HAZARDOUS LOCATION AS DEFINED IN ACCORDANCE WITH NFPA 820.
6. CONTRACTOR SHALL STRICTLY ADHERE TO THE REQUIREMENTS IN NFPA 70, ARTICLE 500, HAZARDOUS (CLASSIFIED) LOCATIONS FOR ALL AREAS REFERENCED IN THE NOTE ABOVE. THIS INCLUDES PROVIDING APPROPRIATE SEAL FITTINGS ON CONDUITS AND CABLES ALONG WITH PROVIDING EXPLOSION PROOF EQUIPMENT, RATED FOR THE CLASSIFICATION REFERENCED ABOVE, WITHIN THE HAZARDOUS AREA IF LOCATED IN THE HAZARDOUS AREA.
7. CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING GAS SERVICE AND METER LOCATION WITH UTILITY COMPANY. CONTRACTOR SHALL PAY ALL COSTS ASSOCIATED WITH PROVIDING GAS SERVICE FROM THE EXISTING MAIN THROUGH THE SITE.
8. INSTALL NATURAL GAS SYSTEM PER: 2 E-504

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRIAN C. STANG LICENSED 30899 KANSAS PROFESSIONAL ENGINEER 02-12-2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

LIFT STATION ELECTRICAL SITE PLAN


JOB NO.: 2400521
DATE:FEB 2025
DESIGNED BY:WWN
DRAWN BY:TRP

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
E-104

SHEET NUMBER **31** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-104 LIFT STATION ELECTRICAL SITE PLAN.dwg Last Save: 2/12/2025 1:24 PM Last saved by: ASGinger
Last plotted by: Ginger, Adam S Plot Scale: 1.2:56 Plot Date: 2/12/2025 2:26 PM Plotter name: None

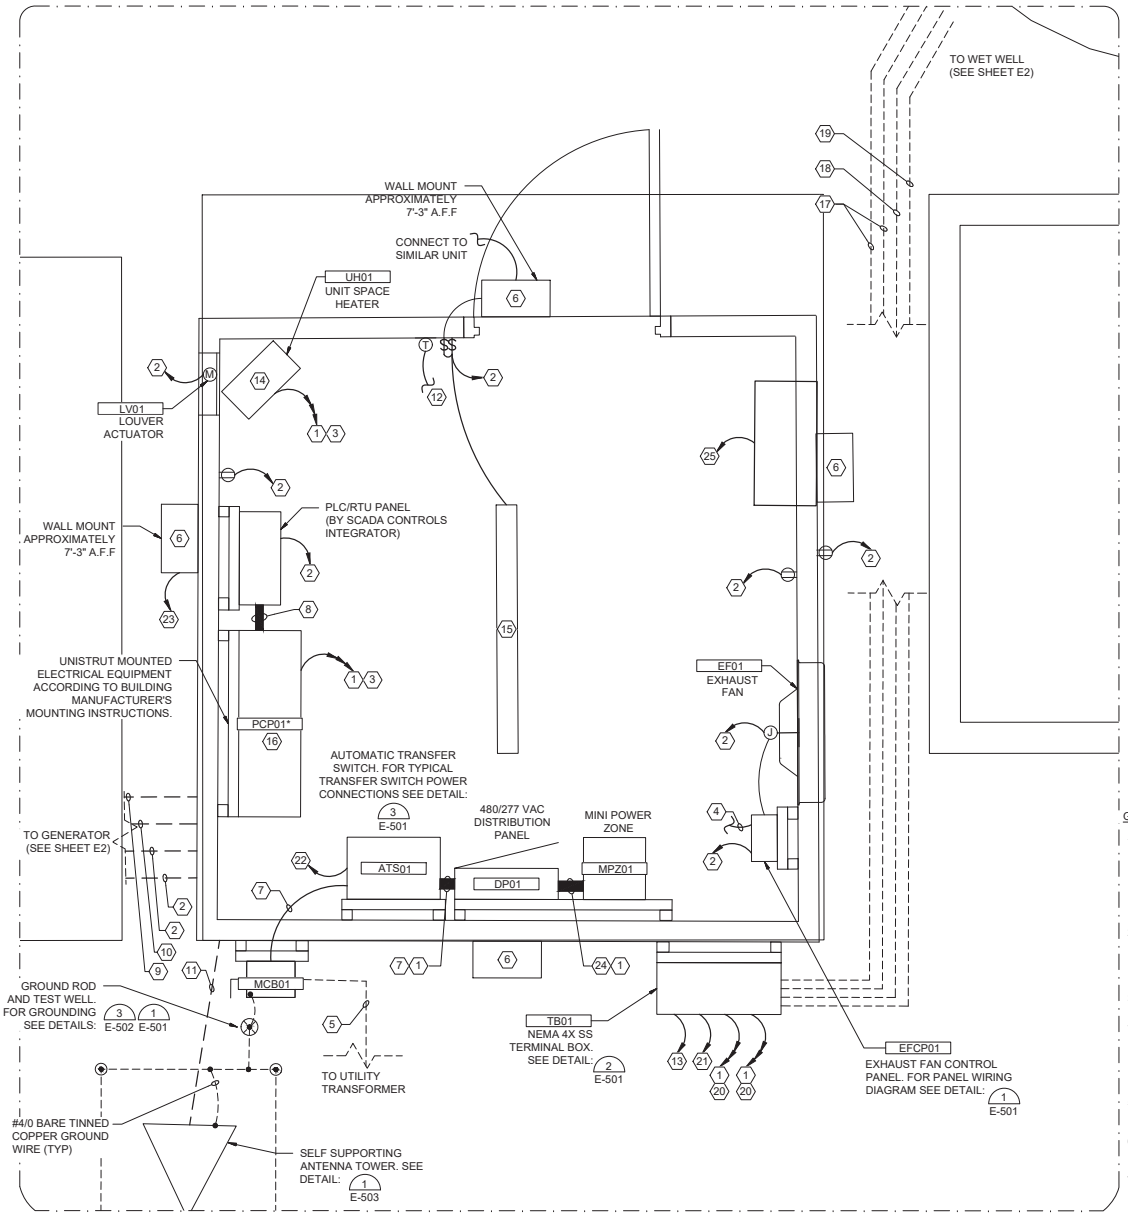

PEGASUS ADDITION LIFT STATION POWER PLAN

PROJECT NORTH

1 E-105

SCALE: 1" = 1'-0"

KEY NOTES:

1. SEE ONELINE ON SHEET E1 FOR CONDUIT AND CONDUCTOR SIZING.
2. 120VAC FROM MPZ01, SEE PANEL SCHEDULE FOR CONDUIT AND CONDUCTOR SIZES.
3. 480VAC FROM DP01, SEE ONELINE DIAGRAM FOR CONDUIT AND CONDUCTOR SIZES.
4. (2-#14, #14 GND) 3/4"C, 120VAC. FROM EFCP01 FOR LOUVER ACTUATOR.
5. 480VAC FROM UTILITY TRANSFORMER, SEE ONELINE DIAGRAM FOR CONDUIT AND CONDUCTOR SIZES. UNDERGROUND ELECTRICAL LINES ARE DIAGRAMMATIC IN NATURE, AND DO NOT NEED TO FOLLOW THIS PATH FOR INSTALLATION.
6. EXTERIOR LIGHT FIXTURE, SEE LIGHT FIXTURE SCHEDULE FOR MORE INFORMATION.
7. 480VAC POWER FROM ATS01 TO MCB01.
8. (10-#14, 2-STP, #14 GND, 10-#14 SPARE) 2"C, I/O SIGNAL.
9. FROM GEN. SET G01 TO AUTOMATIC TRANSFER SWITCH ATS01.
10. (12-#14, #14 GND) 1" C, CONTROL. FROM AUTOMATIC TRANSFER SWITCH ATS01 TO GEN. SET G01.
11. (RF CABLE) 2" C, SIGNAL. FROM ANTENNA TO PLC/RTU CONTROL PANEL.
12. PROVIDE CONDUIT AND CABLE AS REQUIRED BY THERMOSTAT MANUFACTURERS. MAKE ALL REQUIRED CONNECTIONS.
13. (2-3 CONDUCTOR SHIELDED CABLE) 1"C, LEVEL TRANSDUCER SIGNAL TO PUMP CONTROL PANEL PCPC01.
14. UNIT SPACE HEATER. INSTALL ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS. MAKE ALL REQUIRED CONNECTIONS.
15. INTERIOR LIGHT FIXTURE, SEE LIGHT FIXTURE SCHEDULE FOR MORE INFORMATION.
16. PUMP CONTROL PANEL PCP01 PROVIDED AS PART OF EQUIPMENT PACKAGE. SEE SPECIFICATIONS FOR PUMP STATION CONTROL PANEL DETAILS. MAKE ALL CONNECTIONS PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
17. (MANUFACTURER'S SUPPLIED PUMP CORDS) 3" C, 480 VAC, FROM WET WELL THROUGH VENTRIB TROUGH TO JUNCTION BOX TB01.
18. (MANUFACTURER'S SUPPLIED CABLE) 2" C, SIGNAL. FROM LEVEL TRANSMITTER LT01 AT WETWELL TO TB01.
19. (MANUFACTURER'S SUPPLIED CABLES) 2" C, SIGNAL. FROM FLOAT SWITCHES LS01/02/03/04/05 AT WETWELL TO TB01.
20. 480VAC POWER FOR PUMPS FROM PUMP CONTROL PANEL.
21. (8-#14, 2-STP, #14 GND) 2"C, FLOAT SWITCHES, PUMP SEAL, AND OVERTEMP SIGNALS TO PUMP CONTROL PANEL
22. (6-#14, #14 GND, 6-#14 SPARE) 2"C, I/O SIGNAL. TO PLC/RTU PANEL.
23. (2-#12, #12 GND) 3/4"C, 120VAC. FROM LIGHT SWITCH IN FRP ENCLOSURE.
24. 480VAC POWER FROM DP01 TO MPZ01.
25. (2-#10, #10 GND) 1"C. 115V WINDOW AC UNIT.

GENERAL NOTES:

1. UNLESS OTHERWISE NOTED, ALL CONDUIT AND PORTIONS OF THE CONDUIT SYSTEM SHALL BE SURFACE MOUNTED AND THE CONDUIT SYSTEM WITHIN THE UTILITY SHELTER SHALL BE GALVANIZED RIGID STEEL, ALL OTHERS SHALL BE PVC COATED RIGID STEEL. ALL BOXES, SUPPORTS, HANGERS, UNISTRUT AND ALL OTHER PORTIONS OF THE CONDUIT SYSTEM WITHIN THE UTILITY SHELTER SHALL BE GALVANIZED STEEL, ALL OTHERS SHALL BE PVC COATED OR STAINLESS STEEL. ALL BELOW GRADE CONDUIT FROM THE WET WELL TO THE ELECTRICAL ENCLOSURE SHALL BE PVC COATED RIGID STEEL, ALL OTHERS SHALL BE SCHEDULE 40 PVC WITH GALVANIZED ELBOWS.
2. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUIT, WIRING, TERMINATIONS, DISCONNECTS, CONTROL RELAYS, CONTROL ENCLOSURES AND OTHER ITEMS AS NECESSARY FOR COMPLETE AND FUNCTIONAL LIFT STATION. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND OTHER SECTIONS OF THE PLANS FOR ITEMS AS MAY BE REQUIRED.
3. COORDINATE ALL CONDUIT ROUTING WITH ENGINEER PRIOR TO INSTALLATION.
4. FIELD LOCATE FINAL LOCATIONS OF ALL DIRECT BURIED CONDUITS AND PULLBOXES. PROVIDE PULLBOXES AS REQUIRED FOR A WORKABLE INSTALLATION. ALL PULLBOXES SHALL BE APPROPRIATELY SIZED BY THE CONTRACTOR AS REQUIRED BY THE NUMBER OF CONDUITS IN THE DUCT BANK FOR A WORKABLE INSTALLATION WITH MINIMUM SIZES AS INDICATED WITHIN THE DETAILS. COORDINATE ALL WORK WITH APPLICABLE UTILITY COMPANIES, MATERIAL SUPPLIERS, AND OWNER REPRESENTATIVES.
5. ALL UNISTRUT MOUNTING RACKS WITH ELECTRICAL EQUIPMENT ATTACHED SHALL BE SECURED FROM THE FLOOR AND TO THE WALL. SEE
6. ALL LOCATIONS WITHIN THE WET WELL AS INDICATED ON THIS PLAN SHEET SHALL BE CONSIDERED A CLASS 1, DIVISION 2 HAZARDOUS LOCATION AS DEFINED IN ACCORDANCE WITH NFPA 820.
7. CONTRACTOR SHALL STRICTLY ADHERE TO THE REQUIREMENTS IN NFPA 70, ARTICLE 500, HAZARDOUS (CLASSIFIED) LOCATIONS FOR ALL AREAS REFERENCED IN THE NOTE ABOVE. THIS INCLUDES PROVIDING APPROPRIATE SEAL FITTINGS ON CONDUITS AND CABLES ALONG WITH PROVIDING EXPLOSION PROOF EQUIPMENT, RATED FOR THE CLASSIFICATION REFERENCED ABOVE, WITHIN THE HAZARDOUS AREA IF LOCATED IN THE HAZARDOUS AREA.
8. USE CRIMPED OR BOLTED CONNECTIONS FOR ALL CONNECTIONS BETWEEN CONDUCTORS AND BUILDING SYSTEM COMPONENTS. USE EXOTHERMIC WELDED CONNECTIONS FOR ALL UNDERGROUND PORTIONS OF THE SYSTEM WITH THE EXCEPTION OF GROUND ROD TEST WELLS.

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. SYMONS LICENSED 30899 KANSAS PROFESSIONAL ENGINEER 02.12.2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

LIFT STATION UTILITY SHELTER ELECTRICAL PLAN


JOB NO.: 2400521
DATE: FEB 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-105

SHEET NUMBER **32** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-105 LIFT STATION UTILITY SHELTER ELECTRICAL PLAN.dwg Last Save: 2/12/2025 1:36 PM Last saved by: ASGinger
Last plotted by: GHager, Adam S Plot Style: --- Plot Scale: 1:2.56 Plot Date: 2/12/2025 2:15 PM Plotter name: None

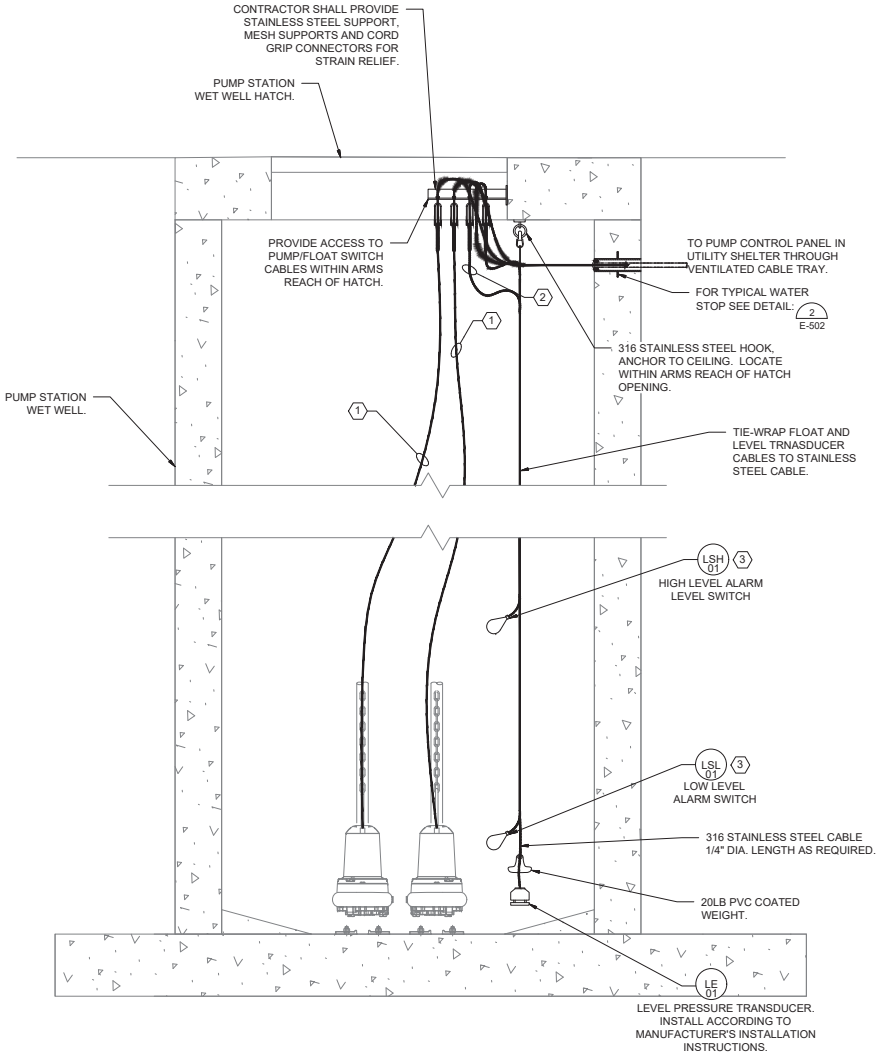

1 E-106 WET WELL ELEVATION DIAGRAM

SCALE: NONE

PANEL NO.:	MPZ01
USAGE:	PANELBOARD
LOCATION:	LIFT STATION
PHASES:	1
L-L VOLTS	240V
L-G VOLTS	120V
BUS AMPS:	40A
MAIN CB AMPS:	40A
AIC RATING:	10,000

PROJECT:	PEGASUS ADDITION LIFT STATION
CLIENT:	CITY OF WITCHITA
MOUNTING:	SURFACE
PANEL TYPE:	PANELBOARD
ENGINEER:	BCS
PROJECT NO.:	2400521
FED FROM:	DP01

CIRCUIT SETS	WIRE	NEUT	GND	COND.	LOAD AMPS.	DESCRIPTION	NOTES	BREAKER POLE	AMP.	CKT. #		CKT. #	BREAKER AMP.	POLE	NOTES	DESCRIPTION	LOAD AMPS.	CIRCUIT SETS	WIRE	NEUT	GND.	COND.
1	#12	#12	#12	3/4"	4.5	RECEPT		1	20	1	A	2	15	1		LIGHTING	0.8	1	#12	#12	#12	3/4"
1	#12	#12	#12	3/4"	1.4	EXHAUST FAN		1	20	3	B	4	15	1		PLC/RTU PANEL	1.7	1	#12	#12	#12	3/4"
1	#12	#12	#12	3/4"	15.0	GENERATOR BLOCK HTR		1	20	5	A	6	15	1		LOUVER	2.0	1	#12	#12	#12	3/4"
1	#12	#12	#12	3/4"	1.5	GENERATOR BATT		1	20	7	B	8	20	1		RECEPT (A/C UNIT)		1	#12	#12	#12	3/4"
						SPARE		1	20	9	A	10	20	1		SPARE						

LOAD SUMMARY	CON. KVA	%	DEM. KVA
RECEPTACLES	0.54	code	0.54
MOTORS	0.18	100%	0.18
LIGHTS (INT.)	0	125%	0
LIGHTS (EXT.)	0.3	125%	0.375
HVAC (HEAT)	0	100%	0
HVAC (COOL)	0	100%	0
VENTILATION	0	100%	0
KITCHEN	0	65%	0
EMERGENCY	0	100%	0
MISC.	0	100%	0
FUTURE	0	100%	0
OTHER	1.98	100%	1.98
TRACK	0	100%	0
LARGEST MTR	0	25%	0
TOTAL KVA	3 KVA		3 KVA
TOTAL AMPS	13 AMPS		13 AMPS

PANEL NOTES:
1. PROVIDE GROUND BUS
2. PROVIDE FULL SIZE NEUTRAL BUS UNLESS NOTED OTHERWISE

2 E-106 MPZ01 PANEL SCHEDULE

SCALE: NONE

DESCRIPTION	MANUFACTURER	CATALOG NUMBER
LED 4' LOW-PROFILE ENCLOSED AND GASKETED	LITHONIA	FEM L48 4000LM LPAFL MD 90CRI 40K
LED WALL PACK	LITHONIA	TWR1 LED ALO-MED 40K UVOLT

3 E-106 LIGHT FIXTURE SCHEDULE

SCALE: NONE

KEY NOTES:

1. MANUFACTURER SUPPLIED PUMP CORDS FROM WET WELL TO VENTRIB TROUGH.
2. MANUFACTURER SUPPLIED CABLE FOR LEVEL TRANSDUCER TO VENTRIB TROUGH.
3. COORDINATE FLOAT LEVEL SWITCH MOUNTING HEIGHTS WITH OWNER AND ENGINEER.

GENERAL NOTES:

1. ALL BELOW GRADE CONDUIT FROM THE WET WELL TO THE ELECTRICAL ENCLOSURE SHALL BE PVC COATED RIGID STEEL.
2. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUIT, WIRING, TERMINATIONS, DISCONNECTS, CONTROL RELAYS, CONTROL ENCLOSURES AND OTHER ITEMS AS NECESSARY FOR COMPLETE AND FUNCTIONAL PUMP STATION. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND OTHER SECTIONS OF THE PLANS FOR ITEMS AS MAY BE REQUIRED.
3. COORDINATE ALL CONDUIT ROUTING WITH ENGINEER PRIOR TO INSTALLATION.
4. ALL LOCATIONS WITHIN THE WET WELL AND METER VAULT AS INDICATED ON THIS PLAN SHEET SHALL BE CONSIDERED A CLASS 1, DIVISION 2 HAZARDOUS LOCATION AS DEFINED IN ACCORDANCE WITH NFPA 820.
5. CONTRACTOR SHALL STRICTLY ADHERE TO THE REQUIREMENTS IN NFPA 70, ARTICLE 500, HAZARDOUS (CLASSIFIED) LOCATIONS FOR ALL AREAS REFERENCED IN THE NOTE ABOVE. THIS INCLUDES PROVIDING APPROPRIATE SEAL FITTINGS ON CONDUITS AND CABLES ALONG WITH PROVIDING EXPLOSION PROOF EQUIPMENT, RATED FOR THE CLASSIFICATION REFERENCED ABOVE, WITHIN THE HAZARDOUS AREA IF LOCATED IN THE HAZARDOUS AREA.

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRENDEN C. STANG LICENSED 30899 KANSAS PROFESSIONAL ENGINEER

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

WETWELL ELEVATION DIAGRAM AND MPZ01 PANEL SCHEDULE


JOB NO.: 2400521
DATE: FEB. 2025
DESIGNED BY: BCS
DRAWN BY: ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-106

SHEET NUMBER 33 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-106 WETWELL ELEVATION DIAGRAM AND MPZ01 PANEL SCHEDULE.dwg Last Saved: 1/14/2025 5:40 PM Last saved by: ASGringer
Last Added by: Stanchich, Daryl R. Plot Scale: 1.2:365 Plot Date: 2/17/2025 5:37 PM Plotter Used: None

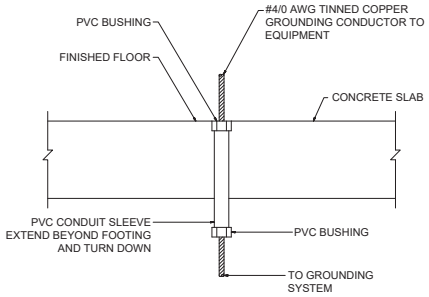


NOTES:

1. EXTEND PVC CONDUIT TO TOP OF BASE, OR PEDESTAL FOR BASE,FOR PEDESTAL MOUNTED EQUIPMENT. SUPPORT AT (2) PLACES(MIN).
2. SEAL ALL SLEEVES TO PREVENT WATER PENETRATION.

1 / E-501 GROUNDING CONDUIT SLEEVE DETAIL

SCALE: NONE

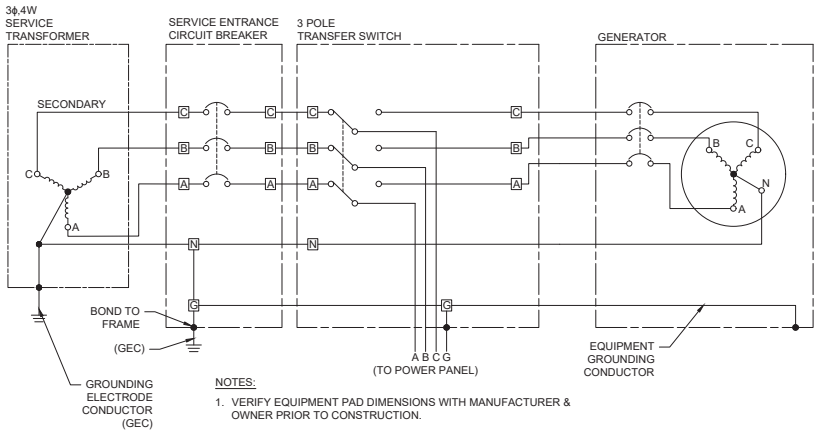


NOTES:

1. VERIFY EQUIPMENT PAD DIMENSIONS WITH MANUFACTURER & OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE FRONT, BACK & SIDE CLEARANCES AS REQUIRED

3 / E-501 3 POLE TRANSFER SWITCH CONNECTION DETAIL

SCALE: NONE

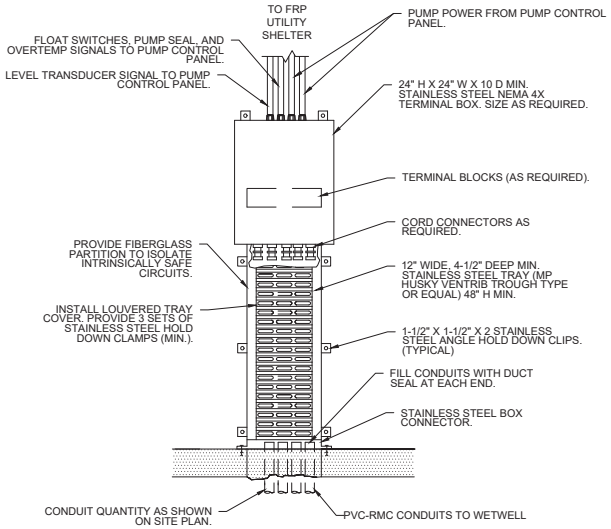

2 / E-501 TERMINAL BOX CABLE ENTRY DETAIL

SCALE: NONE

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRIAN C. STANLEY LICENSED 30899 KANSAS PROFESSIONAL ENGINEER

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL DETAILS I


JOB NO.: 2400521
DATE:FEB. 2025
DESIGNED BY:BCS
DRAWN BY:ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-501


SHEET NUMBER **34** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-500 ELECTRICAL DETAILS I THRU IV.dwg Last Save: 1/24/2025 7:17 AM Last saved by: ASGringer
Last plotted by: Stanelick, Daryl R. Plot Style: — Plot Scale: 1:2.965 Plot Date: 2/17/2025 3:38 PM Plotter used: None

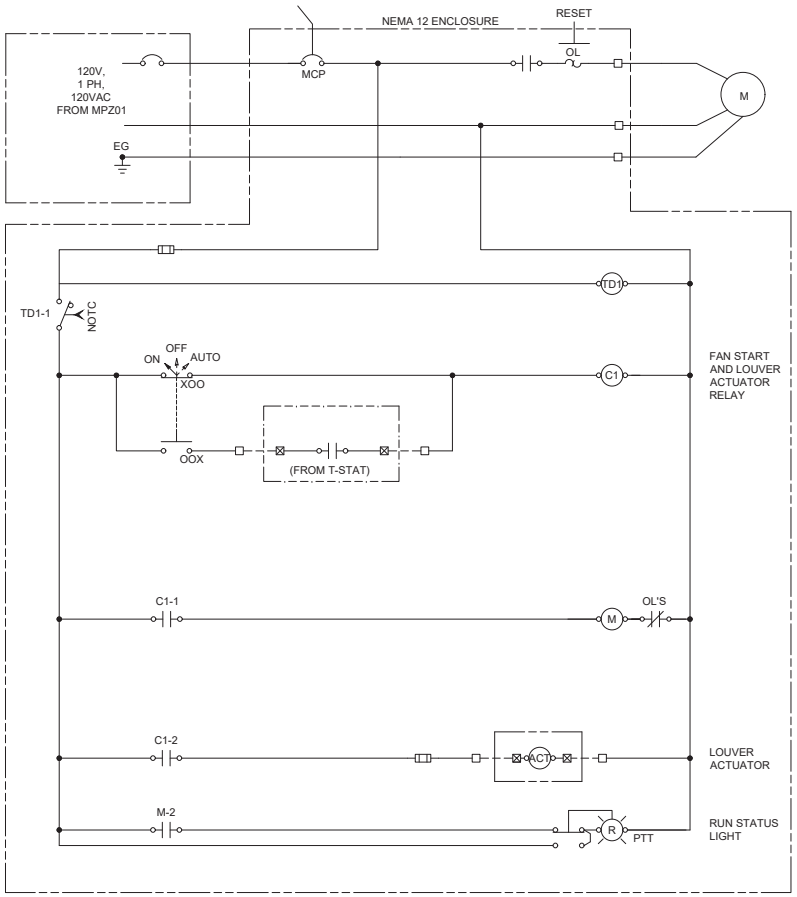


NOTES:
1. COORDINATE T-STAT VOLTAGE REQUIREMENTS WITH MANUFACTURER'S RECOMENDATIONS. PROVIDE LV TRANSFORMER IF REQUIRED.

1 / E-502 EXHAUST FAN PANEL SCHEMATIC DETAIL
SCALE: NONE

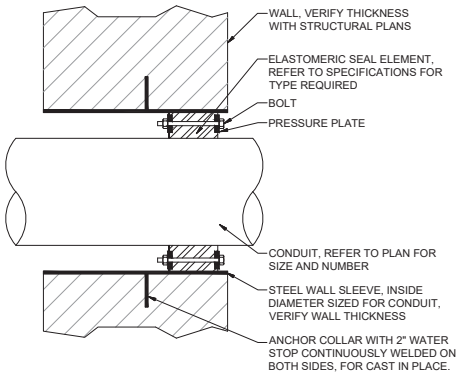

"LINK-SEAL" MODULAR SEAL WITH MODEL 'WS' STEEL WALL SLEEVES

2 / E-502 TYPICAL WATER STOP SEALING DETAIL
SCALE: NONE

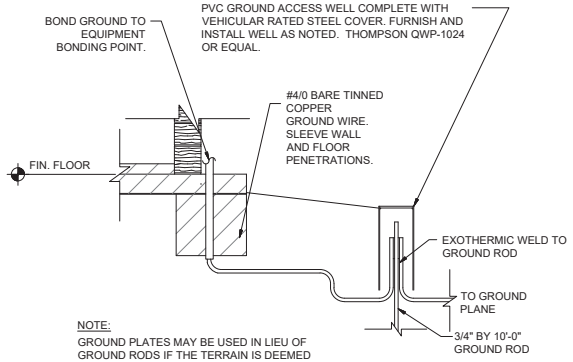

NOTE:
GROUND PLATES MAY BE USED IN LIEU OF GROUND RODS IF THE TERRAIN IS DEEMED UNSUITABLE FOR RODS. ACCESS WELLS WILL STILL BE REQUIRED FOR EACH PLATE AND SHALL HAVE A SUITABLE DIAMETER FOR THE INSTALLED PLATE.

3 / E-502 GROUND ROD CONNECTION DETAIL
SCALE: NONE

GARVER

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRIAN C. SIMMONS LICENSED 30899 KANSAS PROFESSIONAL ENGINEER
02/12/2025

REV	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL DETAILS II


JOB NO.: 2400521
DATE:FEB 2025
DESIGNED BY:BCS
DRAWN BY:ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

DRAWING NUMBER
E-502

SHEET NUMBER 35 OF 38

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-500 ELECTRICAL DETAILS I THRU IV.dwg LastSave: 1/24/2025 8:17 AM LastSaved By: ASSinger
Last plotted by: Ginger, Adam S Plot Scale: 1:2.56 Plot Date: 2/12/2025 12:12 PM Plotter: Letter None

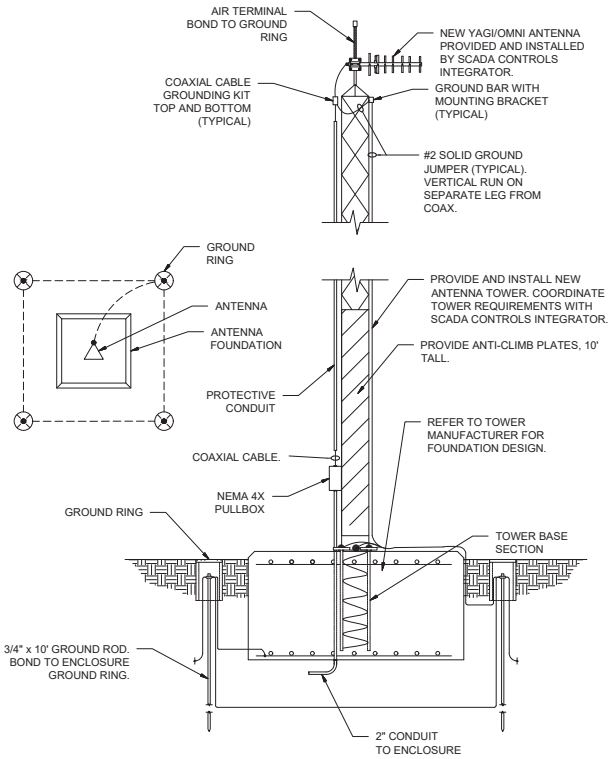


NOTE:

CONTRACTOR TO INSTALL SELF-SUPPORTING TOWER AND STRUCTURAL BASE PER MANUFACTURER'S DESIGN. REFER TO SPECIFICATIONS FOR REQUIREMENT.

1 / E-503 TYPICAL ANTENNA TOWER DETAIL

SCALE: NONE

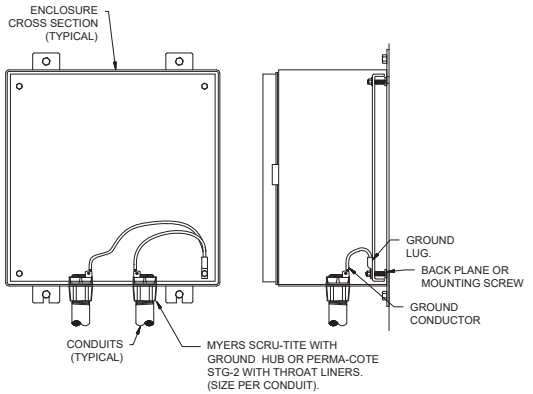

NOTES:

1. ALL SERVICE, FEEDER, AND CONTROL CONDUITS SHALL BE GROUNDED ON BOTH ENDS.

2 / E-503 CONDUIT GROUNDING DETAIL

SCALE: NONE

© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. SWING LICENSED 30899 KANSAS PROFESSIONAL ENGINEER
02.12.2025

REV	DATE	DESCRIPTION	BY

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL DETAILS III


JOB NO.: 2400521
DATE:FEB 2025
DESIGNED BY:BCS
DRAWN BY:ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.


DRAWING NUMBER
E-503

SHEET NUMBER **36** OF **38**


File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-500 ELECTRICAL DETAILS I THRU IV.dwg LastSave: 1/24/2025 8:17 AM LastSaved by: ASGinger
Last plotted by: GInger, Adam S Plot Scale: 1.2:56 Plot Date: 2/12/2025 12:13 PM Plotter: Letter None

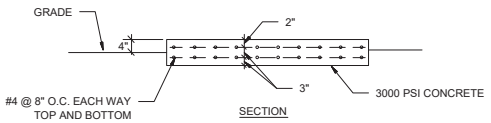

1. THICKNESS AND STEEL MUST BE SIZED PER GENERATOR SIZE.
2. PAD BY GENERAL CONTRACTOR. ELECTRICAL CONTRACTOR TO VERIFY ALL REQUIREMENTS WITH EQUIPMENT PROVIDED PRIOR TO GENERAL CONTRACTOR POURING PAD.

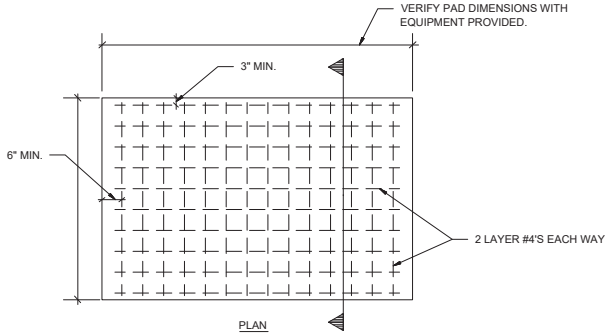

1 E-504 GENERATOR PAD DETAIL
SCALE: NONE

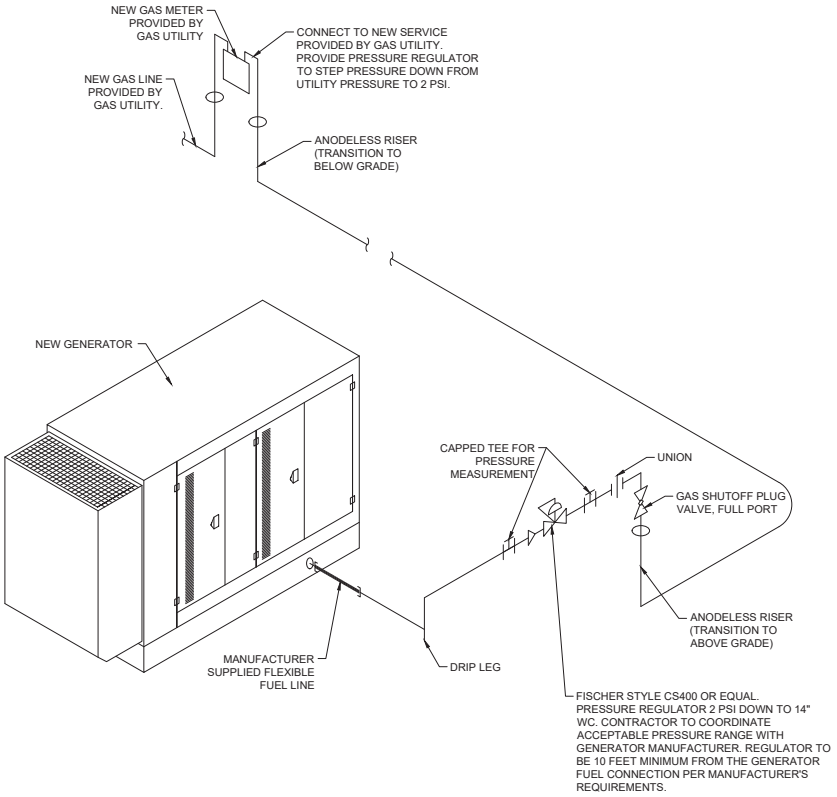

2 E-504 NATURAL GAS SYSTEM ISOMETRIC
SCALE: NONE

GARVER
© 2025 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.

BRADEN C. STANLEY LICENSED 30899 KANSAS PROFESSIONAL ENGINEER
02.12.2025

REV.	DATE	DESCRIPTION	BY

WICHITA

CITY OF WICHITA
WICHITA, KANSAS

PEGASUS LIFT STATION

ELECTRICAL DETAILS IV

JOB NO.: 2400521
DATE:FEB 2025
DESIGNED BY:BCS
DRAWN BY:ASG

BAR IS ONE INCH ON ORIGINAL DRAWING
0 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER
E-504


SHEET NUMBER **37** OF **38**

File: L:\2024\T41-2400521 - Pegasus Addition Design\Drawings_SS LIFT STATION\E-500 ELECTRICAL DETAILS I THRU IV.dwg Last Save: 1/24/2025 8:17 AM Last saved by: ASGringer
Last plotted by: Gringer, Adam S Plot Style: --- Plot Scale: 1:2.56 Plot Date: 2/7/2025 12:13 PM Plotter: Letter: None

Final Plat

PEGASUS ADDITION

Wichita, Sedgwick County, Kansas

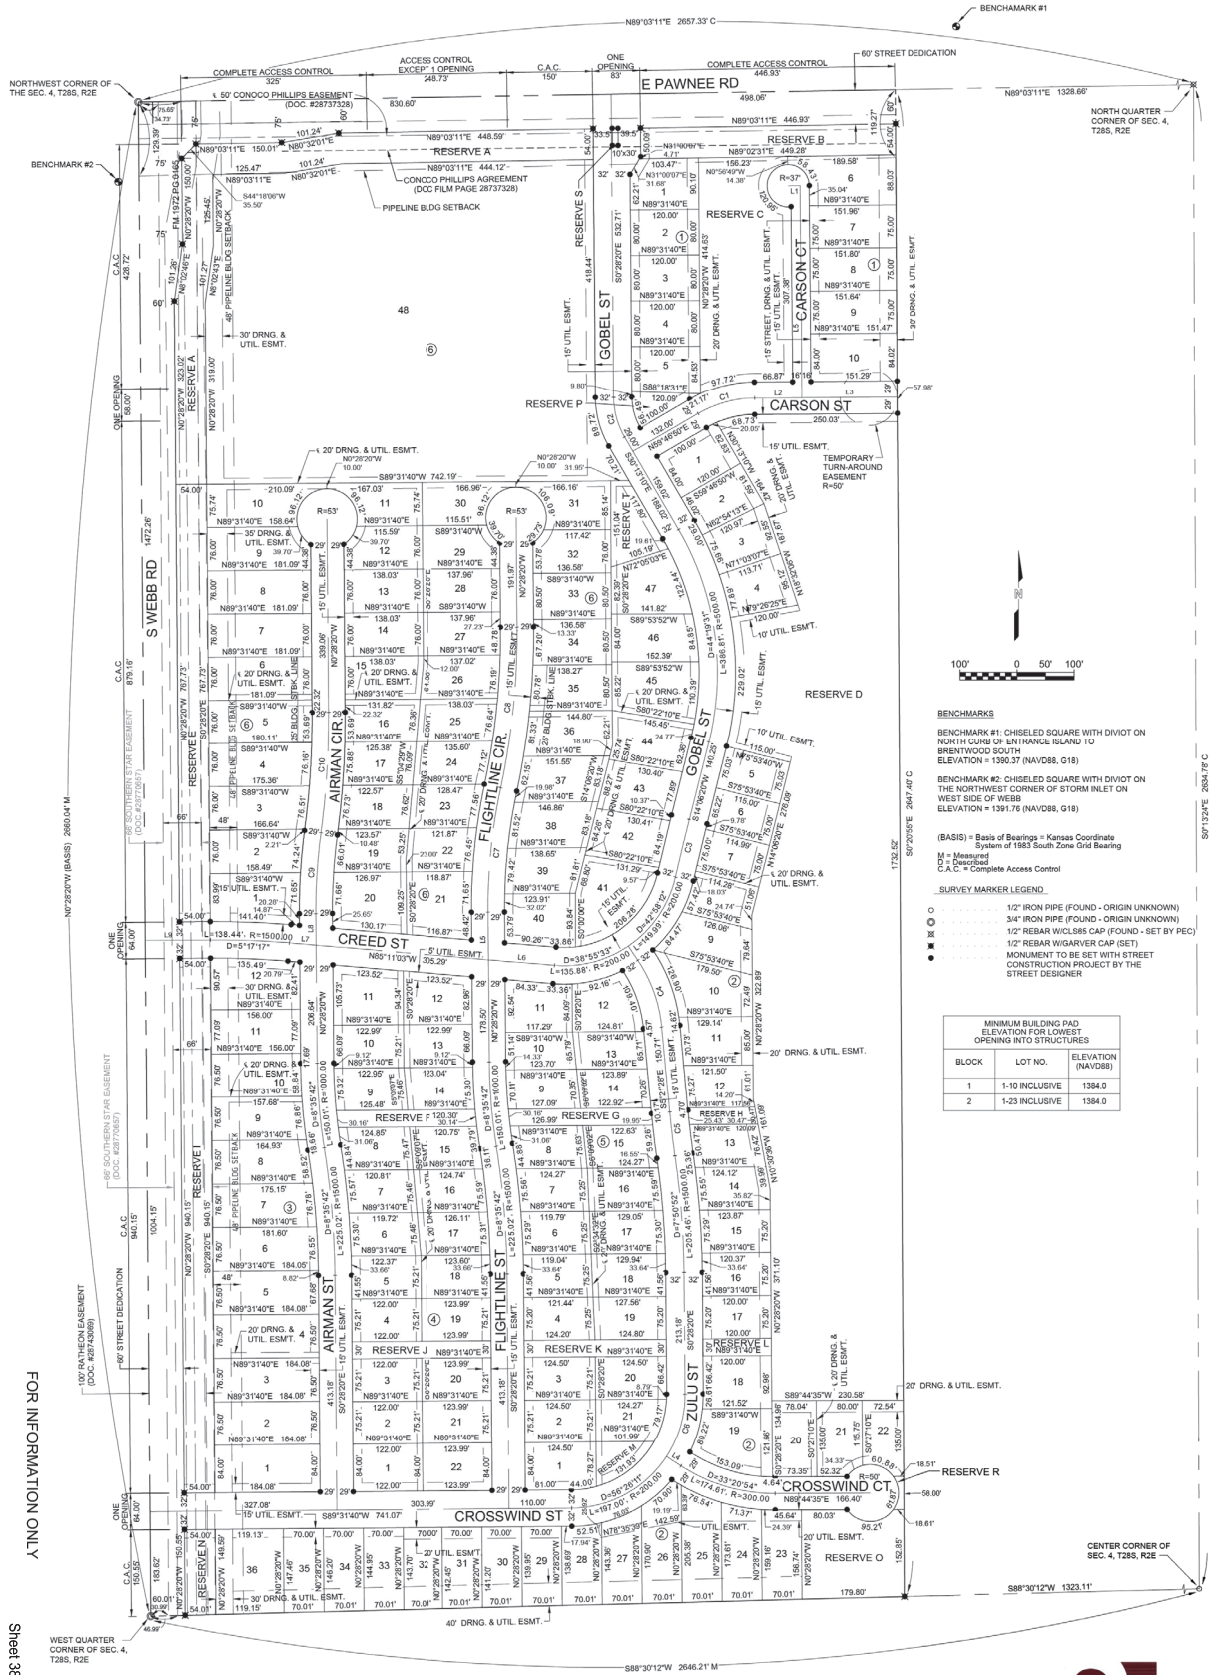

BENCHMARKS

BENCHMARK #1: CHISELED SQUARE WITH DIVIOT ON NORTH CURB OF ENTRANCE ISLAND TO BRENTWOOD SOUTH
ELEVATION = 1390.37 (NAVD88, G18)

BENCHMARK #2: CHISELED SQUARE WITH DIVIOT ON THE NORTHWEST CORNER OF STORM INLET ON WEST SIDE OF WEBB
ELEVATION = 1391.76 (NAVD88, G18)

(BASIS) = Basis of Bearings = Kansas Coordinate System of 1983 South Zone Grid Bearing
M = Measured
D = Described
C.A.C. = Complete Access Control

SURVEY MARKER LEGEND

- 1/2" IRON PIPE (FOUND - ORIGIN UNKNOWN)
- 3/4" IRON PIPE (FOUND - ORIGIN UNKNOWN)
- 1/2" REBAR W/CLS85 CAP (FOUND - SET BY PEC)
- 1/2" REBAR W/GARVER CAP (SET)
- MONUMENT TO BE SET WITH STREET CONSTRUCTION PROJECT BY THE STREET DESIGNER

MINIMUM BUILDING PAD ELEVATION FOR LOWEST OPENING INTO STRUCTURES		
BLOCK	LOT NO.	ELEVATION (NAVD88)
1	1-10 INCLUSIVE	1384.0
2	1-23 INCLUSIVE	1384.0

FOR INFORMATION ONLY

Sheet 38 of 38

SHEET 1 OF 2

DWG FILE: 21T41378 SURVEY BASE
PROJECT NO. 21T41376
JANARY 29, 2024

GARVER
1995 MIDFIELD RD.
Wichita, KS 67209
(316) 264-8008
www.GarverUSA.com