


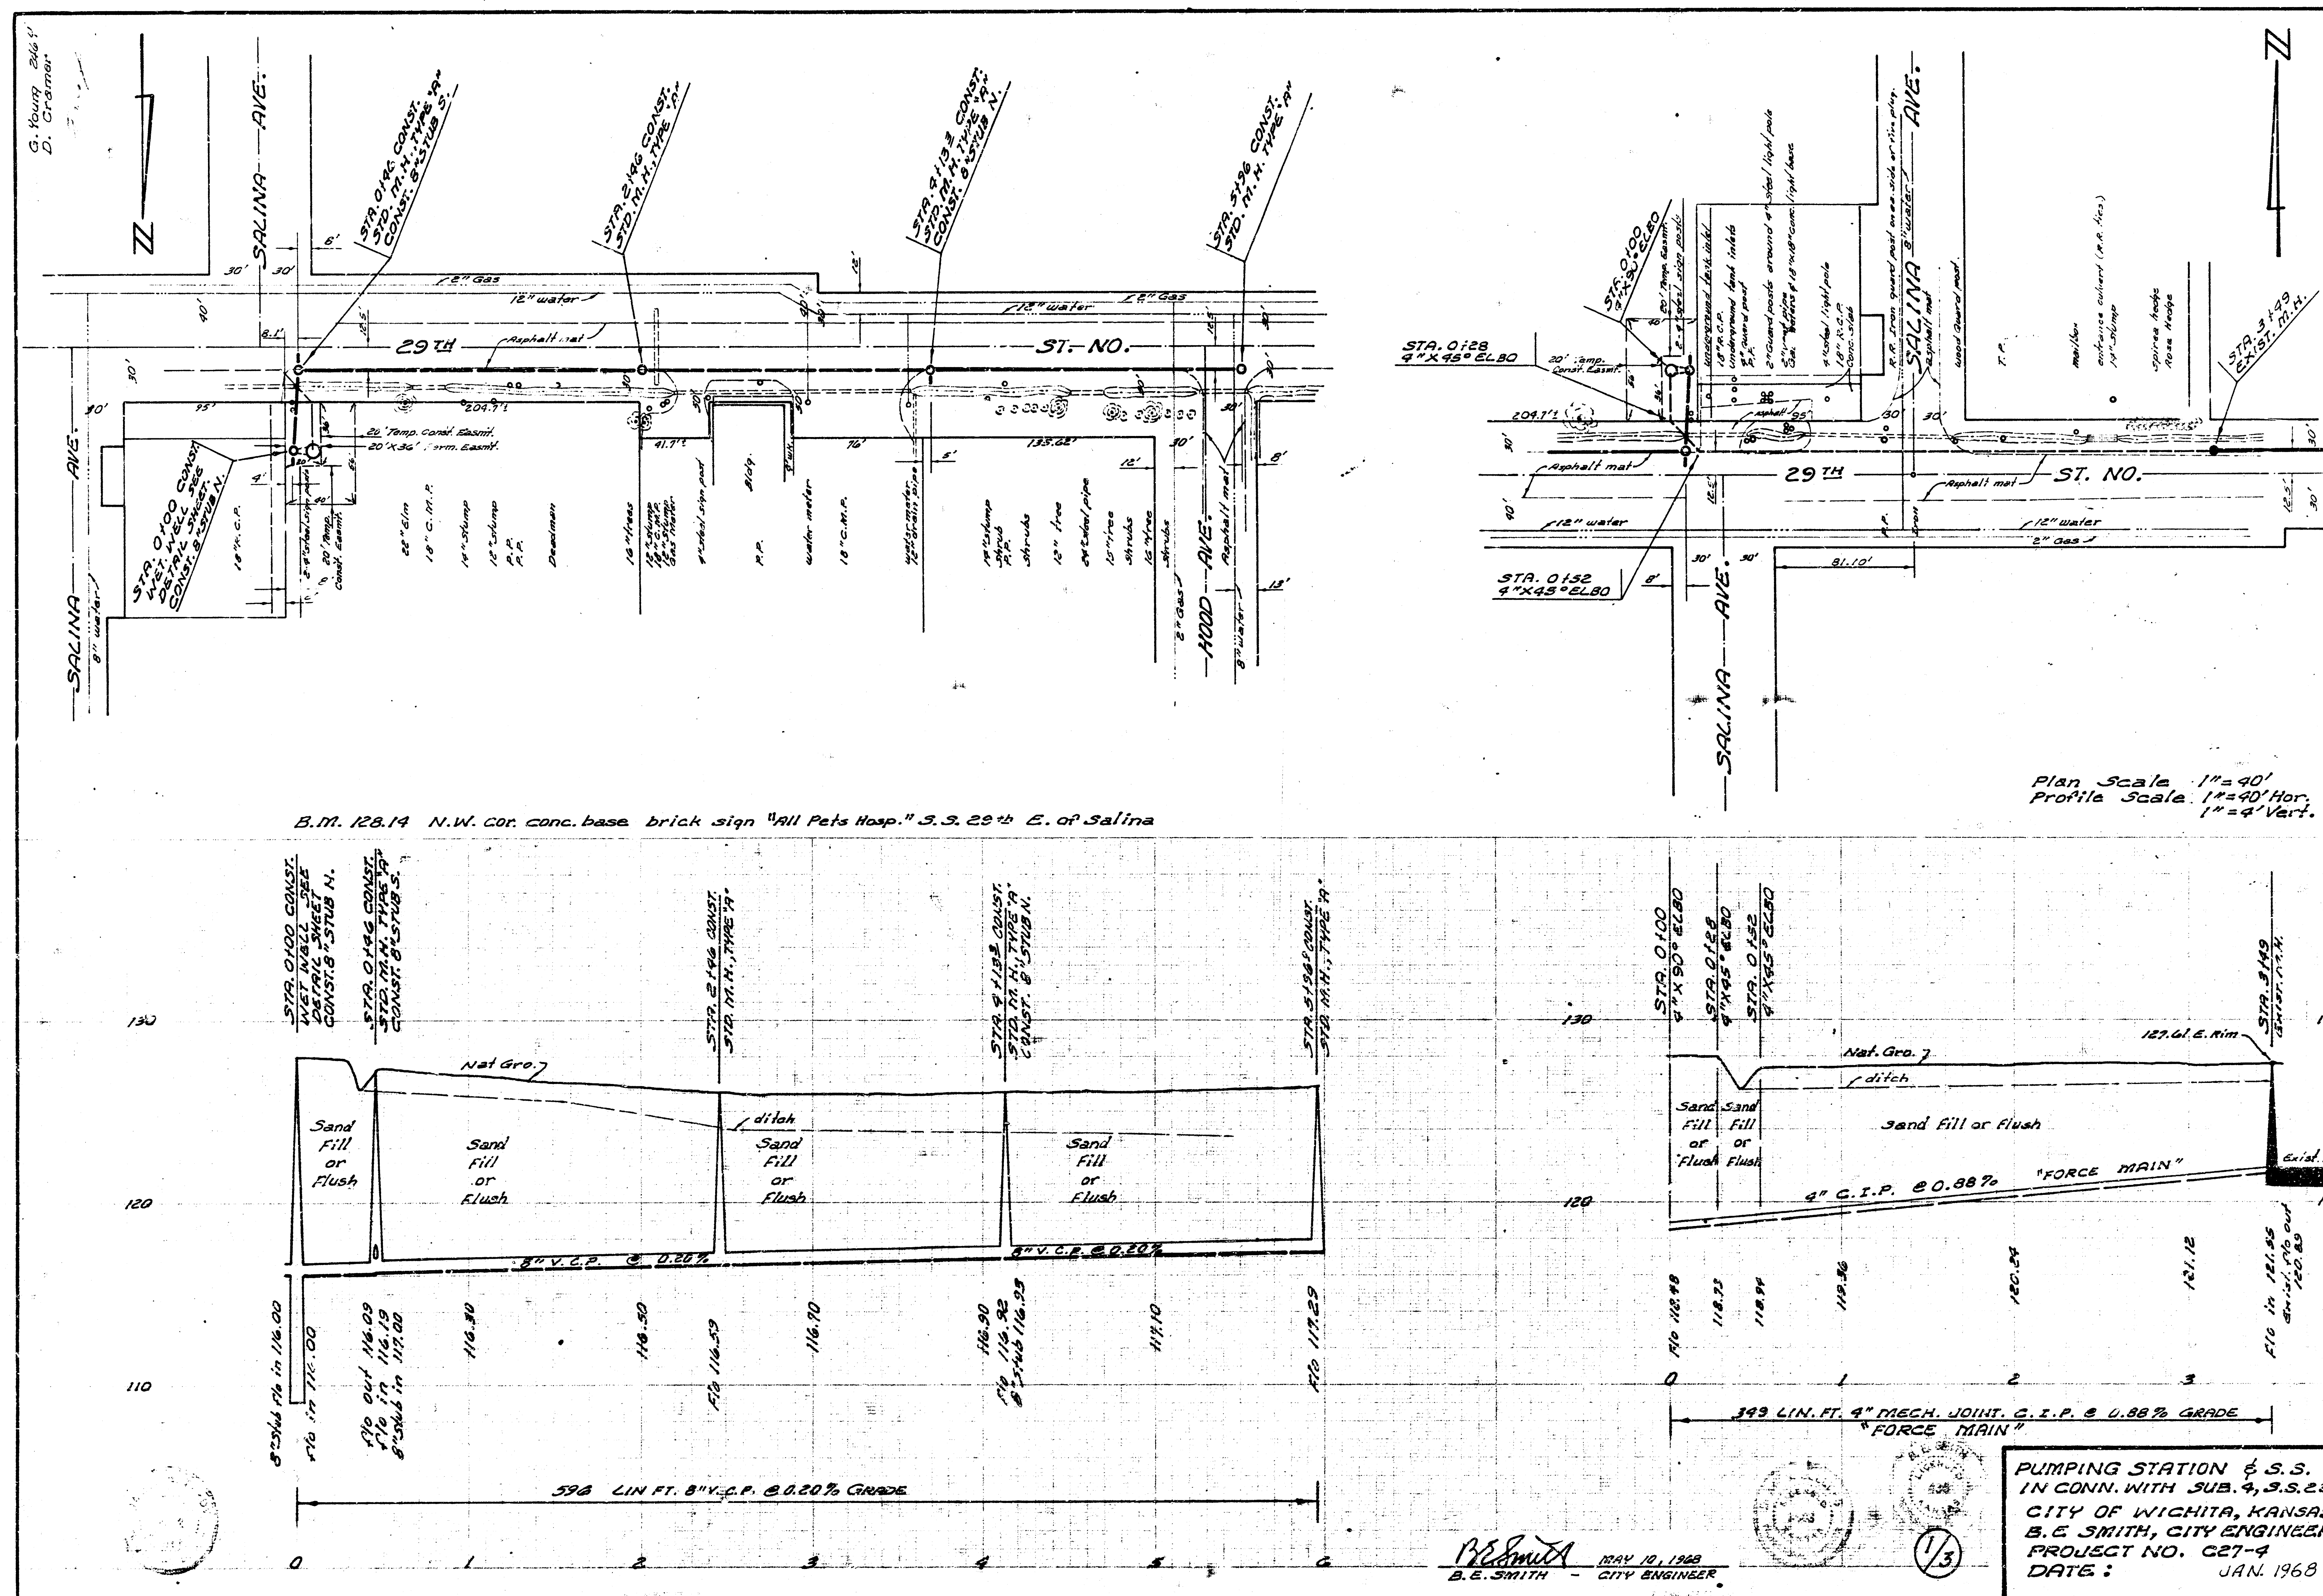
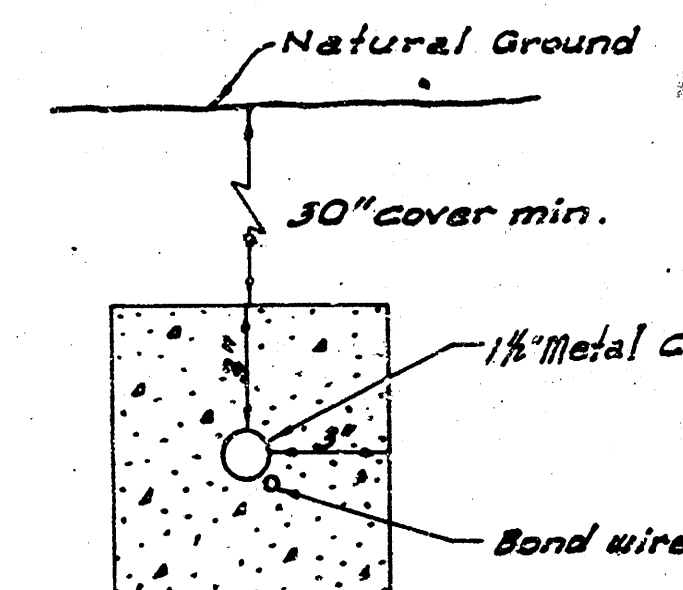


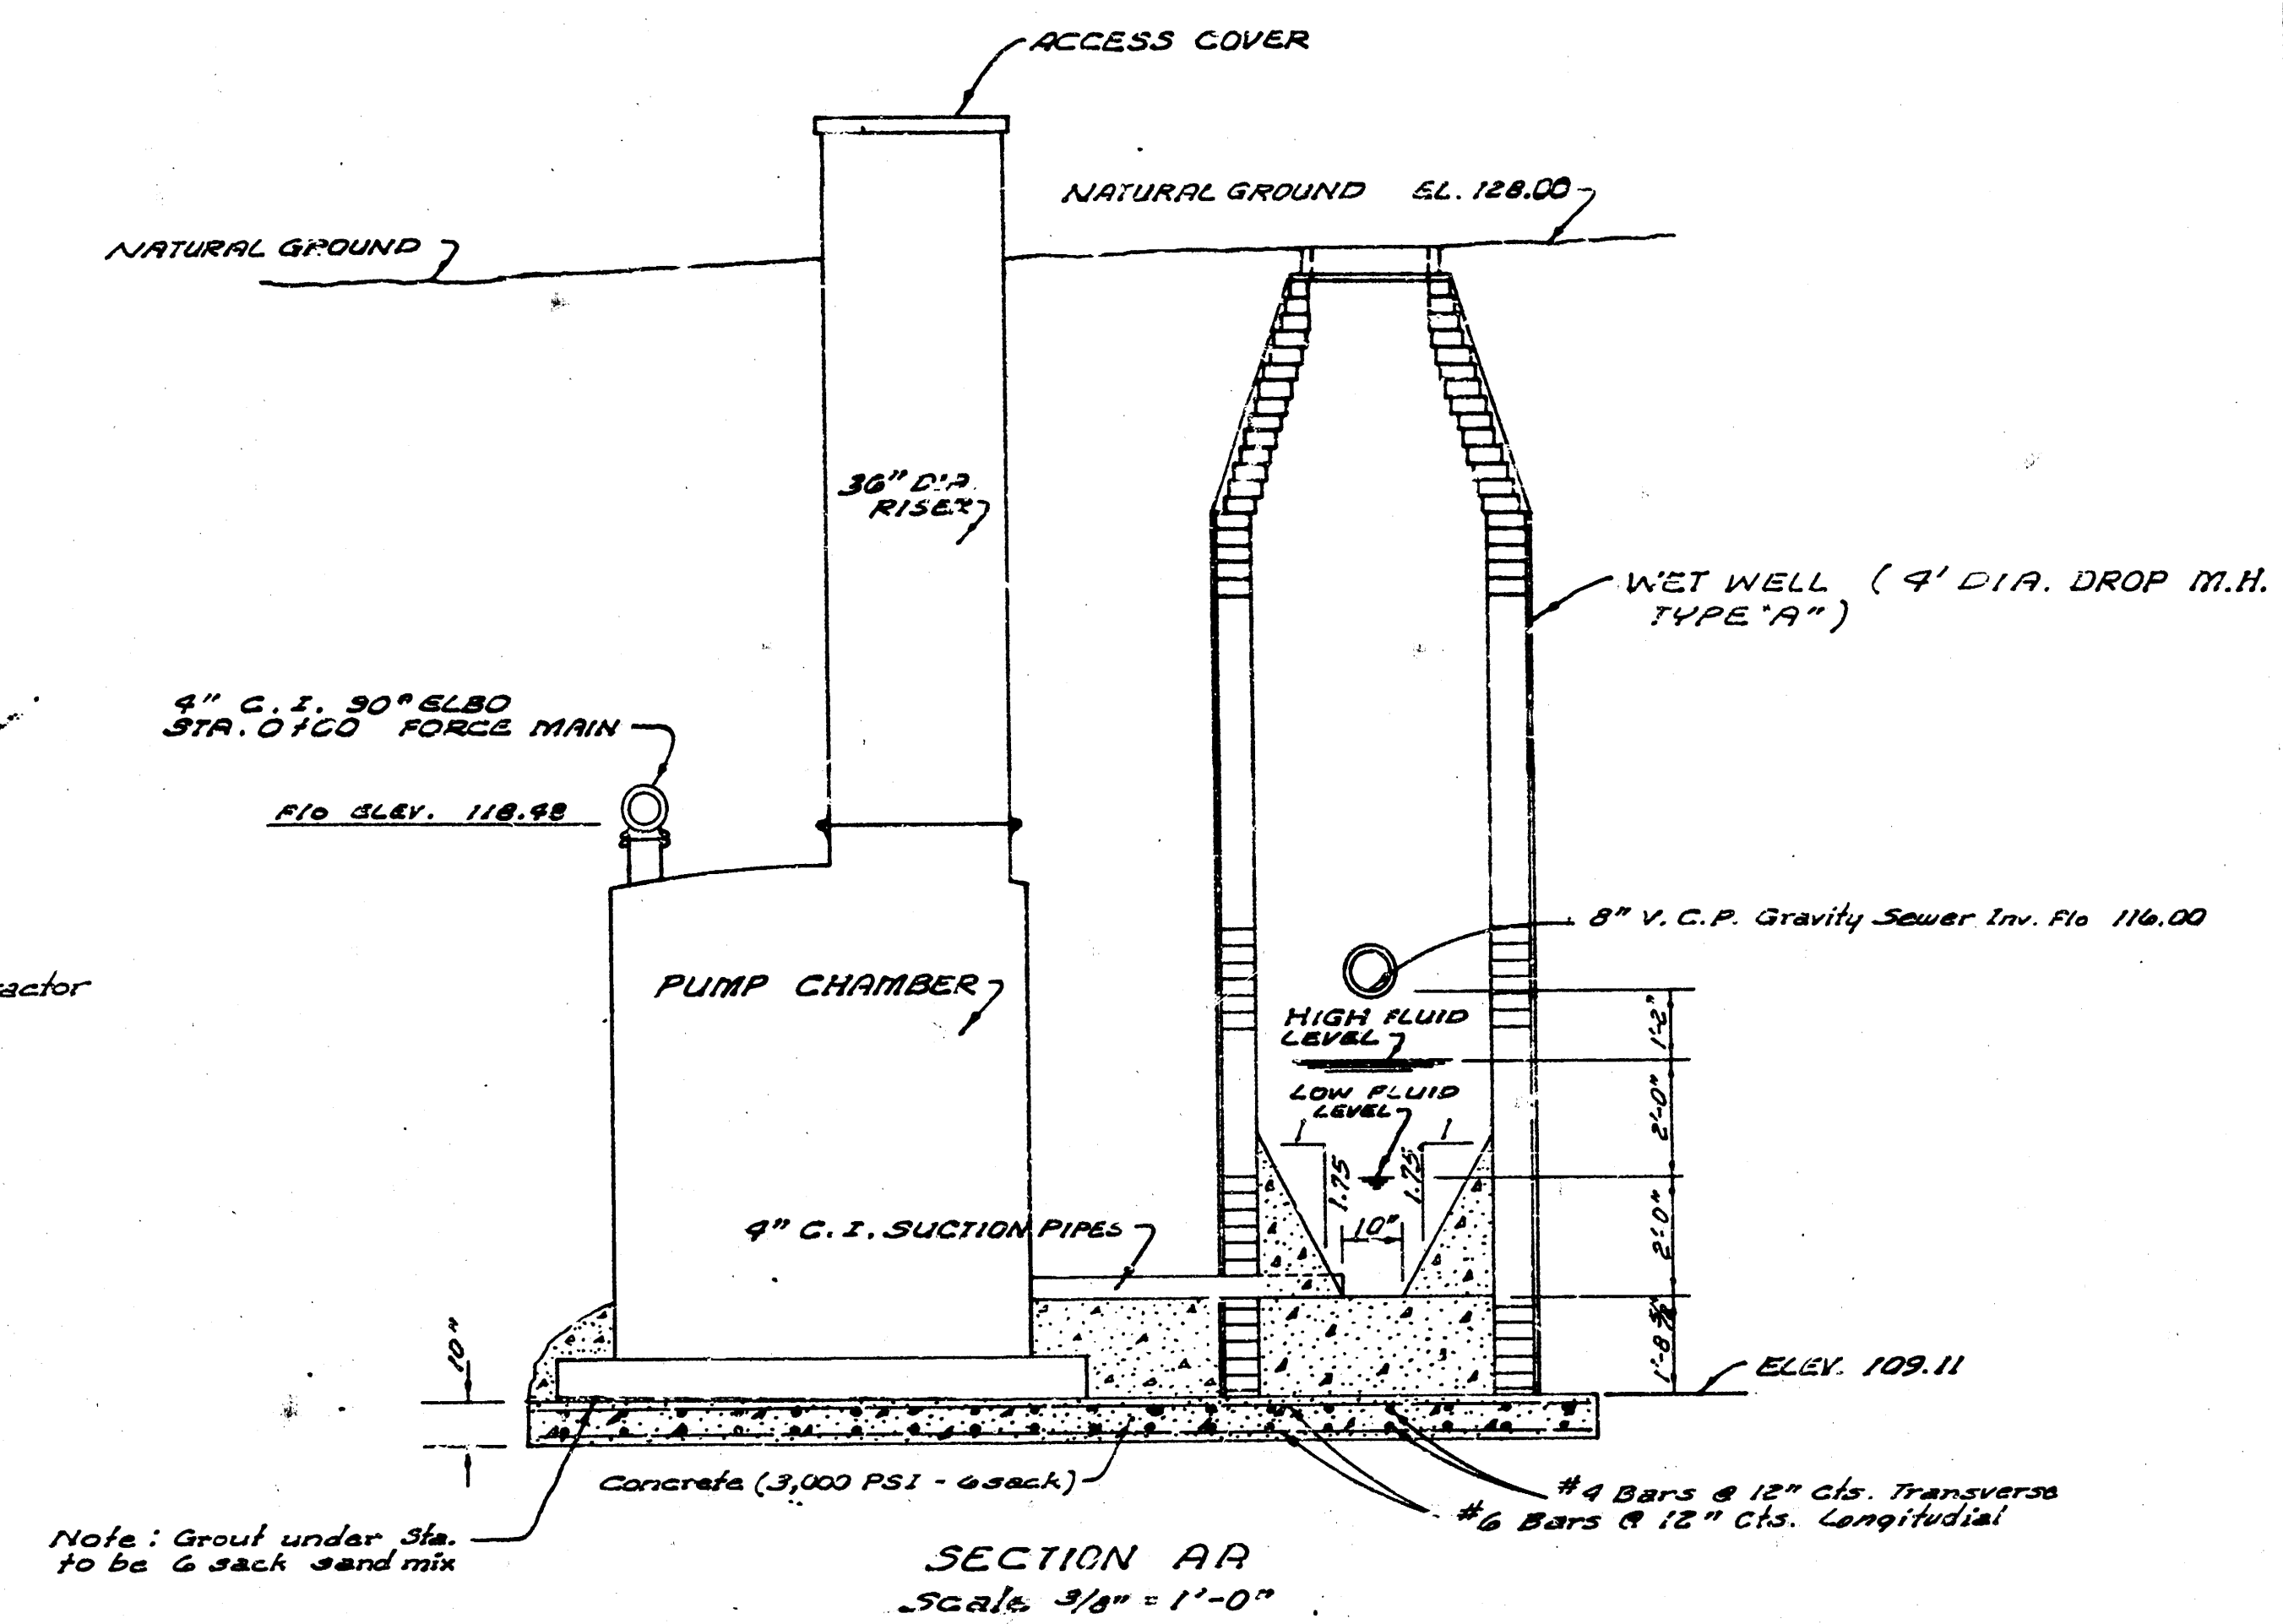

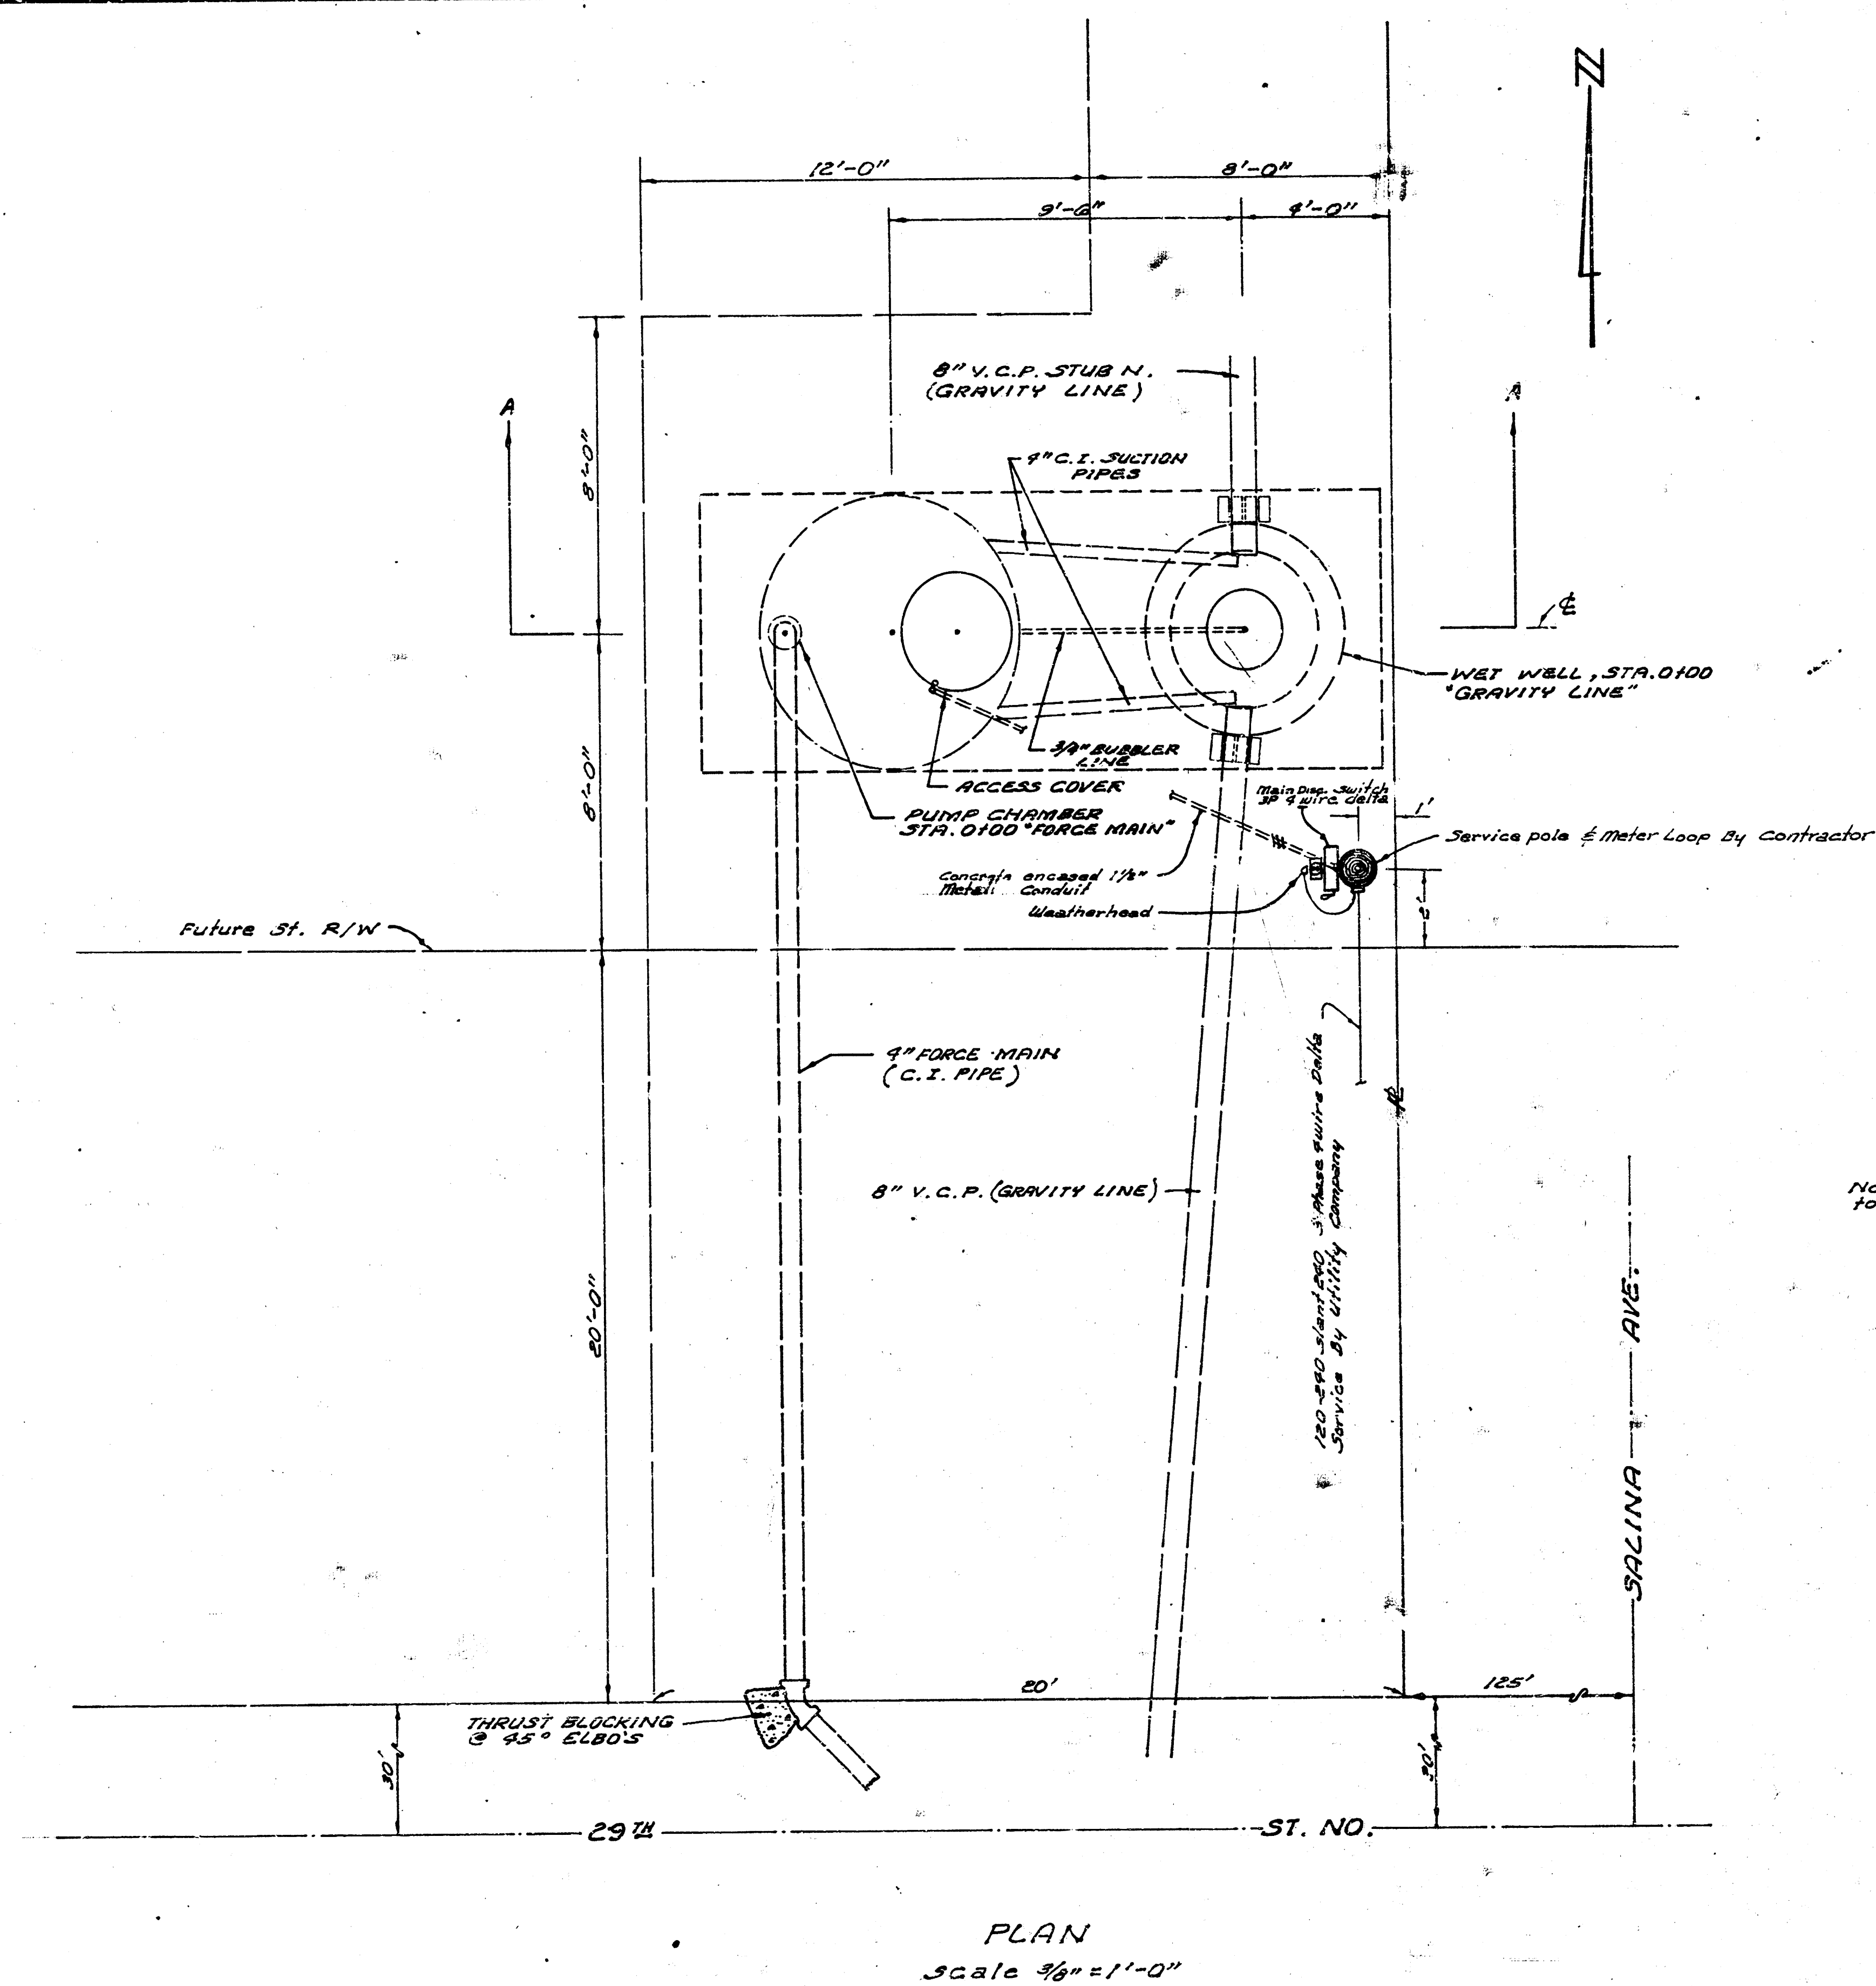

- GENERAL NOTES:
- #1 4" C.I. Elbows & Thrust blocking shall be included in bid price of Lin. Ft. of 4" C.I.P.
 - #2 Wet well, Conc. pad, Conc. encasement of conduit, electrical wiring from Lift Sta. to Service pole including Meter Loop & Service pole shall be included in Lump sum bid of Lift Station

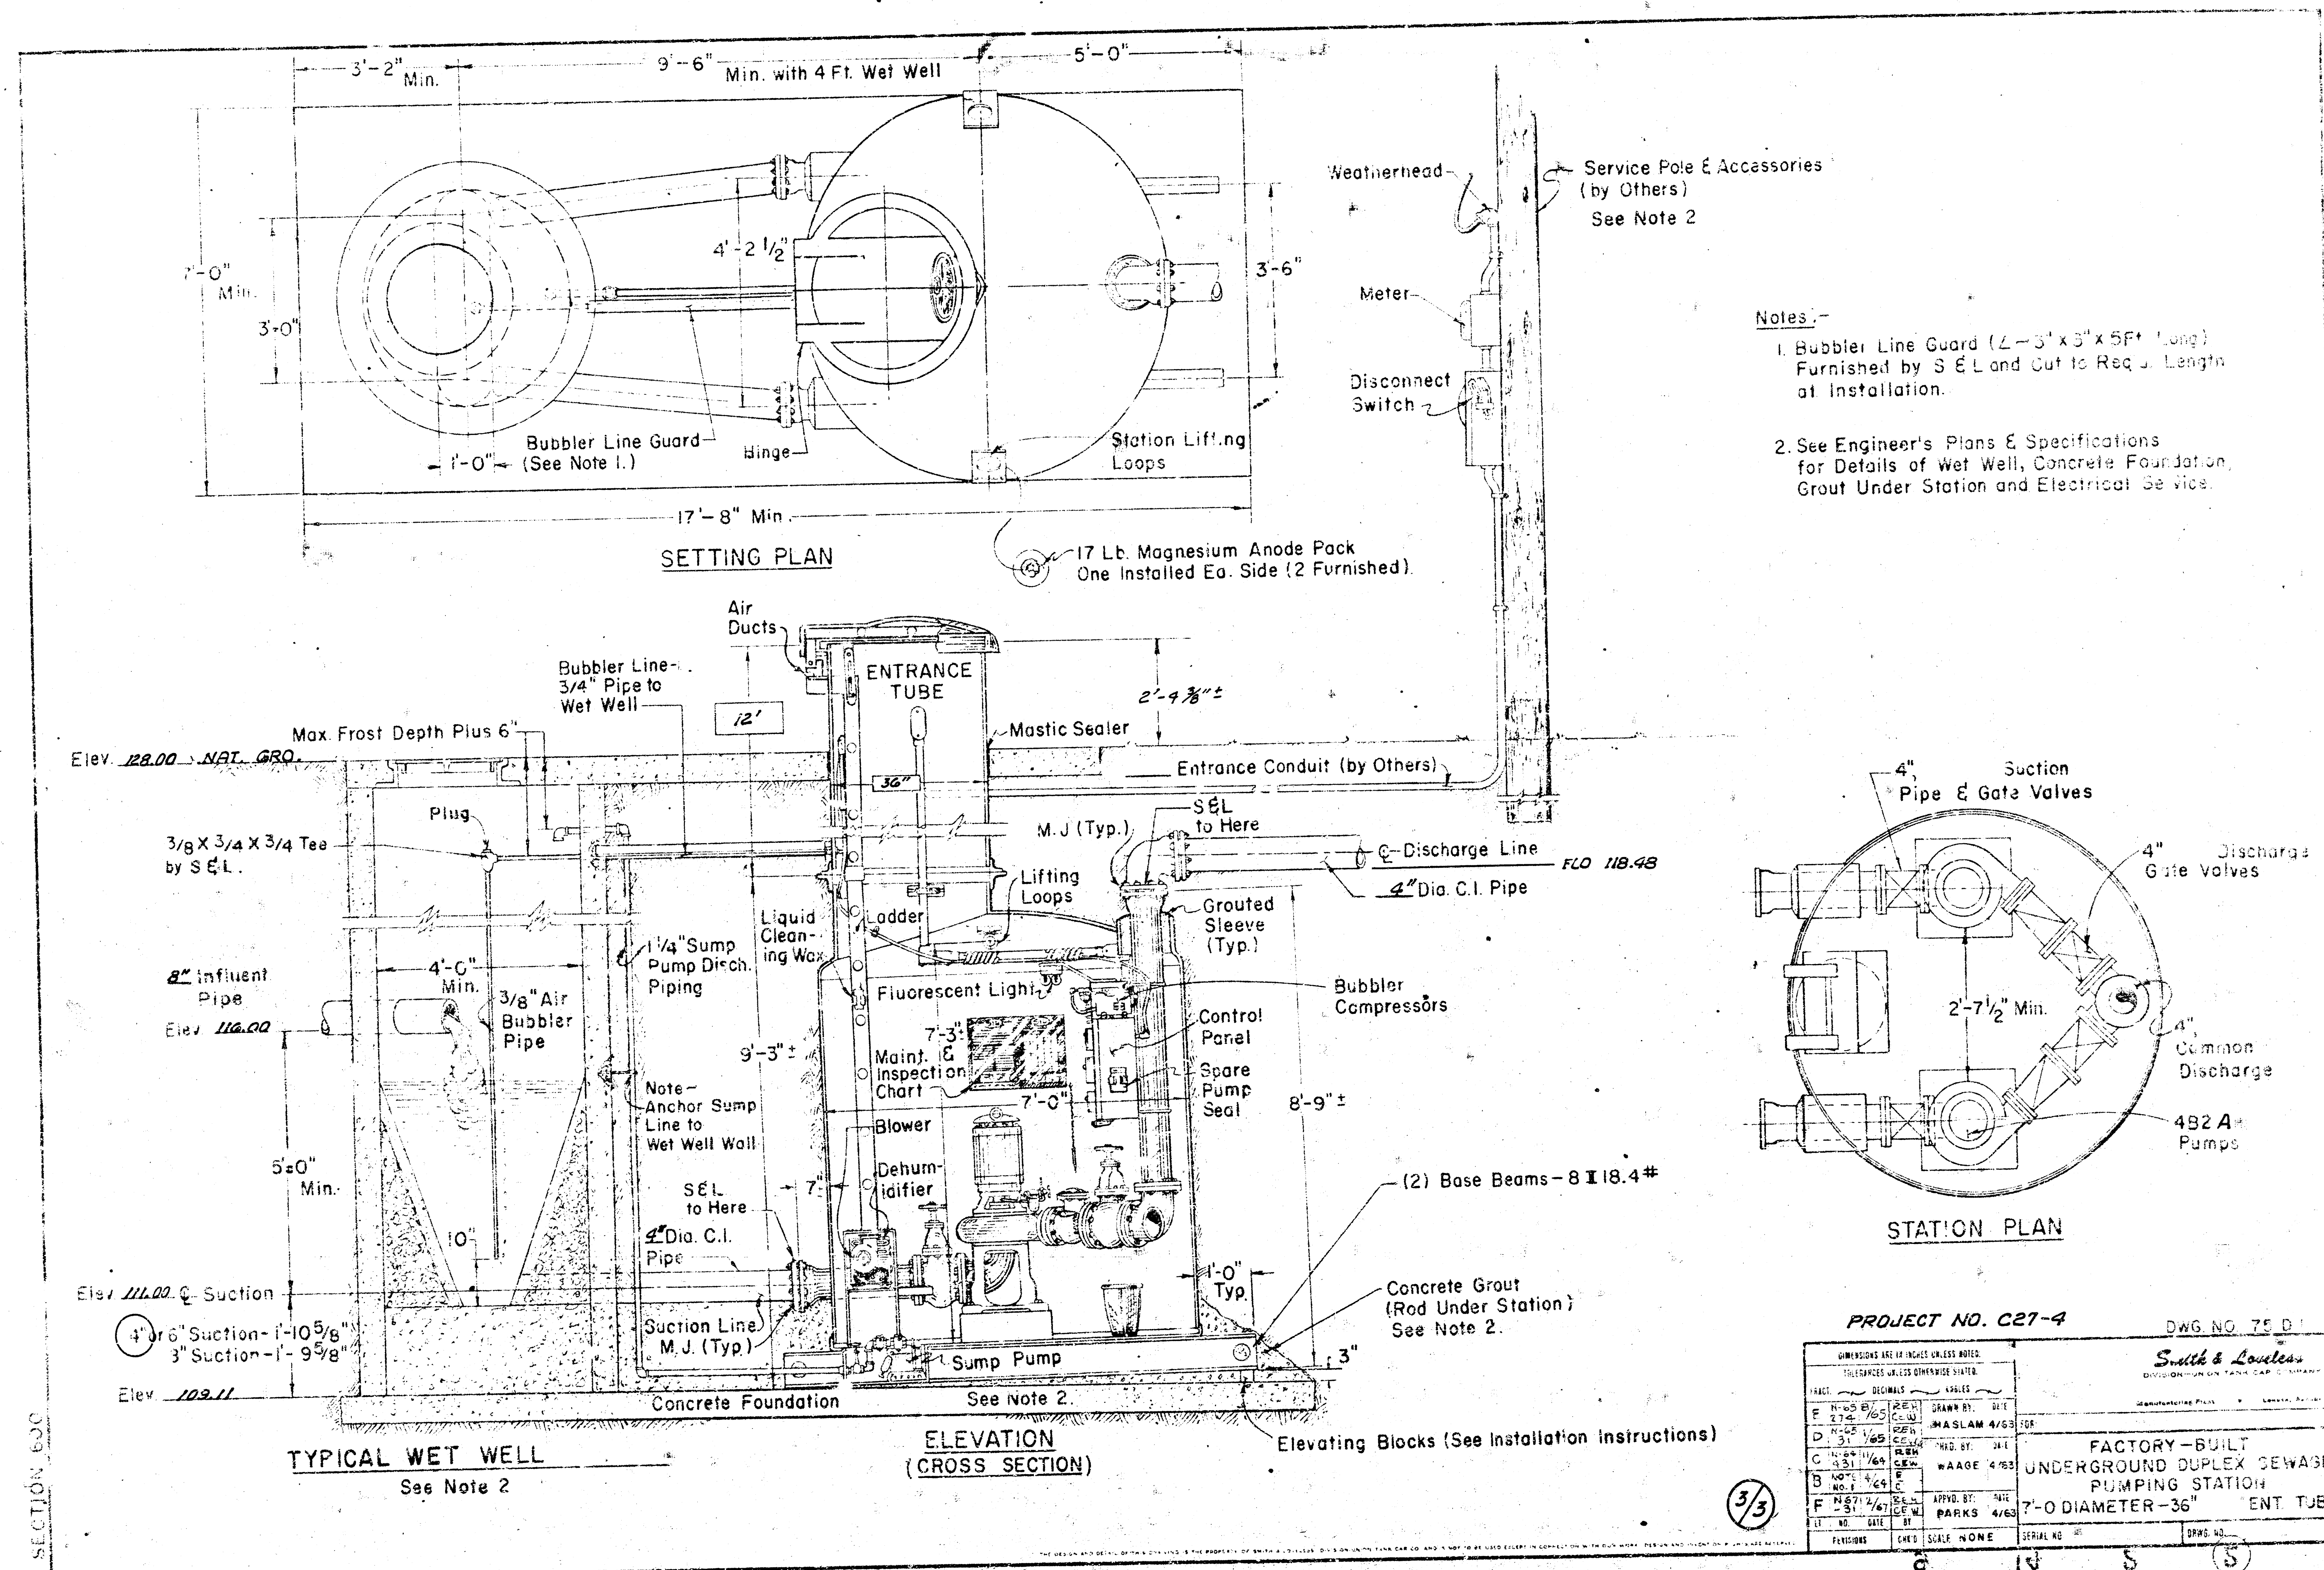

PROJECT NO. C27-4 DWG. NO. 75 D

Smith & Lonsdale
DIVISION OF CIVIL ENGINEERING

REVISION	DATE	BY	CHKD.	APPROV.
1	11/10/67	W. J. L.	W. J. L.	W. J. L.
2	11/10/67	W. J. L.	W. J. L.	W. J. L.
3	11/10/67	W. J. L.	W. J. L.	W. J. L.
4	11/10/67	W. J. L.	W. J. L.	W. J. L.
5	11/10/67	W. J. L.	W. J. L.	W. J. L.
6	11/10/67	W. J. L.	W. J. L.	W. J. L.
7	11/10/67	W. J. L.	W. J. L.	W. J. L.
8	11/10/67	W. J. L.	W. J. L.	W. J. L.
9	11/10/67	W. J. L.	W. J. L.	W. J. L.
10	11/10/67	W. J. L.	W. J. L.	W. J. L.

FACTORY-BUILT UNDERGROUND DUPLEX SEWAGE PUMPING STATION 7'-0" DIAMETER-36" ENT. TUBE

3/3