

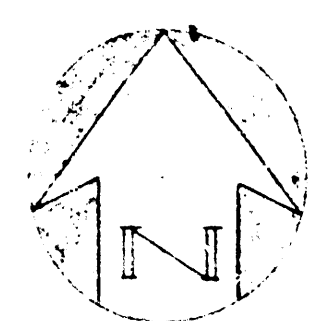
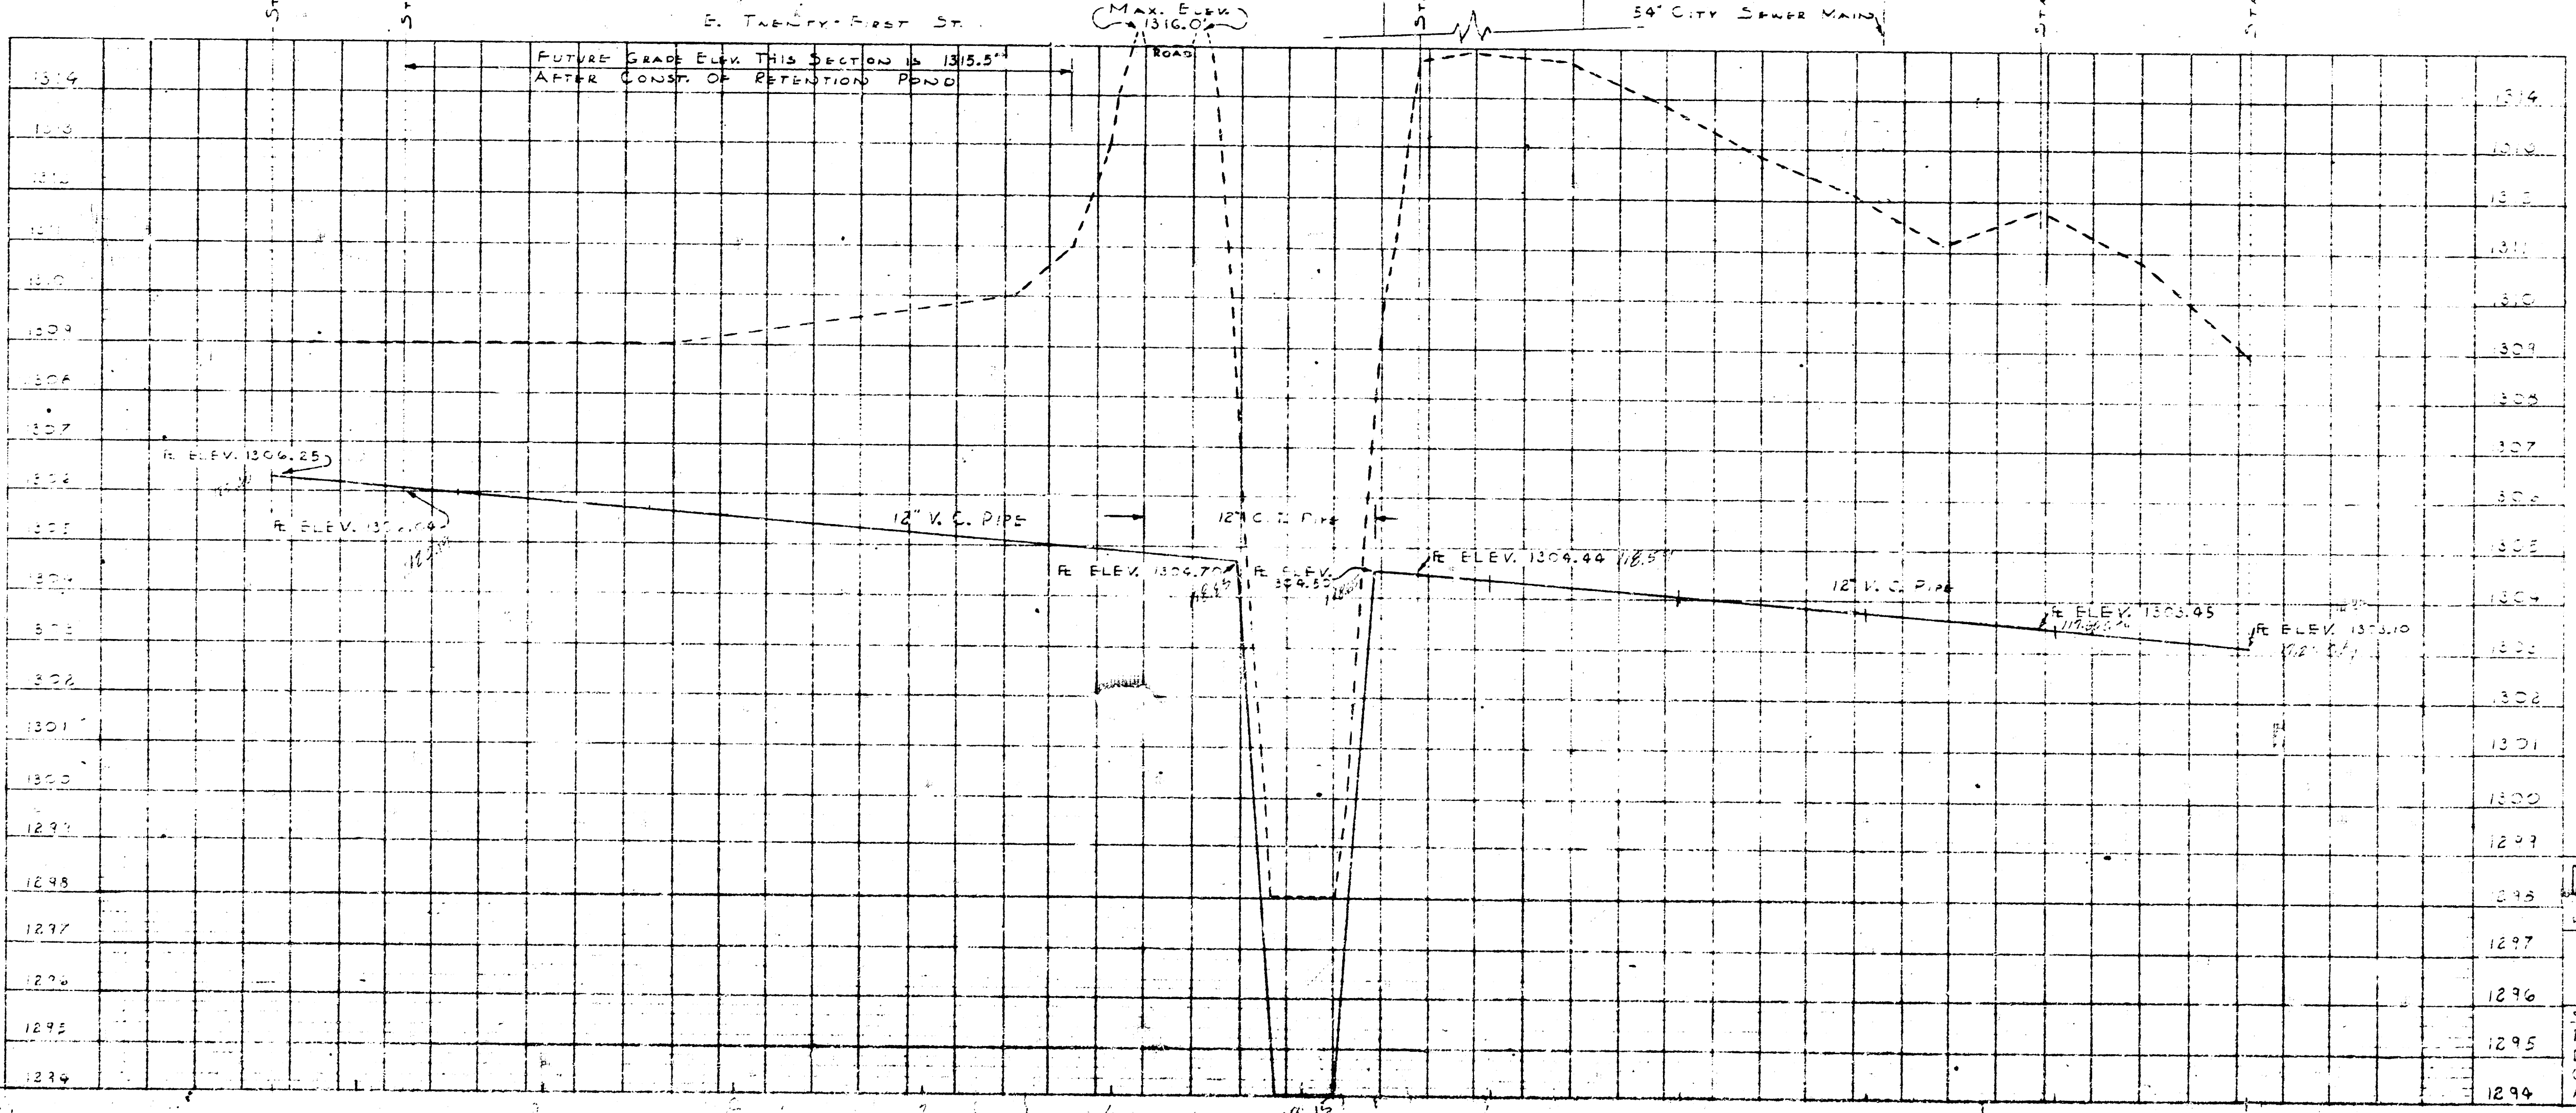
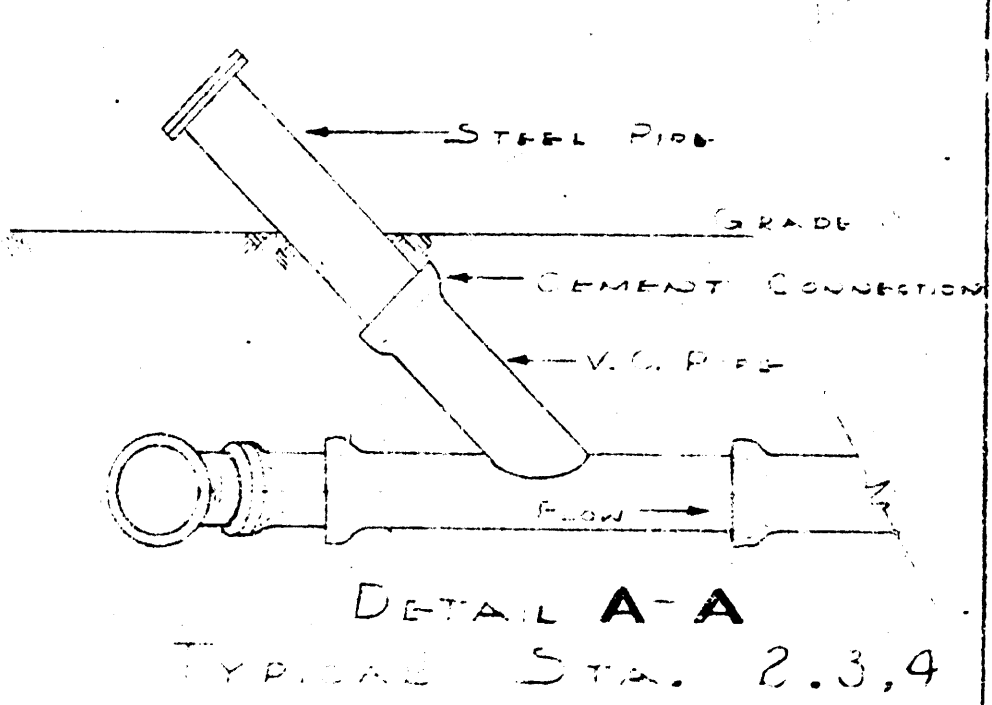


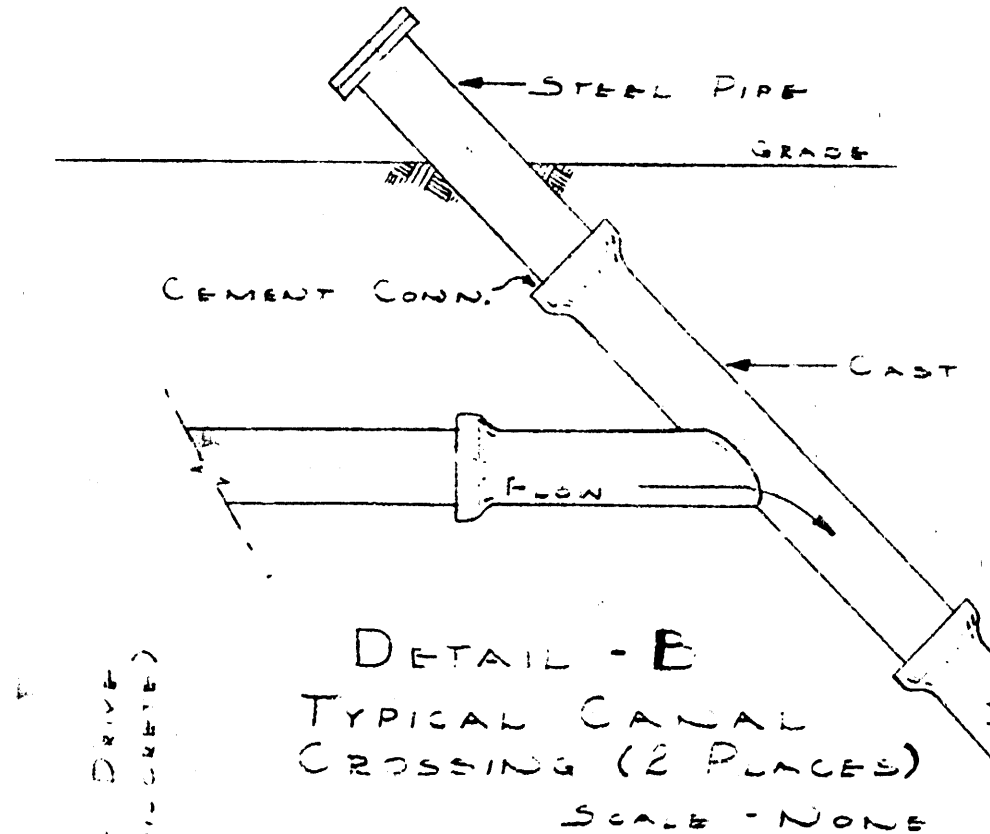

SCALE: 1"=50'

CONSTRUCTION NOTES

1. CANAL CROSSING SHALL HAVE 3'-0" MIN. COVER BOTH WALLS & BOTTOMS
2. PIPE UNDER BOTTOM OF CANAL SHALL HAVE 1'-0" COMPACTED BACK FILL AND 2'-0" RISE RAMPING ON BEHIND CONCRETE OR MASS STEEL
3. PIPE UNDER BOTTOM OF CANAL SHALL BE WEIGHTED FOR BUOYANCY. A CONCRETE CASING OR REFRAS. CLIPPER WEIGHTS MAY BE USED AT CONTRACTOR'S DISCRETION

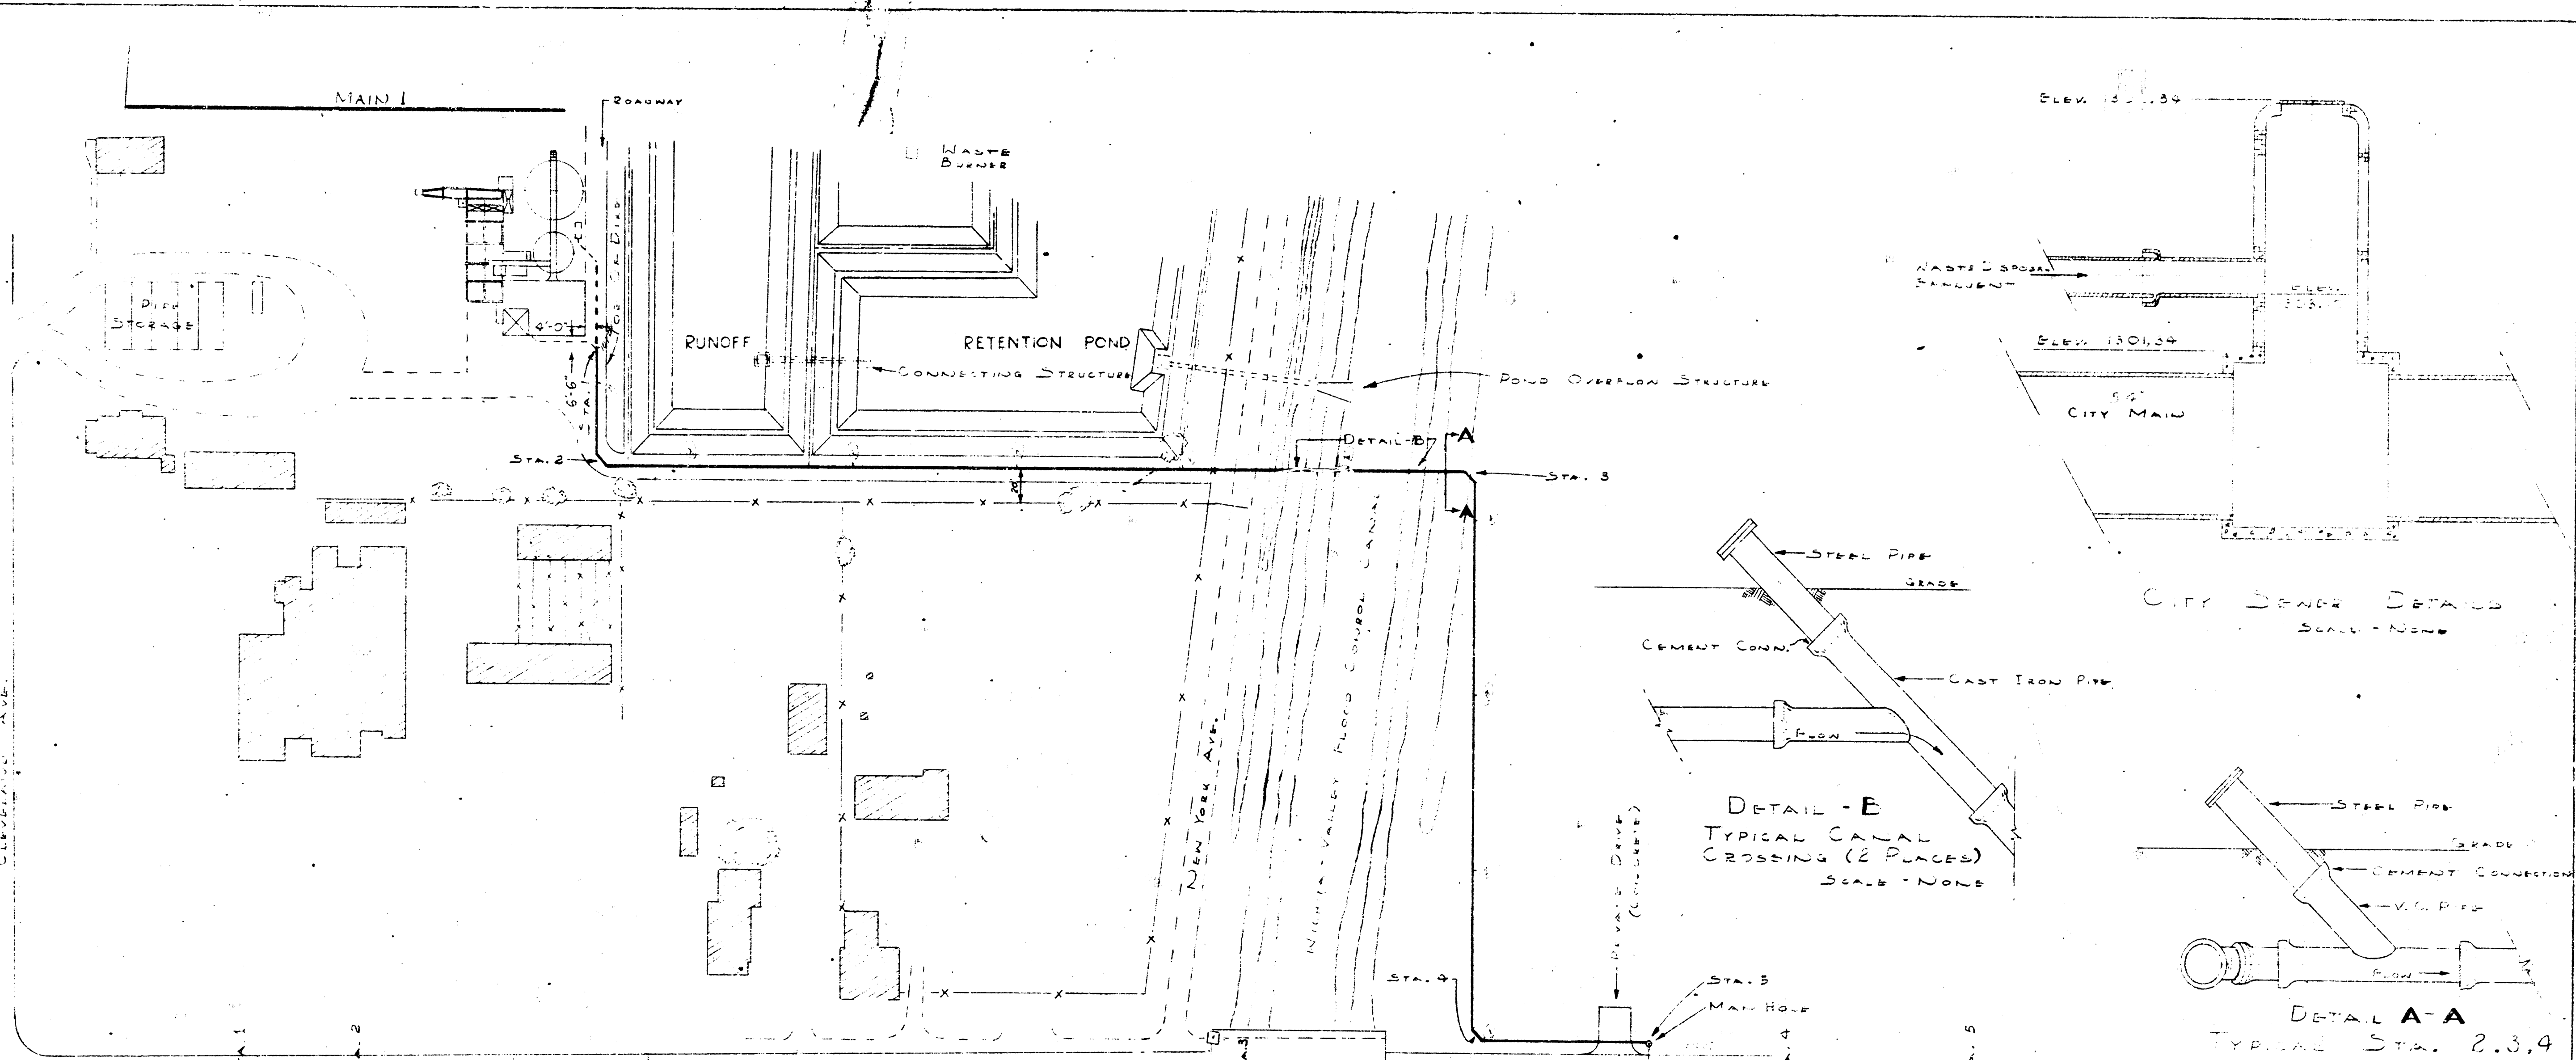

Booked & 197
6-19-64 JMB

JOB No. 503
DERBY REFINING
WICHITA CO. KANSAS
WASTE DISPOSAL UNIT
RECONNECT LINE TO CITY SEWER
LOCAL AS NOTED
DATE: 2-2-59
DRAWN: R. D. J.
CHECKED: E. H. ATTORNO: J.M.V.
WR-D-604