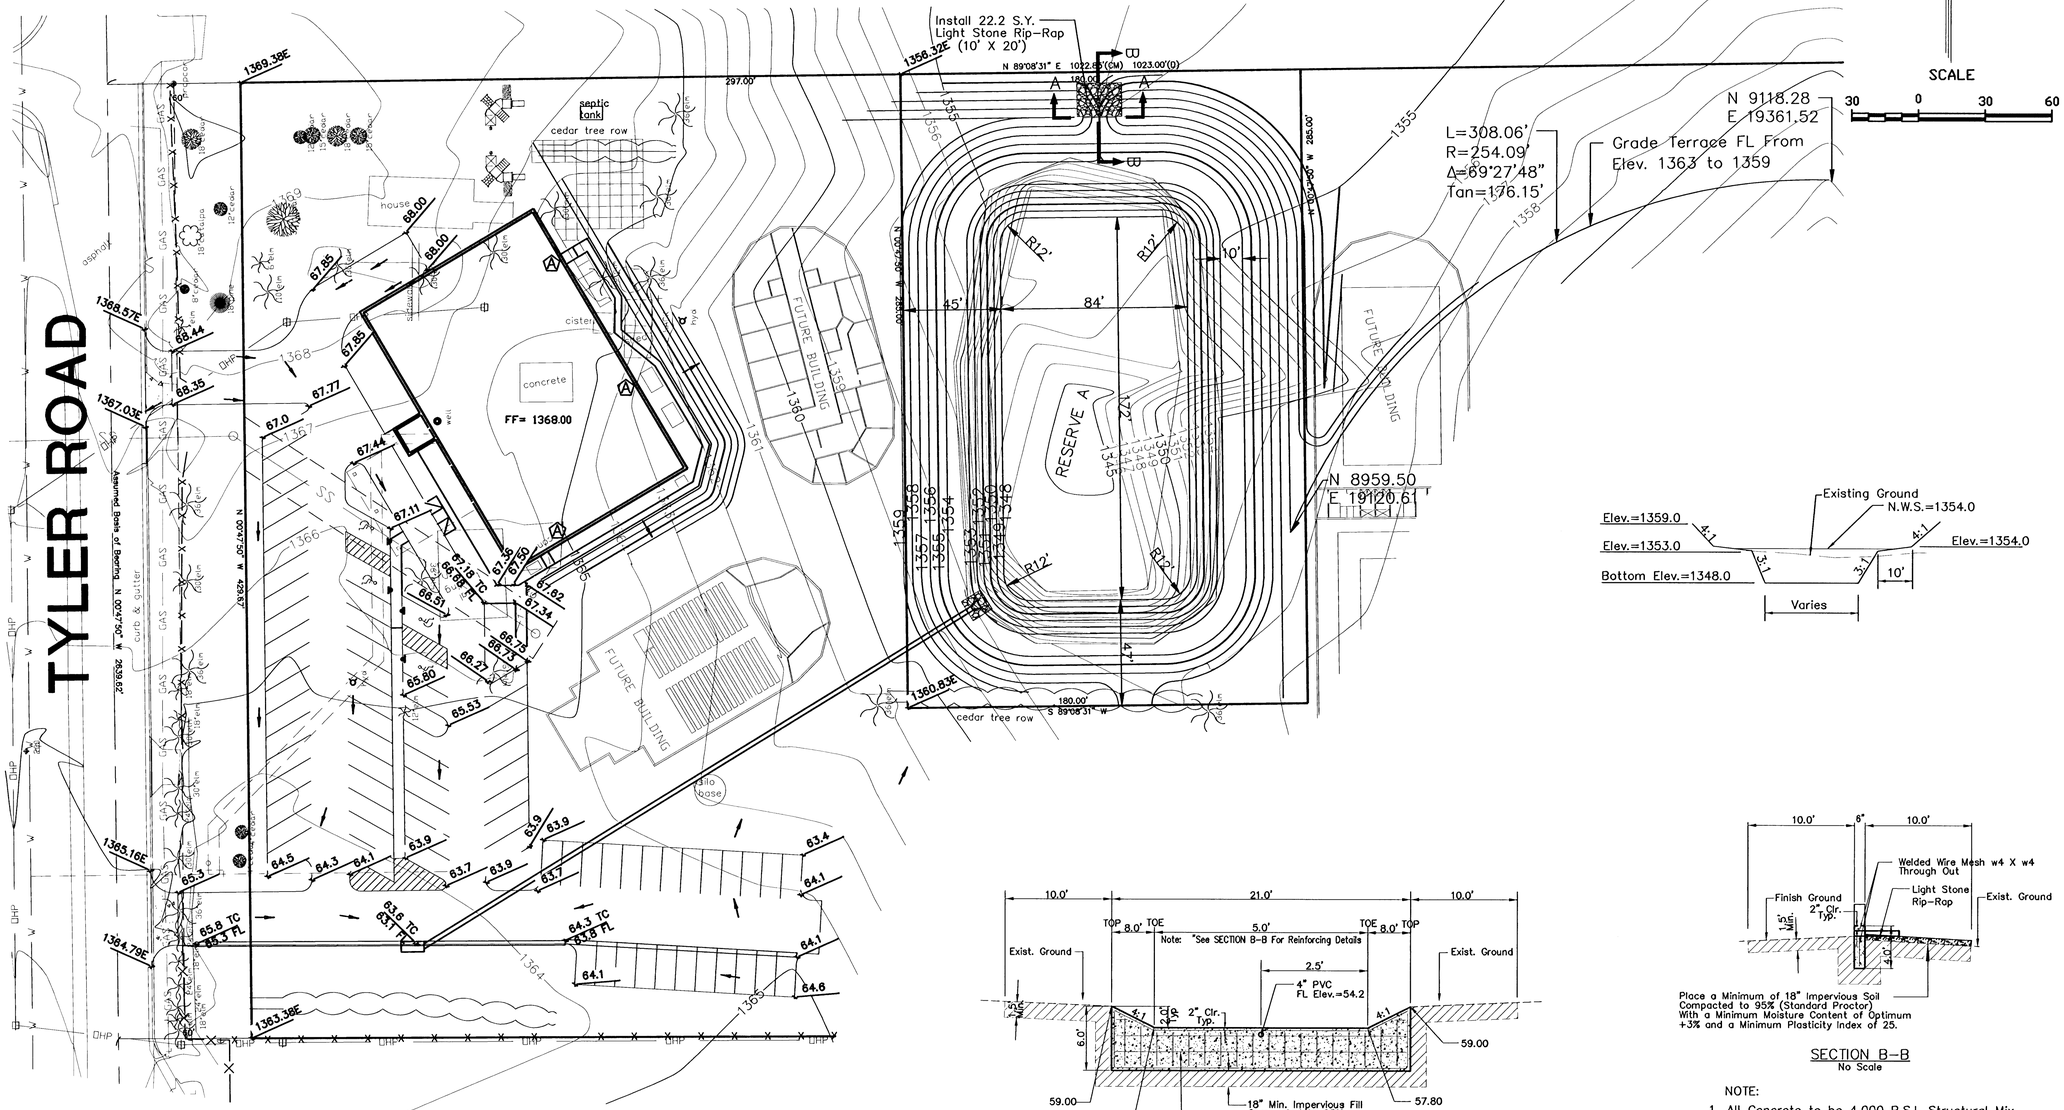


NOTE:

1. All Concrete to be 4,000 P.S.I. Structural Mix.
2. All Exposed Concrete Edges to Have 3/4" – 45° Chamfer.
3. All Exposed Concrete Surfaces to be Broomed.
4. Use W4 X W4 Welded Wire Fabric for Reinforcement
5. Minimum Overlap of Reinforcing Steel Shall be 24 Inches.

No.	Date	By	Approved	Revision

NORTHWEST METHODIST ADDITION
STORM SEWER IMPROVEMENTS
GRADING PLAN
CITY OF WICHITA, KANSAS
JIM ARMOUR P.E. - CITY ENGINEER
1748 PPS (607861)

POE & ASSOCIATES, INC.
5940 E. Central, Suite 200 ■ Wichita, KS 67208-4242
Phone 316/685-4114 ■ FAX 316/685-4444

FINAL

Designed By: T. Austin/S. Schmidt
Drawn By: A. Moss
Poe Job No.: 874\Base.dwg
Date: 2/12/2007

Sheet 8 of 10