

Index

Cover Sheet	1
Plan/Profile Sheet Lines 1 & 2	2
Plan/Profile Sheet Lines 3 & 4	3
Inlet & Sediment Barrier Details	4
Headwall Details	5
Manhole Details	6
Lid & Rim Details	7
Copy Of Plot	8

Benchmarks

1. "X" S.E. Cor. Bridge Deck 1/2 Mile N. Of 29th St. N.
On Ridge Rd.
ELEV. = 139.14 City Datum (1326.54 M.S.L.)
2. 60d Step Bench E. Side HLP 1936' S Of &
37th St. N. E. Side Ridge
ELEV. = 140.81 City Datum (1328.21 M.S.L.)
3. 60d Step Bench E. Side HLP 1405' S Of &
37th St. N. E. Side Ridge
ELEV. = 141.18 City Datum (1328.58 M.S.L.)
4. 60d Step Bench E. Side HLP 592' S Of &
37th St. N. E. Side Ridge
ELEV. = 142.14 City Datum (1329.54 M.S.L.)
5. Co. B.M. " " On S. Hubward RCBC 73' W. Of
& Ridge Road On 37th St. N.
ELEV. = 144.12 City Datum (1331.52 M.S.L.)

PRIVATE STORM WATER SEWER TO SERVE Ridge Port North Addition

LOT 1

Private Project Number 932 PPS (607861)


CITY OF WICHITA, KANSAS

Michael E. Lindebak, P.E. City Engineer


September, 1999

General Notes:

1. Contractor will be required to provide notice to utility companies a minimum of forty-eight (48) hours prior to any excavation, as follows:
Kansas One-Call 687-2470
The Contractor must notify the following in case of an emergency:
Cablevision 262-0661
or 263-2061
Kansas Gas Service 383-8650
KGE 383-8600
Peoples Gas Company 942-8811
Southwestern Bell Telephone Company 800-344-7233
City of Wichita Water Department 268-4508
City of Wichita Sewer Maintenance 268-4071
2. Underground utility service lines and overhead utility pole lines are to be adjusted as necessary by others prior to construction unless the plans specifically call for their adjustment by the Contractor or unless the plans specifically identify a utility to be adjusted by its owner during construction. Existing utilities and their location, as shown on the plans, represent the best information obtainable for design. The Contractor will be required to work around existing utilities within the right-of-way which do not conflict with proposed construction.
3. Contractor shall not start work on the project until the Project Inspector is assigned to the project and is present on the site. Any work done without inspection will be required to be uncovered for inspection.
4. All areas disturbed by construction operations shall be seeded with rye grass at a rate of 6 lbs. per 1000 sq. feet or as per city specs. Contractor to prepare ground to city specifications.
5. Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in direct conflict with proposed new construction shall be saved and protected from damage.
6. Rubble from the removal of miscellaneous structures and excess excavation which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations that, in the opinion of the Engineer, will leave an unsightly appearance will not be approved.
7. The Contractor shall be responsible for preserving property irons. The Contractor will be required to re-establish any property irons which are damaged or destroyed by his construction operations. Such irons shall be re-established by a licensed land surveyor in accordance with state law.
8. The Contractor shall give all property owners and/or tenants of developed property directly abutting the construction of this project a minimum of ten (10) days advance notice prior to start of construction.

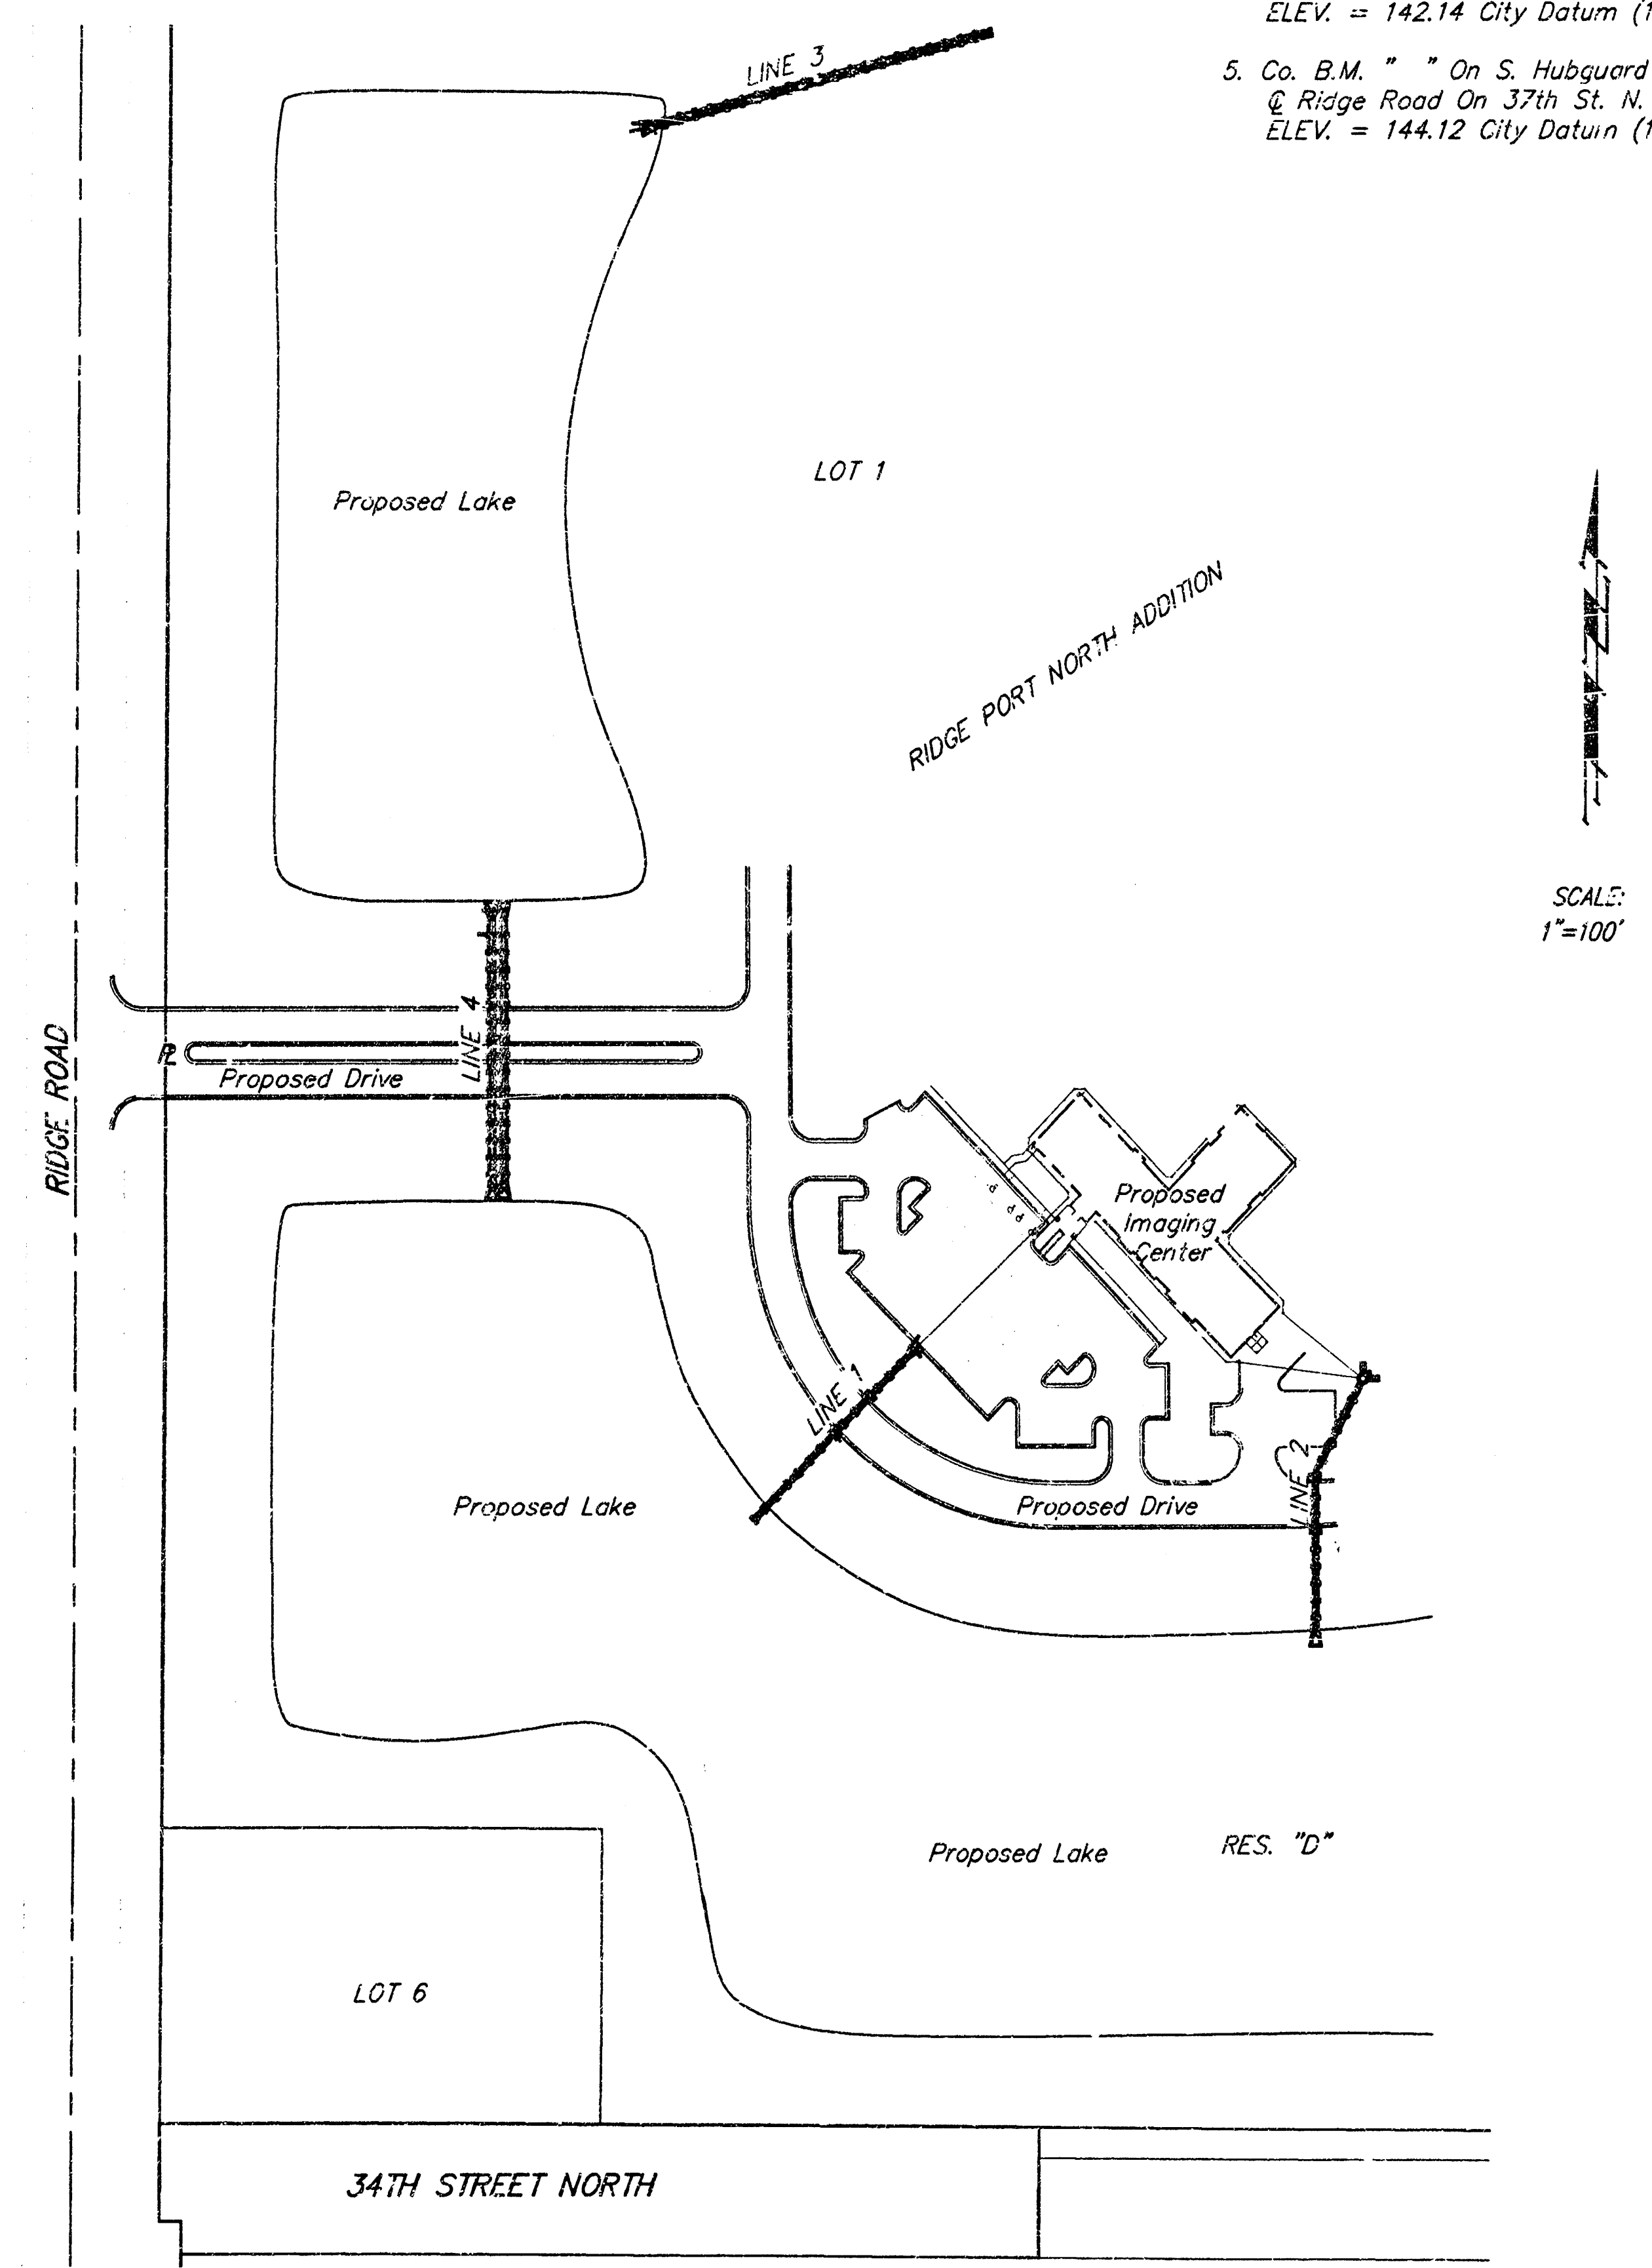

Location Map

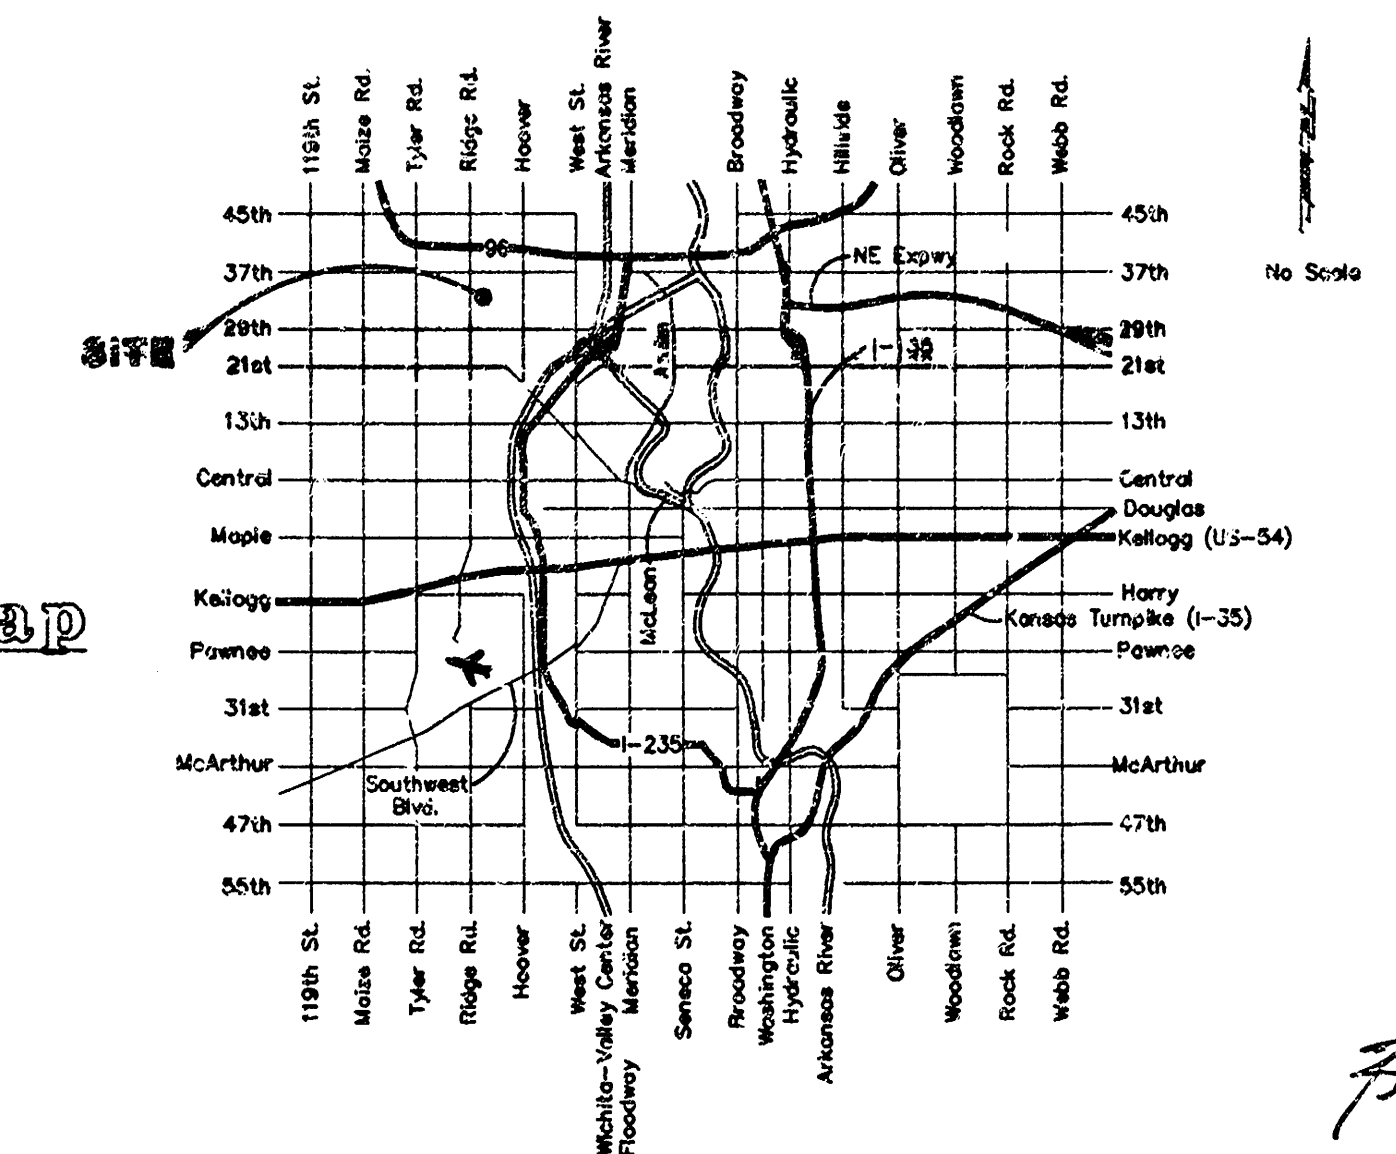

APPROVED AS NOTED
BY CITY ENGINEER OF WICHITA

Storm Sewers VRH 9/17/99

NOTE TO CONTRACTORS


Installation, inspection and testing for this project is to be provided by a Licensed Consulting Engineering Firm under contract with the Owner/Developer. Said inspection to be in accordance with the City of Wichita standard construction engineering practices and certified by a Licensed Professional Engineer. No work shall be performed in dedicated easements or public right-of-way by the Contractor without such inspection nor shall any work be commenced without written authorization by the City Engineer. All Construction and Materials shall comply with the City of Wichita Specifications and Standards (on file and available in the City Engineer's Office).






BAUGHMAN COMPANY P.A.
ENGINEERING, SURVEYING, & PLANNING
316-262-7271 • 315 ELLIS • WICHITA, KANSAS 67211

Project Inspected & Built by Baughman Co. 3/00

18-5-2-4

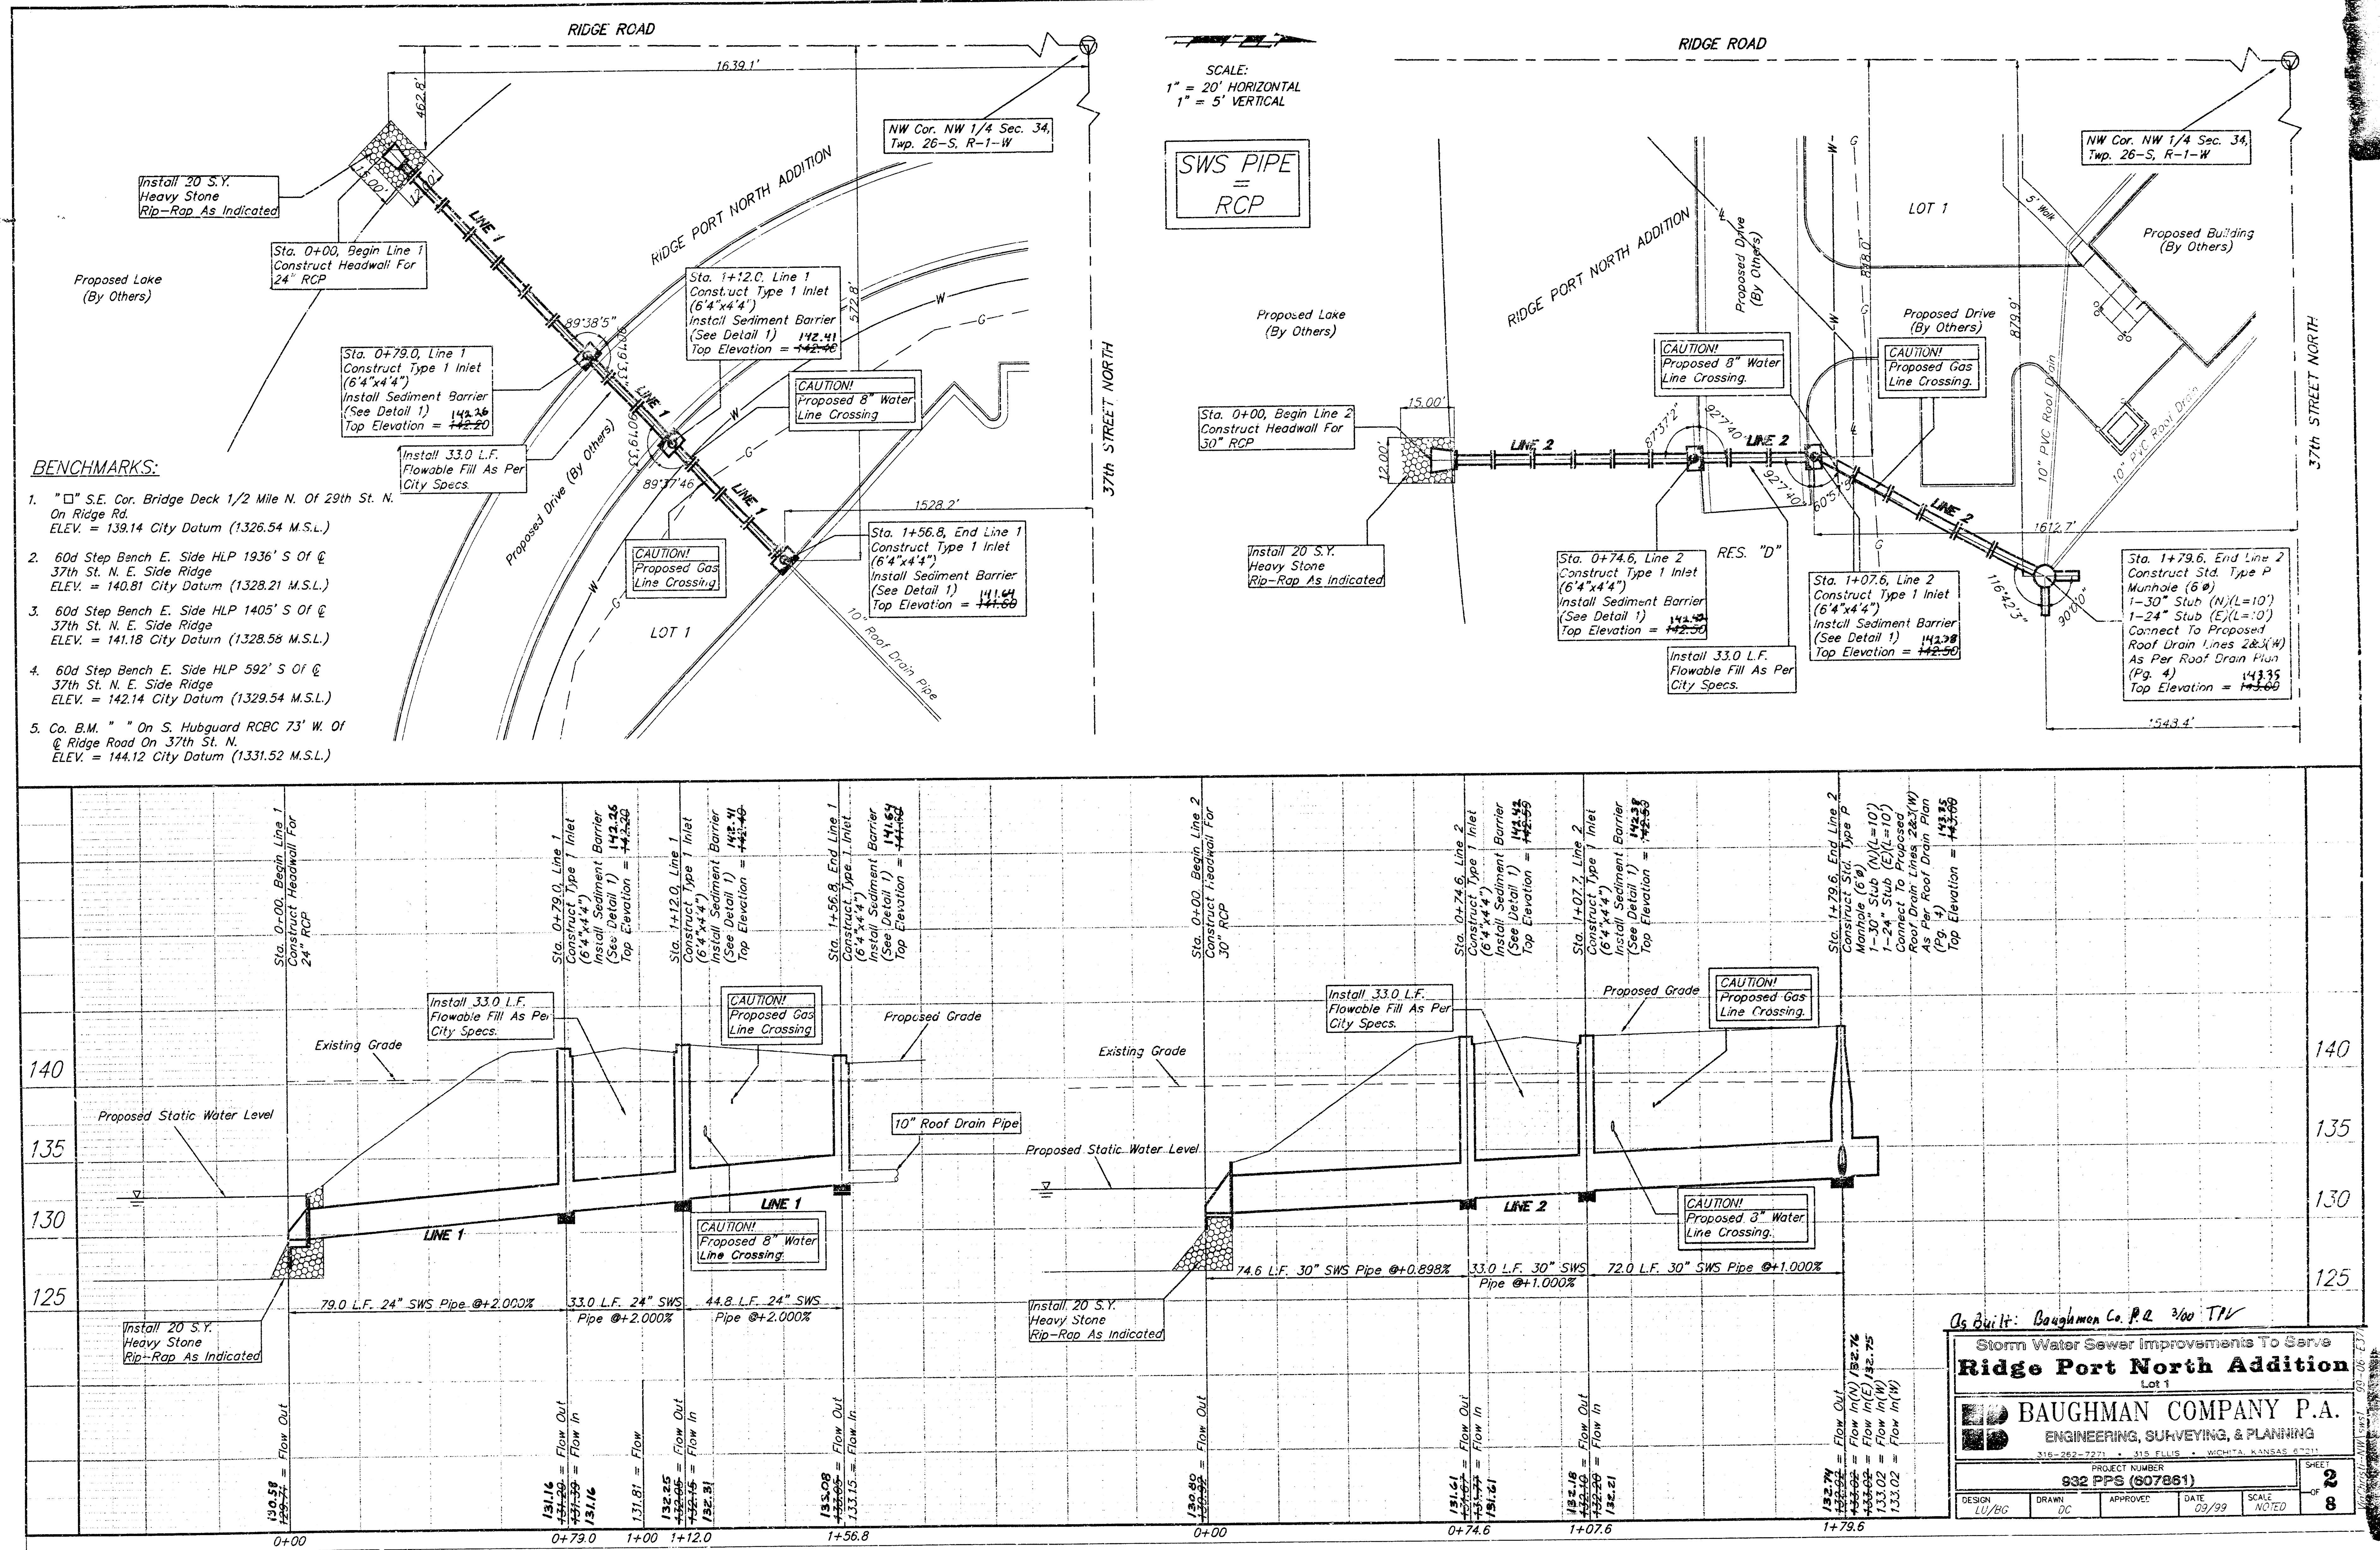

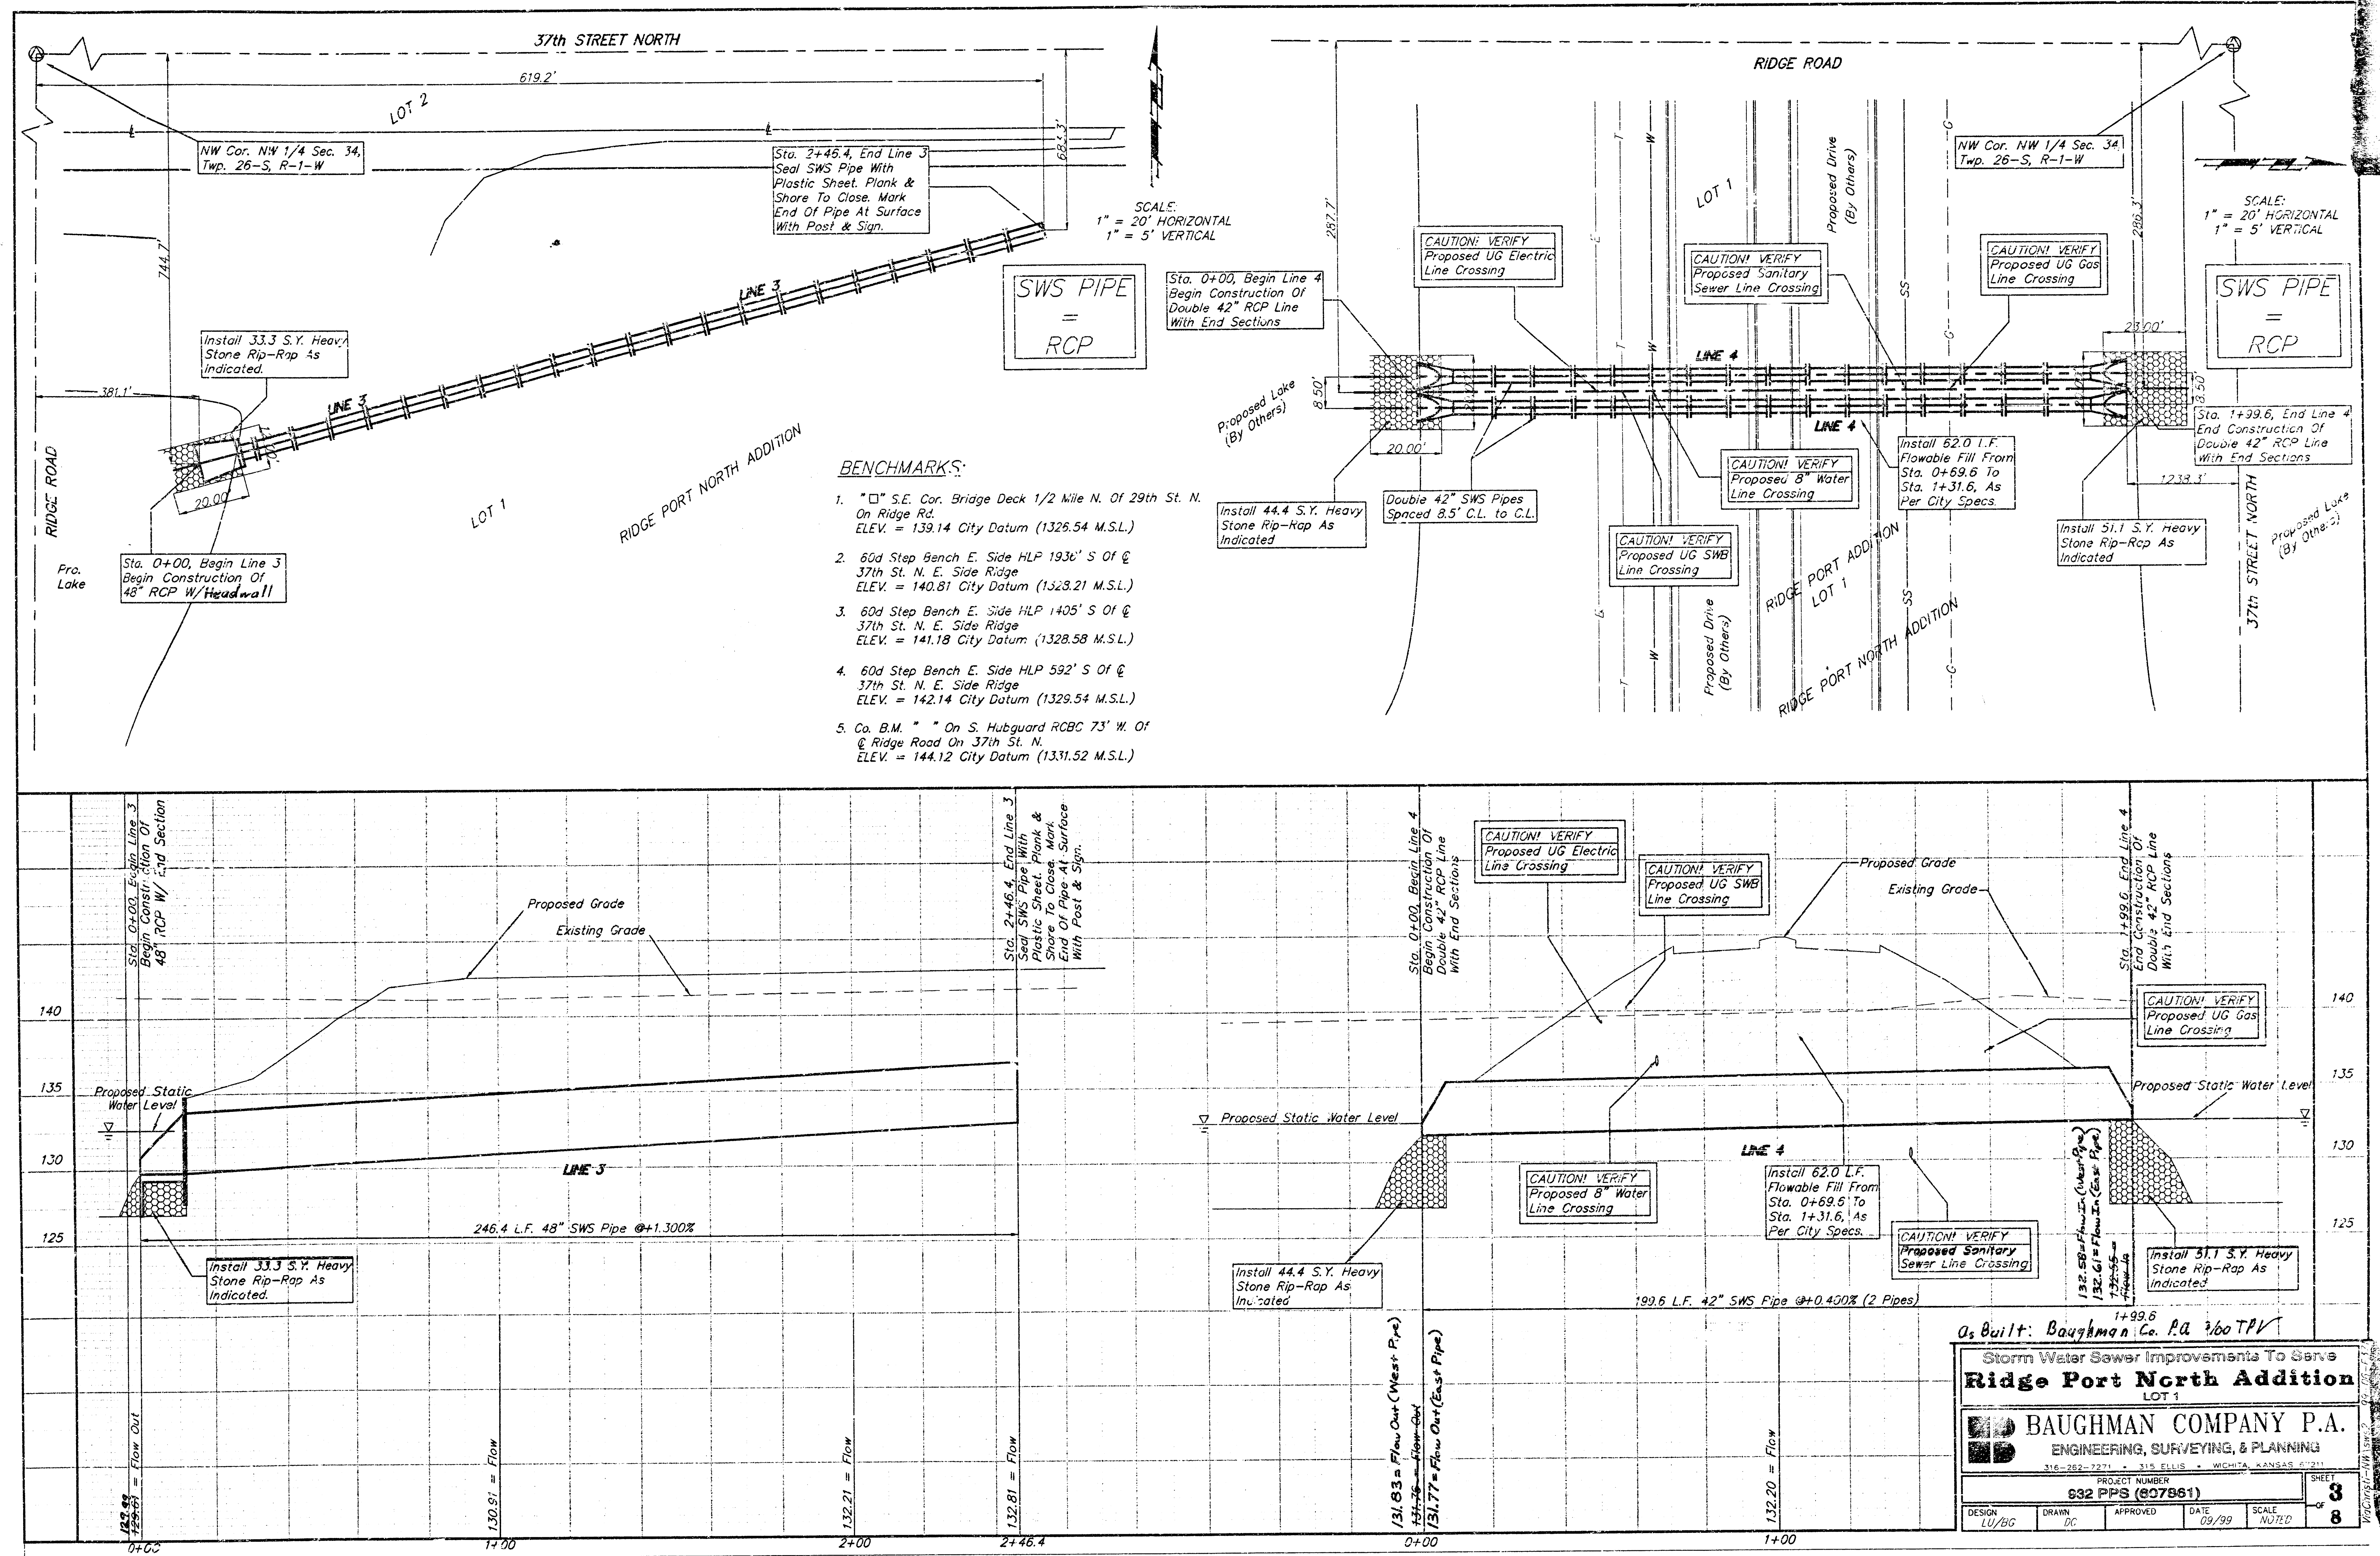

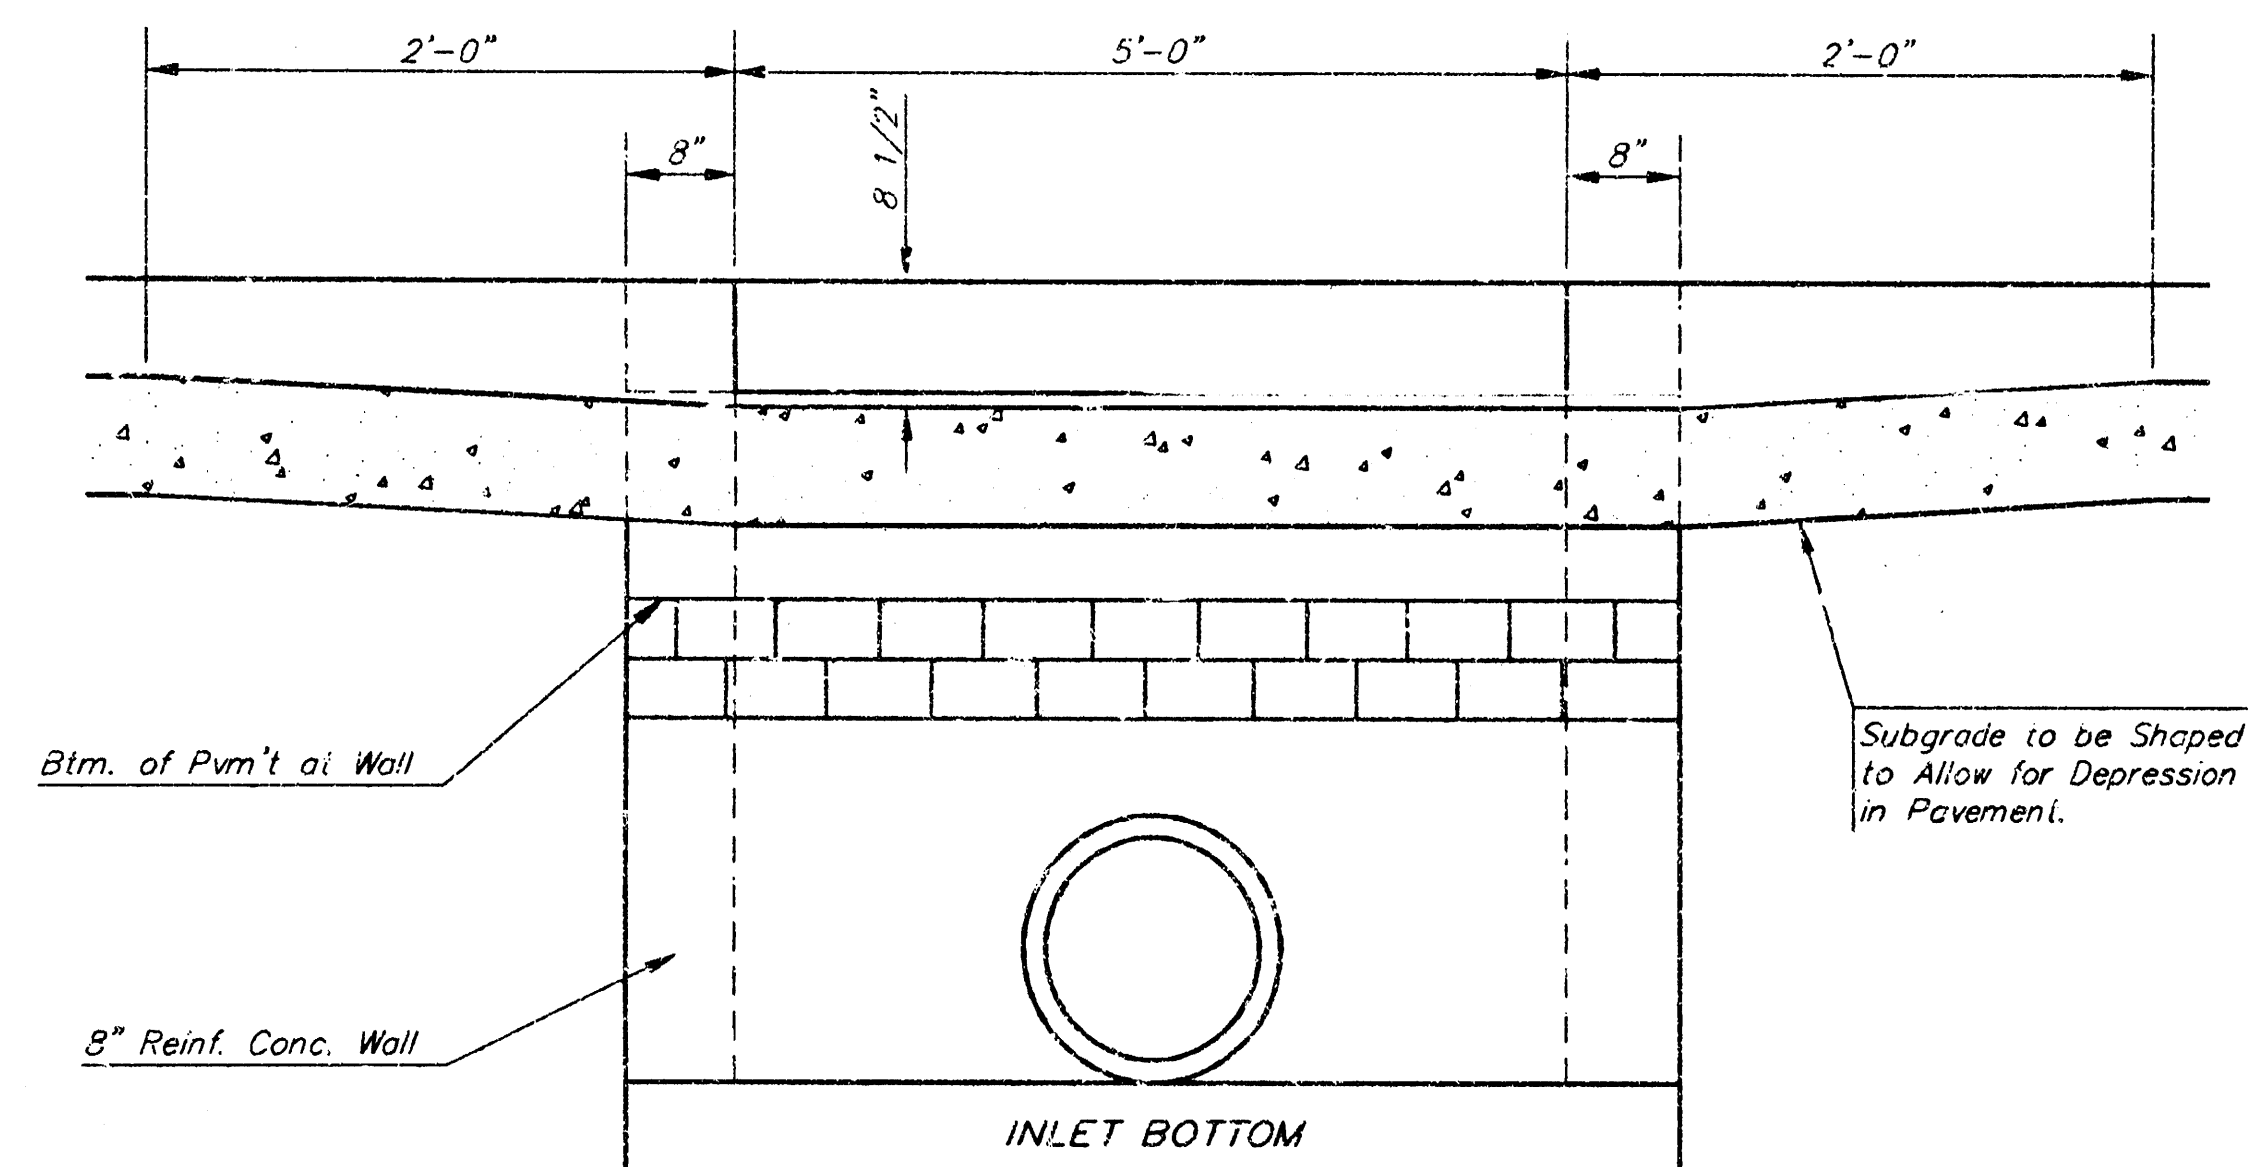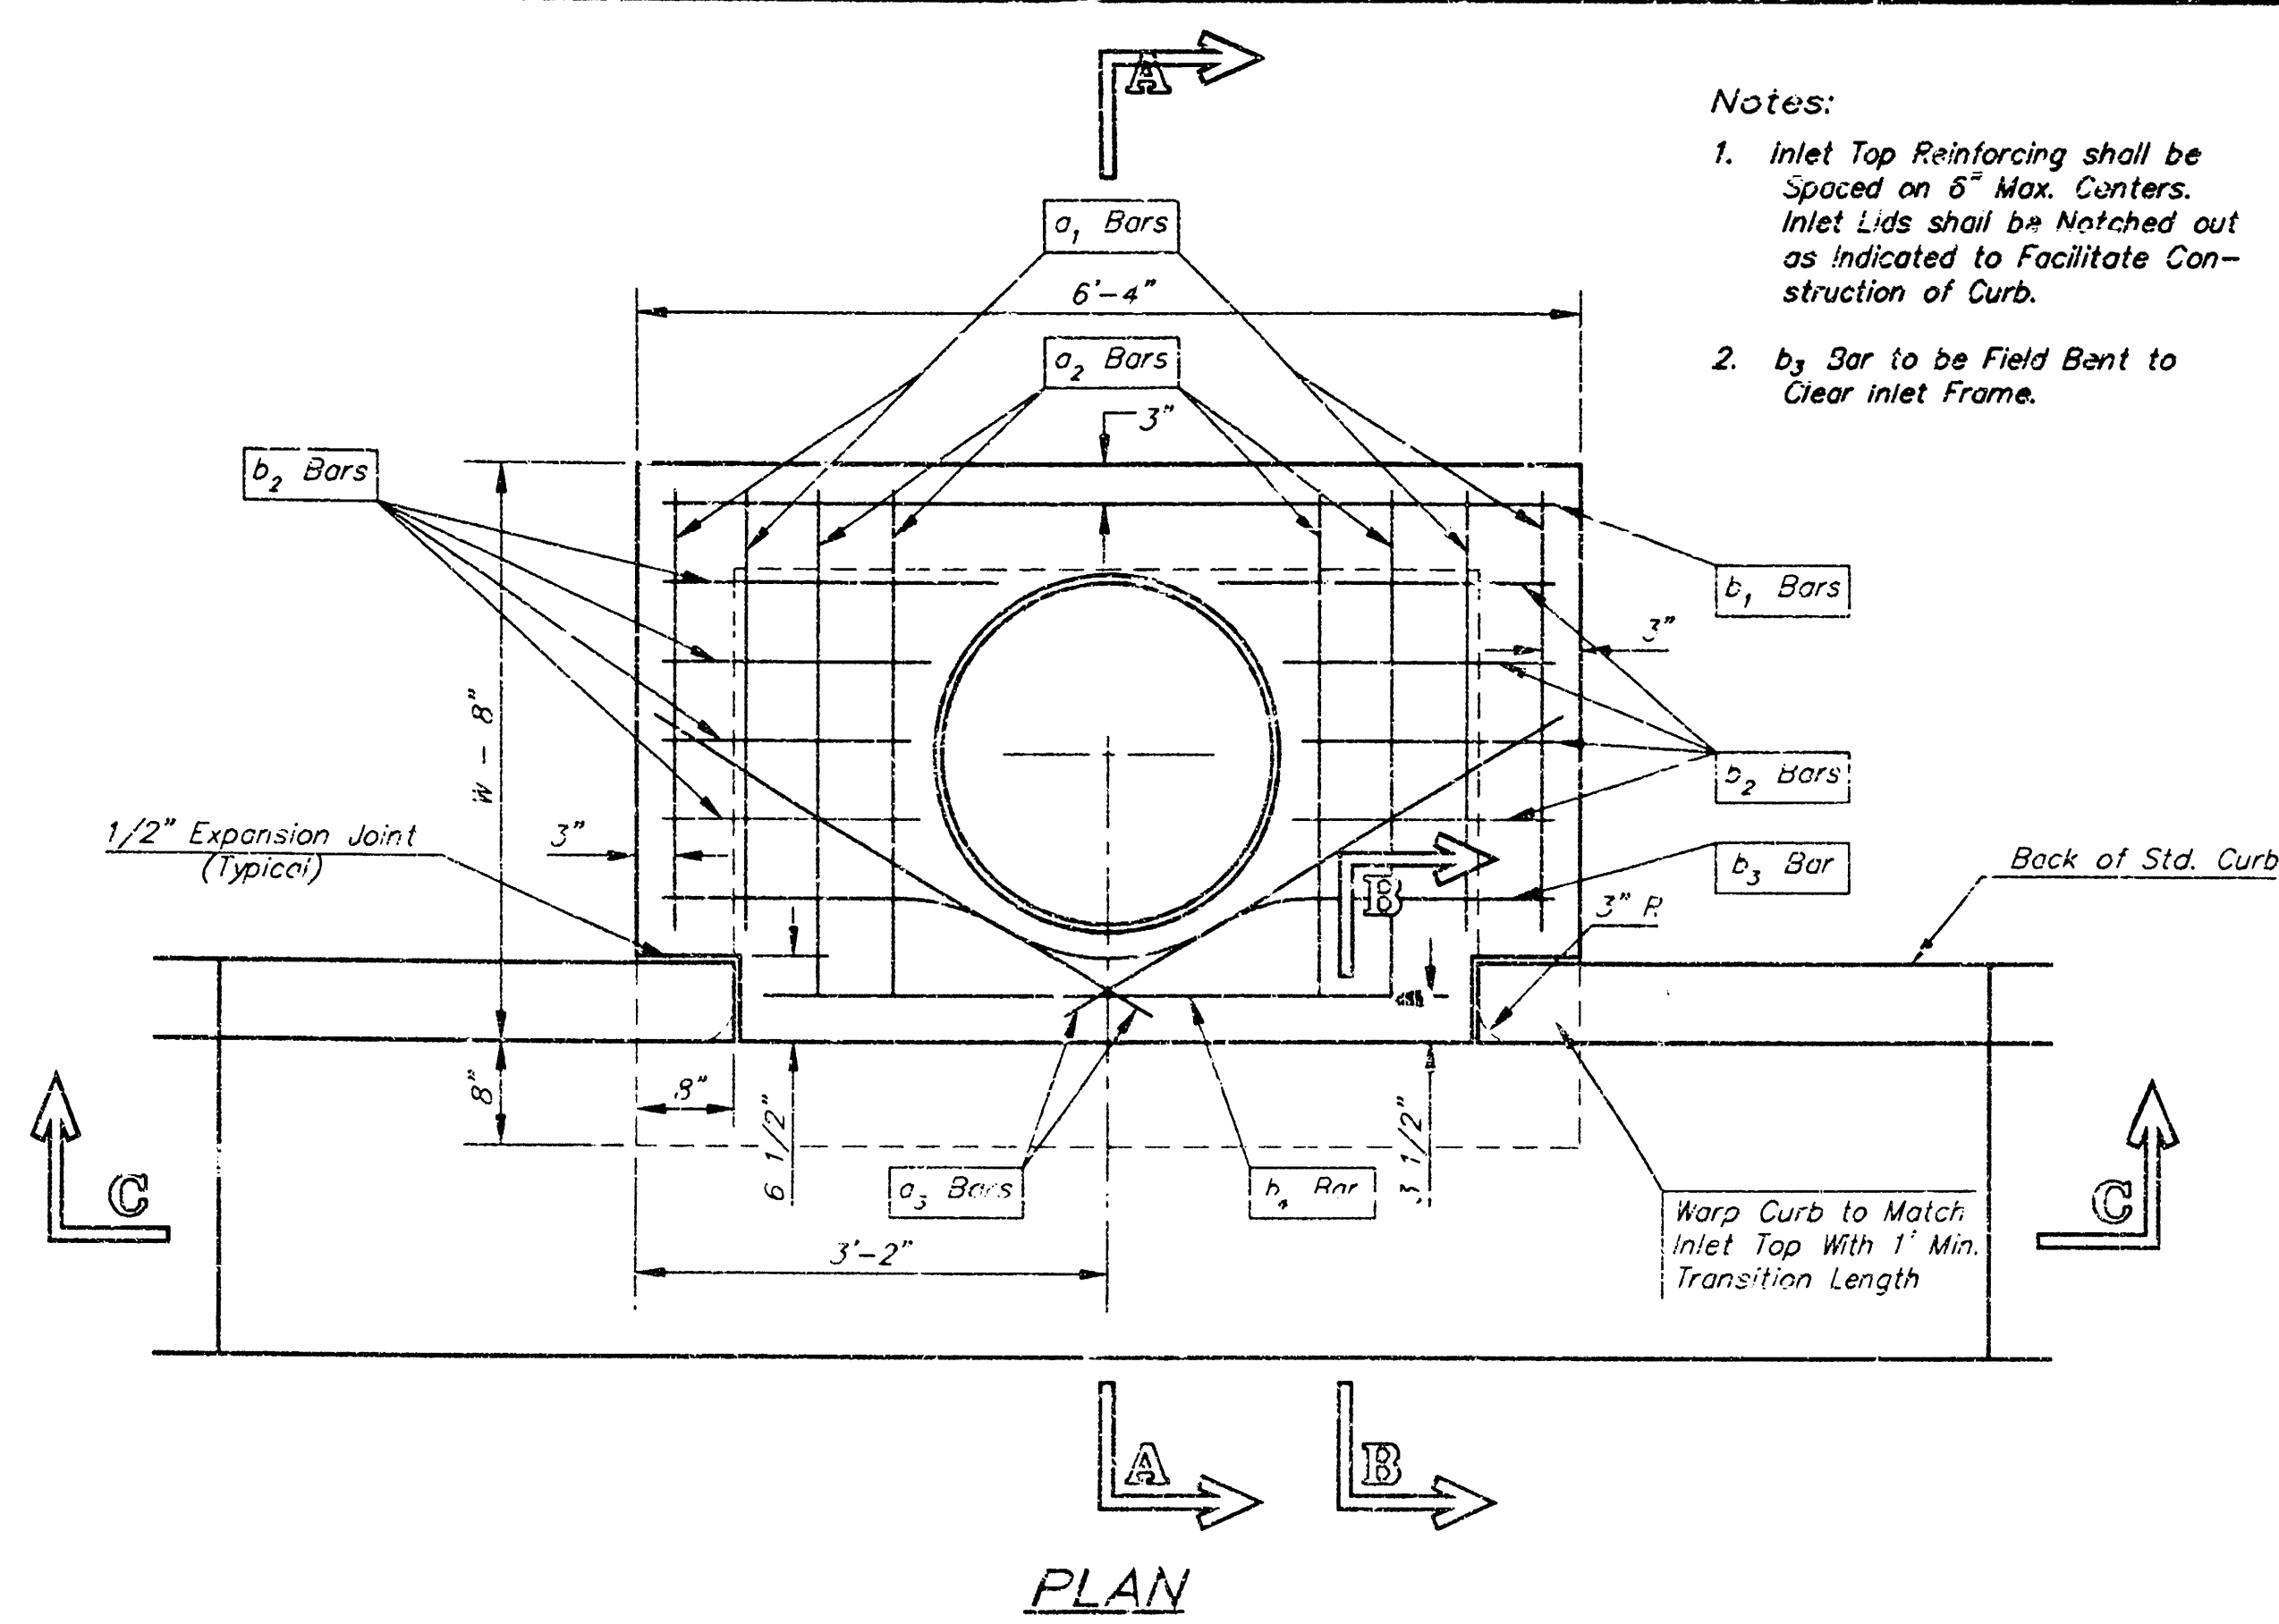

STEEL SCHEDULE

BAR	a ₁			a ₂					b ₁				b ₂				Wt. Lbs.
	4	4	2	1	3	5	7	9	6	1	1	1	1	1			
NUMBER	4	4	2	1	3	5	7	9	6	1	1						
SIZE	#4	#4	#4	#4	#4	#4	#4	#4	#4	#4	#6						
LENGTH	W=4'-4"	5'-7"	6'-7"	4'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	60±					
	W=5'-4"	7'-7"	8'-7"	5'-0"	6'-1"	-	-	-	1'-9"	6'-2"	4'-8"	81±					
	W=6'-4"	9'-7"	10'-7"	6'-0"	-	6'-1"	-	-	1'-9"	6'-2"	4'-8"	101±					
	W=7'-4"	11'-7"	12'-7"	7'-0"	-	-	6'-1"	-	1'-9"	6'-2"	4'-9"	121±					
	W=8'-4"	13'-7"	14'-7"	8'-0"	-	-	-	6'-1"	1'-9"	6'-2"	4'-8"	141±					




Note: a₃ Bars to be Placed Approx. 2" Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS

W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8" 6'-4" 7 1/2"	21" & SMALLER	0.38±
5'-4"	4'-8" 6'-4" 7 1/2"	24" & 30"	0.51±
6'-4"	5'-8" 6'-4" 7 1/2"	36" & 42"	0.64±
7'-4"	6'-8" 6'-4" 7 1/2"	48" & 54"	0.77±
8'-4"	7'-8" 6'-4" 7 1/2"	60" & 66"	0.90±



GENERAL NOTES

- Concrete taps to be installed on thin mortar cushion to insure full support along brick walls. Concrete taps may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.
- Contractor shall have the option of constructing 8" brick masonry walls between the concrete inlet base and top on this inlet when W=6'-4" and H=7'-0" or less.
- Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
- The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

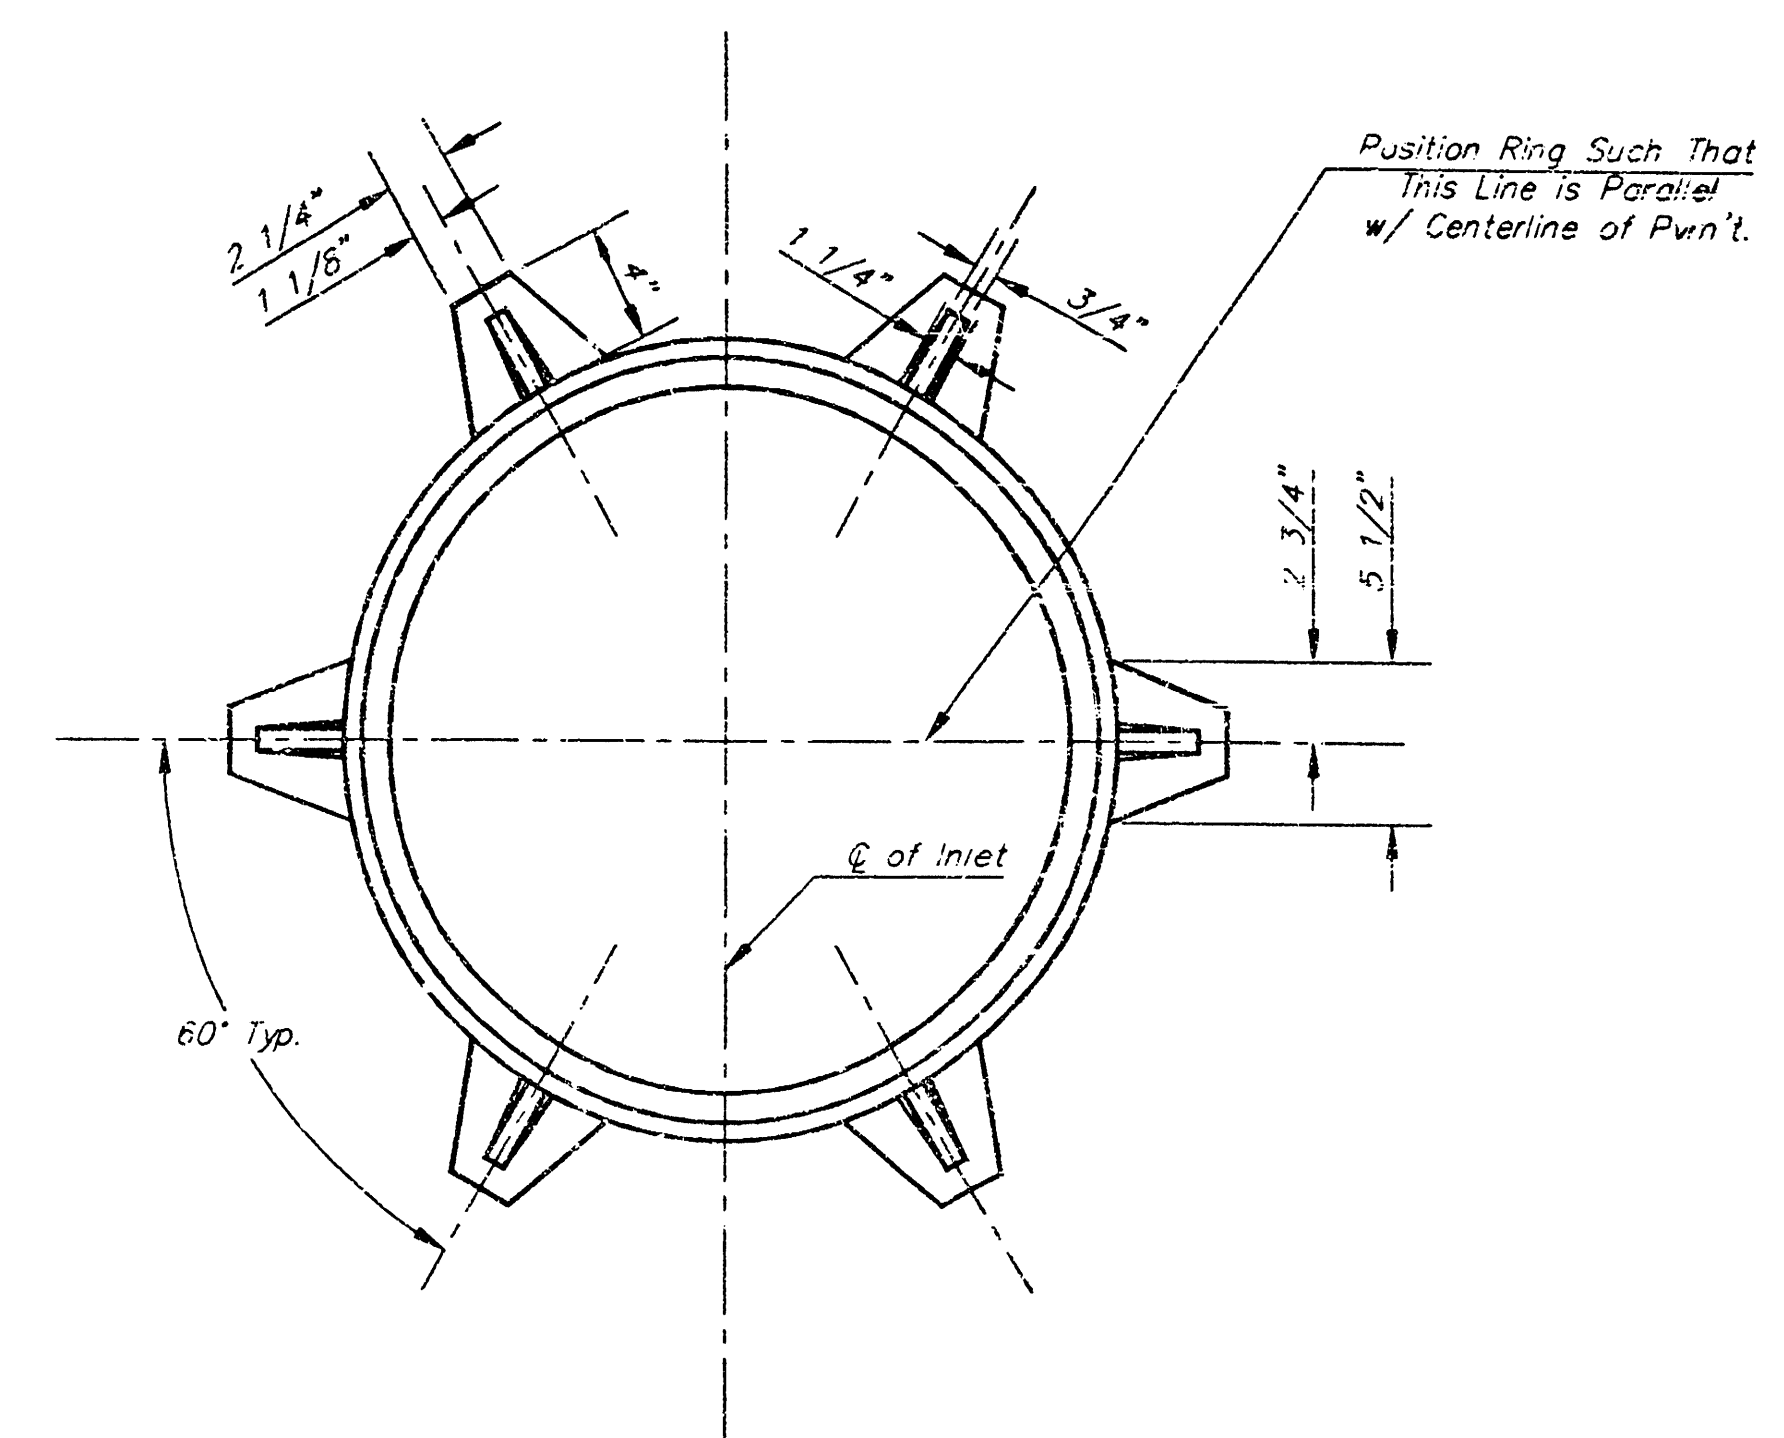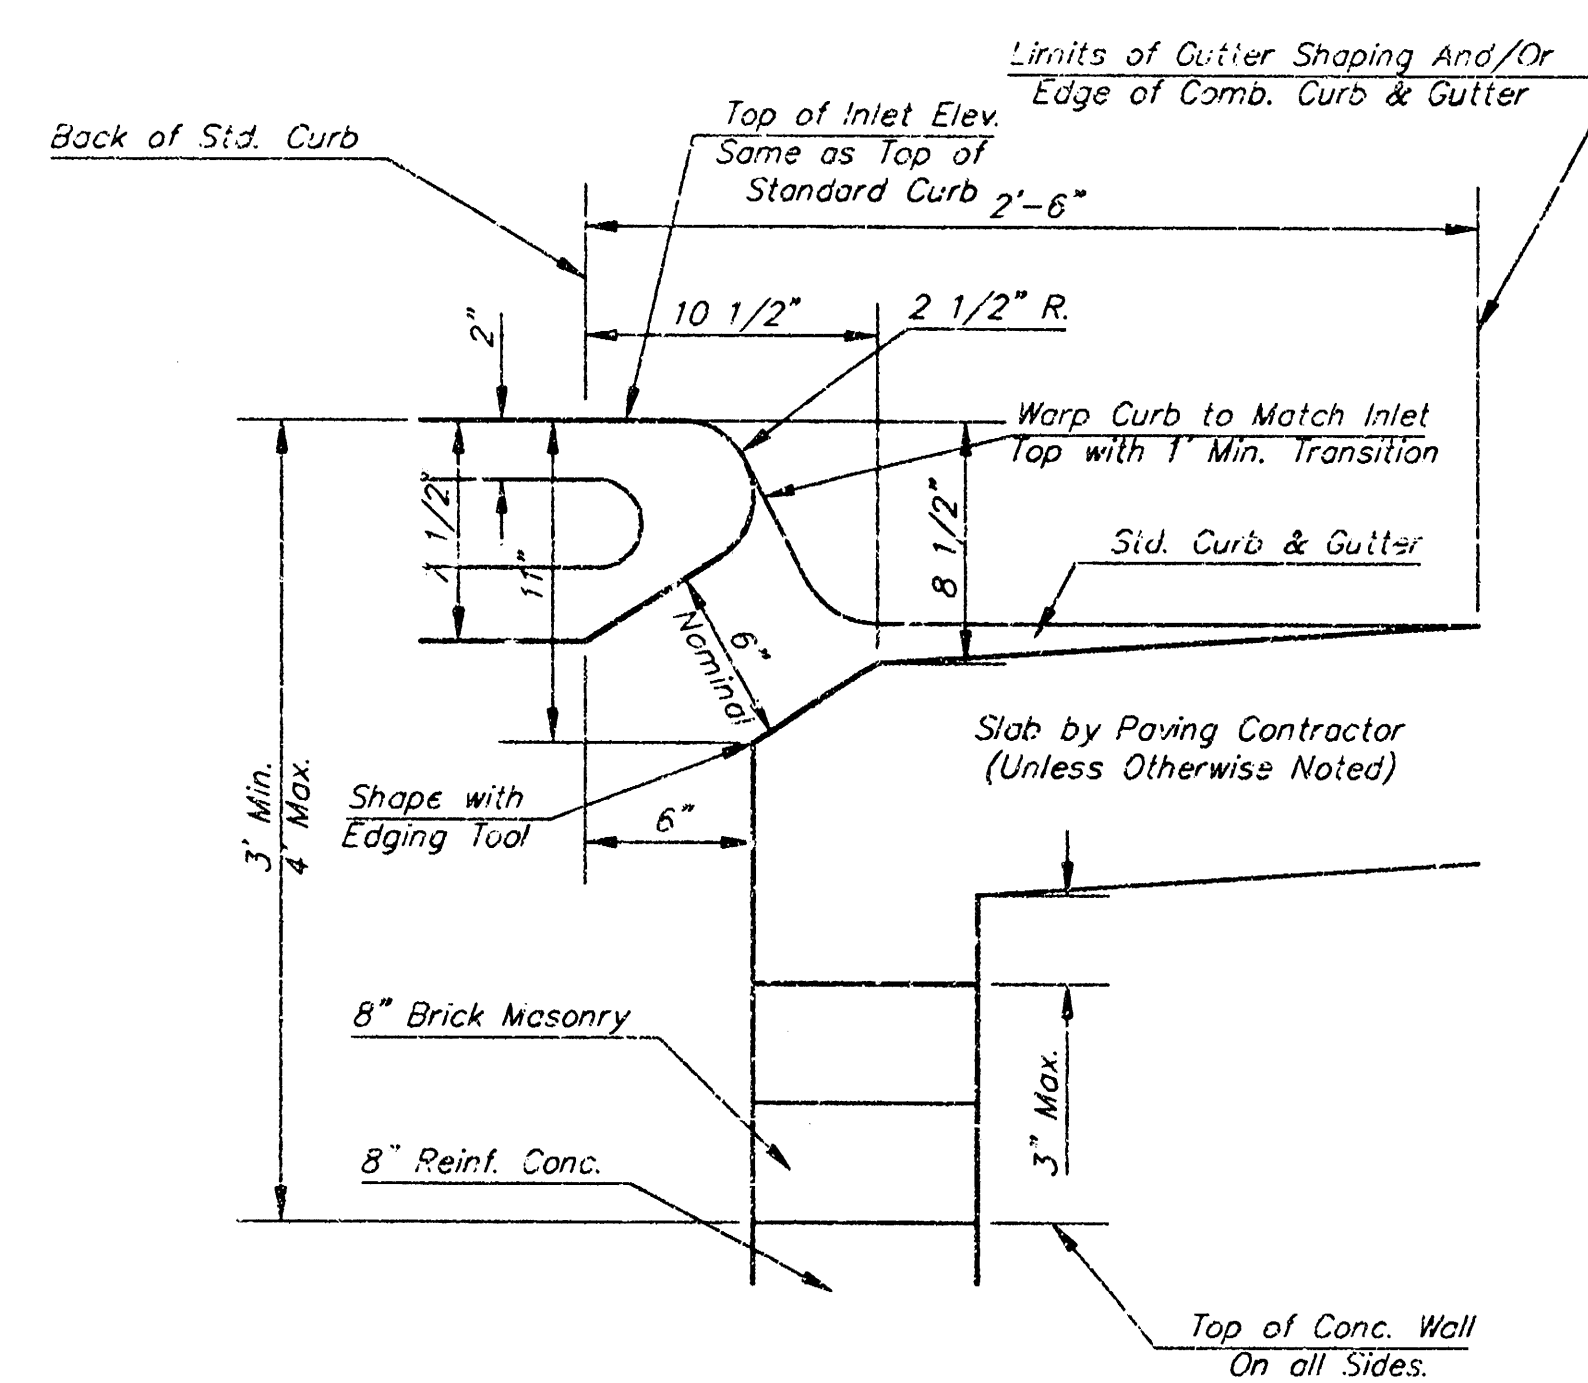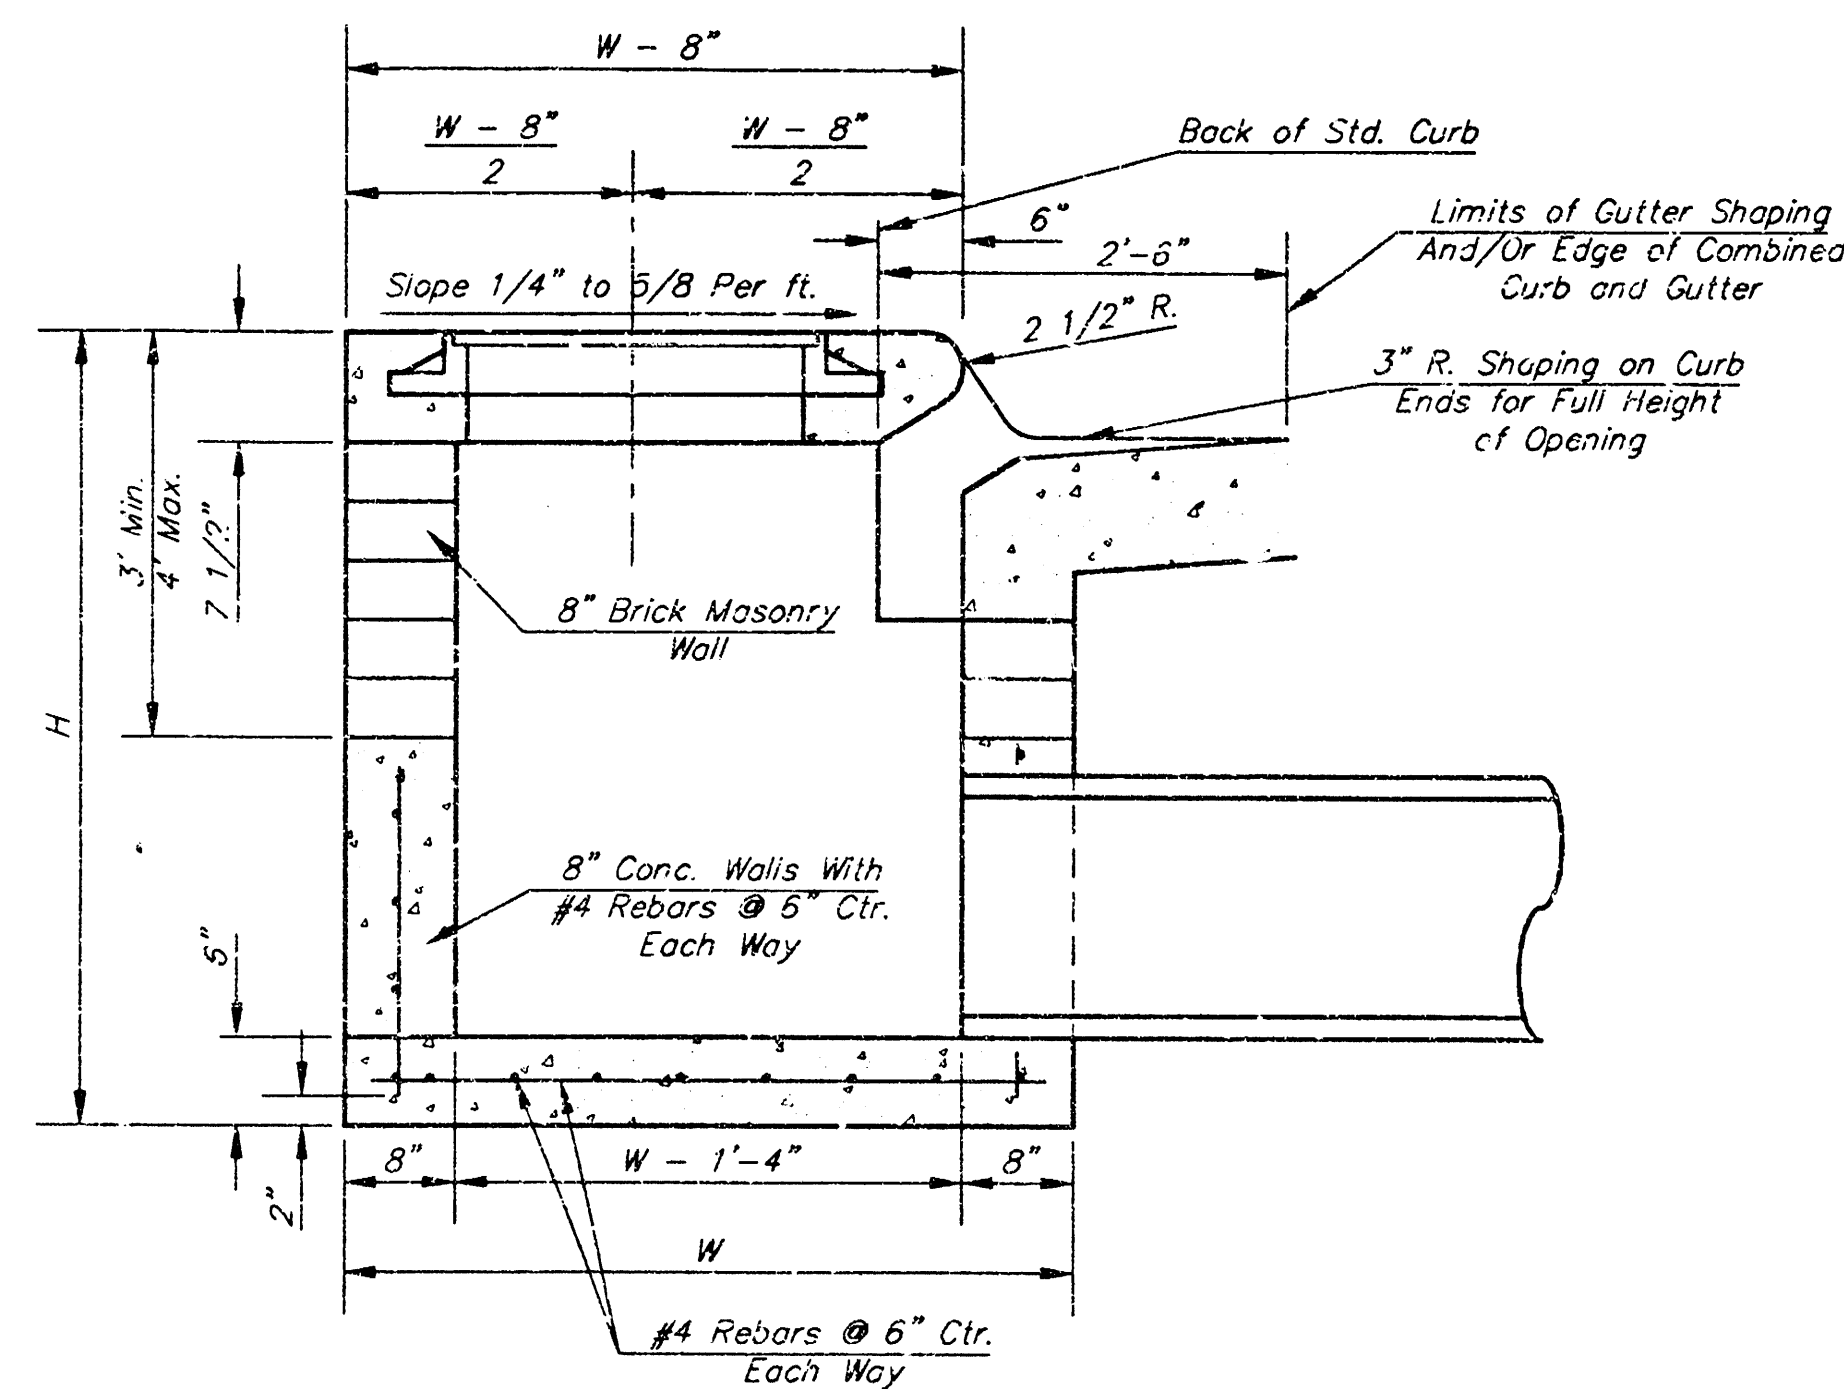

MANHOLE RING AND COVER

*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

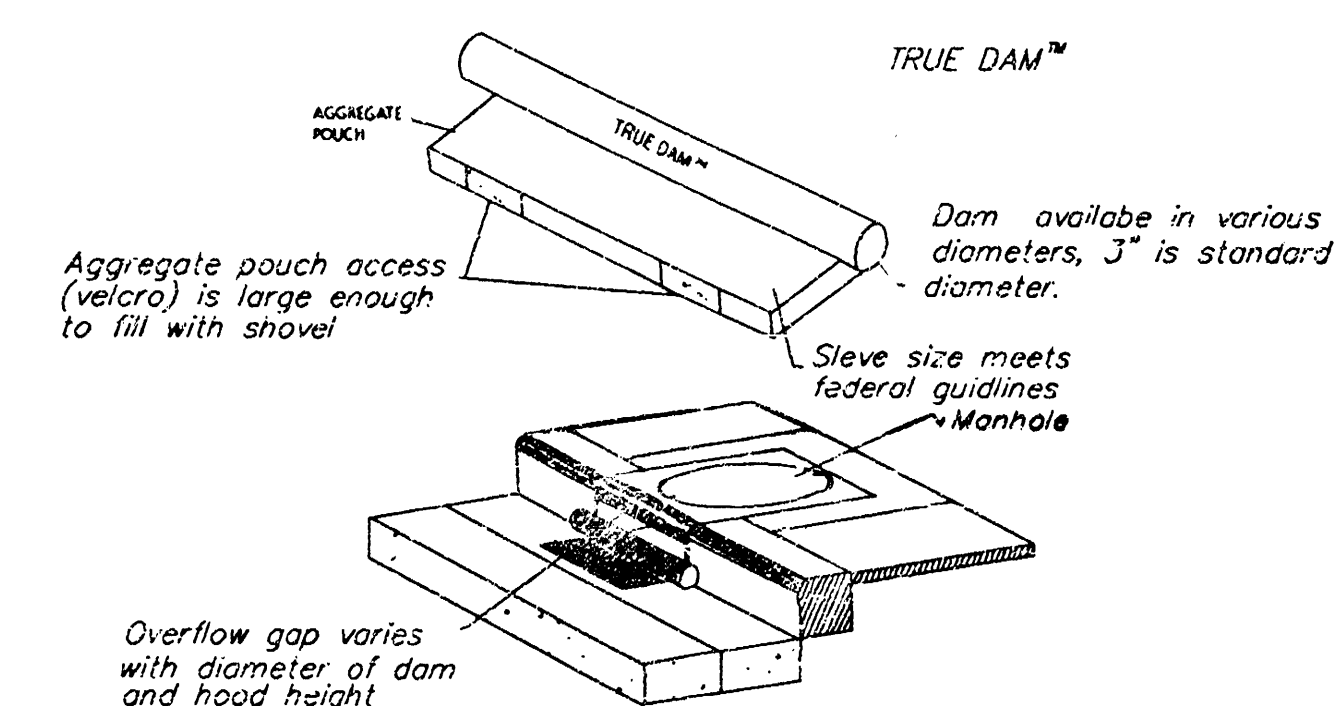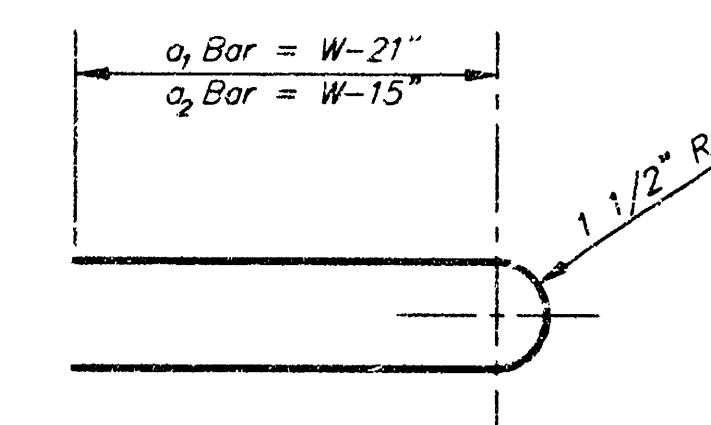

Note: A substitute to the "Dandy Bags" or the "True Dam" must be comparable and approved by the engineer in charge. For more information on the "Dandy Bag" and the "True Dam" call Merideth Brothers, Inc., Suppliers of Dandy Products at 1-800-591-2284. Dandy Products or alternative to be paid per Each as Sediment Barriers.

No Scale

SEDIMENT BARRIER DETAIL 1

CITY OF WICHITA, KANSAS

TYPE 1 CURB INLET

INLET OPENING = 6"X6'-0"

BAUGHMAN COMPANY P.A.

ENGINEERING, SURVEYING, & PLANNING


316-282-7271 • 315 ELLIS • WICHITA, KANSAS 67211

PROJECT NUMBER: 932 PPS (607861)

DESIGN: C.O.W. DATE: 9/99 SCALE: N=1"=10'

DRAWN: STAFF APPROVED: N=1"=10'

SHEET: 4 OF 8

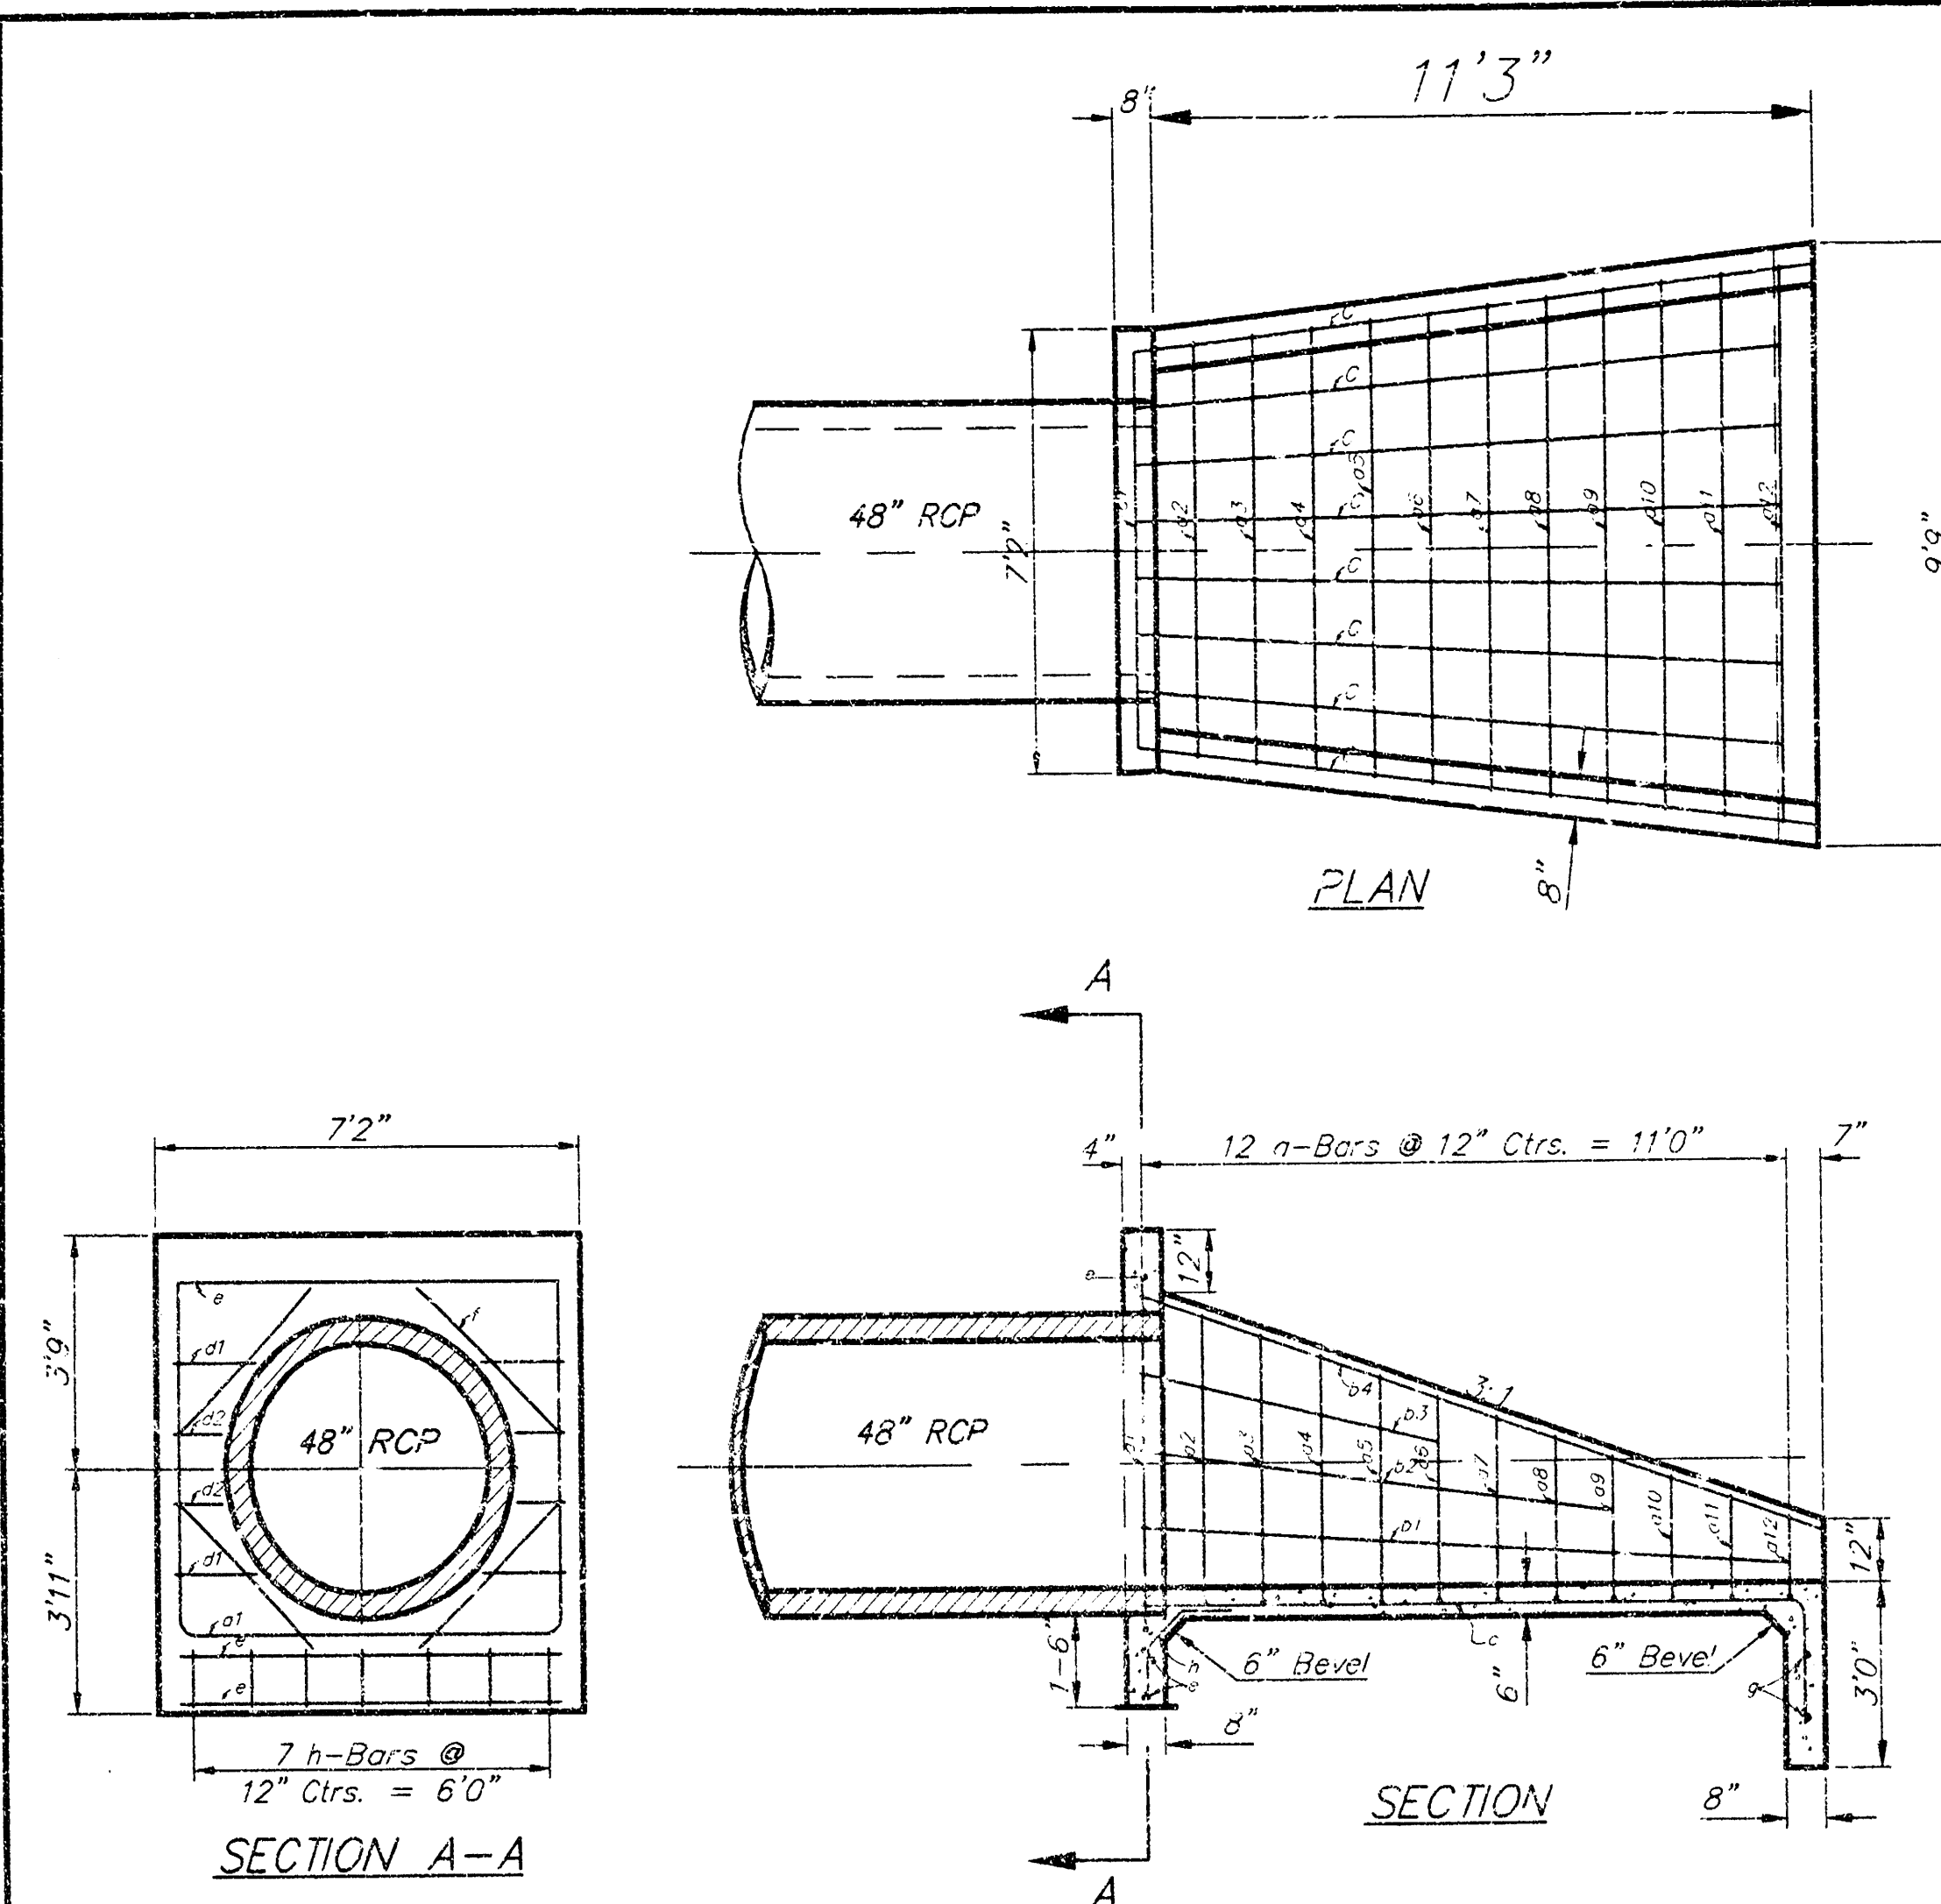

a-Bars	
a1 5'8"	
a2 4'7"	
a3 4'3"	
a4 3'11"	
a5 3'7"	
a6 3'3"	
a7 2'11"	
a8 2'7"	
a9 2'3"	
a10 1'11"	
a11 1'7"	
a12 1'3"	

c-Bars	
c1 6'5"	
c2 6'8"	
c3 6'10"	
c4 7'1"	
c5 7'4"	
c6 7'7"	
c7 7'10"	
c8 8'0"	
c9 8'3"	
c10 8'6"	
c11 8'9"	
c12 8'11"	


REBAR SCHEDULE

Bar	Shape	No.	Length	Weight
a1		1	17'9"	11.86
a2		1	15'10"	10.58
a3		1	15'4"	10.24
a4		1	14'11"	9.96
a5		1	14'5"	9.69
a6		1	14'1"	9.41
a7		1	13'8"	9.13
a8		1	13'2"	8.80
a9		1	12'9"	8.52
a10		1	12'4"	8.24
a11		1	11'11"	7.96
a12		1	11'5"	7.63
b1		2	11'0"	14.70
b2		2	8'1"	10.80
b3		2	5'2"	6.90
b4		2	11'7"	15.48
c		8	13'3"	70.81
d1		4	1'4"	3.56
d2		4	9"	2.00
e		3	6'6"	13.03
f		4	3'4"	8.91
g		2	9'0"	12.02
h		7	2'6"	11.69
Total Rebar			281.92 Lbs.	
Concrete			13.22 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.

- Field Bend or Cut Reinforcing as Required for Clearance.
- All Concrete Reinforcement to be #4 Rebar.
- All Rebar to Have Min. of 1 1/2" Conc. Cover.

HEADWALL FOR 48" RCP

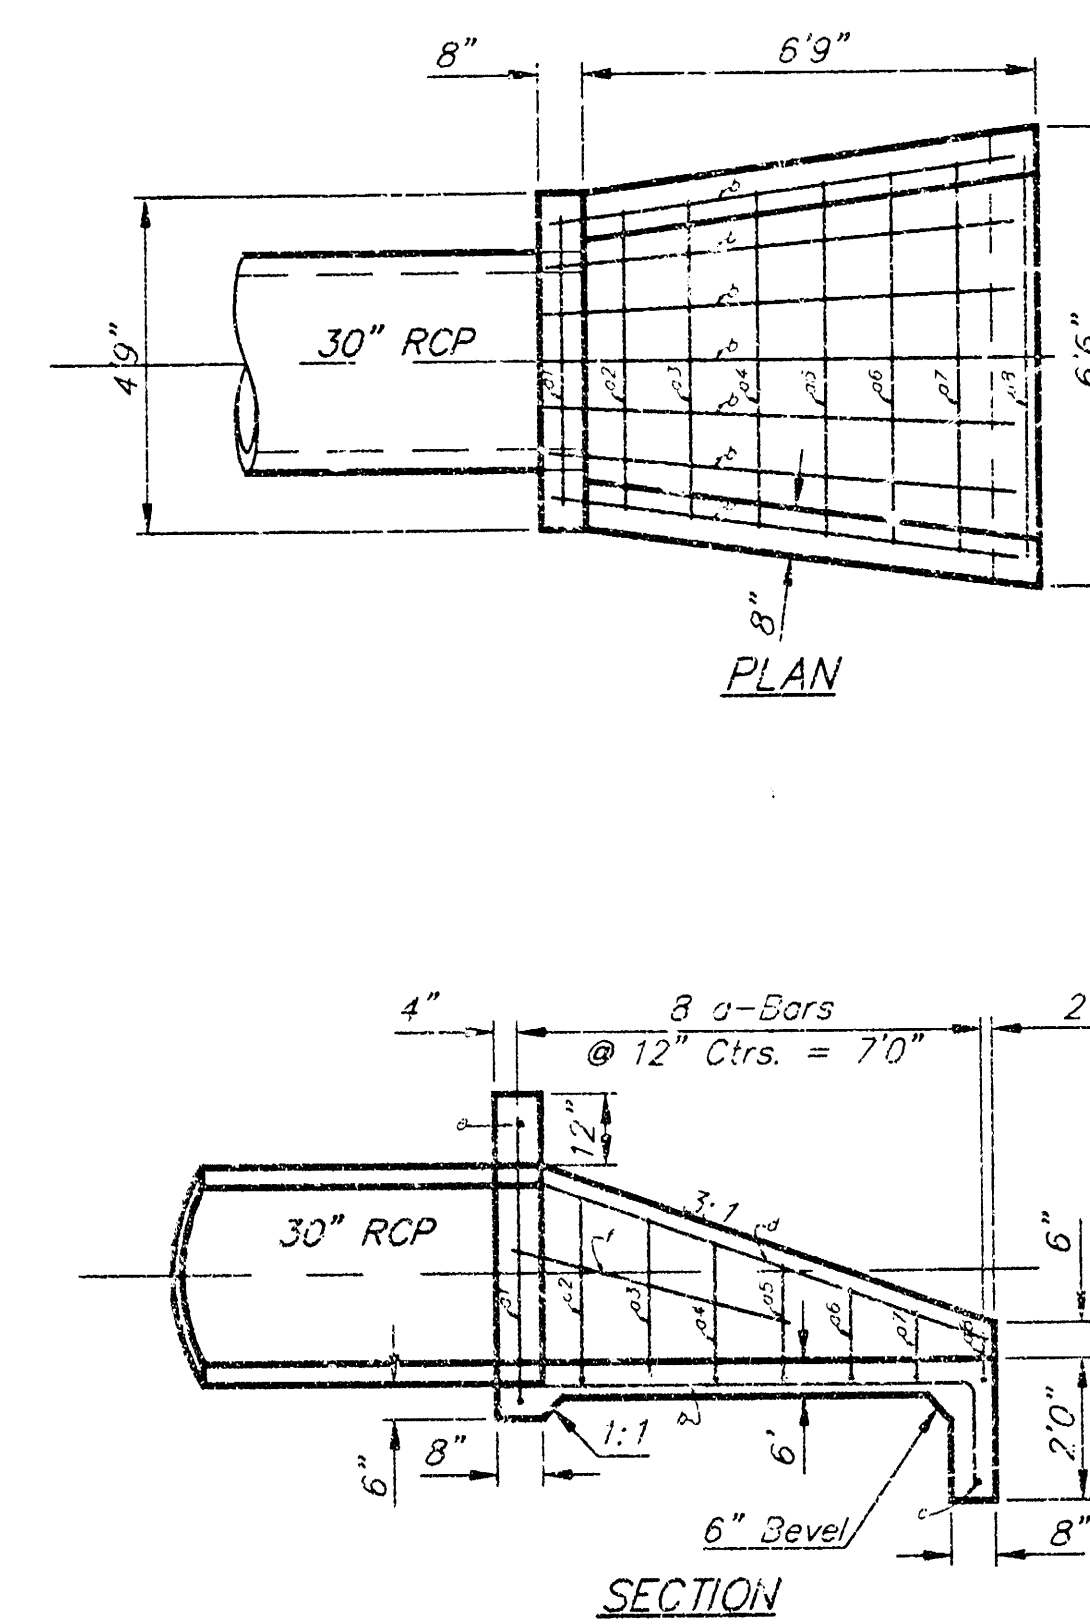

a-Bars	
a1 4'0"	
a2 2'7"	
a3 2'3"	
a4 1'11"	
a5 1'7"	
a6 1'3"	
a7 1'1"	
a8 8"	

b-Bars	
b1 4'1"	
b2 4'3"	
b3 4'5"	
b4 4'8"	
b5 5'0"	
b6 5'3"	
b7 5'6"	
b8 5'8"	


REBAR SCHEDULE

Bar	Shape	No.	Length	Weight
a1		1	12'1"	8.07
a2		1	9'5"	6.29
a3		1	9'0"	6.01
a4		1	8'6"	5.58
a5		1	8'2"	5.46
a6		1	7'9"	5.18
a7		1	7'4"	4.90
a8		1	7'0"	4.68
b		7	8'6"	32.07
c		1	6'0"	4.01
d		2	7'6"	10.02
e		1	4'5"	2.95
f		2	4'3"	5.68
Total Rebar			104.60 Lbs.	
Concrete			2.19 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.

- Field Bend or Cut Reinforcing as Required for Clearance.
- All Concrete Reinforcement to be #4 Rebar.
- All Rebar to Have Min. of 1 1/2" Conc. Cover.

HEADWALL FOR 30" RCP

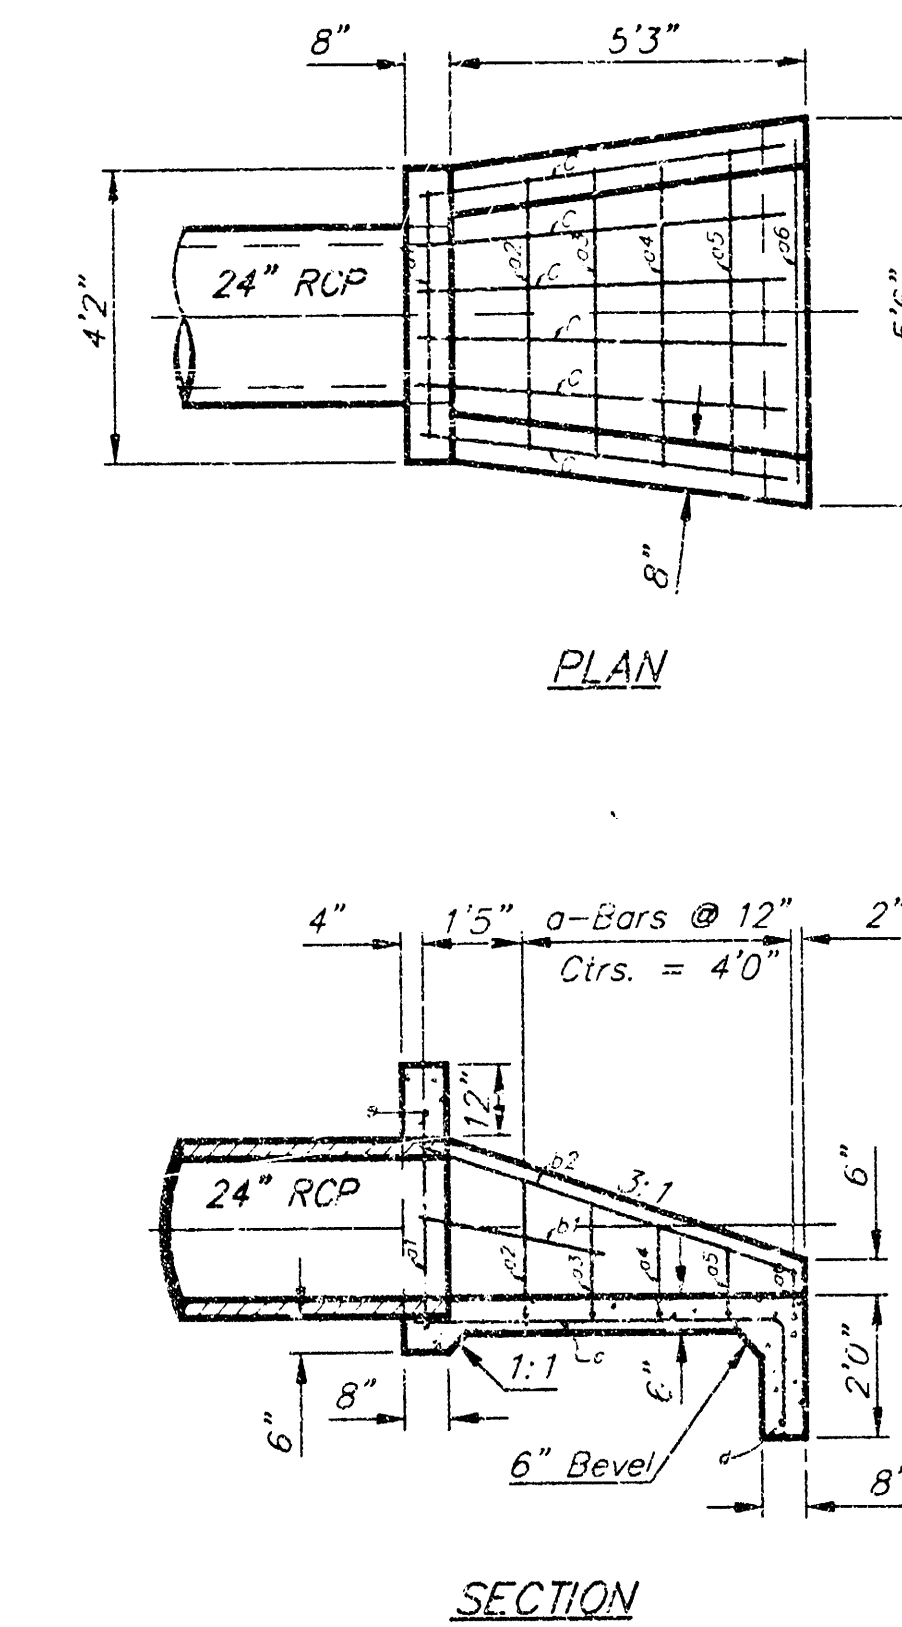

a-Bars	
a1 3'0"	
a2 1'11"	
a3 1'7"	
a4 1'3"	
a5 1'1"	
a6 8"	

c-Bars	
c1 3'5"	
c2 3'9"	
c3 4'0"	
c4 4'3"	
c5 4'6"	
c6 4'9"	

REBAR SCHEDULE

Bar	Shape	No.	Length	Weight
a1		1	9'5"	6.29
a2		1	7'7"	5.07
a3		1	7'2"	4.79
a4		1	6'9"	4.51
a5		1	6'4"	4.23
a6		1	6'1"	4.06
b1		2	2'8"	3.67
b2		2	5'10"	7.79
c		5	6'11"	27.72
d		1	5'0"	3.37
e		1	3'10"	2.56
Total Rebar			74.03 Lbs.	
Concrete			1.40 C.Y.	

A Deduction in Concrete Quantities Has Been Made for Pipe Openings Through the Headwall.

- Field Bend or Cut Reinforcing as Required for Clearance.
- All Concrete Reinforcement to be #4 Rebar.
- All Rebar to Have Min. of 1 1/2" Conc. Cover.

HEADWALL FOR 24" RCP

GENERAL NOTES


- ALL PIPES SHALL BE FLUSH CUT PRIOR TO BEING CAST INTO CONCRETE HEADWALL.
- CONCRETE USED IN HEADWALL CONSTRUCTION SHALL BE SAME AS PER CITY STANDARD PAVING MIX EXCEPT THAT IT SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 4000 PSI.
- ALL EXPOSED EDGES SHALL BE BEVELED 1/2".
- REINFORCING STEEL SHALL COMPLY TO A.S.T.M. DESIGNATION A615 GRADE 60. ALL DIMENSIONS RELATIVE TO REINFORCING STEEL ARE TO CENTERLINE OF BAR UNLESS OTHERWISE NOTED.
- THE "REIN. CONC. HEADWALL" SHALL BE PAID FOR AT THE UNIT PRICE BID PER EACH IN PLACE WHICH SHALL INCLUDE ALL LABOR, MATERIALS, EXCAVATION, CONCRETE, REINFORCING STEEL AND ALL OTHER INCIDENTAL ITEMS NECESSARY TO COMPLETE THE WORK. MATERIAL QUANTITIES SHOWN ARE FOR INFORMATION ONLY.

HEADWALL DETAIL


BAUGHMAN COMPANY P.A.
ENGINEERING, SURVEYING, & PLANNING
316-282-7271 • 315 ELLIS • WICHITA, KANSAS 67211

PROJECT NUMBER
932 PPS (607881)
DESIGN BLP/DMV DRAWN JAK APPROVED DATE 09/99 SCALE NONE SHEET 5 OF 8

SEWER APPURTENANCES DETAILS

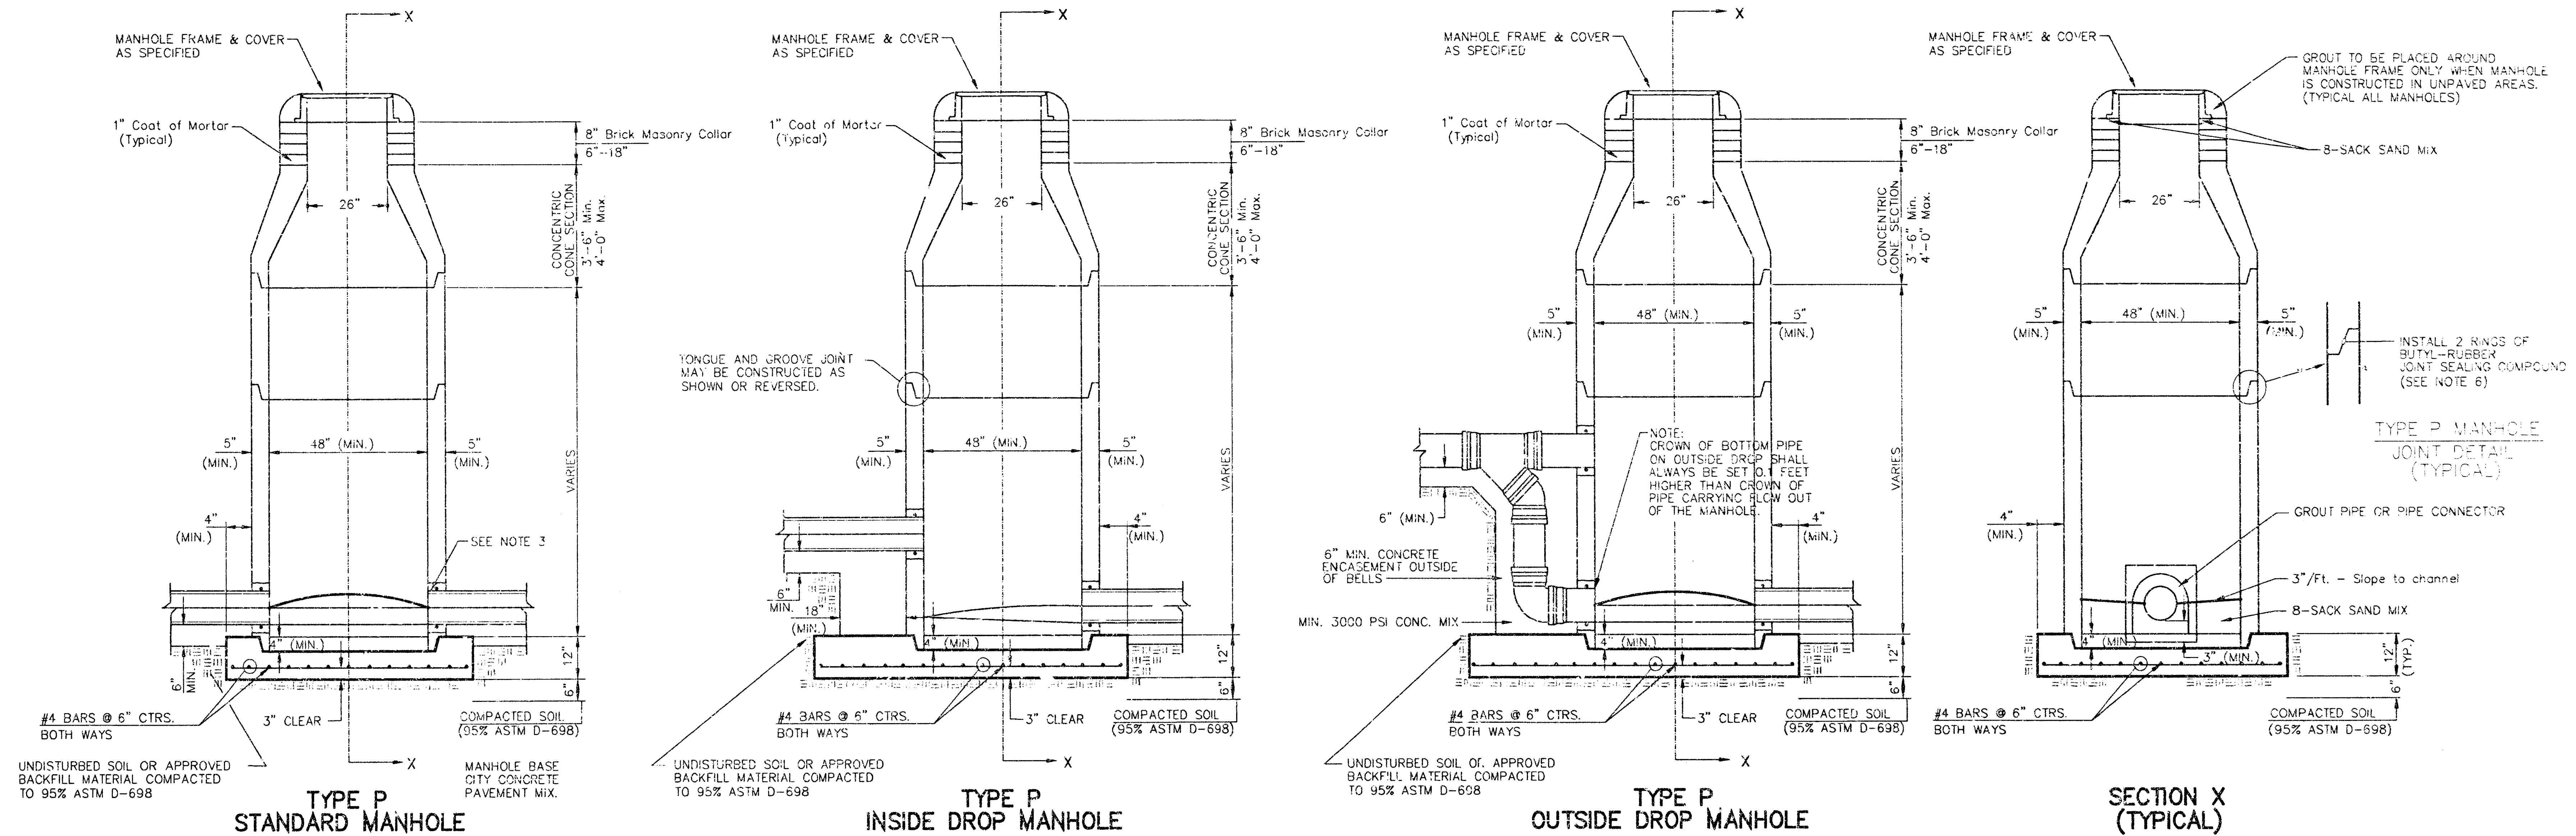
GENERAL NOTES
PRECAST MANHOLE NOTES

- ALL PRECAST CONCRETE MANHOLE SECTIONS SHALL CONFORM TO THE LATEST REVISIONS OF A.S.T.M. C478 AS MODIFIED BY THE SPECIFICATIONS.
- NON-SHRINK GROUT SHALL BE NON-METALLIC TYPE.
- APPROVED FLEXIBLE WATERSTOP GASKETS SHALL BE INSTALLED TO JOIN THE SEWER TO THE MANHOLE WALL WHEN A.B.S. COMPOSITE PIPE OR P.V.C. PIPE IS USED. FOR OTHER TYPES OF PIPE THE SEWER SHALL BE GROUTED IN PLACE WITH NON-SHRINK GROUT. THE SEWER PIPE SHALL BE SUPPORTED WITH CONCRETE ENCASEMENT A MINIMUM OF 3 FEET FROM THE MANHOLE WALL AND TO THE FIRST JOINT FOR V.C.P. SUCH THAT THE JOINT REMAINS FLEXIBLE.
- ALL INSIDE SURFACES OF THE CONCRETE MANHOLE WHICH WOULD BE EXPOSED TO SEWER GAS SHALL BE COATED WITH 2 COATS TNEPEC SERIES 66 HI-BUILD EPOXOLINE, DRY THICKNESS OF 8 MILS (MIN.).
- EXTERIOR MANHOLE WALLS SHALL BE COATED WITH 1 COAT MOBILARMA 633 BITUMINOUS COATING.
- JOINT SEALING COMPOUND SHALL BE KENT SEAL NO. 2 OR APPROVED EQUAL.
- PRECAST MANHOLES SHALL BE SET AT LEAST 4 INCHES INTO THE MANHOLE BASE.
- TOP OF MANHOLE FLOOR SLAB SHALL BE AT LEAST 3 INCHES BELOW THE FLOW LINE OF THE OUTLET PIPE TO INSURE SUFFICIENT MINIMUM THICKNESS OF SHAPED INVERT.
- LIFTING HOLES SHALL BE FILLED WITH NON-SHRINK GROUT AND THE INTERIOR SURFACE COATED AS SPECIFIED.
- MORTAR USED IN MASONRY CONSTRUCTION SHALL CONTAIN 8 SACKS OF CEMENT PER CUBIC YARD. CONCRETE USED IN MANHOLE BASES SHALL CONFORM TO THE REQUIREMENTS OF CONCRETE FOR CONCRETE PAVEMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS USING CITY CONCRETE PAVEMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACED AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE SMALLER THAN 24" SHALL HAVE AN INSIDE DIAMETER OF 4". MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE 24" OR LARGER SHALL HAVE AN INSIDE DIAMETER OF 5". COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.
- REINFORCING STEEL SHALL BE INSTALLED IN THE MANHOLE BASES AND SHALL CONSIST OF NO. 4 BARS PLACED ON 6" CENTERS IN BOTH DIRECTIONS. THE MANHOLE BASE REINFORCEMENT SHALL BE PLACED AT LEAST 3" ABOVE THE BOTTOM OF THE MANHOLE BASE. ALL COSTS FOR FURNISHING AND INSTALLING REINFORCING STEEL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
- OPENINGS SHALL BE CUT INTO THE MANHOLE WALL WHEN OUTSIDE DROPS ARE CONSTRUCTED ON EXISTING MANHOLES. SUCH OPENINGS CUT INTO EXISTING MANHOLES SHALL BE AS SMALL AS PRACTICAL TO FACILITATE INSTALLING AND GROUTING THE NEW PIPE IN PLACE. WATERSTOP GASKETS SHALL BE USED WITH P.V.C. AND A.B.S. COMPOSITE PIPE. THE NEW PIPE SHALL BE GROUTED INTO THE OPENING USING AN APPROVED NON-SHRINK GROUT FOR THE FULL MANHOLE WALL THICKNESS. THE EXTERIOR OF THE COMPLETED CONNECTION SHALL BE SEALED WITH AN APPROVED BITUMINOUS COATING SUCH THAT THE CONNECTION WILL BE WATER TIGHT. FLOOR OF MANHOLE SHALL BE MODIFIED TO FORM NEW FLOW CHANNEL FOR THE NEW CONNECTION AS INDICATED BY THE DRAWING. THIS WORK, INCLUDING MODIFICATION OF MANHOLE FLOOR, SHALL BE PAID FOR AT THE UNIT PRICE BID FOR OUTSIDE DROP STACK CONSTRUCTED ON EXISTING MANHOLE.
- THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF CLEANING AND FREE OF AREAS WHERE SOLIDS COULD BE DEPOSITED AS SEWAGE FLOWS THROUGH THE MANHOLE FROM ALL INLET PIPES TO THE OUTLET PIPE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE AS SHOWN BY THE DRAWINGS EXCEPT FOR INSIDE DROP MANHOLES. FLOW CHANNELS FOR INSIDE DROP MANHOLES SHALL BE CONSTRUCTED AS INDICATED BY THE DRAWING. MANHOLE FLOORS SHALL HAVE SLOPES OF 3 INCHES PER FOOT IN THE AREAS OUTSIDE OF THE FLOW CHANNELS SLOPED TOWARD THE FLOW CHANNELS. PIPES LAID THROUGH MANHOLES SHALL HAVE THE TOP HALF REMOVED TO NEAT LINES FOR THE FULL INSIDE DIAMETER OF THE MANHOLE. MANHOLE FLOORS SHALL THEN BE SHAPED AROUND THE BOTTOM HALF OF THE PIPE WHICH FORMS THE FLOW CHANNEL.
- PIPES INSTALLED WITHIN THE EXCAVATION MADE FOR THE MANHOLE SHALL BE CRADLED WITH CONCRETE TO THE LIMITS OF THE MANHOLE EXCAVATION. WHEN CLAY PIPE IS USED, THE CRADLE SHALL EXTEND TO THE FIRST JOINT OUTSIDE THE MANHOLE. THE CRADLE SHALL BE TERMINATED AT THE CLAY PIPE JOINT IN A MANNER WHICH WILL MAINTAIN THE FLEXIBILITY OF THE JOINT. COST OF CRADLE WITHIN MANHOLE EXCAVATION OR TO CLAY PIPE JOINTS ADJACENT TO MANHOLE SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
- MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWING.
- THE VERTICAL DROP IN INSIDE DROP MANHOLES SHALL NOT EXCEED 2' FOR INFLOWING PIPES SIZED 12" OR SMALLER AND 2' FOR INFLOWING PIPES LARGER THAN 12". THE CROWNS OF INFLOWING PIPES SHALL NEVER BE SET LOWER THAN THE CROWN OF THE OUTFLOWING PIPE.
- STANDARD MANHOLES AND STANDARD INSIDE DROP MANHOLES SHALL BE BID AS STANDARD MANHOLES FOR THE TYPE AND DIAMETER INDICATED. OUTSIDE DROP MANHOLES SHALL BE BID AS STANDARD OUTSIDE DROP MANHOLES FOR THE TYPE AND DIAMETER INDICATED. ALL MANHOLE DIAMETERS WILL BE 4' UNLESS INDICATED OTHERWISE.
- A BRICK MASONRY COLLAR SHALL BE INSTALLED BETWEEN THE CAST IRON FRAME AND THE CONCENTRIC CONE. THE COLLAR WILL HAVE 8" WALLS AND A VERTICAL HEIGHT OF 6" MINIMUM AND 18" MAXIMUM. A 1" COAT OF MORTAR WILL BE PLASTERED ON THE OUTSIDE OF THE COLLAR. THE USE OF PRE-CAST CONCRETE SPACERS FOR MANHOLE TOP ADJUSTMENT IS ALSO ALLOWED.

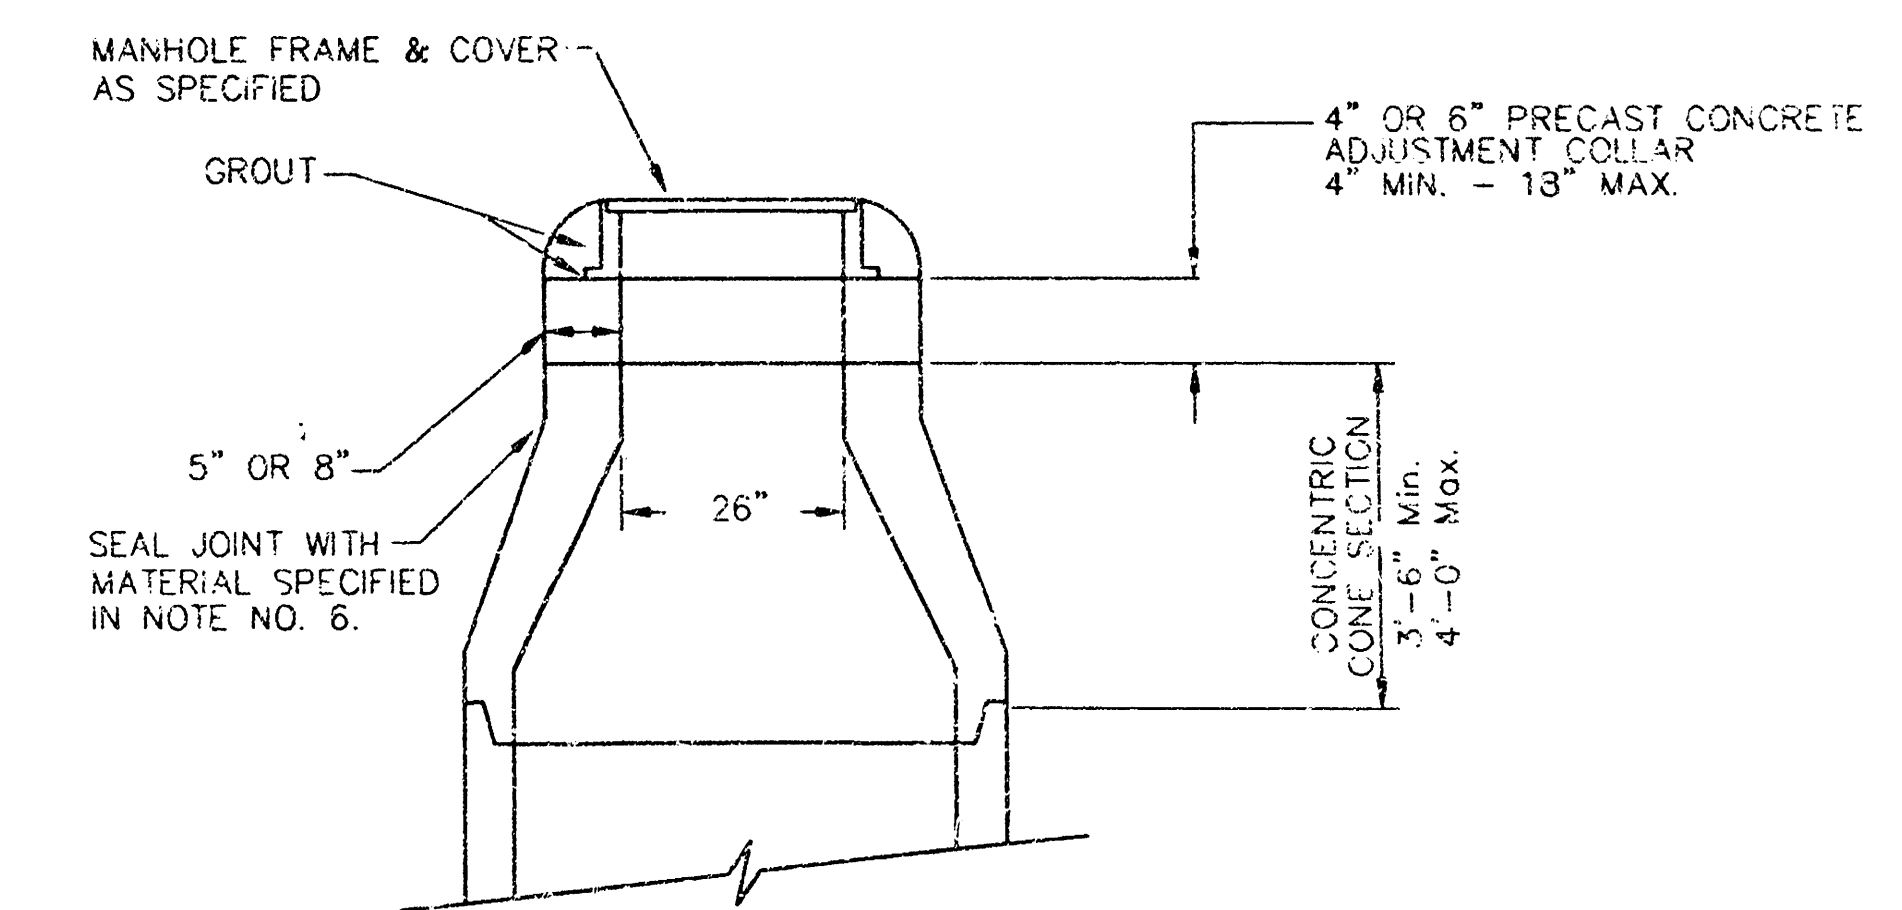
ALTERNATE CONSTRUCTION
IN UNPAVED AREAS

CITY OF WICHITA			
STD. MANHOLE DETAILS			
SEWER APPURTENANCES			
BAUGHMAN COMPANY P.A.			
ENGINEERING, SURVEYING, & PLANNING			
315-262-7271 • 315 E. 15th • WICHITA, KANSAS 67201			
PROJECT NUMBER		SHEET	
932 PPS (607881)		6	
DESIGN	DRAWN	APPROVED	DATE
STAFF	STAFF	STAFF	09/99
SCALE		NONE	
8		8	


MANHOLE COVER
Weight = 180 Lbs.

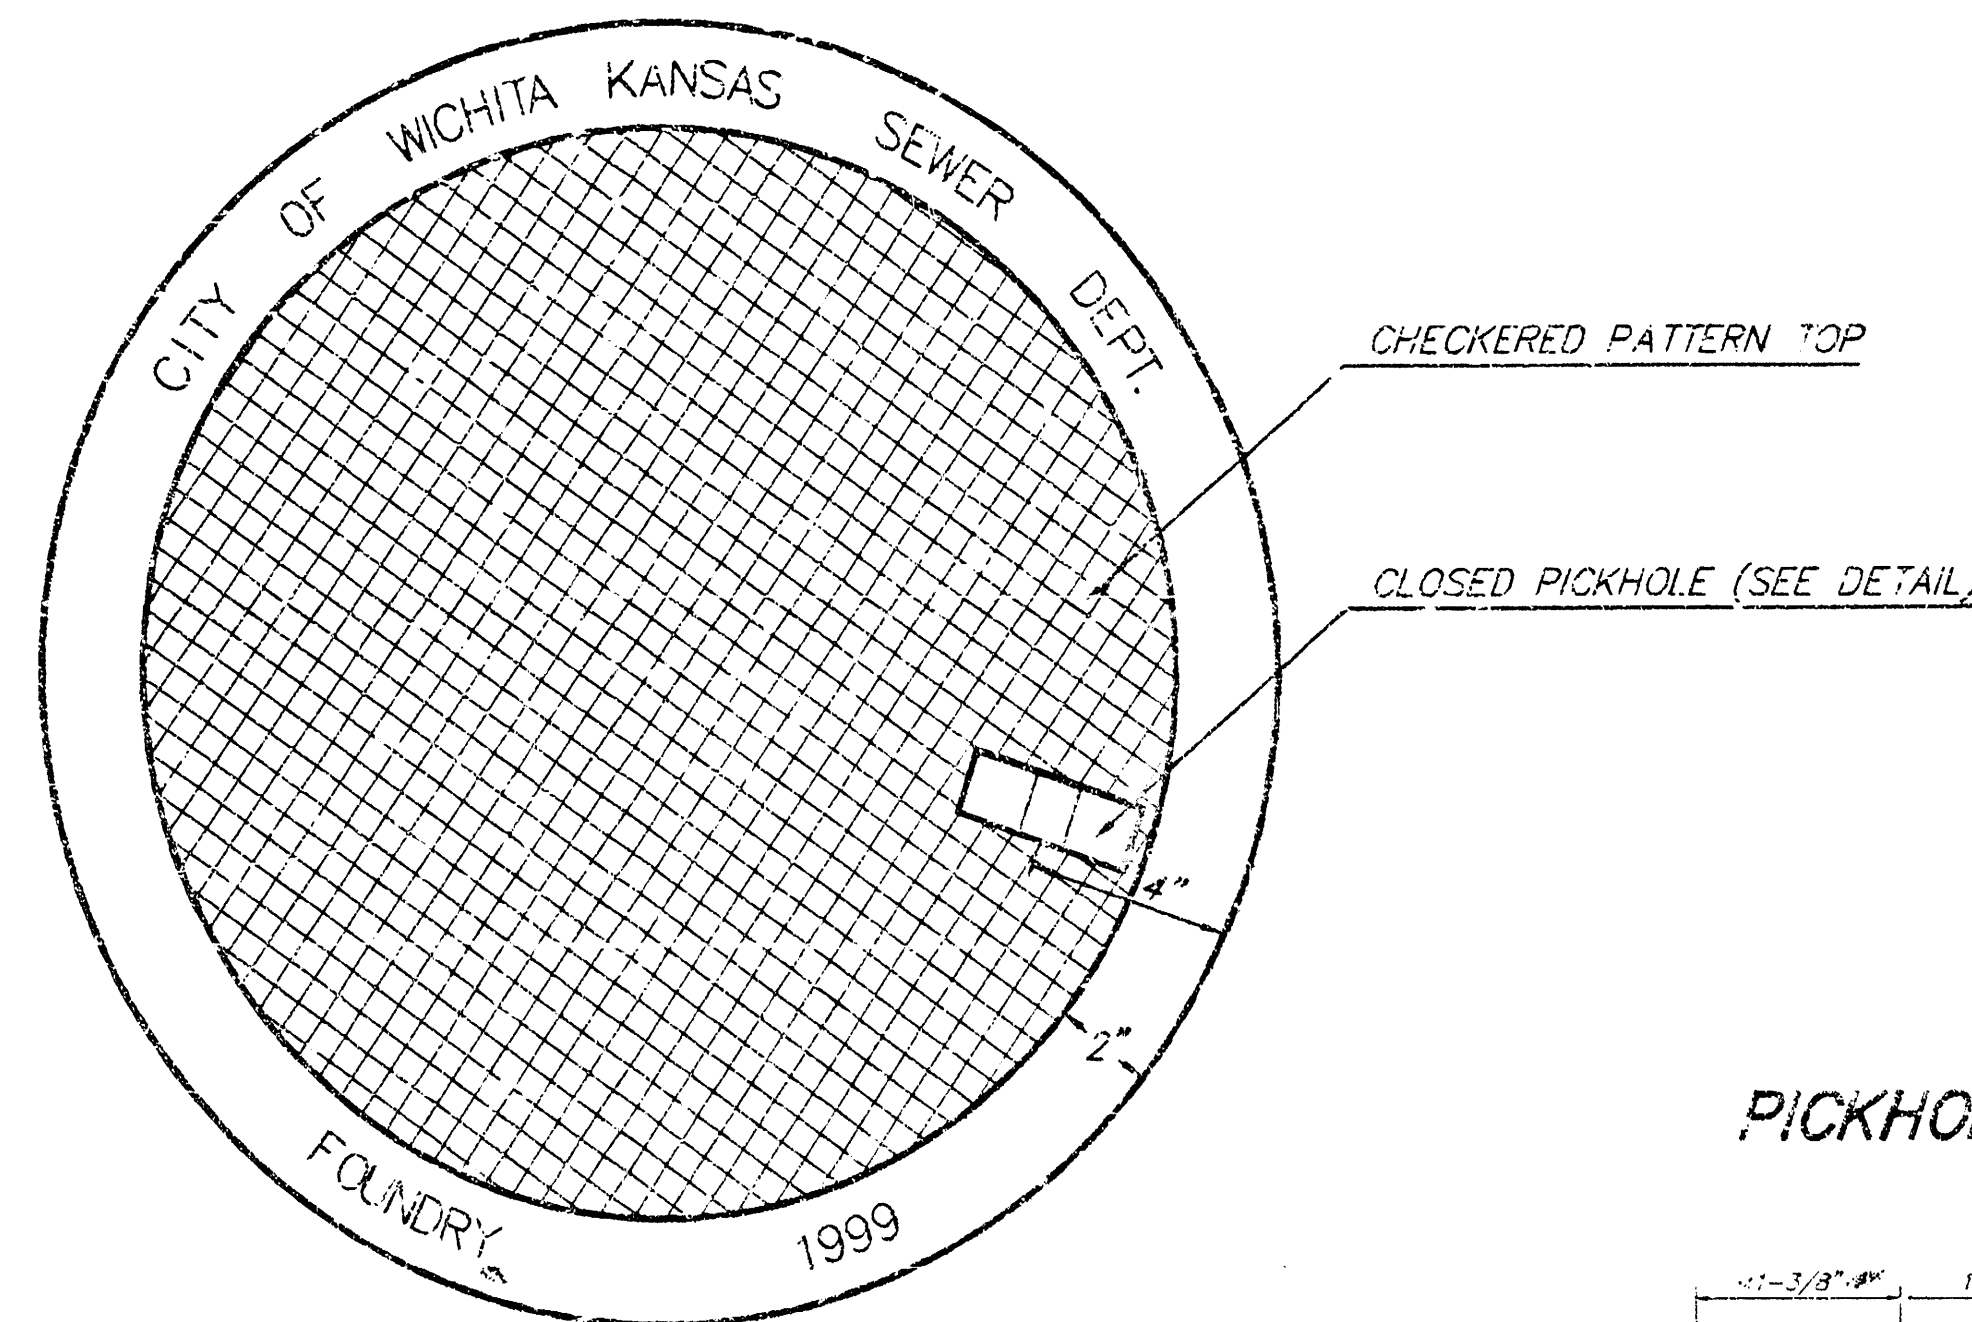

TOP VIEW

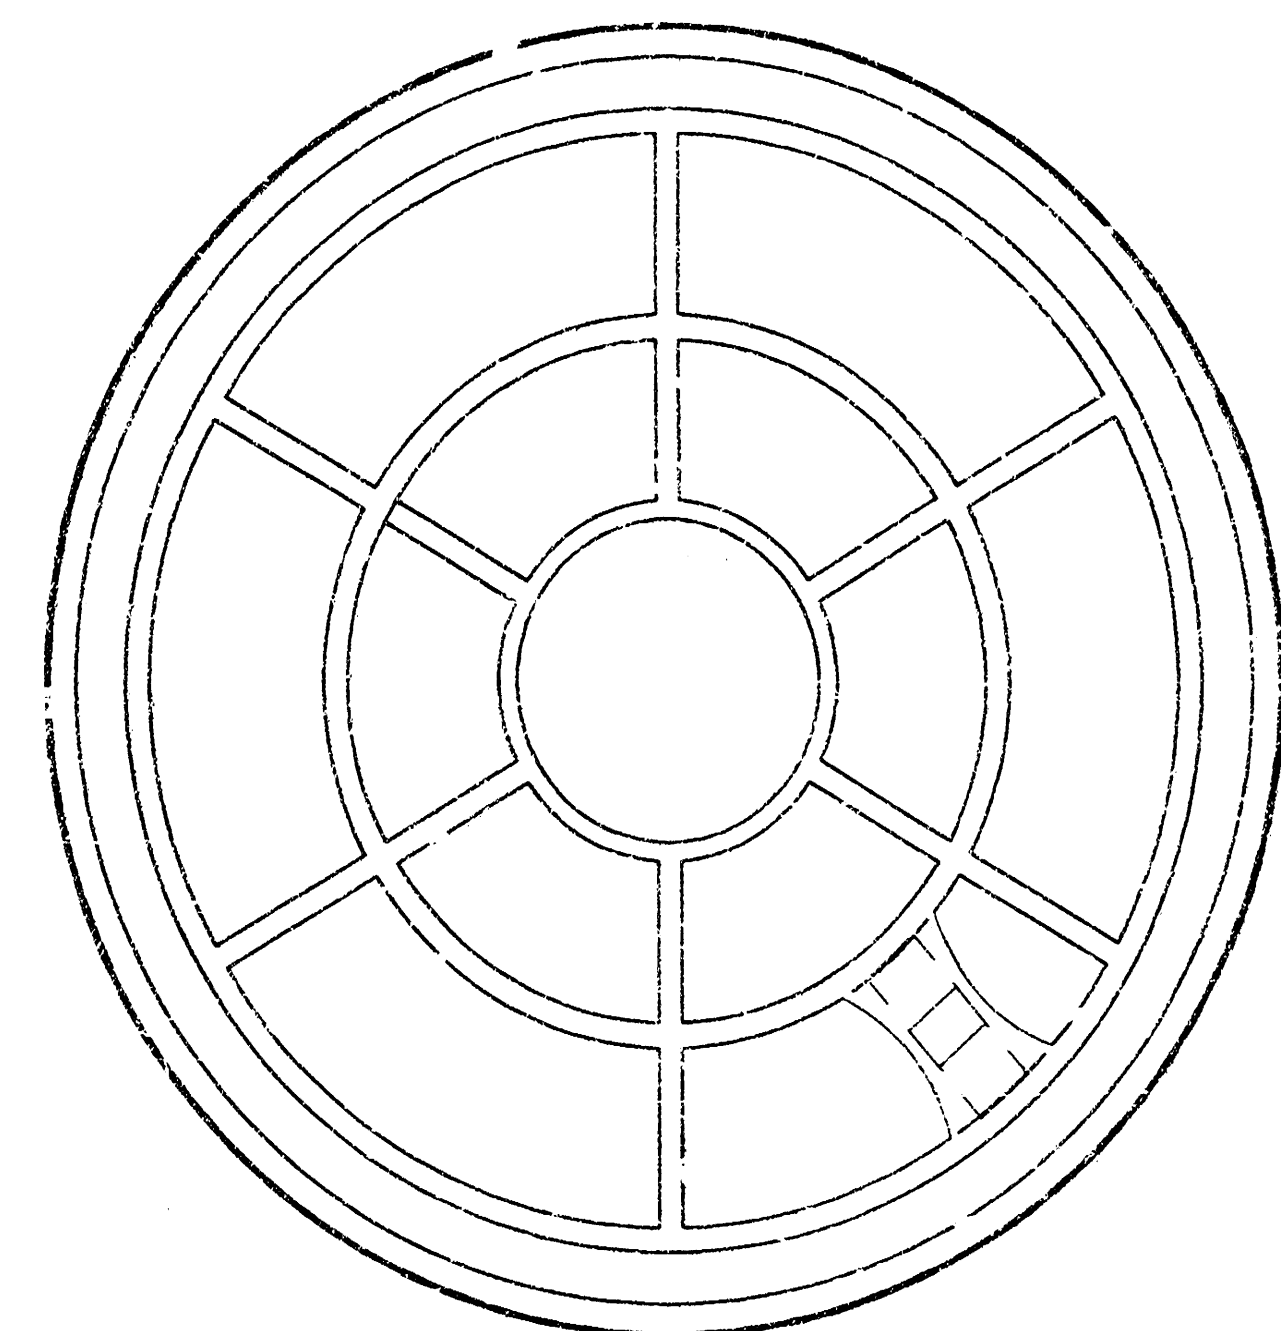


BOTTOM VIEW

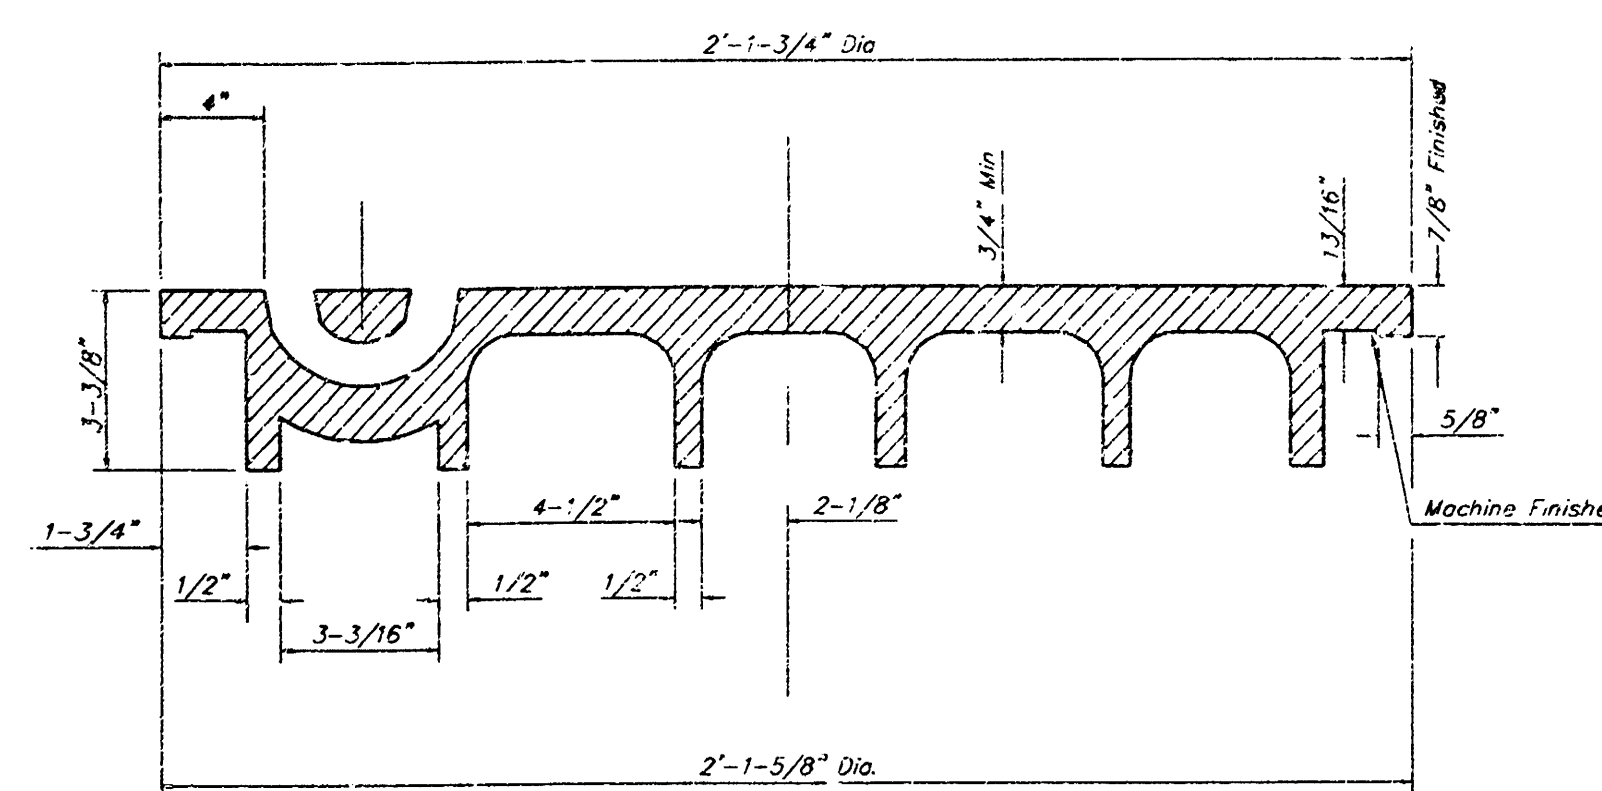


SECTION VIEW

PICKHOLE DETAIL

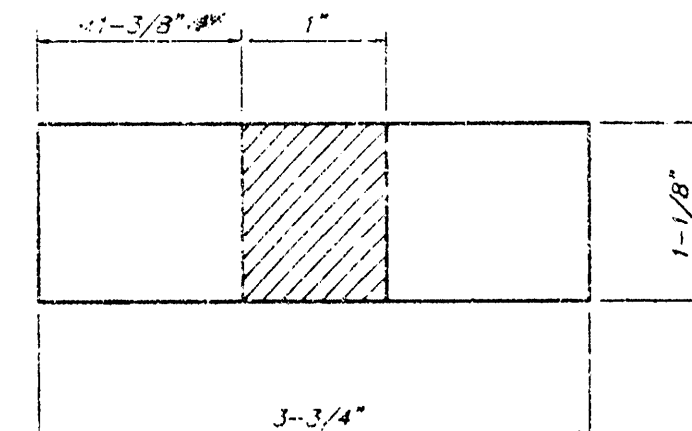

TOP VIEW

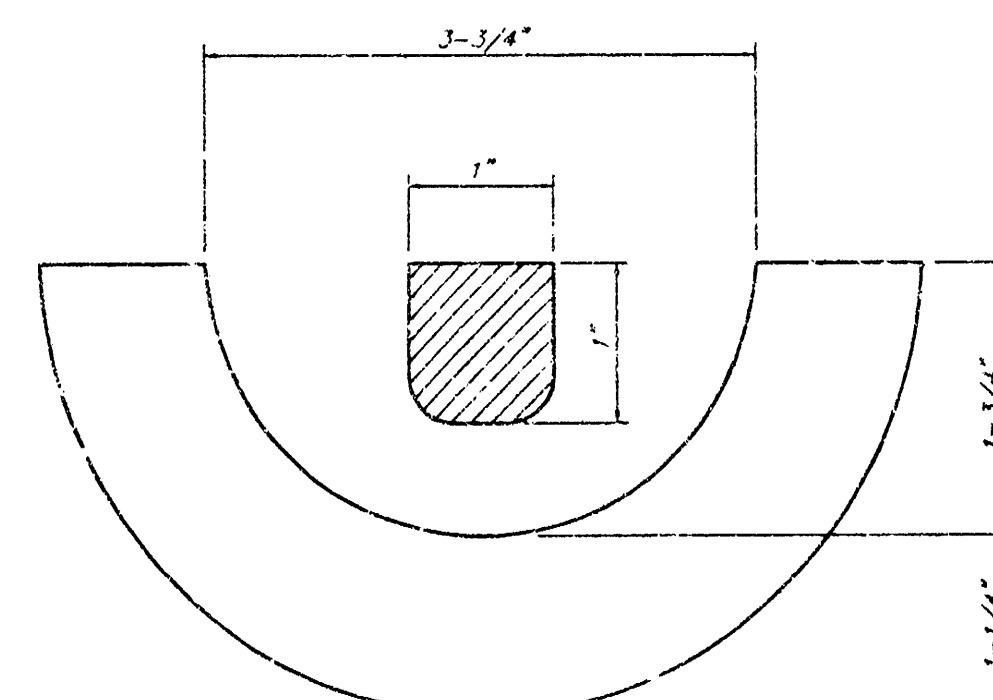


SECTION VIEW


MANHOLE FRAME AND COVER DETAIL

ADOPTED AS STANDARD DESIGN BY
CITY OF WICHITA, KANSAS

MANHOLE FRAME
Weight = 145 Lbs.

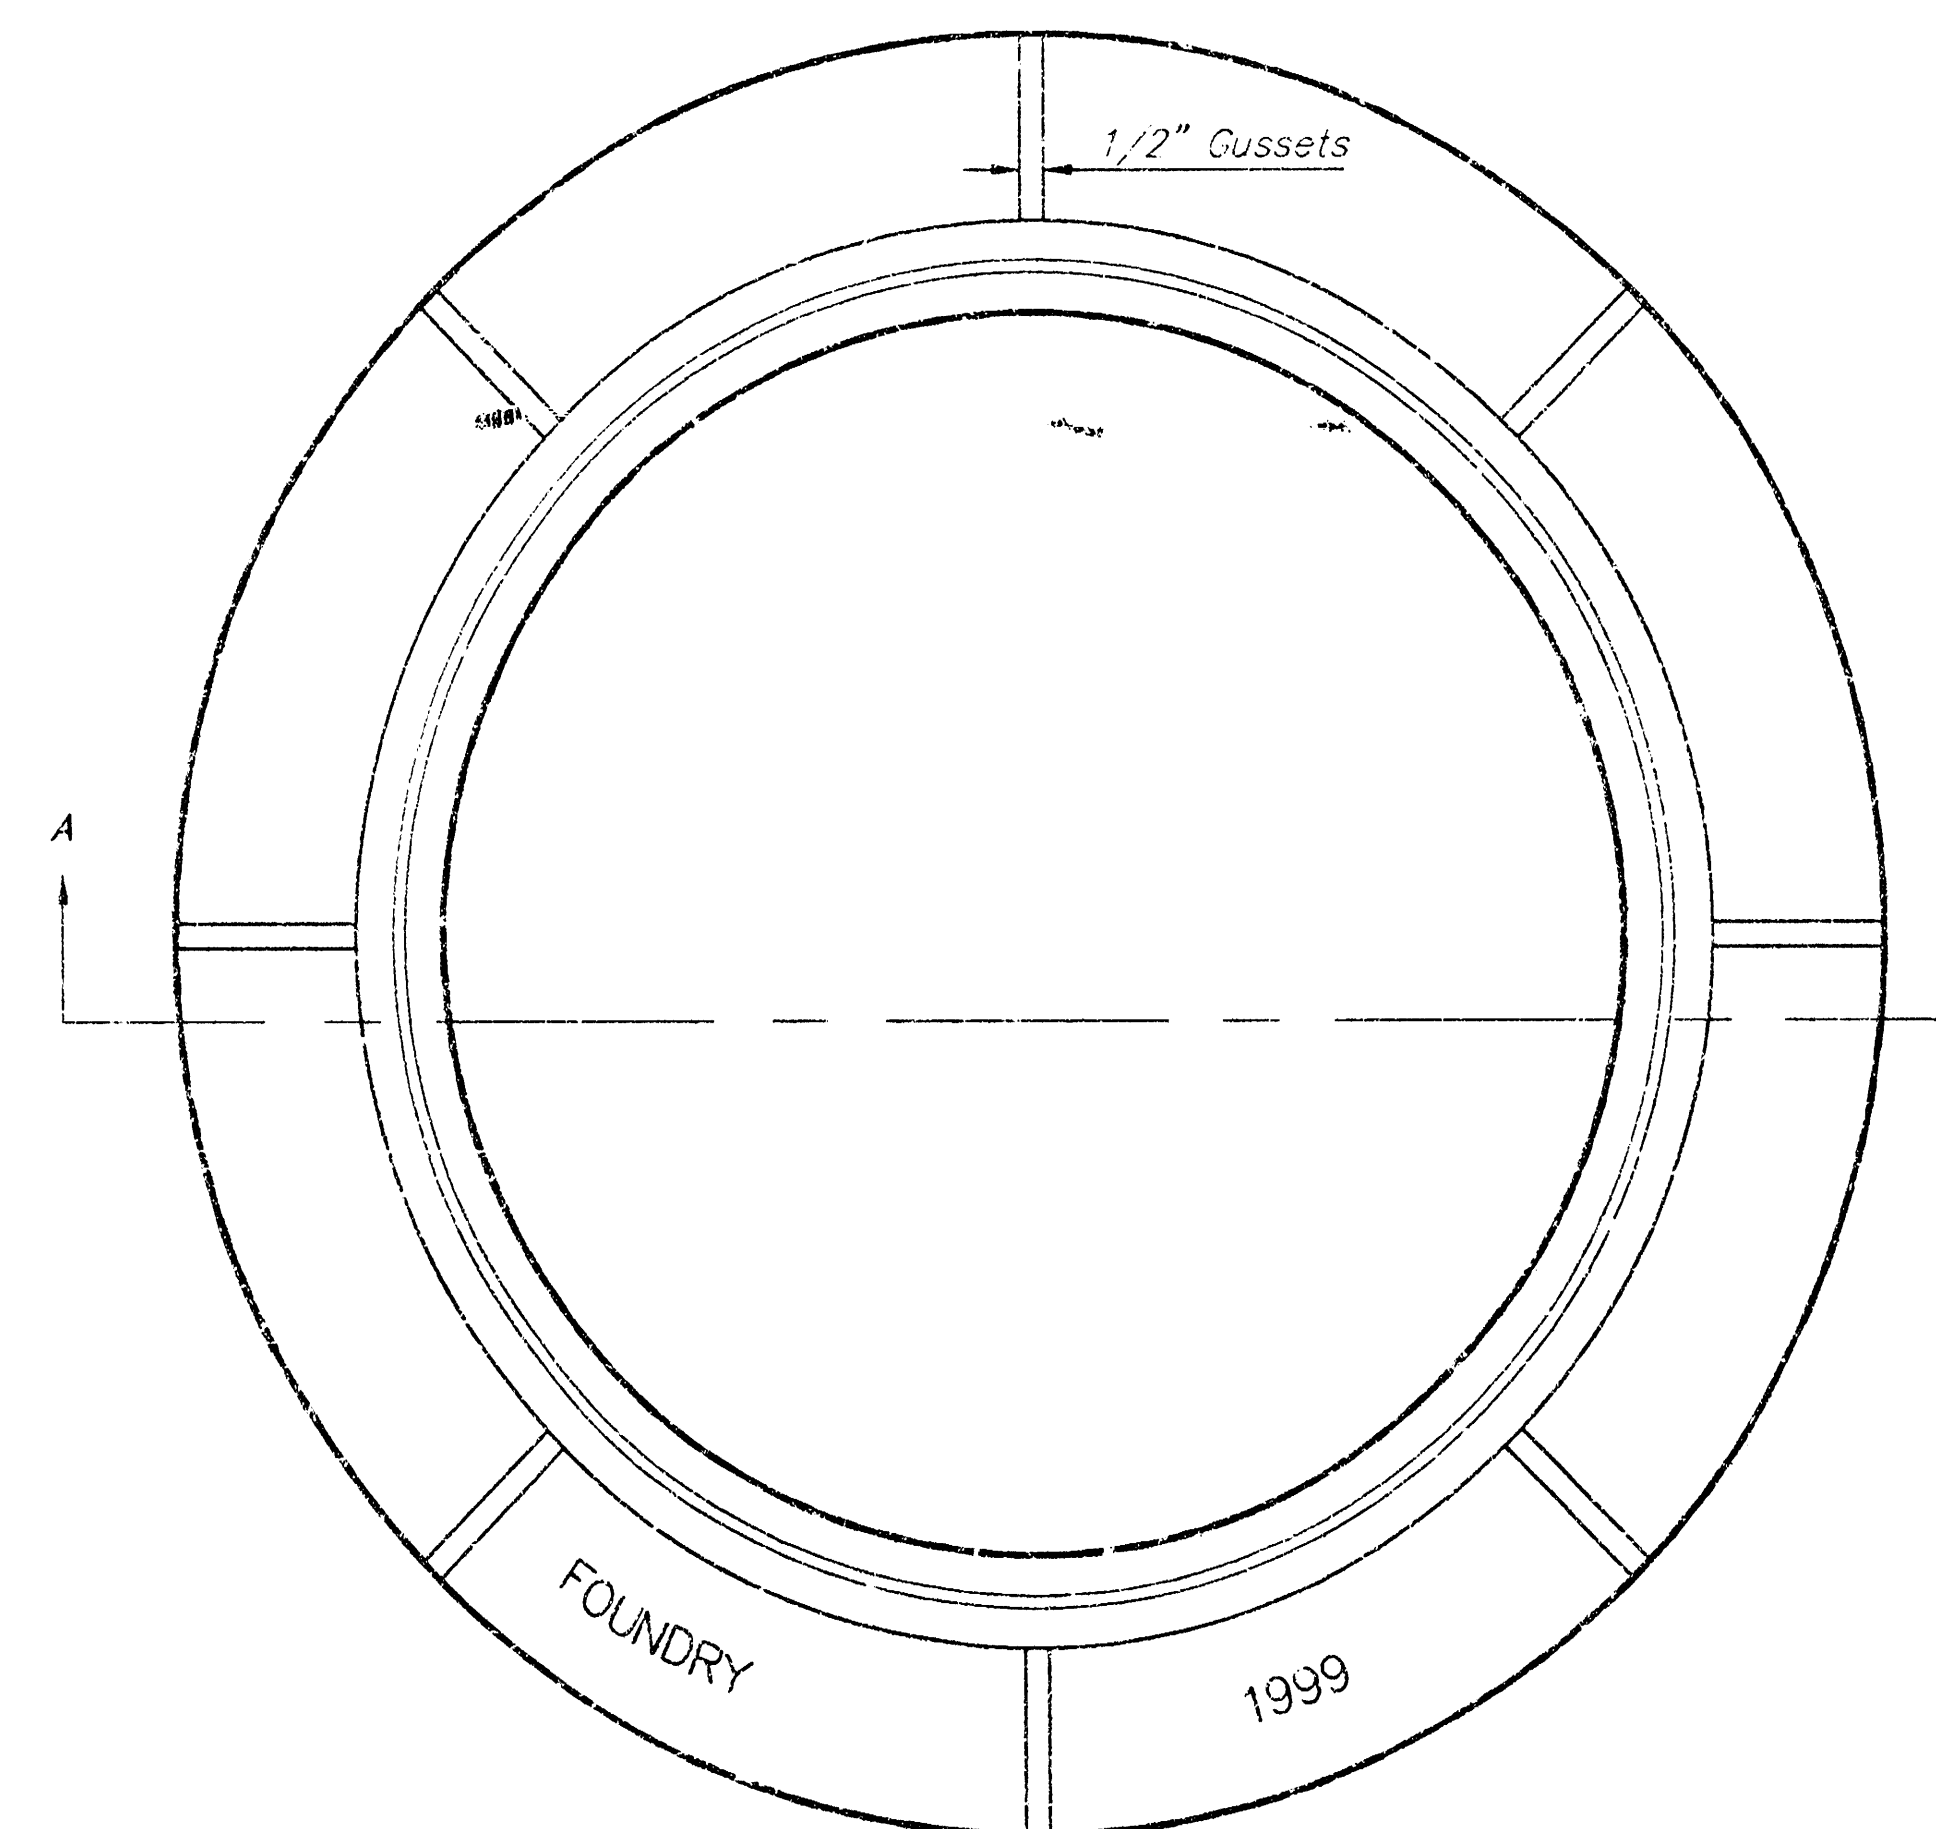

TOP VIEW

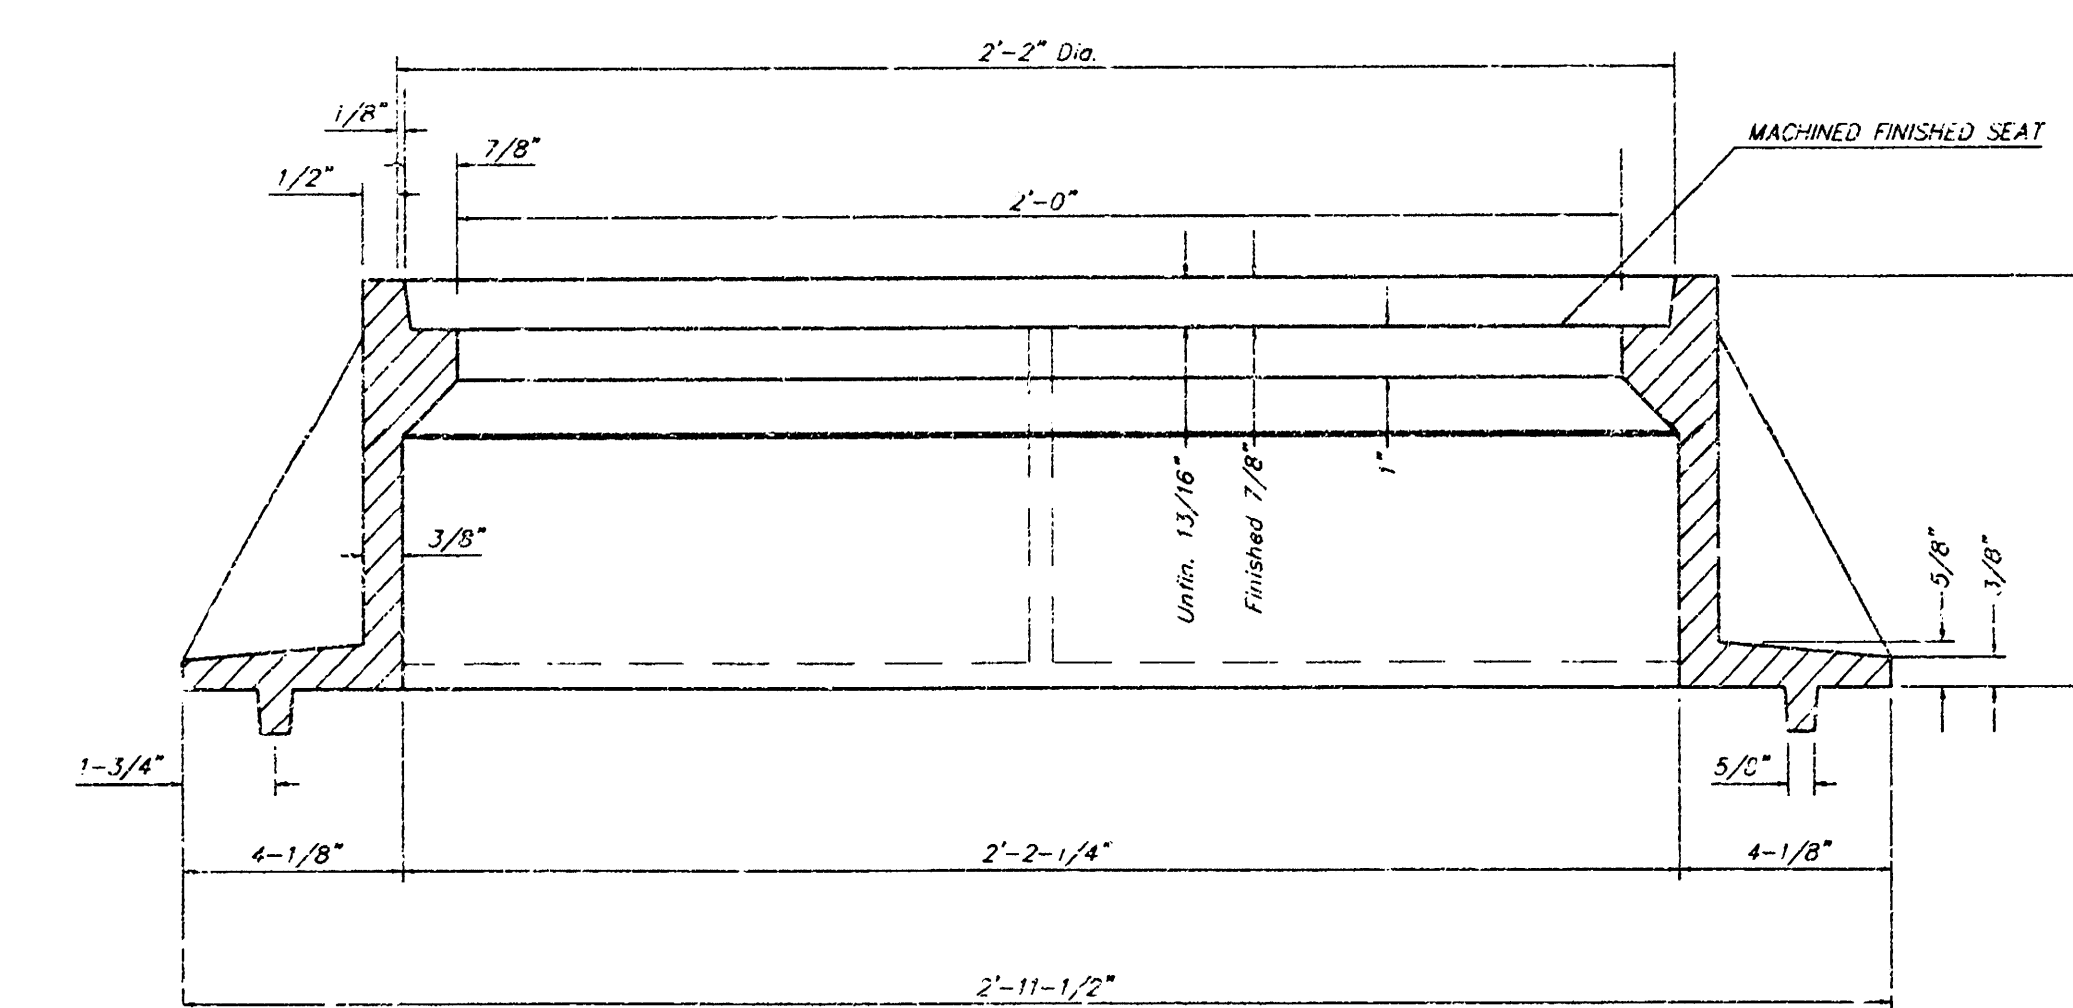

SECTION A-A

GENERAL NOTES

MANHOLE CASTINGS SHALL BE MANUFACTURED USING GOOD QUALITY GRAY IRON CONFORMING TO CLASS 30 OF A.S.T.M. DESIGNATION A-48. DIMENSIONS AND WEIGHTS SHOWN ON THE DETAILED DRAWINGS SHALL BE CONSIDERED AS MINIMUM REQUIREMENTS AND ANY DEVIATIONS FROM THE DIMENSIONS SHOWN MUST BE SPECIFICALLY APPROVED. THE FINISHED CASTINGS SHALL BE OF UNIFORM QUALITY, FREE FROM BLOWHOLES, POROSITY, HARD SPOTS, SHRINKAGE DISTORTIONS OR OTHER DEFECTS.

MANHOLE CASTINGS SHALL BE COATED WITH AN ASPHALT PAINT RESULTING IN A SMOOTH, TOUGH AND TENACIOUS COATING WHICH IS NOT BRITTLE OR TACKY.

MANHOLE CASTINGS SHALL BE MANUFACTURED SUCH THAT A COVER MANUFACTURED BY ANY ONE FOUNDRY WILL FIT INTERCHANGEABLY INTO A FRAME MANUFACTURED BY ANOTHER FOUNDRY AND STILL MEET ALLOWABLE CLEARANCES AND NON-ROCKING REQUIREMENTS. THIS WILL REQUIRE MANUFACTURING OF THE MATCHING FACES ON THE COVER AND THE FRAME TO CLOSE TOLERANCES.

THE OUTSIDE CIRCUMFERENCE OF THE VERTICAL FACE OF THE COVER AND THE INSIDE CIRCUMFERENCE OF THE VERTICAL FACE IN THE FRAME RECESS SHALL BE MANUFACTURED TO TOLERANCES SUCH THAT THE CLEARANCE BETWEEN THE COVER AND FRAME WILL NOT EXCEED 1/8" AT ANY POINT AROUND THE CIRCUMFERENCE OF THE COVER. THE SEALING SURFACES BETWEEN THE COVER AND FRAME SHALL BE MACHINED SUCH AS THESE SURFACES SHALL MAKE FULL CONTACT FOR THEIR FULL CIRCUMFERENCE TO PRECLUDE THE COVER FROM ROCKING IN THE FRAME.

THE MANHOLE FRAME AND COVER SHALL BE MARKED WITH LETTERING INDICATING THE NAME OF THE MANUFACTURER AND THE YEAR WHEN THE COVER OR FRAME WAS CAST. THE COVER SHALL BE FURTHER IDENTIFIED WITH REGARDS TO OWNERSHIP USING LETTERS AT LEAST 1 INCH IN HEIGHT. THIS IDENTIFICATION SHALL BE "CITY OF WICHITA SEWER DEPARTMENT". THE WORD DEPARTMENT MAY BE ABBREVIATED. THE TEXTURE OF THE TOP SURFACE OF THE COVER SHALL BE MANUFACTURED IN A CHECKERED PATTERN DESIGN AS INDICATED ON THE DRAWINGS. SMOOTH BLOCKOUTS SHALL BE UTILIZED TO HIGHLIGHT THE LETTERING ON THE COVER SURFACE. THE TOTAL AREA OF SMOOTH SURFACE BLOCKOUT SHALL NOT EXCEED THE AREA AS INDICATED ON THE DRAWING. POSITIONING OF SMOOTH BLOCKOUTS AND LETTERING MAY VARY FROM THAT SHOWN ON THE DETAILED DRAWING.

MANHOLE FRAME AND COVER DETAIL			
ADOPTED AS STANDARD DESIGN BY CITY OF WICHITA, KANSAS			
BAUGHMAN COMPANY P.A. ENGINEERING, SURVEYING, & PLANNING 316-262-7271 • 316 ELLIS • WICHITA, KANSAS 67211			
PROJECT NUMBER 932 PPS (807881)		SHEET 7	
DESIGN STAFF	DRAWN STAFF	APPROVED	DATE 02/99
		SCALE NONE	OF 8

WICHITA, SEDGWICK COUNTY, KANSAS



This plat approved and all dedications shown hereon accepted by the City Council of the City of Wichita, Kansas, this 25th day of Mar, 1999.



State of Kansas) SS
Sedgwick County)
filed for record in the
of June, 1911

1801375

Intrust Bank, N.A.

State of Kansas)
Sedgwick County)
for me, this 2nd day of
SENIOR VICE-PRESIDENT
(Title)

My App'l. Exp. 10/25/22

State of Kansas) S
Sedgwick County)
this 31ST day of 1
R & R Realty, LLC,
JUDITH M. TER
Notary Public - State of
My Appt. Expires 11-7-200

JUDITH M. TER
Notary Public - State of
My App't. Expires 11-7-2006

My App't. Exp. 11-7-2006

State of Kansas)

State of Kansas)
Sedgwick County)
this 31st day of Feb
Via Christi Property
My App'l Exp. 5-1-


My App'l. Exp. 5-1-





DIANA L. BOWER
NOTARY PUBLIC
STATE OF KANSAS

DIANA L. BOWEN
NOTARY PUBLIC
STATE OF KANSAS
My Appl. Exp. 5-1-

BAUGHMAN COMPANY P.
ENGINEERING, SURVEYING, & PLANNING
316-262-7271 • 315 ELLS • MCNATA, KANSAS 67221

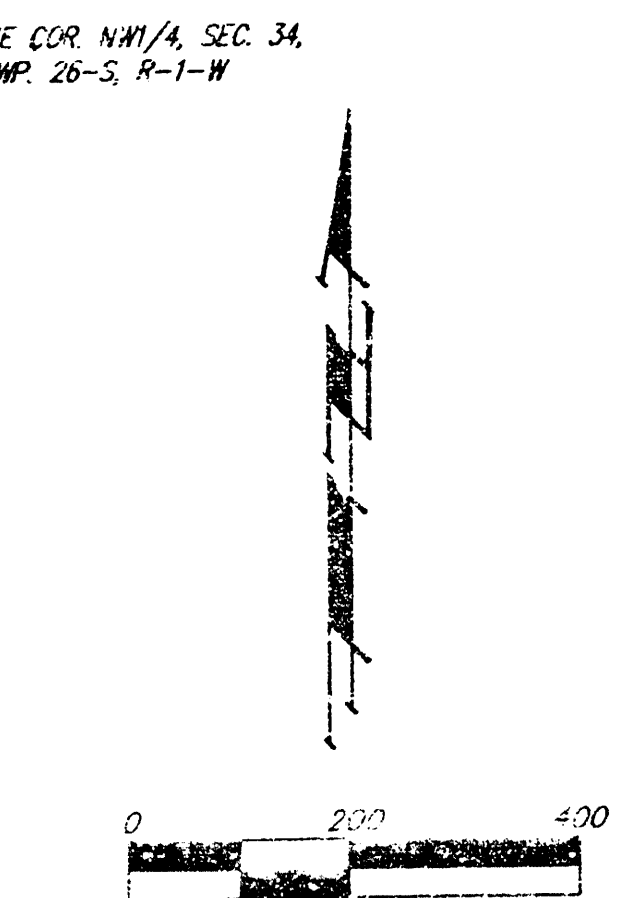

NOTE:
ADDITIONAL BUILDING SETBACK REQUIREMENTS

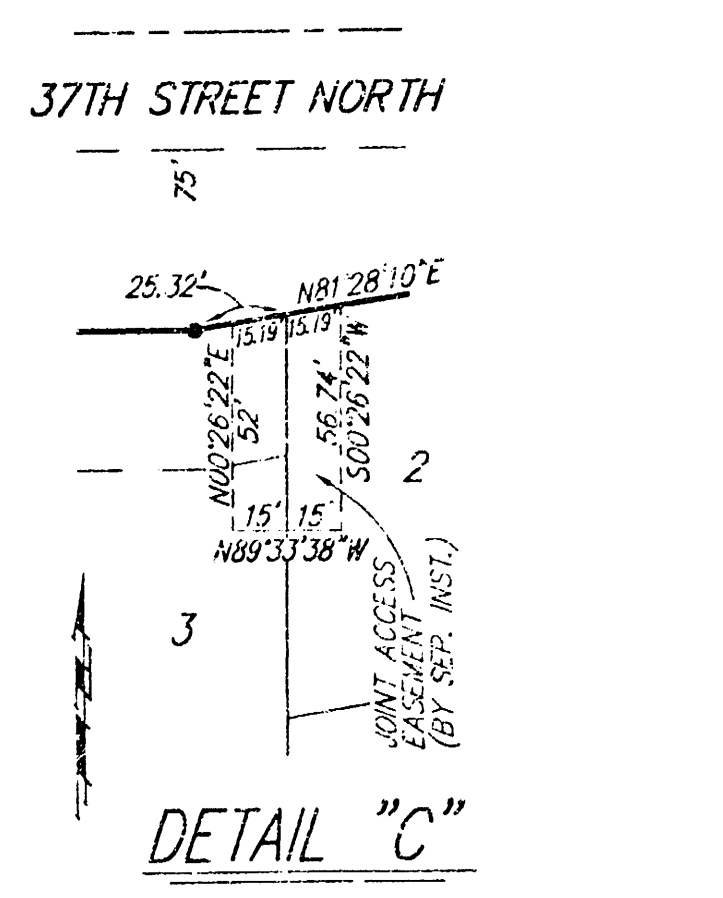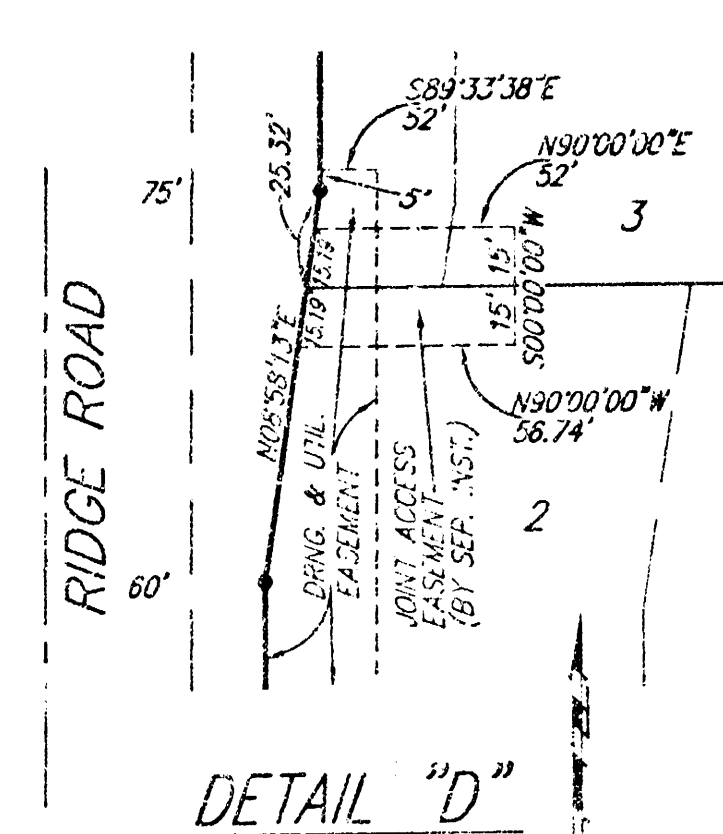

BENCHMARK:
CITY WISC - SW COR. RIDGE RD. & 29TH ST. NO.,
80.8' S. & 63.7' W. OF E. BOTH.
ELEV. = 139.15 CITY DATUM (1326.55 M.S.L.)

NOTE:
NO BUILDING PERMITS ARE TO BE ISSUED FOR ANY LOTS WITHIN "RIDGE
PORT NORTH ADDITION" UNLESS THE LOWEST FLOOR CAN BE CONSTRUCTED
AT OR ABOVE THE BASE FLOOD ELEVATION OR UNLESS THE CITY OF MOBILE
HAS RECEIVED A LETTER OF MAP REVISION FROM THE FEDERAL EMERGENCY
MANAGEMENT AGENCY WHICH WILL ALLOW BUILDINGS TO BE CONSTRUCTED
AT THE LOWEST OPENING AS SPECIFIED ABOVE.

Existing public easements and dedications being vacated
by virtue of K.S.A. 12-512(b). *Equation Company, P.A.*

Know all men by these presents that we, the undersigned, have caused the land in the surveyors certificate to be platted into Lots, Streets, and Reserves to be known as "RIDGE PORT NORTH ADDITION", Wichita, Sedgewick County, Kansas. The utility easements are hereby granted as indicated for the construction and maintenance of all public utilities. The drainage and utility easements are hereby granted as indicated for drainage purposes and for the construction and maintenance of all public utilities. The wall easement is hereby granted as indicated for the construction and maintenance of a private screening wall and utility main lines and service lines shall be allowed to cross this easement. The streets are hereby dedicated to and for the use of the public. Reserves "A" and "C" are hereby reserved for landscaping, entry monuments, utilities, screening walls, and open space. Reserve "B" is hereby reserved for landscaping, open space, utilities, entry monuments, and streets. Reserve "D" is hereby reserved for drainage purposes, ponds, landscaping, open space, berms, gazebos, screening walls, and sidewalks. Reserve "E" is hereby reserved for floodway, drainage purposes, and open space, and no buildings shall be constructed or placed on or within said Reserve "E", nor shall any fill, change of grade, creation of channel, or any other work be carried on without the permission of the appropriate governing body. Reserves "A", "B", "C", "D", and "E" shall be owned and maintained by the lot owners association for the addition. All abutters rights of access to or from Ridge Road and to or from 47th Street North shall be as indicated on the face of the plat. The Minimum Building Pad Elevations for the lowest opening to the structures shall be as indicated on the face of the plat.

Bruce A. Orr
 R & B Realty, LLC
 Jay W. Russell, Manager
 Manager

Kevin M. Mullan, *Manager*
Via Christi Property Services, Inc.
David M. Mohr, *President*

State of Kansas) SS
Sedgwick County)
this 31st day of Ma
Ken-Win Farms Inc., or

My App't. Exp. 5-1-20

State of Kansas) SS
Sedgewick County)

State of Kansas) SS
Sedgwick County)
this 31st day of MA
R & R Realty, LLC, on

A JUDITH M. TERHUN
 Notary Public - State of Kansas
 My Comm. Exp. 11-1-2001