



PROJECT NO. 472 76 245 81413 000 000 001

FROM THE NORTH LINE OF SECOND STREET

TO THE SOUTH LINE OF THIRD STREET



North line of Second
Begin Dellrose Construction

PLANS PREPARED BY
R.S. DELAMATER & ASSOCIATES, INC.
CONSULTING ENGINEERS
WICHITA, KANSAS

1. Interurban traffic generated outside the project area is not to be carried through construction. Local residential traffic generated within the project area shall be carried through construction.*

2. Utility service lines, valve boxes, meters, et cetera, are to be adjusted as necessary by others prior to or during construction unless the plans specifically call for their adjustment by the Contractor. Existing utilities and their location as shown on the plans, represent the best information obtainable for design. The plan locations shown are not guaranteed. Additional existing utilities may also be encountered. The Contractor shall work around existing utilities within the right-of-way which do not conflict with proposed construction.

3. Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in conflict with proposed new construction shall be saved and protected from damage.

4. Rubble from the removal of miscellaneous structures and excess excavation which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations that, in the opinion of the Engineer, will leave an unsightly appearance will not be approved.

5. A saw cut of at least one-half the depth of existing surface courses or one-fourth the depth of the existing total pavement thickness shall be provided at locations where proposed construction abuts an existing surface course or pavement for which partial removal of that surface or pavement is required. Such saw cuts will not be paid for directly and this cost shall be considered as subsidiary to the removal of the surface or pavement.

6. The Contractor shall give all property owners and/or tenants of developed property directly affected by the construction of this project a minimim of 24 hours advance notice prior to start of construction.

7. Removal of existing concrete driveway pavements and/or concrete sidewalk pavements will be paid for as square feet of walk and drive removal.

8. Existing asphalt material to be wasted which is suitable for salvage shall become the property of the Contractor.

90. A tack coat of emulsified asphalt (SS-1H or SSS-1H) shall be applied at a rate of approximately 0.05 gallons per square yard between lifts of asphalt when ordered by the Engineer. Tack coat shall not be paid for directly but shall be considered incidental to the project.


10. Driveways shall be constructed with a minimum width of ten (10) feet. ~~Every existing driveway with a width in excess of ten feet shall be constructed with the new width as new rules. No driveway shall be constructed properly across a roadway between the width of driveway and driveway from the above width. Every driveway shall be constructed properly across a roadway between the width of driveway and driveway from the above width. Every driveway shall be constructed properly across a roadway between the width of driveway and driveway from the above width.~~

11. The Contractor shall be responsible for preserving property irons. The Contractor shall be required to re-establish any property irons which are damaged or destroyed by his construction operations. Such irons shall be re-established by a licensed land surveyor or a licensed professional engineer in accordance with state laws.

12. The Contractor shall limit his removal operations to one side of the street, only, at any one time, thus allowing residents to park on the street when their driveways are not accessible, during hours that construction operations are not in progress.


13. Cure all exposed concrete surfaces, including curbs and gutters, valley gutters, driveways and sidewalks, with Emulsified Linseed Oil in accordance with the Supplemental Specifications.

* Construction shall be confined to one-half of the street at a time, except for the overlay operation.




SURVEY	PLOTTED	DESIGN	DRAWN	CHECKED	APPROVED	REVISION
DATE 11-12-84	11-84	11/12-1984	Dec. 1984	Dec. 1984	<i>[Signature]</i>	A
BY MTD	CS, MTD	MTD	JB	CS, JB	<i>[Signature]</i>	12-28-84 JES
					<i>[Signature]</i>	MTD
					<i>[Signature]</i>	12-28-84

Reference B.M. 173.63 NW corner 1st step of house @ 254 N. Oliver B.M. #1
 B.M. 179.15 "M" in the word "Mueller" on top of fire hydrant S.W. corner of 2nd & Dellrose B.M. #2
 B.M. 178.73 Spike Step in East side of 24" Elm in front of house at 333 Dellrose (Sta. 3+58.14) B.M. #3
 B.M. 181.99 "T" in the word "TROY" on top of fire hydrant at S.W. corner of intersection of 3rd & Dellrose. B.M. #4

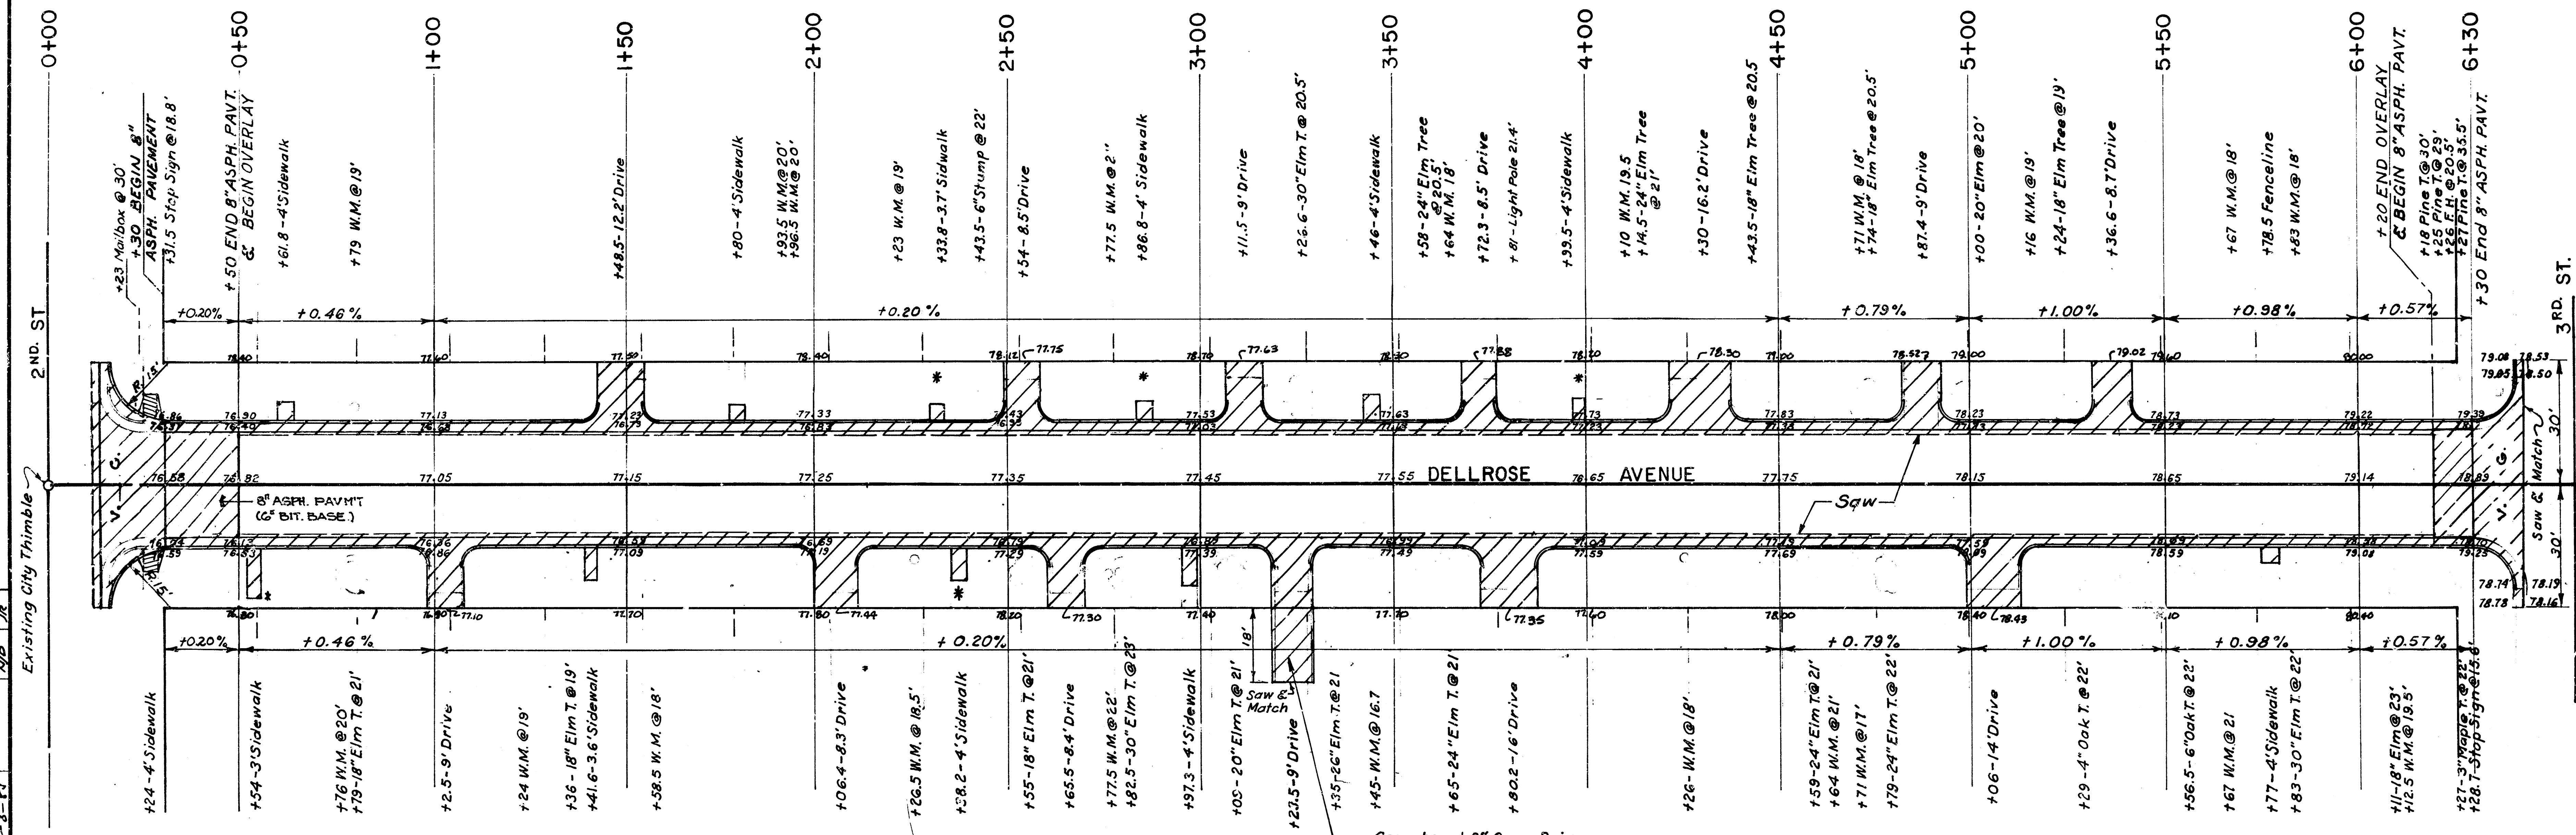


Note:
 Sidewalks denoted with "*" have random cut pattern and shall be replaced in kind. Payment will be as for 4" sidewalk concrete pavement.

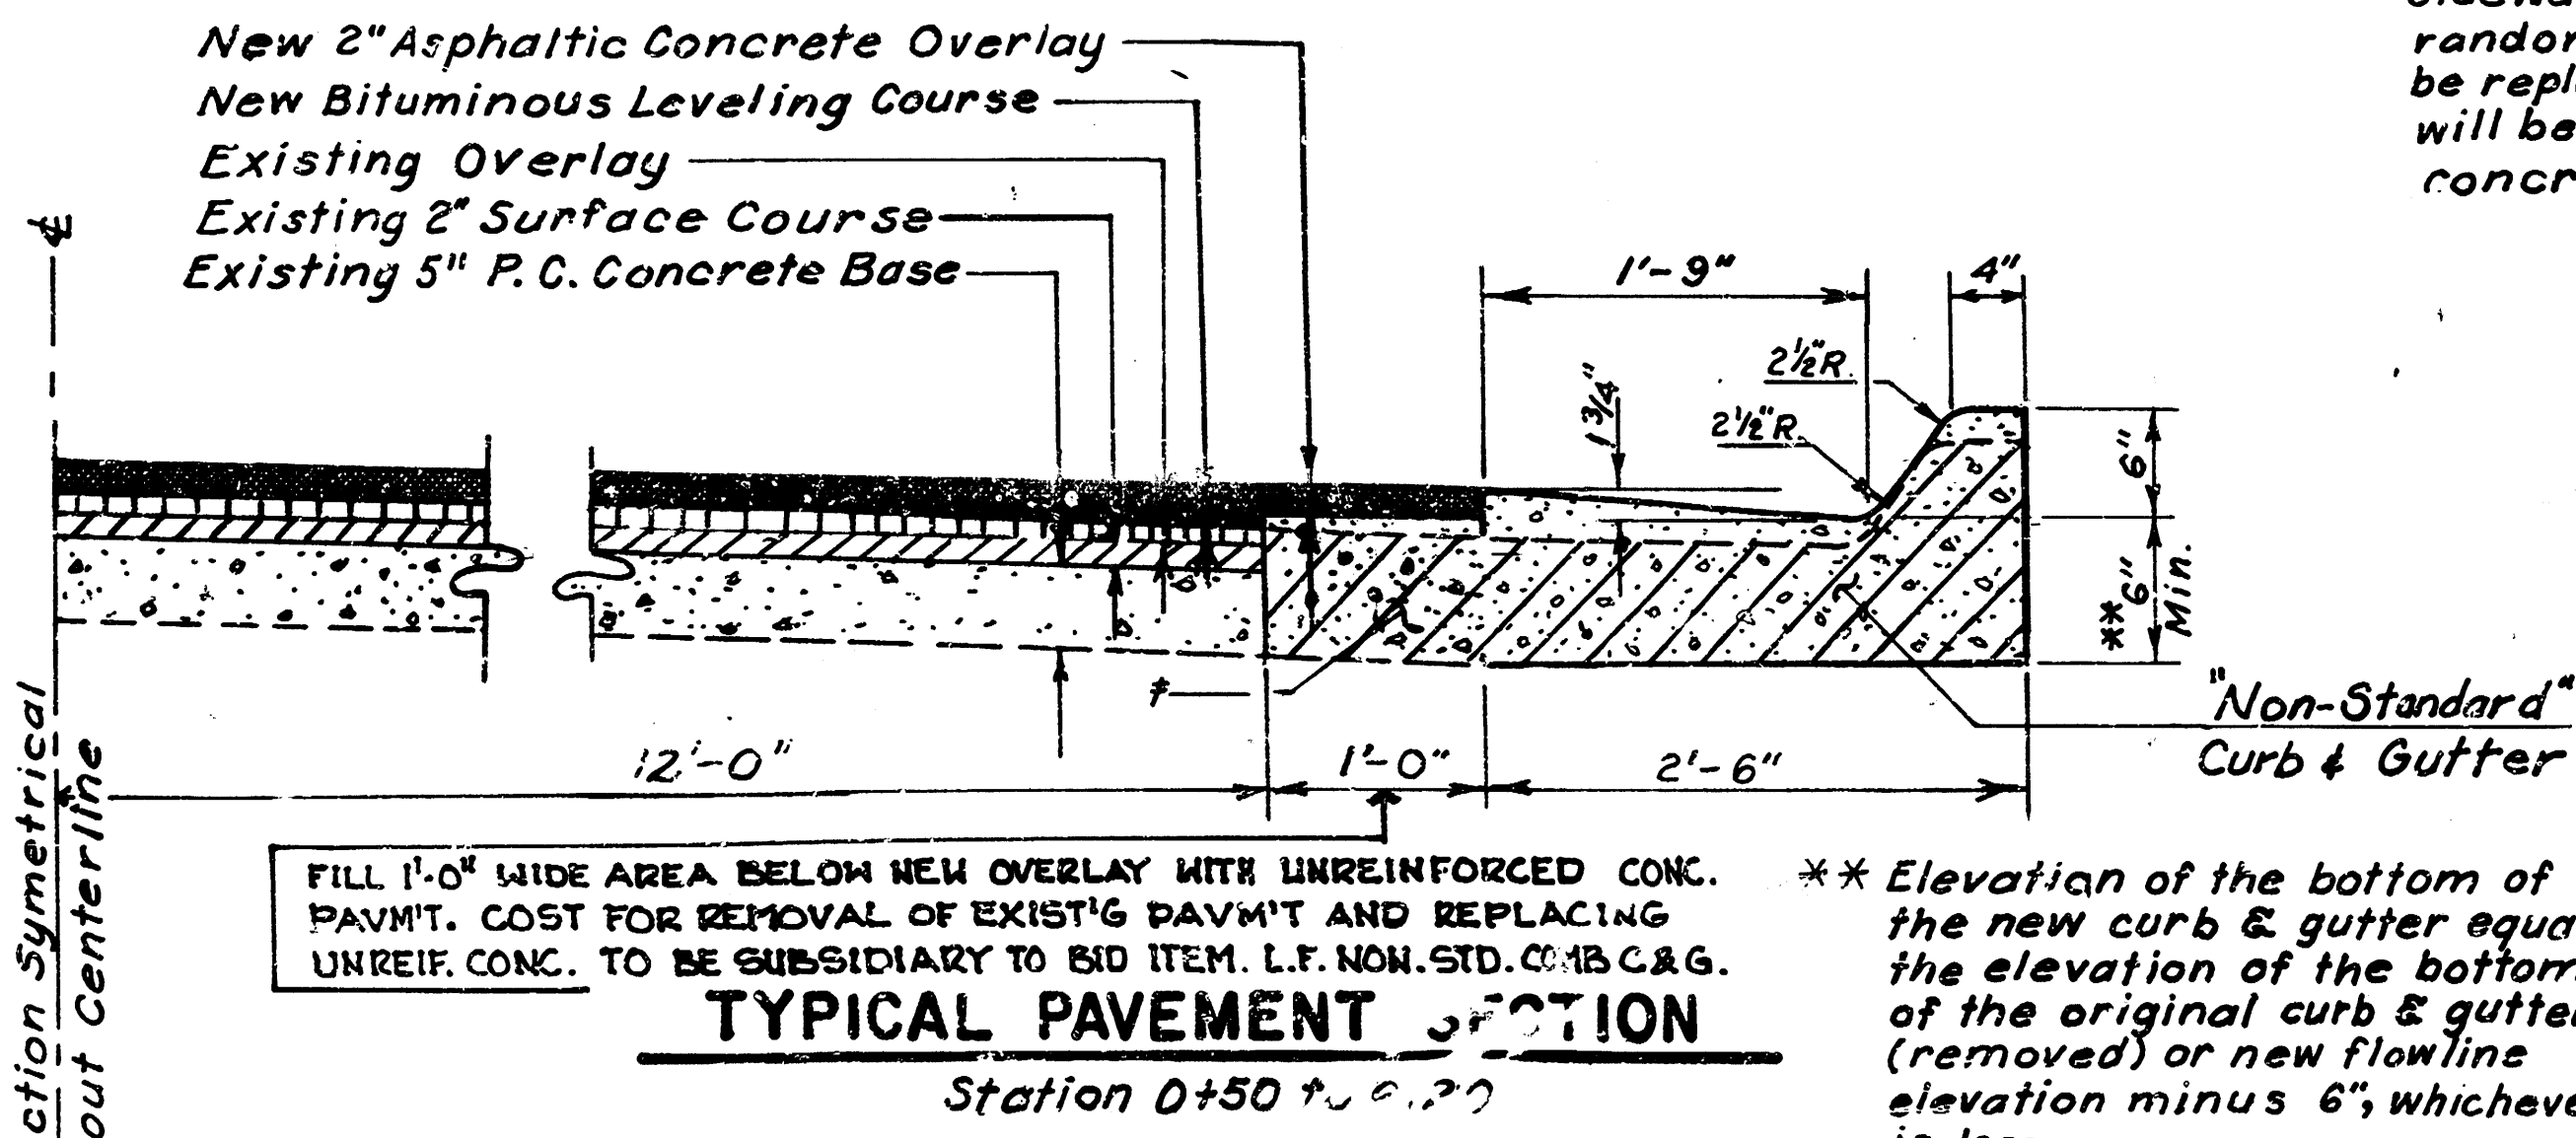

FROM	TO	Left	Right
0+50	1+00	1/4" / ft	1/2" / ft
1+00	1+50	1/4" / ft	Transition
1+50	6+30	1/4" / ft	3/8" / ft

EARTHWORK
 EXCAVATION, BORROW, AND COMPACTED FILL SHALL BE INCIDENTAL TO OTHER BID ITEMS.
ASPHALT - FOR INFORMATION ONLY
 BID ITEM. SQ YDS 2" MINIMUM ASPHALT OVERLAY WITH LEVELING COURSES. LEVELING COURSES CONSISTS OF APPROXIMATELY 175 TONS ASPHALT.



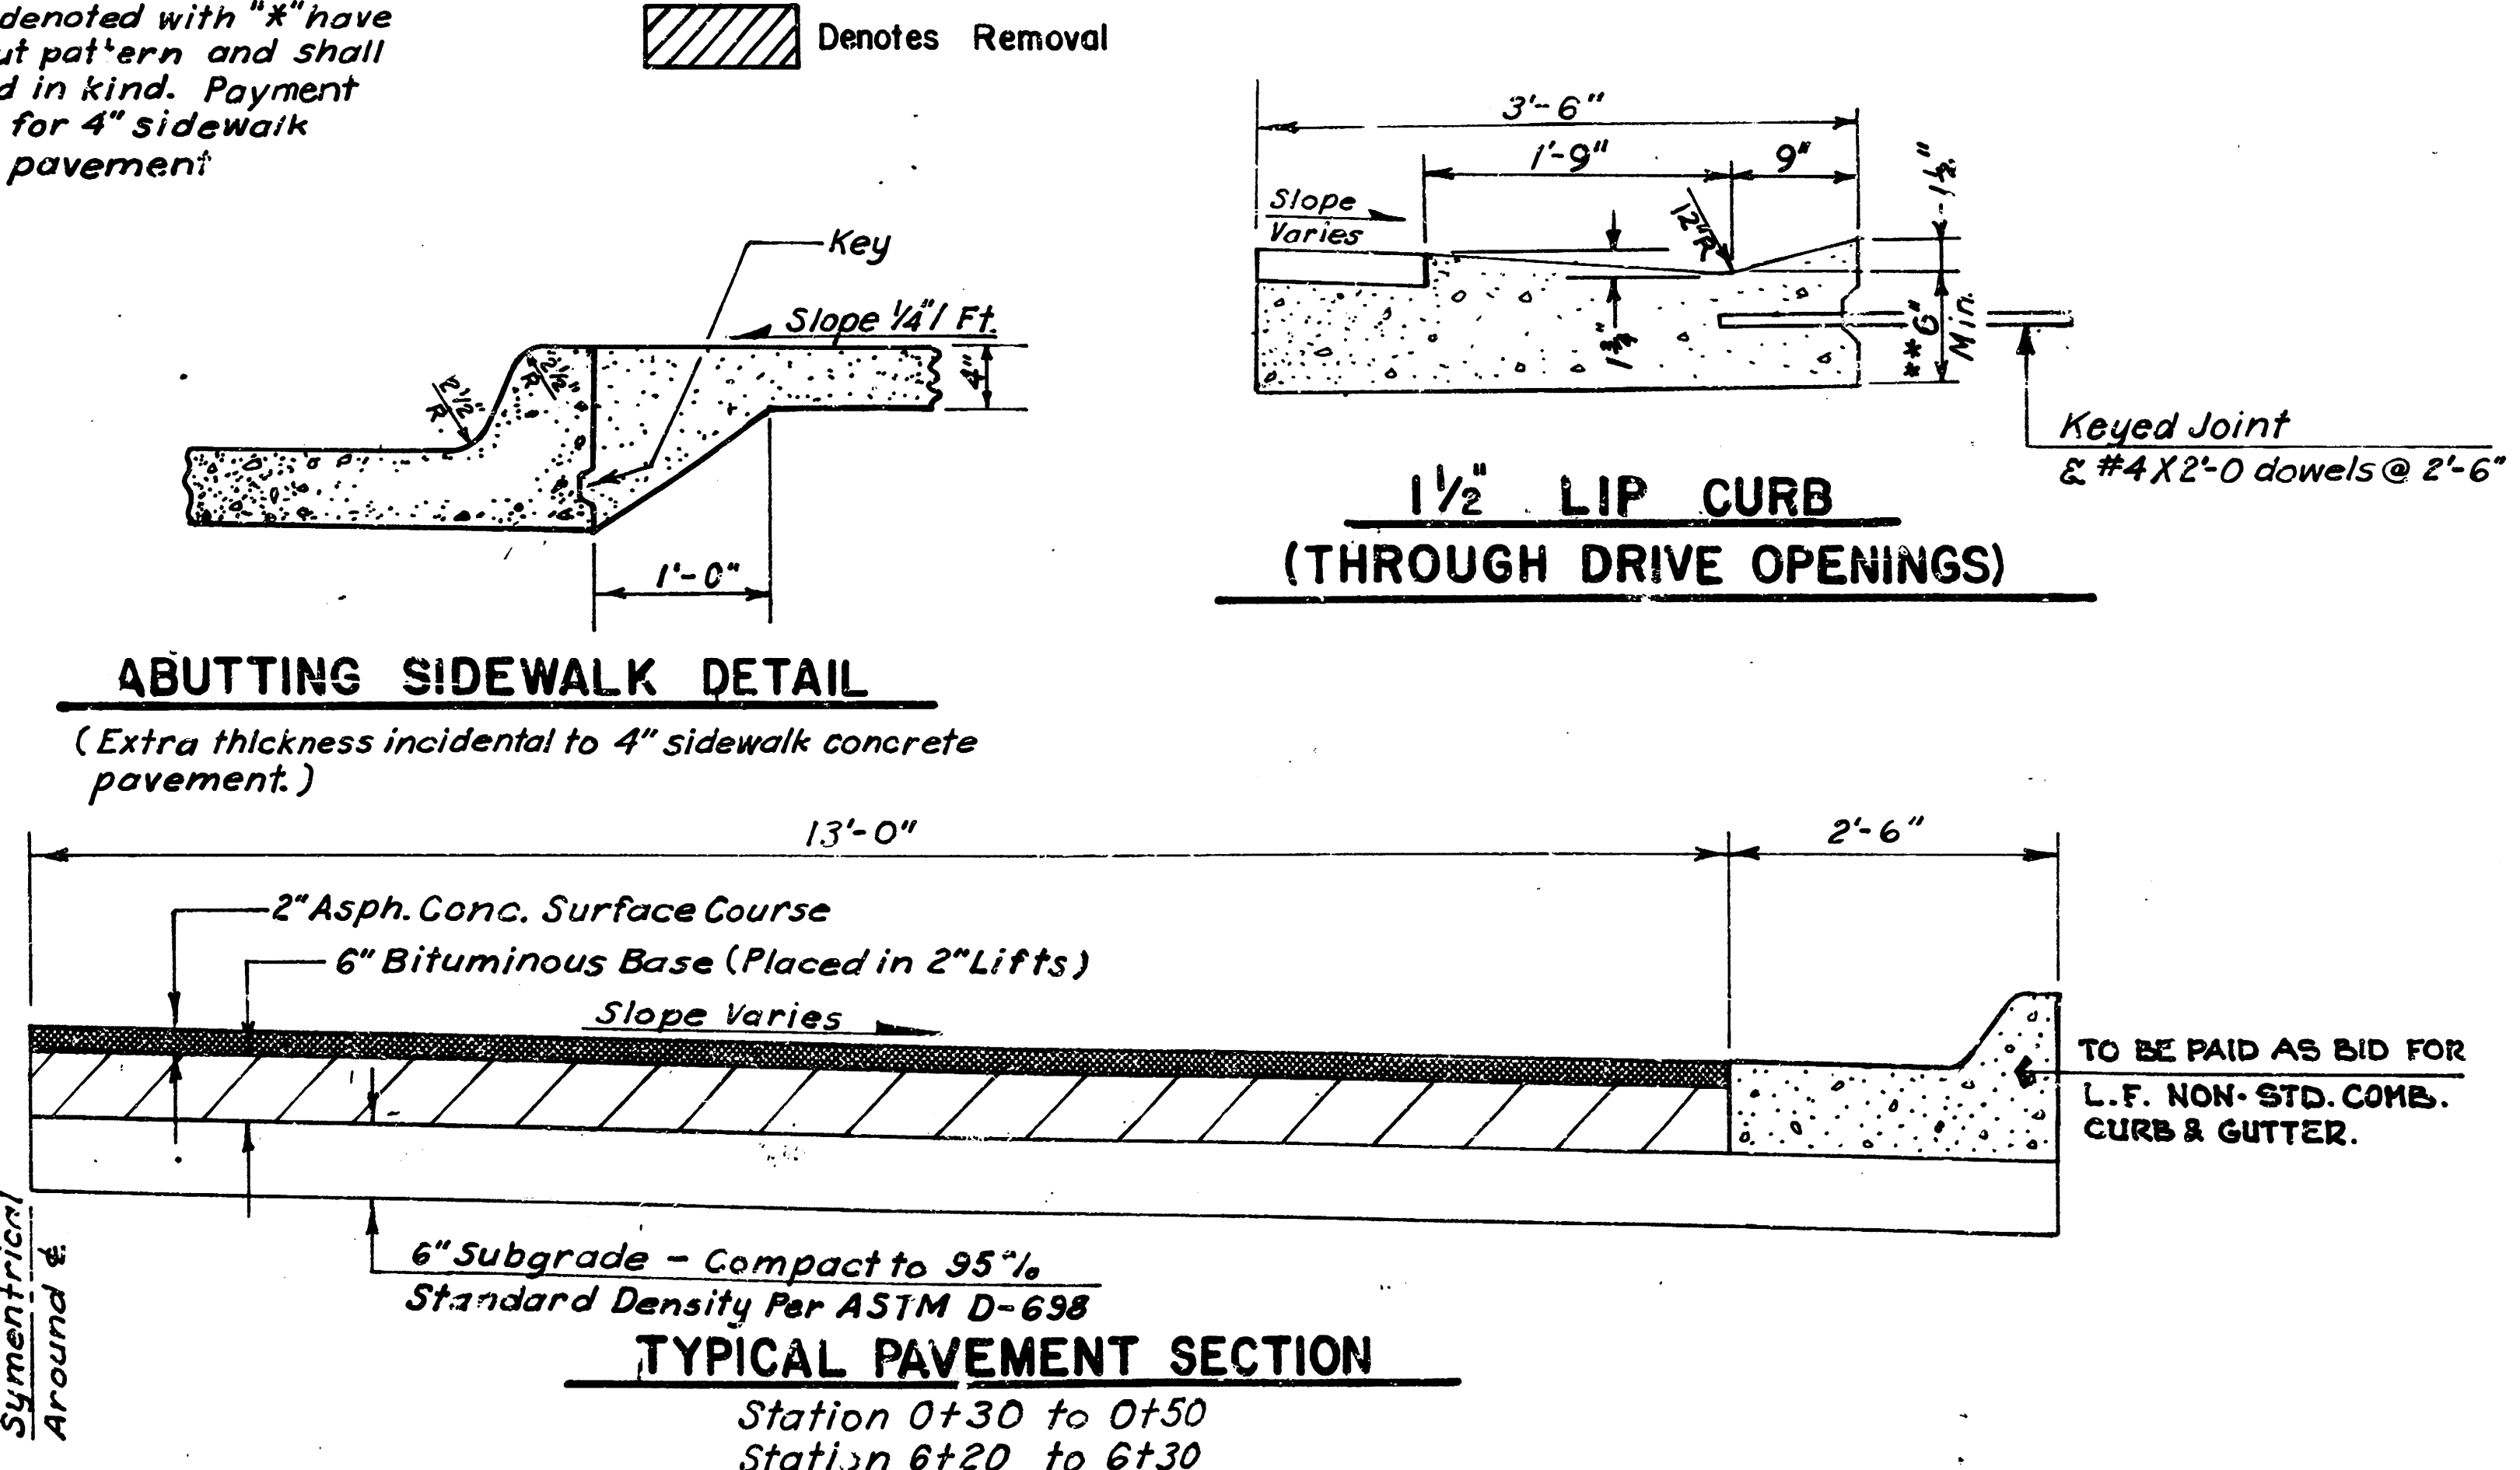


CURB AND GUTTER RECONSTRUCTION
 DELLROSE AVENUE
 FROM THE NORTH LINE OF SECOND ST.
 TO THE SOUTH LINE OF THIRD ST.
 PROJECT 472 76 245 81413 000 000 001


PLAN

R. S. DELAMATER & ASSOCIATES INC.
 CONSULTING ENGINEERS
 WICHITA, KANSAS

DATE: March 1985 DWG. NO. 1012-D-2

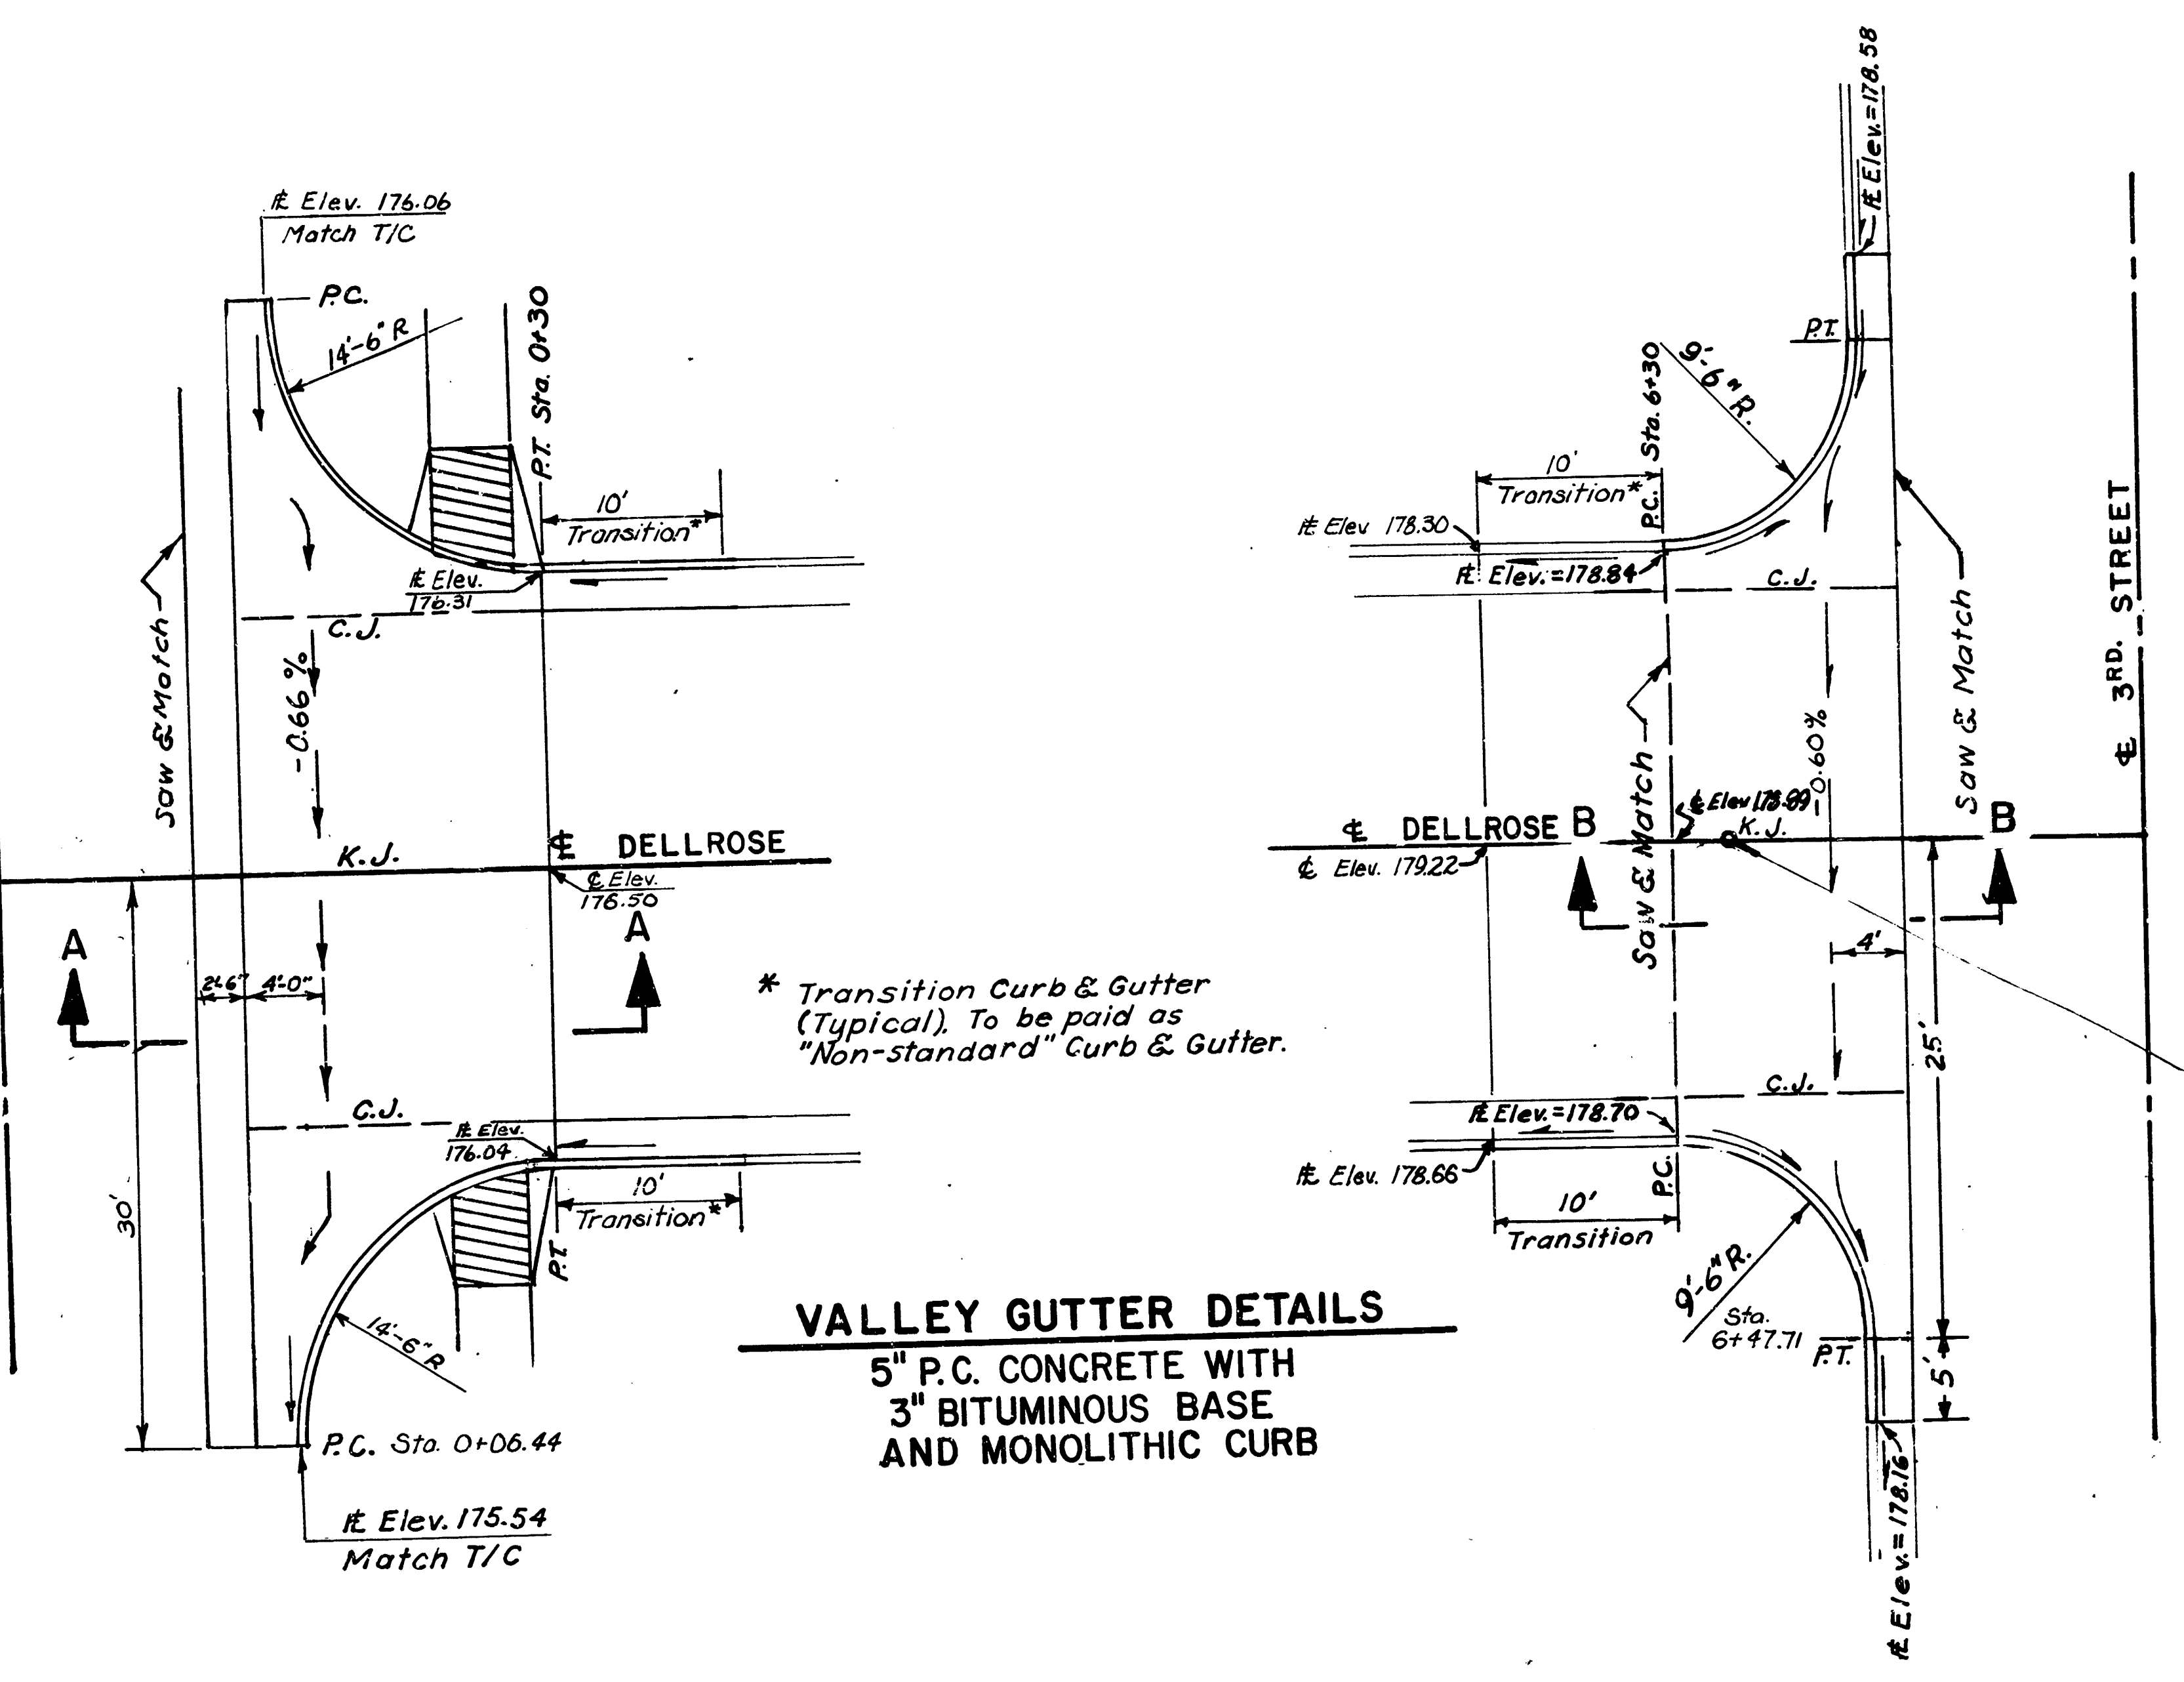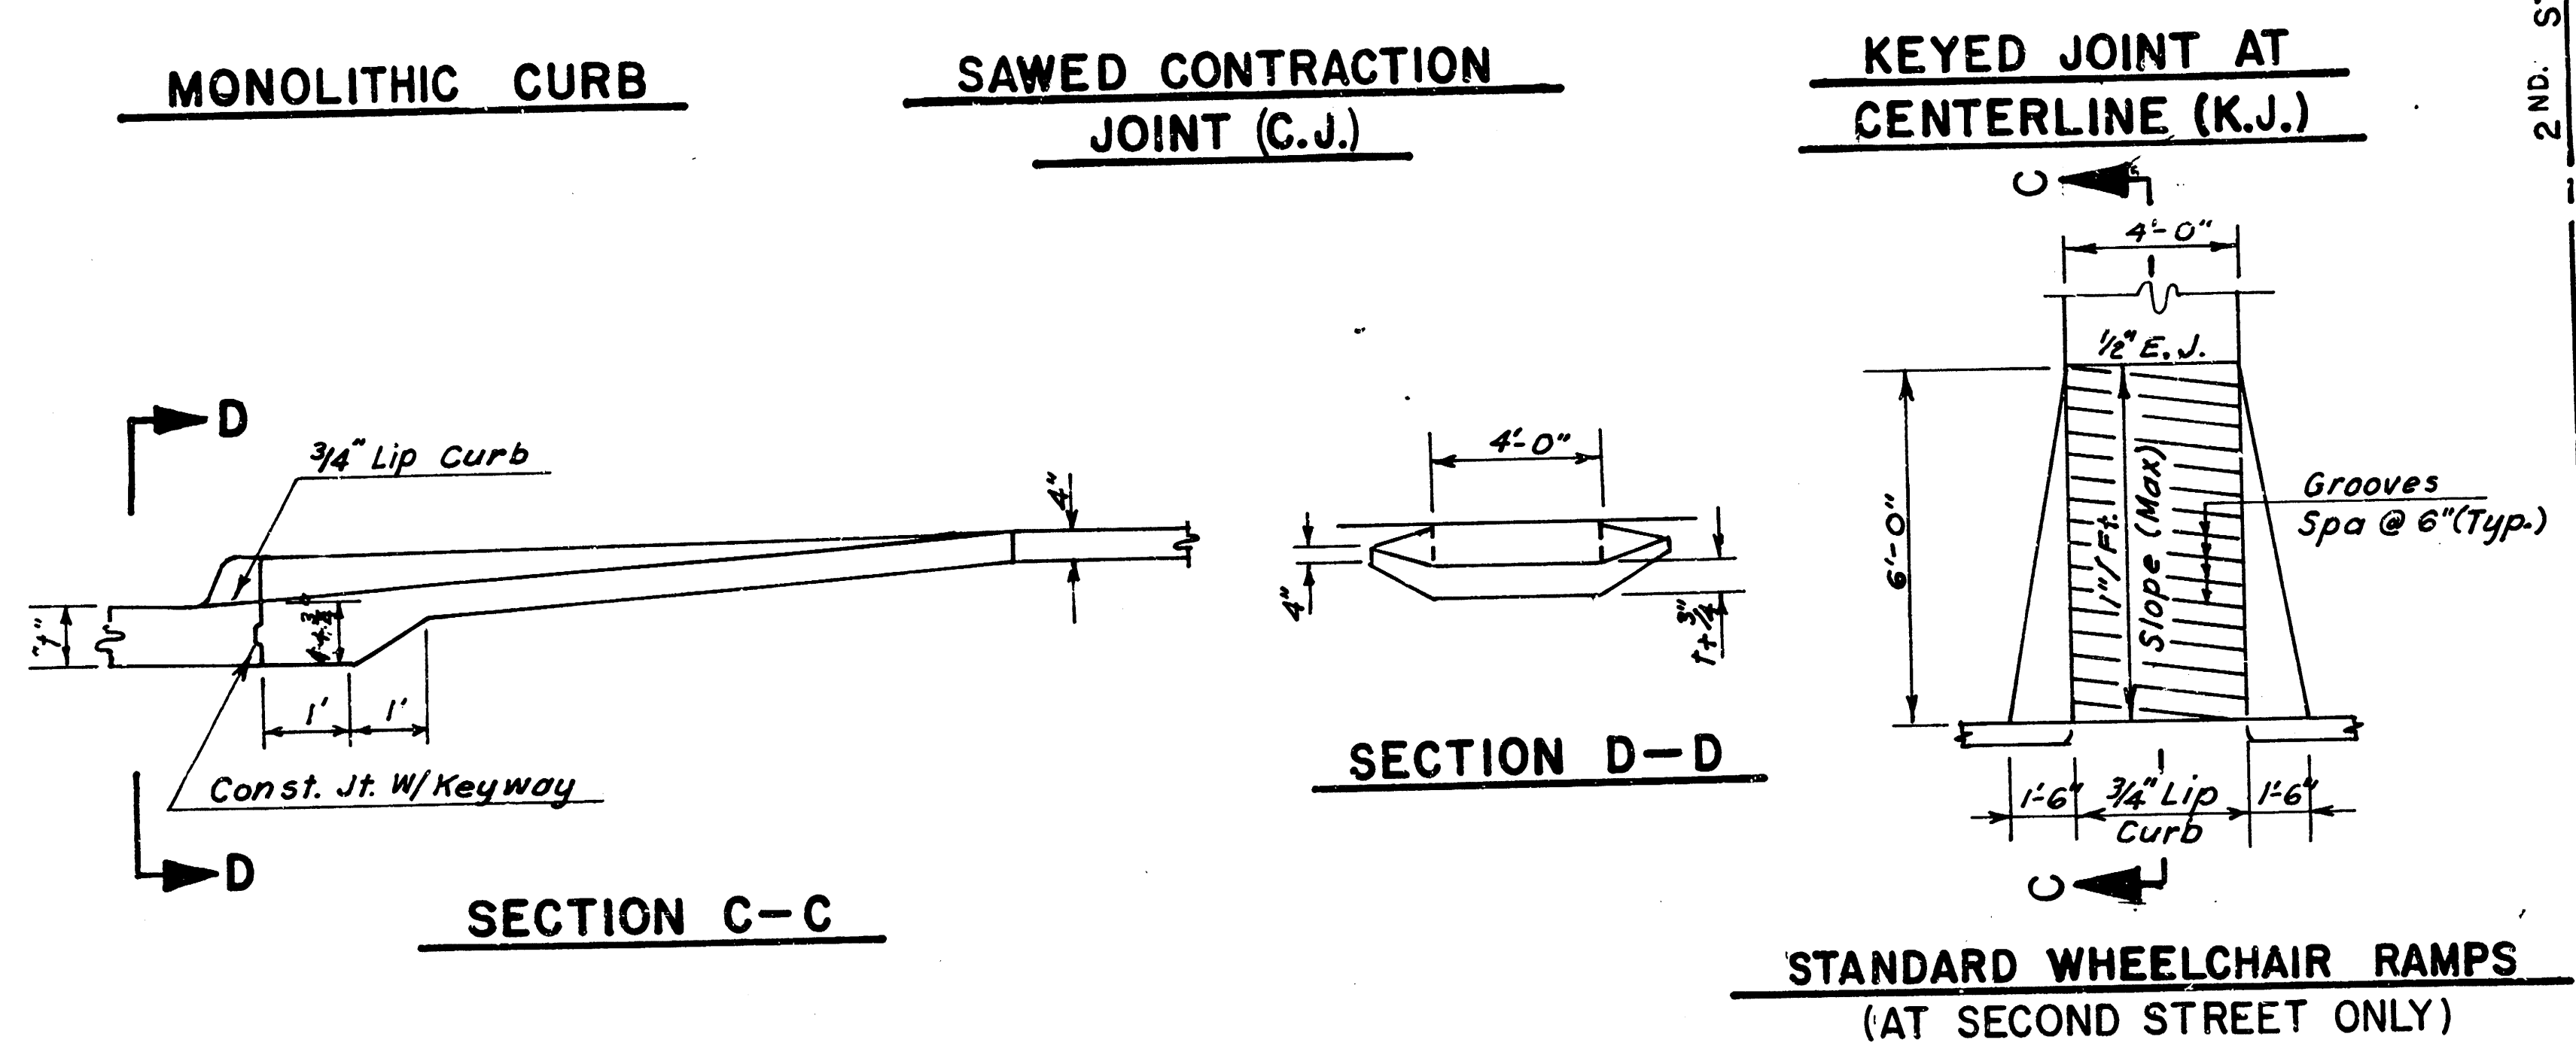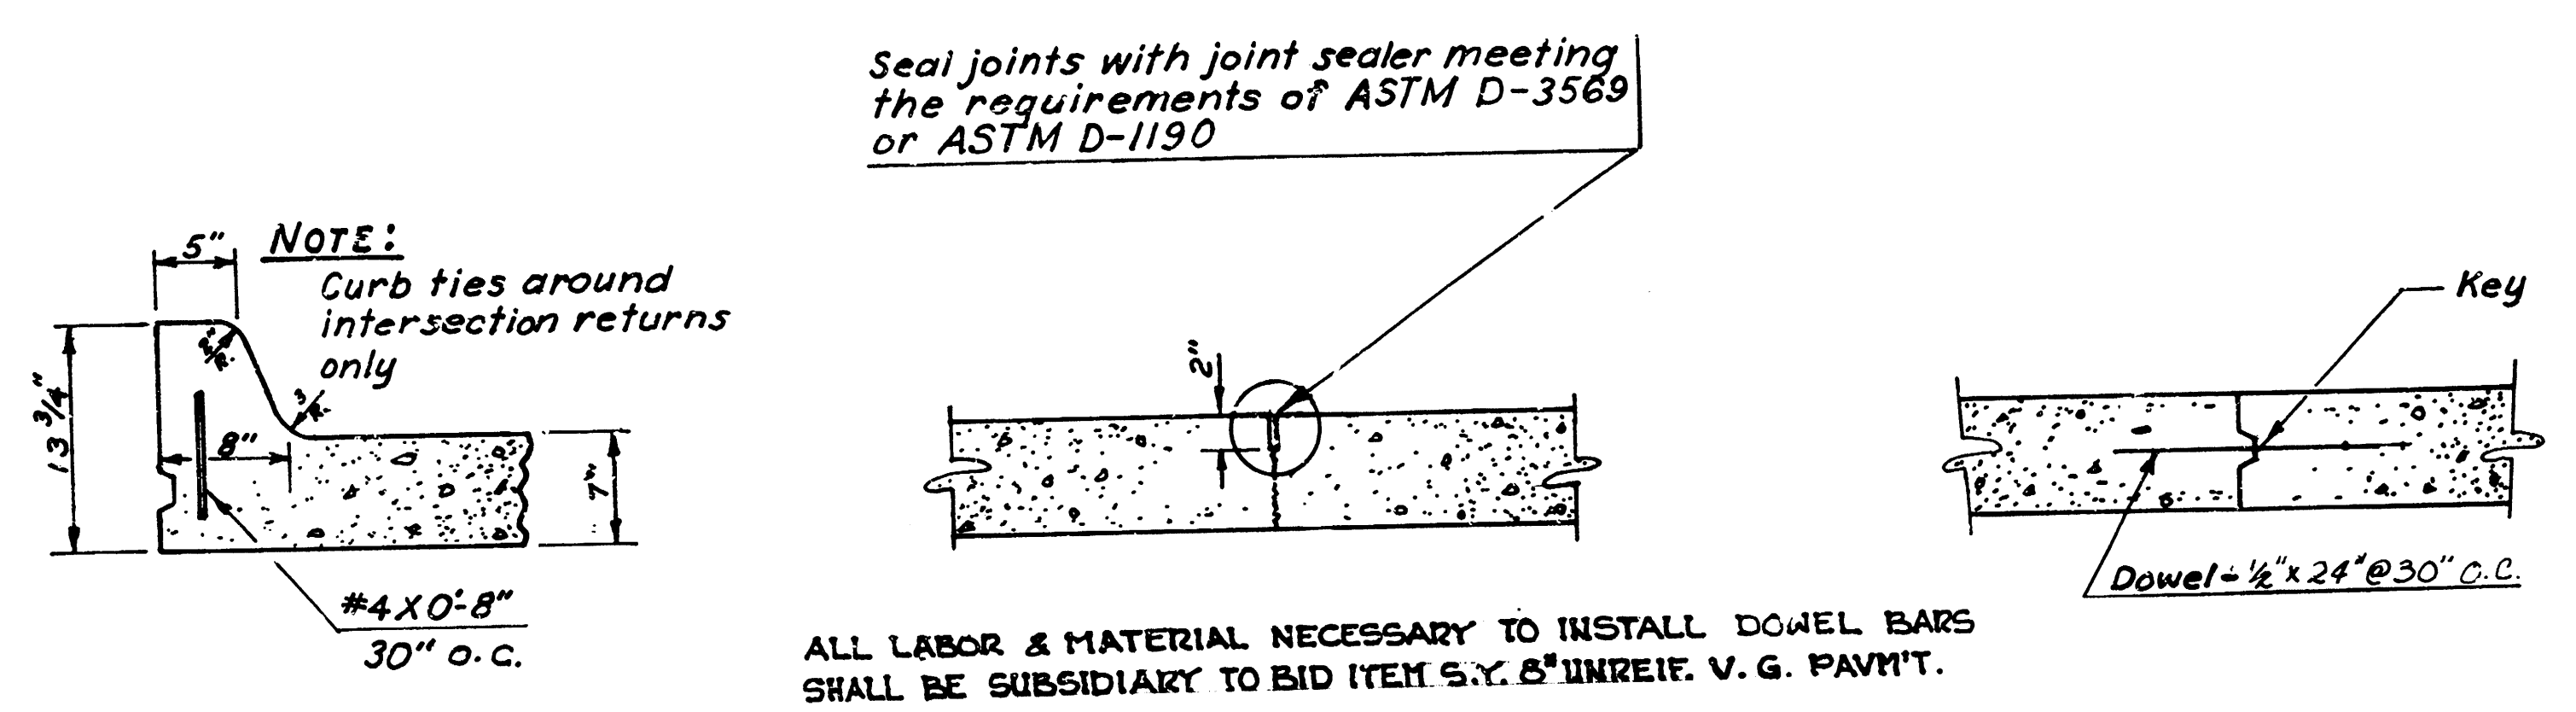

TRIMBLE SHOWN IN RE-SURVEY BOOK. MAKE ARRANGEMENTS TO RE-SET.

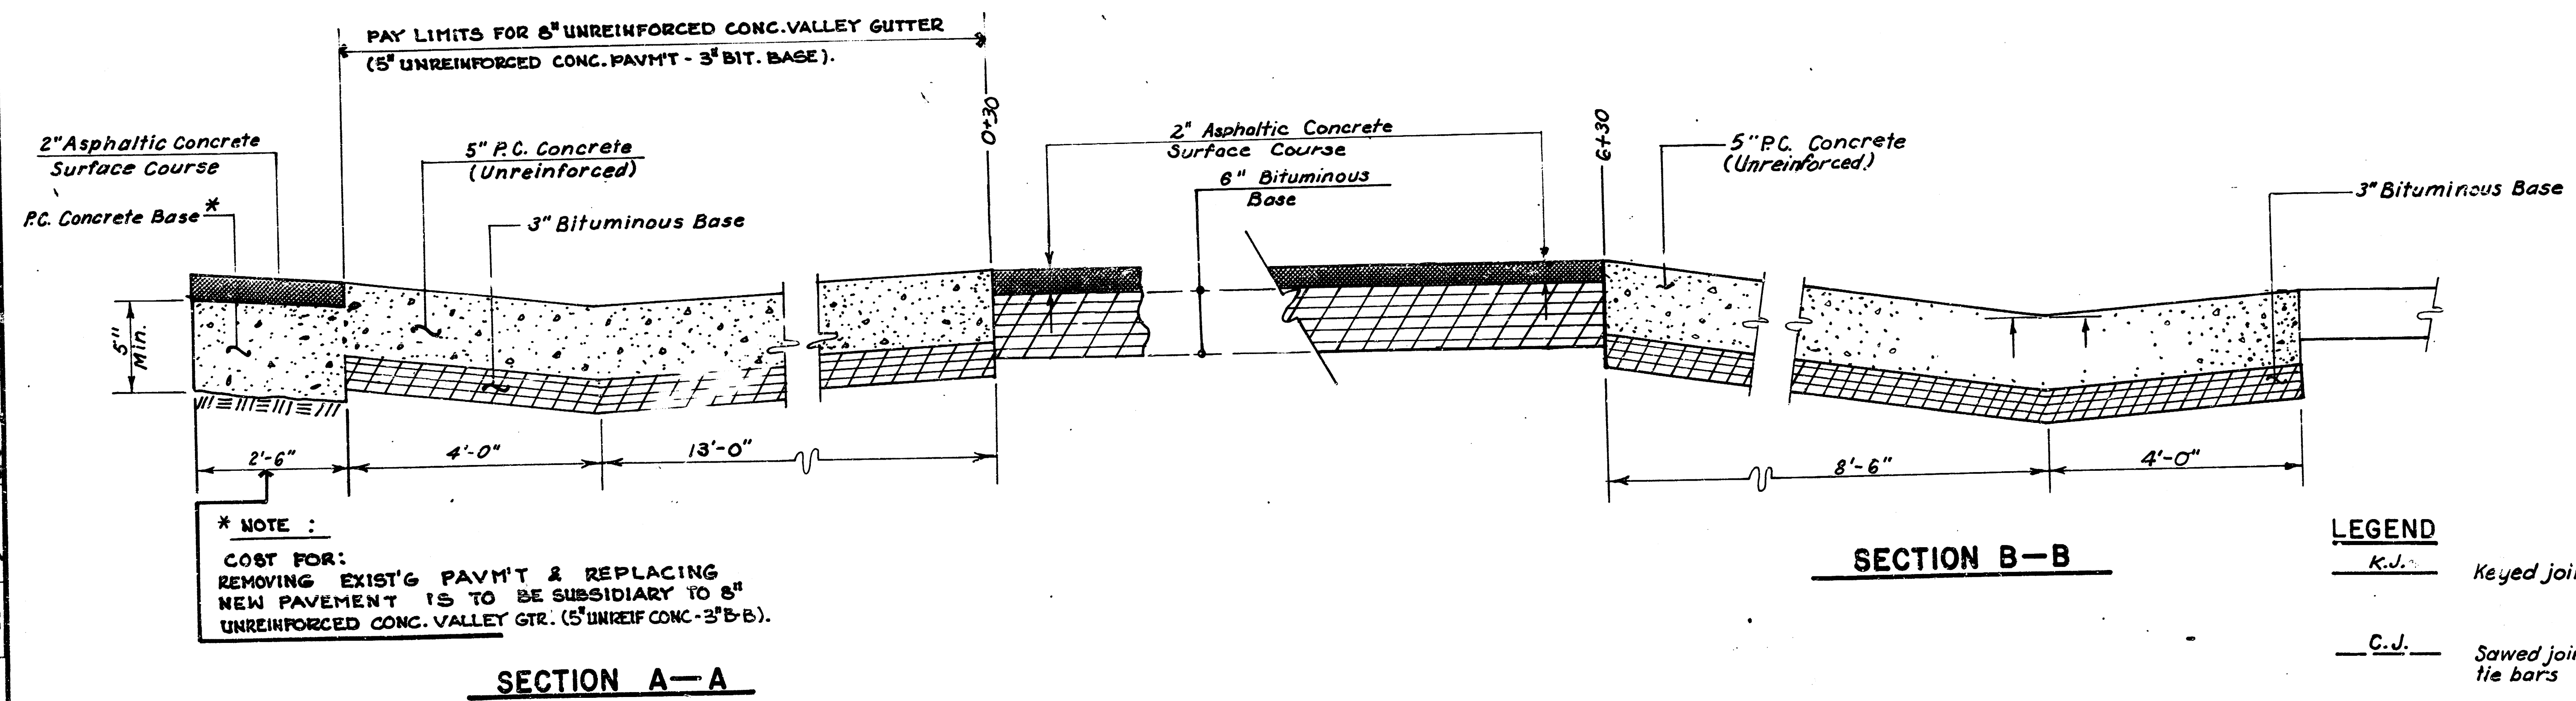

LEGEND

K.J. Keyed joint with tie bars

C.J. Sawed joint - traverse without tie bars

CURB AND GUTTER RECONSTRUCTION
DELLROSE AVENUE
FROM THE NORTH LINE OF SECOND ST.
TO THE SOUTH LINE OF THIRD ST.


PROJECT 472 76 245 81413 000 000 001

VALLEY GUTTER DETAILS


R. S. DELAMATER & ASSOCIATES INC.
CONSULTING ENGINEERS
WICHITA, KANSAS

DATE: March 1985 DWG. NO. 1012-D-3

DATE	BY	CHECKED	DESIGN	APPROVED	REVISION
11/18/85	WJD	WJD	WJD	WJD	1-1-1
11/18/85	WJD	WJD	WJD	WJD	2-2-2
11/18/85	WJD	WJD	WJD	WJD	3-3-3

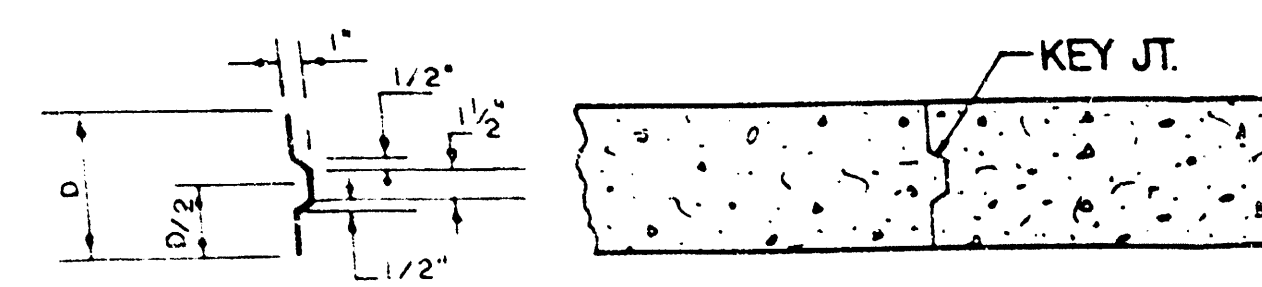


ALT. LONGITUDINAL CONSTRUCTION JOINT

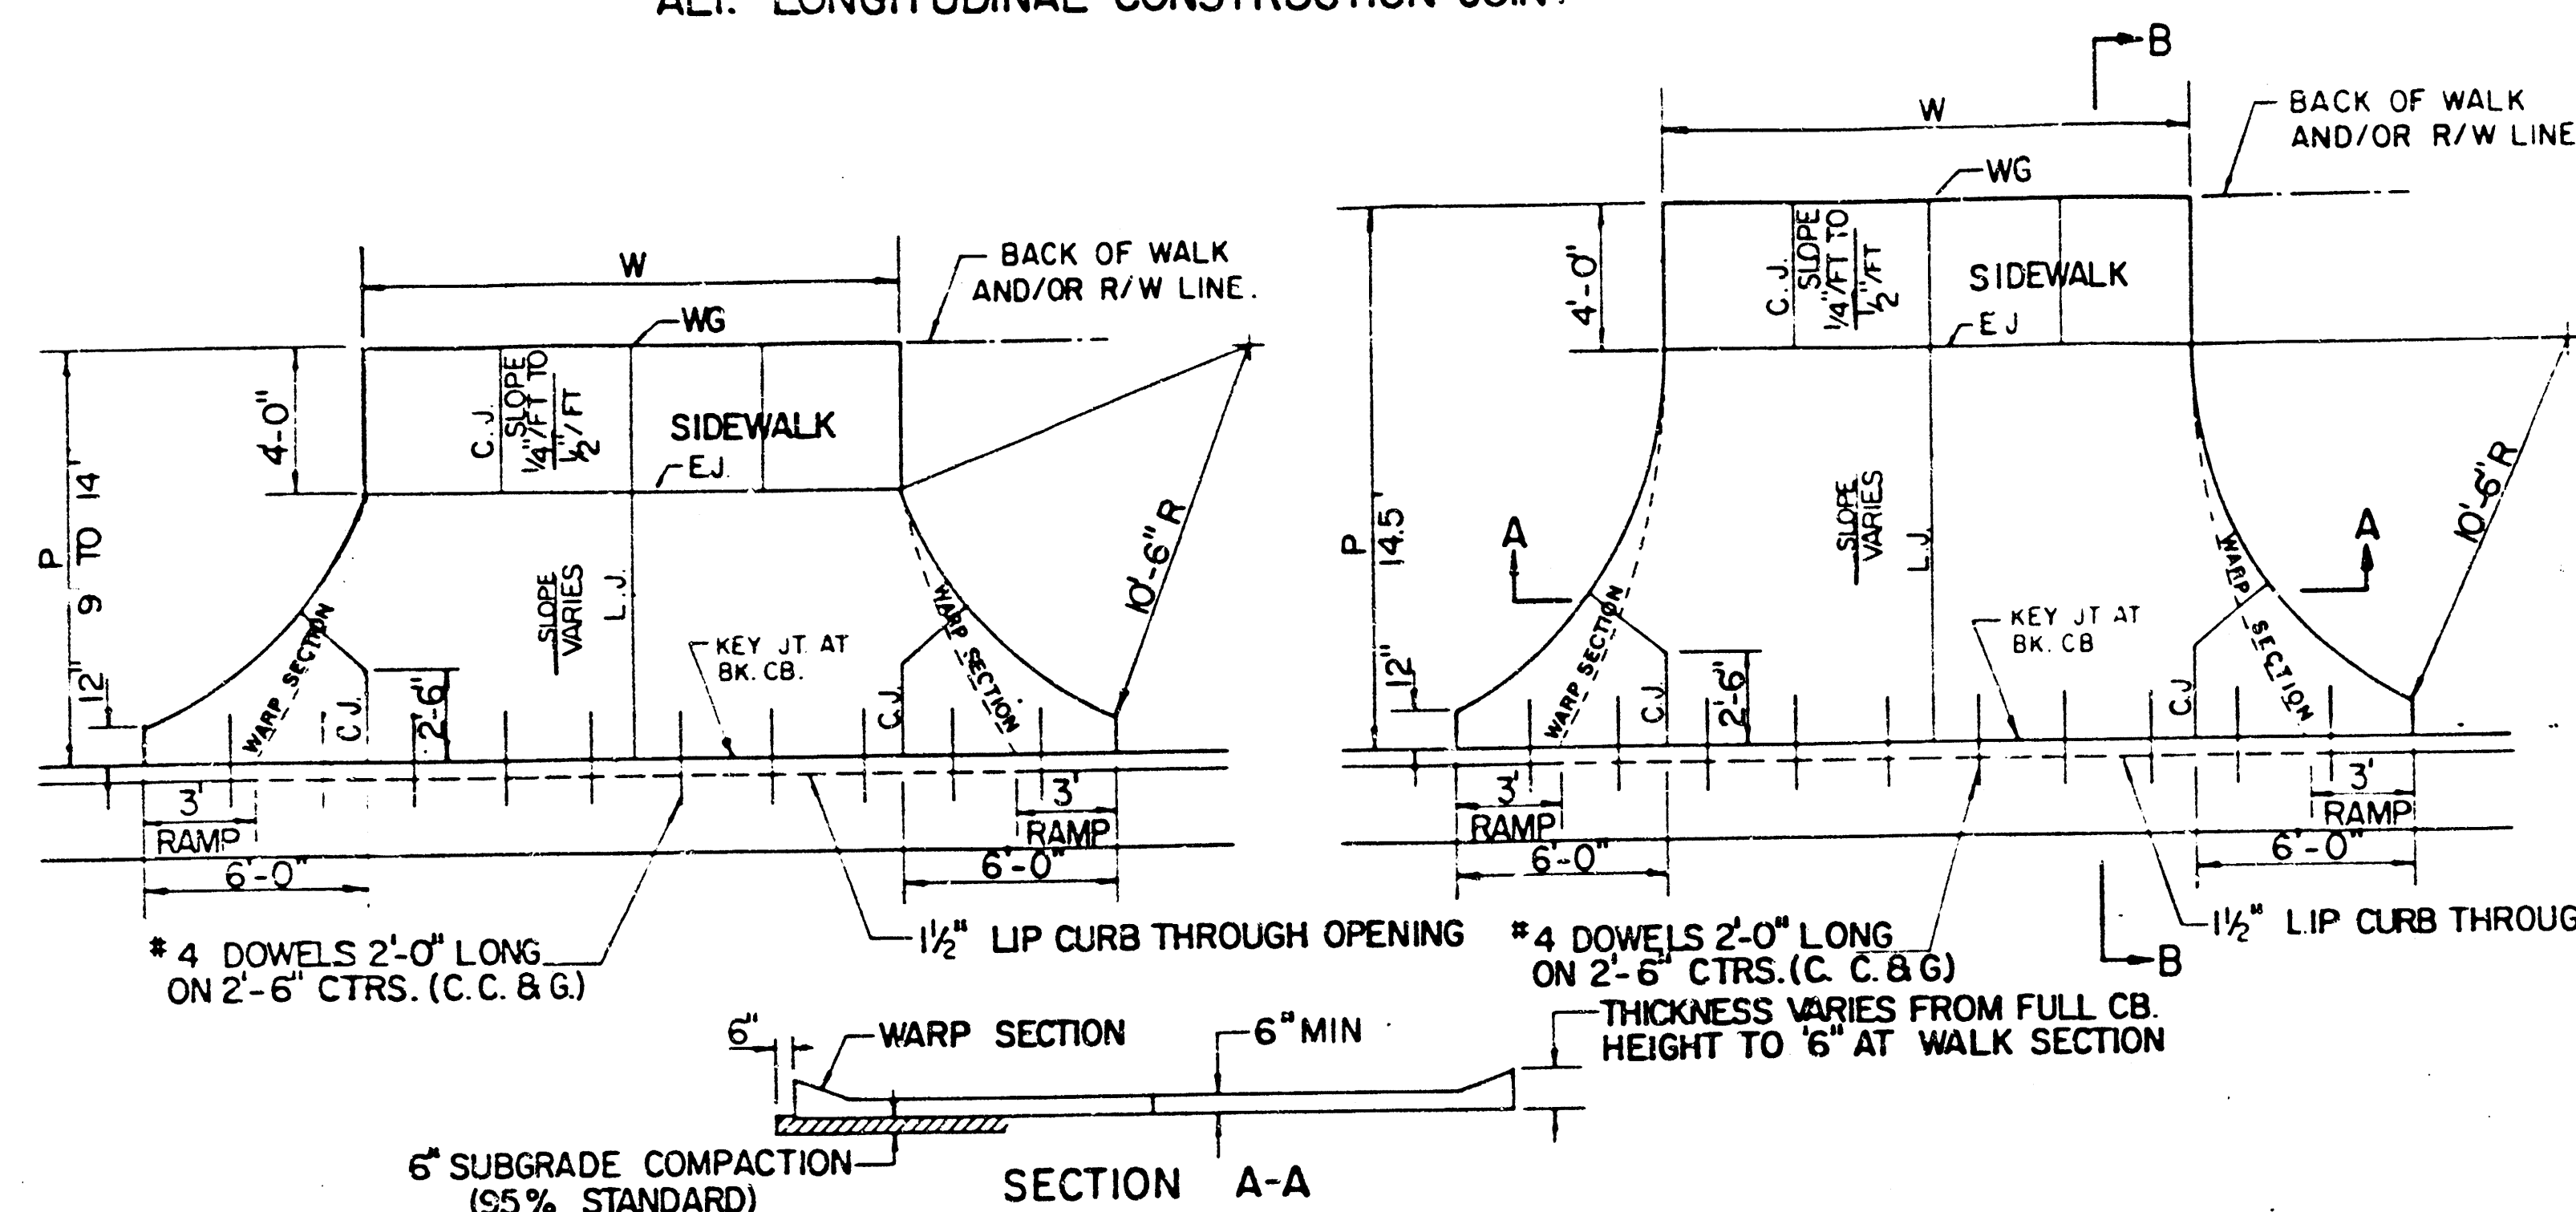



PARKING WIDTH "P"	9'	10'	11'	12'	13'	14.5'	20'	25'	30'	35'	40'	45'	50'
ABSOLUTE MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CURB	0.35'	0.35'	0.40'	0.45'	0.60'	0.80'	1.35'	1.85'	2.35'	2.85'	3.35'	3.85'	4.35'
OPTIMUM MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CURB	0.35'	0.35'	0.40'	0.45'	0.60'	0.70'	1.04'	1.30'	1.56'	1.82'	2.08'	2.34'	2.60'
OPTIMUM MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CURB	0.19'	0.21'	0.23'	0.25'	0.27'	0.30'	0.42'	0.52'	0.62'	0.72'	0.82'	0.92'	1.02'
ABSOLUTE MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CURB	-0.19'	-0.16'	-0.13'	-0.10'	-0.06'	0.00'	0.00'	0.15'	0.25'	0.35'	0.45'	0.55'	0.65'

RADIUS RAMP DRIVES (P = 9.0' & GREATER)

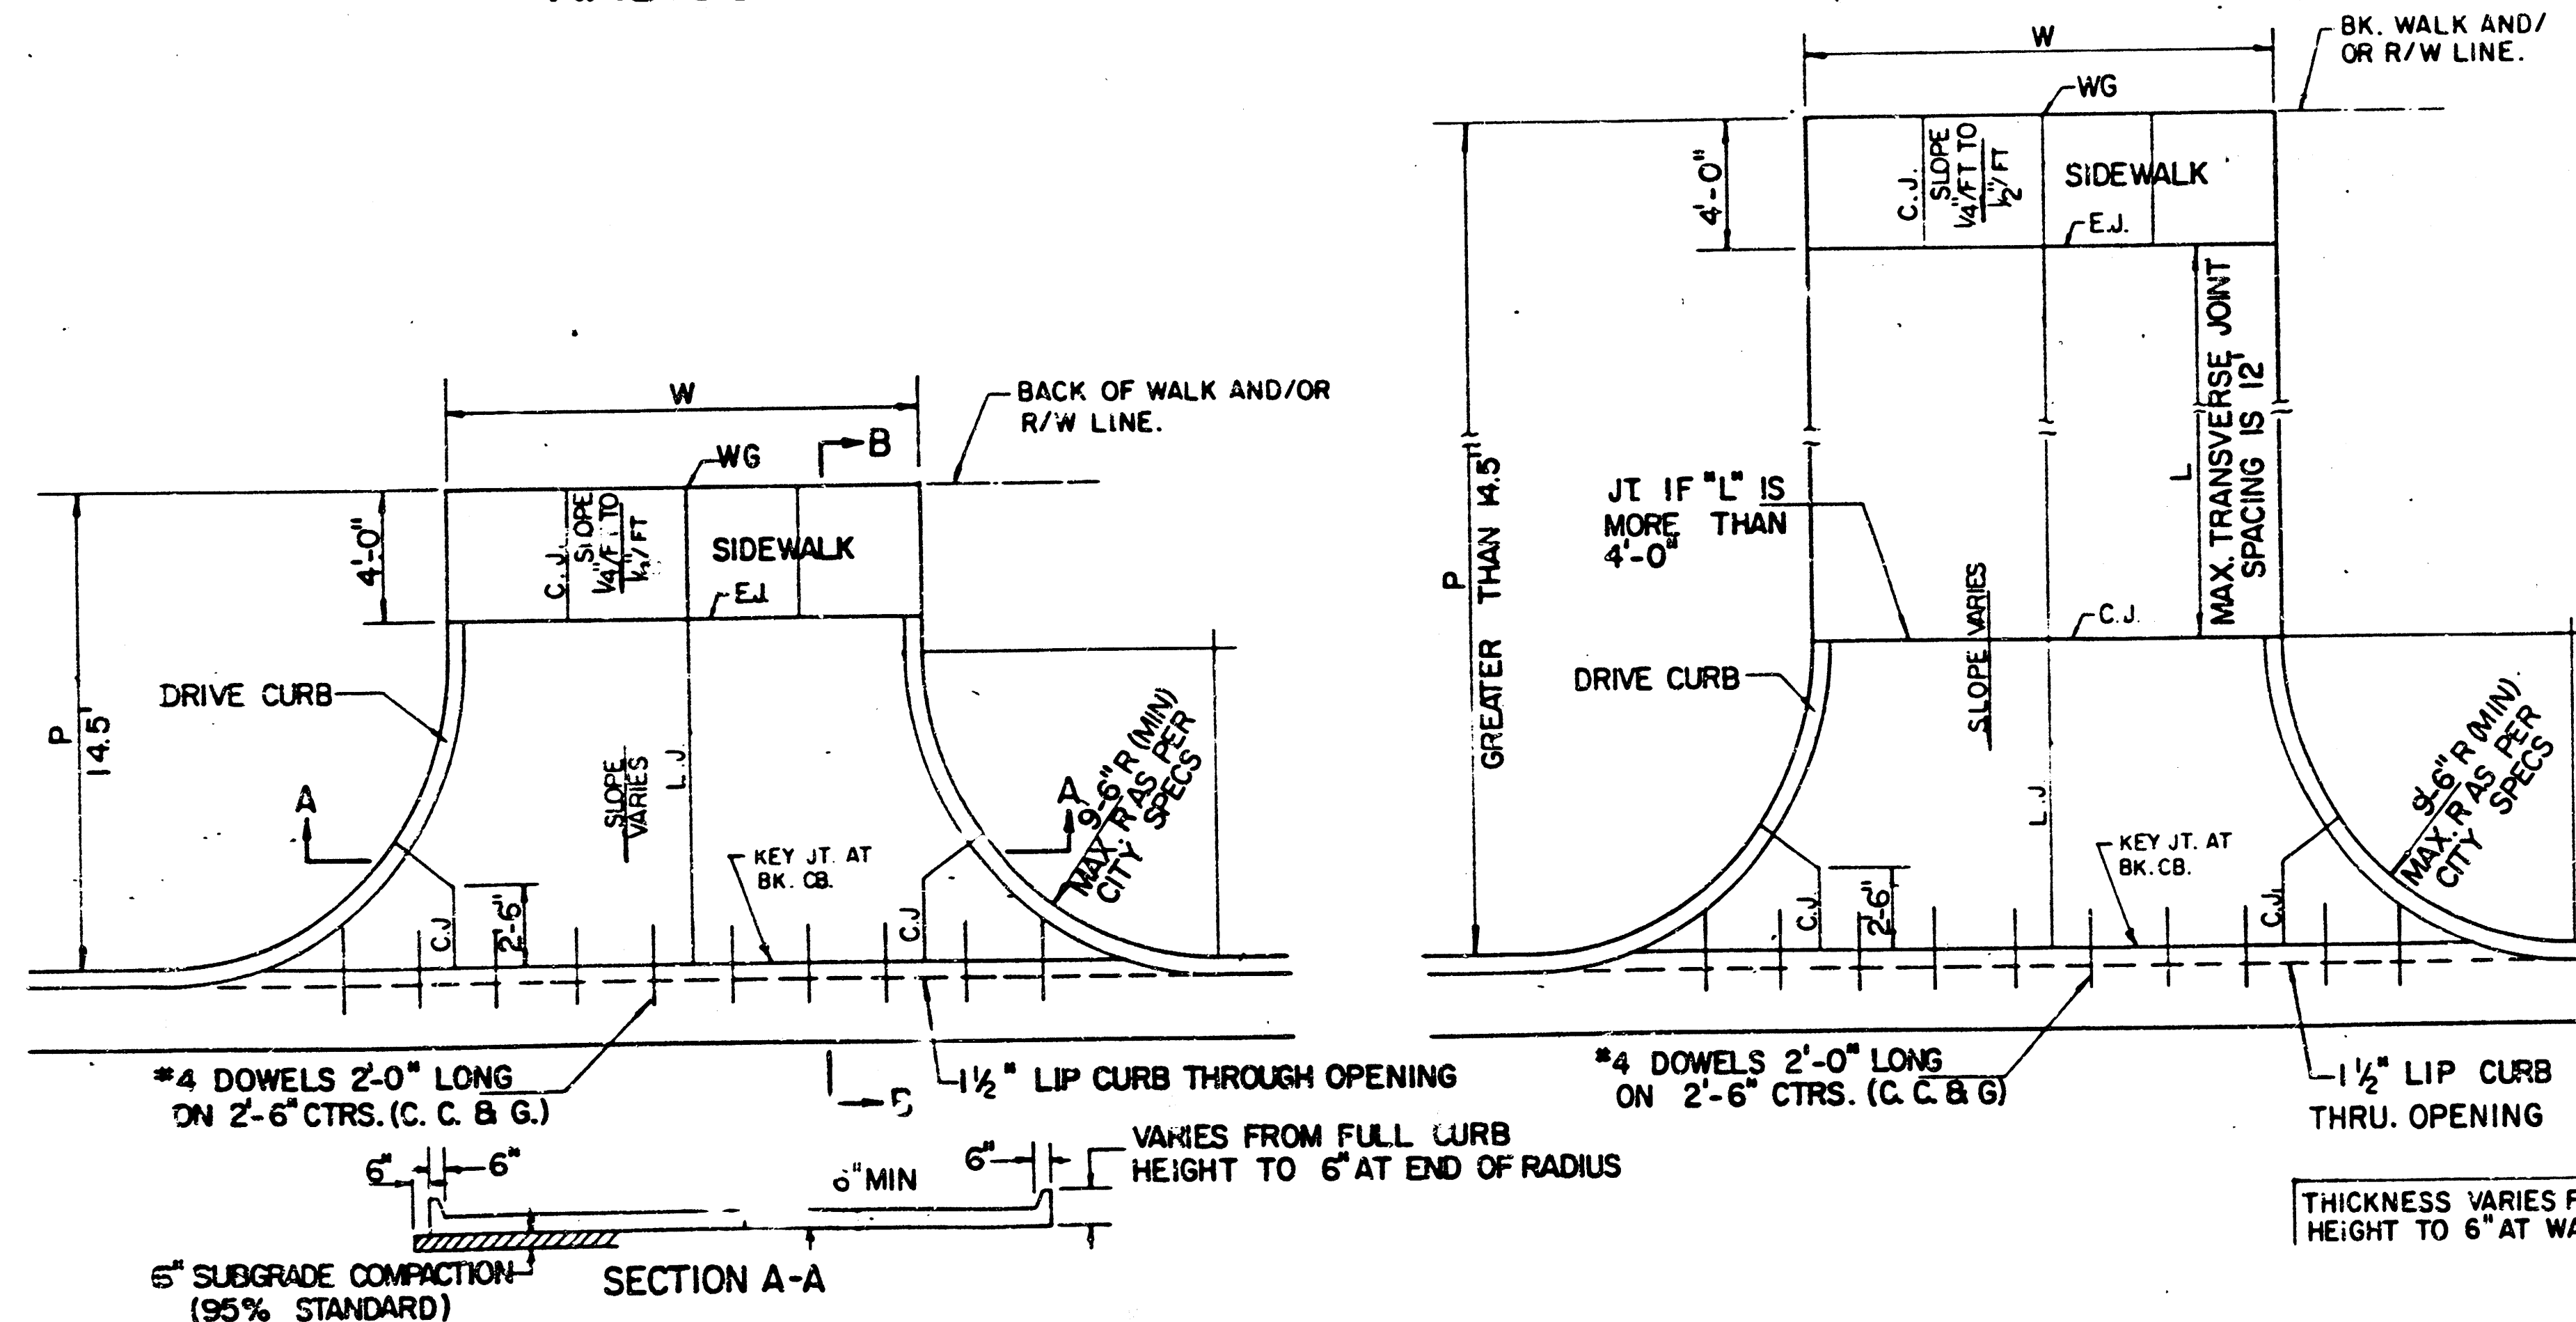


PARKING WIDTH "P"	14.5'	20'	25'	30'	35'	40'	45'	50'
ABSOLUTE MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.80'	1.35'	1.85'	2.35'	2.85'	3.35'	3.85'	4.35'
OPTIMUM MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.70'	1.04'	1.30'	1.56'	1.82'	2.08'	2.34'	2.60'
OPTIMUM MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.30'	0.42'	0.52'	0.62'	0.72'	0.82'	0.92'	1.02'
ABSOLUTE MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.00'	0.00'	0.15'	0.25'	0.35'	0.45'	0.55'	0.65'

FULL RADIUS DRIVES (P = 14.5' & GREATER)

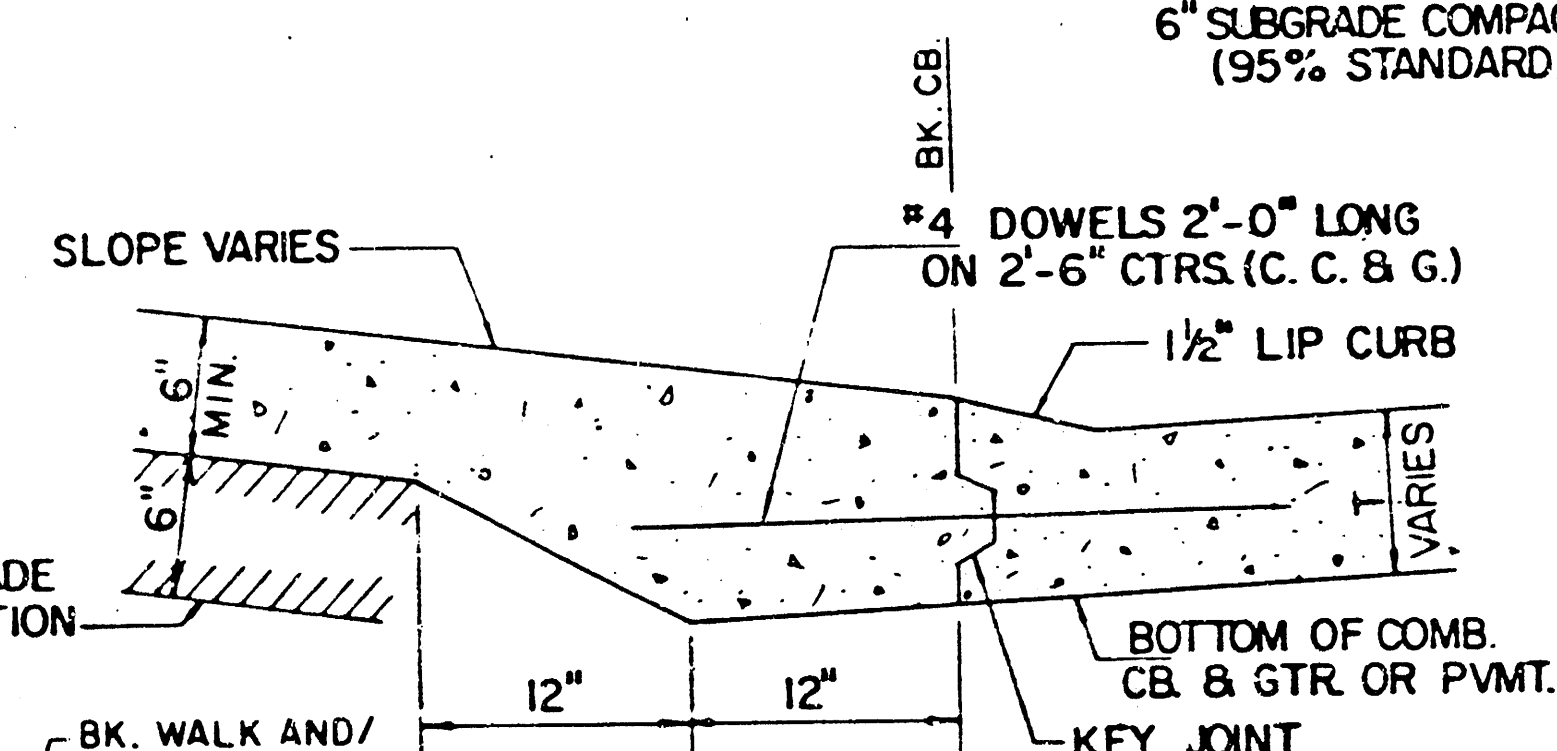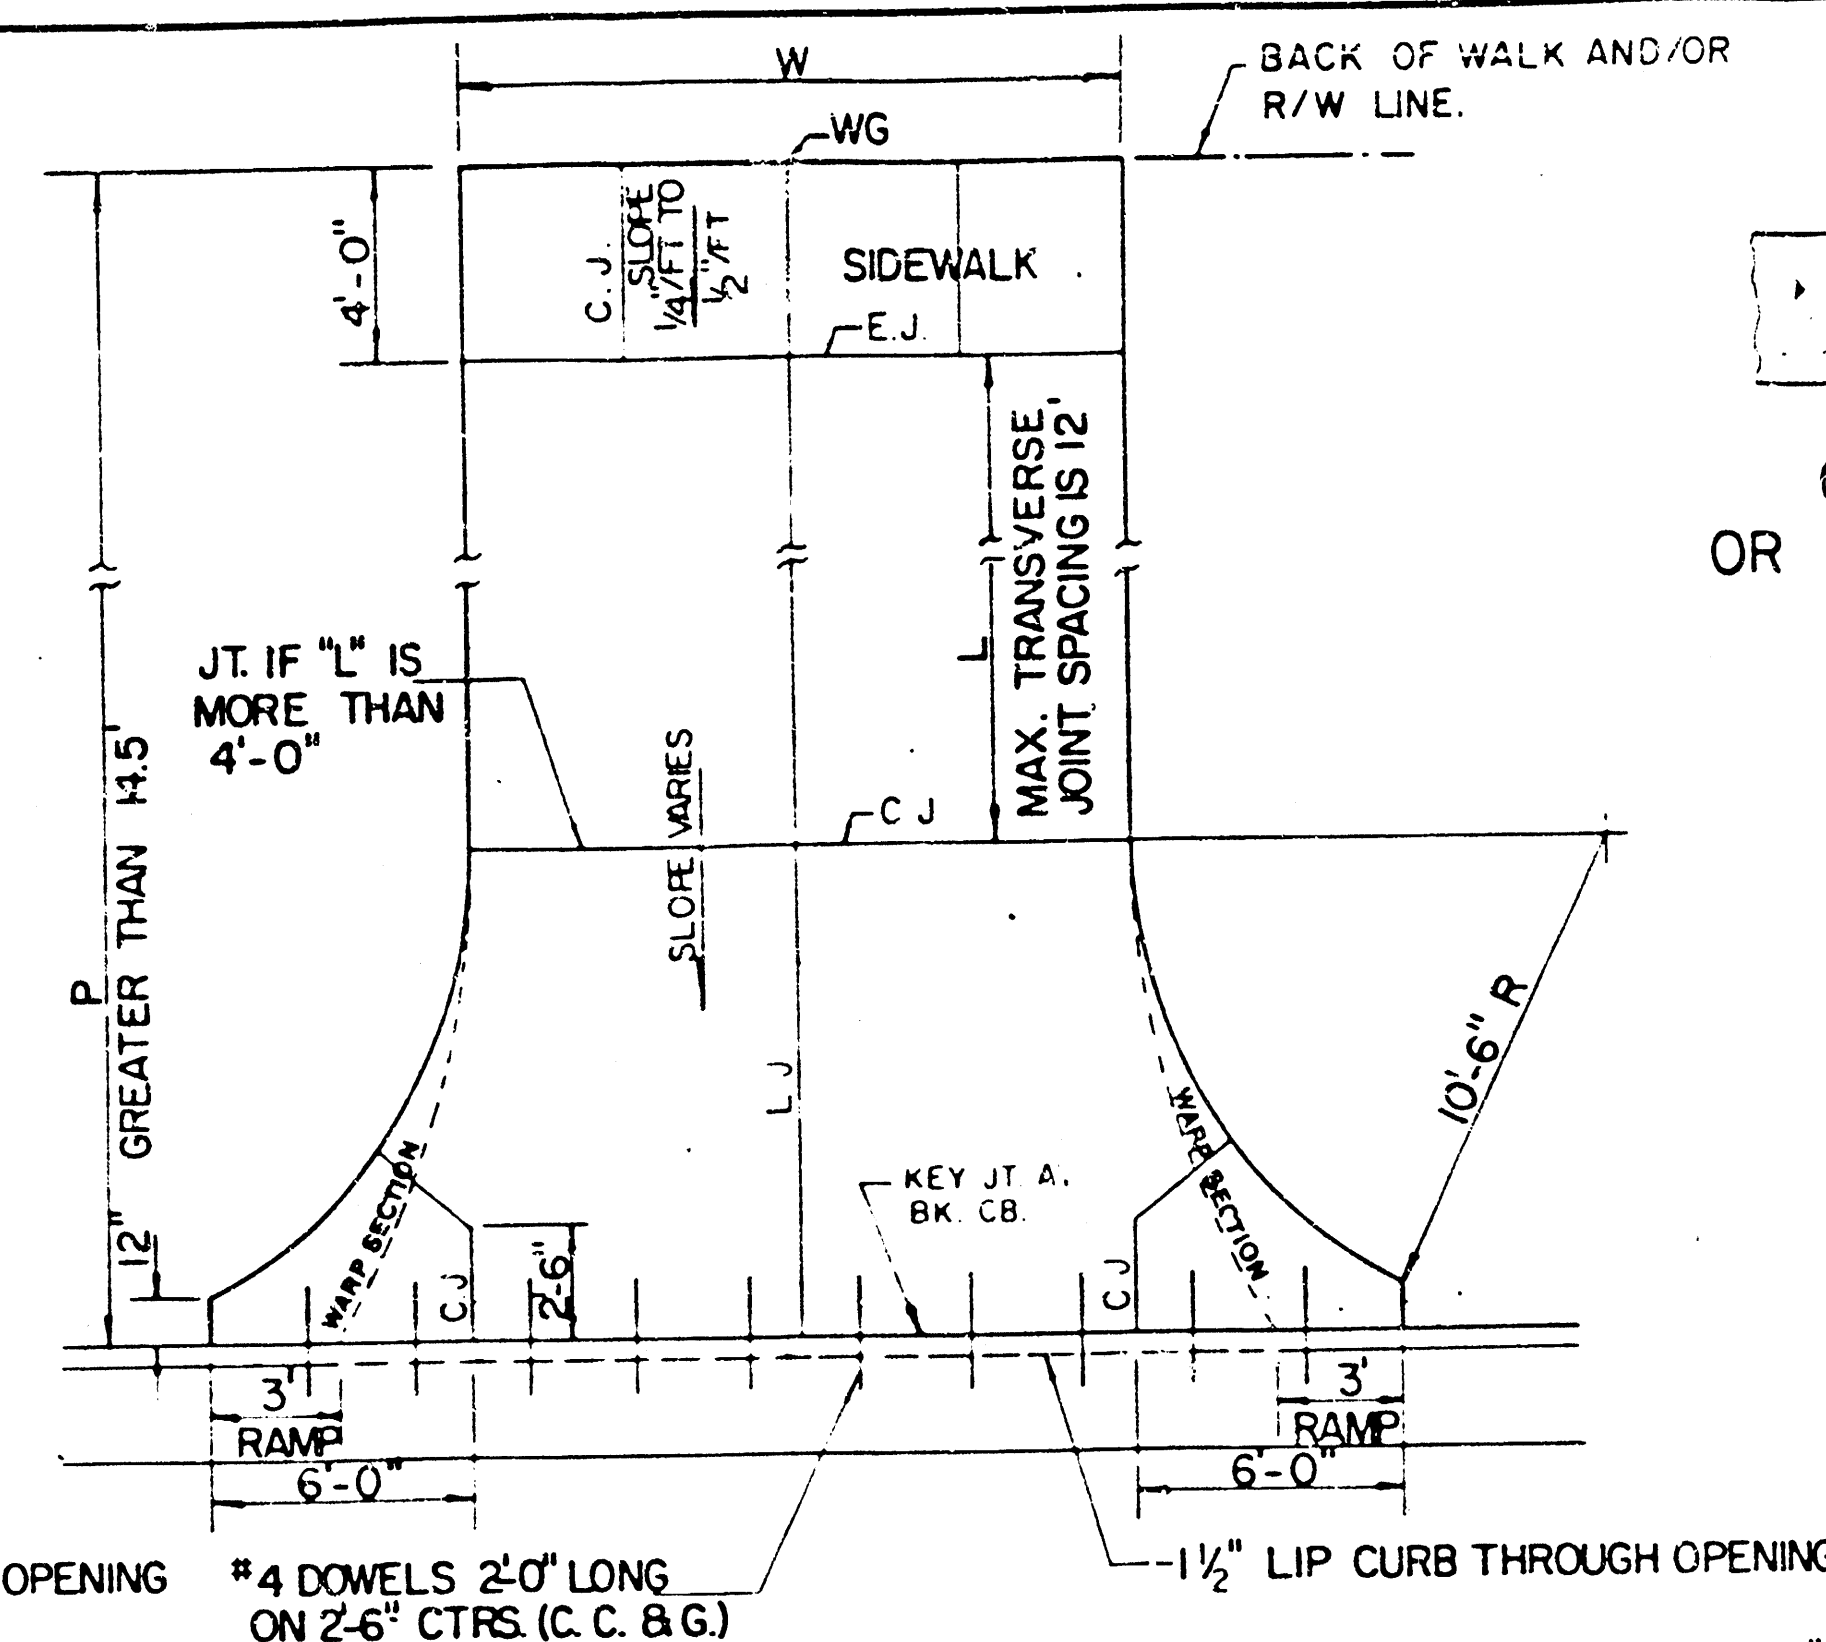


BACK OF CURB DETAIL SECTION B - B (no scale)

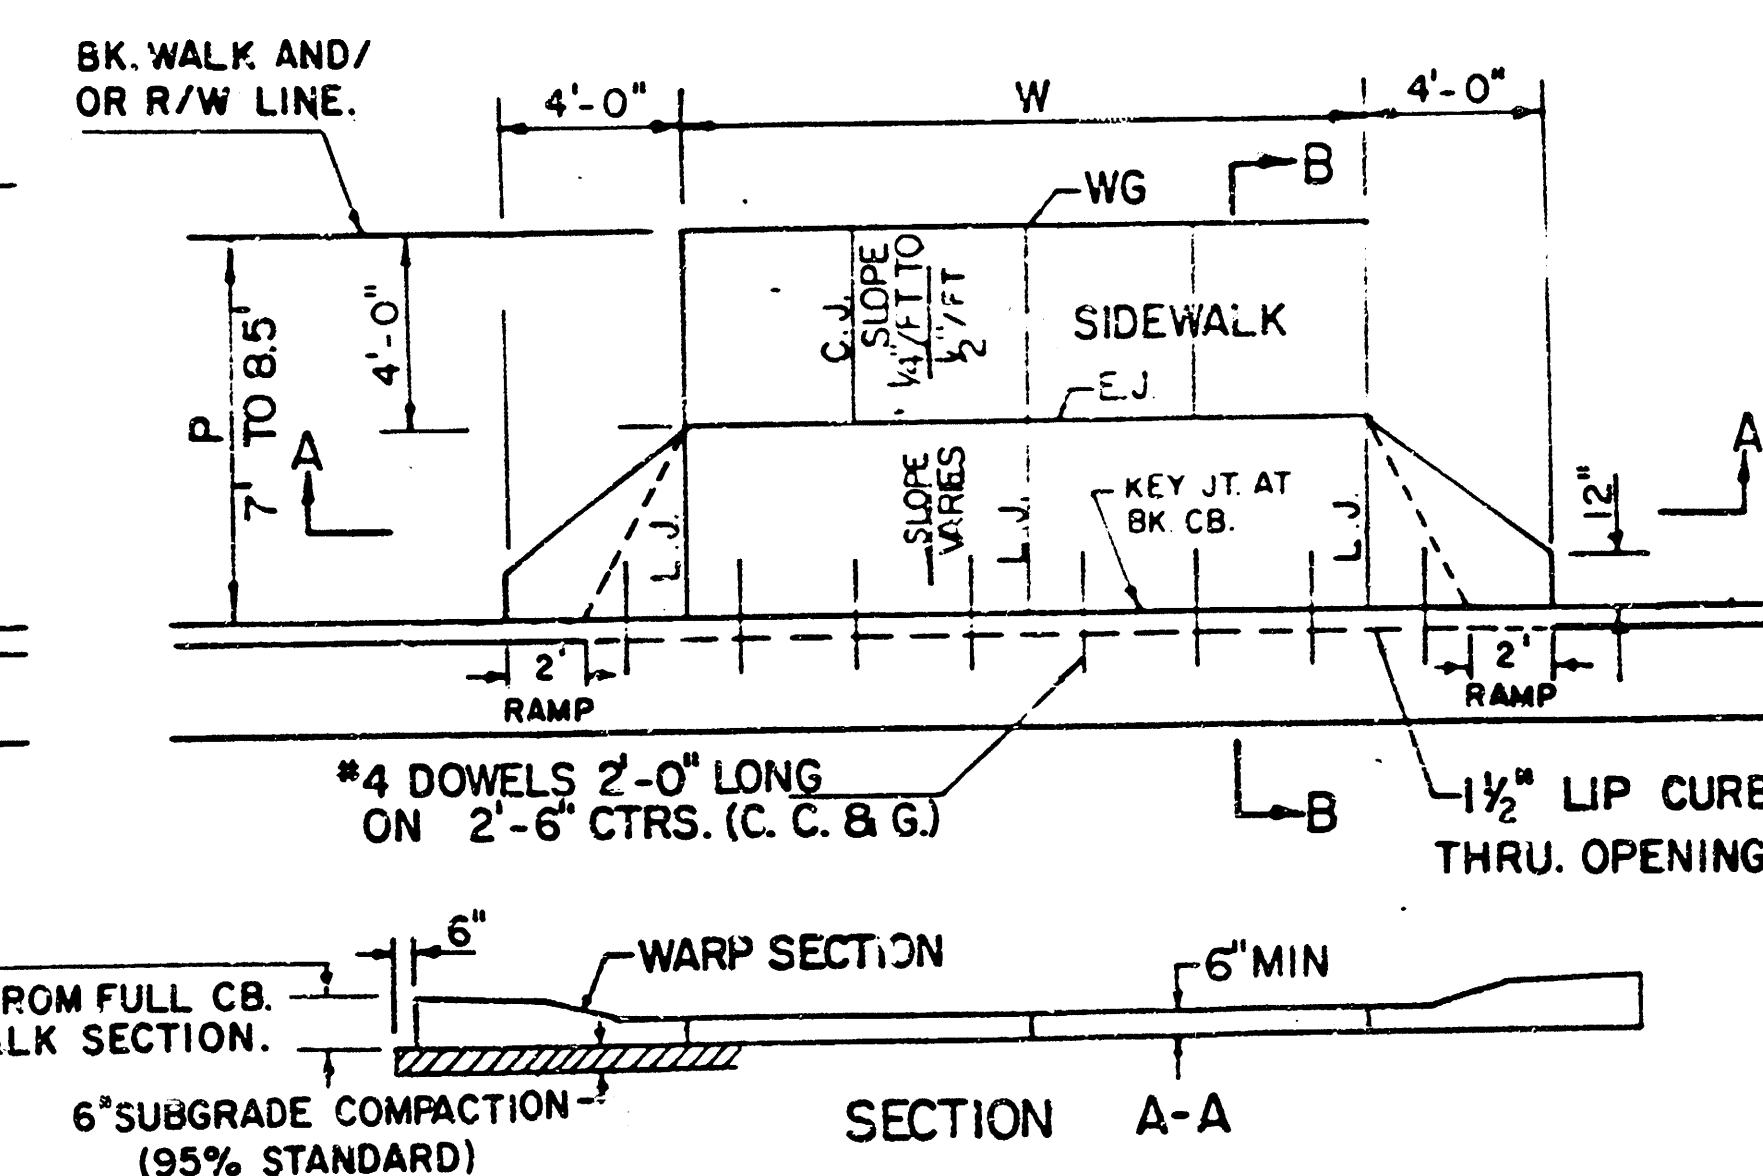


PARKING WIDTH "P"	7'	7.5'	8'	8.5'
ABSOLUTE MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.00'	0.10'	0.20'	0.30'
OPTIMUM MAX. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.00'	0.10'	0.20'	0.30'
OPTIMUM MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	0.15'	0.16'	0.17'	0.17'
ABSOLUTE MIN. DIST. OF PT. "WG" ABOVE TOP OF FULL CB	-0.25'	-0.20'	-0.20'	-0.20'

FULL RAMP DRIVE (P = 7.0' TO 8.5')

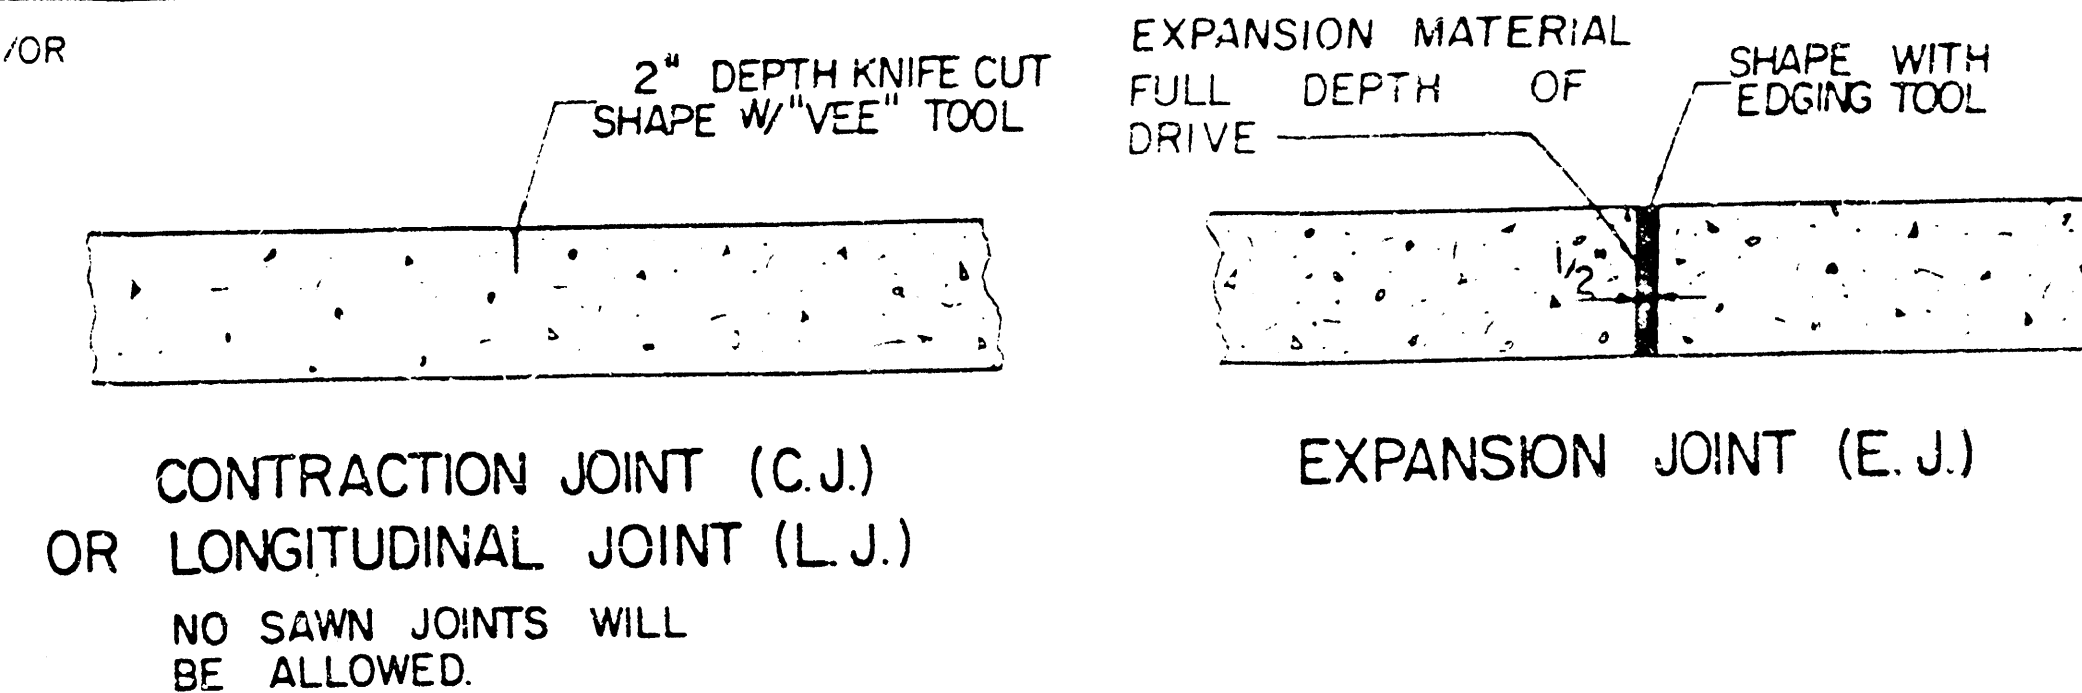

CONTRACTION JOINT (C.J.) OR LONGITUDINAL JOINT (L.J.) NO SAWN JOINTS WILL BE ALLOWED.

EXPANSION JOINT (E.J.)

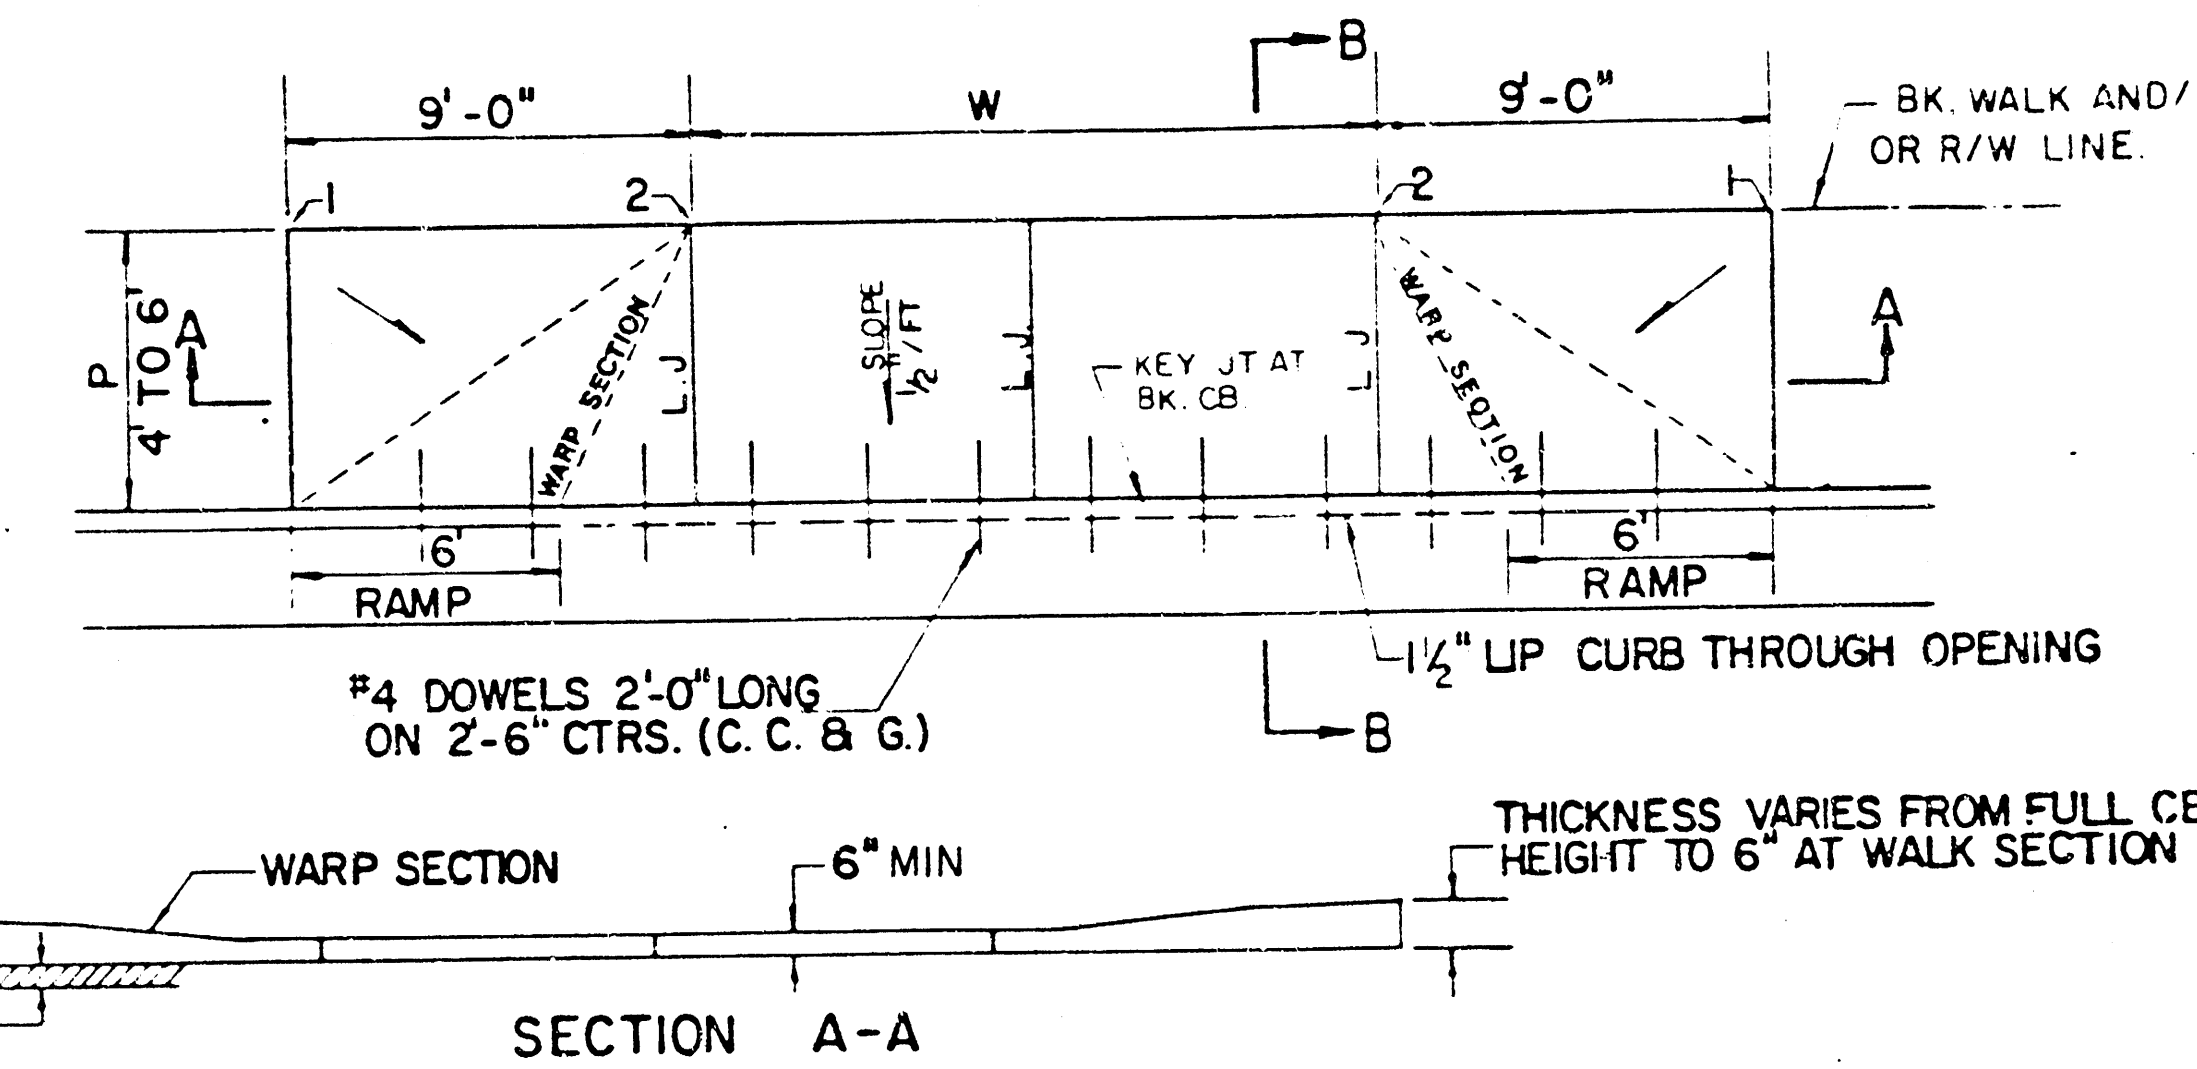

PARKING WIDTH "P"	4'	4.5'	5'	5.5'	6'	6.5'
DIST. OF PT. "T" ABOVE TOP OF FULL CB	0.08'	0.09'	0.10'	0.12'	0.13'	0.14'
DIST. OF PT. "T" BELOW TOP OF FULL CB	-0.26'	-0.24'	-0.22'	-0.20'	-0.18'	-0.16'

FULL RAMP DRIVE (P = 4.0' TO 6.5')



GENERAL NOTES

- DRIVEWAY CONSTRUCTION DETAILED ON THIS SHEET IS FOR USE WITH FULL HEIGHT STREET CURBS AND IN AREAS WITHOUT FULL WALK CONSTRUCTION IN THE PARKING. SEE OTHER DETAIL SHEETS FOR DRIVEWAY CONSTRUCTION WITH ROLL CURB AND/OR FULL WALK.
- ONE LONGITUDINAL JOINT SHALL BE CONSTRUCTED ALONG THE CENTERLINE OF DRIVES HAVING A "W" DIMENSION OF 24' OR LESS. TWO LONGITUDINAL JOINTS SHALL BE CONSTRUCTED WITH EQUAL SPACINGS NOT TO EXCEED 10' FOR DRIVES WITH A "W" DIMENSION GREATER THAN 24'.
- DRIVEWAY WIDTH DENOTED AS "W" ON THE DETAIL DRAWINGS SHALL BE A MINIMUM OF 10' AND A MAXIMUM OF 30'. THE MAXIMUM OPENING FOR RADIUS TYPE DRIVES WITH CURBS THROUGH THE RADIUS SHALL NOT EXCEED 52' AT THE STREET CURB LINE.
- CONSTRUCTION JOINT SPACING IN THE DRIVEWAY WALK SECTION SHALL BE A MINIMUM OF 3' AND A MAXIMUM OF 6' AND ARE TO BE EQUALLY SPACED WITHIN THIS RANGE. WALK SECTION SHALL BE CONSTRUCTED TO THE SAME THICKNESS AS THE DRIVEWAY.
- DOEL BARS SHALL BE OMITTED FROM THE KEVED CONSTRUCTION JOINT ALONG THE BACK OF THE STREET CURB LINE WHEN DRIVEWAYS ARE CONSTRUCTED IN CONJUNCTION WITH NEW CONCRETE PAVEMENT CONSTRUCTION.
- ADDITIONAL THICKNESS OF DRIVE AS INDICATED IN THE DRAWINGS WILL NOT BE PAID FOR DIRECTLY AND THIS COST SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE DRIVEWAY CONSTRUCTION.
- ONE HALF INCH EXPANSION JOINTS SHALL BE INSTALLED WHEREVER DRIVE CONSTRUCTION ABUTS SIDEWALK. ONE HALF INCH EXPANSION JOINTS SHALL ALSO BE INSTALLED ALONG THE PROPERTY LINE AND/OR BACK OF WALK LINE WHEN DRIVE CONSTRUCTION ALONG THIS LINE ABUTS CONCRETE PARKING LOTS OR CONCRETE DRIVE EXTENSION.
- ALL DRIVEWAYS SHALL BE A MINIMUM OF 6" IN THICKNESS AND SHALL BE WITHOUT REINFORCEMENT. DRIVEWAYS MAY BE CONSTRUCTED THICKER THAN 6" AND THEY MAY BE REINFORCED WITH #4-12" W-14" HELDED WIRE FABRIC WHEN PROPERLY AUTHORIZED BY THE PROPERTY OWNER WITH THE ENGINEER'S CONFORMANCE.
- OPTIMUM DRIVEWAY ELEVATIONS SHOWN IN THE TABLES ARE TO BE USED WHEREVER POSSIBLE. ABSOLUTE MAXIMUM AND MINIMUM ELEVATIONS ARE TO BE USED ONLY WHEN THESE VALUES WILL PERMIT NEW CONSTRUCTION TO MATCH EXISTING DRIVES OR PARKING LOTS. VALUES SHOWN IN THE TABLES ARE BASED ON A FULL CURB HEIGHT ELEVATION OF 0.55' ABOVE THE GUTTER FLOW LINE AND MUST BE ADJUSTED ACCORDINGLY FOR OTHER CURB HEIGHTS. VALUES SHOWN IN THE TABLES WITH MINUS SIGNS INDICATE ELEVATIONS BELOW TOP OF FULL HEIGHT CURB.


SCALE: 1" = 5'

STANDARD DRIVE ENTRANCES
FULL HEIGHT CURB
CITY OF WICHITA, KANSAS

PROJECT NUMBER
472 76 245 81413 000 000 001

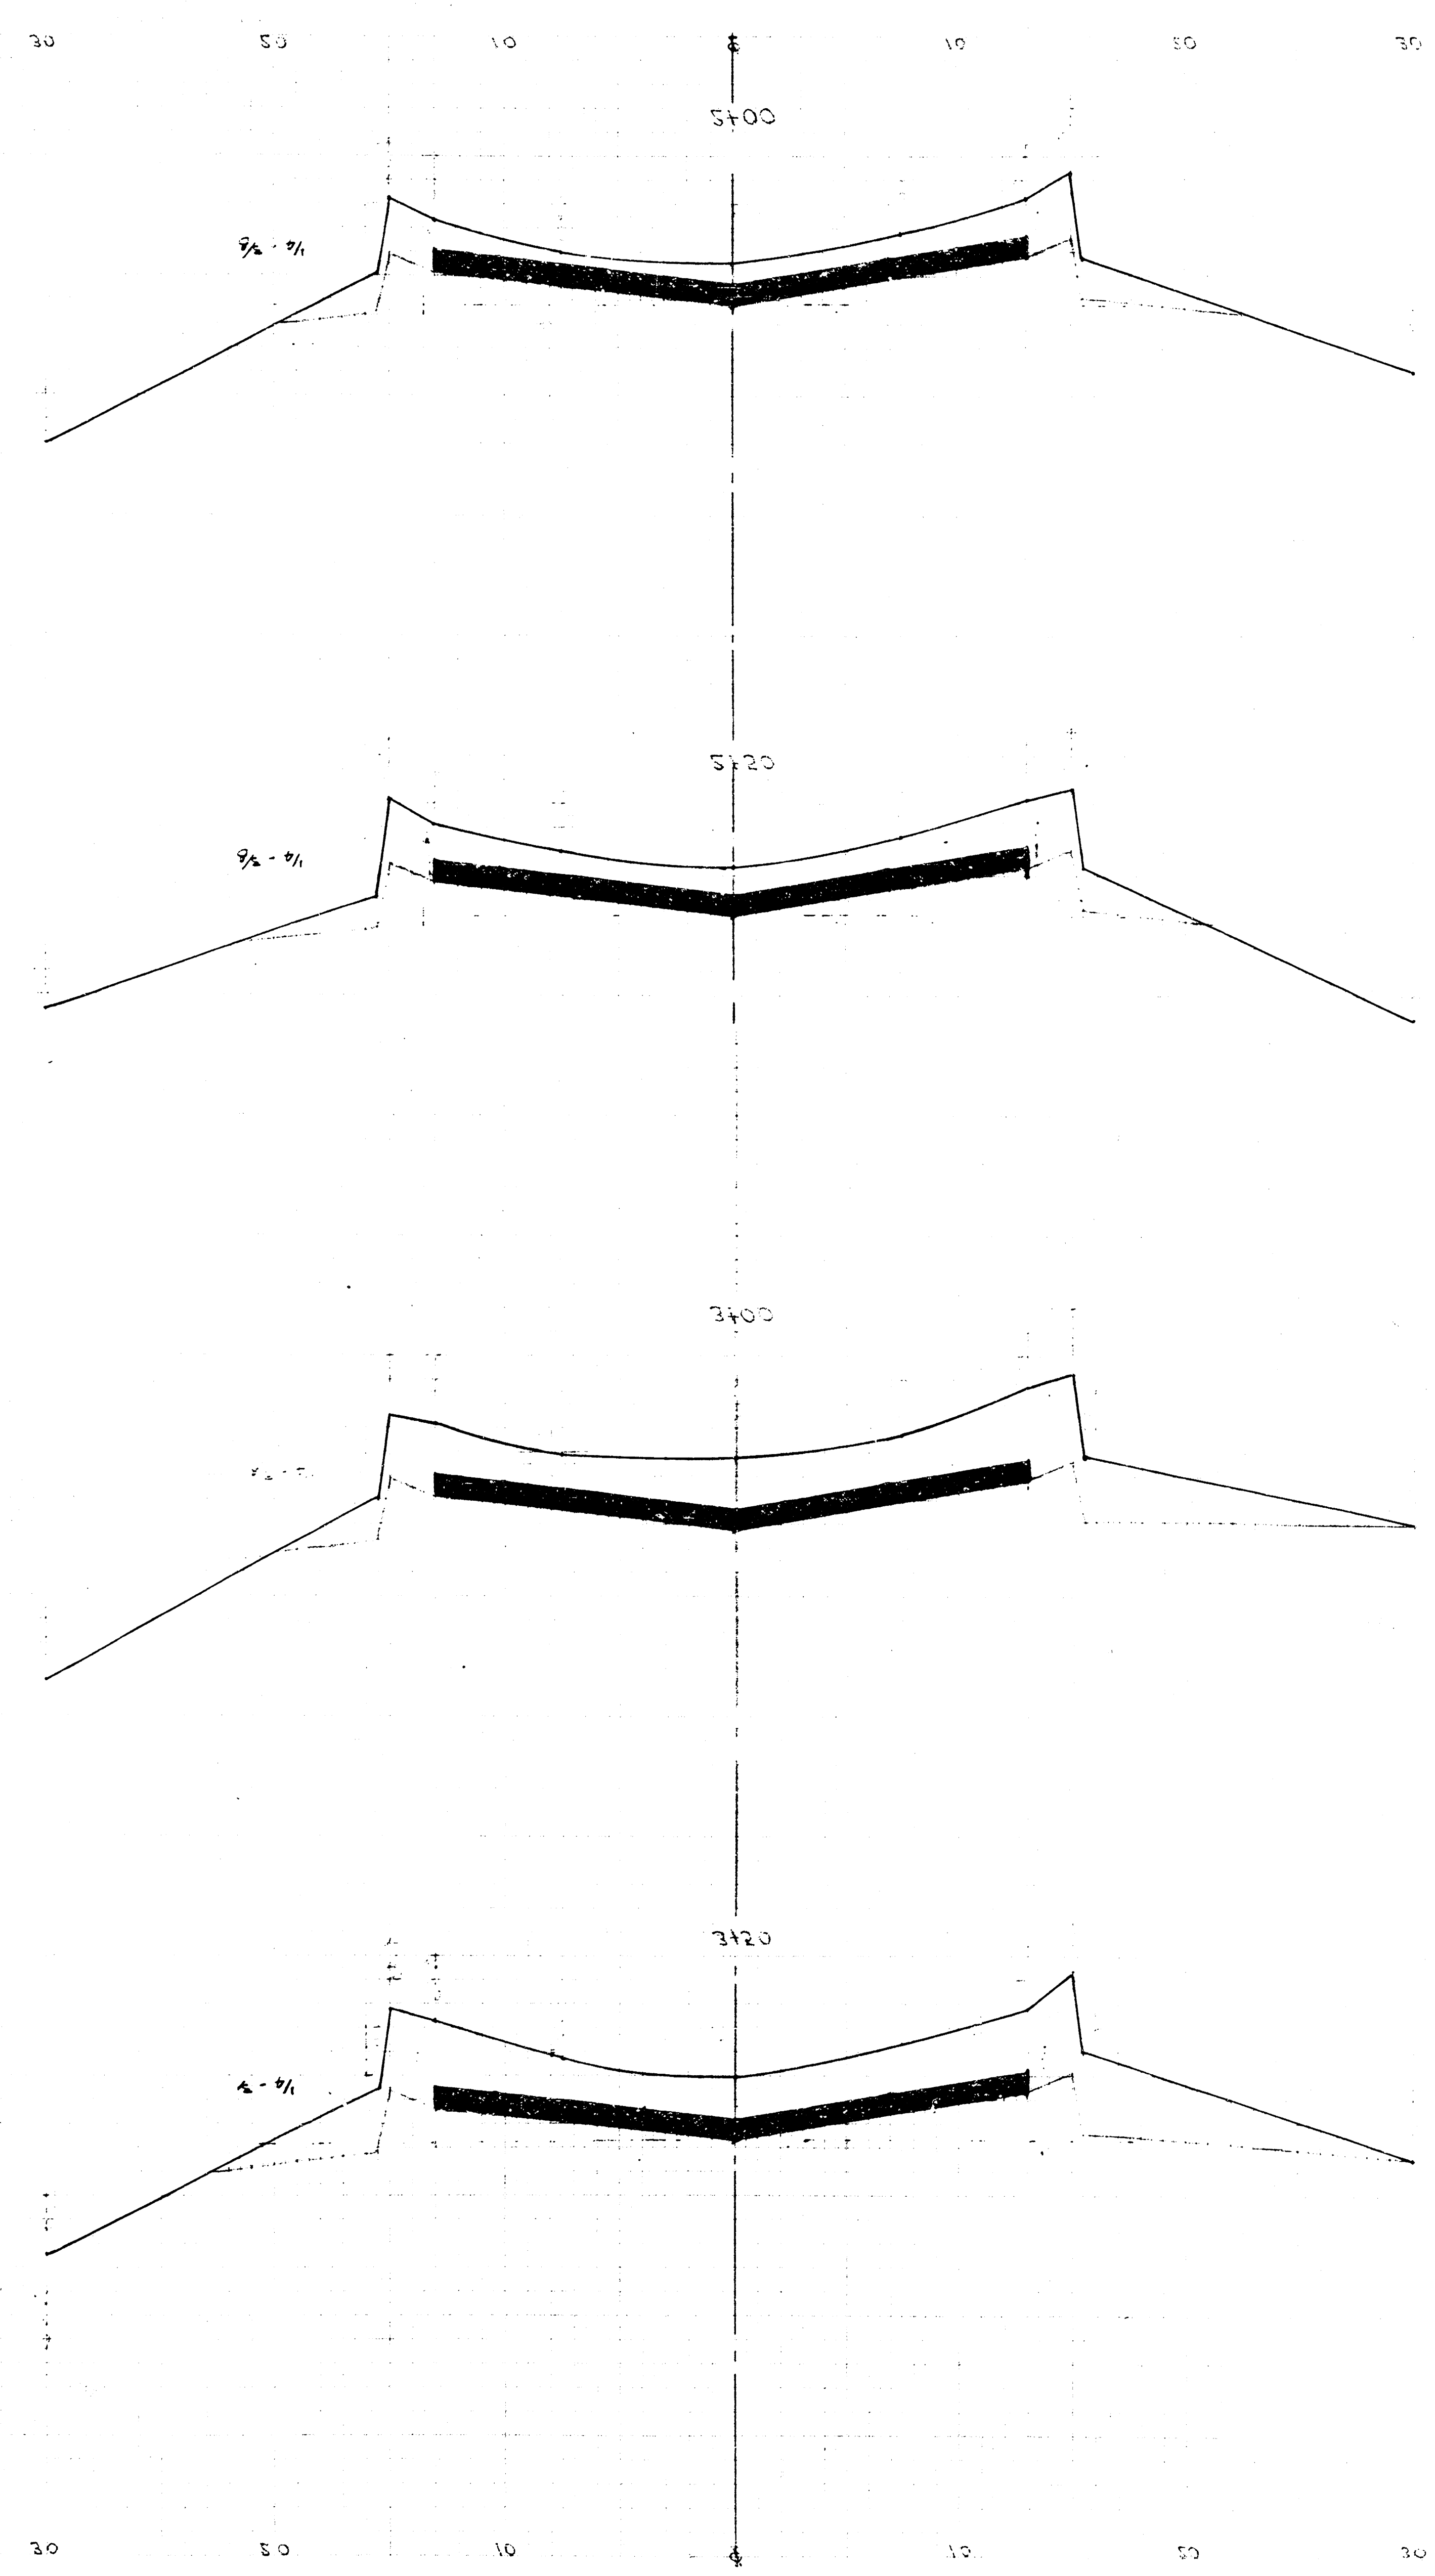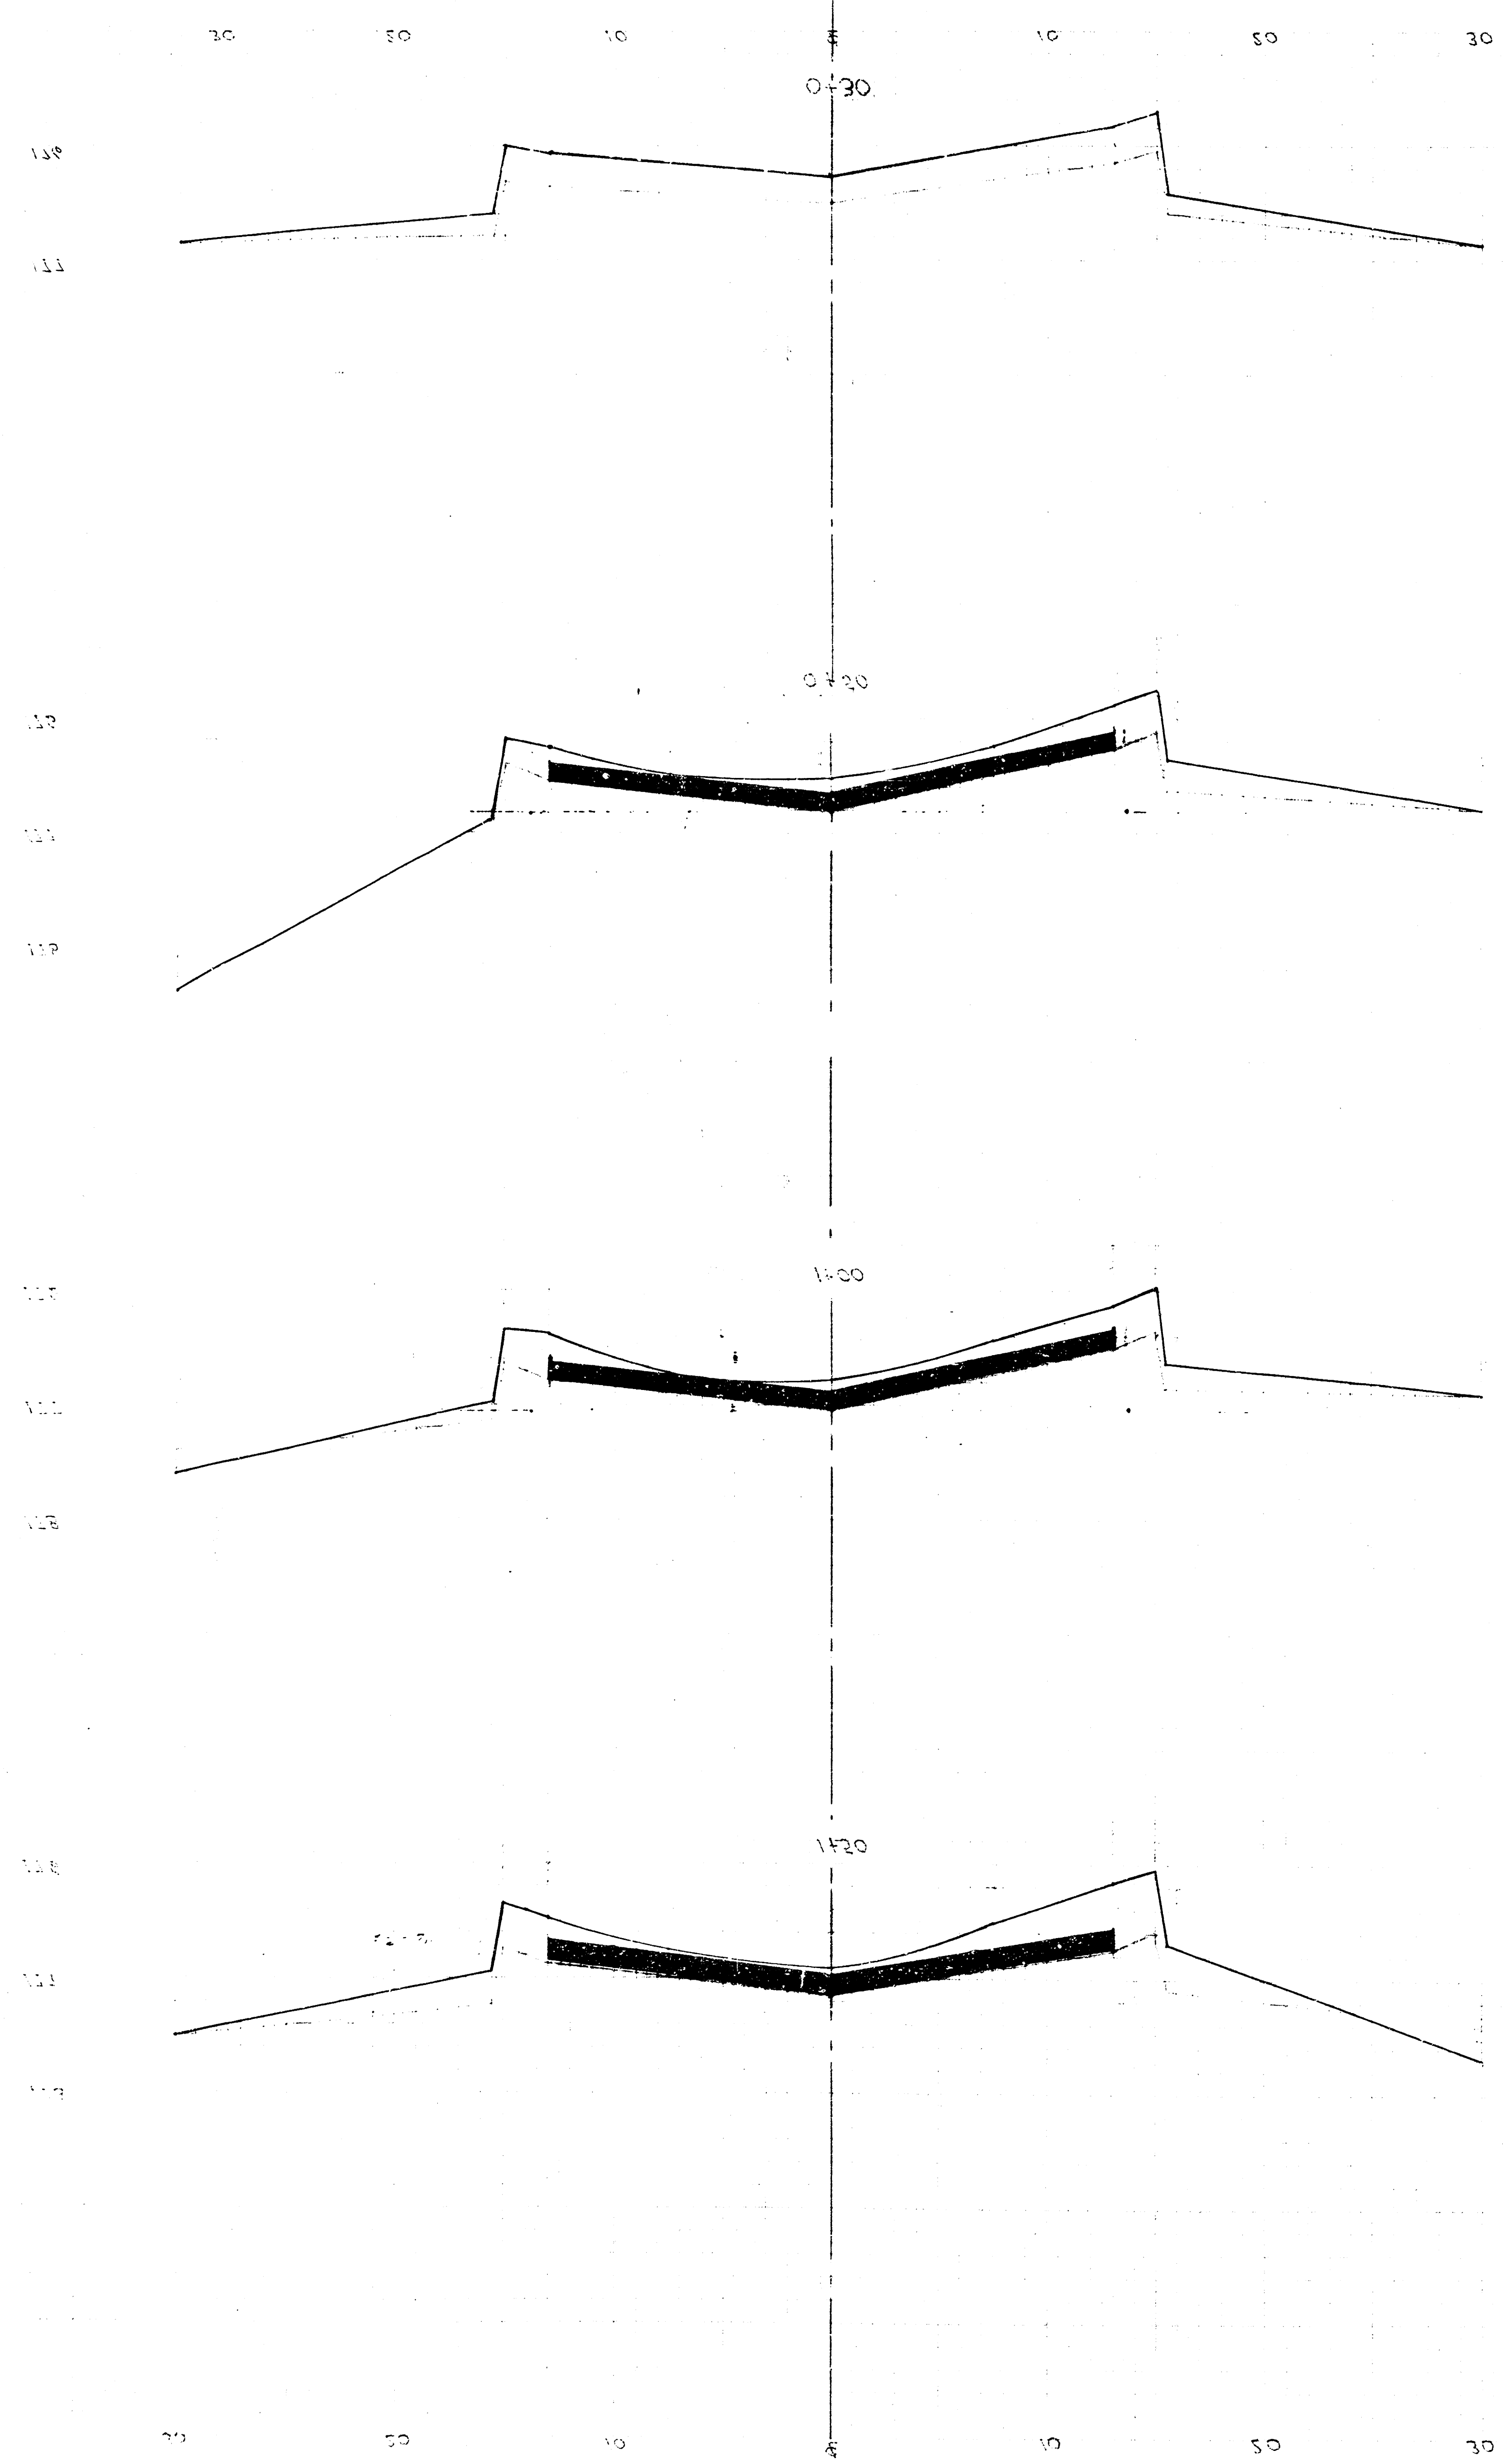

0+15 0+20 1+00 1+20

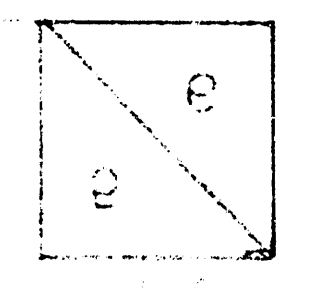

0+15 0+20 1+00 1+20

