

CONTINENTAL VILLAGE MARINA

LITTLE ARKANSAS RIVER
WICHITA, KANSAS


INDEX OF SHEETS
SHEET
1. TITLE SHEET
2. MARINA SITE PLAN
3. EROSION
4. DETAILS

FOR

JACK P. DE BOER ASSOCIATES, INC.
240 NORTH ROCK ROAD
P.O. BOX 18387
WICHITA, KANSAS 67218


McCALEB ENGINEERING

116 SOUTH BROADWAY
EDMOND, OKLAHOMA

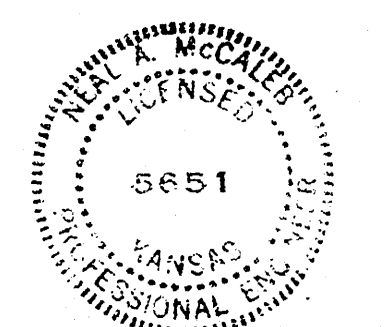
Neal A. McCaleb
NEAL A. McCaleb ENG. REG. NO. 5651










Revised

NOV 12 1970

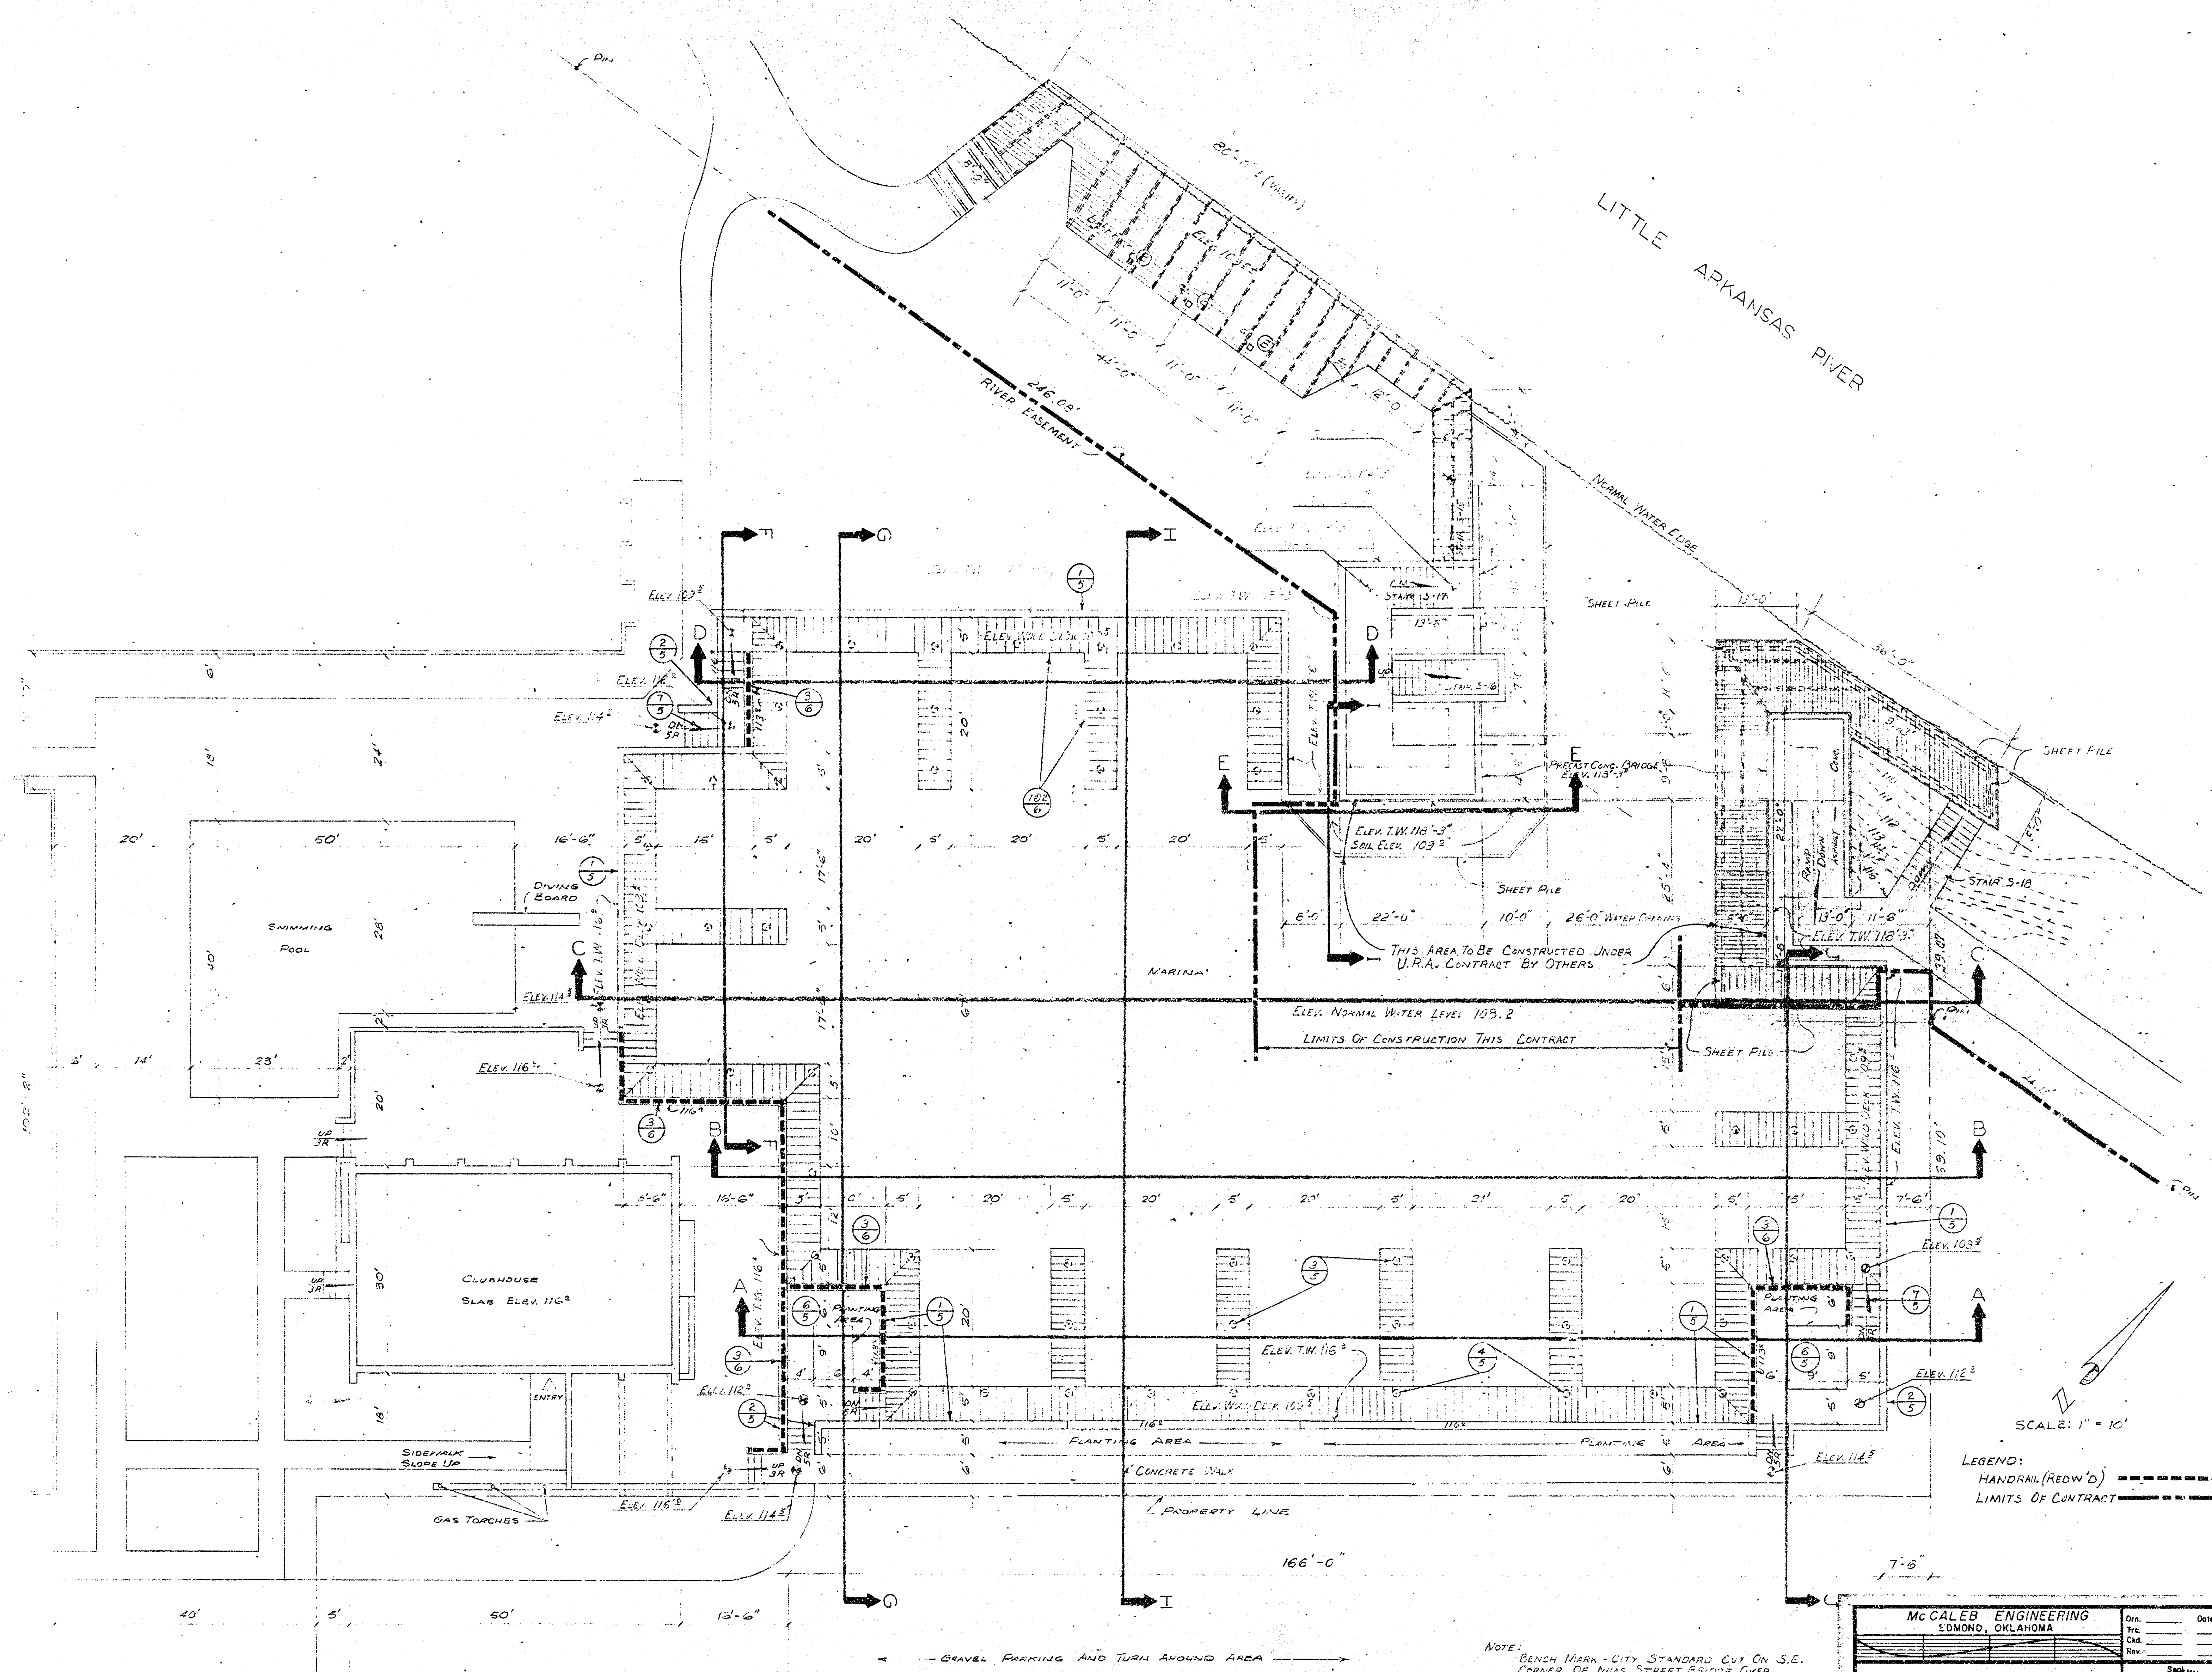

NOTE: BENCH MARK - CITY STANDARD CUT ON S.E. CORNER OF NIMS STREET BRIDGE OVER RIVER ON NIMS STREET. ELEV. 118.415


McCaleb Engineering Edmond, Oklahoma		Dwn. Tye CNA Rev.	Date
CONTINENTAL VILLAGE MARINA SITE PLAN			
Sheet No. 2 of 6		NOV 12 1970	

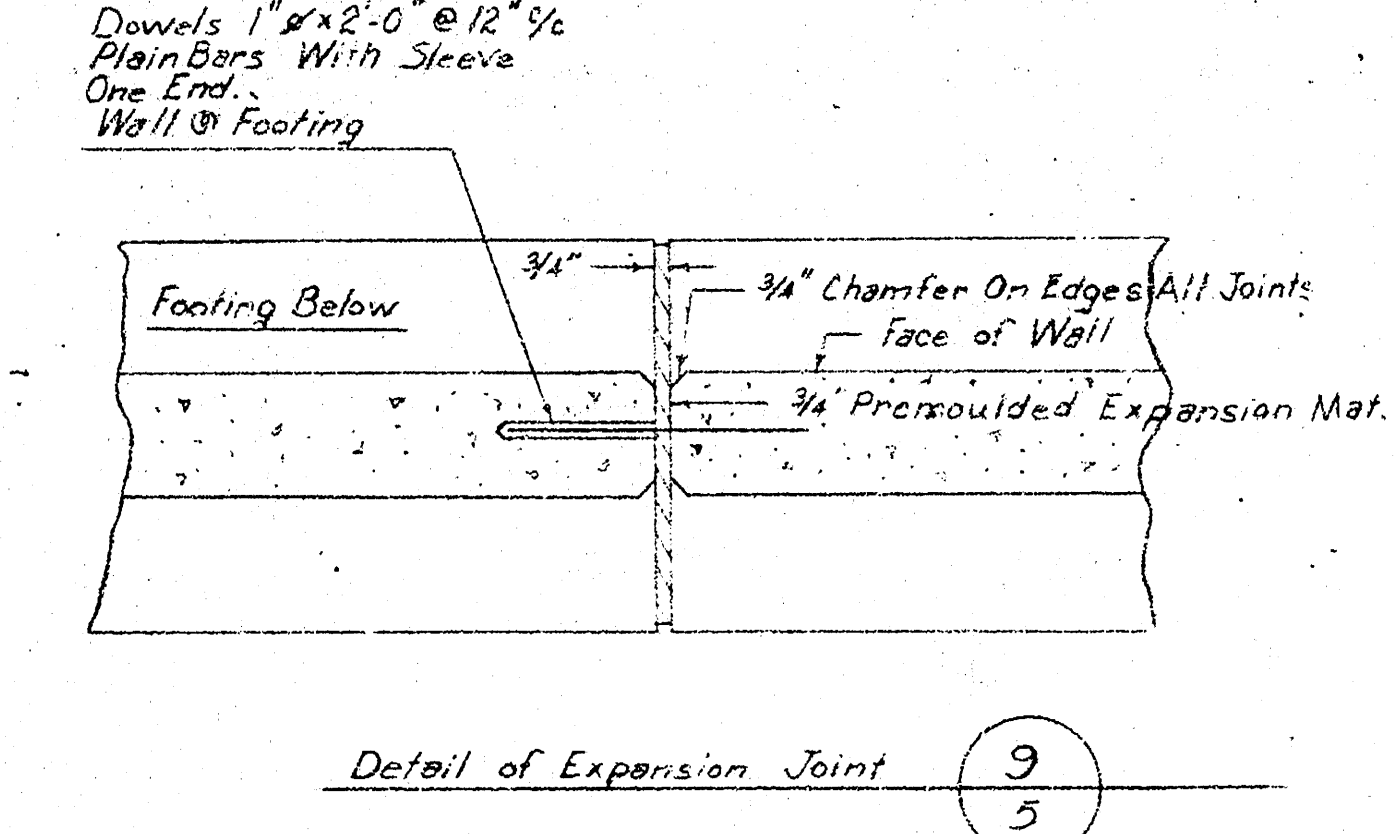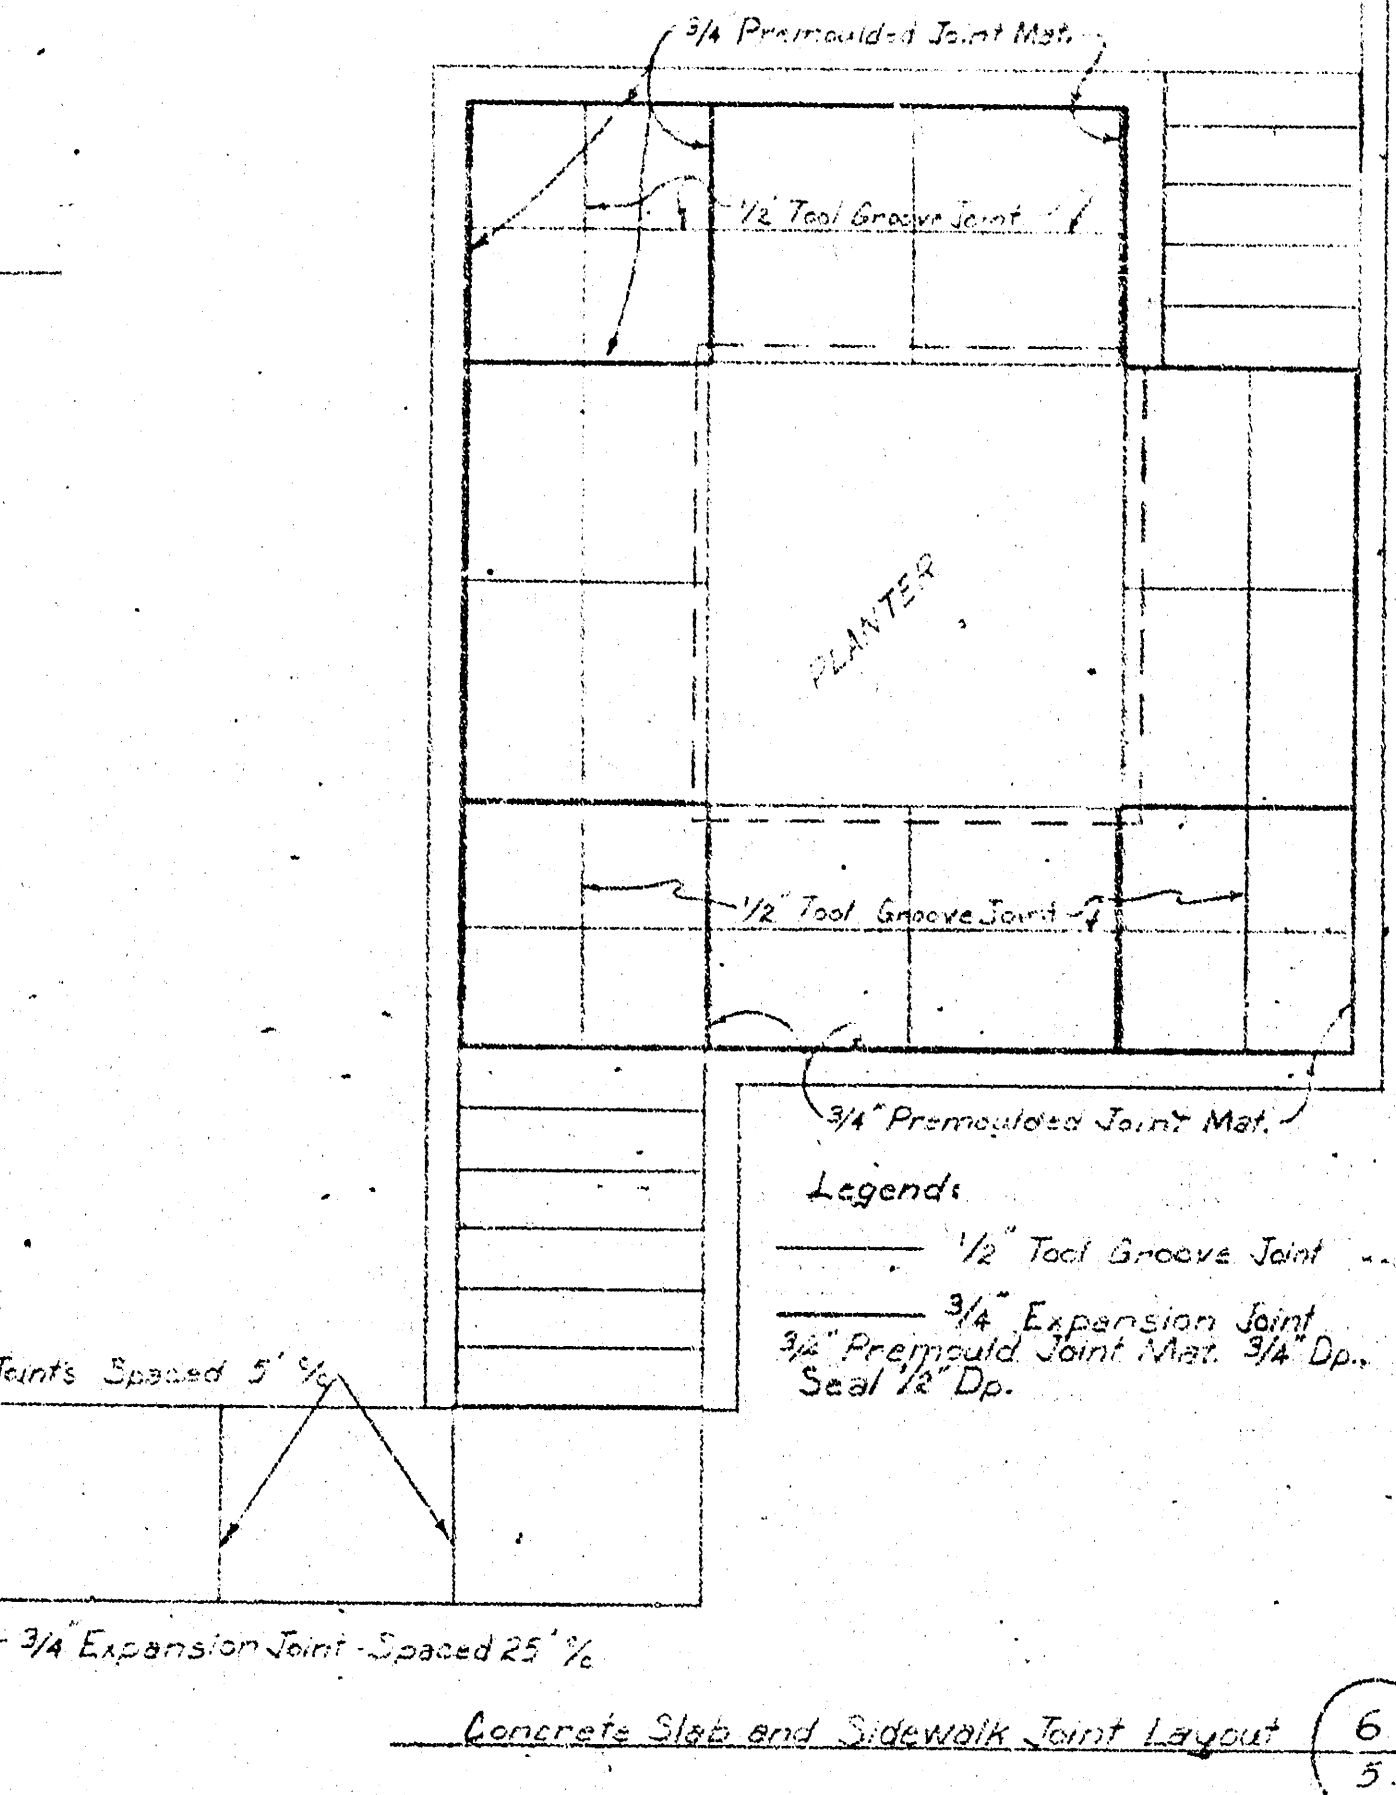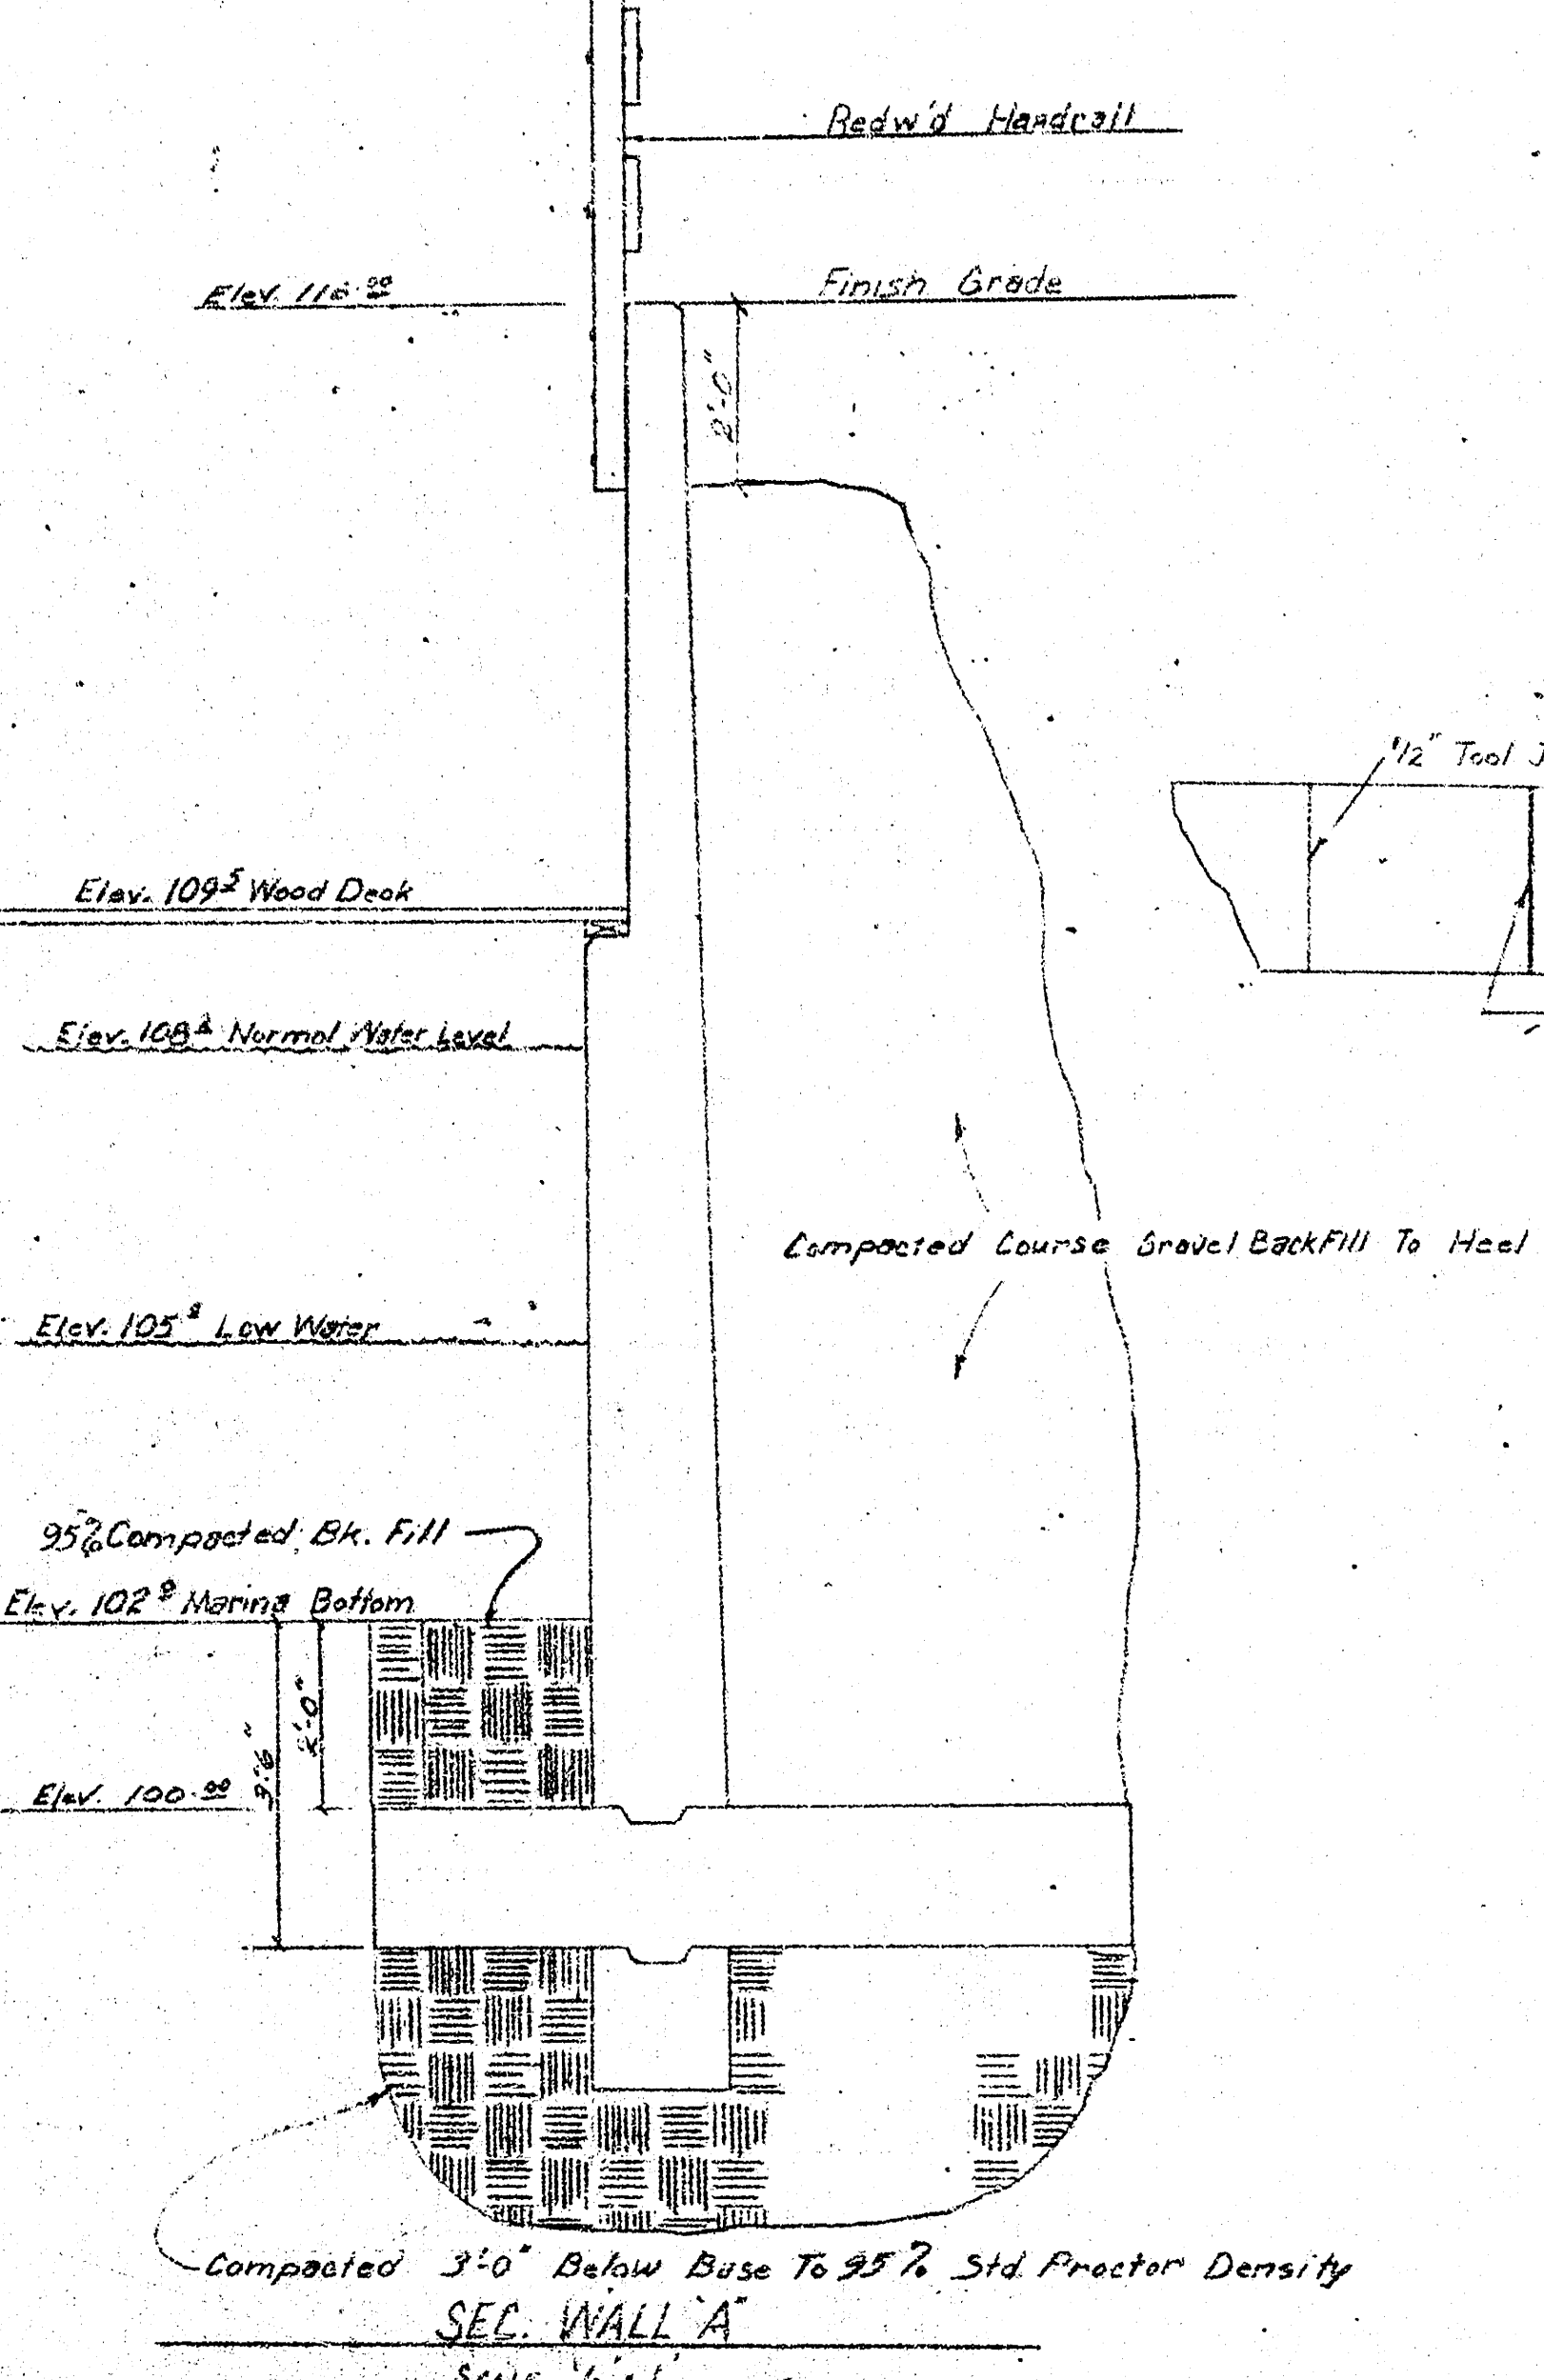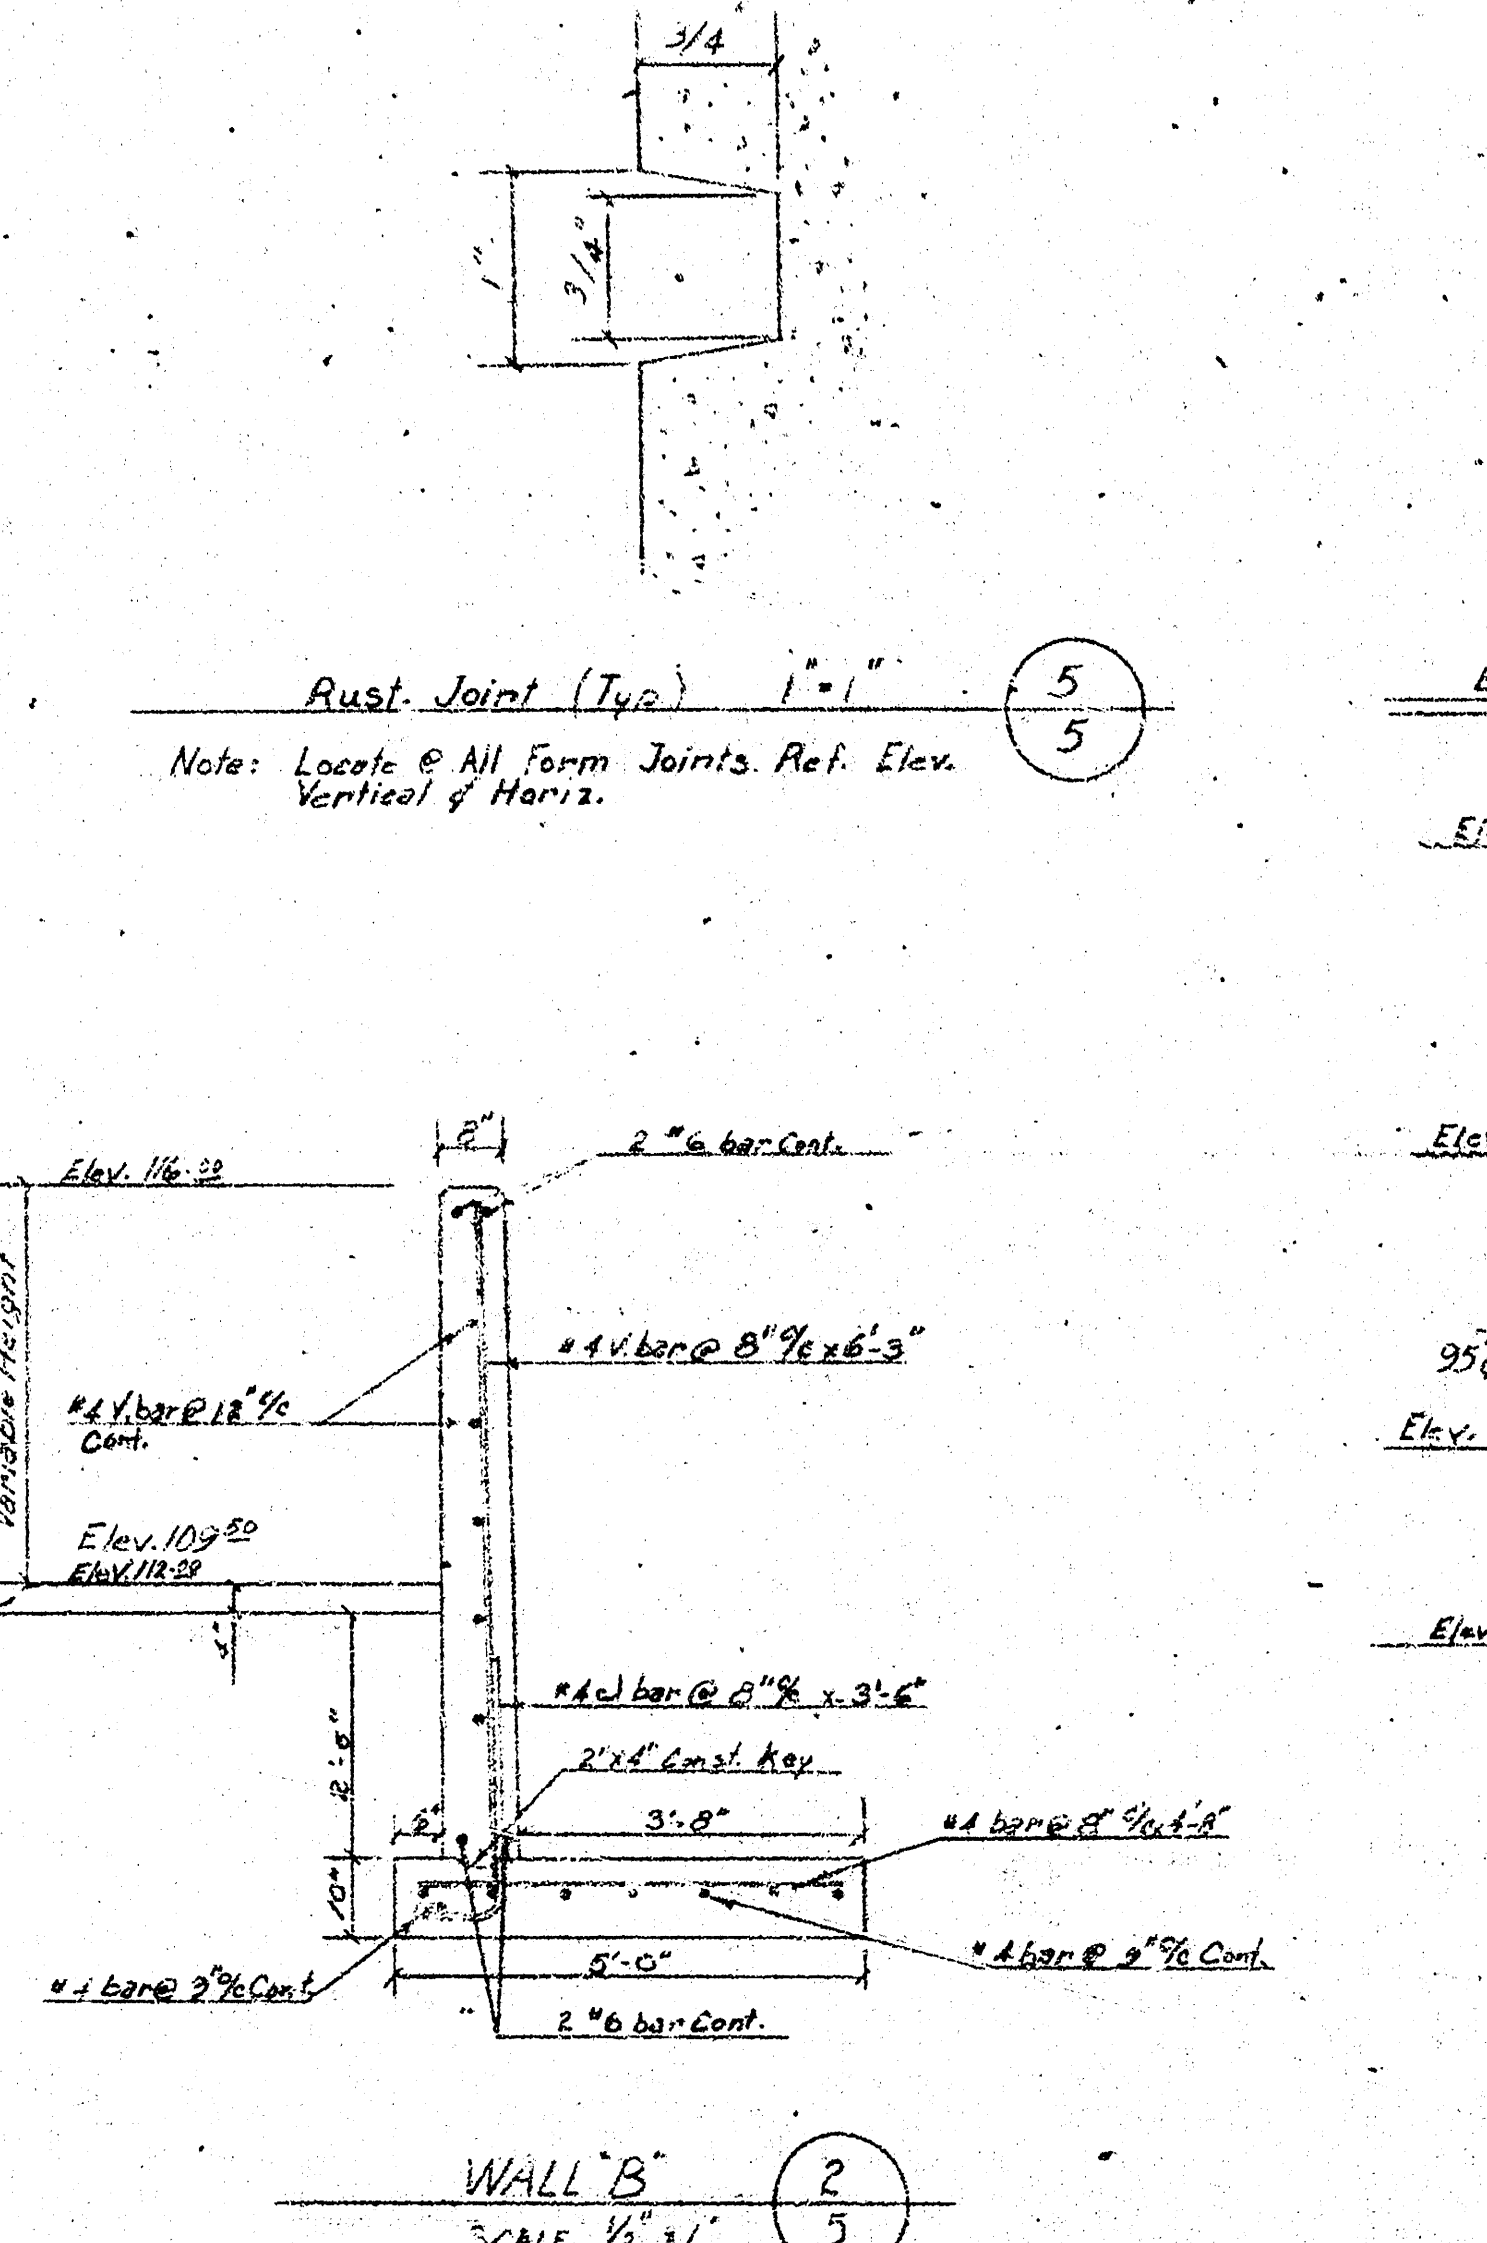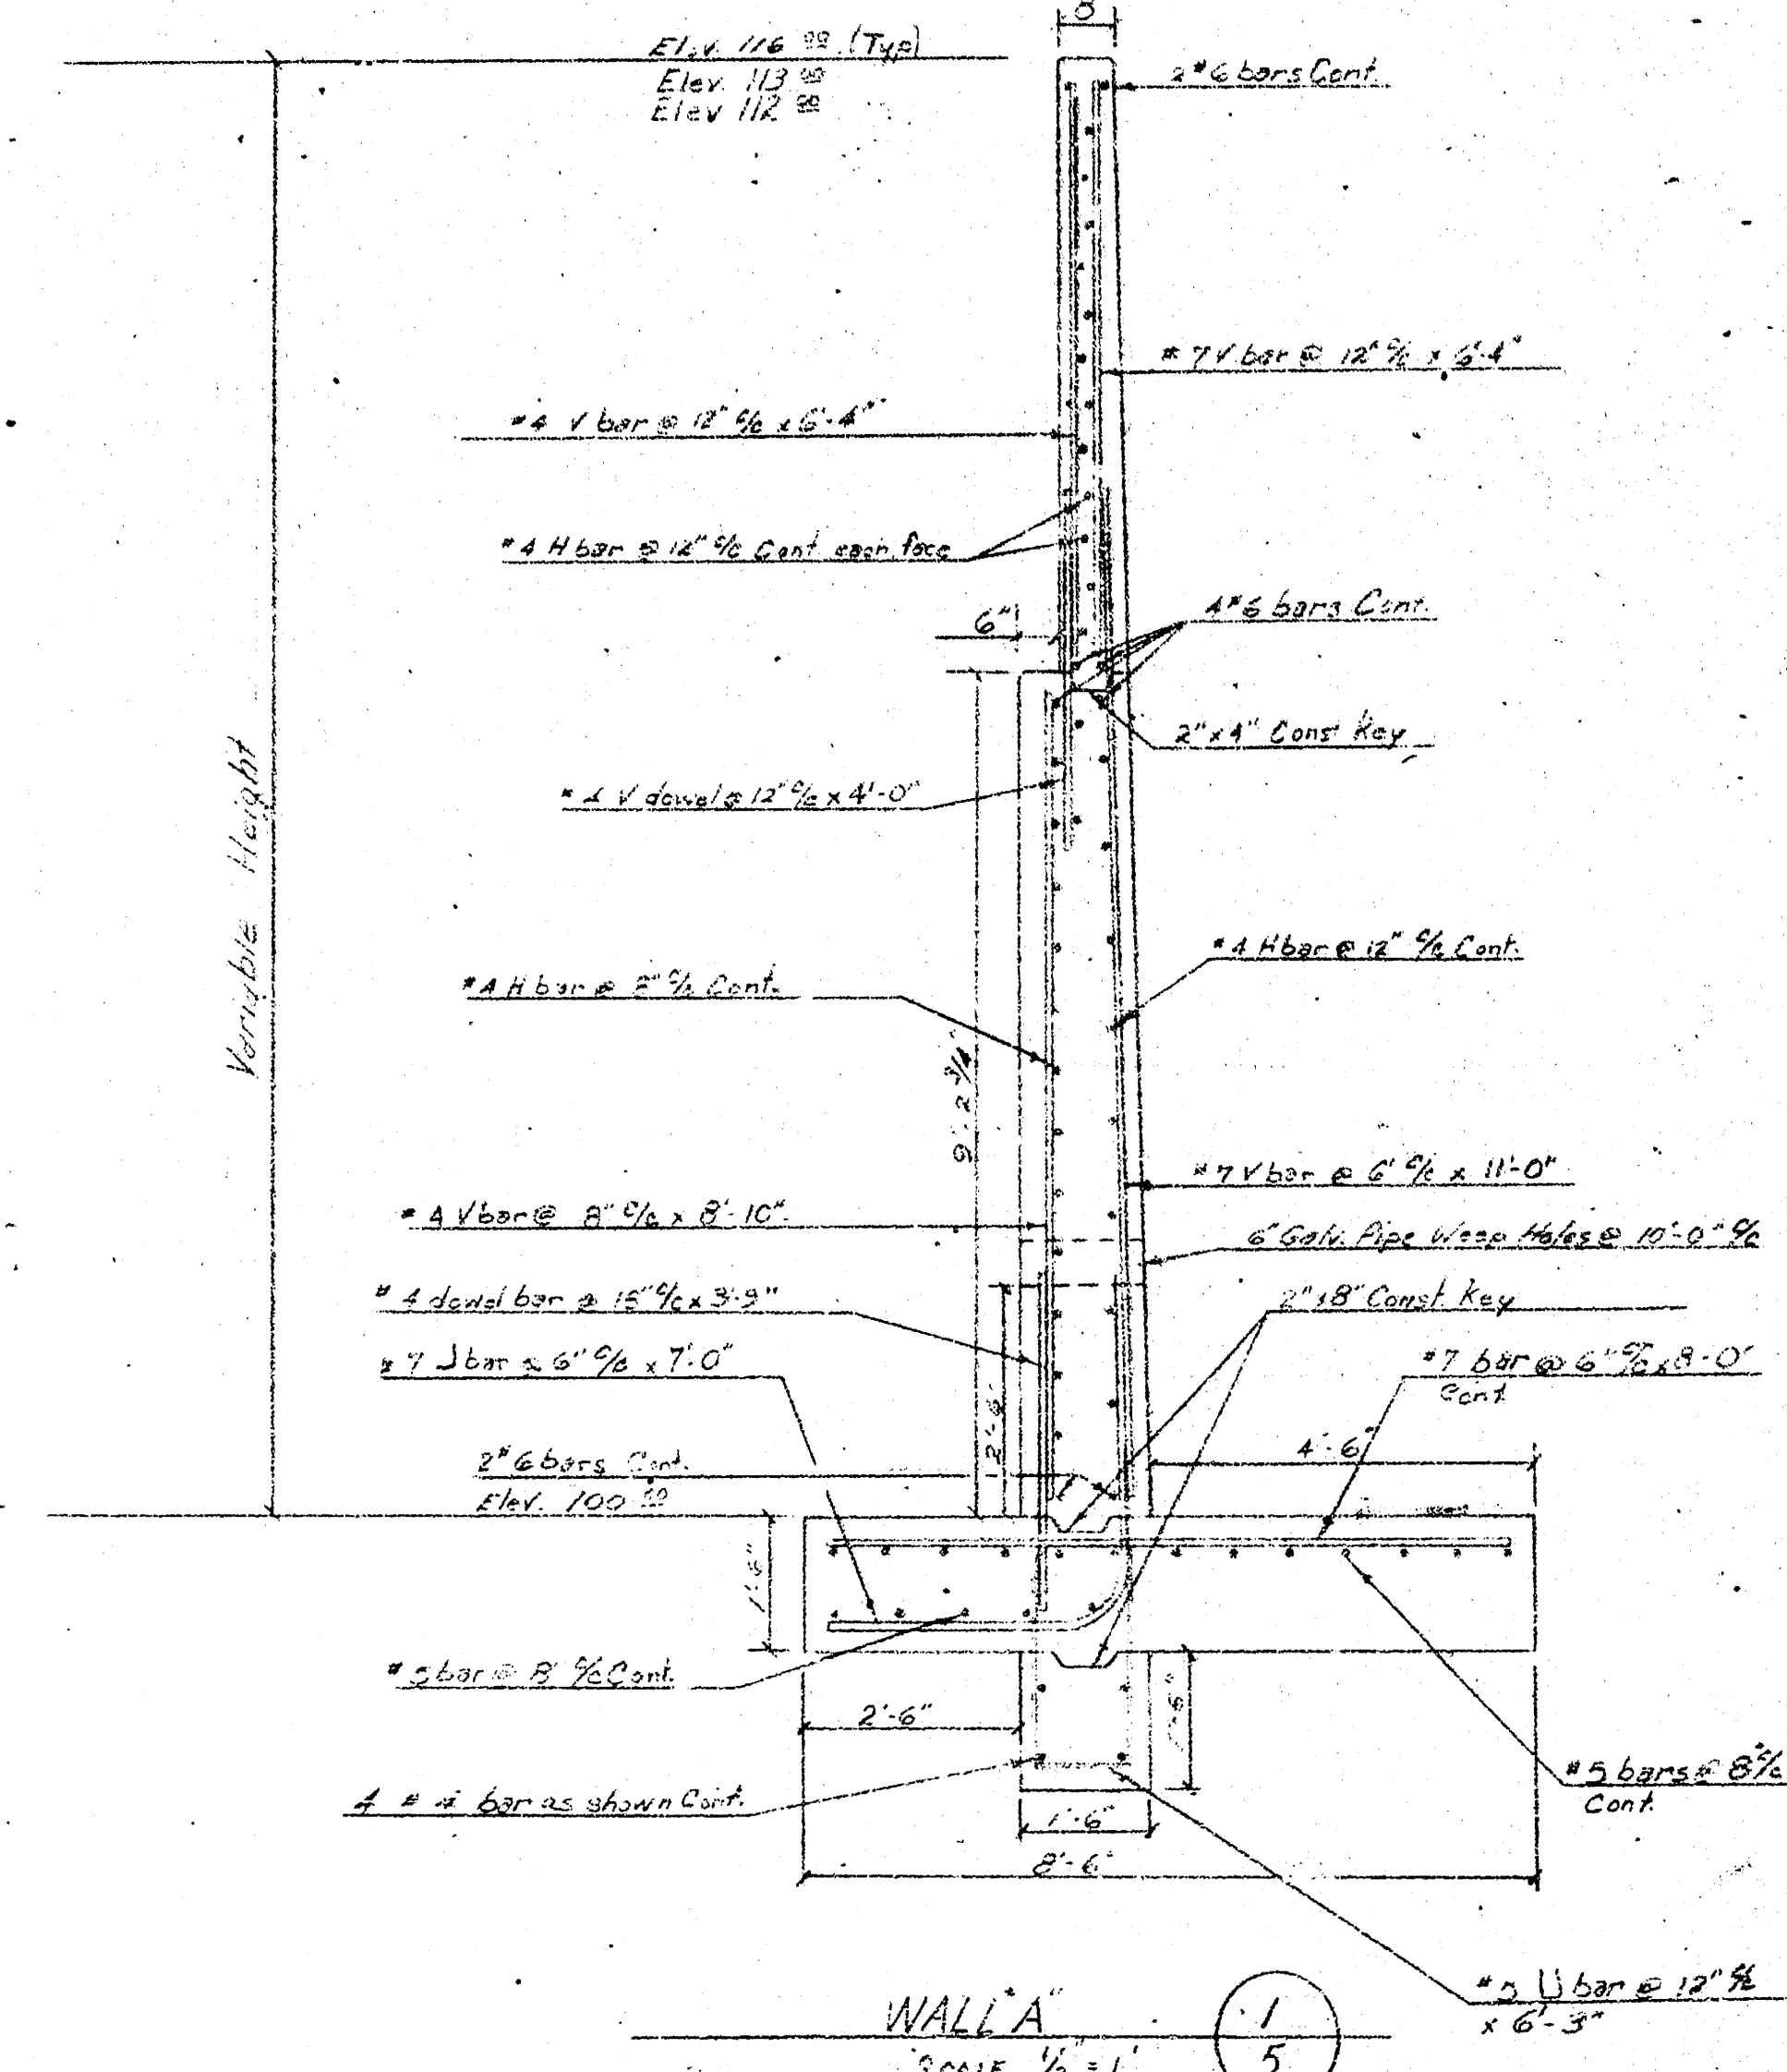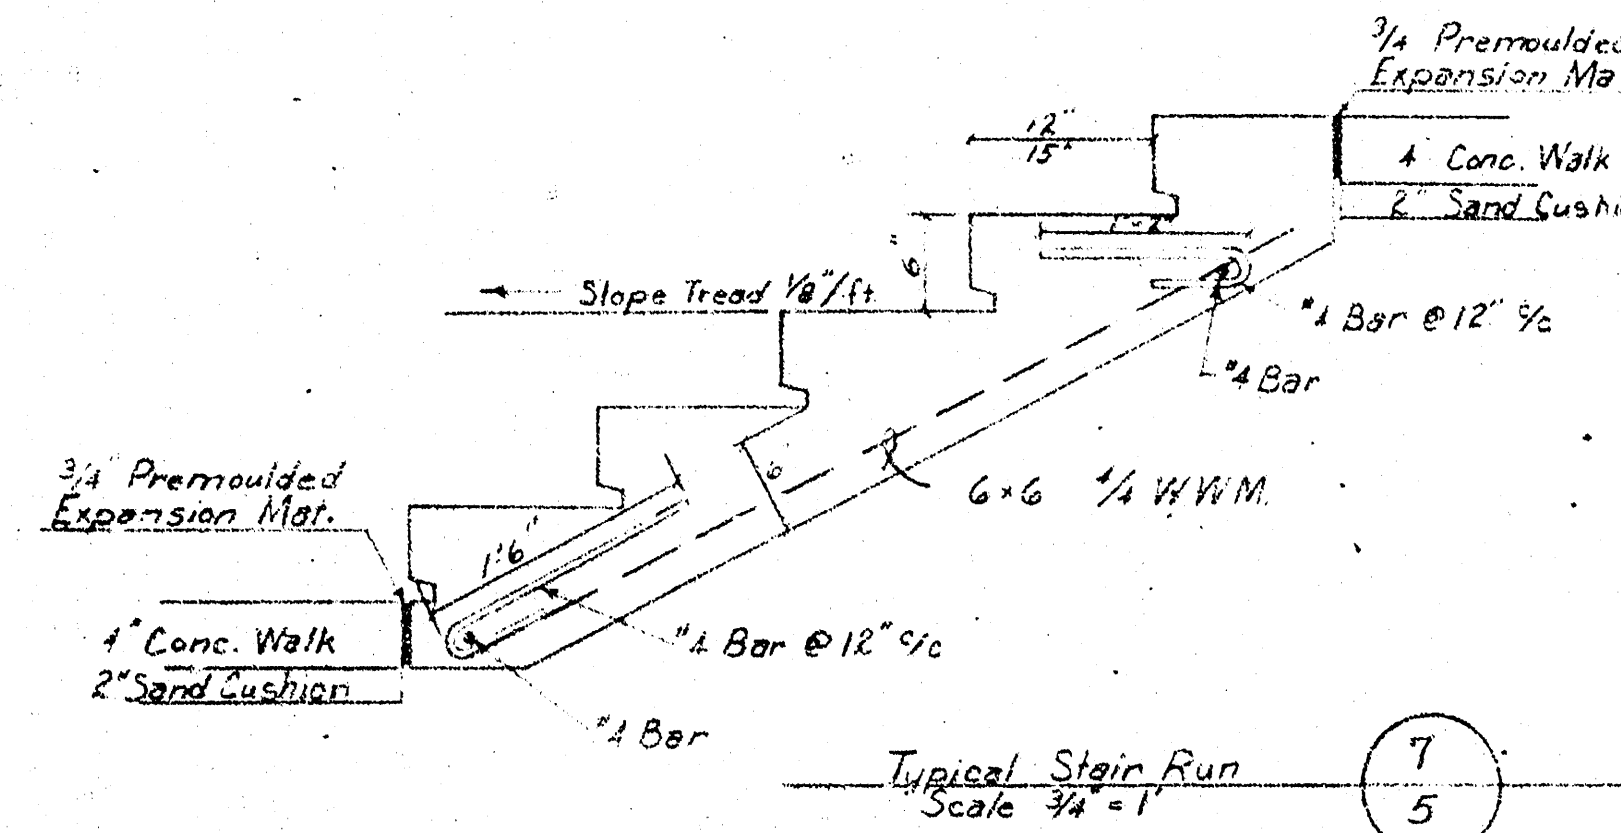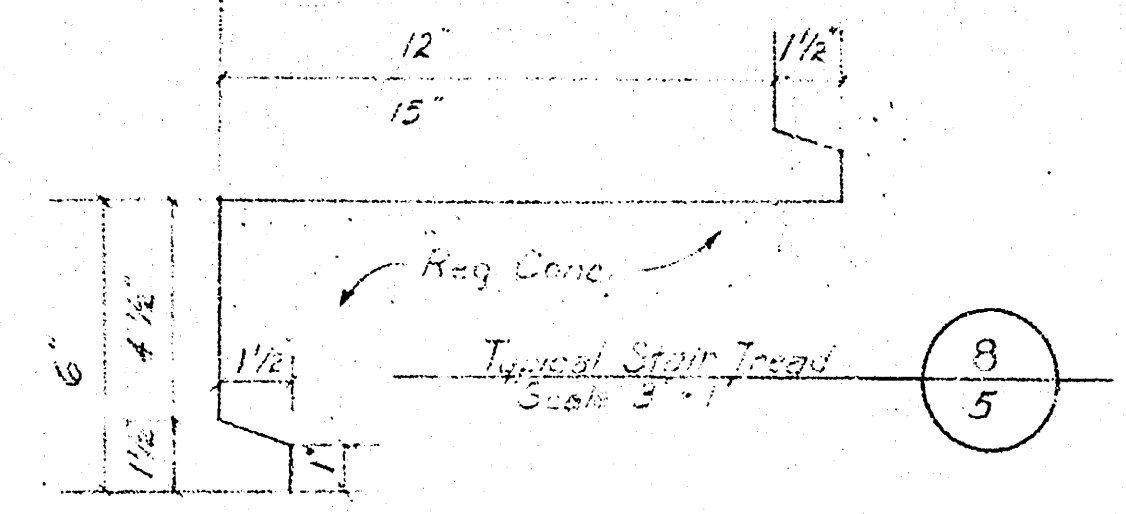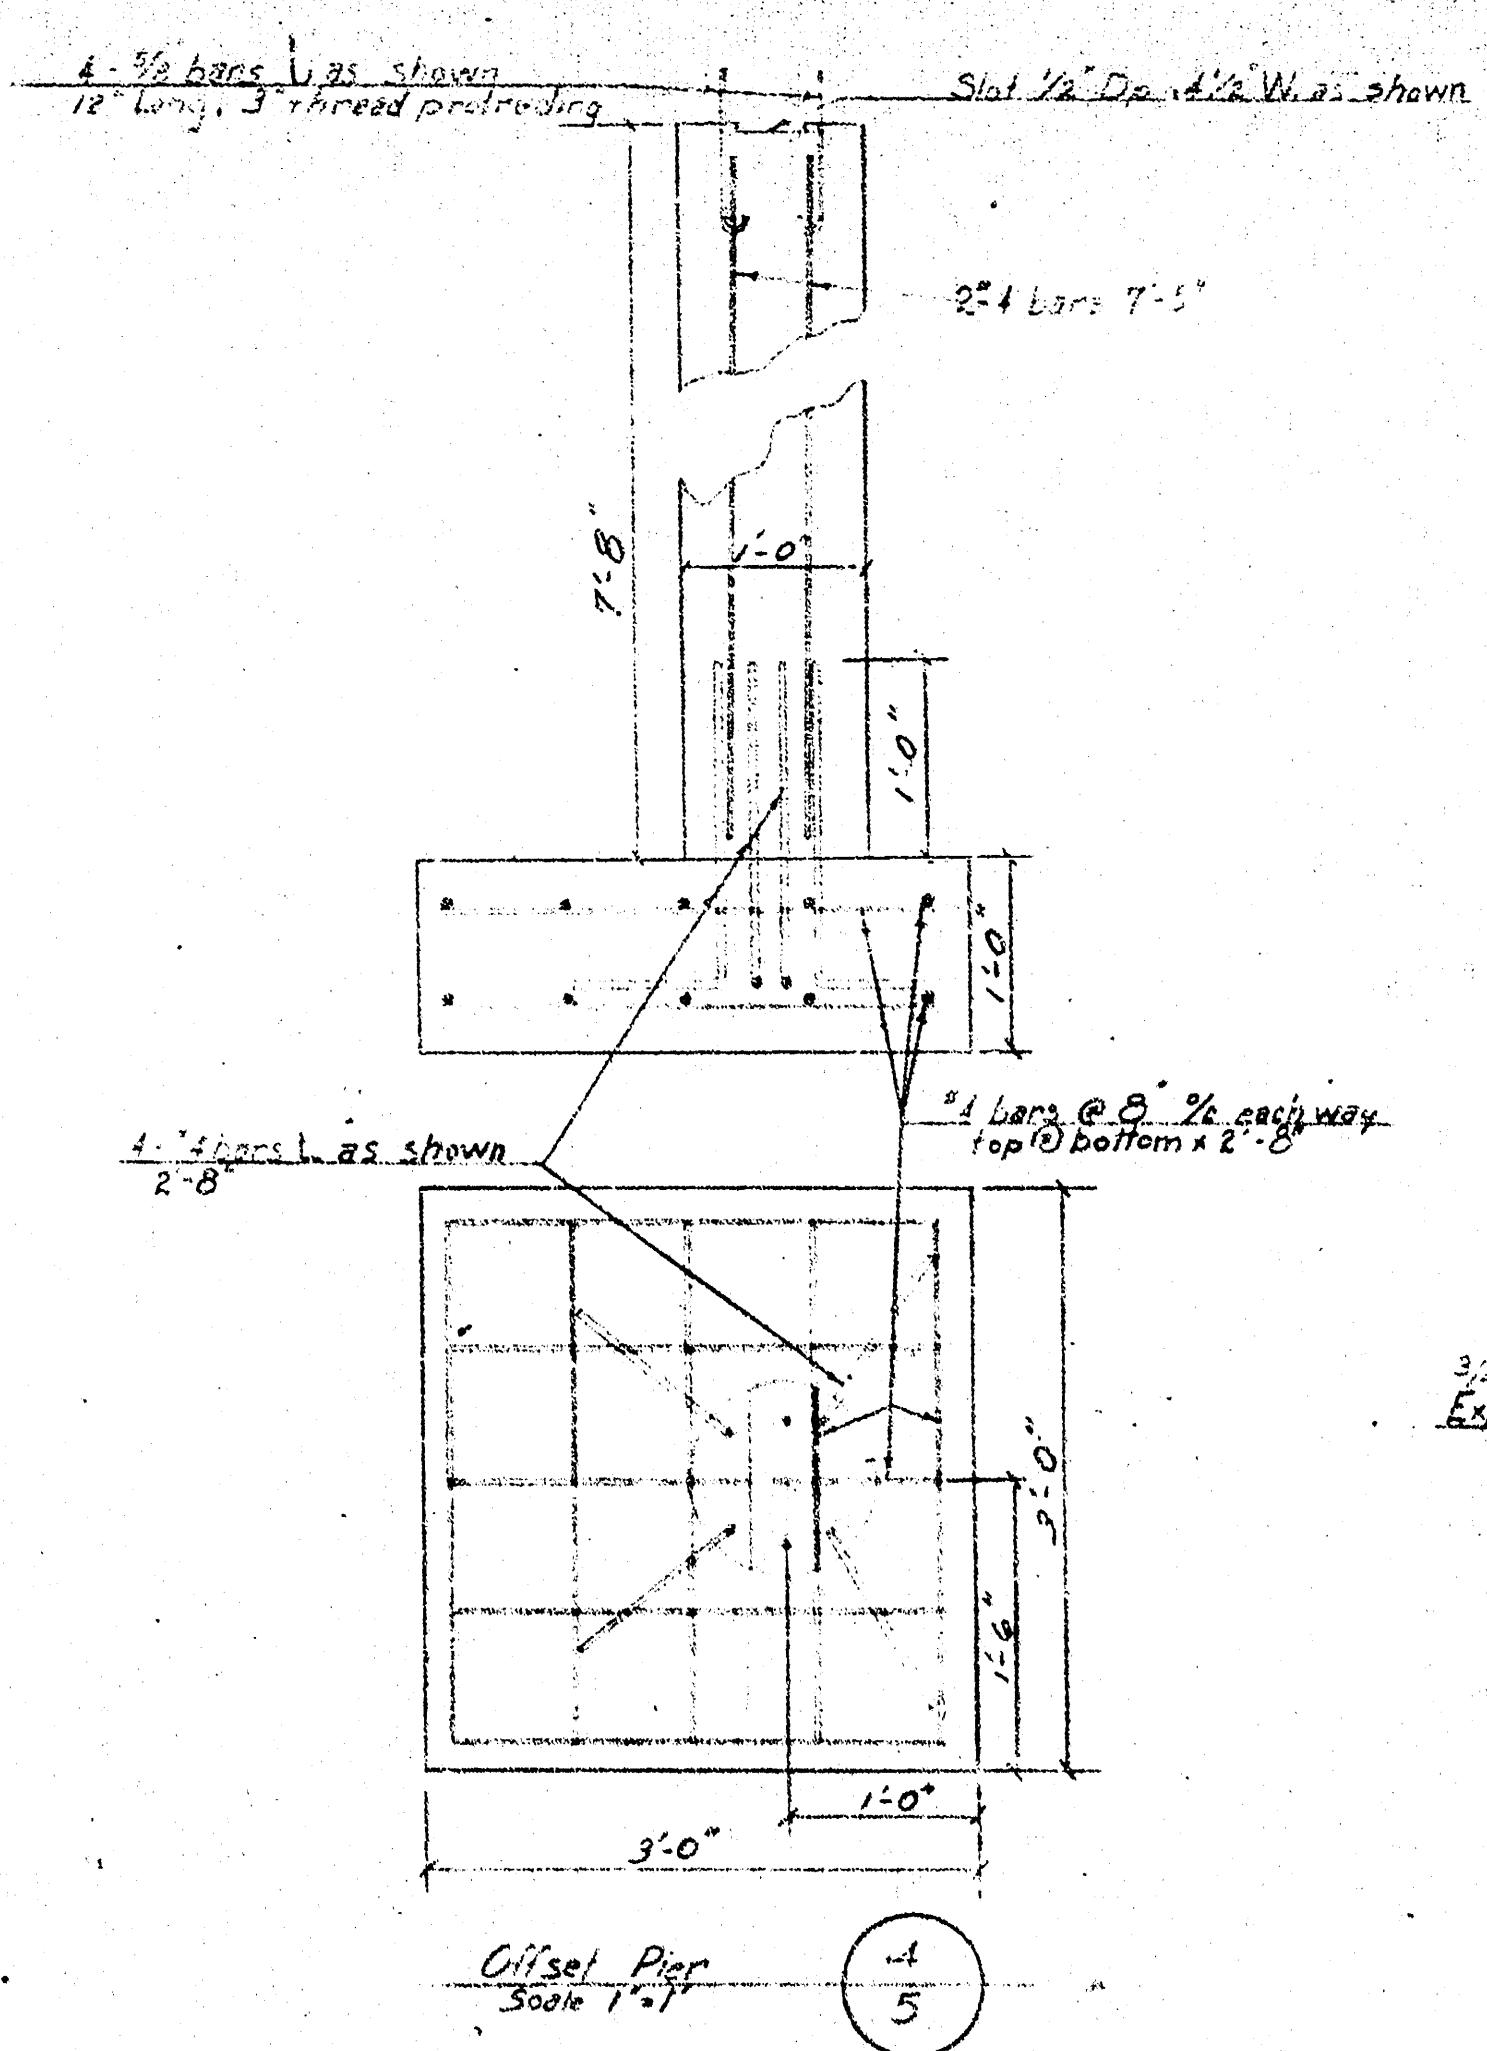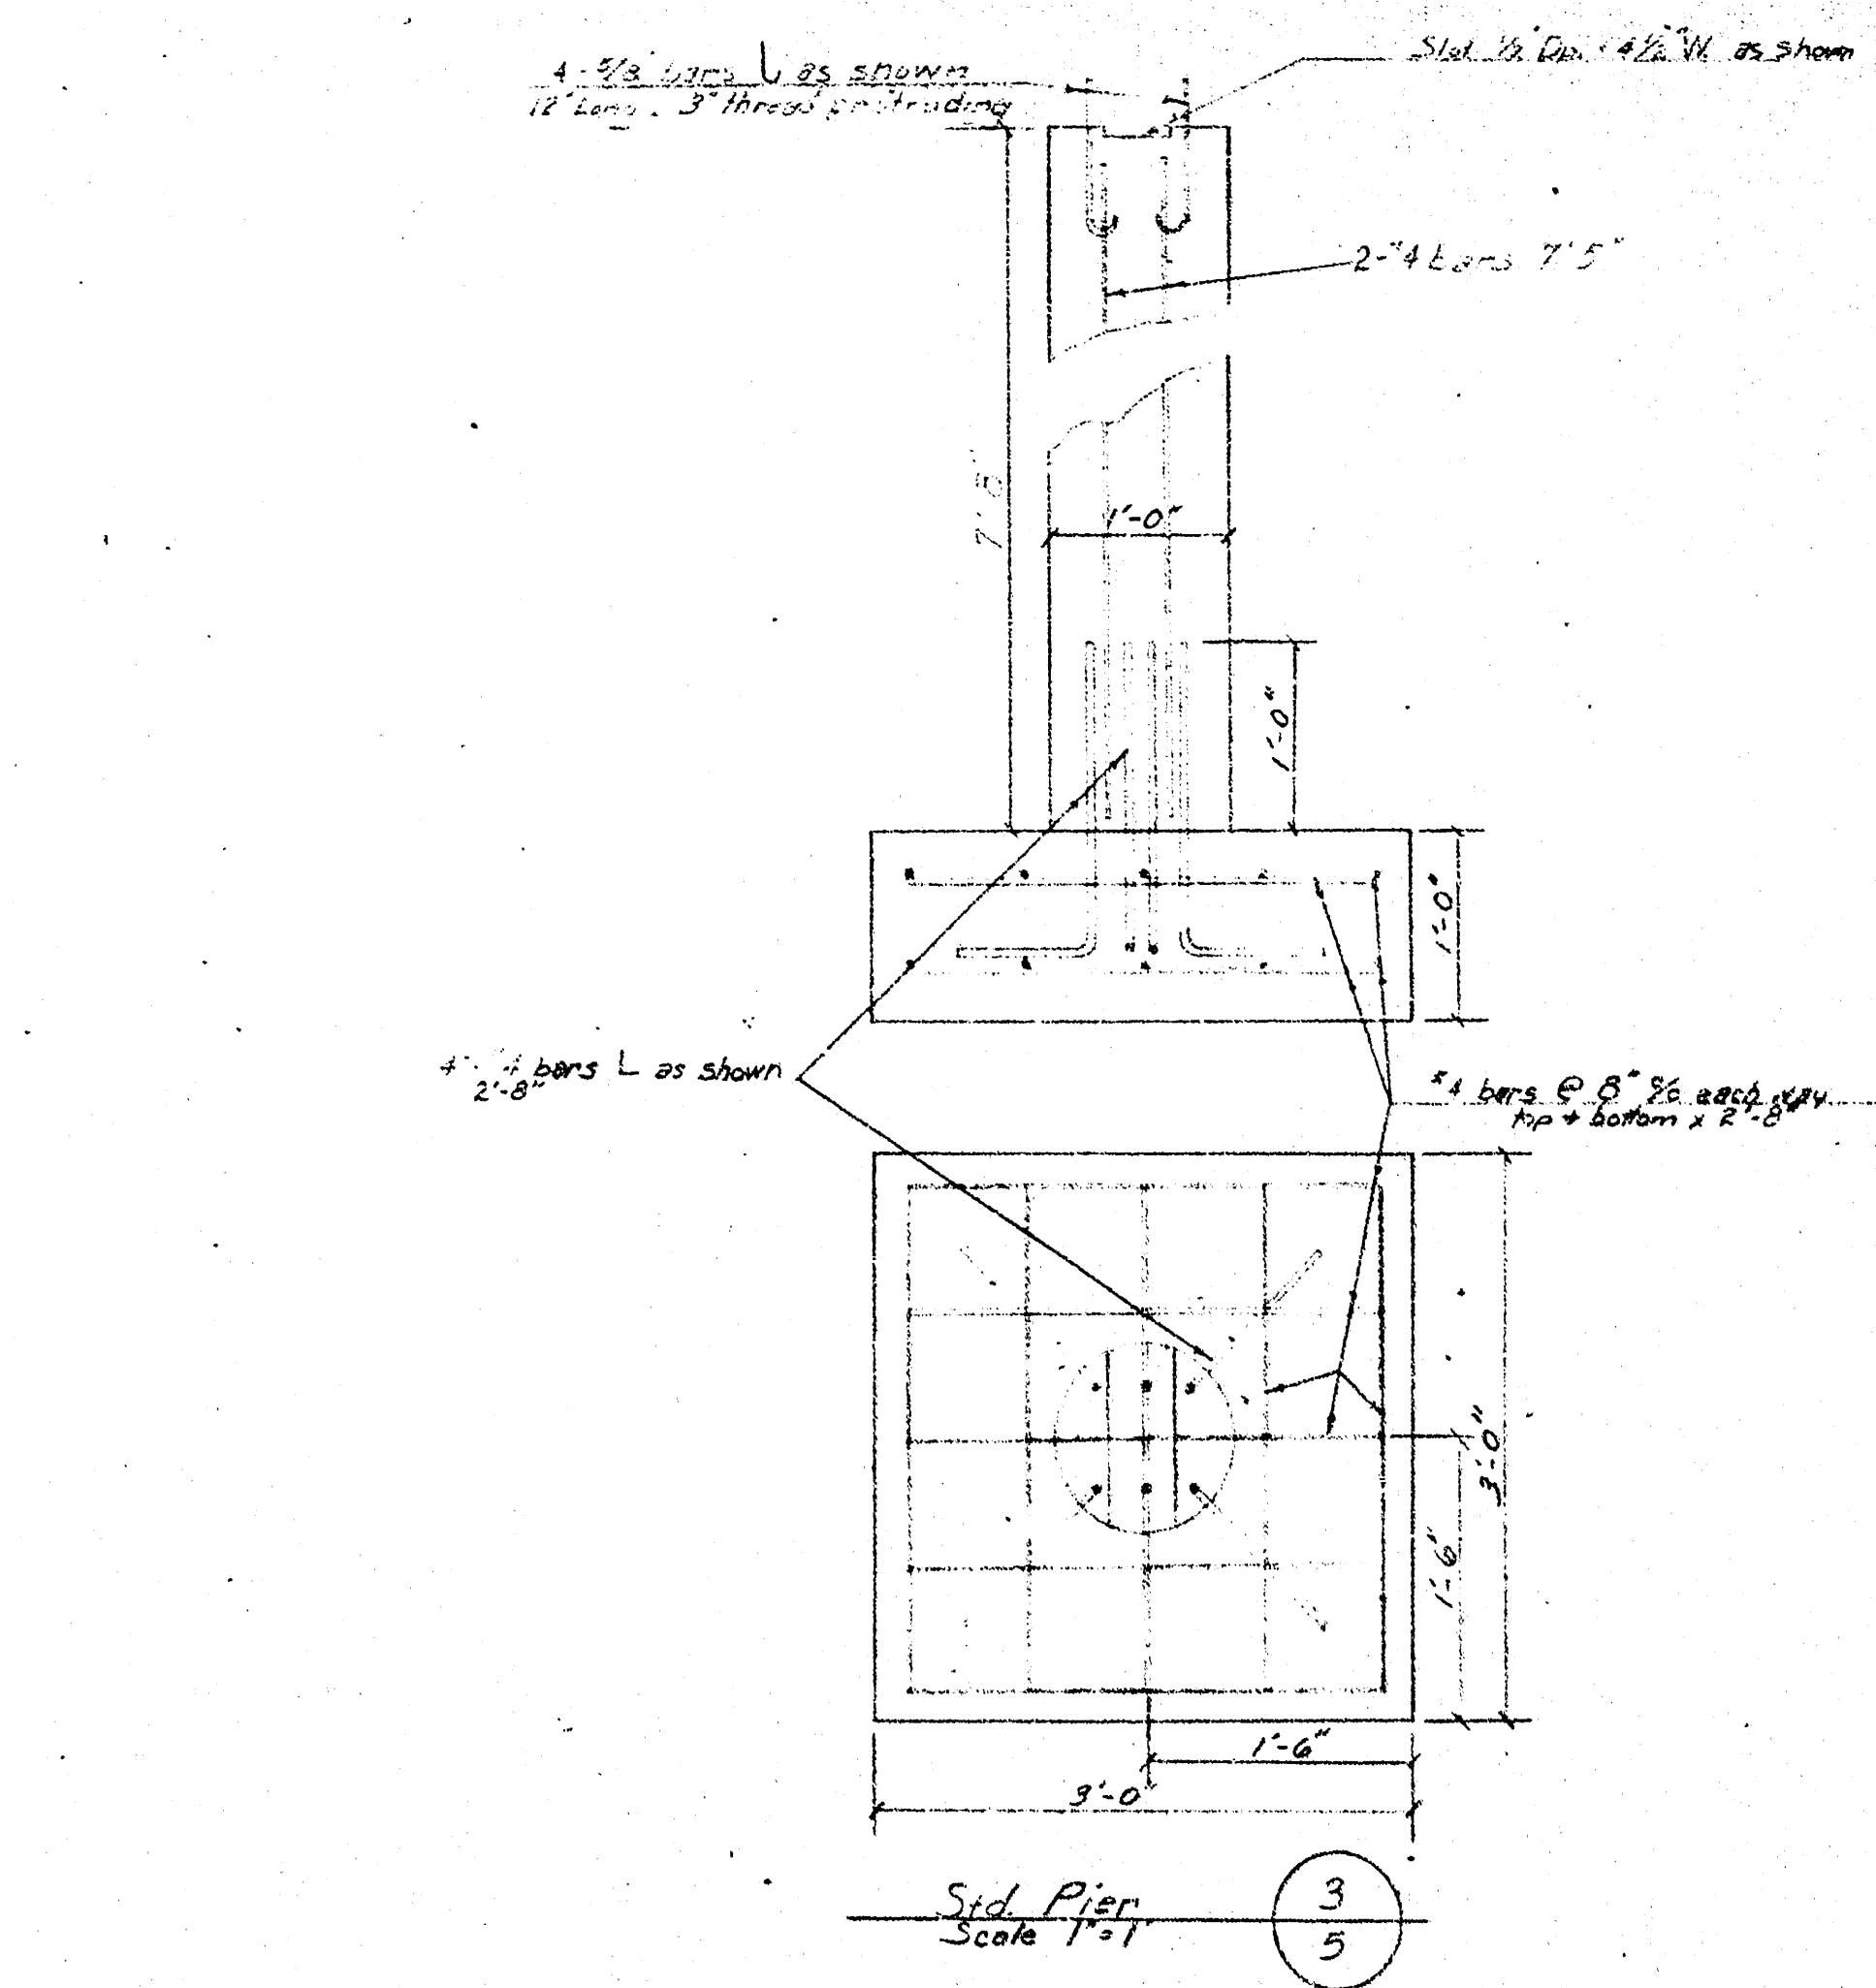


Note: All concrete shall be composed of Portland Cement, fine and coarse aggregate, and water. Cement content shall be 7.0 sacks per C.Y. proportions; parts by volume shall be as follows: Cement 1, fine aggregate 1 1/2-2, coarse aggregate 2 1/2-3, maximum total water content per bag of cement 5.5. Required consistency range for slump shall be vibrated in-place 1 1/2"-3", non-vibrated in-place 2"-4". Strength requirements shall be 7 days 1,800 psi, 28 days 3,000 psi.

Note: Bar reinforcement shall conform to the latest published requirements for Billet Steel Bars for Concrete Reinforcement of Intermediate Grade, ASTM Designation A-15. Deformation of Deformed Steel Bars of Concrete Reinforcement, ASTM Designation A-305. Welded wire fabric for reinforcement shall conform to the latest published requirements of the Standard Specifications for Welded Steel Wire Fabric for Concrete Reinforcement, ASTM Designation A-185.


McCALEB ENGINEERING EDMOND, OKLAHOMA		Drawn: _____ Title: _____ Checked: _____ Reviewed: _____
CONTINENTAL VILLAGE MARINA		5681
DETAIL SHEET		Sheet No. 5 of 6

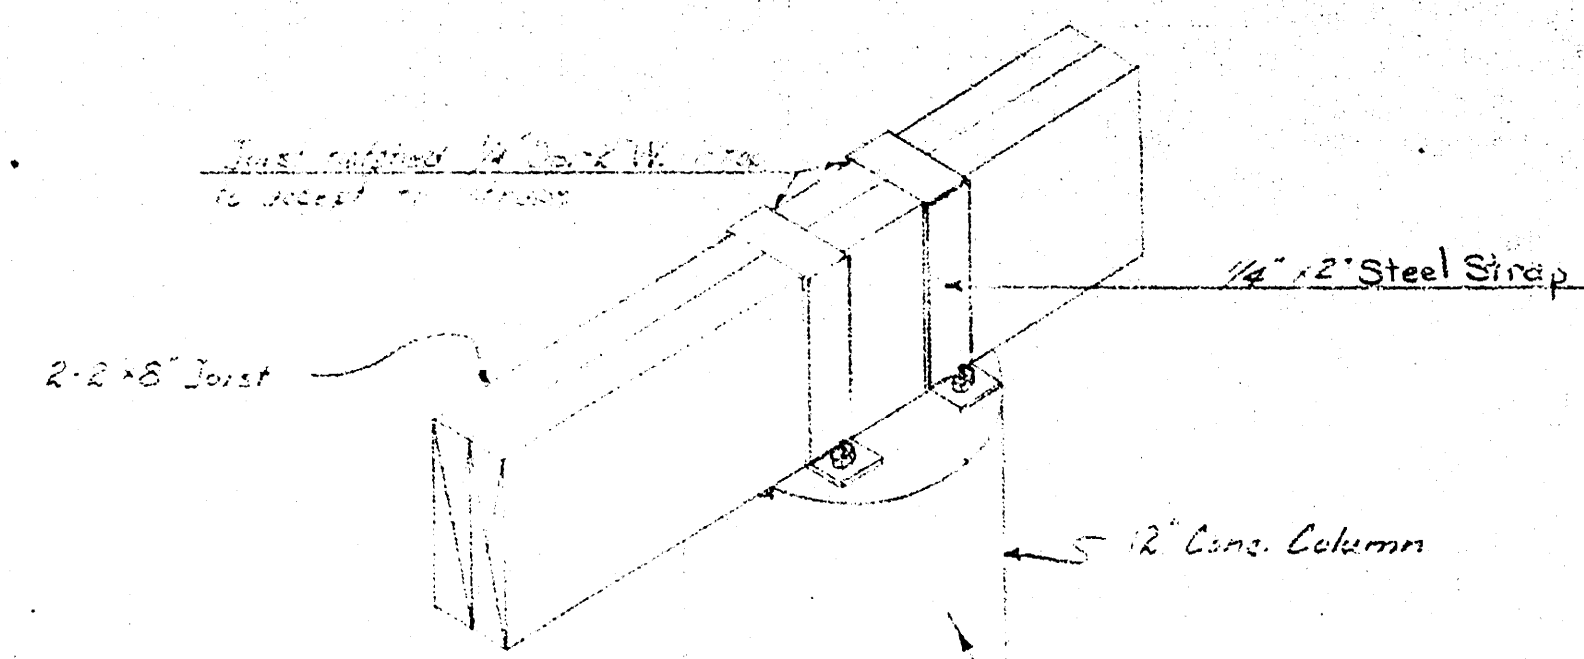

Joist to Column Detail
Scale 1/2" = 1'

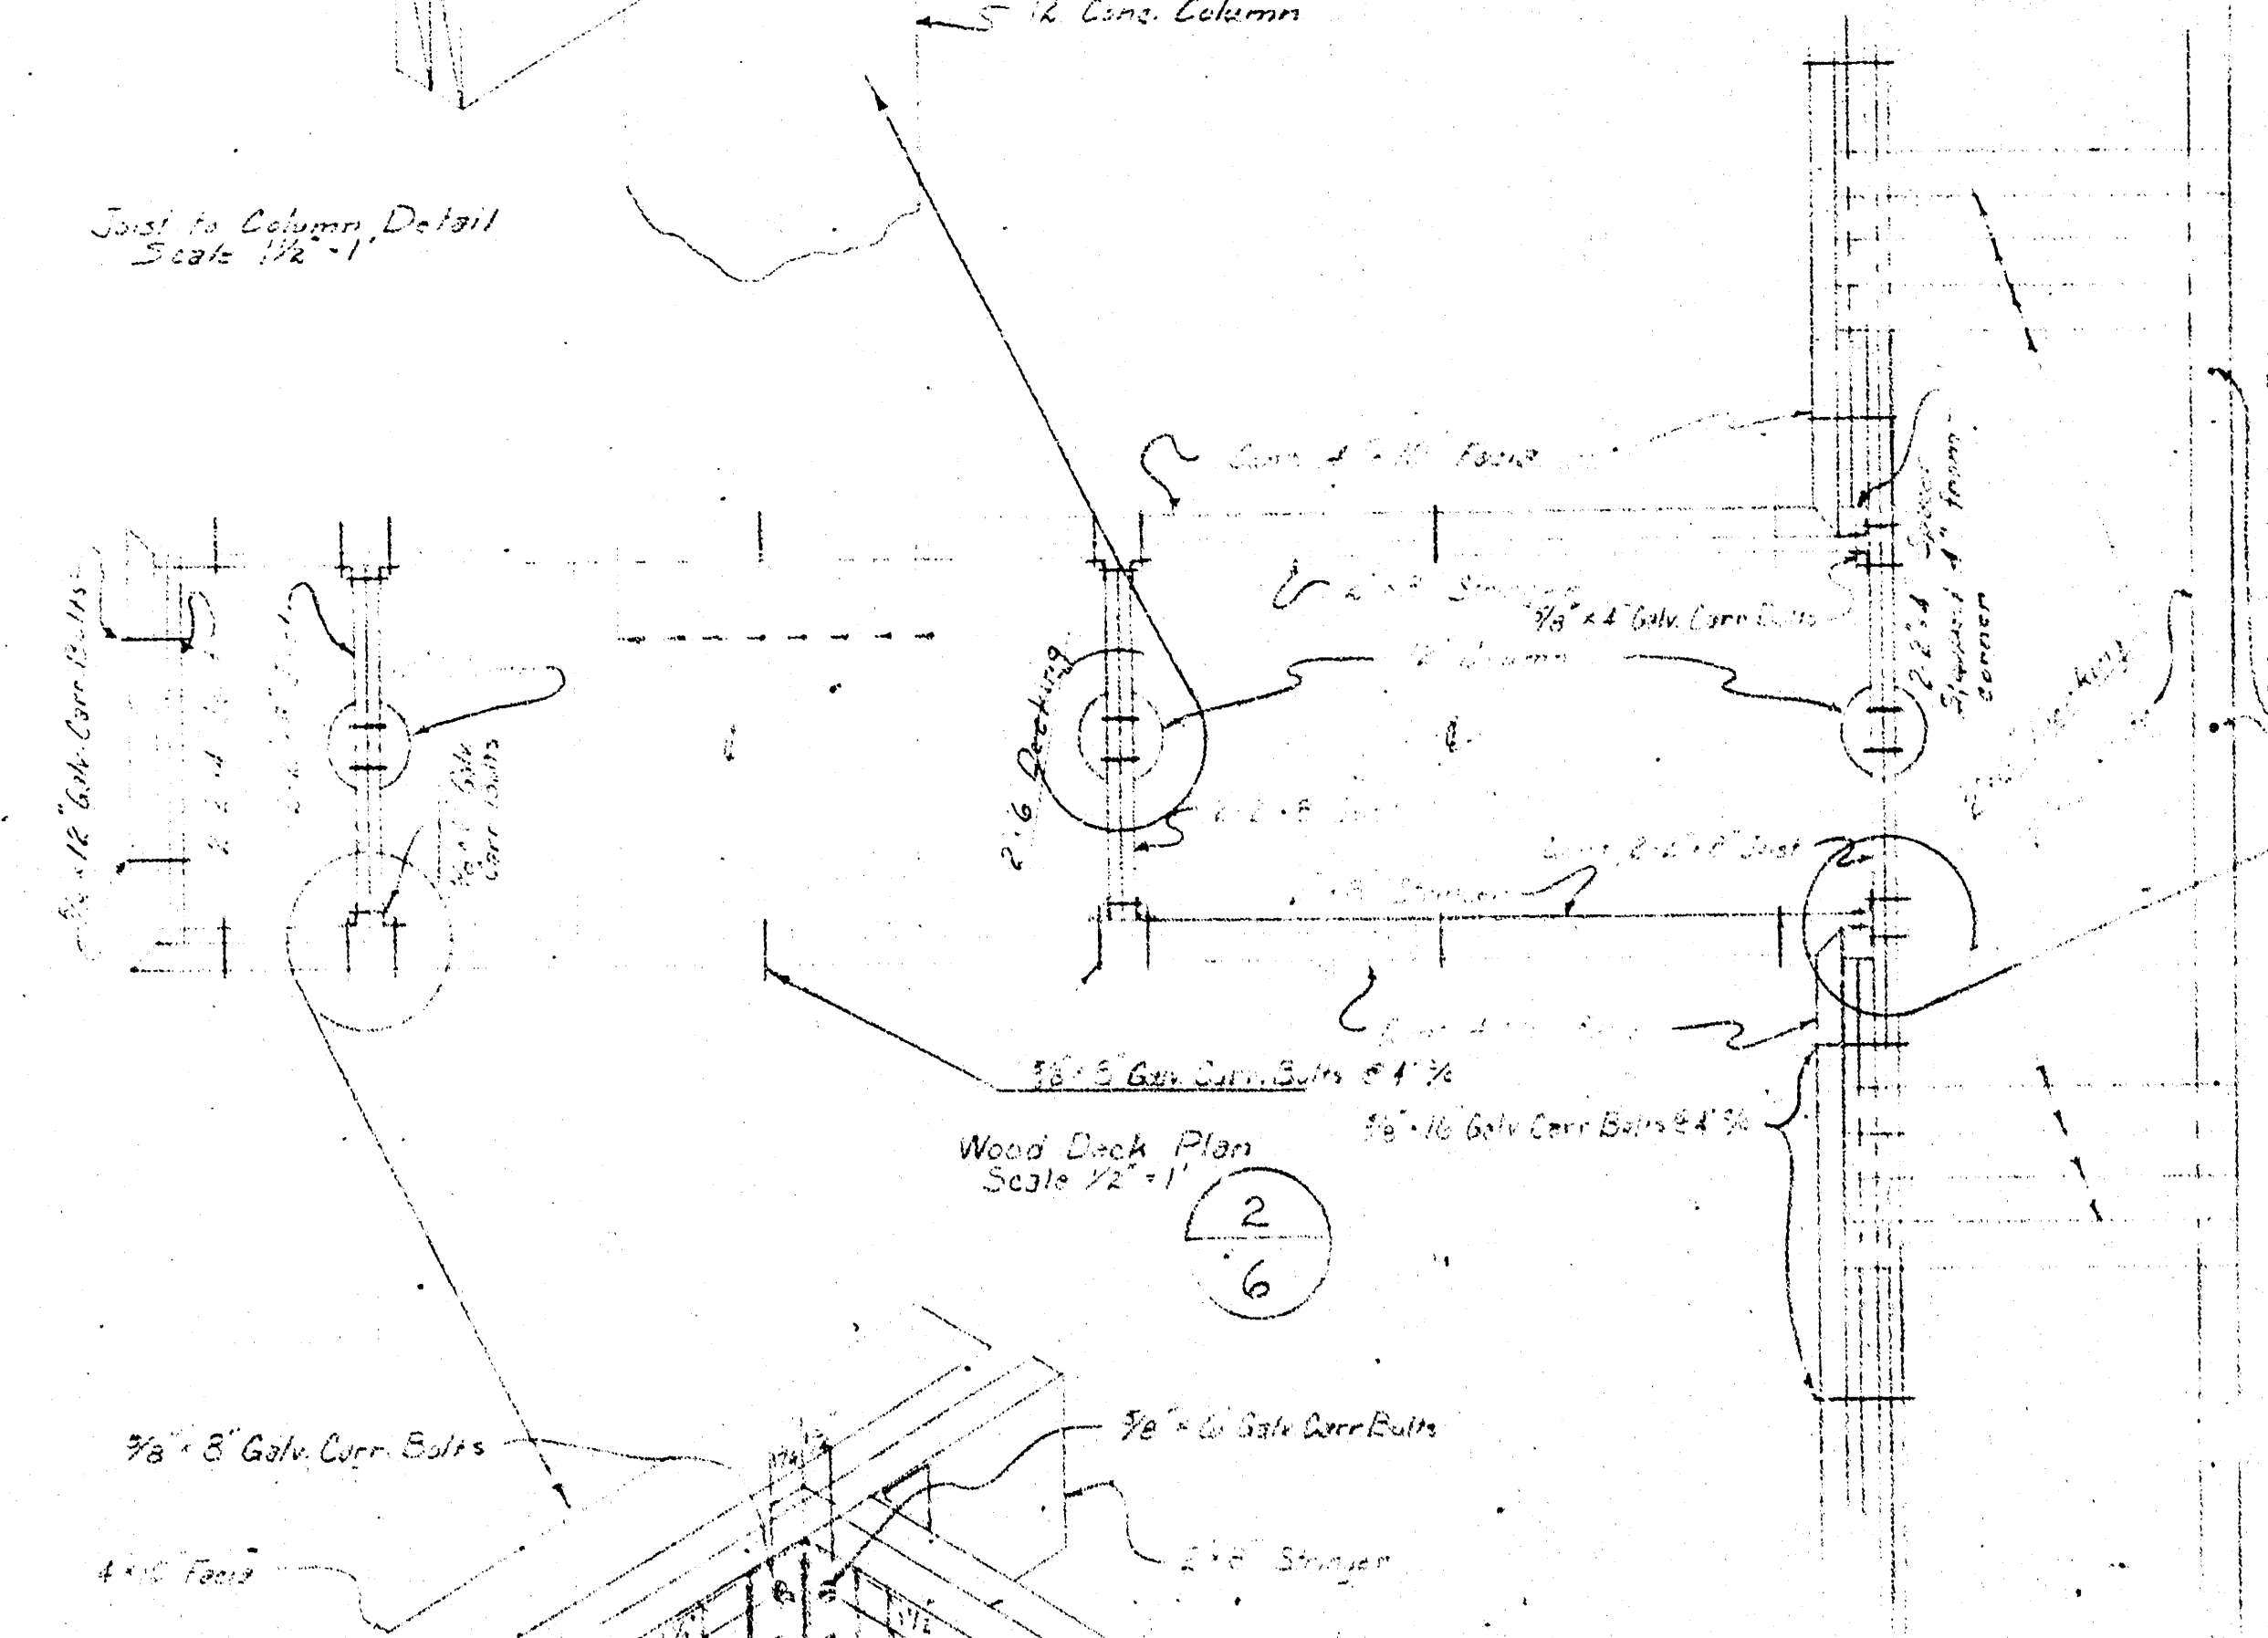


Wood Deck Plan
Scale 1/2" = 1'

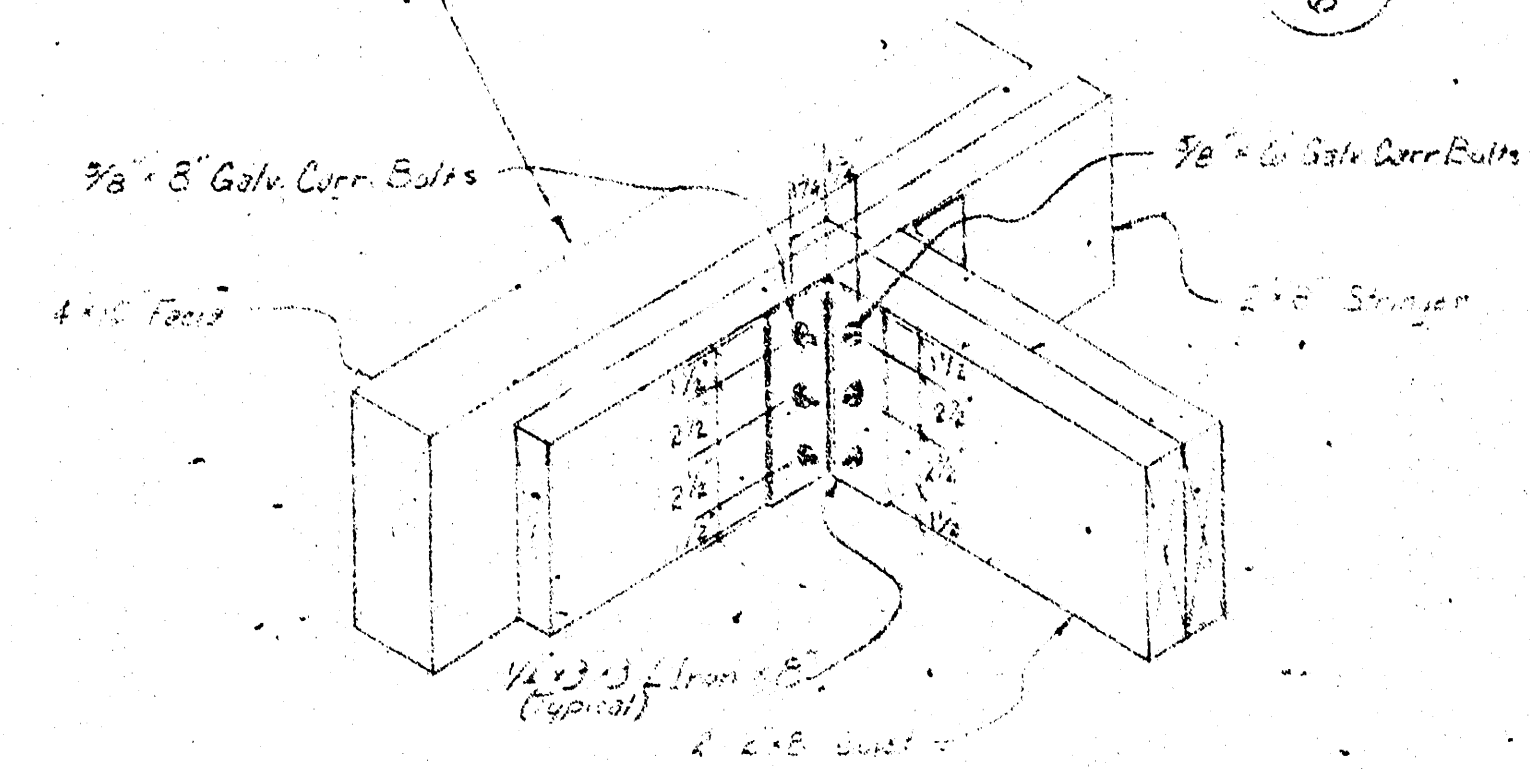


Joist to Column Detail
Scale 1/2" = 1'


Note: Pressure Treated Wood Decks:
a. Lumber shall be Douglas Fir of the Coast region only or Southern Yellow Pine.
b. Methods of grading and general requirements shall be in accordance with ASTM D-245.
c. All lumber shall be treated according to current ANPA Standard Specifications for Preservative Treatment by Pressure Processes.

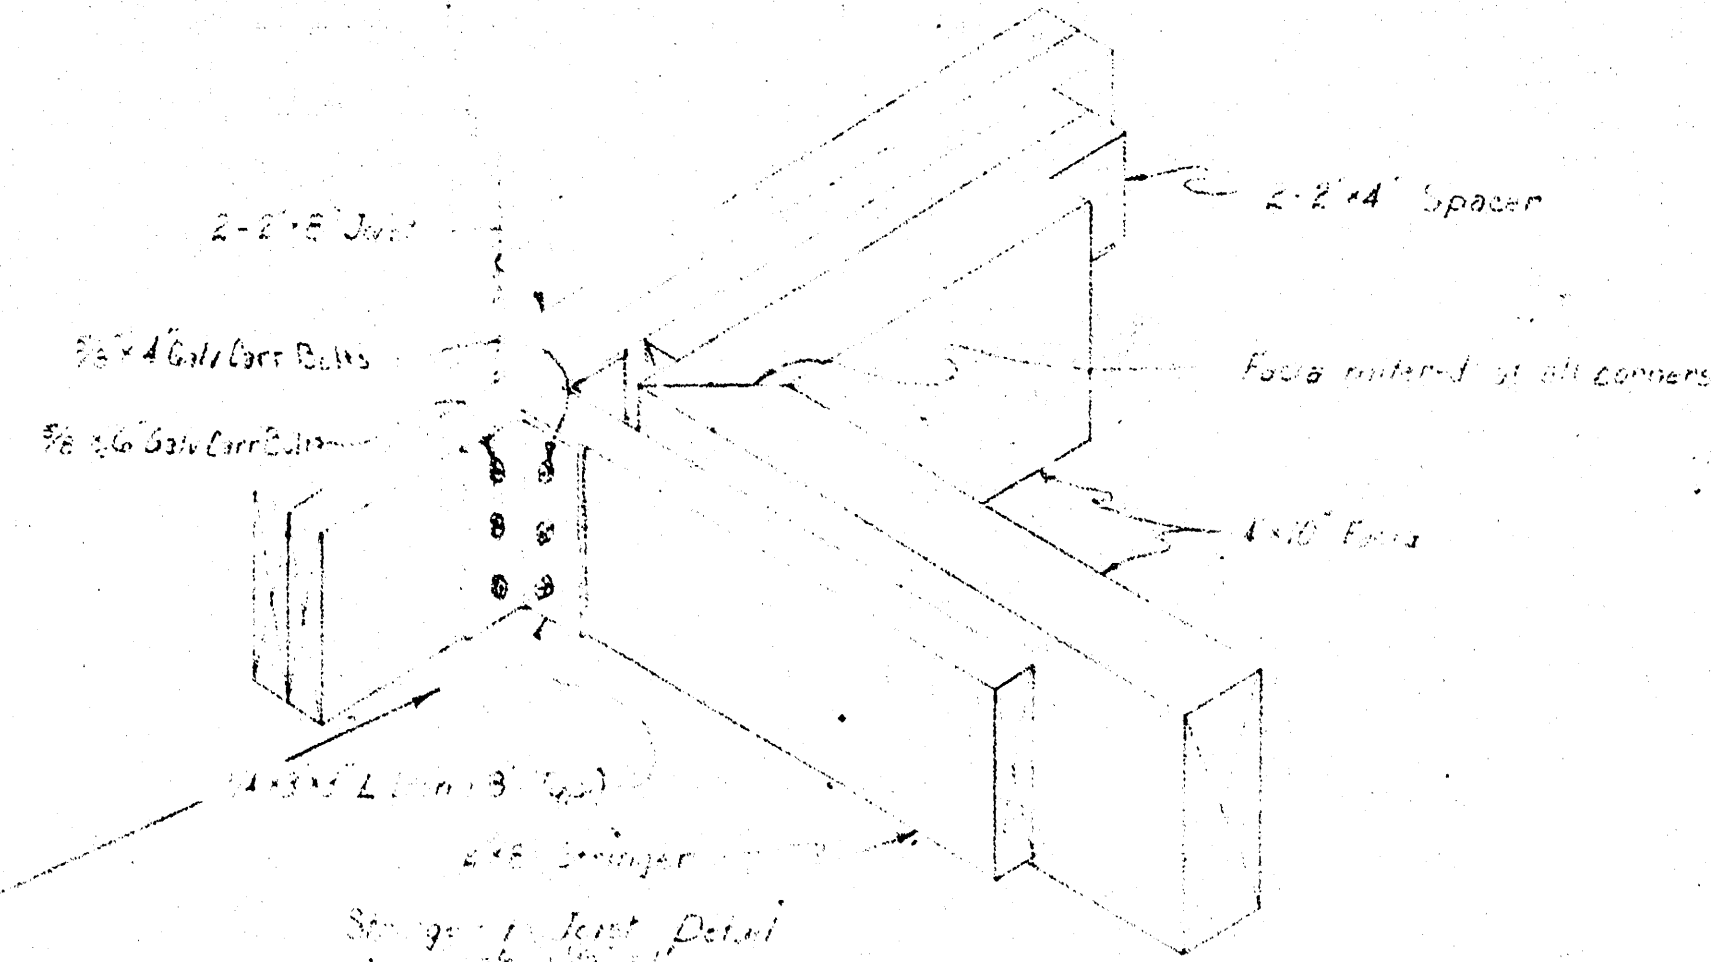

Joist to Column Detail
Scale 1/2" = 1'

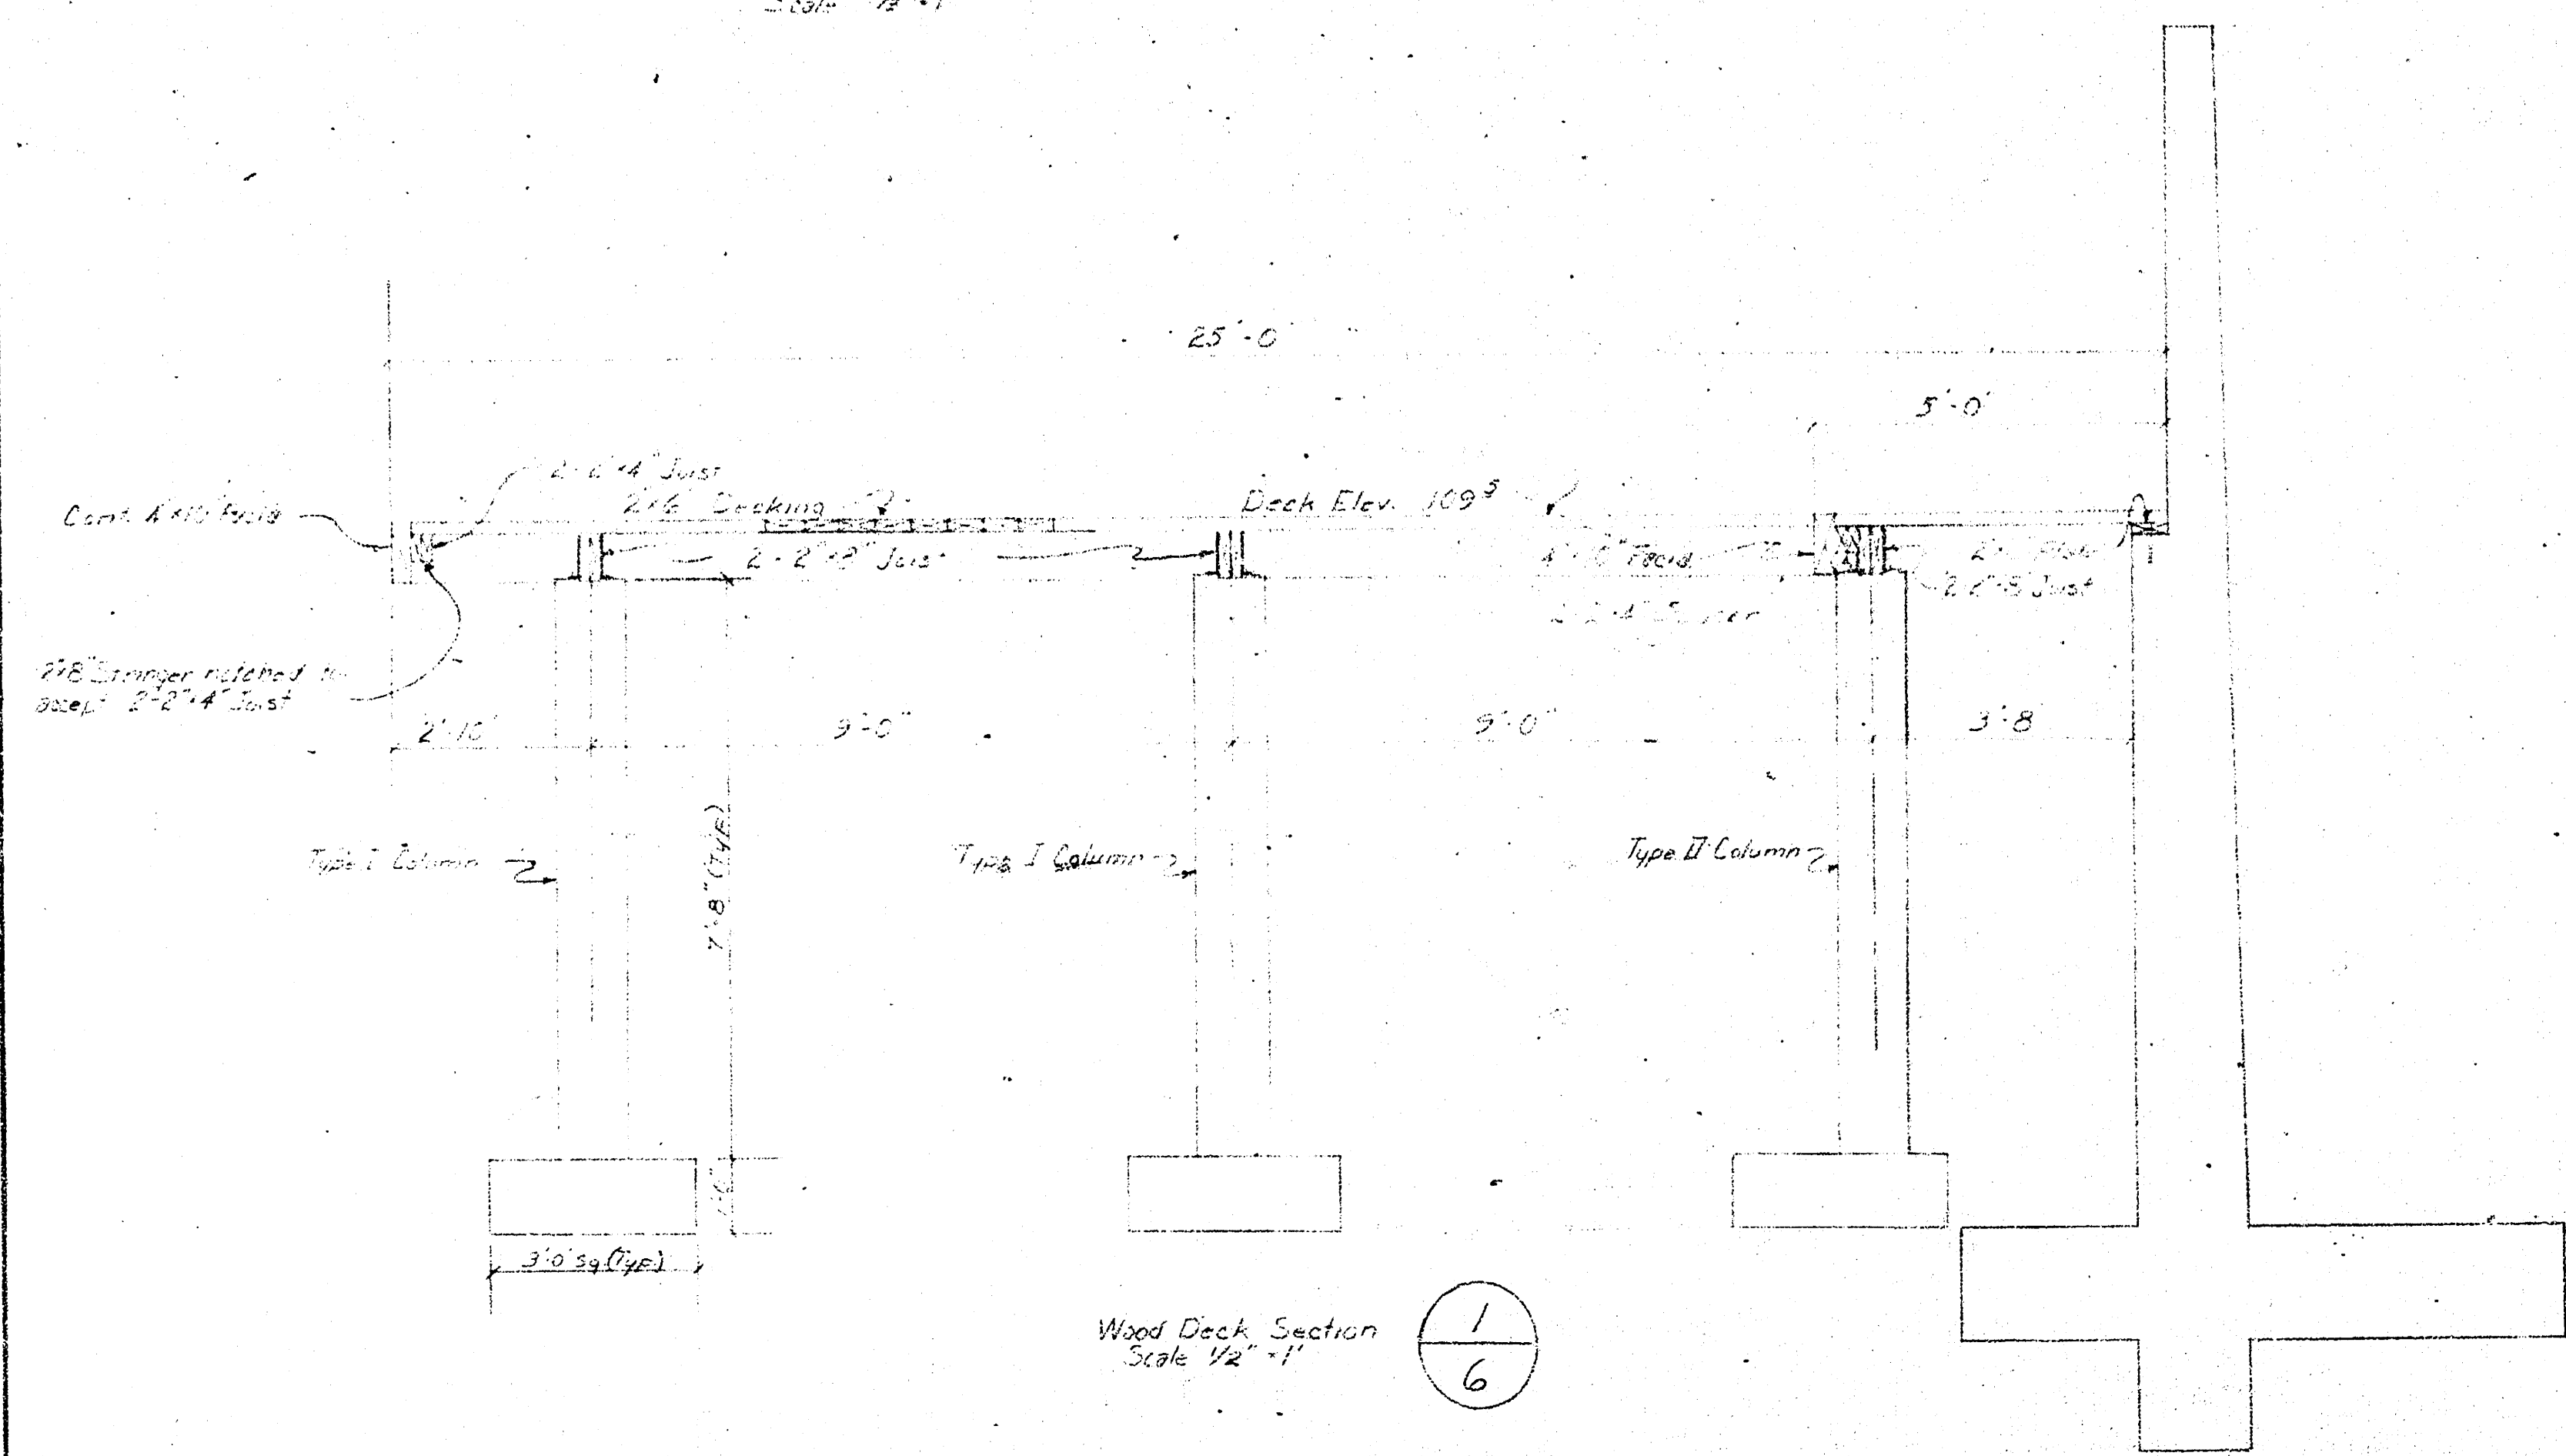

Wood Deck Section
Scale 1/2" = 1'

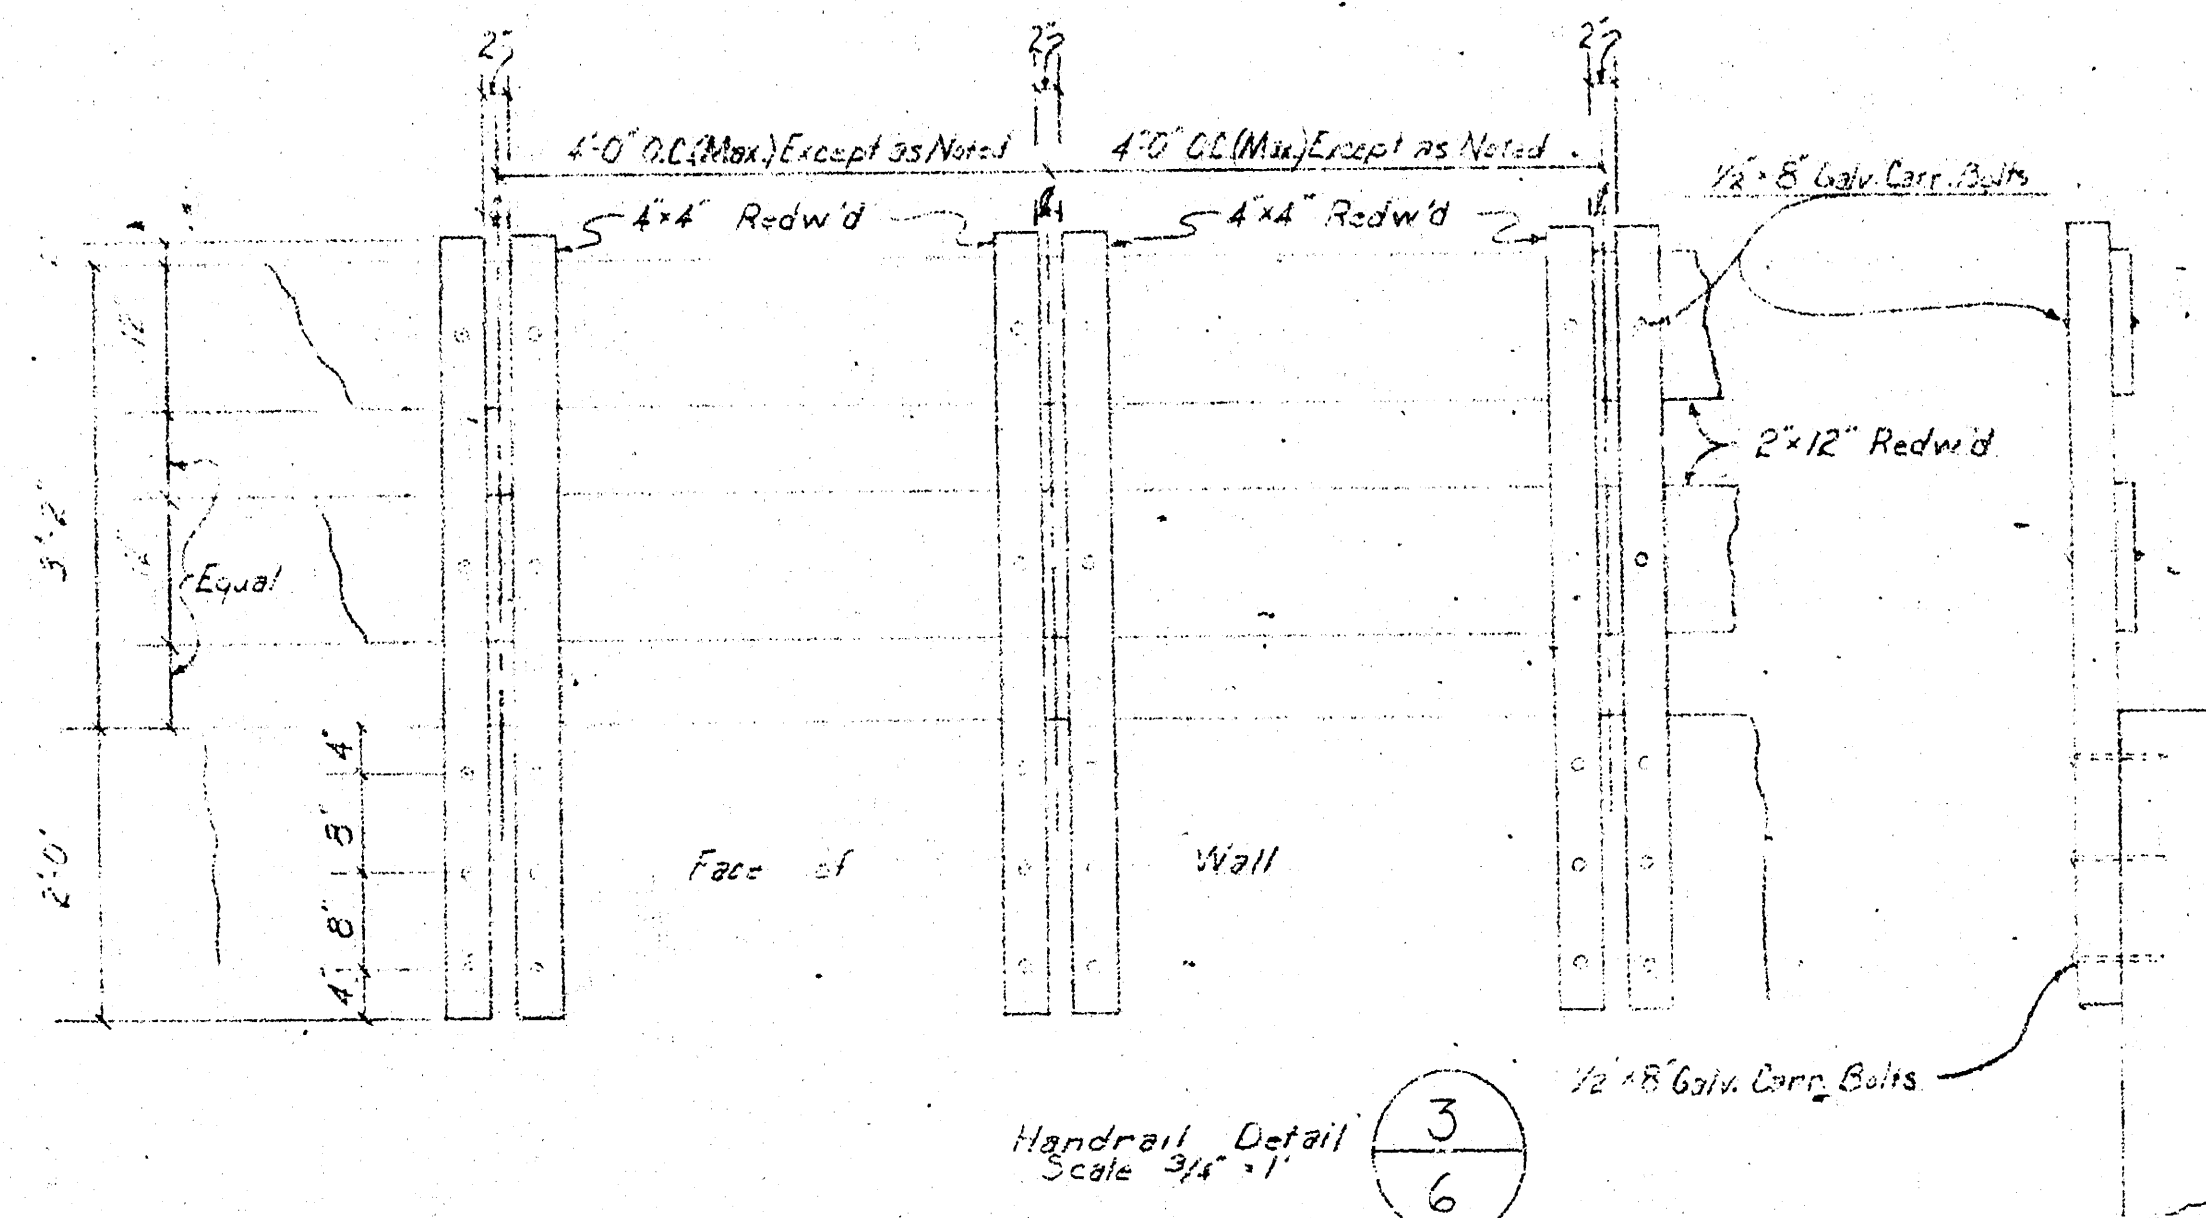

Handrail Detail
Scale 3/4" = 1'

McCALEB ENGINEERING EDMOND, OKLAHOMA		Dr. _____	Date _____
CONTINENTAL VILLAGE MARINA		Eng. _____	
DETAIL SHEET		Rev. _____	
Sheet No. 6 of 6		NOV-12-1970	