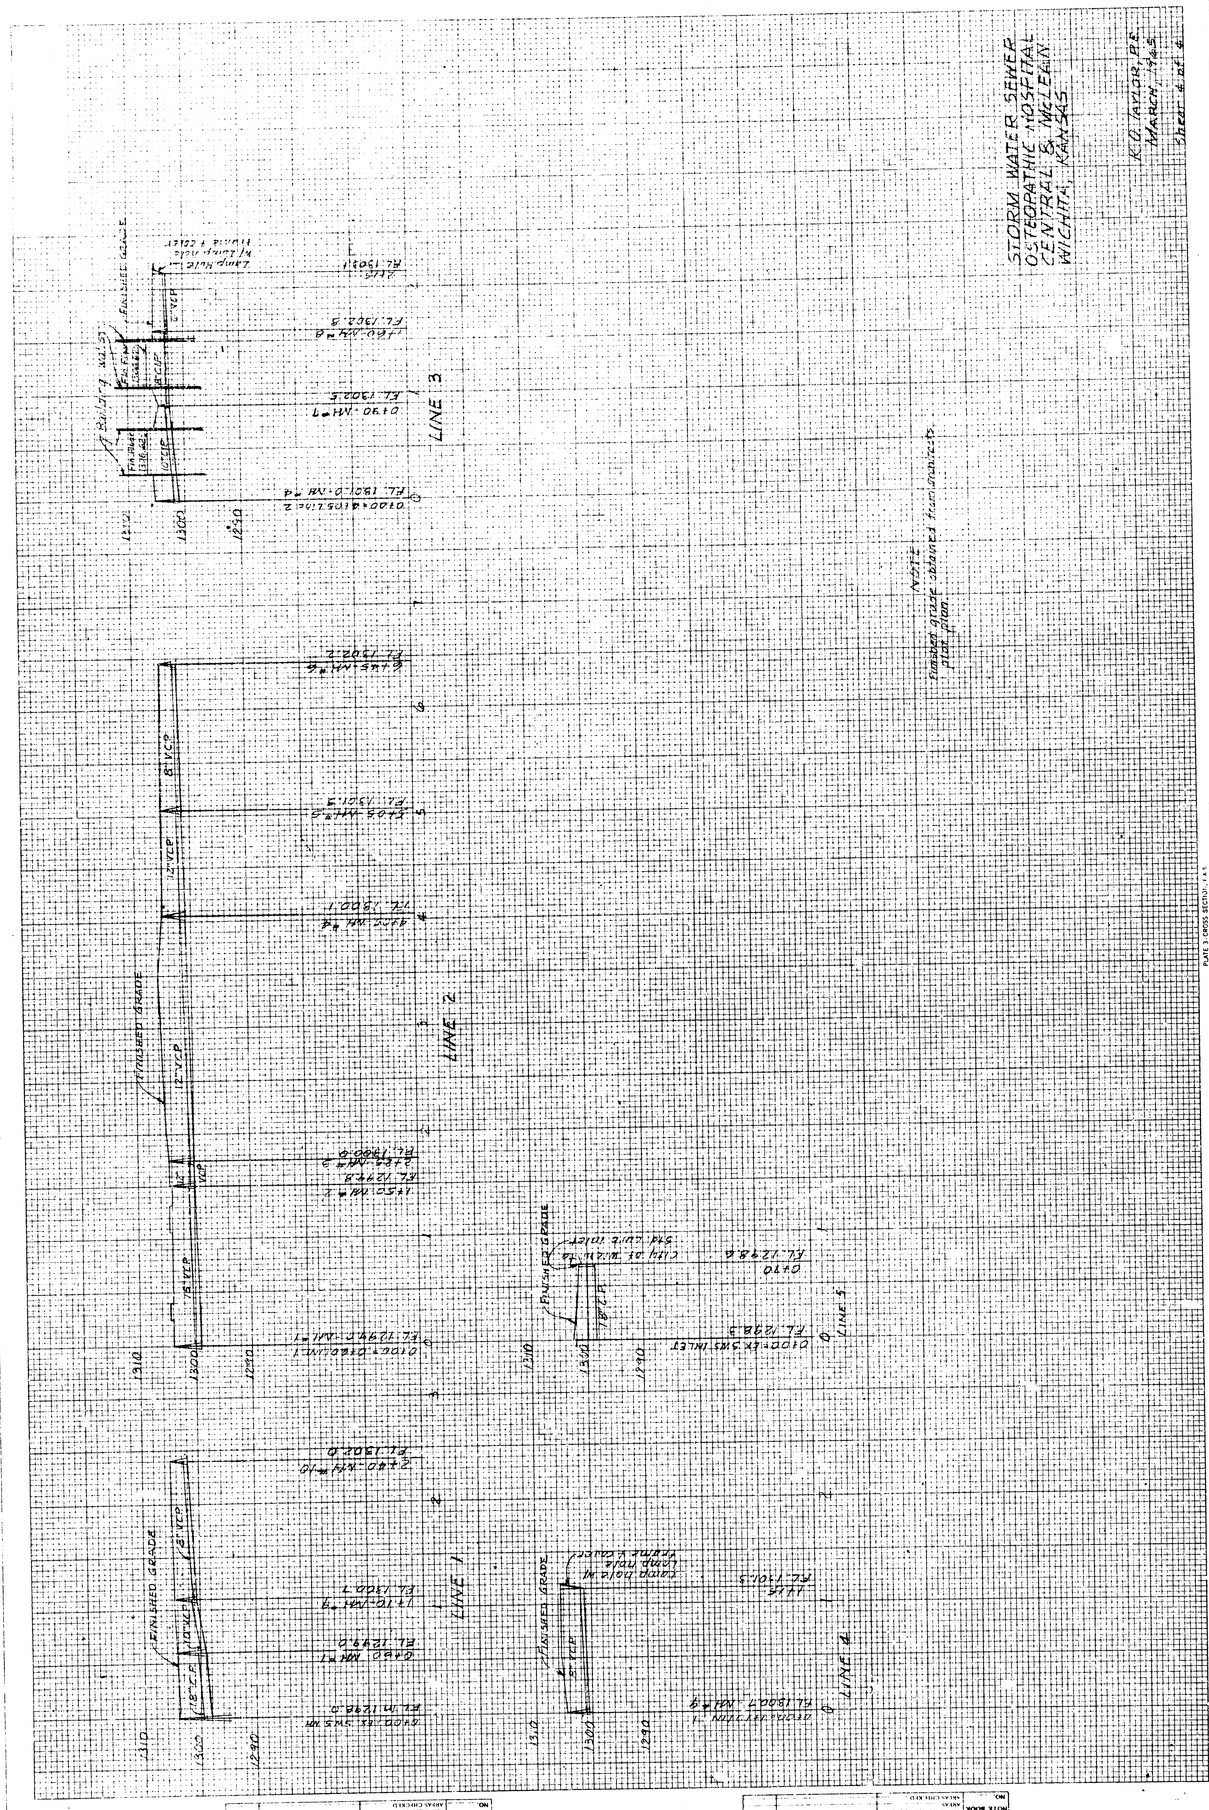
STORM WATER SEWER
OSTEOPATHIC HOSPITAL
CENTRAL & McLEAN
WICHITA, KANSAS
K.G. TAYLOR, P.E.
MARCH 1965
NOTE
Station grade adjusted from profiles.
FINISHED GRADE
LINE 1
LINE 2
LINE 3
LINE 4
LINE 5
FINISHED GRADE
FINISHED GRADE
FINISHED GRADE

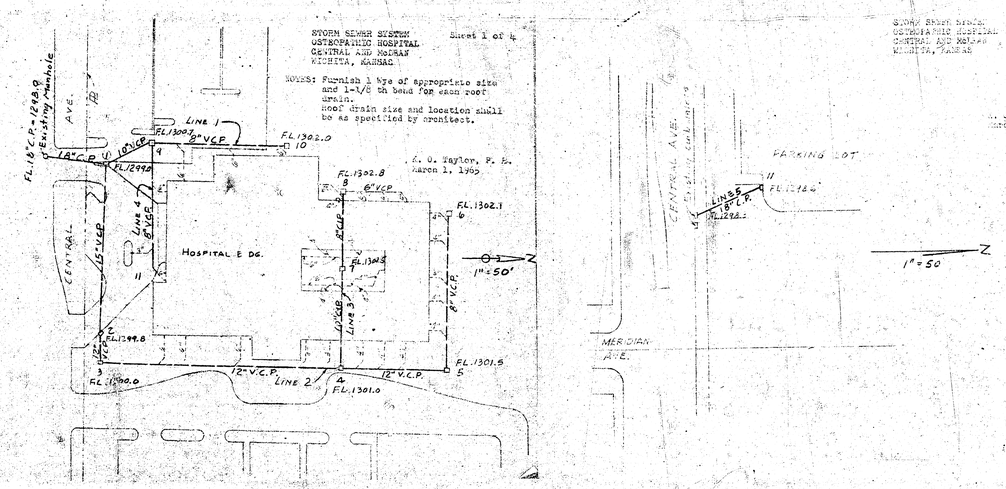

STORM SEWER SYSTEM
OSTEOPATHIC HOSPITAL
CENTRAL AND MOSLEY
WICHITA, KANSAS

Sheet 2 of 4

MANHOLE NO.	TYPE	F.L. ELEV.	TOP ELEV.
1	City of Wichita Std. Curb Inlet	1299.0	Top of Curb
2	do	1299.8	Top of Curb
3	Architects plan with solid manhole cover	1300.0	Drive grade
4	do	1301.0	1305.1
5	do	1301.5	1305.1
6	do	1302.1	1305.1
7	Architects plan with grate as specified	1302.5	1306.5
8	Architects plan with solid manhole cover	1302.8	1305.4
9	do	1300.7	Drive grade
10	do	1302.0	1305.4
11	City of Wichita Std. Curb Inlet	1298.6	1301.5

APPROXIMATE PIPE QUANTITIES:

60 Lin. Ft.	6" VCP
380 Lin. Ft.	8" VCP
50 Lin. Ft.	10" VCP
330 Lin. Ft.	12" VCP
180 Lin. Ft.	15" VCP
130 Lin. Ft.	18" Concrete Pipe
70 Lin. Ft.	8" CIP
90 Lin. Ft.	10" CIP

A. O. Taylor, P. E.
March 1, 1965