

STORM WATER SEWER PHASE 1 PLANS FOR PRAIRIE WOODS SECOND ADDITION

SWS # 500
PROJECT NO. 468-82823
CITY OF WICHITA, KANSAS
MICHAEL E. LINDEBAK, CITY ENGINEER
INDEX CODE 751164
JUNE, 1998

GENERAL NOTES


1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PRESERVING PROPERTY IRONS. THE CONTRACTOR WILL BE REQUIRED TO RE-ESTABLISH ANY PROPERTY IRONS WHICH ARE DAMAGED OR DESTROYED BY HIS CONSTRUCTION OPERATIONS. SUCH IRONS SHALL BE RE-ESTABLISHED BY A LICENSED LAND SURVEYOR IN ACCORDANCE WITH STATE LAWS.
2. EXISTING UTILITIES AND THEIR LOCATIONS, AS SHOWN ON THE PLANS REPRESENT THE BEST INFORMATION OBTAINABLE FOR DESIGN. LOCATION INFORMATION HAS BEEN OBTAINED FROM THE VARIOUS UTILITY COMPANIES AND IS EITHER FROM COMPANY RECORD DRAWINGS OR COMPANY PROVIDED FIELD LOCATIONS. THE PLAN LOCATIONS SHOWN ARE NOT GUARANTEED. ADDITIONAL EXISTING UTILITIES MAY ALSO BE ENCOUNTERED.
3. CONTRACTOR WILL BE REQUIRED TO PROVIDE A MINIMUM ADVANCE NOTICE OF FORTY-EIGHT (48) HOURS TO UTILITY COMPANIES PRIOR TO STARTING ANY EXCAVATION AS FOLLOWS:

KANSAS ONE-CALL 1-800-344-7233
or 687-2470 (LOCAL WICHITA)

THE CONTRACTOR MUST NOTIFY THE FOLLOWING IN CASE OF AN EMERGENCY:

SOUTHWESTERN BELL TELEPHONE COMPANY 1-800-734-7590
CABLEVISION 262-0561
KANSAS GAS & ELECTRIC (ELECTRIC) 264-1141
KANSAS GAS & ELECTRIC (GAS) 832-3180 OR 832-3169
CITY OF WICHITA SEWER MAINTENANCE 268-4908
CITY OF WICHITA WATER DEPARTMENT 268-4908

4. RUBBLE FROM THE REMOVAL OF MISCELLANEOUS STRUCTURES AND EXCESS EXCAVATION WHICH IS TO BE WASTED SHALL BE DISPOSED OF ON SITES TO BE PROVIDED BY THE CONTRACTOR. THESE SITES SHALL BE APPROVED BY THE ENGINEER AS TO SUITABILITY, APPEARANCE AND SITE LOCATION. LOCATIONS THAT, IN THE OPINION OF THE ENGINEER, WILL LEAVE AN UNSIGHTLY APPEARANCE WILL NOT BE APPROVED. ALL DISPOSAL SITES MUST BE APPROVED BY THE KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT. MATERIAL EITHER STOCKPILED OR DISPOSED OF IN A FLOOD PLAIN WOULD REQUIRE A KANSAS STATE BOARD OF AGRICULTURE PERMIT. ANY MATERIAL DUMPED IN WATERS OF THE UNITED STATES, OR WETLANDS IS SUBJECT TO U.S. CORPS OF ENGINEERS PERMITTING REGULATIONS. ANY MATERIAL BURIED OR STOCKPILED BEYOND APPROVED CONSTRUCTION LIMITS WOULD REQUIRE ADDITIONAL ARCHAEOLOGICAL INVESTIGATIONS UNLESS BURIED IN A PREVIOUSLY APPROVED BORROW LOCATION.
5. COST OF EXCAVATION, HAULING, AND DUMPING OF EXCESS EXCAVATION SHALL BE SUBSIDIARY TO THE PROJECT.
6. TREES AND SHRUBS IN PUBLIC RIGHT-OF-WAY WHICH ARE IN DIRECT CONFLICT WITH PROPOSED NEW CONSTRUCTION SHALL BE REMOVED BY THE CONTRACTOR WITH THE ENGINEER'S APPROVAL. TREES AND SHRUBS WHICH ARE NOT IN DIRECT CONFLICT WITH PROPOSED NEW CONSTRUCTION SHALL BE SAVED AND PROTECTED FROM DAMAGE.
7. ALL DISTURBED AREAS TO BE SEED WITH RYE GRASS AT A RATE OF 200 LBS./ ACRE WITHIN 10 DAYS OF CONSTRUCTION. COST SHALL BE SUBSIDIARY TO PROJECT.
8. REVERSE CURB INLET TOPS. PAVEMENT IN THIS AREA WILL BE BUILT AT FUTURE DATE. COST OF REVERSING INLET TOPS SHALL BE SUBSIDIARY TO THE INLET CONSTRUCTION.
9. CONTRACTOR SHALL LEAVE EXCESS MATERIAL ON SITE IN A LOCATION DESIGNATED BY THE OWNER. LOCATION WILL BE WITHIN THE BENEFIT DISTRICT BOUNDARY. MATERIAL SHALL BE PLACED ADJACENT TO ROAD RIGHT-OF-WAYS WITHIN LOTS. MATERIAL SHALL BE PLACED IN LIFTS NO GREATER THEN 9" AND SHALL BE SMOOTH SO GRASS MAY BE PLANTED.

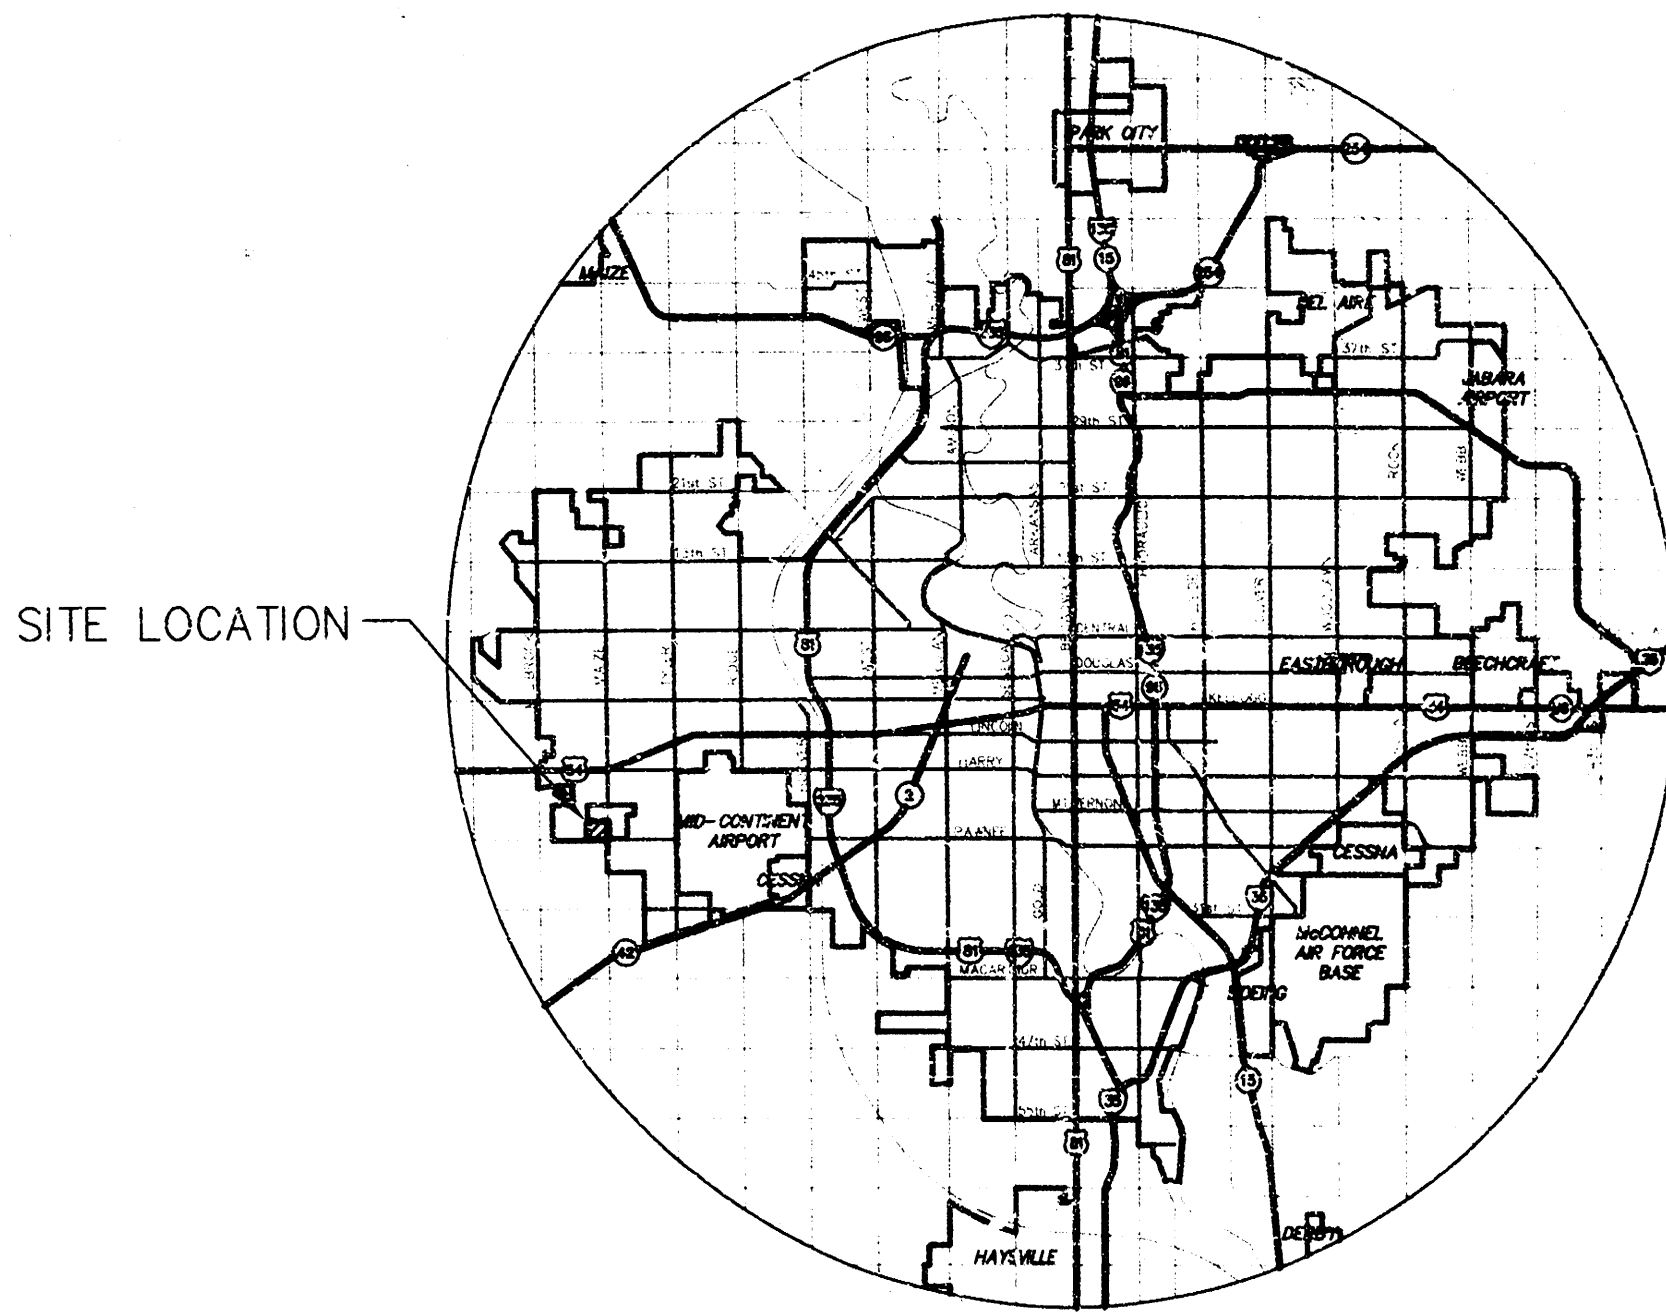

LOCATION MAP

INDEX TO DRAWINGS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2-3	LINE 1
4	LINE 1, 2 & 2A
5	DITCH CROSS SECTIONS
6-8	INLET DETAILS
9	MANHOLE DETAILS
10	FINAL PLAT

BENCHMARKS

- BM #1 COW BENCHMARK 44' SOUTH & 49.8' WEST OF CL PAWNEE & MAIZE ROAD. ELEV. = 135.12
- BM #2 "□" CUT ON TOP OF WEST END OF SOUTH RCP, 1300' ± NORTH OF CL PAWNEE. ELEV. = 138.945
- BM #3 COW BENCHMARK 31.5' SOUTH & 38' EAST OF CL MAIZE ROAD & MAY ELEV. = 137.69
- BM #4 STEPPED SPIKE IN P.P., SW COR. LARK LANE & PAWNEE. ELEV. = 143.48
- BM #5 "□" CUT ON SW COR. CURB INLET ON WEST SIDE LARK LANE, 1340' N. OF CL PAWNEE. ELEV. = 141.755

BM #5



BM #2

BENEFIT DISTRICT BOUNDARY

BM #4

BM #1

SCALE: 1" = 150'

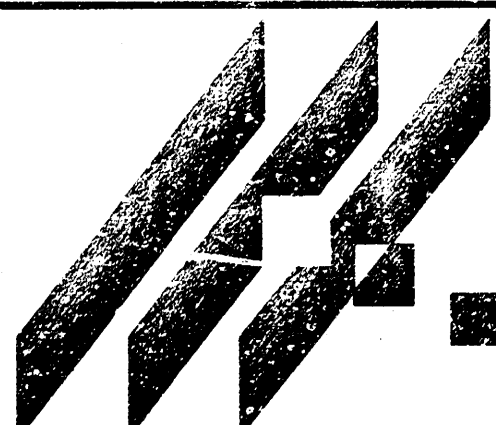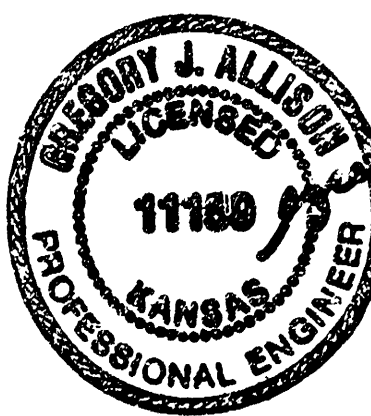

MID-KANSAS ENGINEERING
CONSULTANTS, INC.
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

PRAIRIE WOODS SECOND ADDITION
PROJECT NAME

STORM WATER SEWER PLANS - PHASE 1
SHEET TITLE

JTC	ASE	GJA
DESIGN BY.	DRAWN BY.	CHECKED BY.
JUNE 1998	97084-DT	1 / 10
DATE	JOB NO.	SHEET / OF

Prairie Woods Second Addition

Exist. San. Swr. MH
MH Top=137.37
FL Out=127.64
FL In=127.74

Exist. San. Swr. MH
MH Top=138.03
FL Out=123.45

Exist. San. Swr. MH
MH Top=137.33
FL In=127.50
FL Out=127.40

REMOVE 100 L.F. OF HEDGE ROW

10' Util. Esmt.

Ex. 8" San. Swr.

Install 22 SY of Light Stone Rip-Rap

LINE 1

50' Util. & Drg. Esmt.

10'-0" (MIN.)

2'-0" (MIN.)

5'

5'

WATER MAIN

Sta. 4+07.95, Line 1
Const Shallow Type "A" MH
MH Dia. = 5'
MH Top = 138.50

Sta. 5+29.23, Line 1
Const Std. Type 1A Curb Inlet
W = 4'-4", L = 11'-4"
Inlet Top = 138.74
Stafford Sta. 4+78.14,
17.66' Rt. CL on Inlet

PAWNEE

ROAD

GRAVEL

Sta. 0+00, Line 1

1

2

3

4

5

6

STAFFORD

SEE CROSS SECTIONS (SHT. 5)

TYPICAL DITCH CROSS SECTION

STA. 2+00 TO 3+50


EXCAVATION = 907 C.Y.

PROTECTIVE FILL DETAIL

MINIMUM PROTECTIVE FILL SHALL BE PROVIDED IN ALL INSTANCES WHERE COVER OVER THE PROP. LINE IS LESS THAN (2) FEET (COST SUBSIDIARY TO PIPE INSTALLATION)



PLAN LINE 1

Scale: 1"=20'




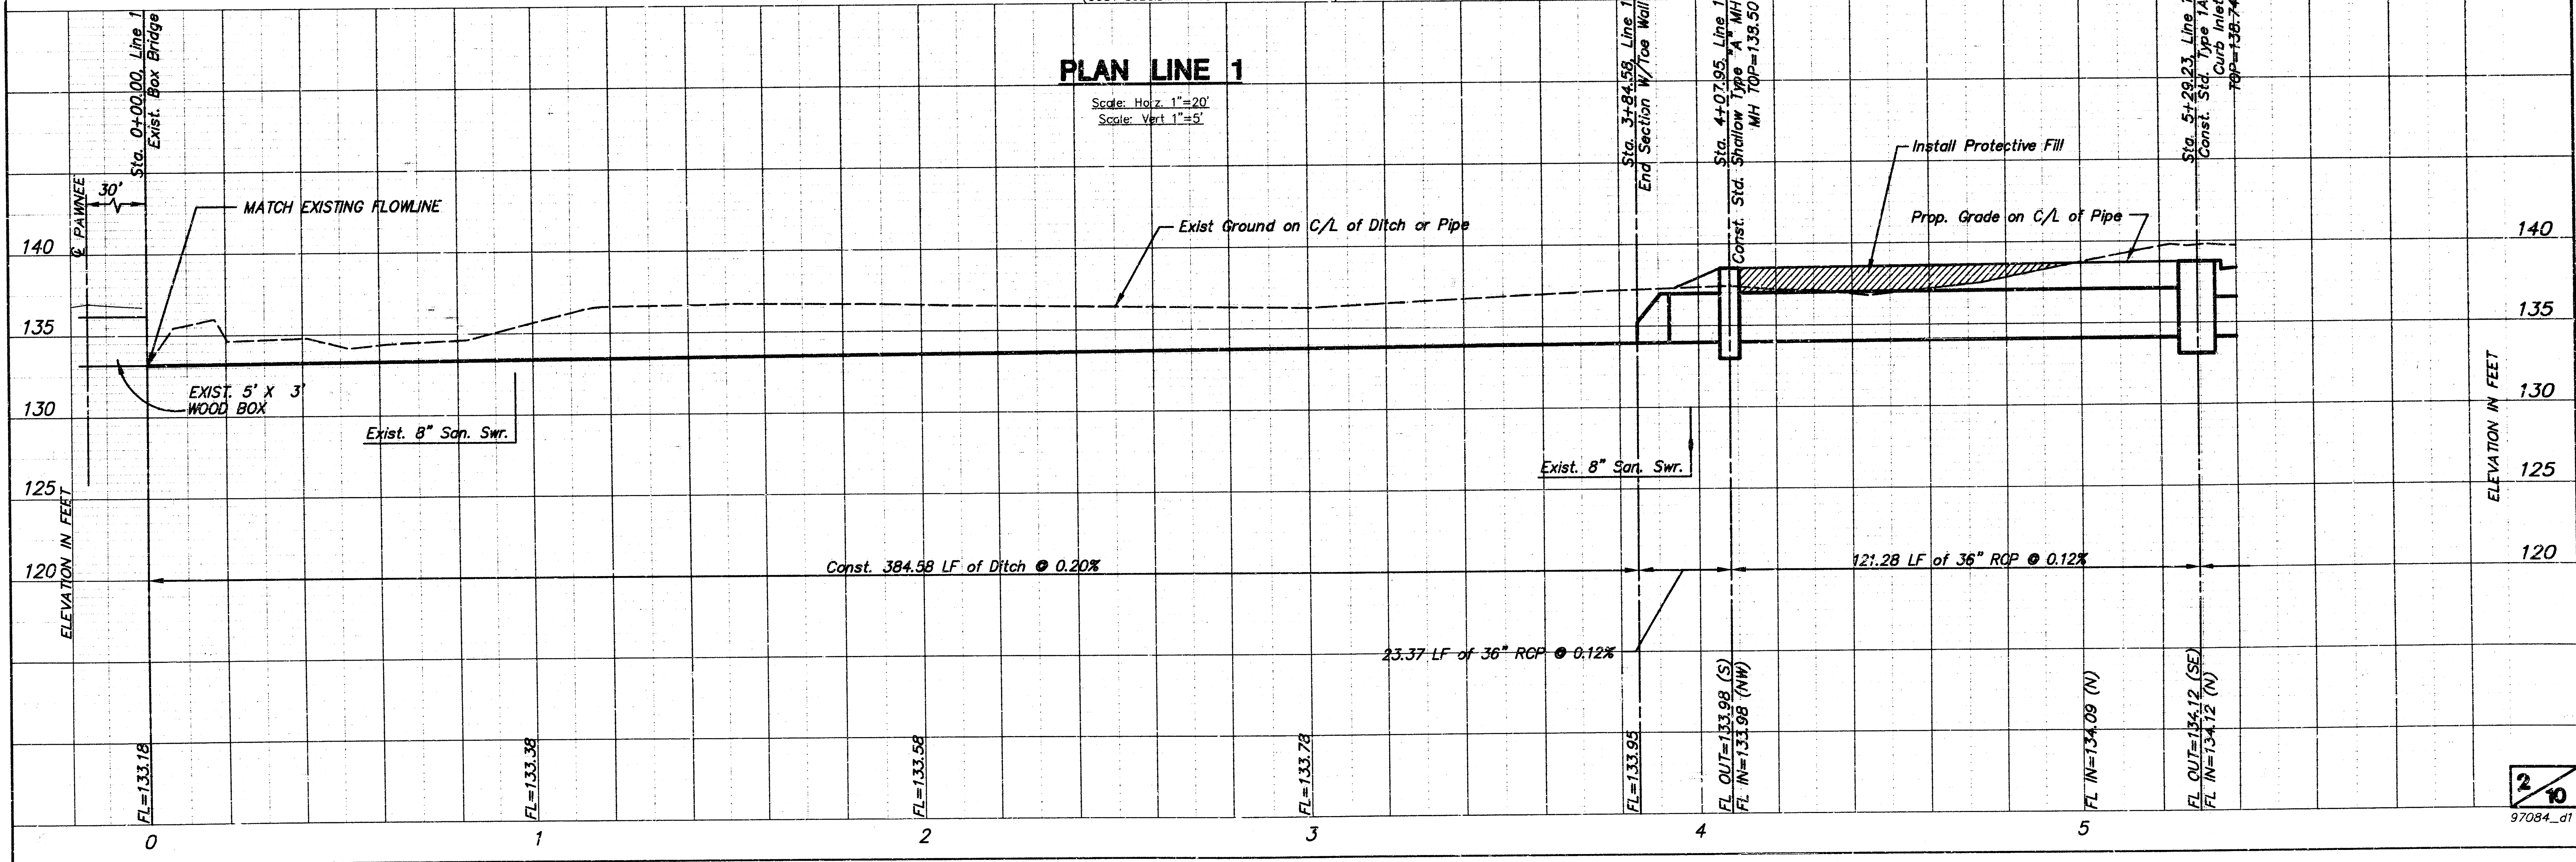


PRAIRIE WOODS SECOND ADD.
STORM WATER SEWER PLANS
LINE 1


Prairie Woods 2nd Addition

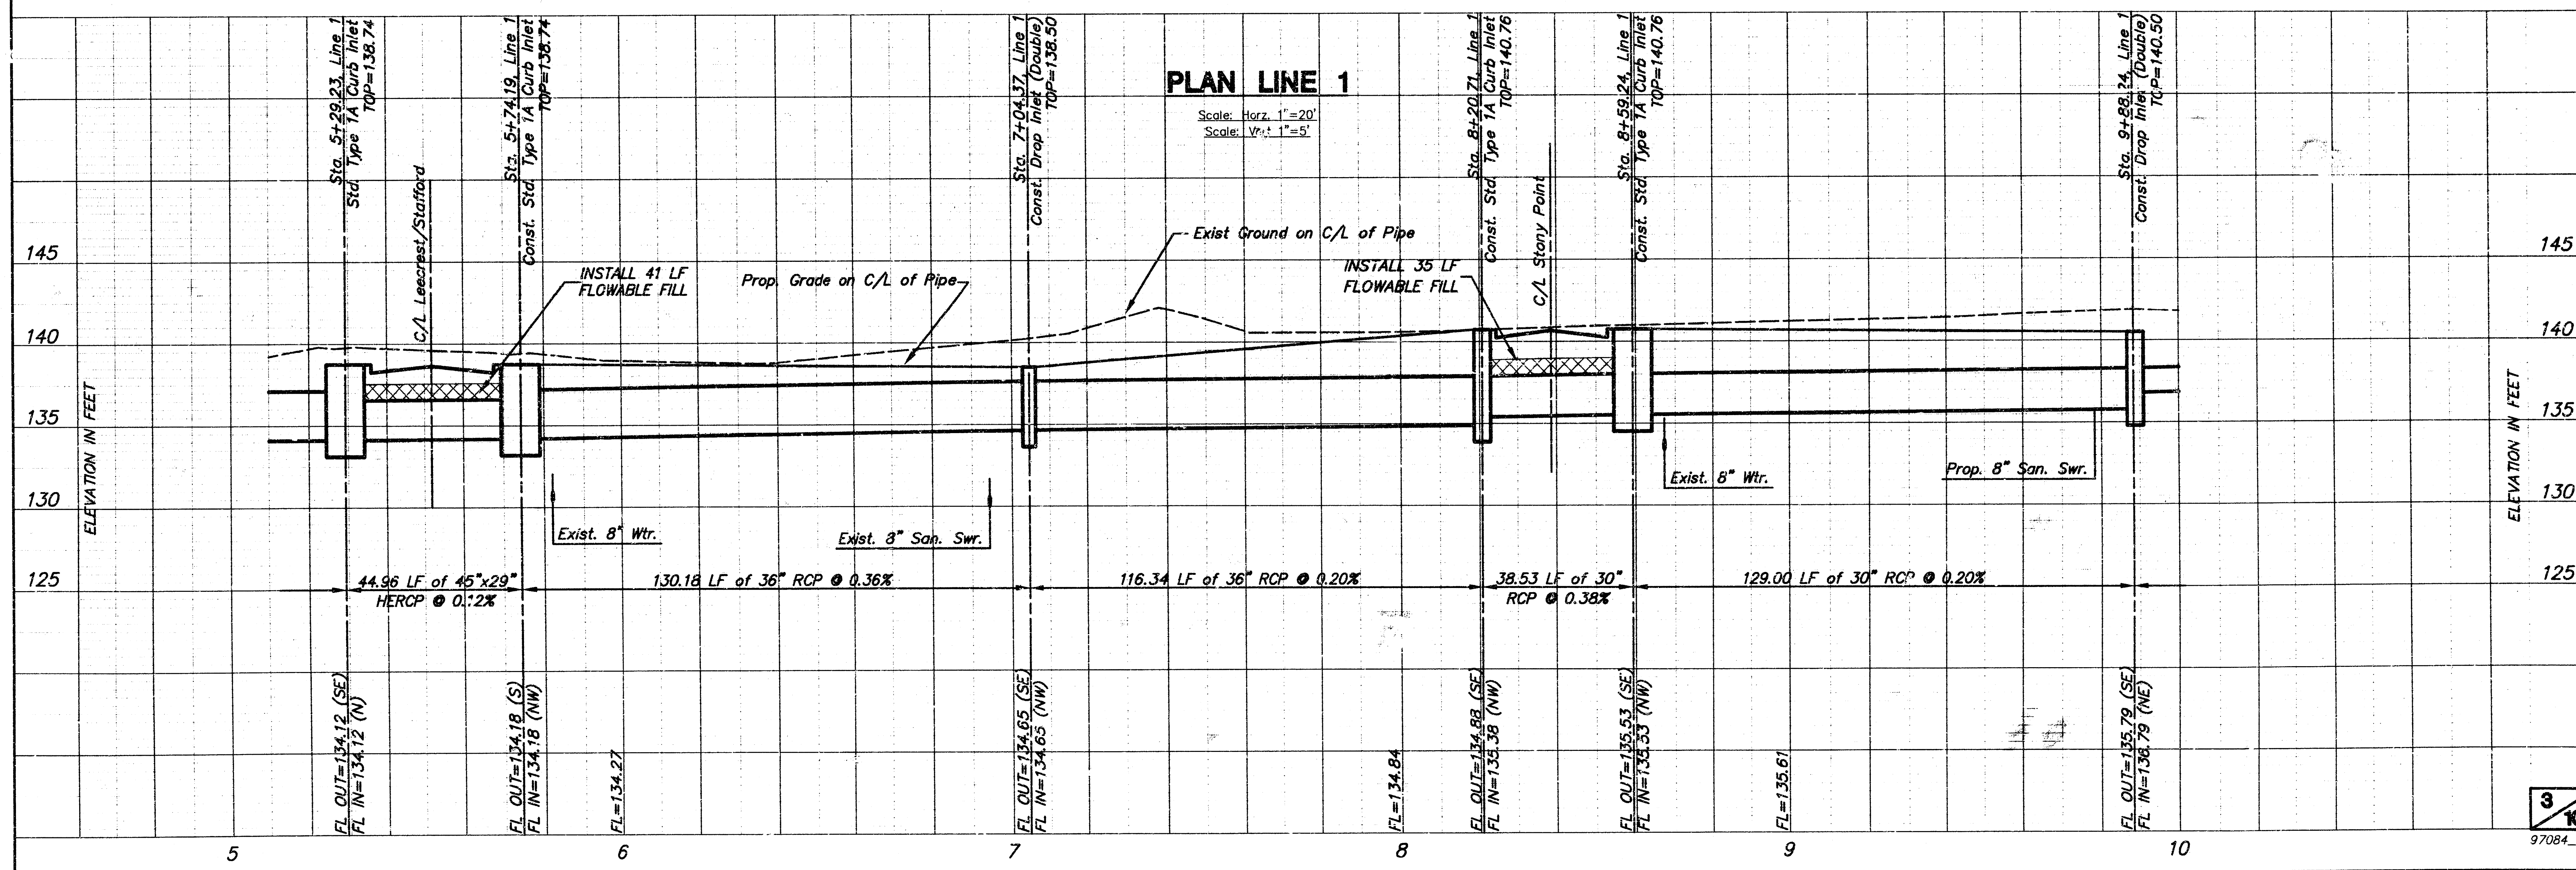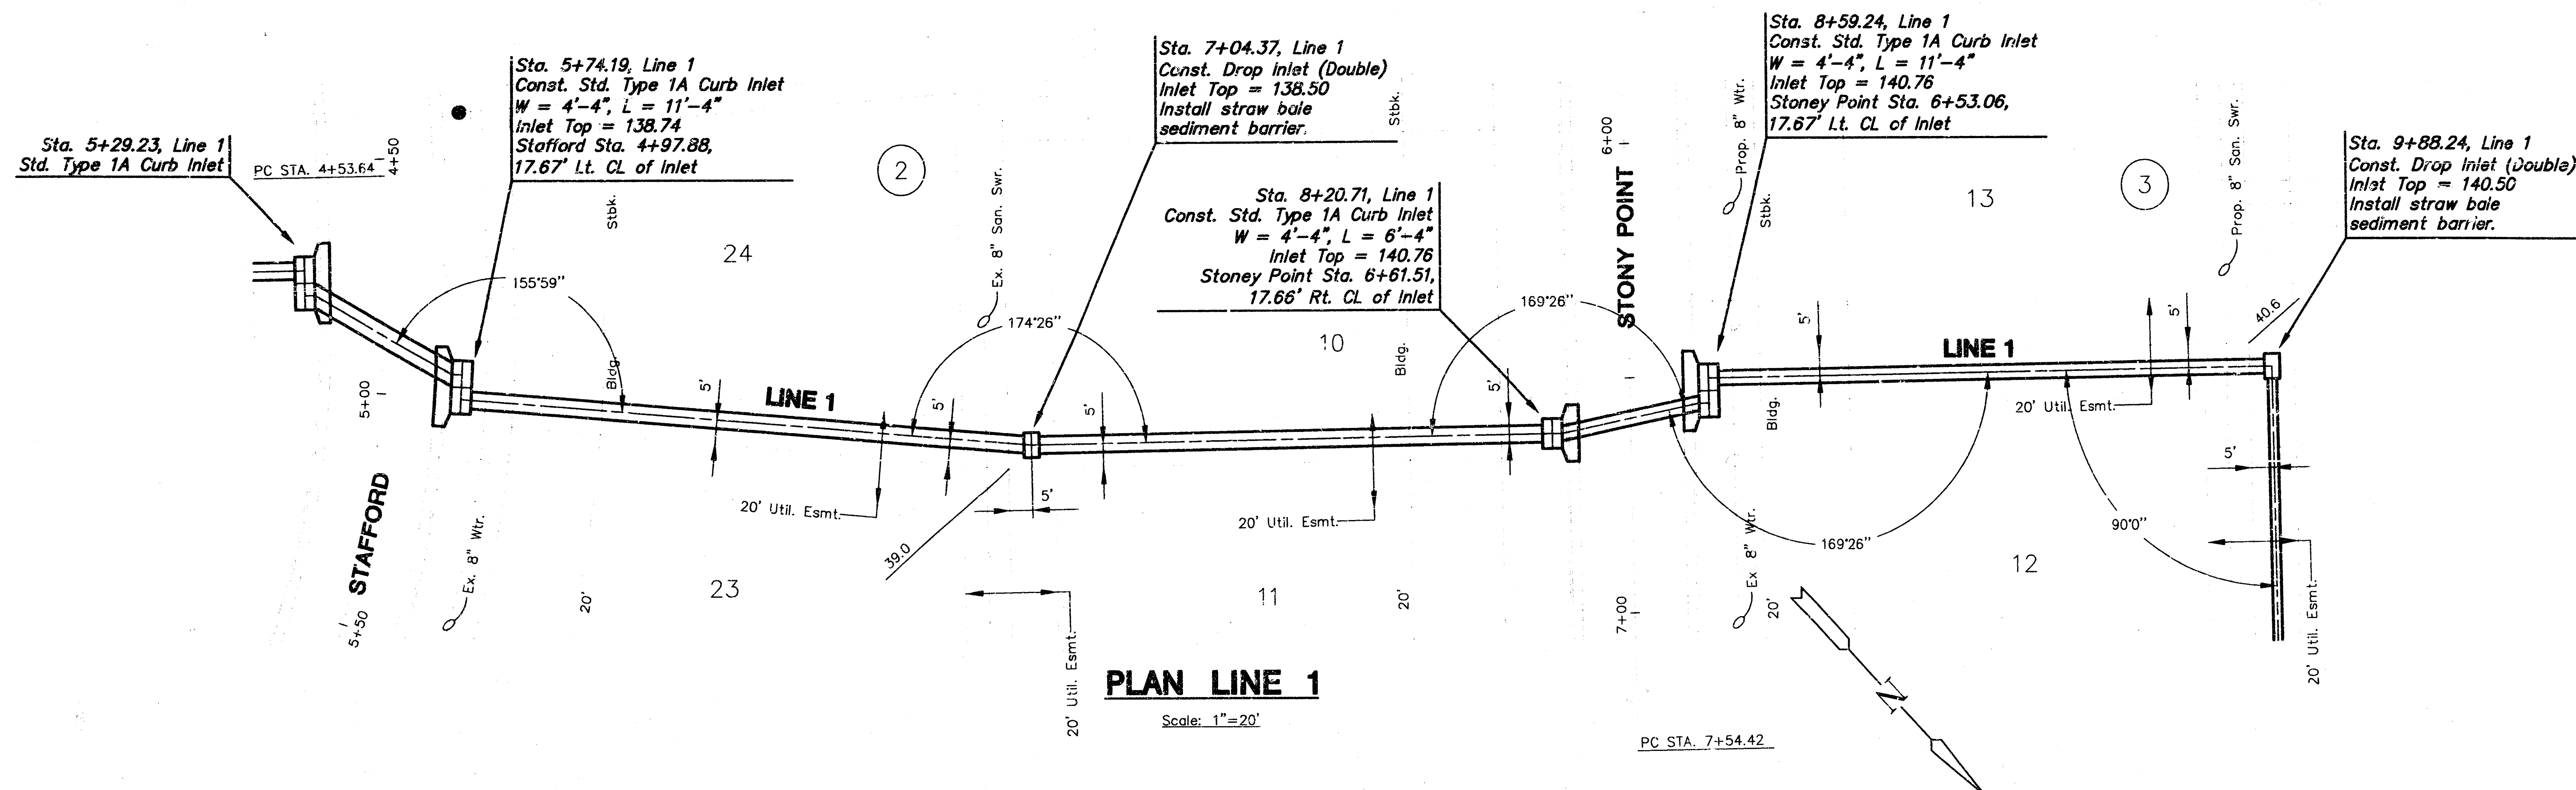


**PRAIRIE WOODS SECOND ADD.
STORM WATER SEWER PLANS
LINE 1**

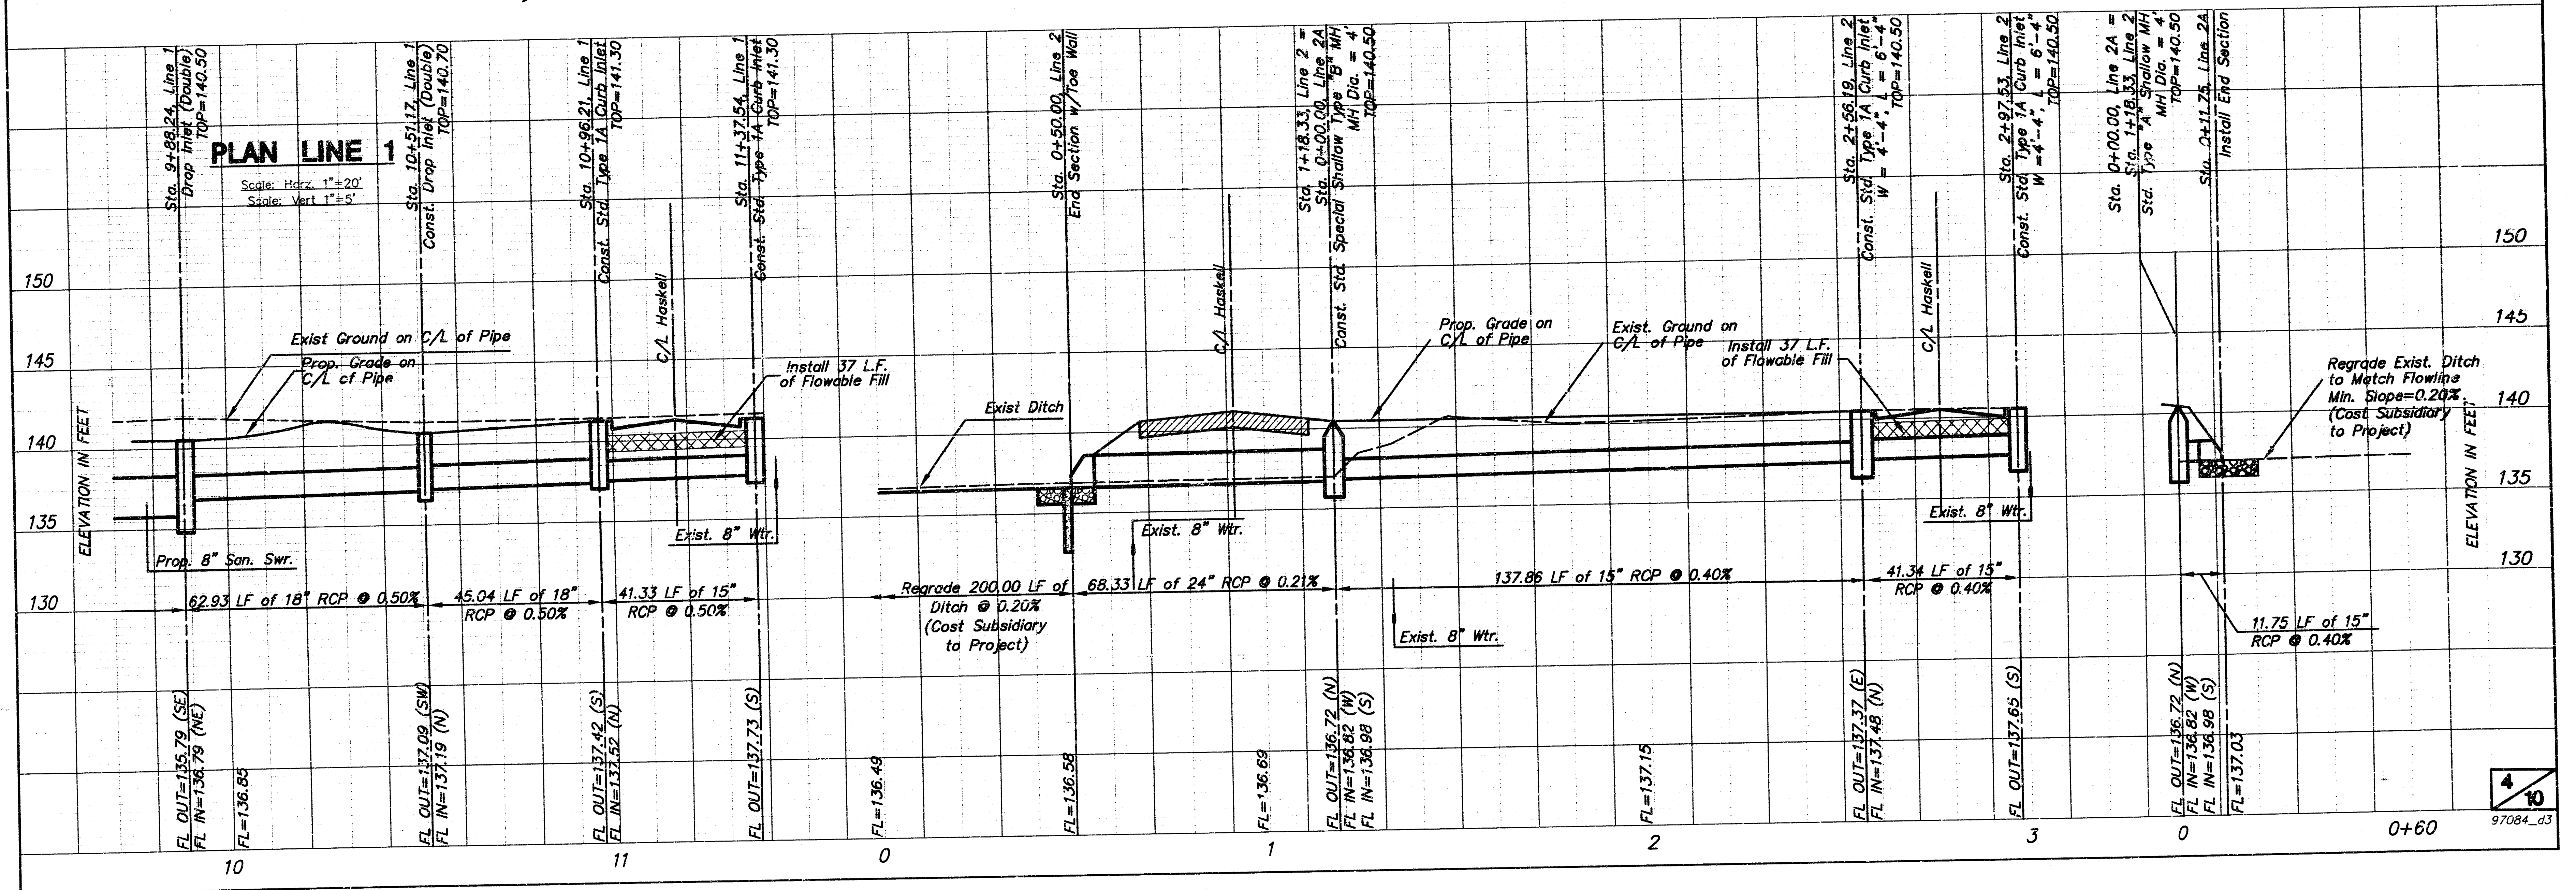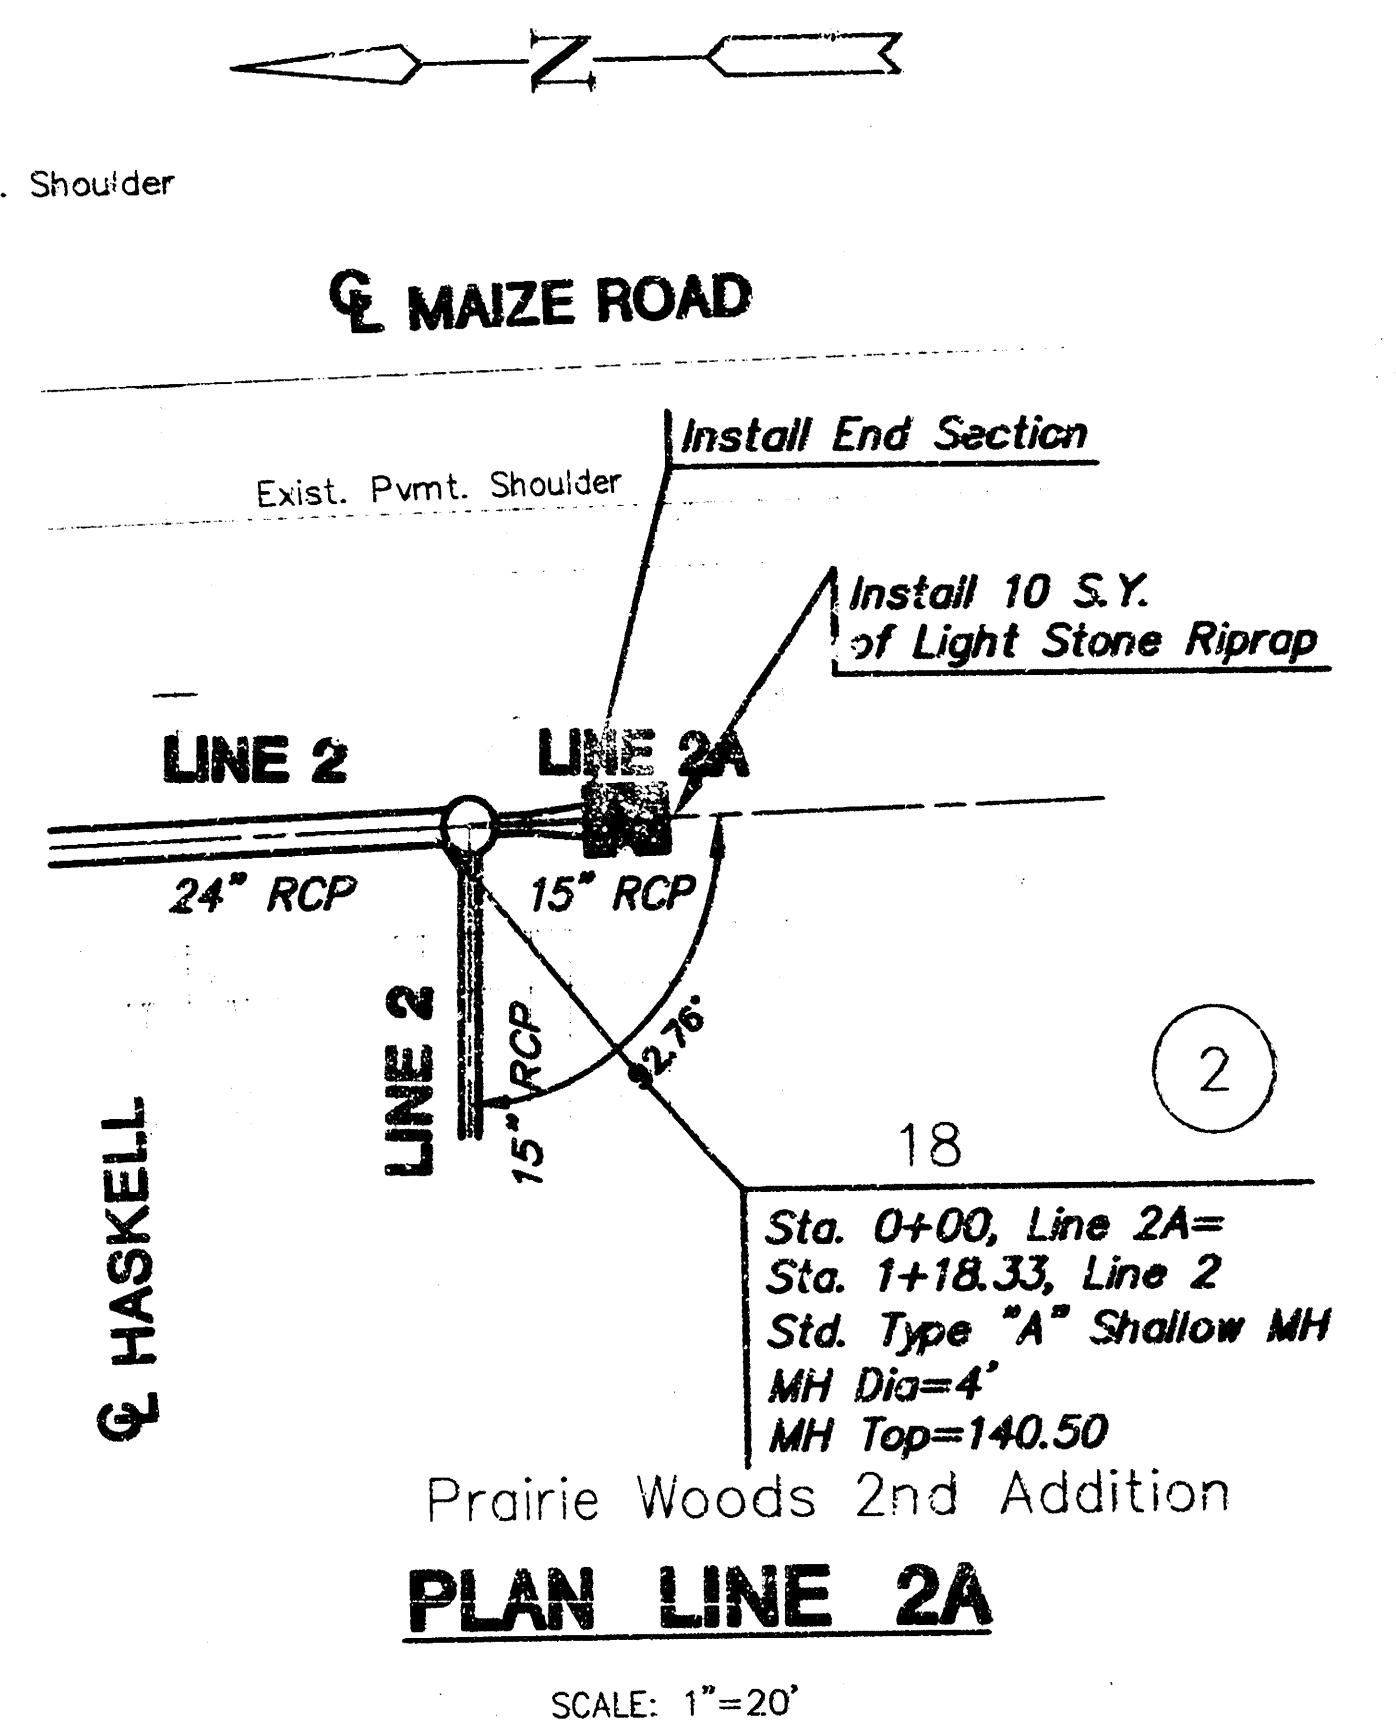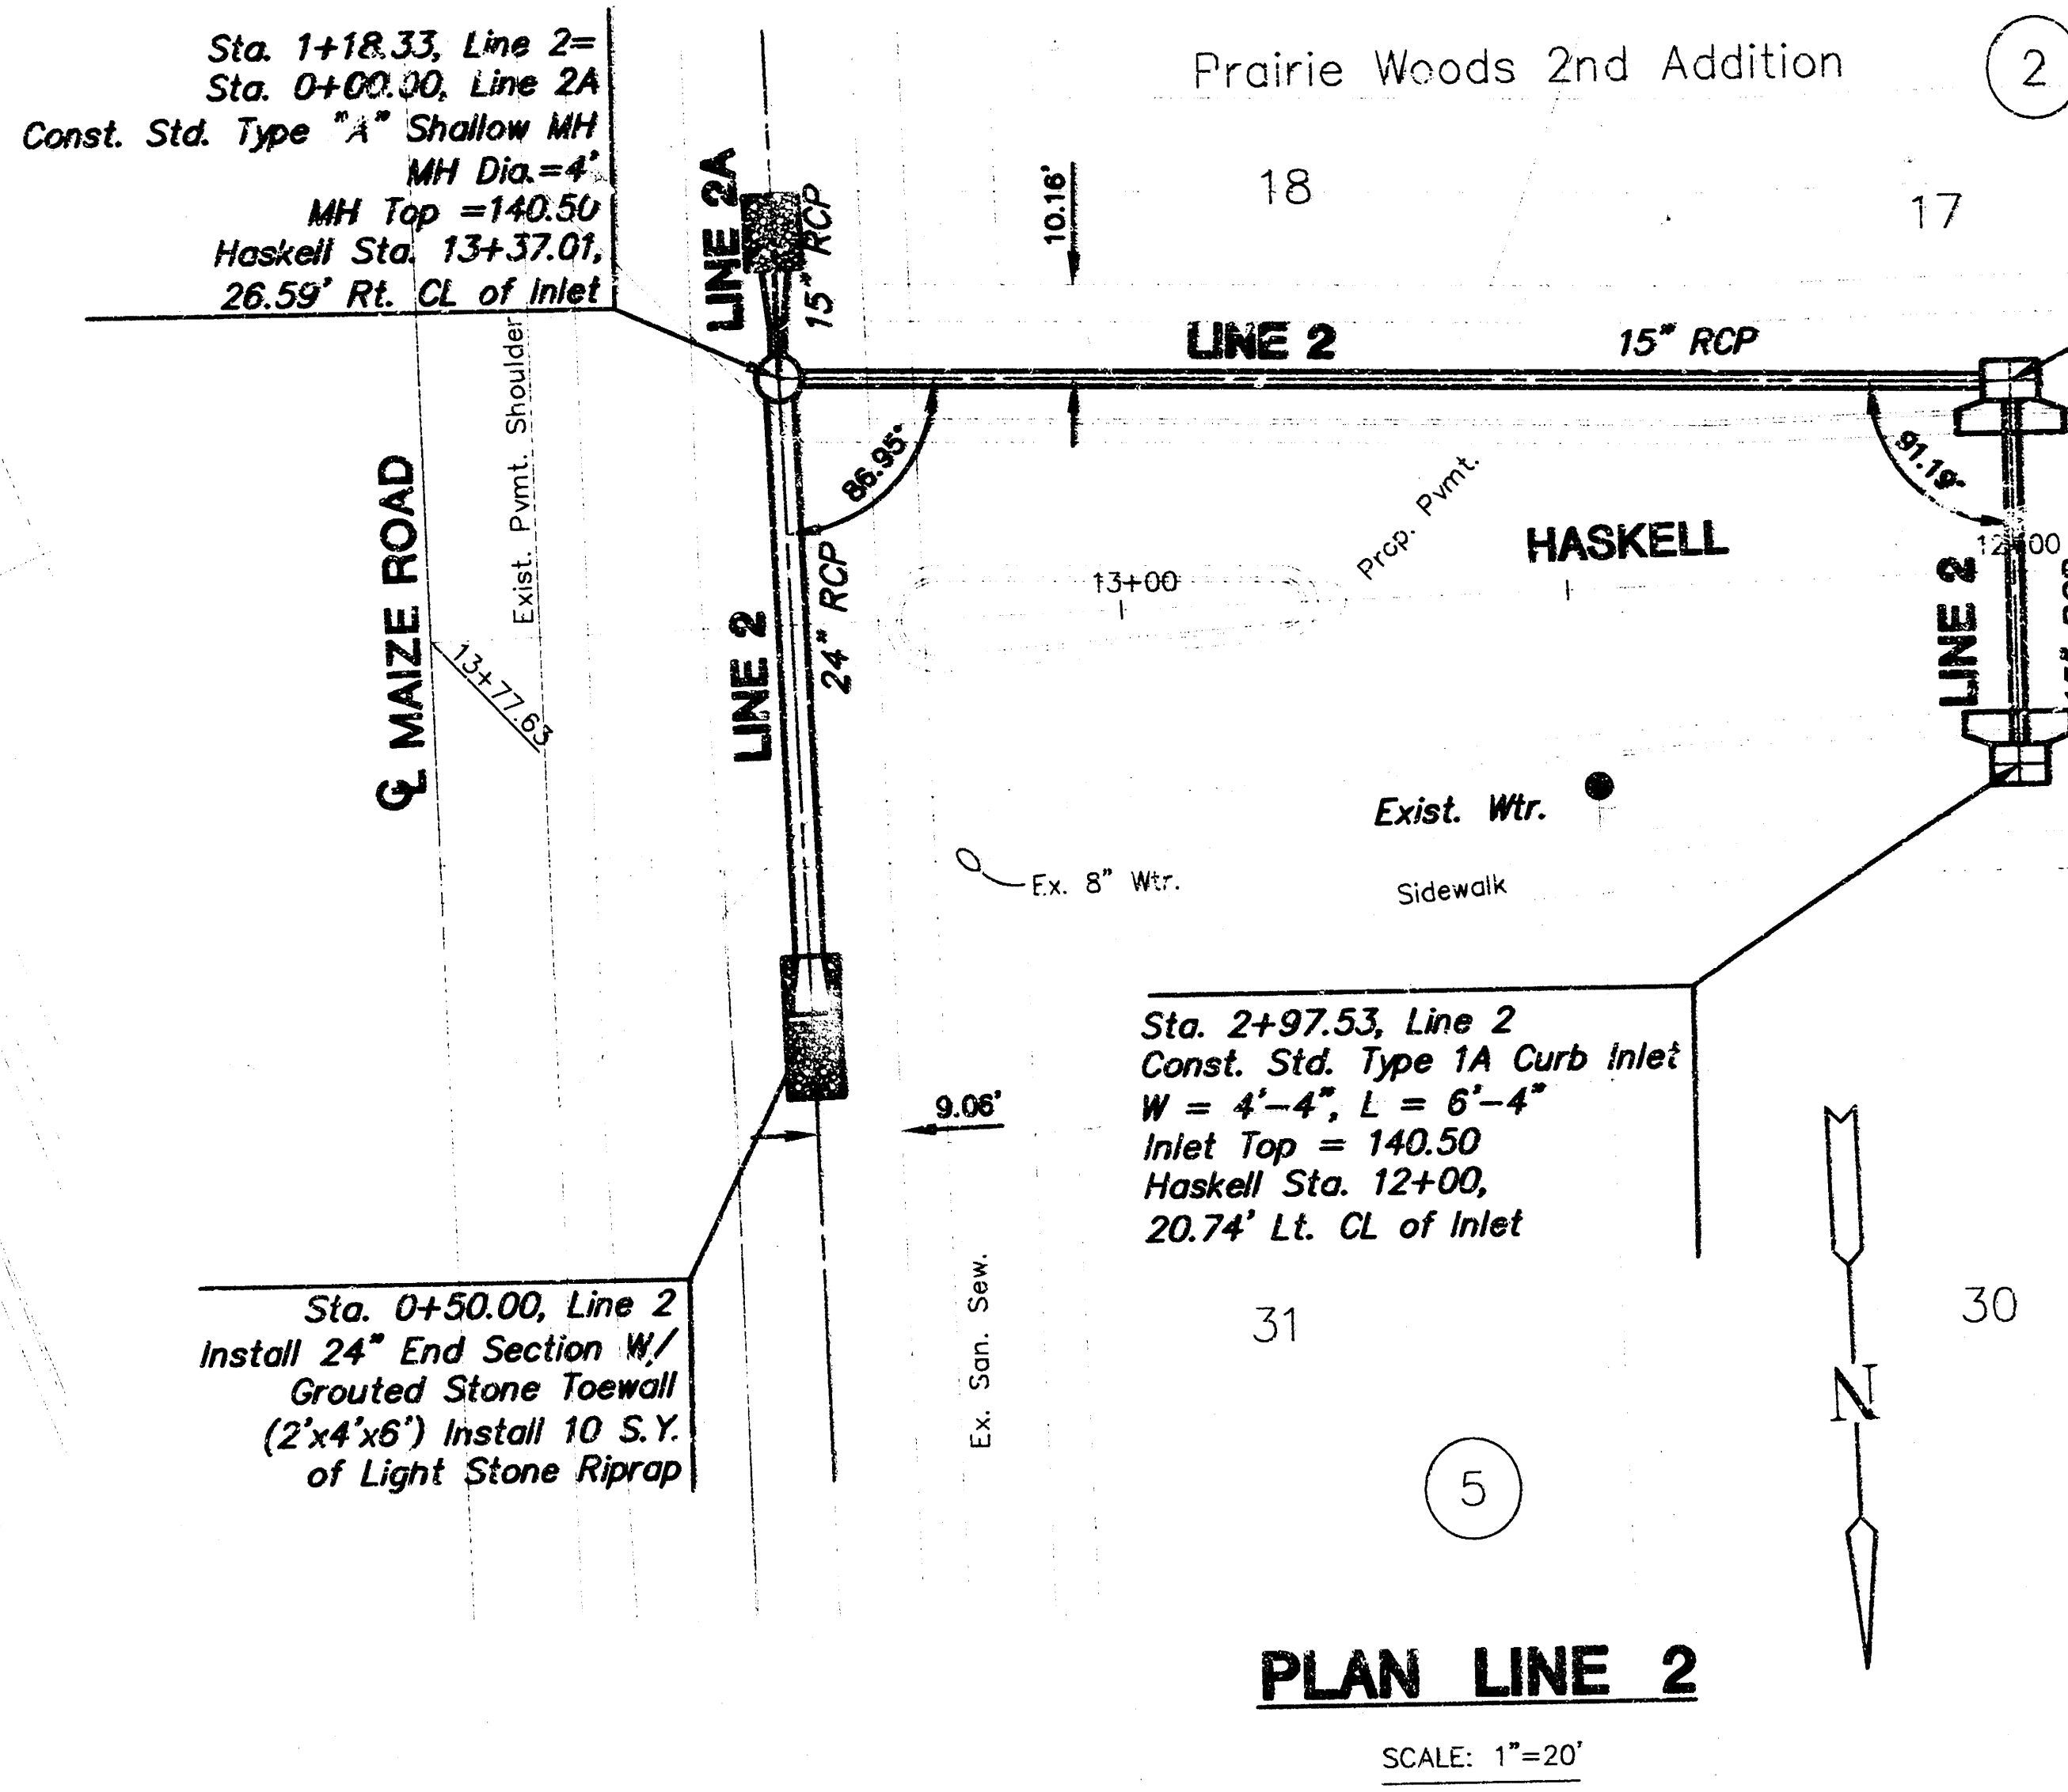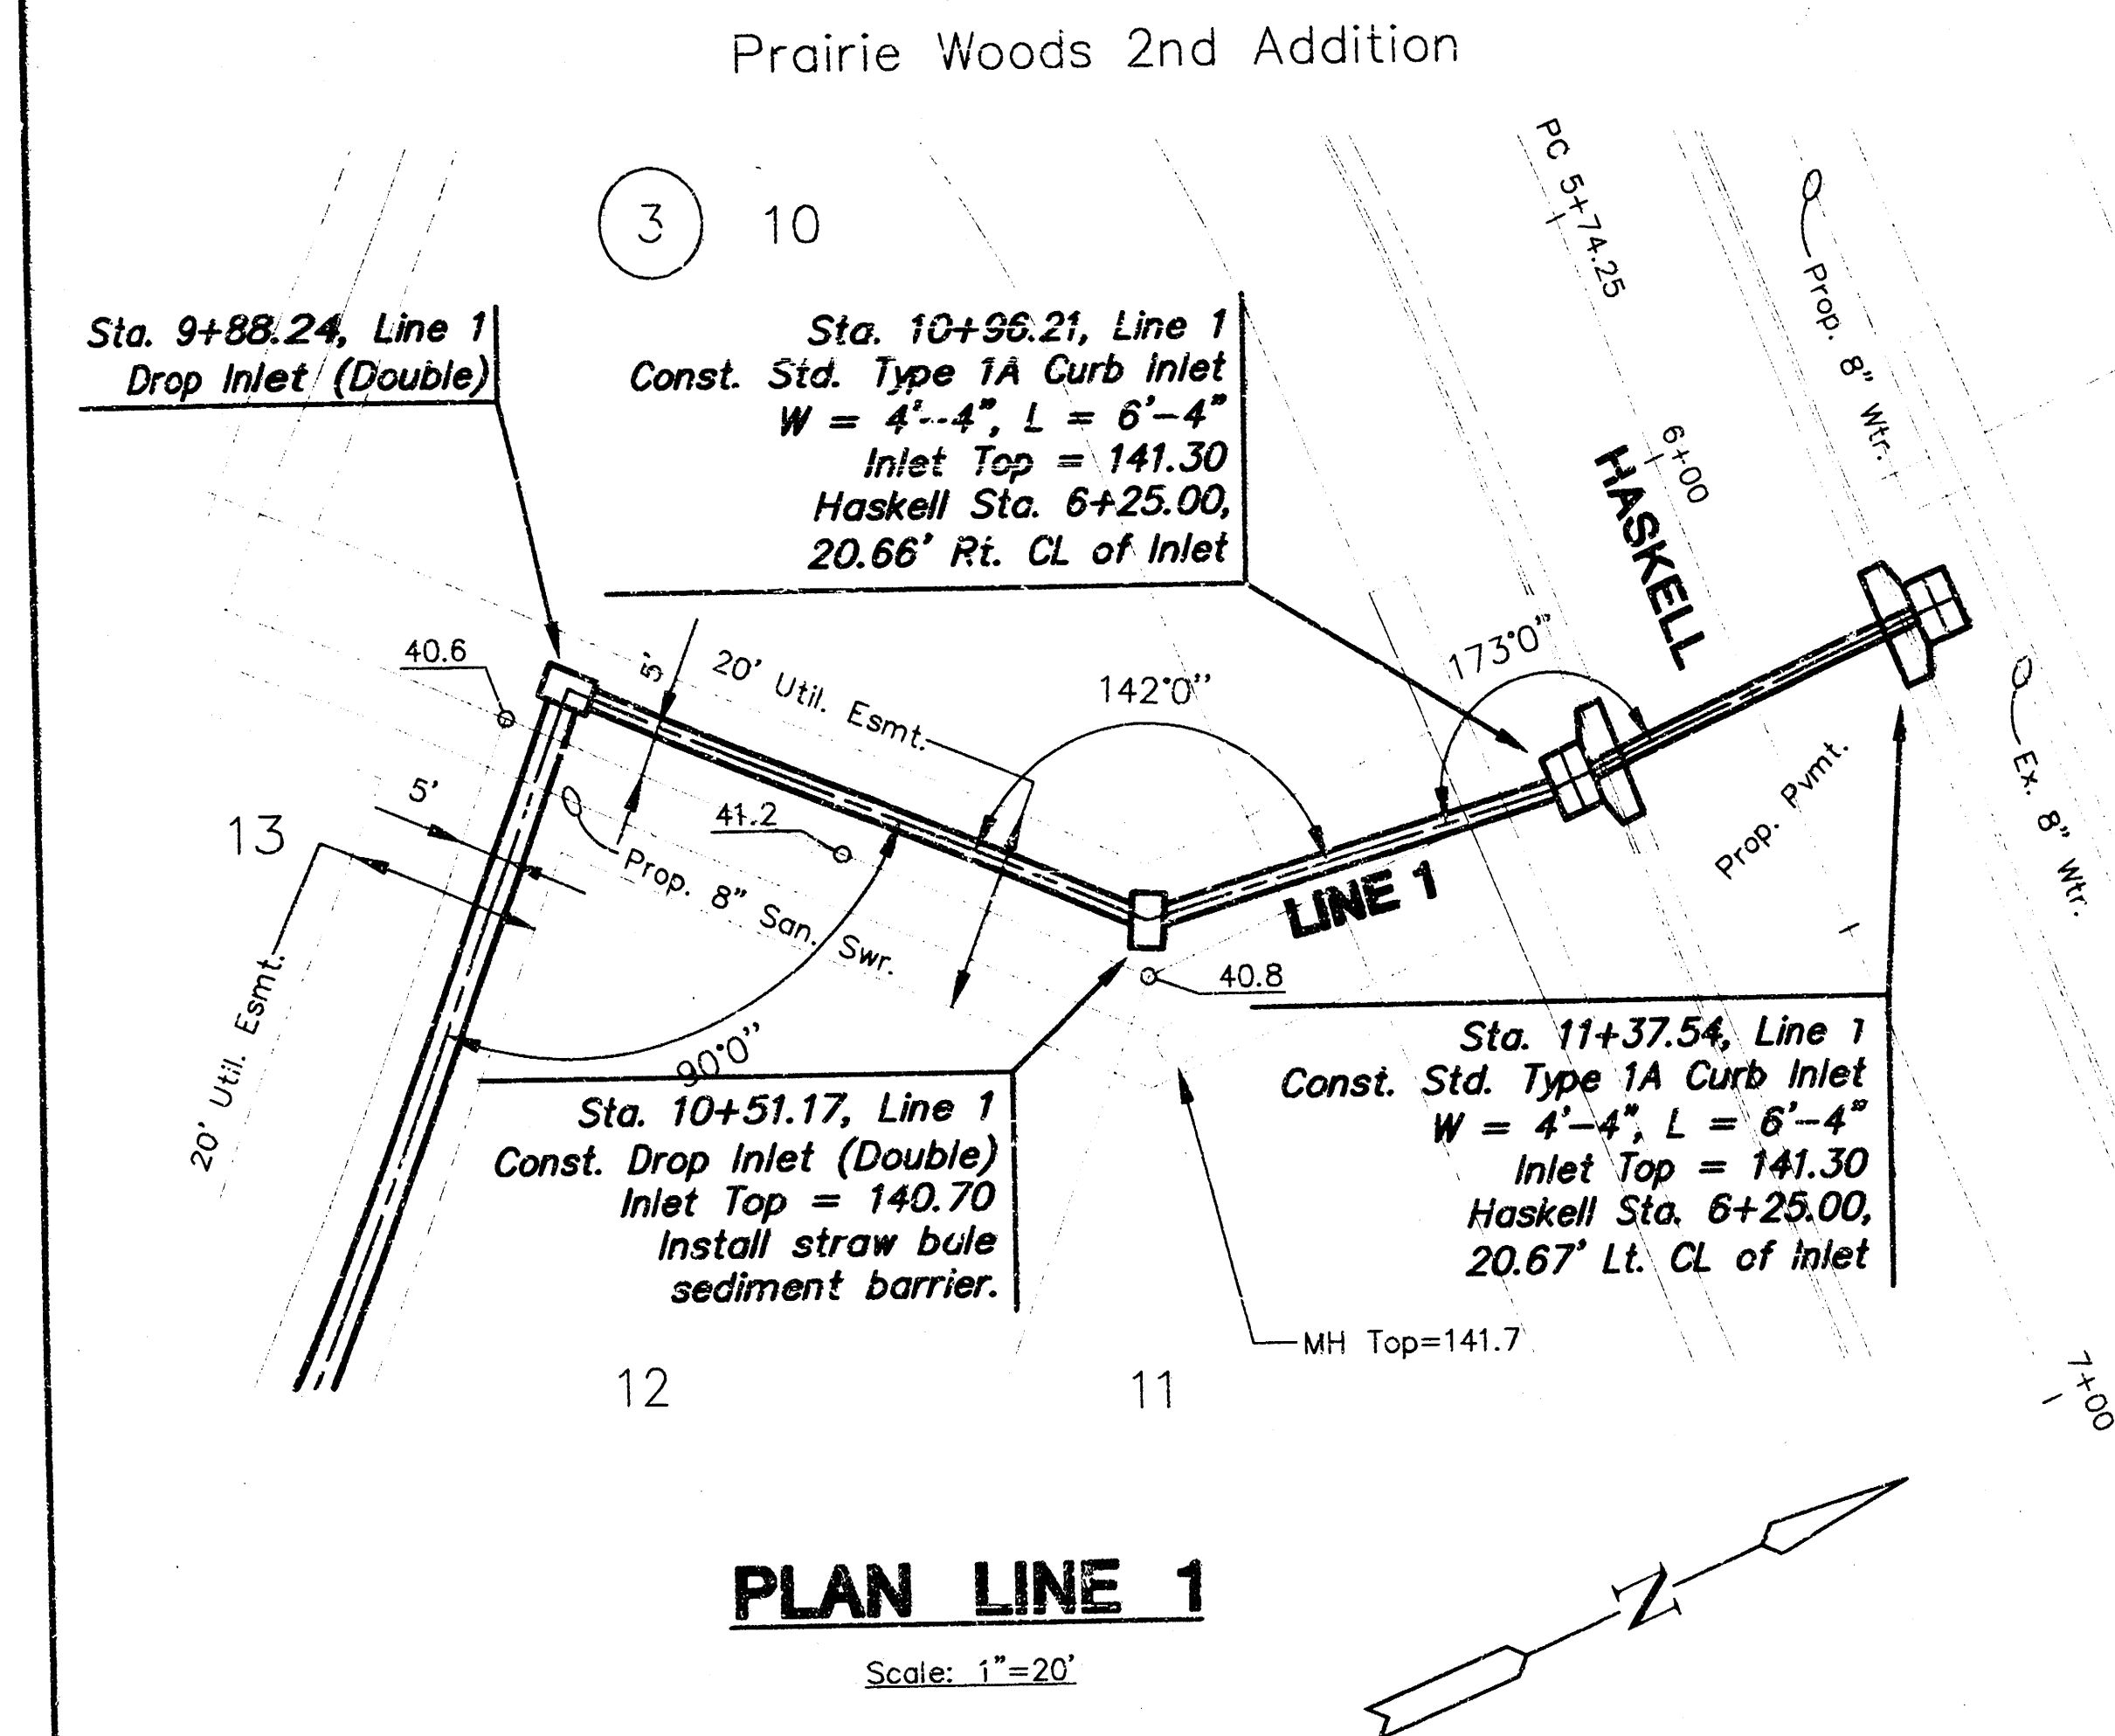


3+84.58

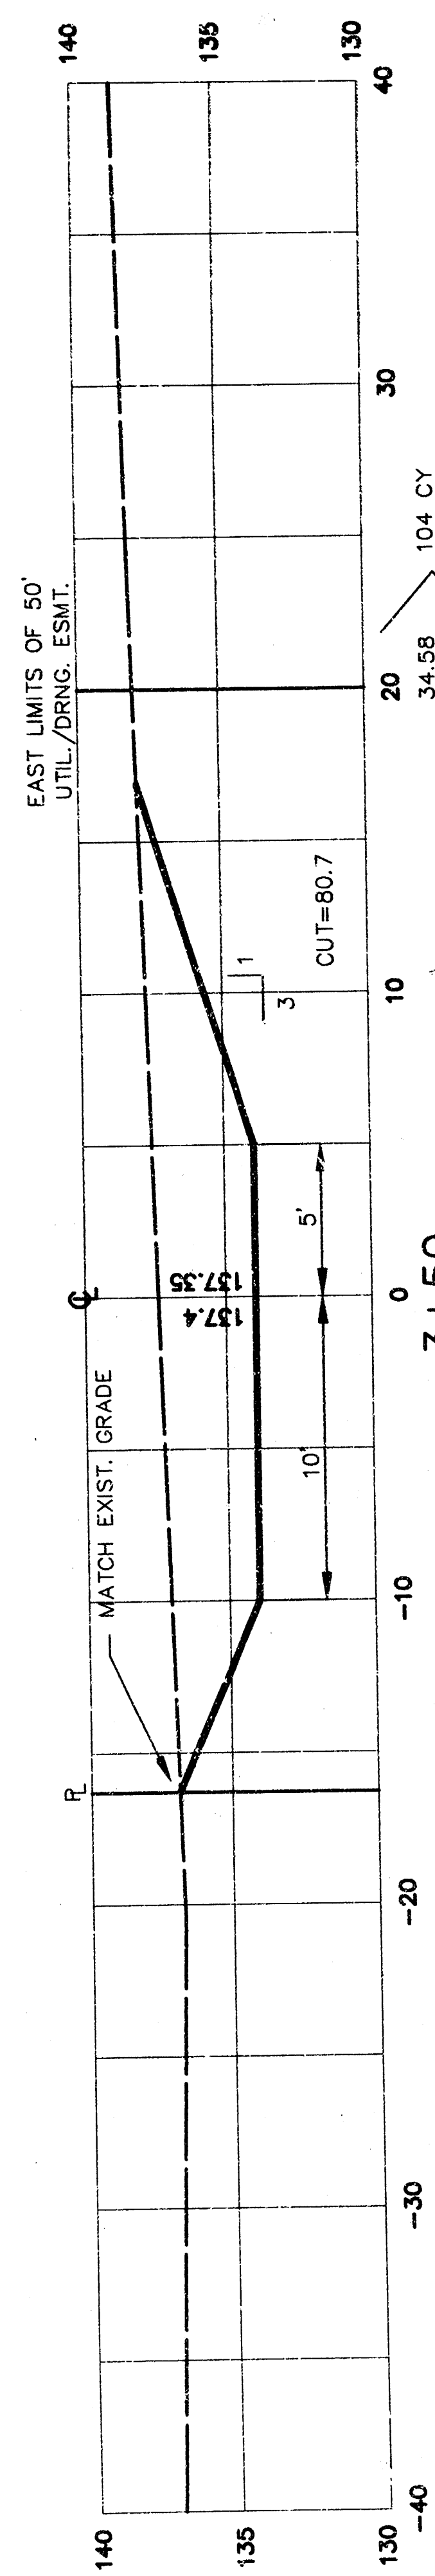


3+50

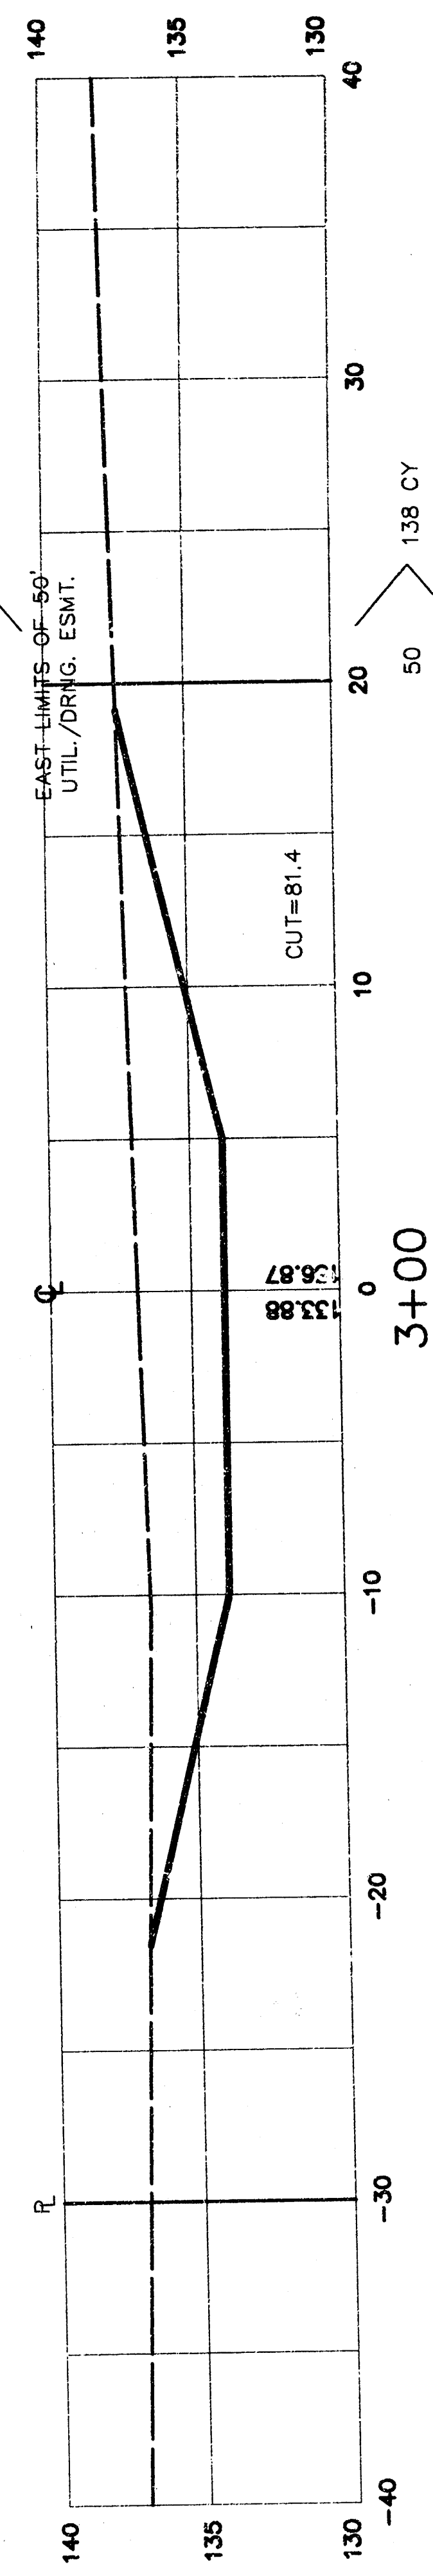


3+00

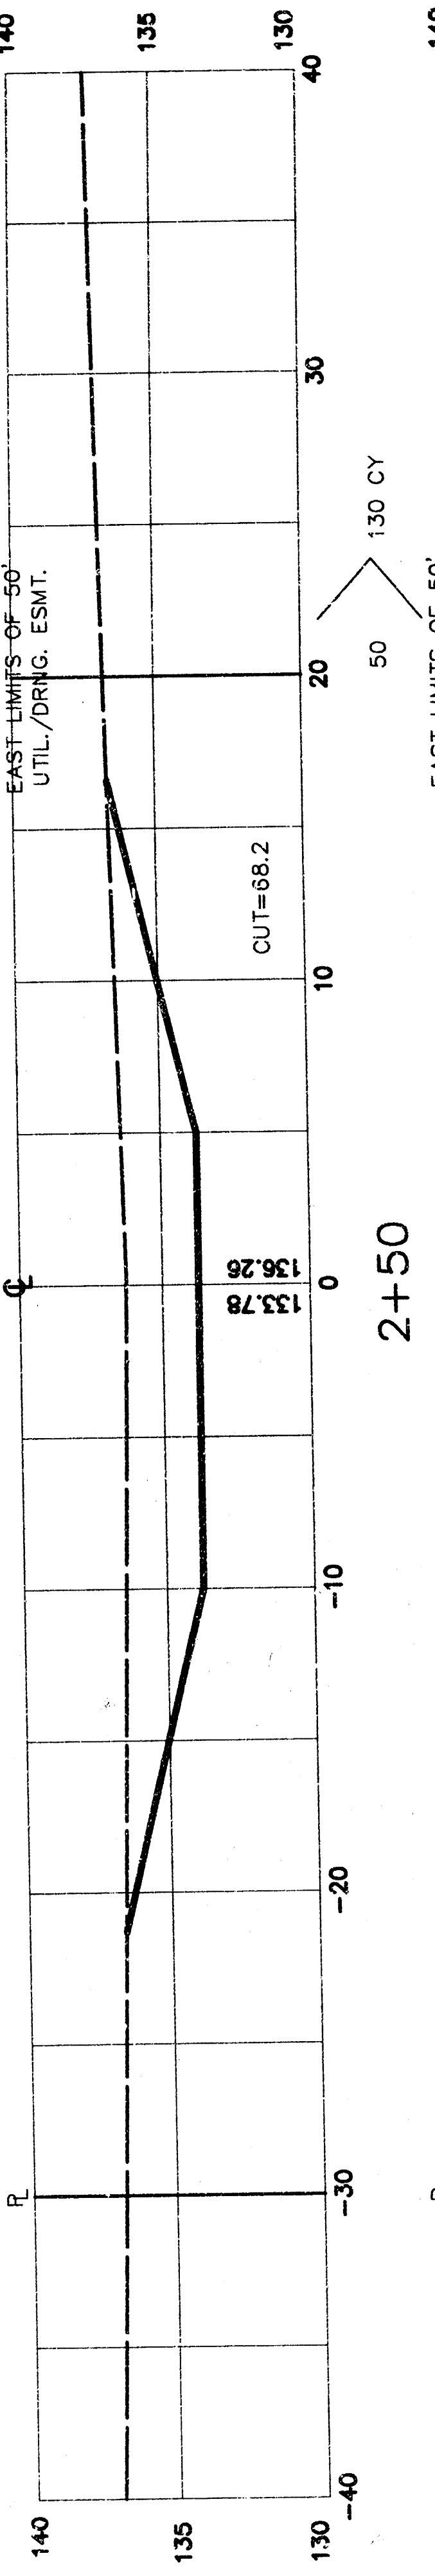


2+50

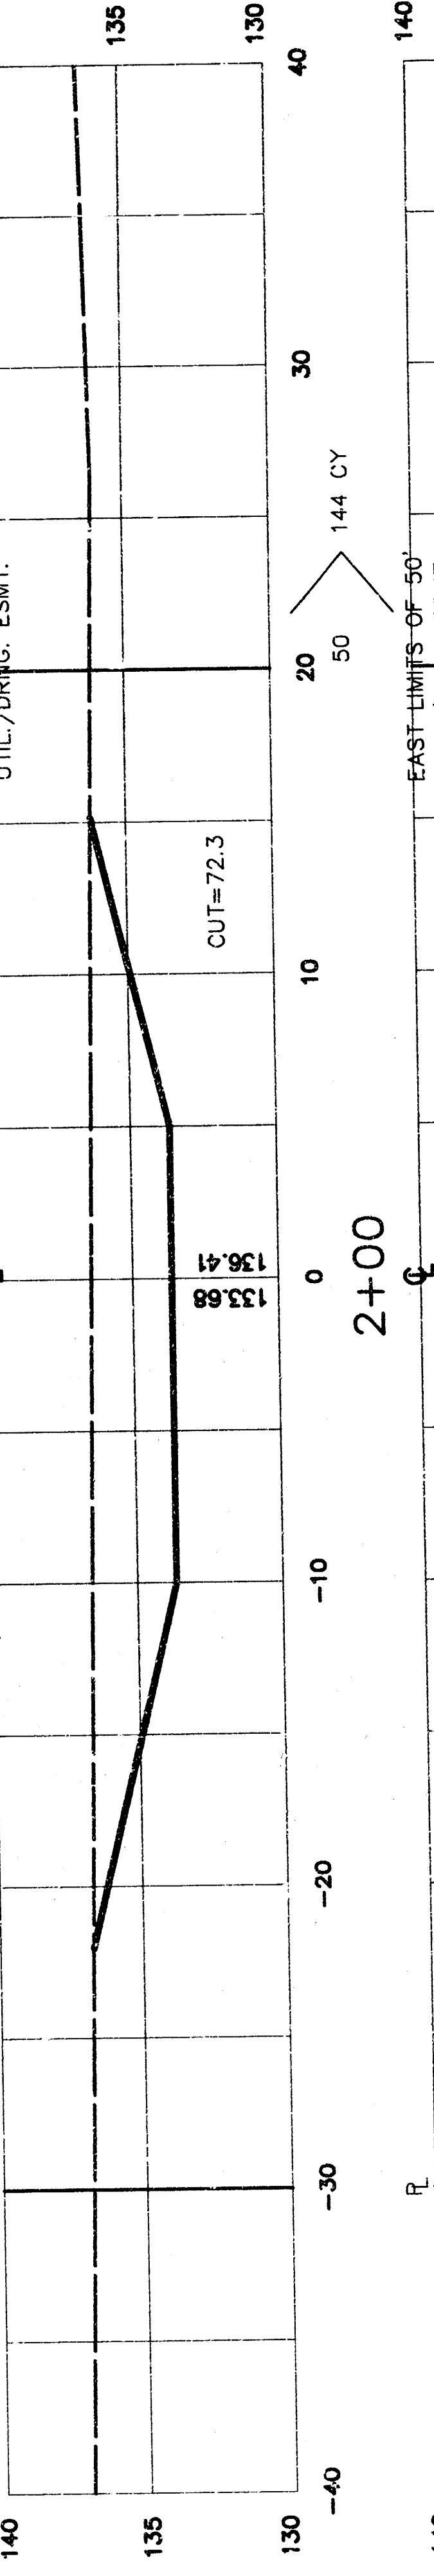


2+00

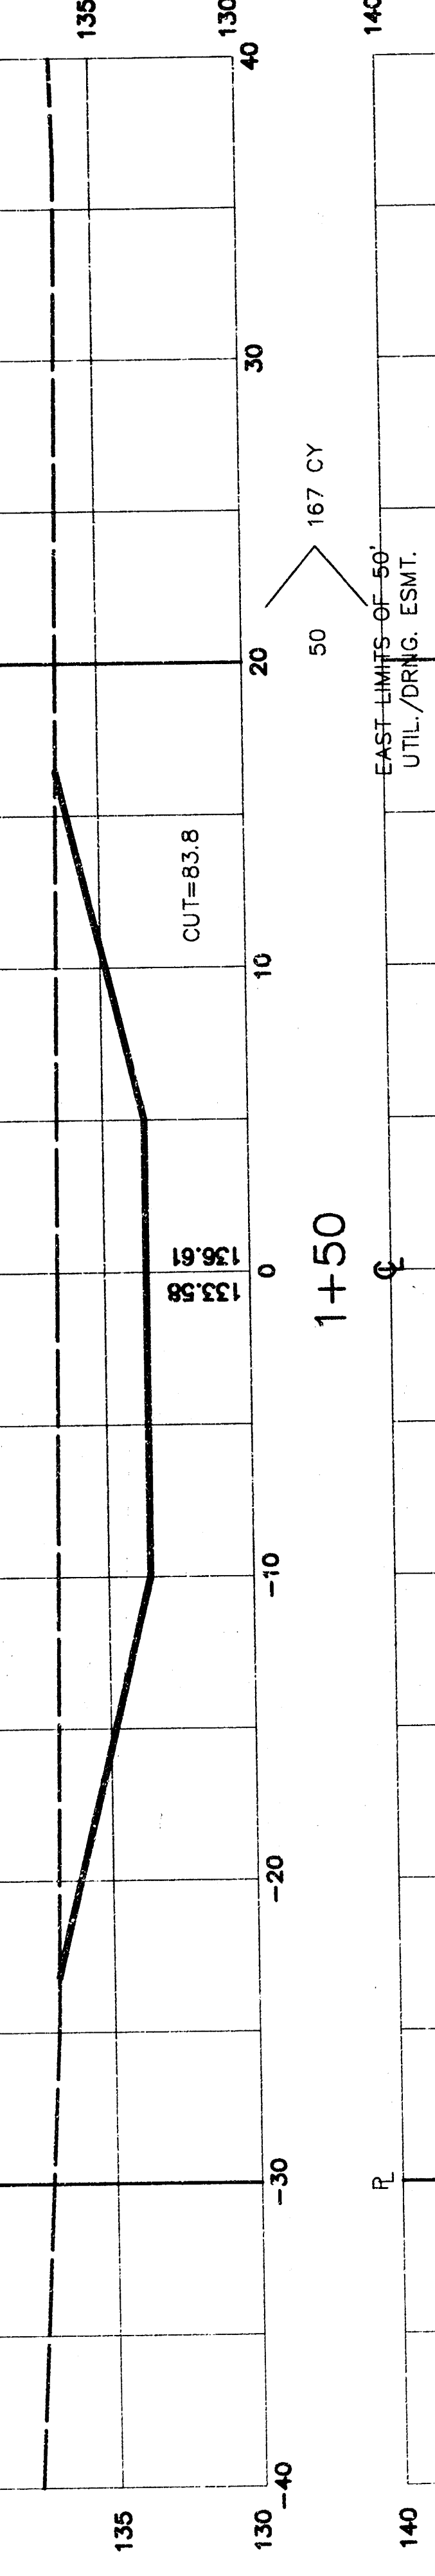


1+50

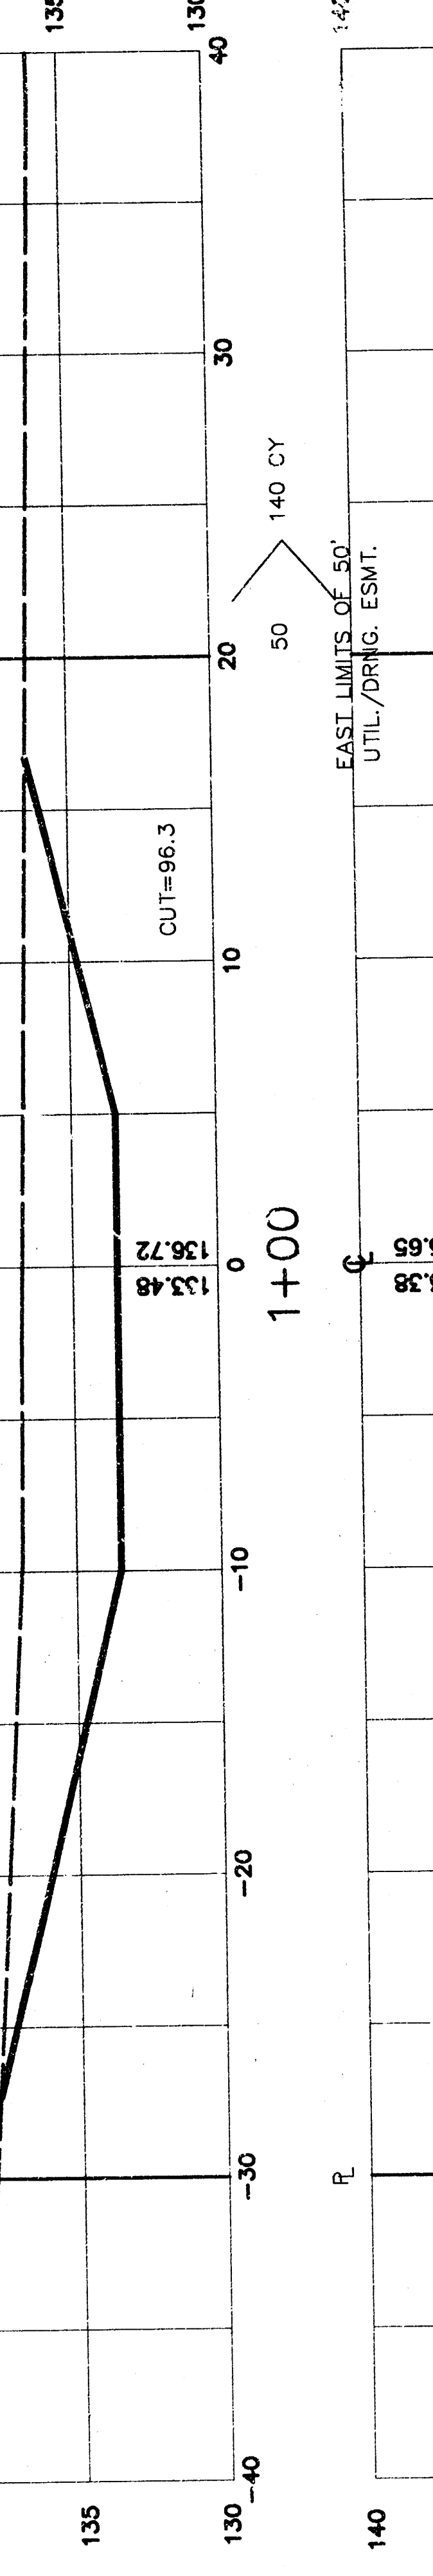


1+00





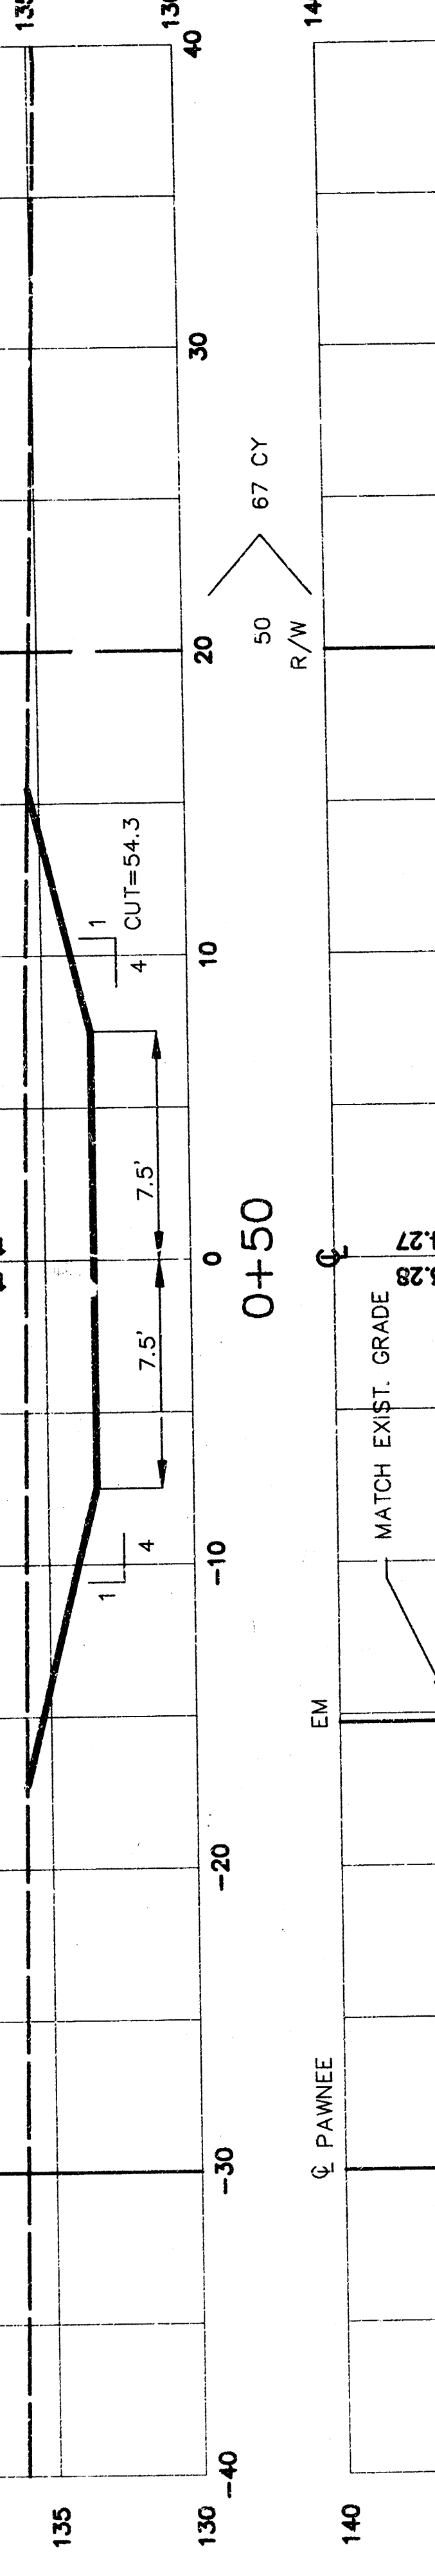


0+50

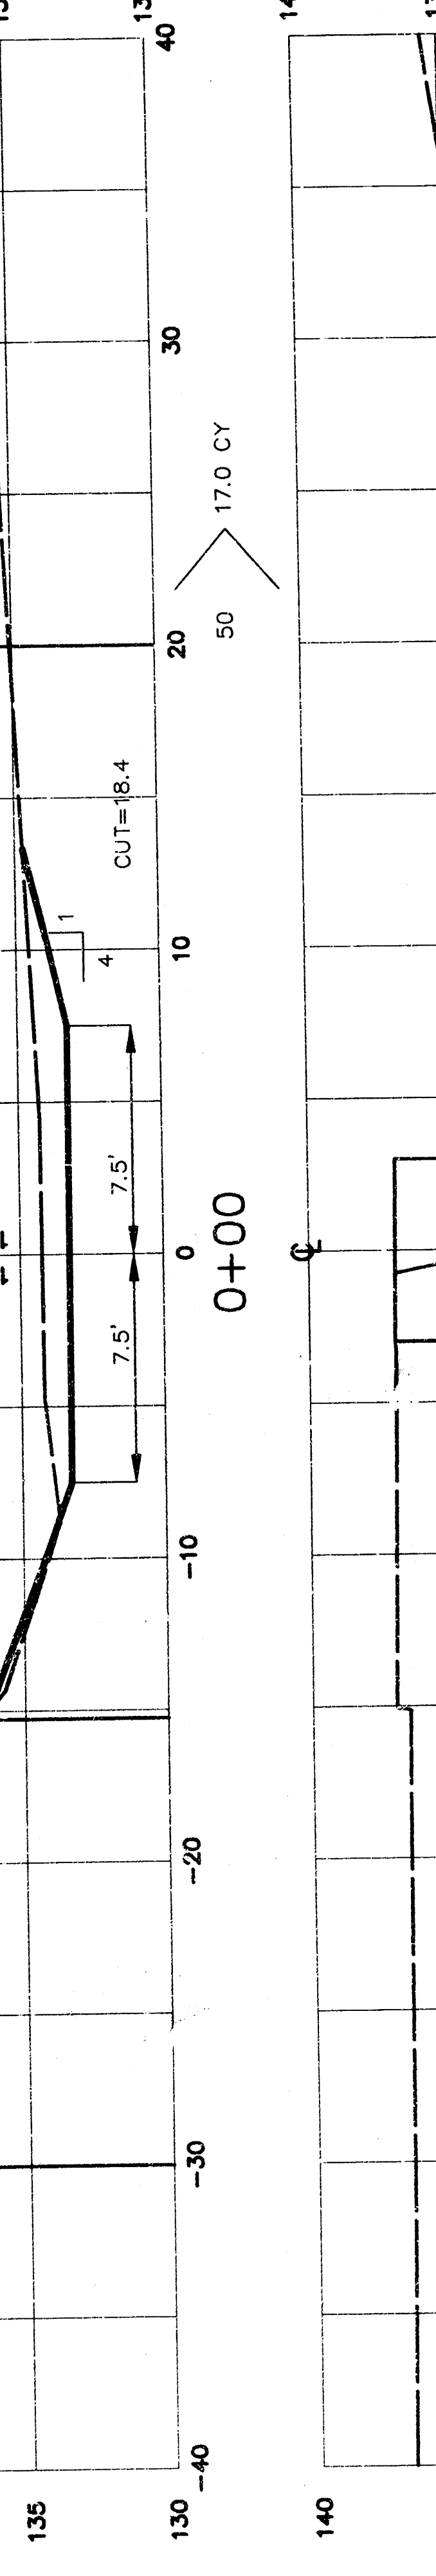

0+00

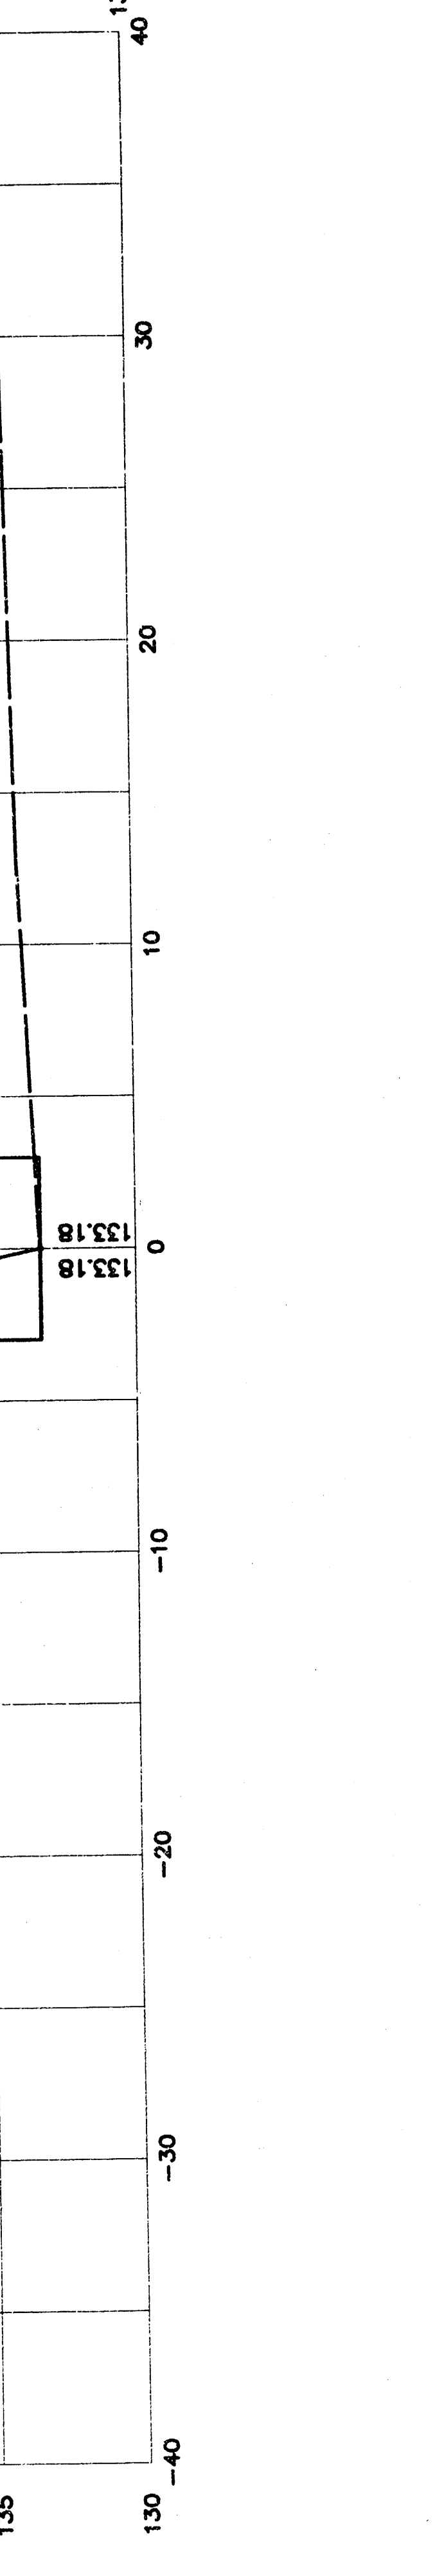

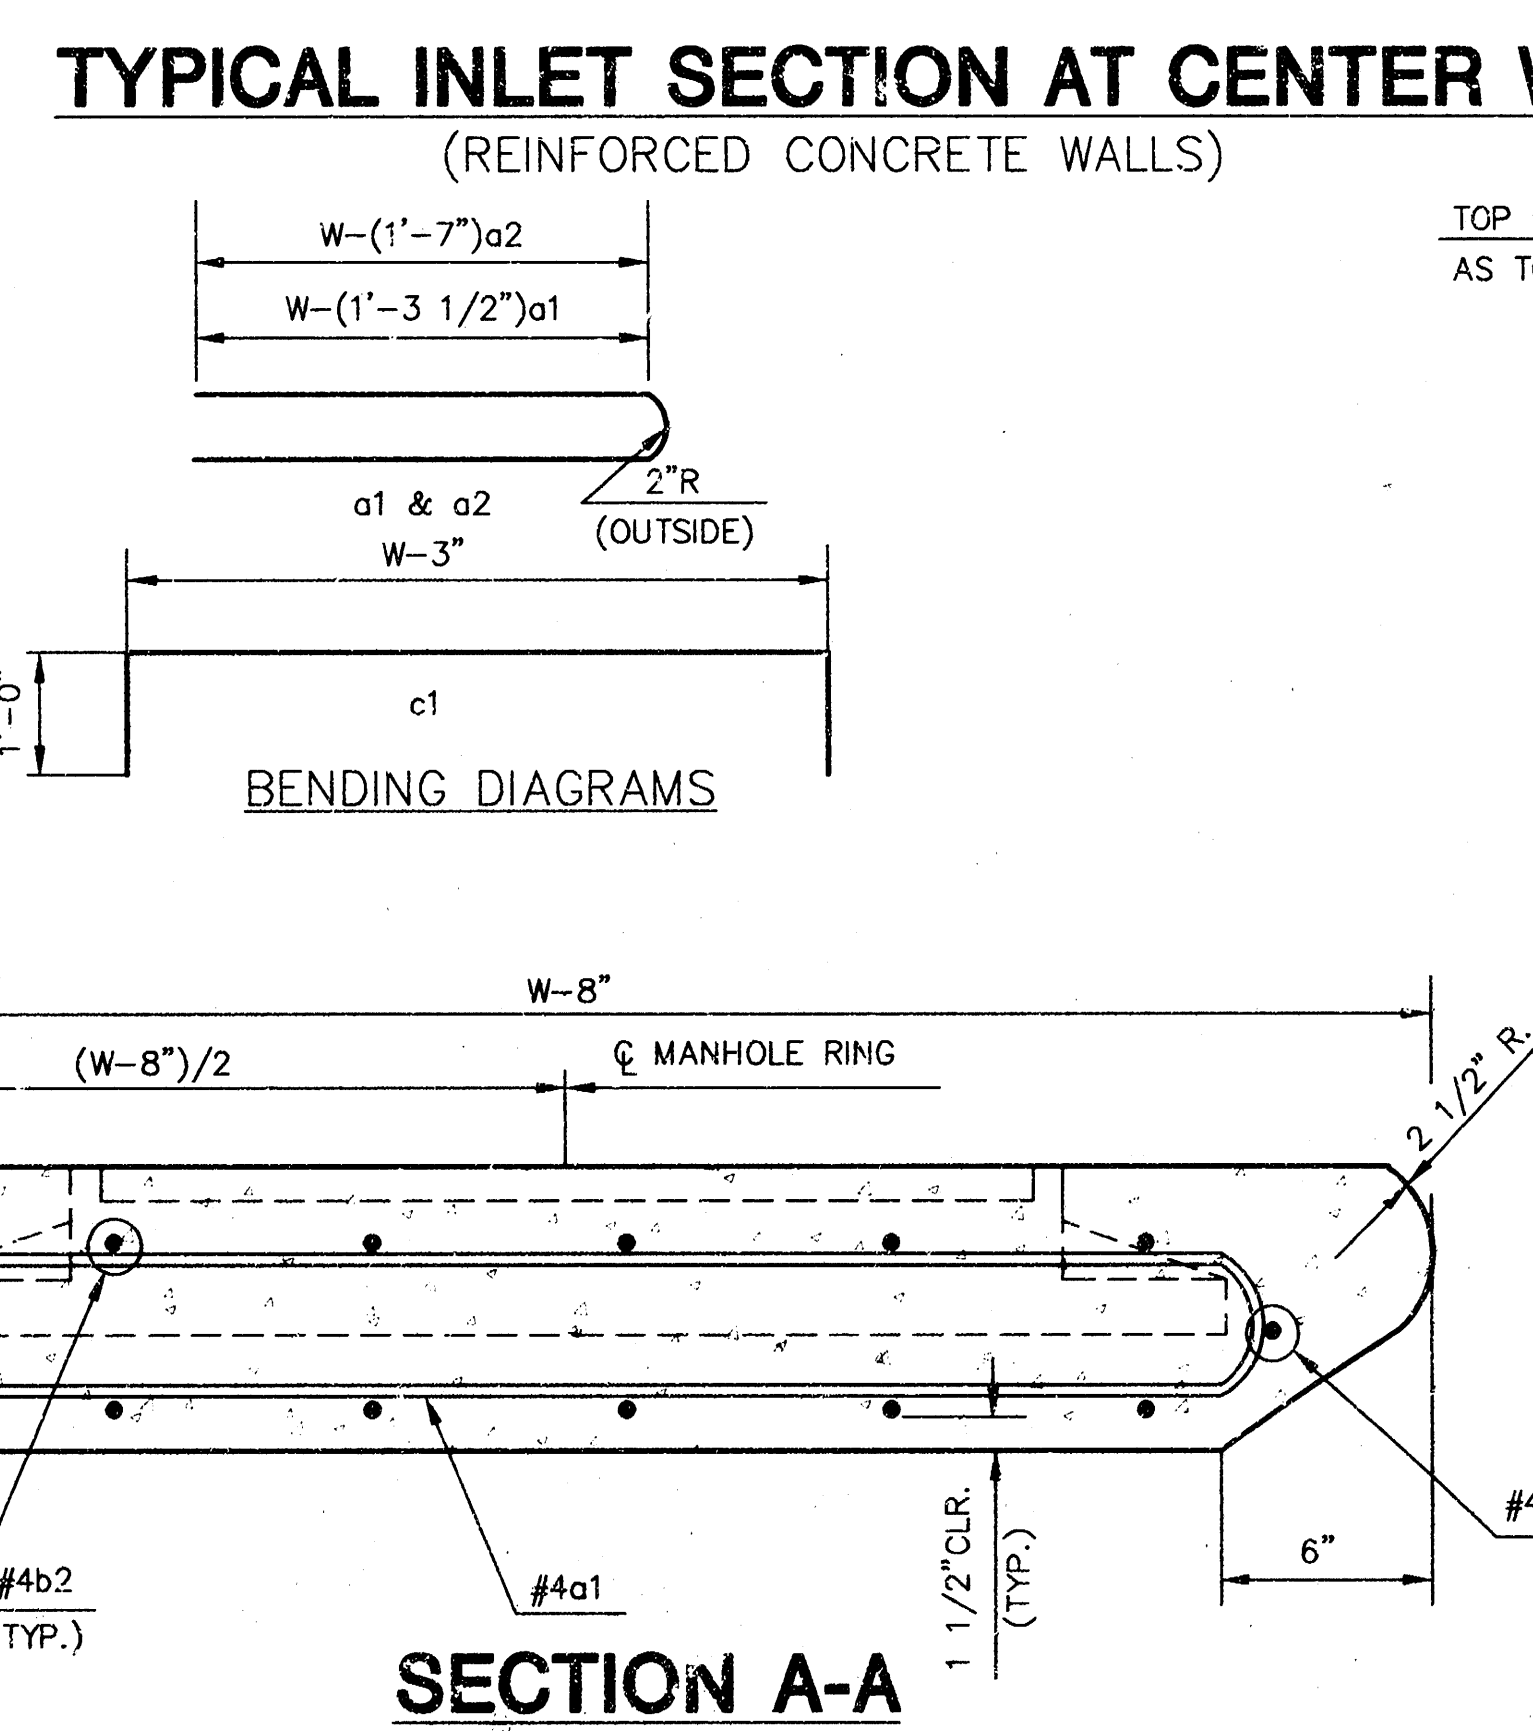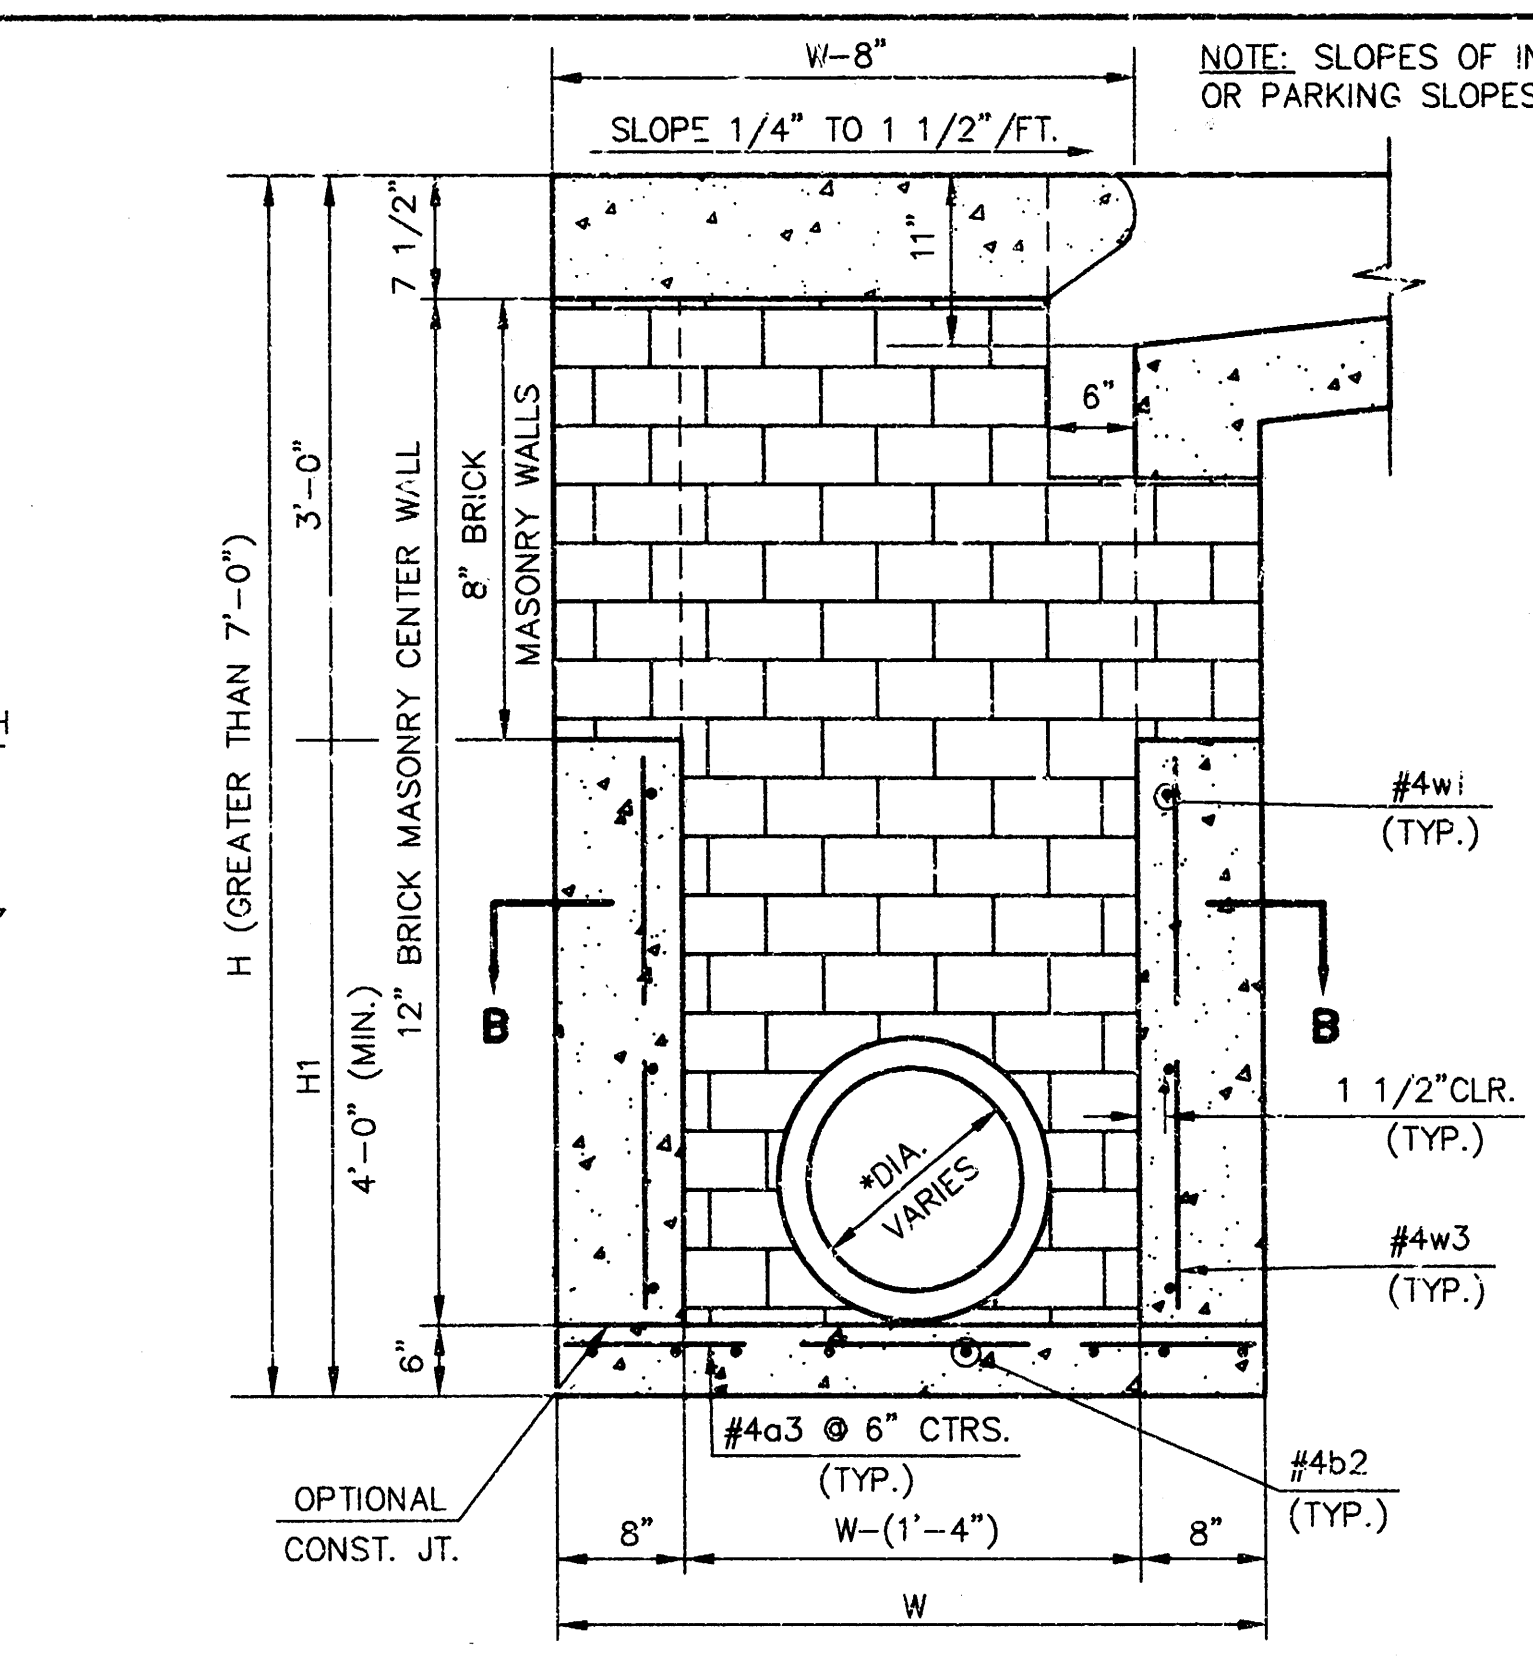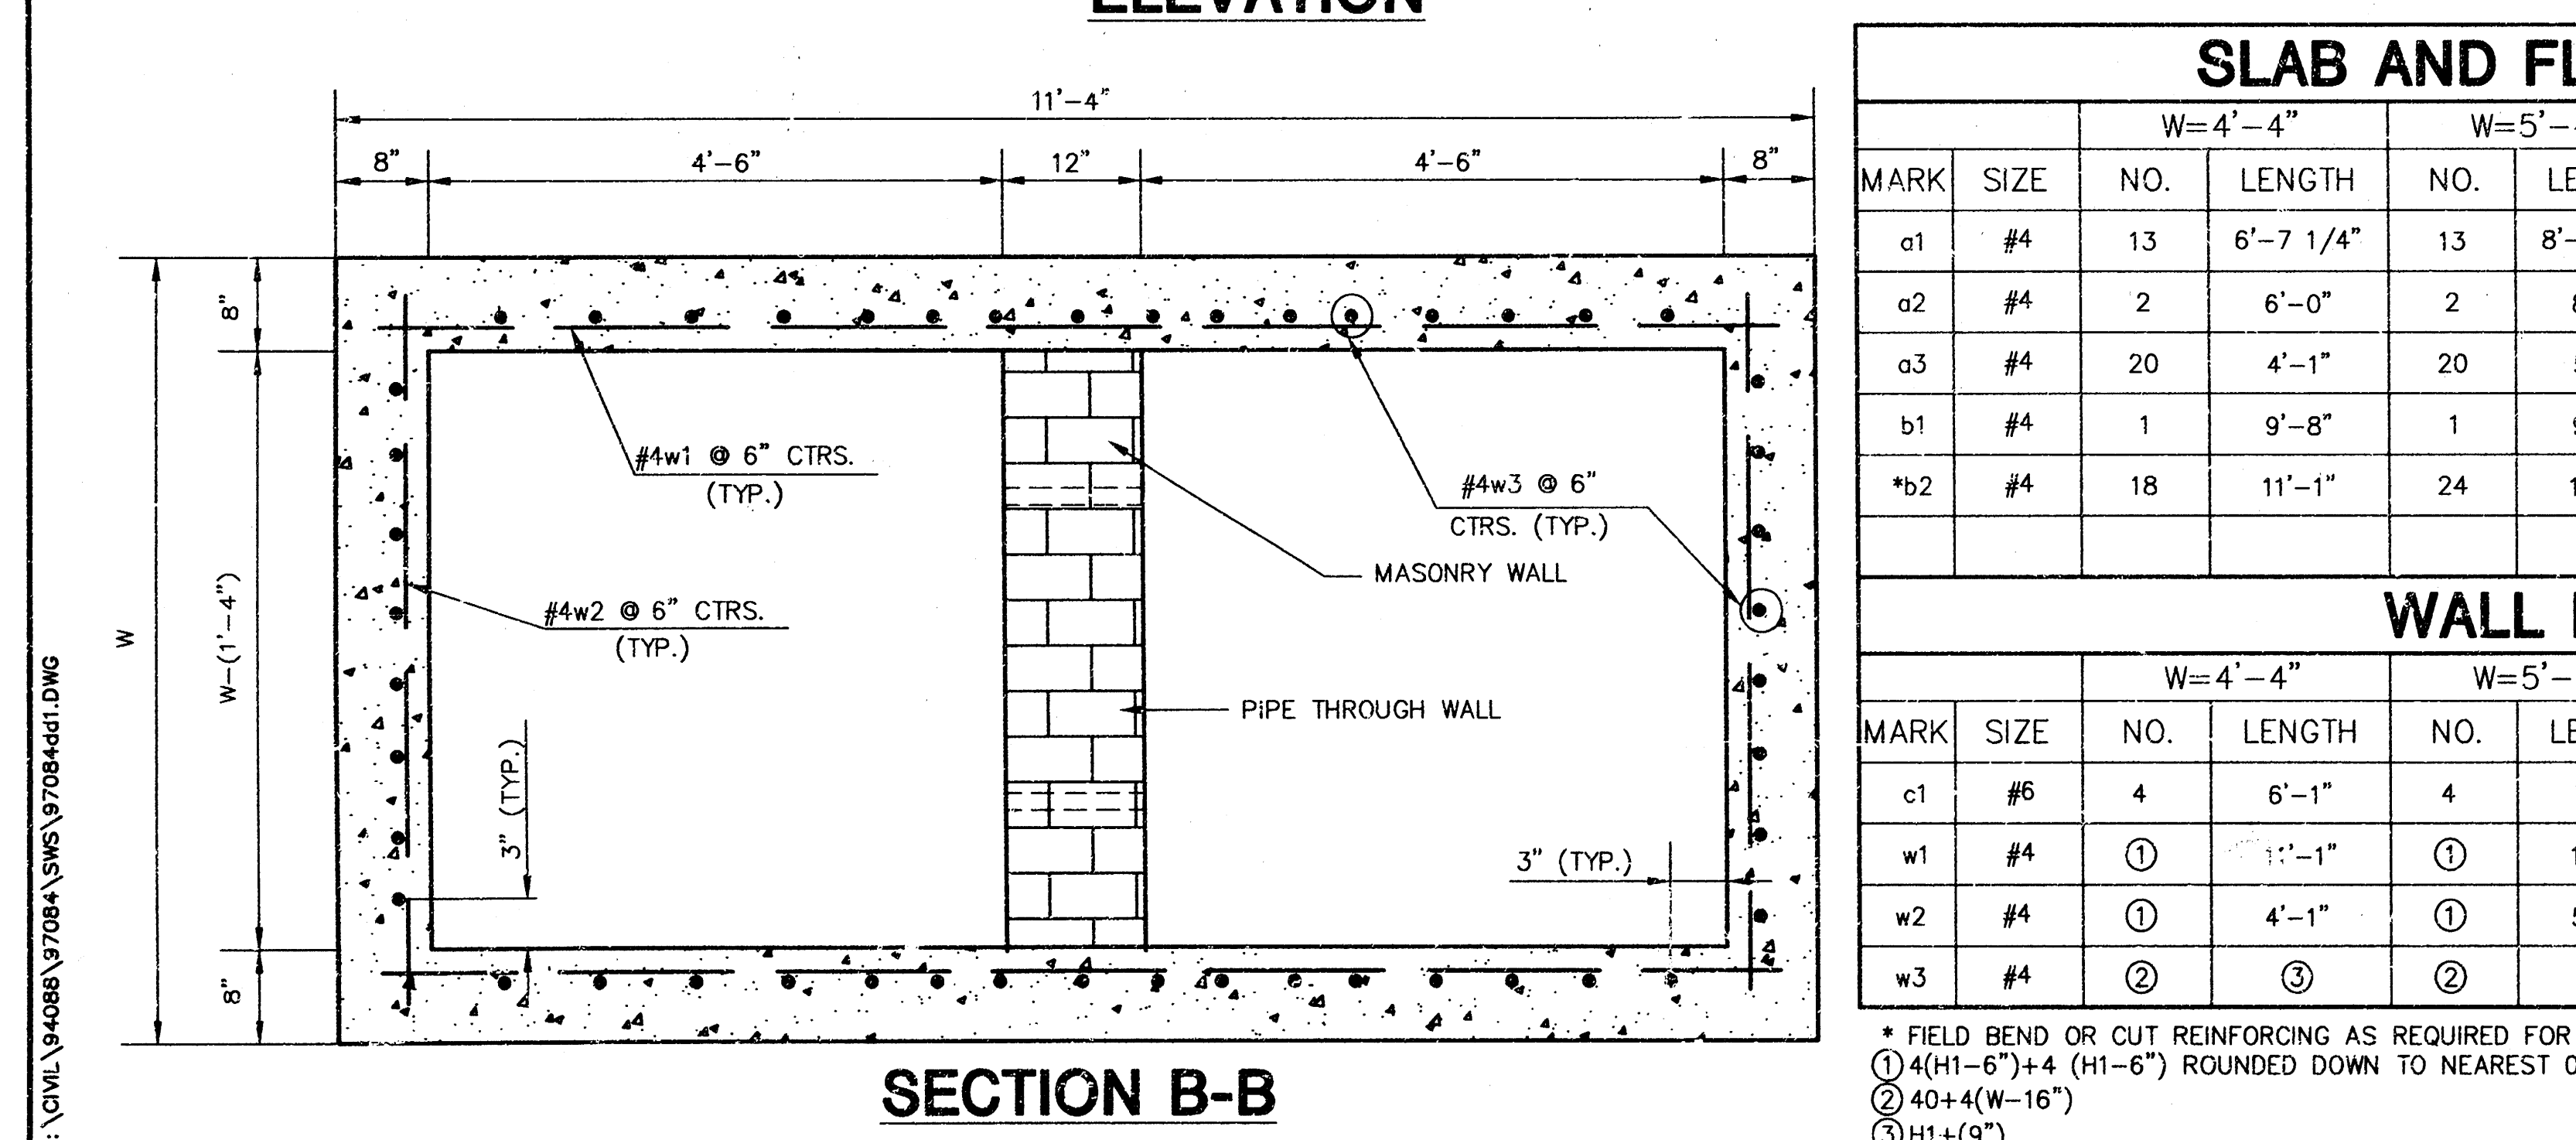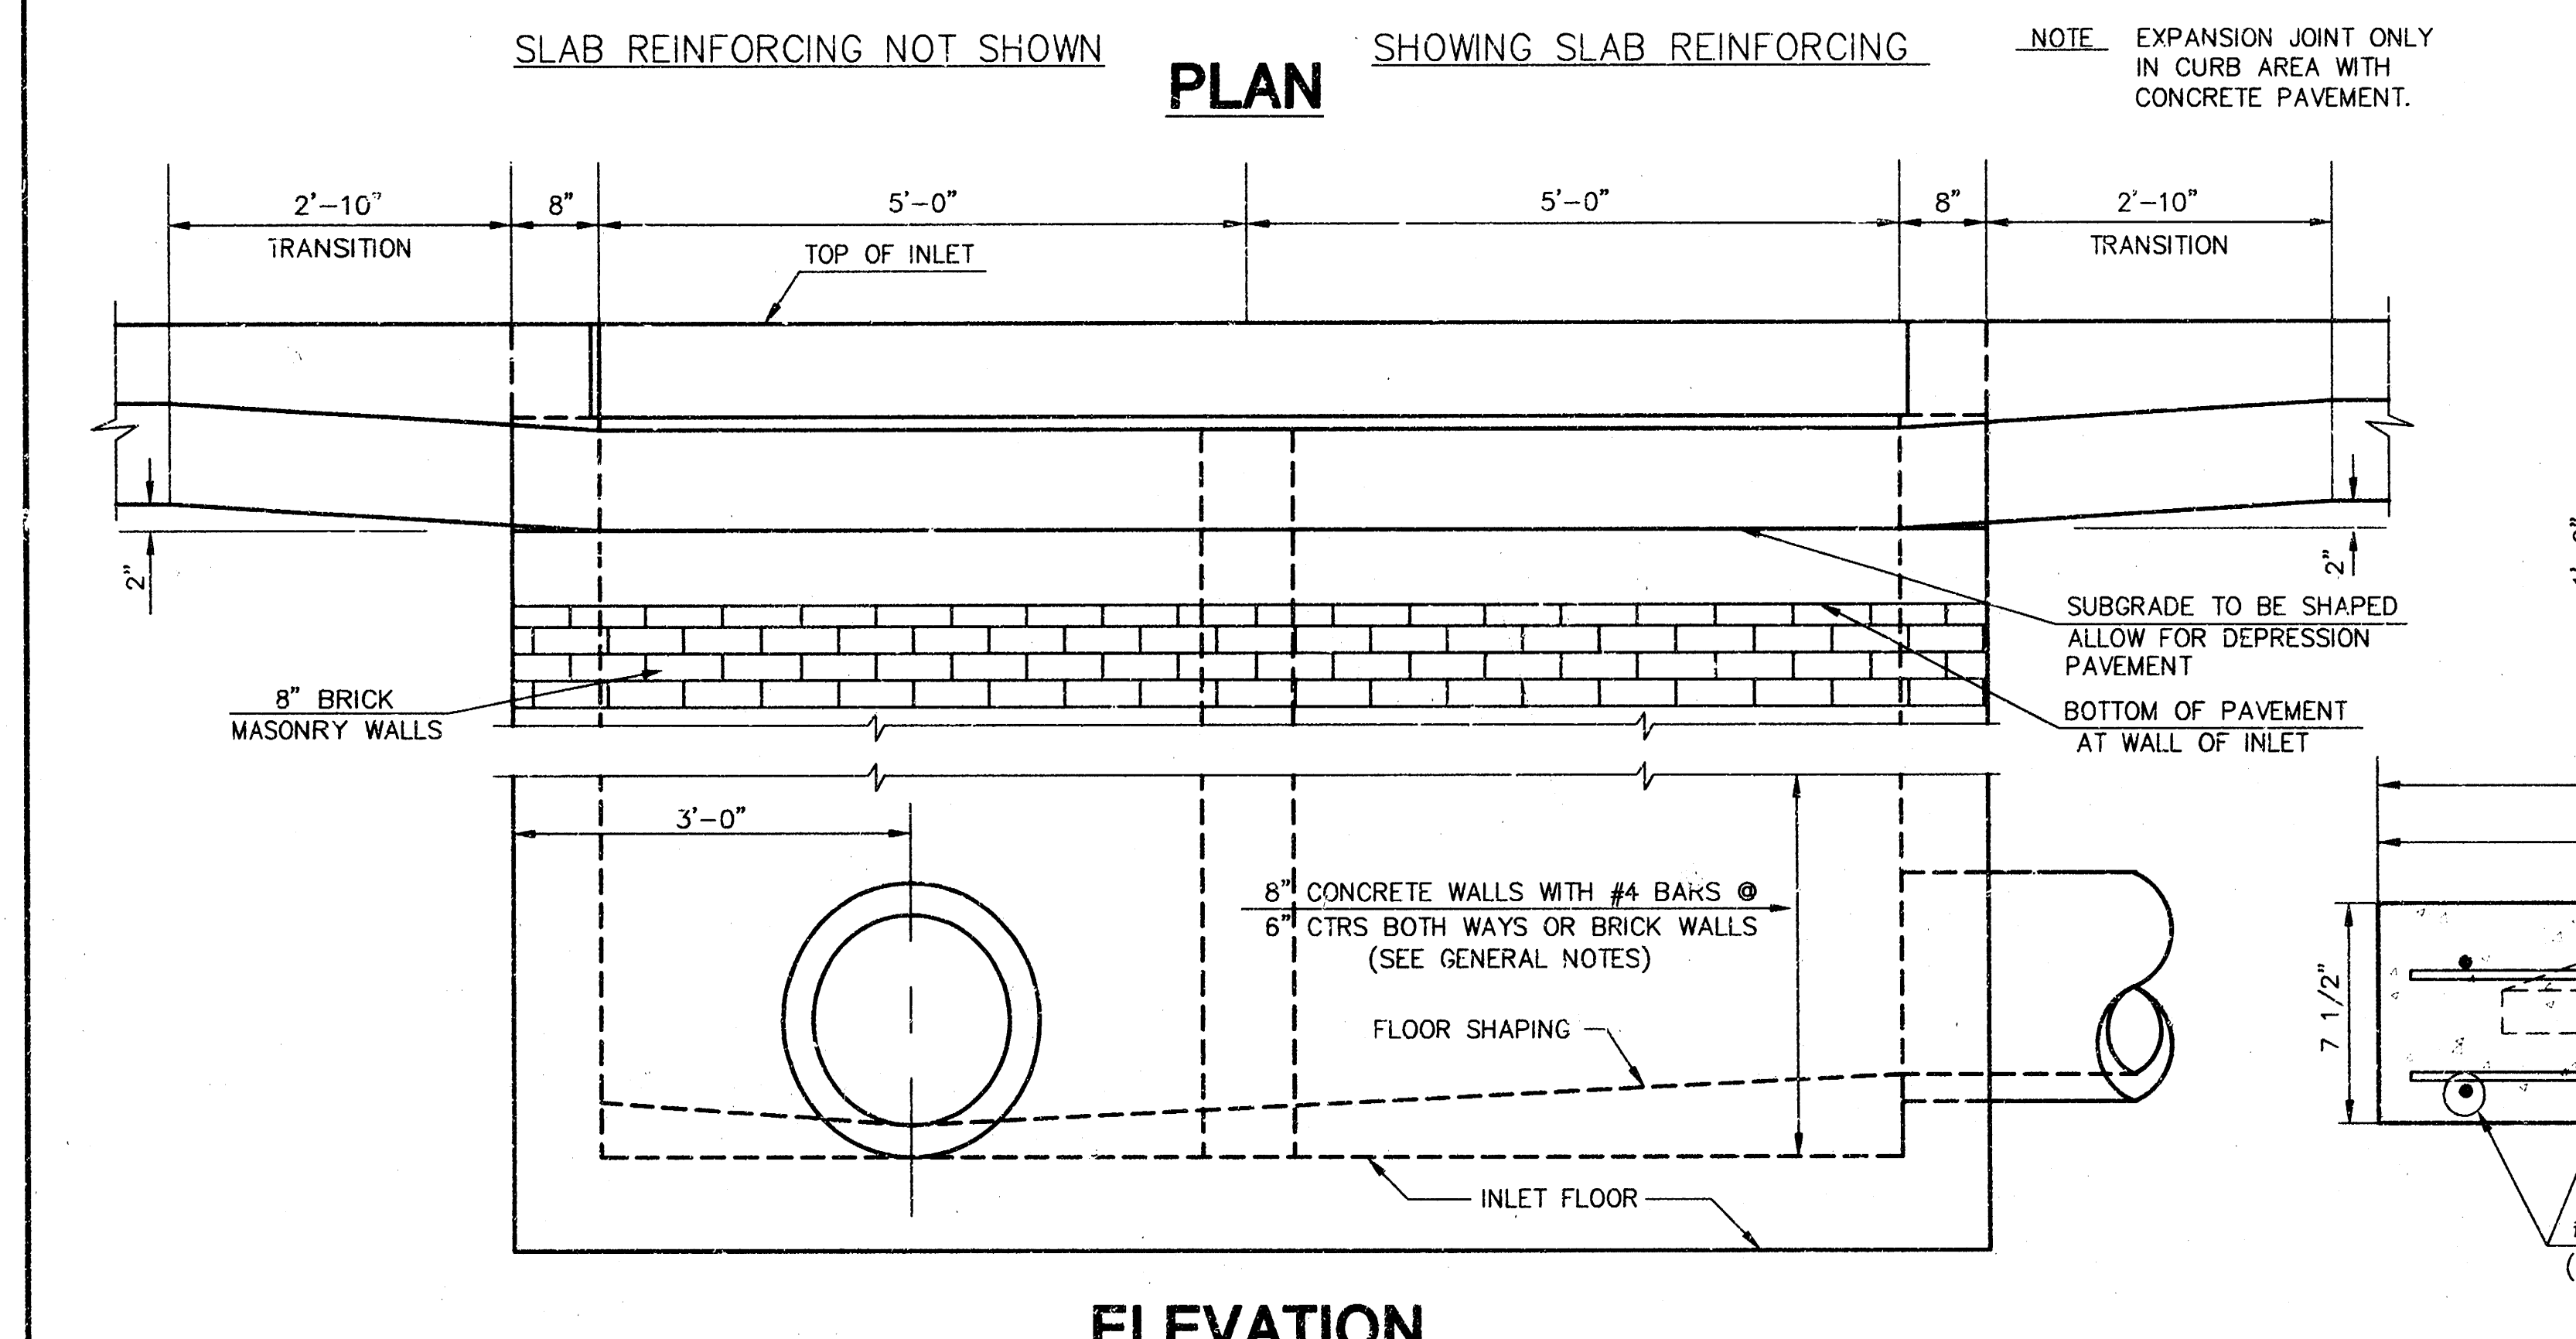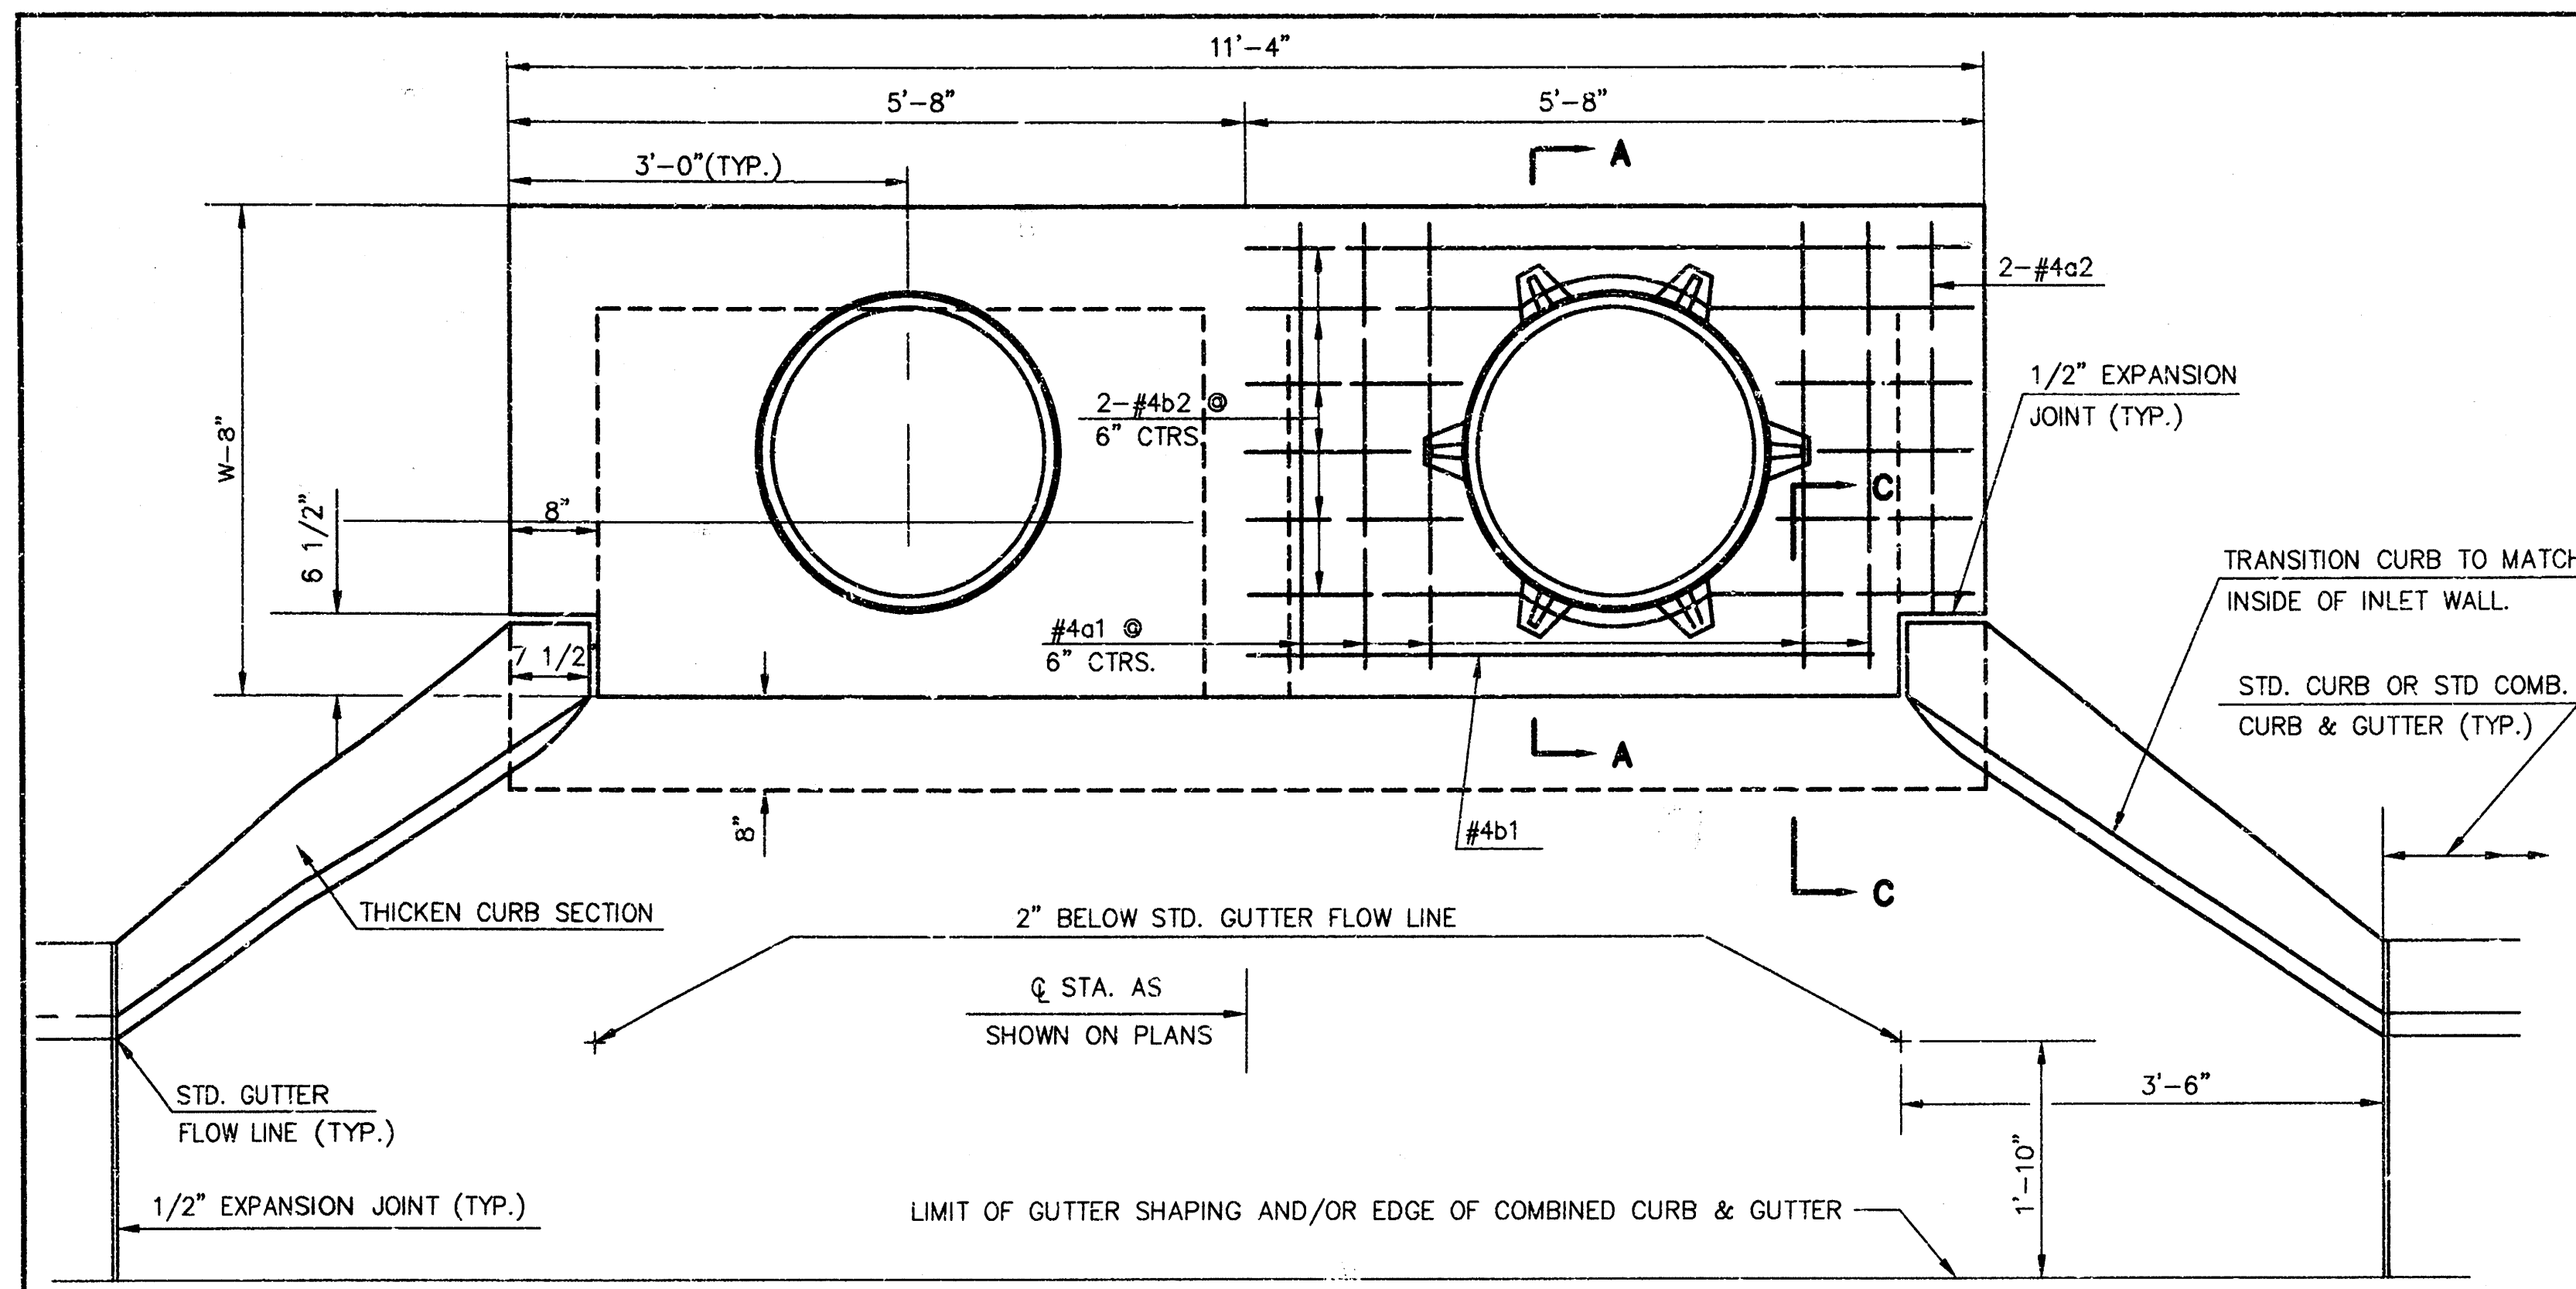



SLAB AND FLOOR REINFORCING

MARK	SIZE	W=4'-4"		W=5'-4"		W=6'-4"		W=7'-4"		W=8'-4"	
		NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
a1	#4	13	6'-7 1/4"	13	8'-7 1/4"	13	10'-7 1/4"	13	12'-7 1/4"	13	14'-7 1/4"
a2	#4	2	6'-0"	2	8'-0"	2	10'-0"	2	12'-0"	2	14'-0"
a3	#4	20	4'-1"	20	5'-1"	20	6'-1"	20	7'-1"	20	8'-1"
b1	#4	1	9'-8"	1	9'-8"	1	9'-8"	1	9'-8"	1	9'-8"
b2	#4	18	11'-1"	24	11'-1"	30	11'-1"	36	11'-1"	42	11'-1"

WALL REINFORCING

MARK	SIZE	W=4'-4"		W=5'-4"		W=6'-4"		W=7'-4"		W=8'-4"	
		NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
c1	#6	4	6'-1"	4	7'-1"	4	8'-1"	4	9'-1"	4	10'-1"
w1	#4	①	1'-1"	①	1'-1"	①	1'-1"	①	1'-1"	①	1'-1"
w2	#4	①	4'-1"	①	5'-1"	①	6'-1"	①	7'-1"	①	8'-1"
w3	#4	②	③	②	③	②	③	②	③	②	③

* FIELD BEND OR CUT REINFORCING AS REQUIRED FOR CLEARANCE
 ① 4(HI-6)+4 (HI-6) ROUNDED DOWN TO NEAREST 0.5
 ② 40+4(W-16)
 ③ H1+(9")

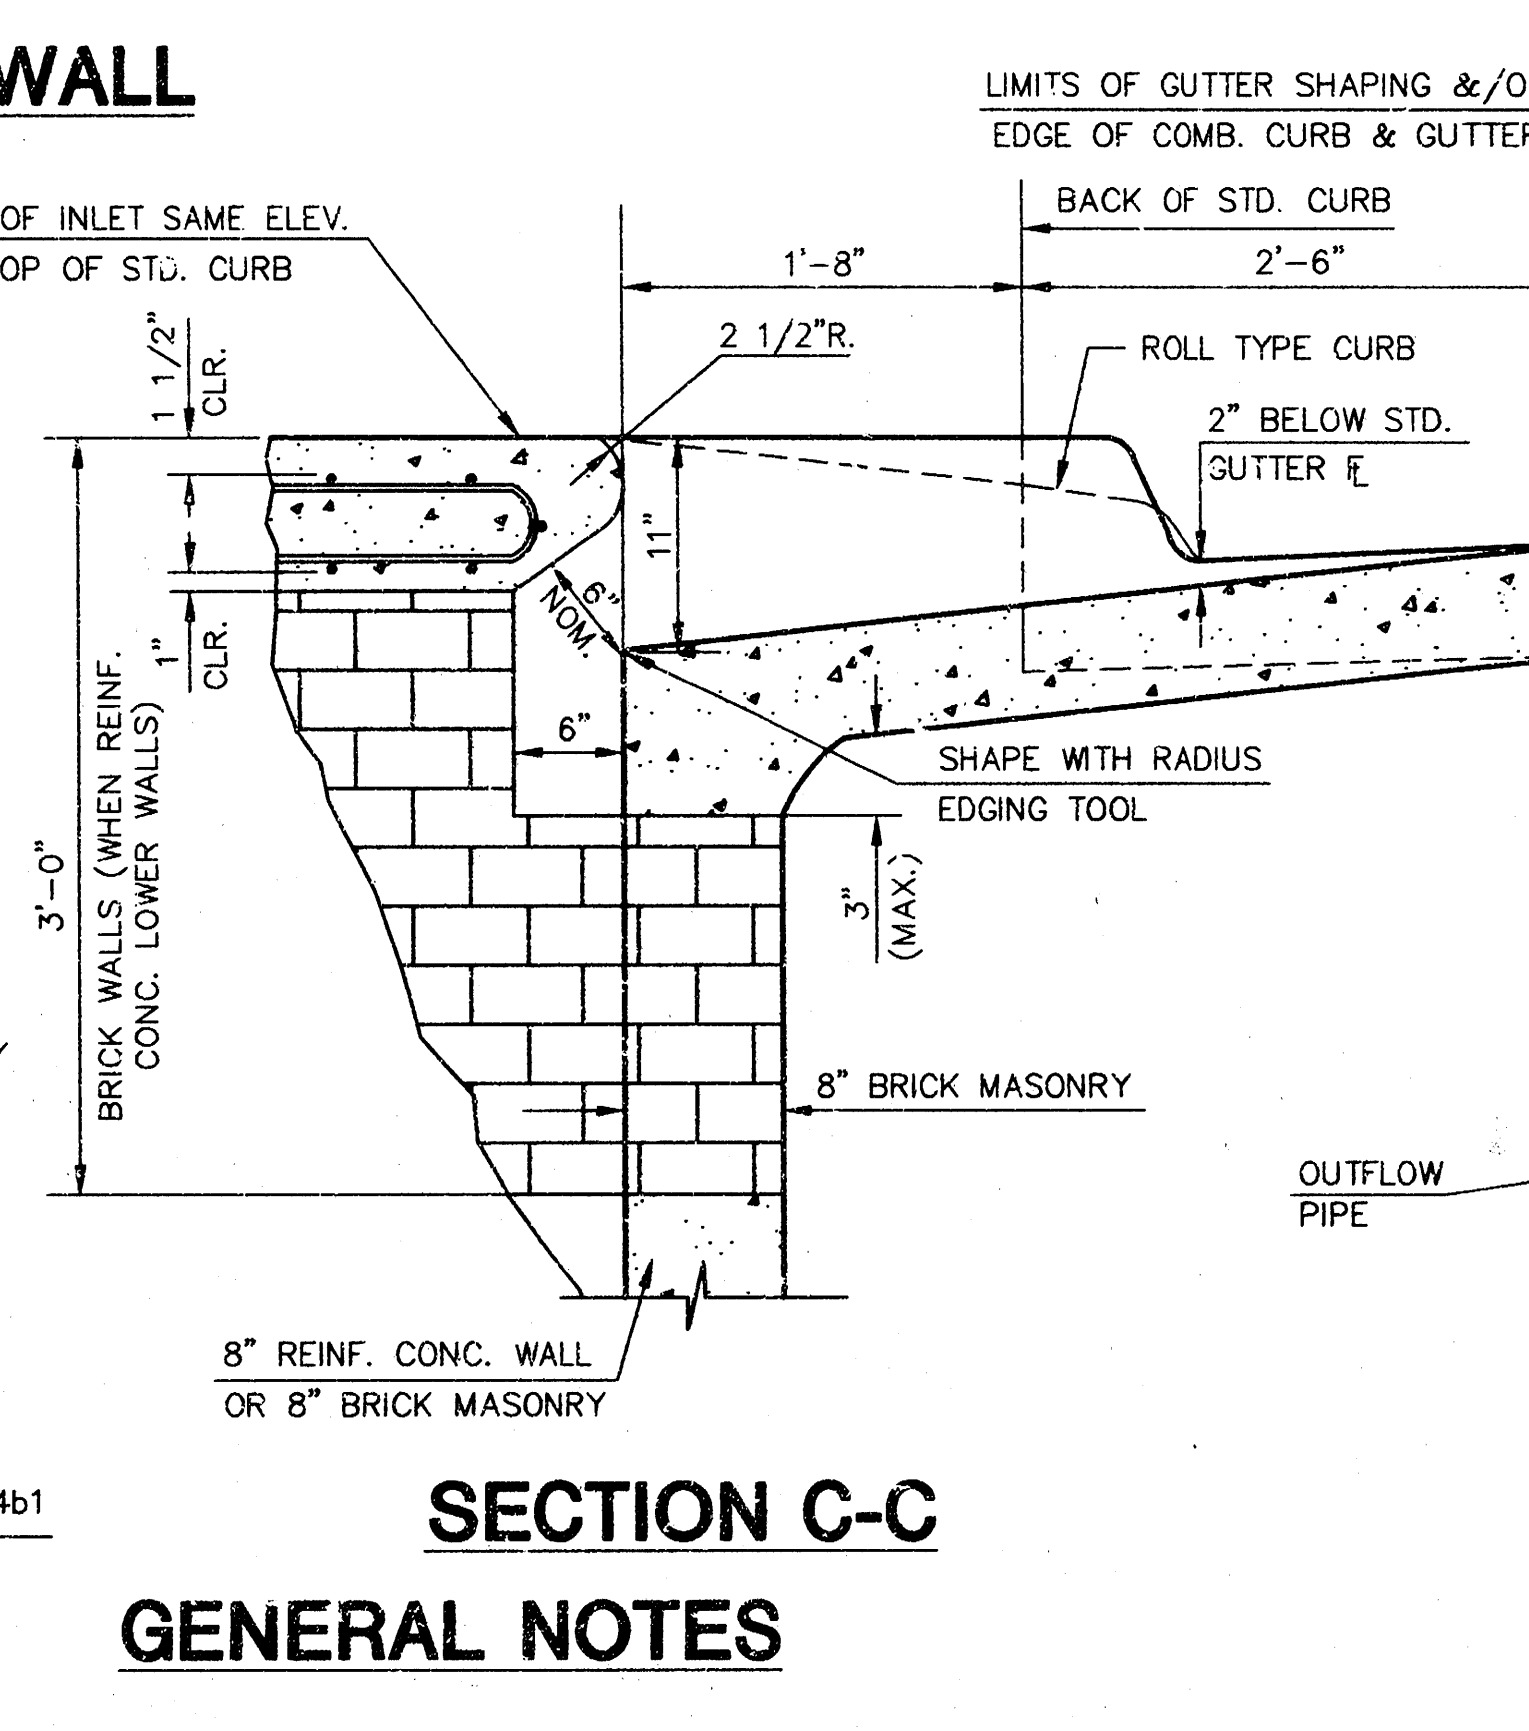
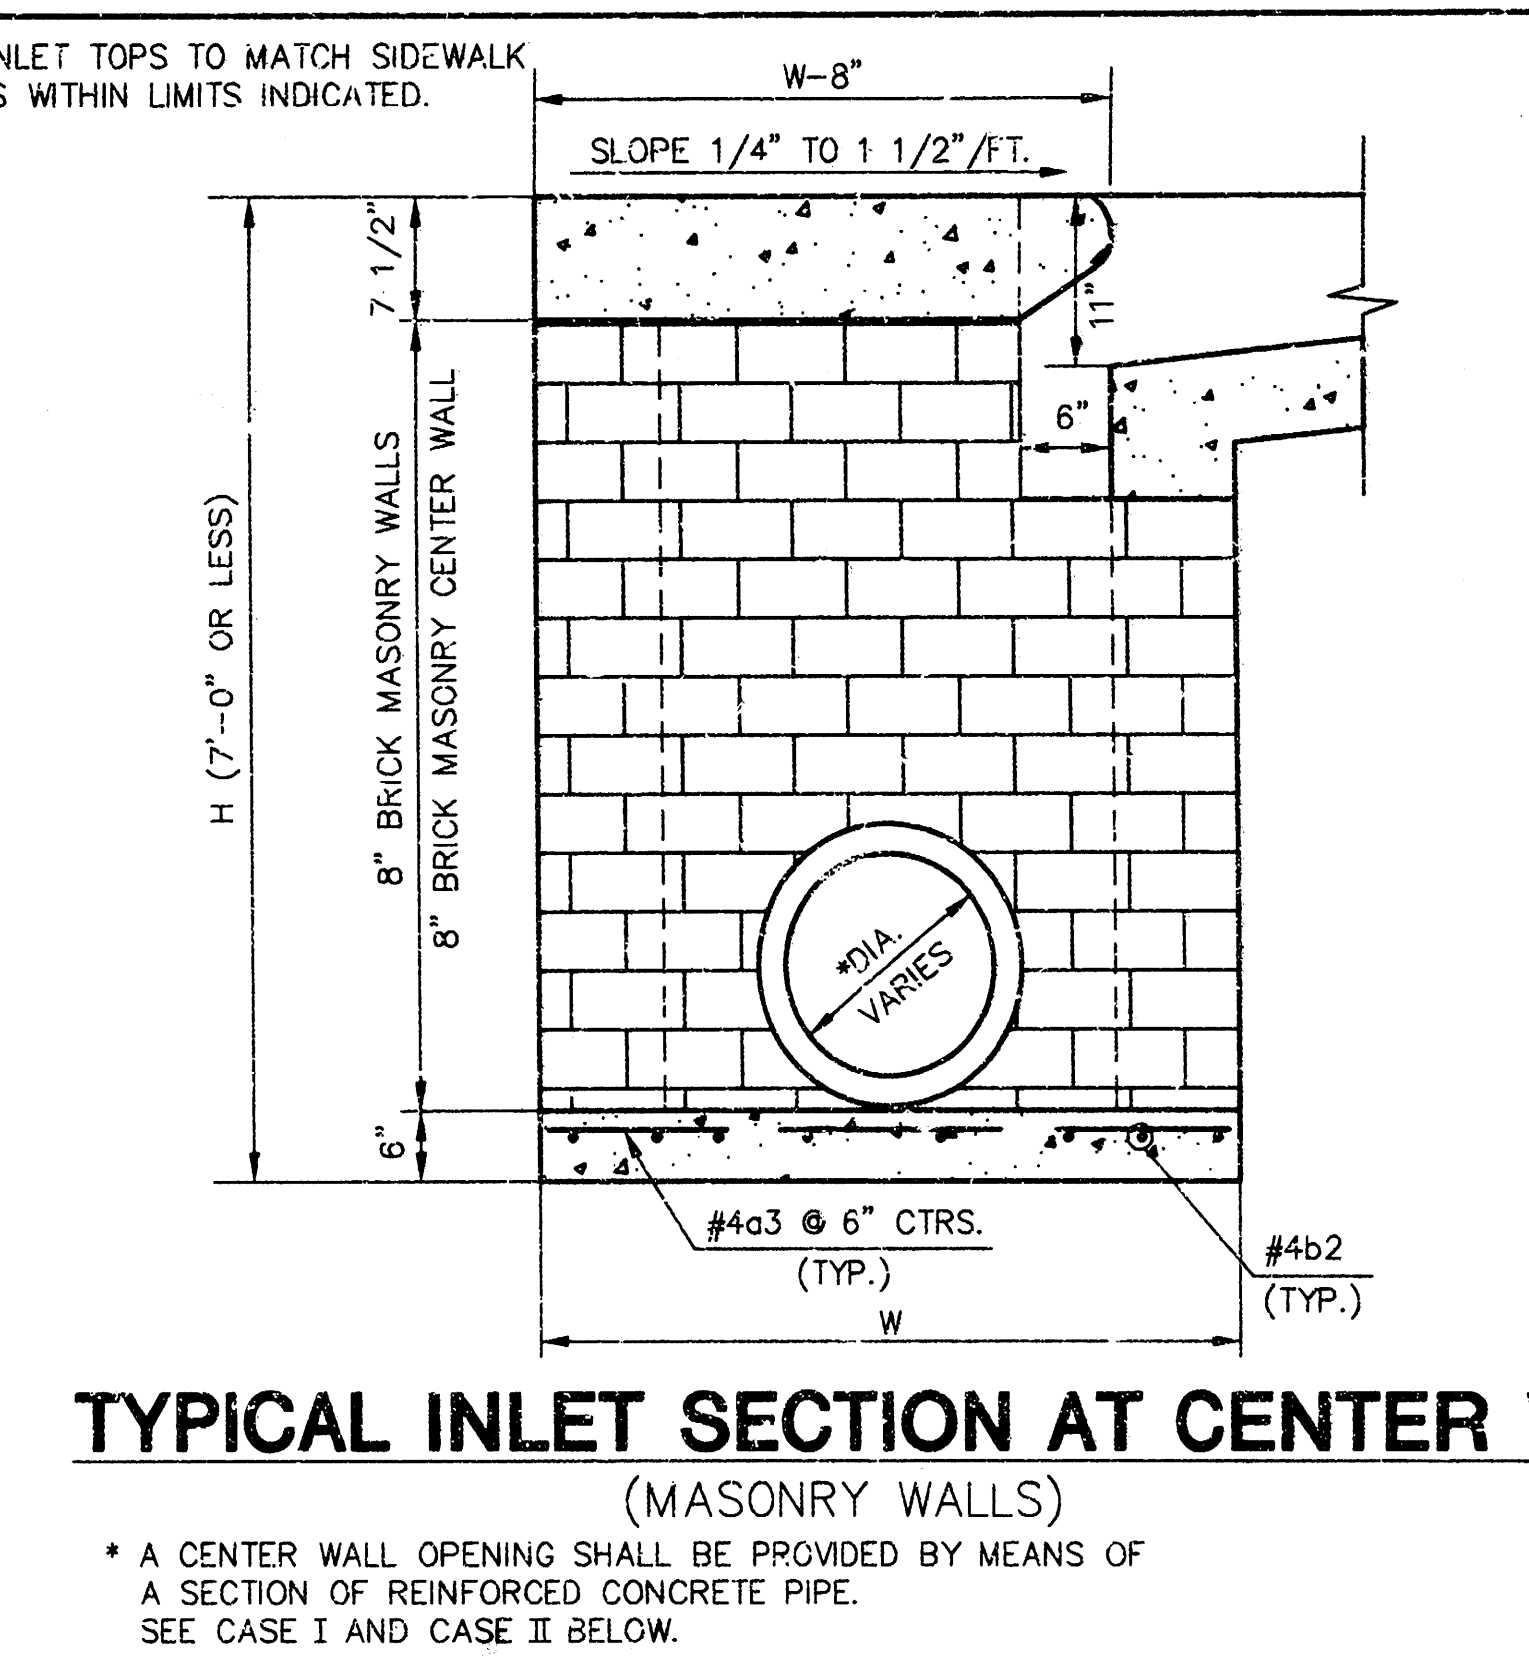


GENERAL NOTES

- THE CONTRACTOR SHALL BE REQUIRED TO CONSTRUCT 8" BRICK MASONRY WALLS BETWEEN THE CONCRETE INLET BASE AND TOP ON THIS INLET WHEN W=6'-4" OR LESS AND H=7'-0" OR LESS. WHEN W IS GREATER THAN 6'-4" AND H IS LESS THAN 7'-0", THE OUTSIDE INLET WALLS BELOW THE BRICK STACK SHALL BE REINFORCED CONCRETE CONSTRUCTION AND THE CENTER WALL SHALL BE OF MASONRY CONSTRUCTION AS SHOWN FOR THE MASONRY WALL OPTION.
- INLET INVERT SHALL BE SHAPED WITH 8 SACK SAND MIX CONCRETE TO CREATE FLOW CHANNELS AND TO INCREASE HYDRAULIC EFFICIENCY SUCH THAT THE INLET WILL BE SELF CLEANING BETWEEN ALL INLET AND/OR OUTLET PIPES.
- CONCRETE TOPS TO BE INSTALLED ON THIN MORTAR CUSHION TO INSURE FULL SUPPORT ALONG BRICK WALLS. CONCRETE TOPS MAY BE CAST IN PLACE OR PRECAST. CONCRETE USED FOR INLET CONSTRUCTION SHALL BE CONCRETE PAVEMENT MIX.
- INLET TOP REINFORCING SHALL BE SPACED ON 6" MAX. CENTERS. INLET LIDS SHALL BE NOTCHED OUT AS INDICATED TO FACILITATE CONSTRUCTION OF CURB. BARS IN INLET TOP TO BE FIELD BENT OR CUT TO CLEAR MANHOLE RING.
- THE ENDS OF ALL PIPES INSTALLED IN INLETS SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF THE INLET WALL.

STANDARD CURB INLET PRECAST TOPS

W	PRE-CAST TOP SIZE	SIDE OR INTERIOR WALL PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8"x11'-4"x7 1/2"	21" & SMALLER	0.83±
5'-4"	4'-8"x11'-4"x7 1/2"	24" & 30"	1.09±
6'-4"	5'-8"x11'-4"x7 1/2"	36" & 42"	1.35±
7'-4"	6'-8"x11'-4"x7 1/2"	48" & 54"	1.61±
8'-4"	7'-8"x11'-4"x7 1/2"	60" & 66"	1.87±



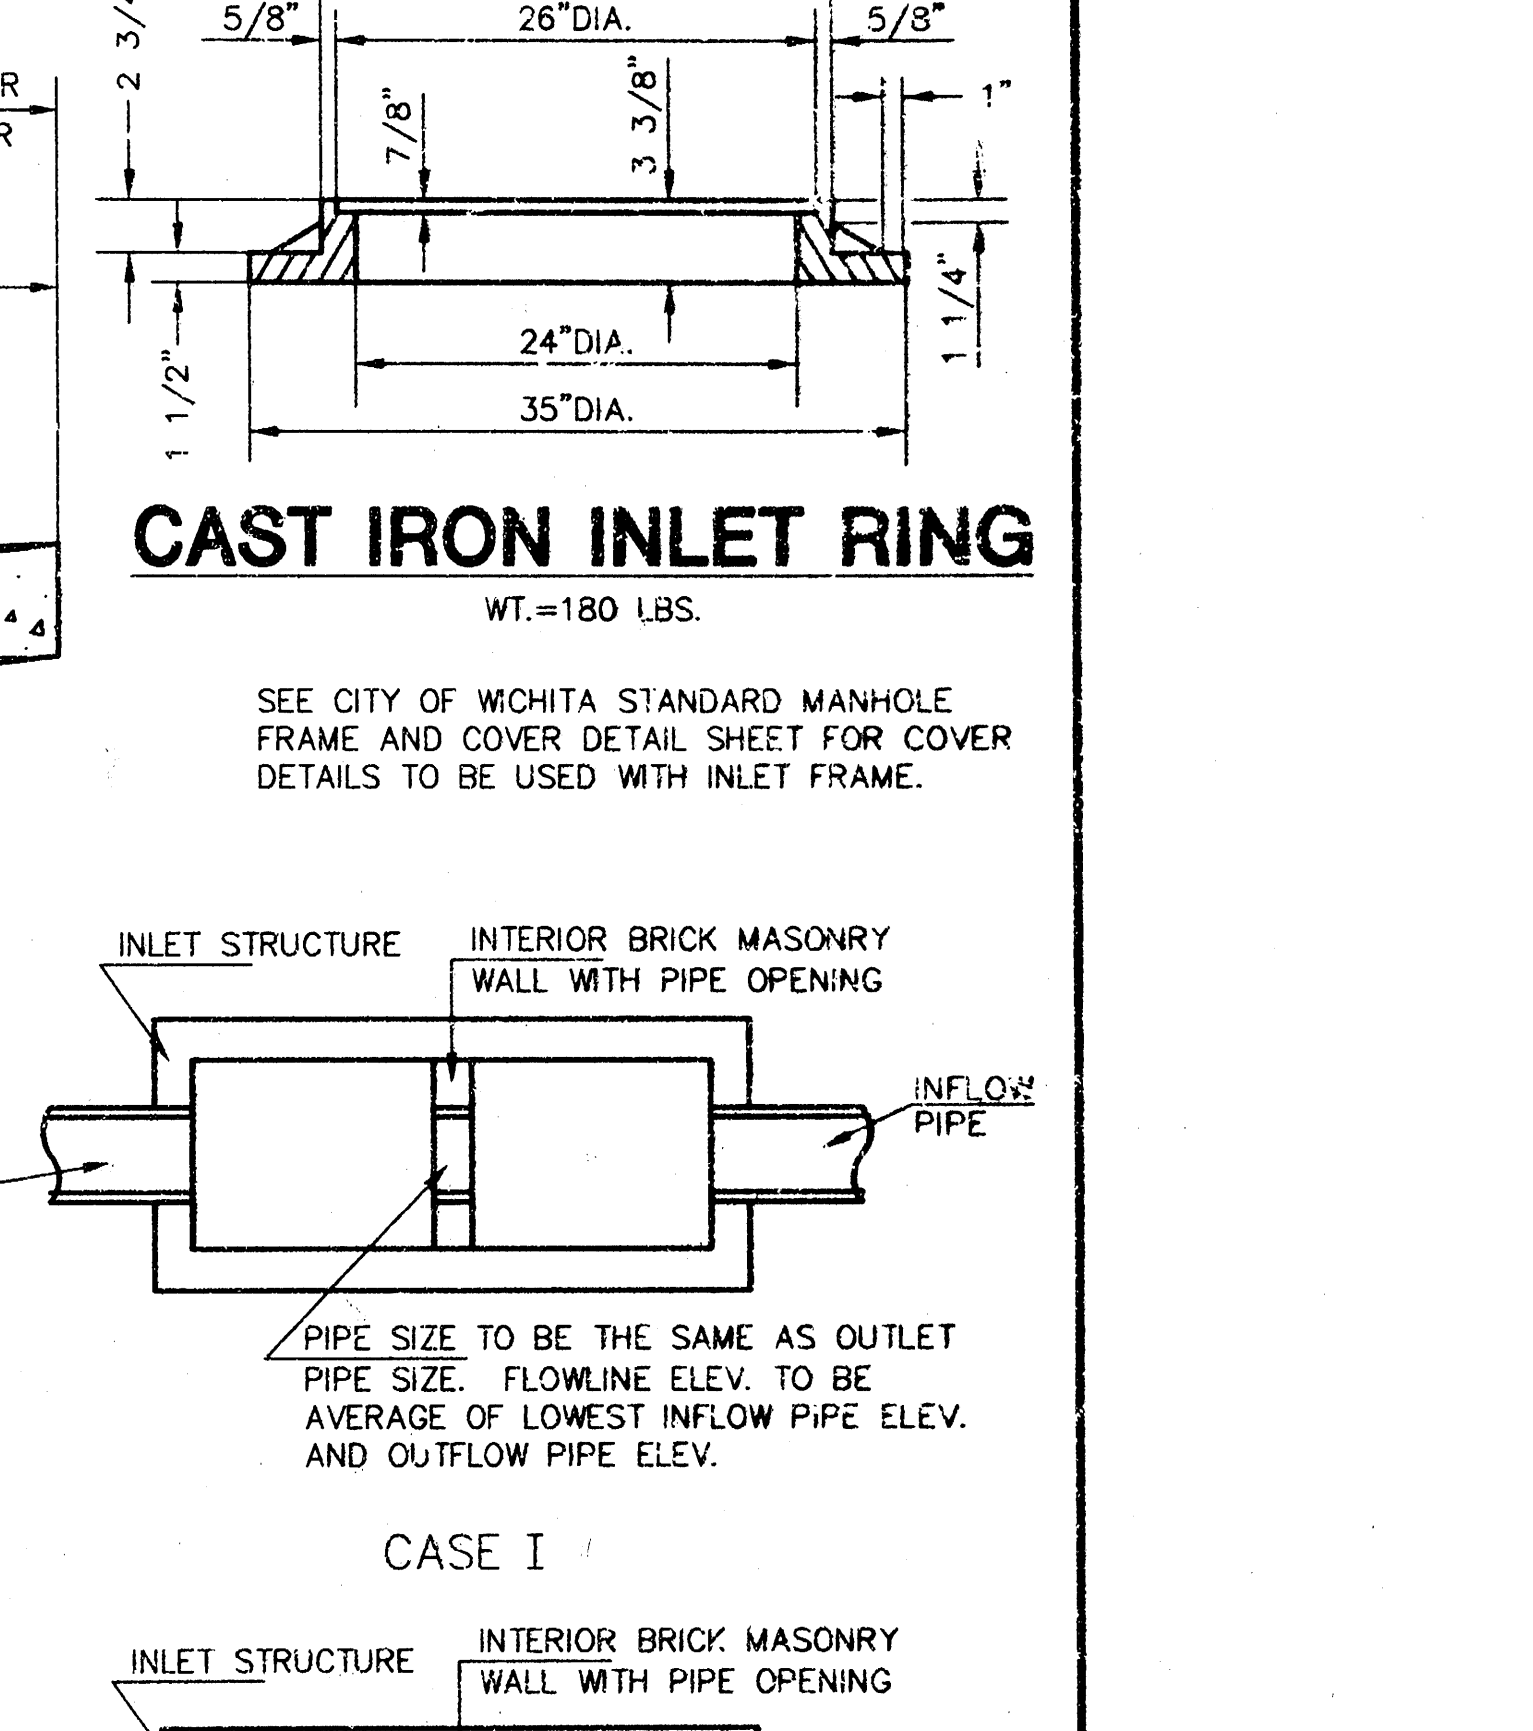
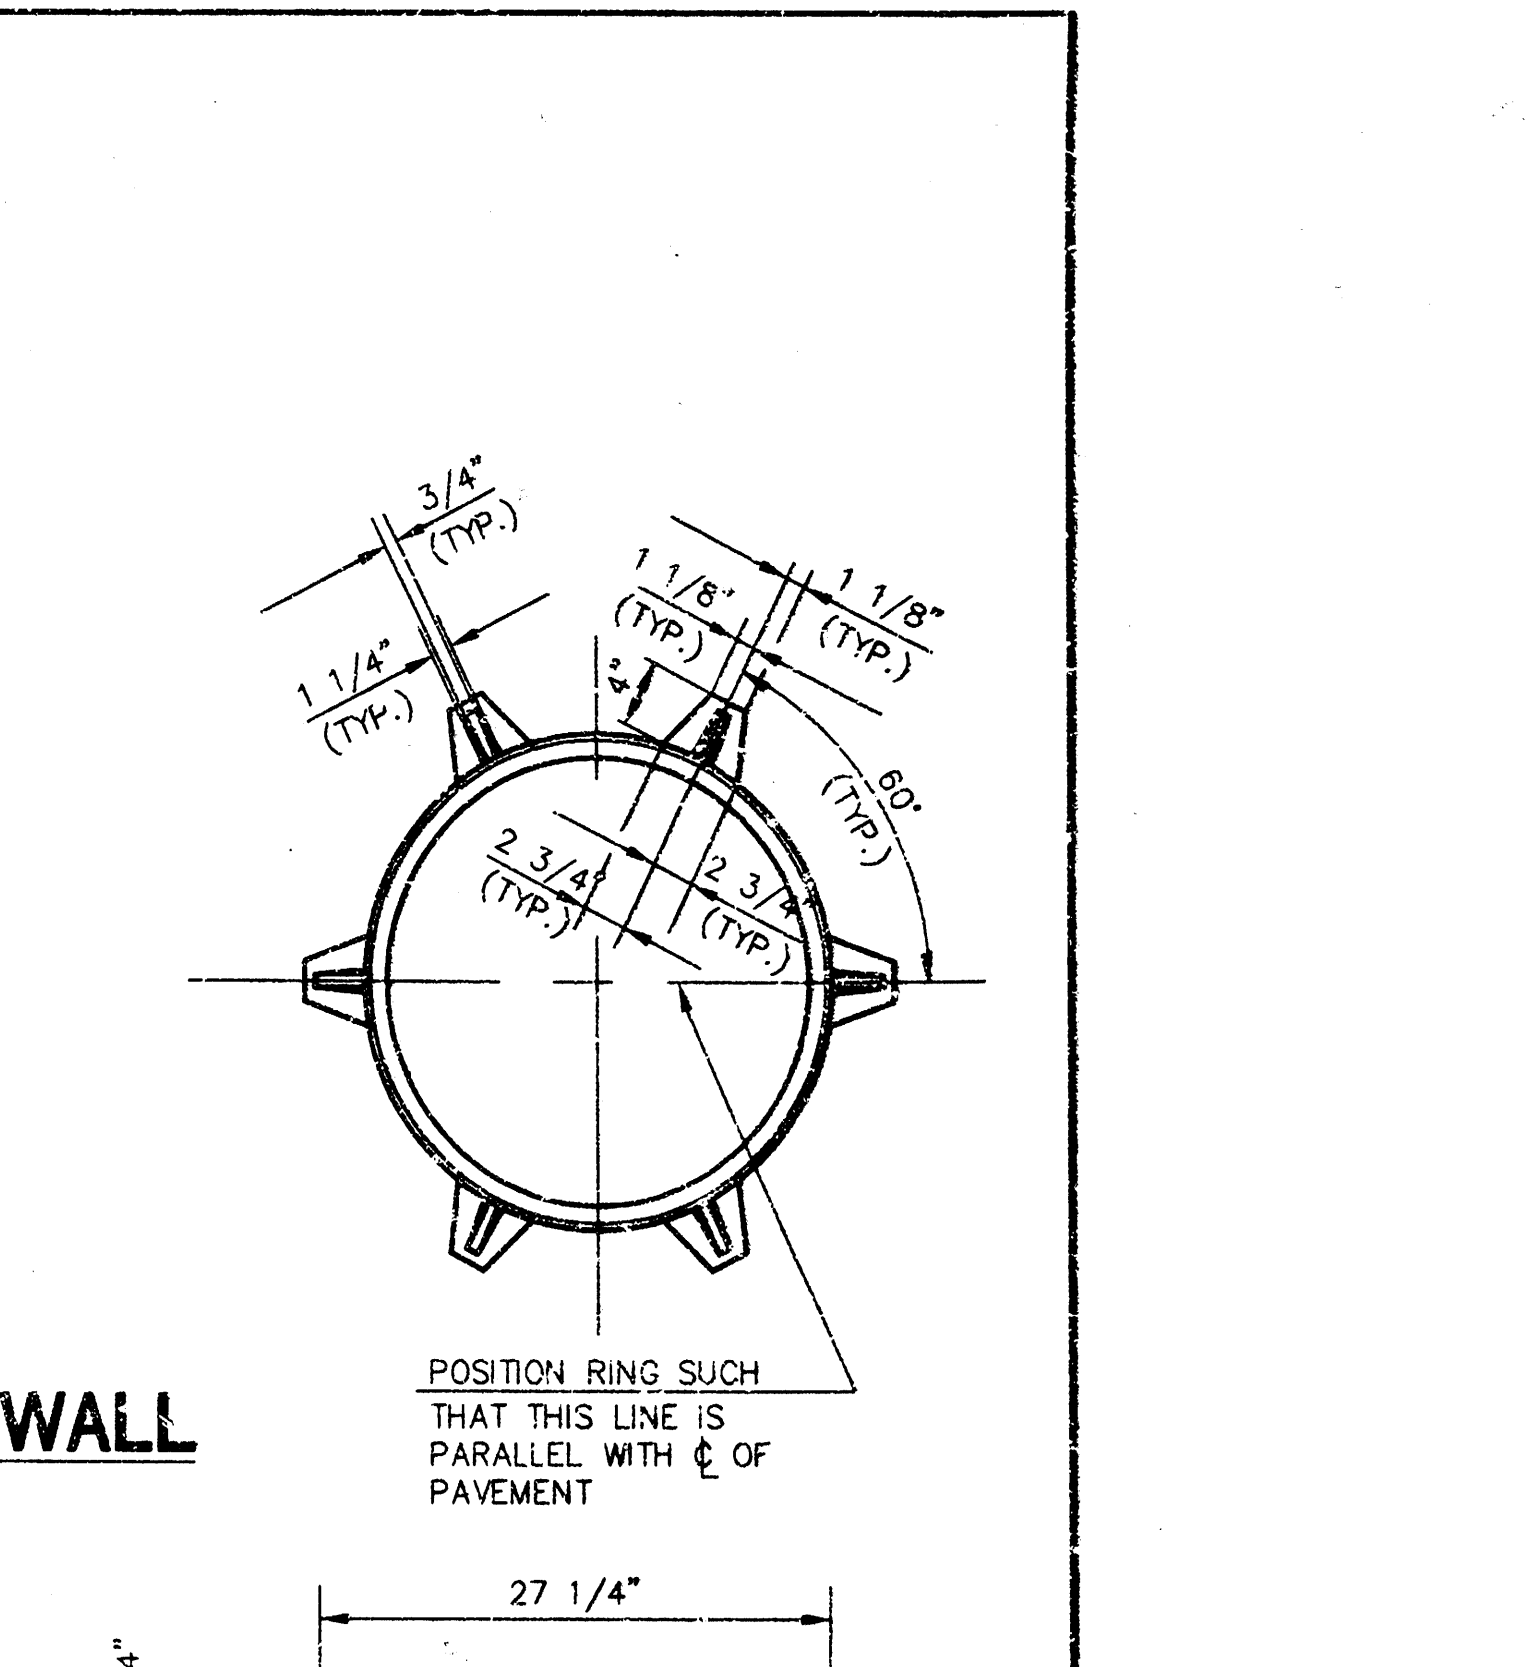


STANDARD TYPE 1A CURB INLET
 INLET OPENING=6"x10'-0"

NOV. 1984

CITY OF WICHITA, KANSAS




Design JES	Checked by JES	Checked by JES	Sheet 6 of 10
Drawn by JES	Date June 1998	Date June 1998	Job No. 97084d3d

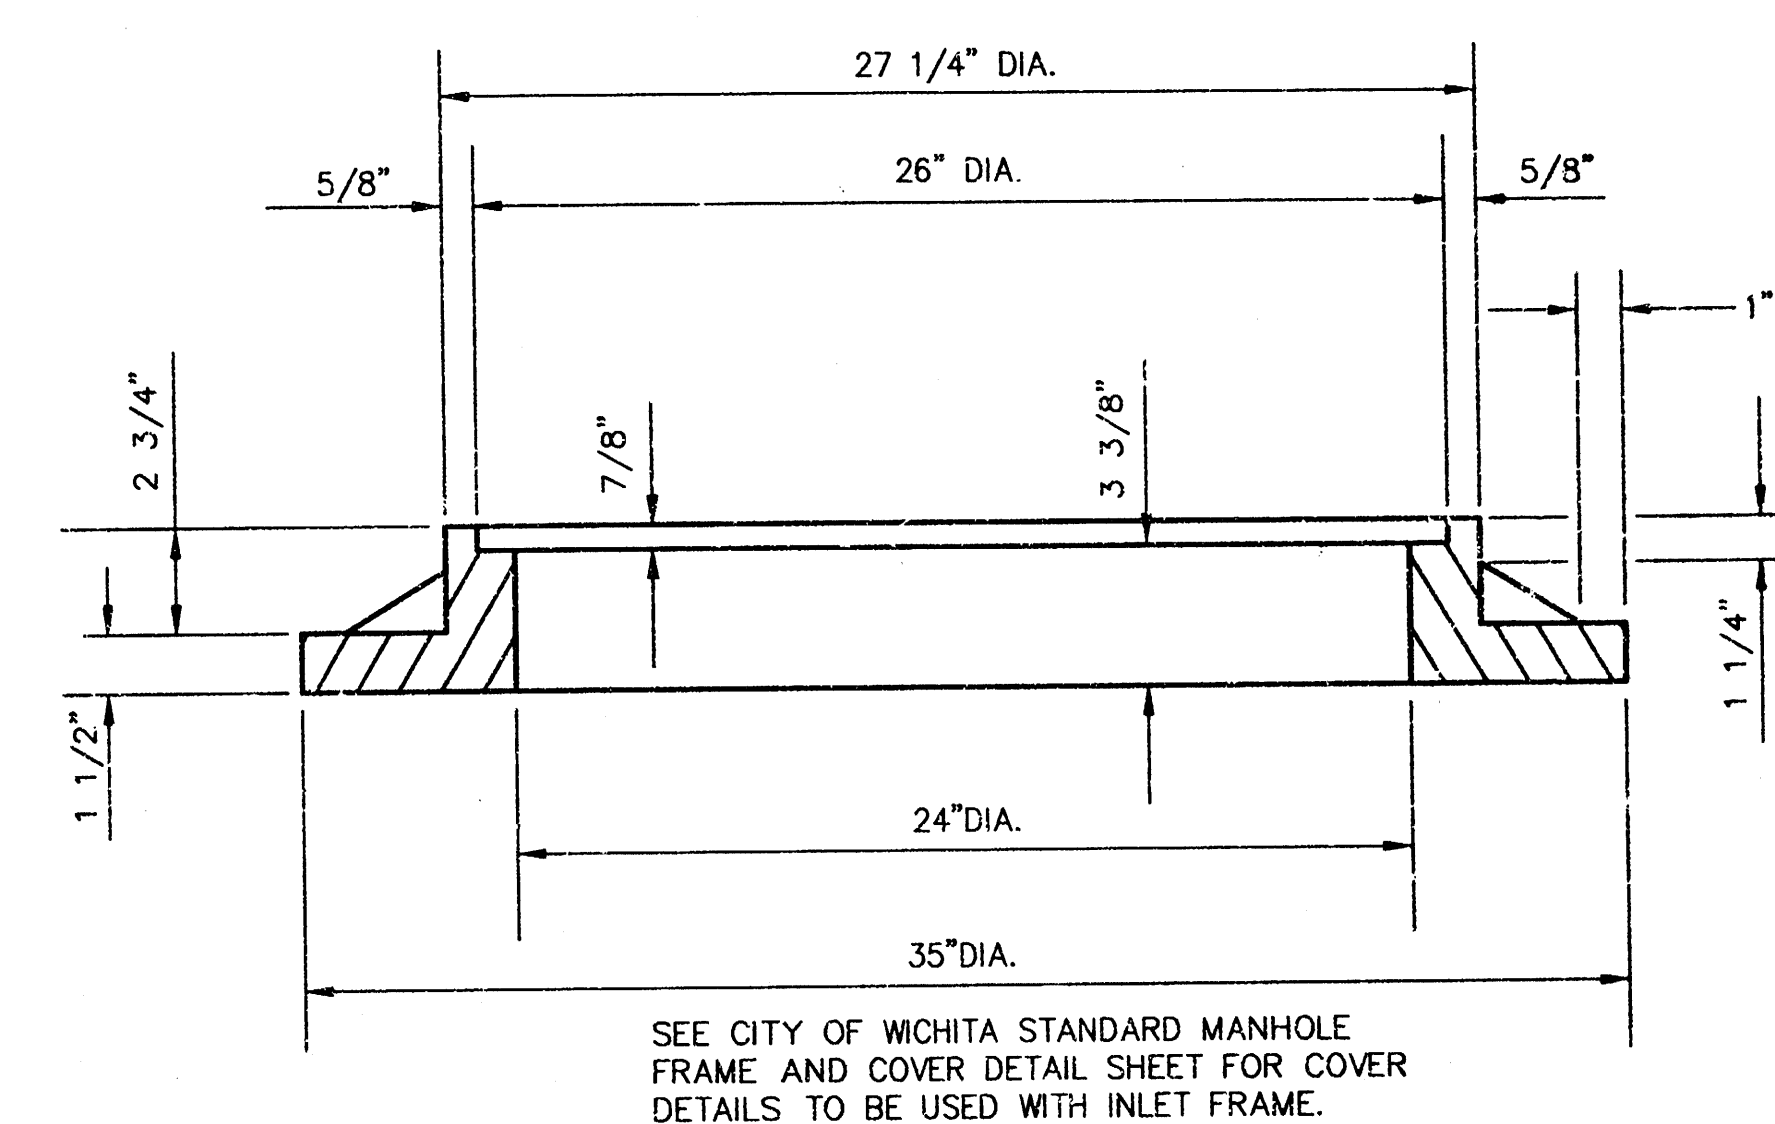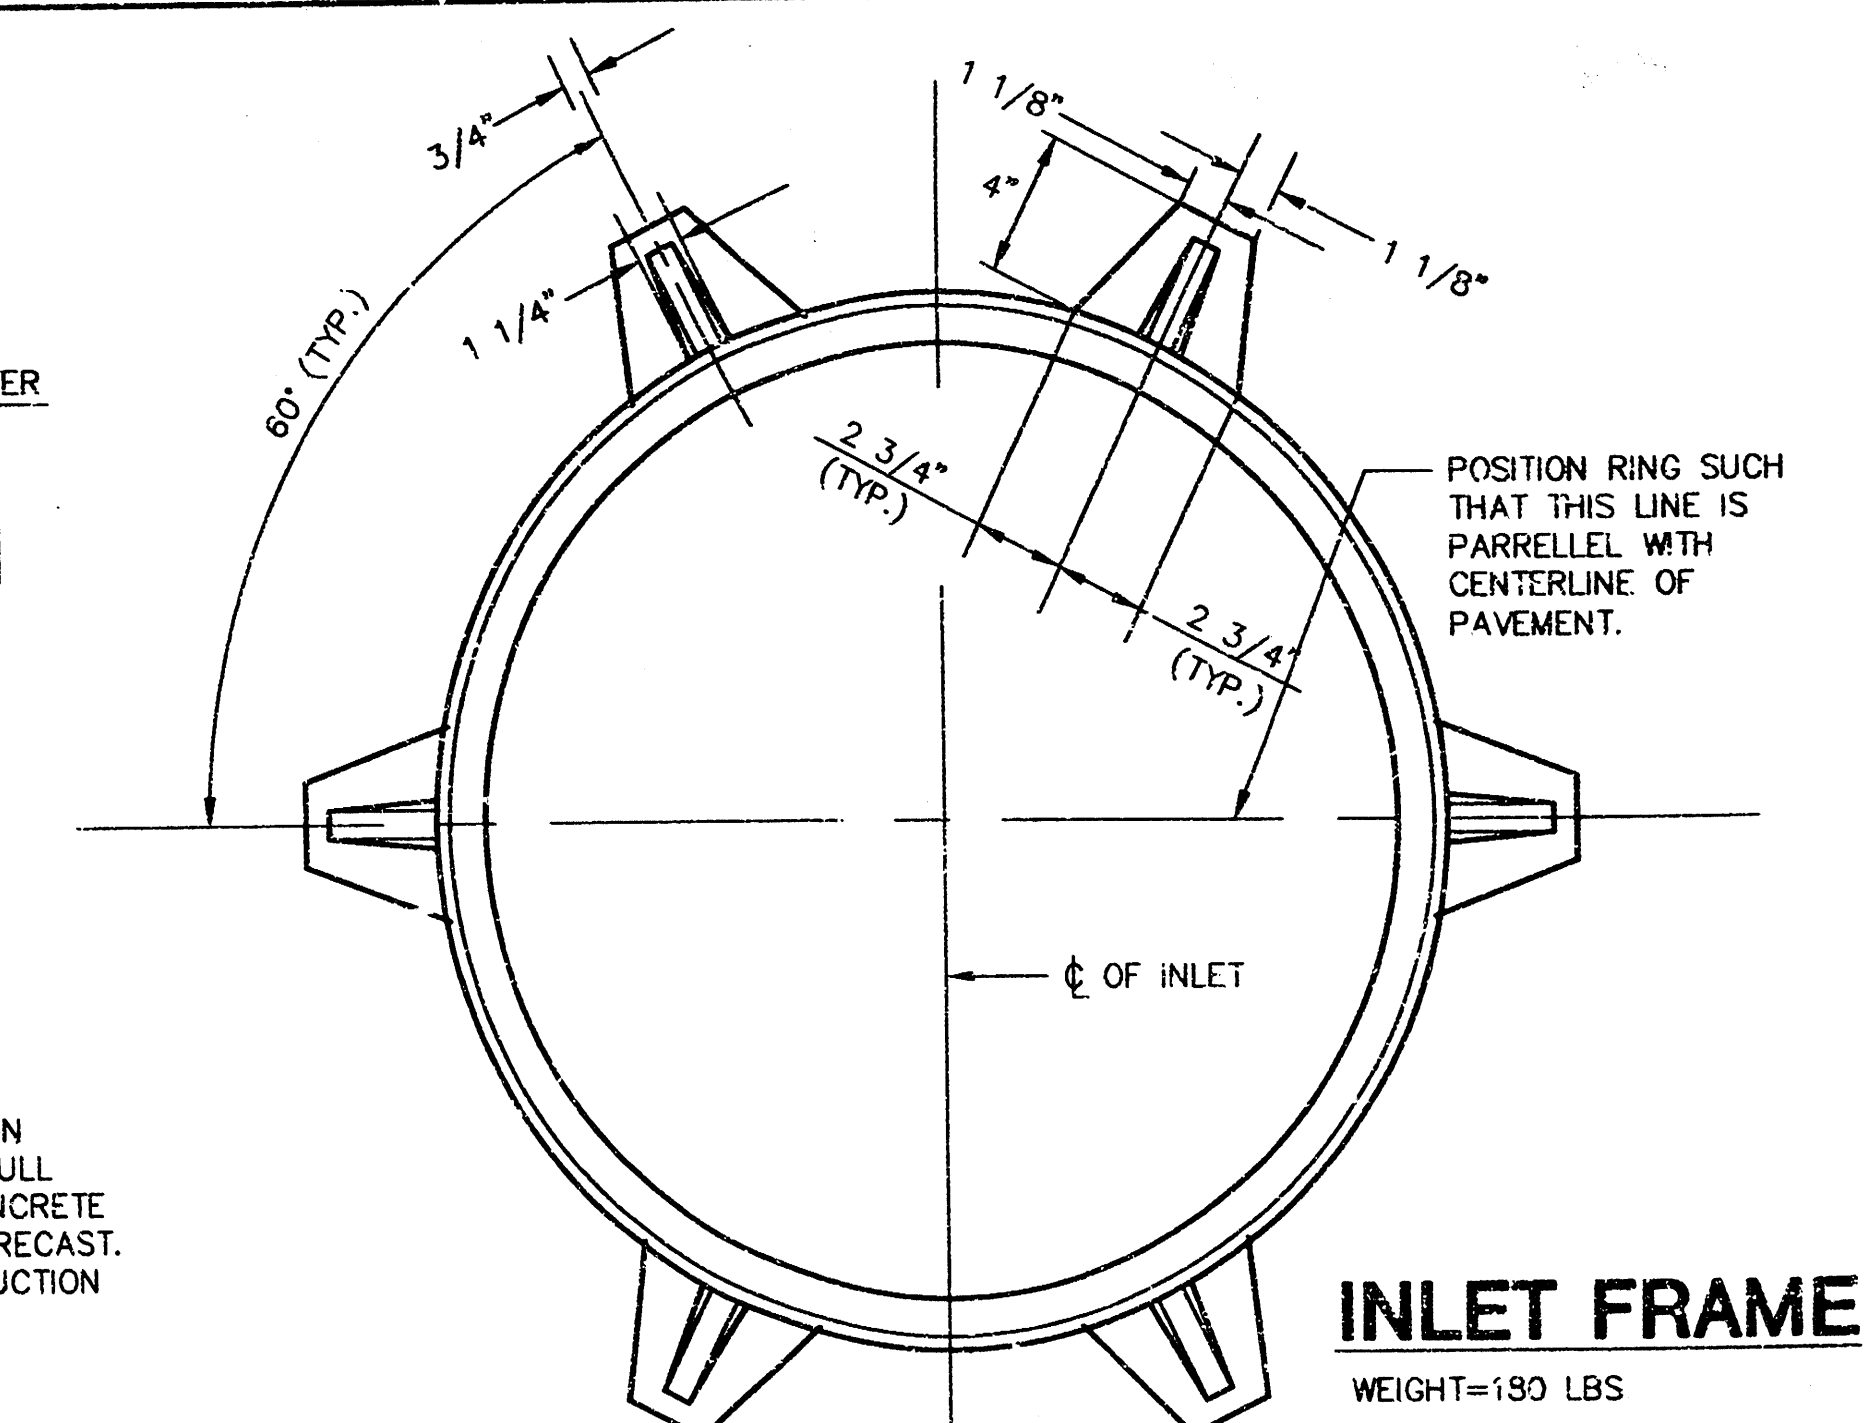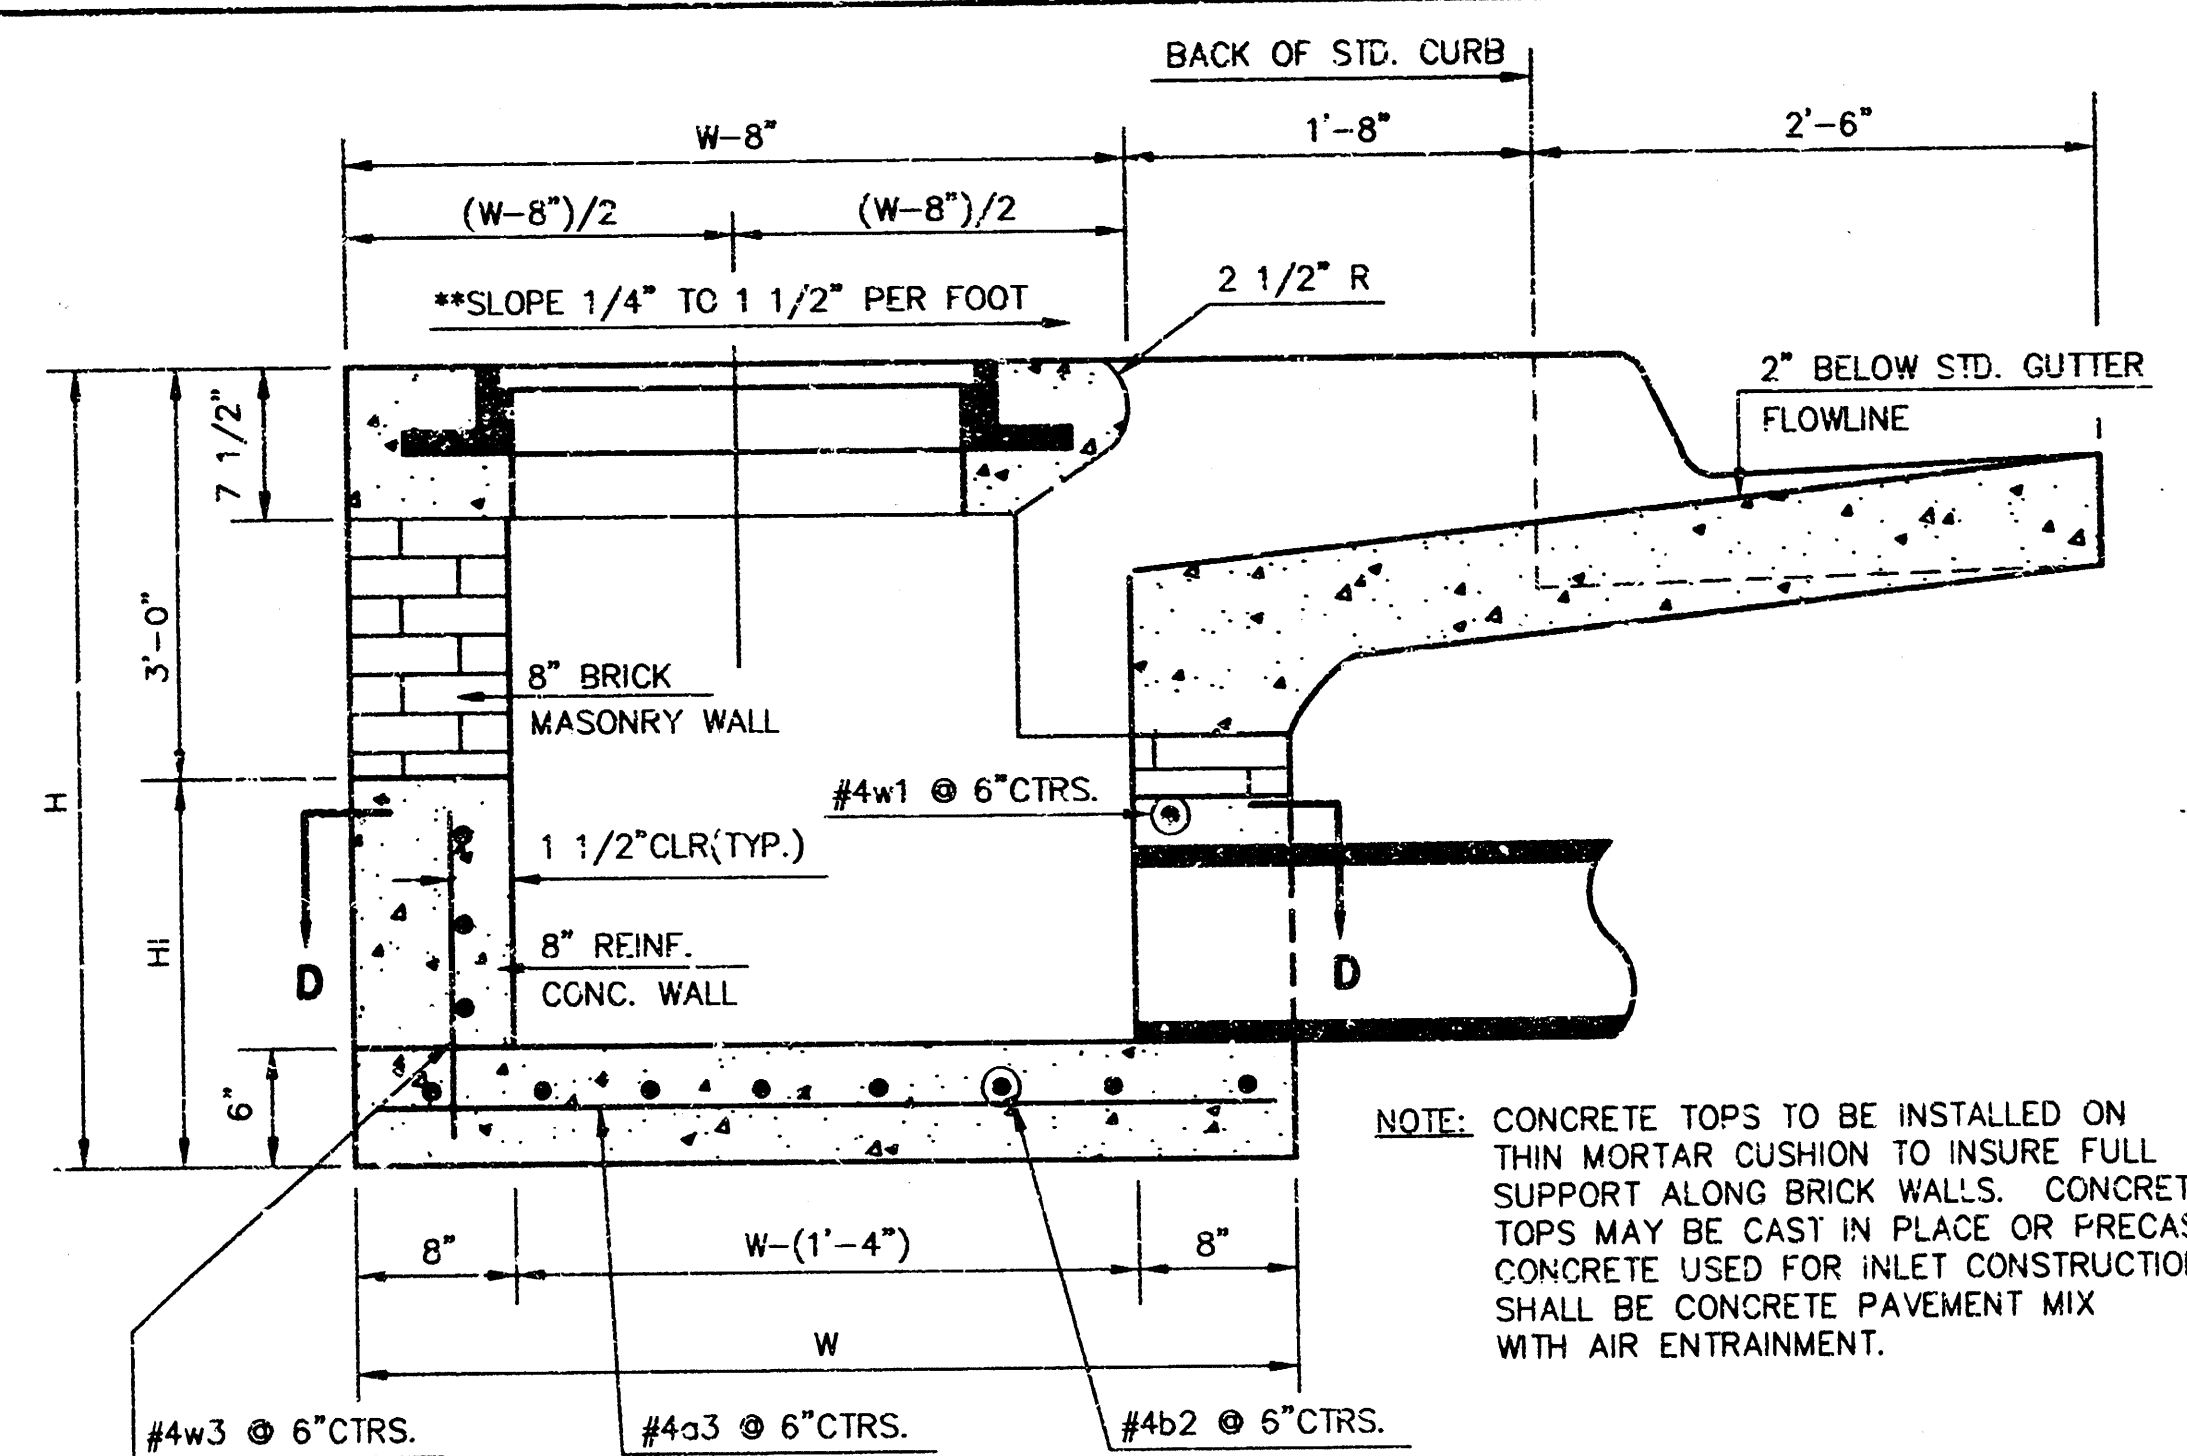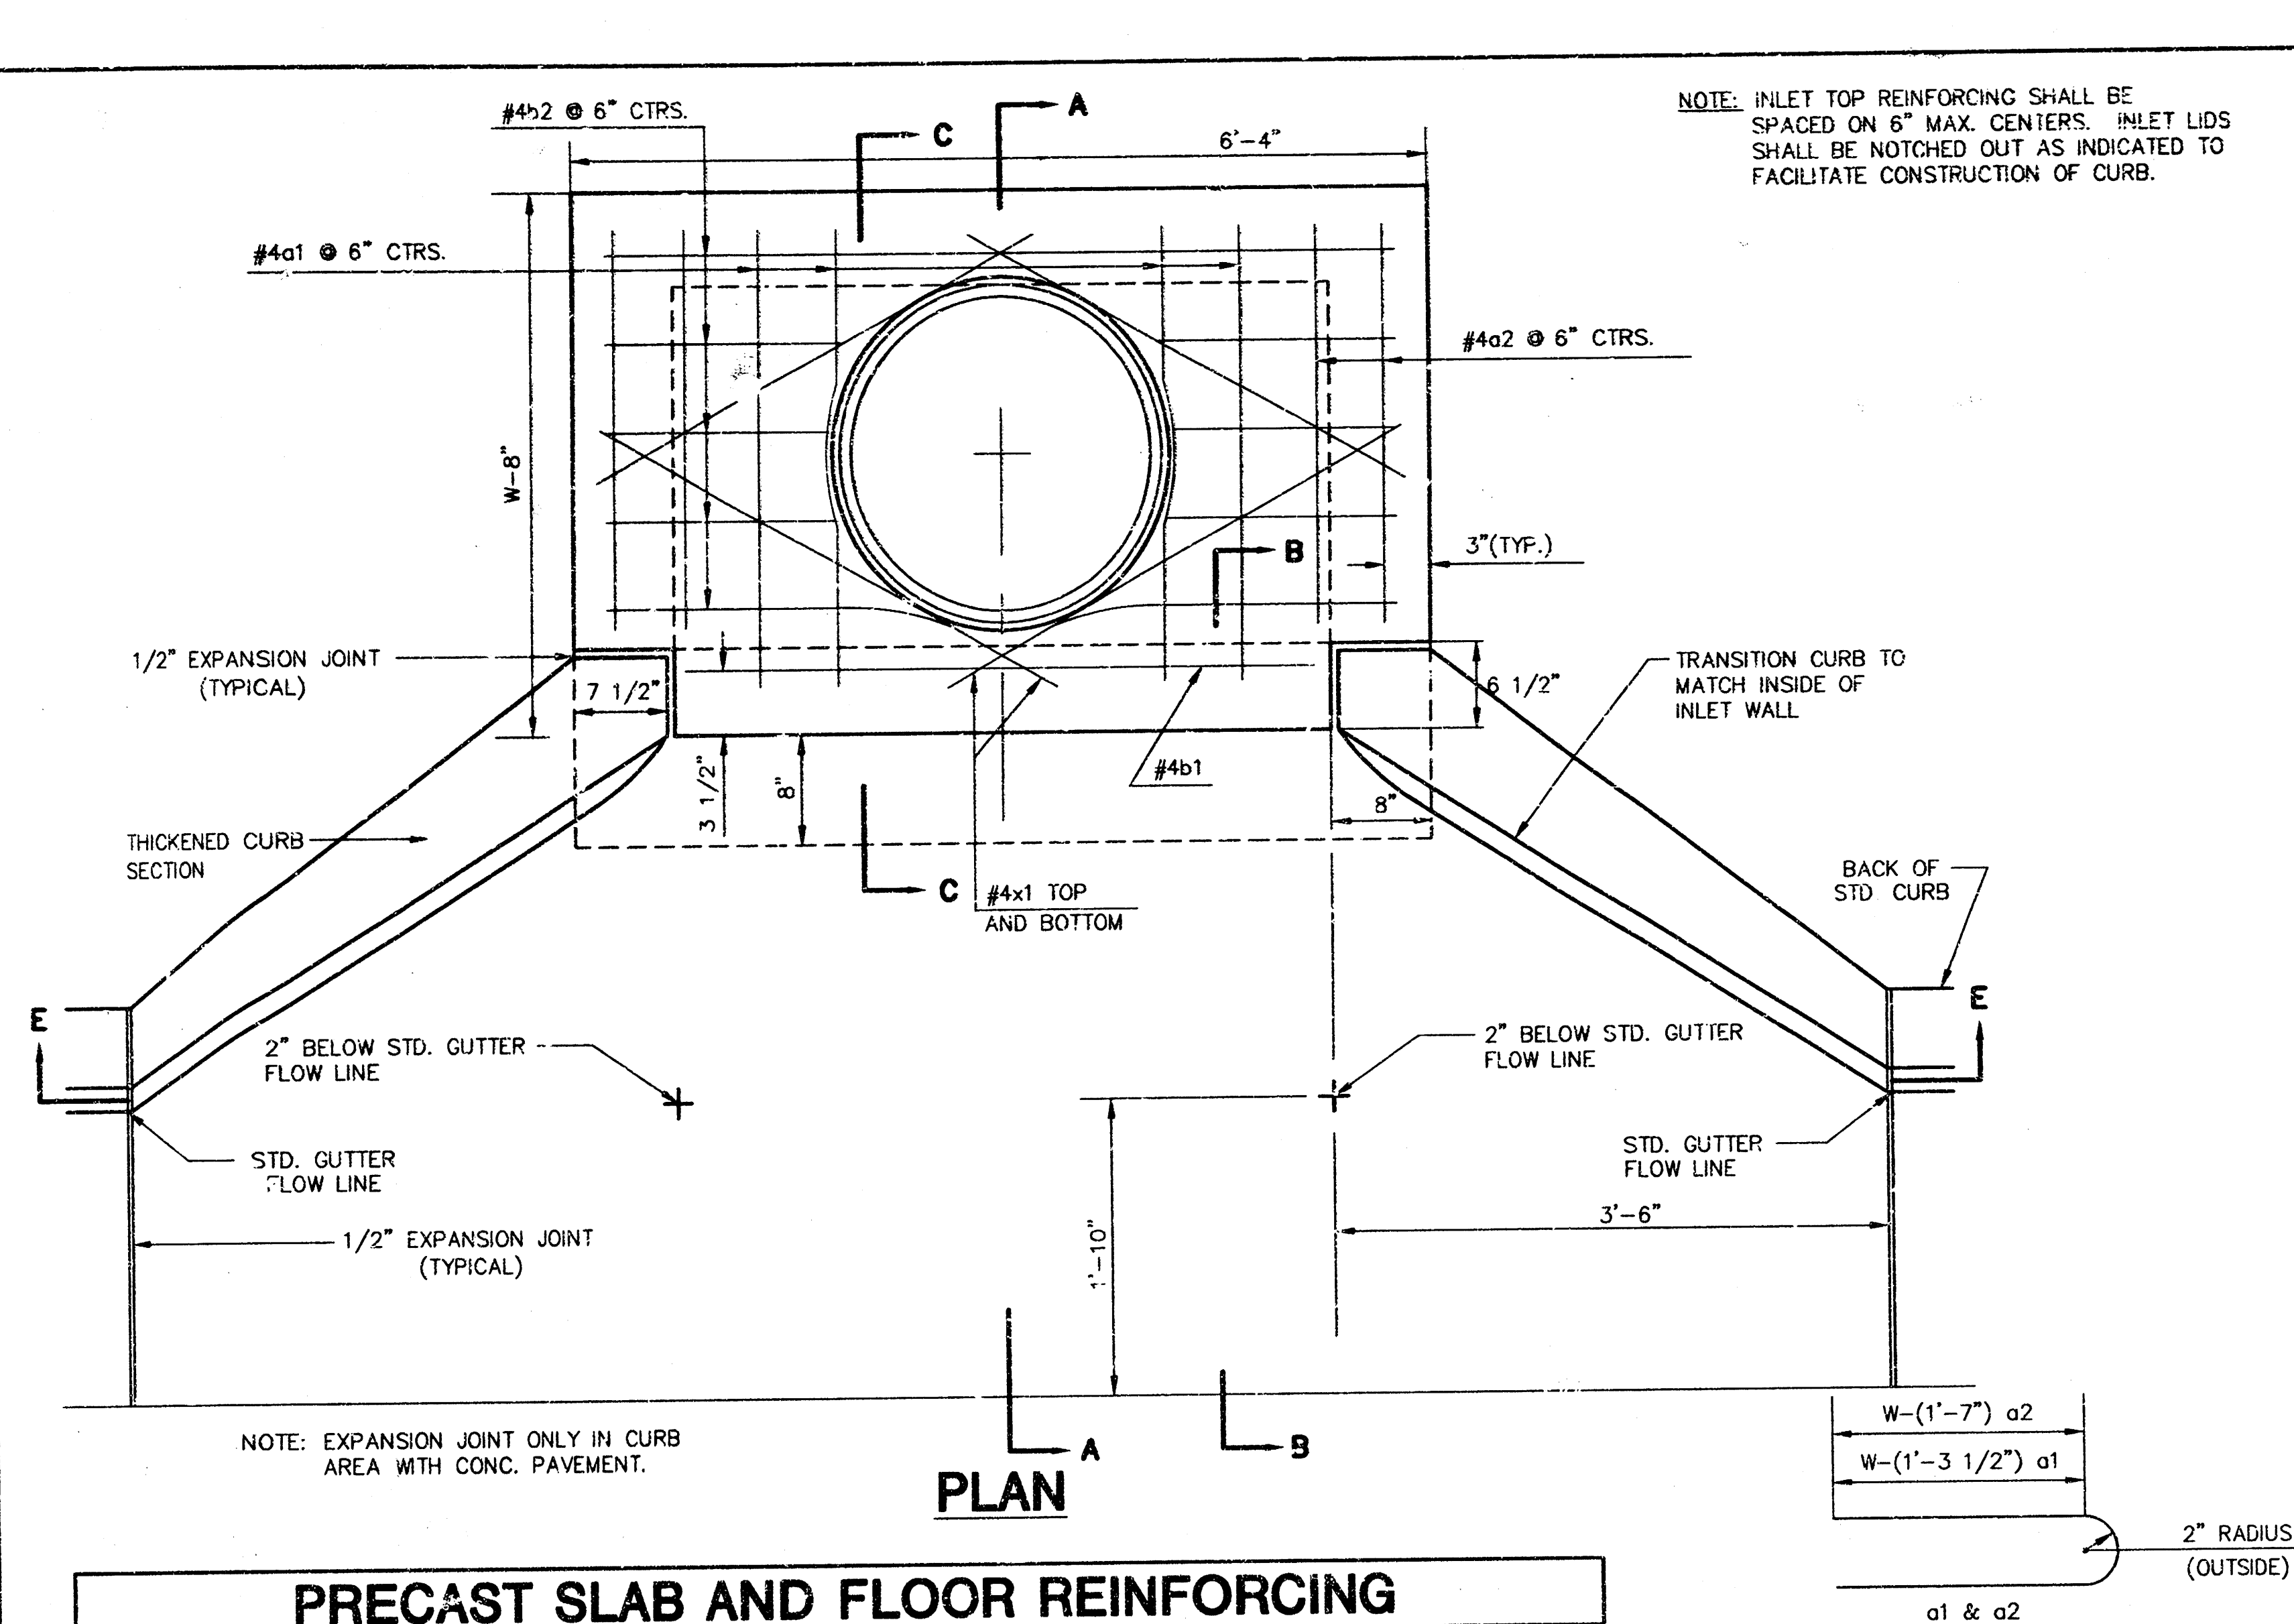

PRECAST SLAB AND FLOOR REINFORCING											
		W=4'-4"		W=5'-4"		W=6'-4"		W=7'-4"		W=8'-4"	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
*a1	#4	6	6'-7"	6	8'-7"	6	10'-7"	6	12'-7"	6	14'-7"
a2	#4	4	6'-0"	4	8'-0"	4	10'-0"	4	12'-0"	4	14'-0"
a3	#4	13	4'-1"	13	5'-1"	13	6'-1"	13	7'-1"	13	8'-1"
b1	#4	1	4'-9"	1	4'-9"	1	4'-9"	1	4'-9"	1	4'-9"
*b2	#4	23	6'-1"	29	6'-1"	35	6'-1"	41	6'-1"	47	6'-1"
x1	#4	8	3'-10"	8	4'-2"	8	4'-6"	8	4'-10"	8	5'-2"
WALL REINFORCING											
		W=4'-4"		W=5'-4"		W=6'-4"		W=7'-4"		W=8'-4"	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
w1	#4	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"
w2	#4	①	4'-1"	①	5'-1"	①	6'-1"	①	7'-1"	①	8'-1"
w3	#4	32	②	36	②	40	②	44	②	48	②

WALL REINFORCING											
		W=4'-4"		W=5'-4"		W=6'-4"		W=7'-4"		W=8'-4"	
MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
w1	#4	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"	①	6'-1"
w2	#4	①	4'-1"	①	5'-1"	①	6'-1"	①	7'-1"	①	8'-1"
w3	#4	32	②	36	②	40	②	44	②	48	②

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8"x6'-4"x7 1/2"	21" & SMALLER	0.38±
5'-4"	4'-8"x6'-4"x7 1/2"	24" & 30"	.51±
6'-4"	5'-8"x6'-4"x7 1/2"	36" & 42"	.64±
7'-4"	6'-8"x6'-4"x7 1/2"	48" & 54"	.77±
8'-4"	7'-8"x6'-4"x7 1/2"	60" & 66"	.90±

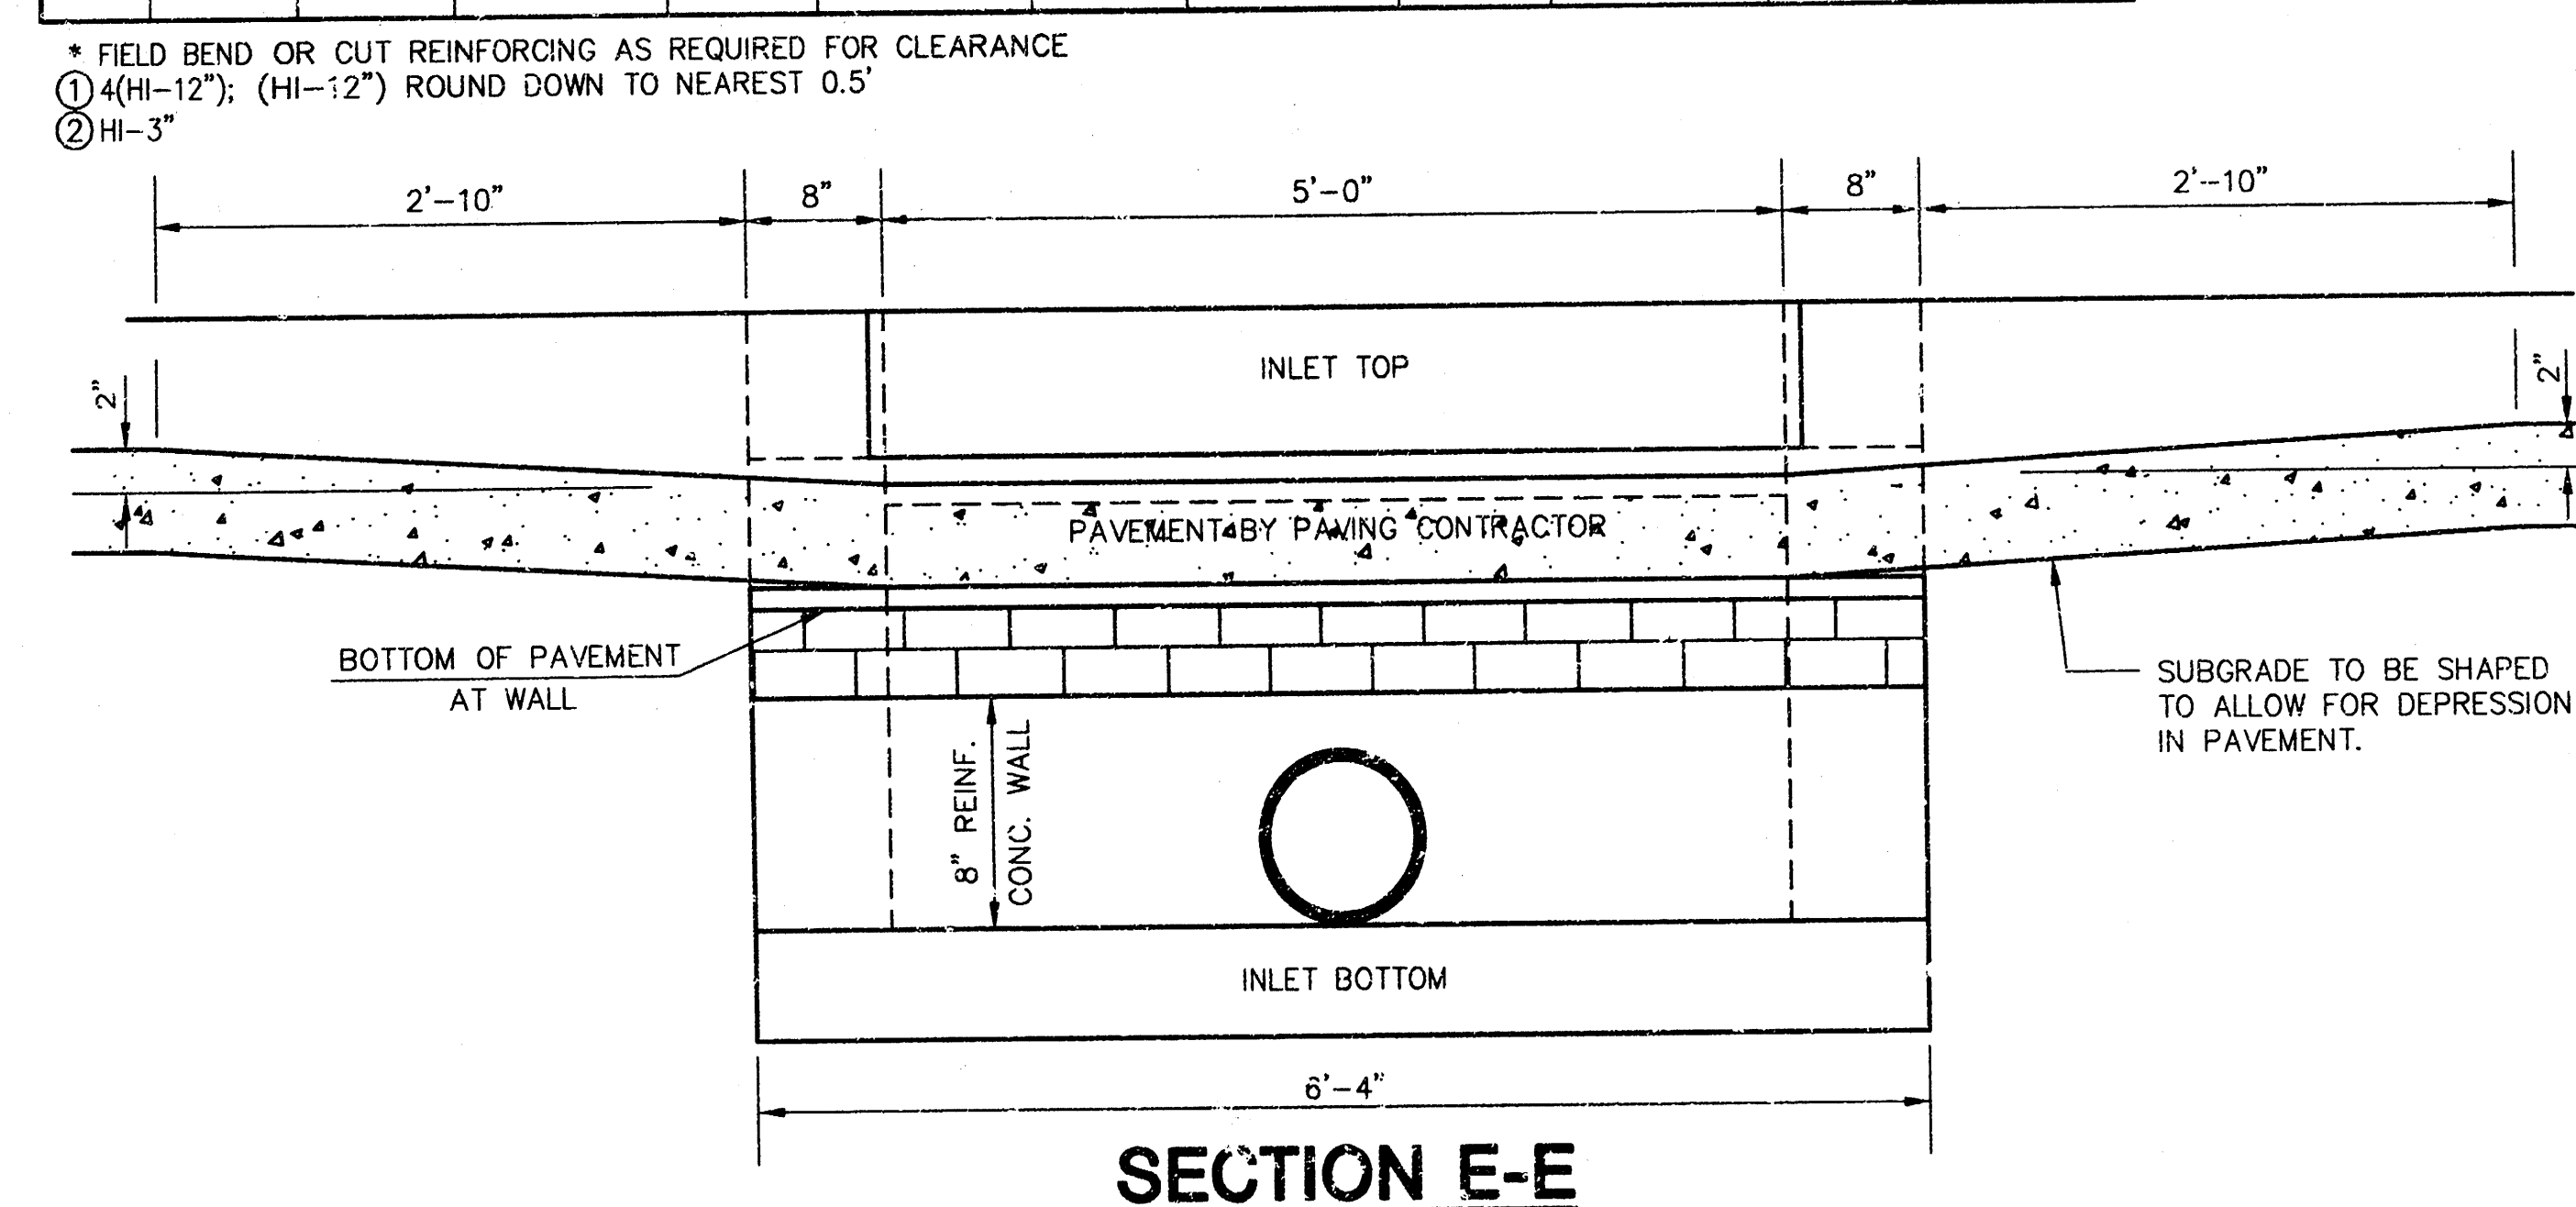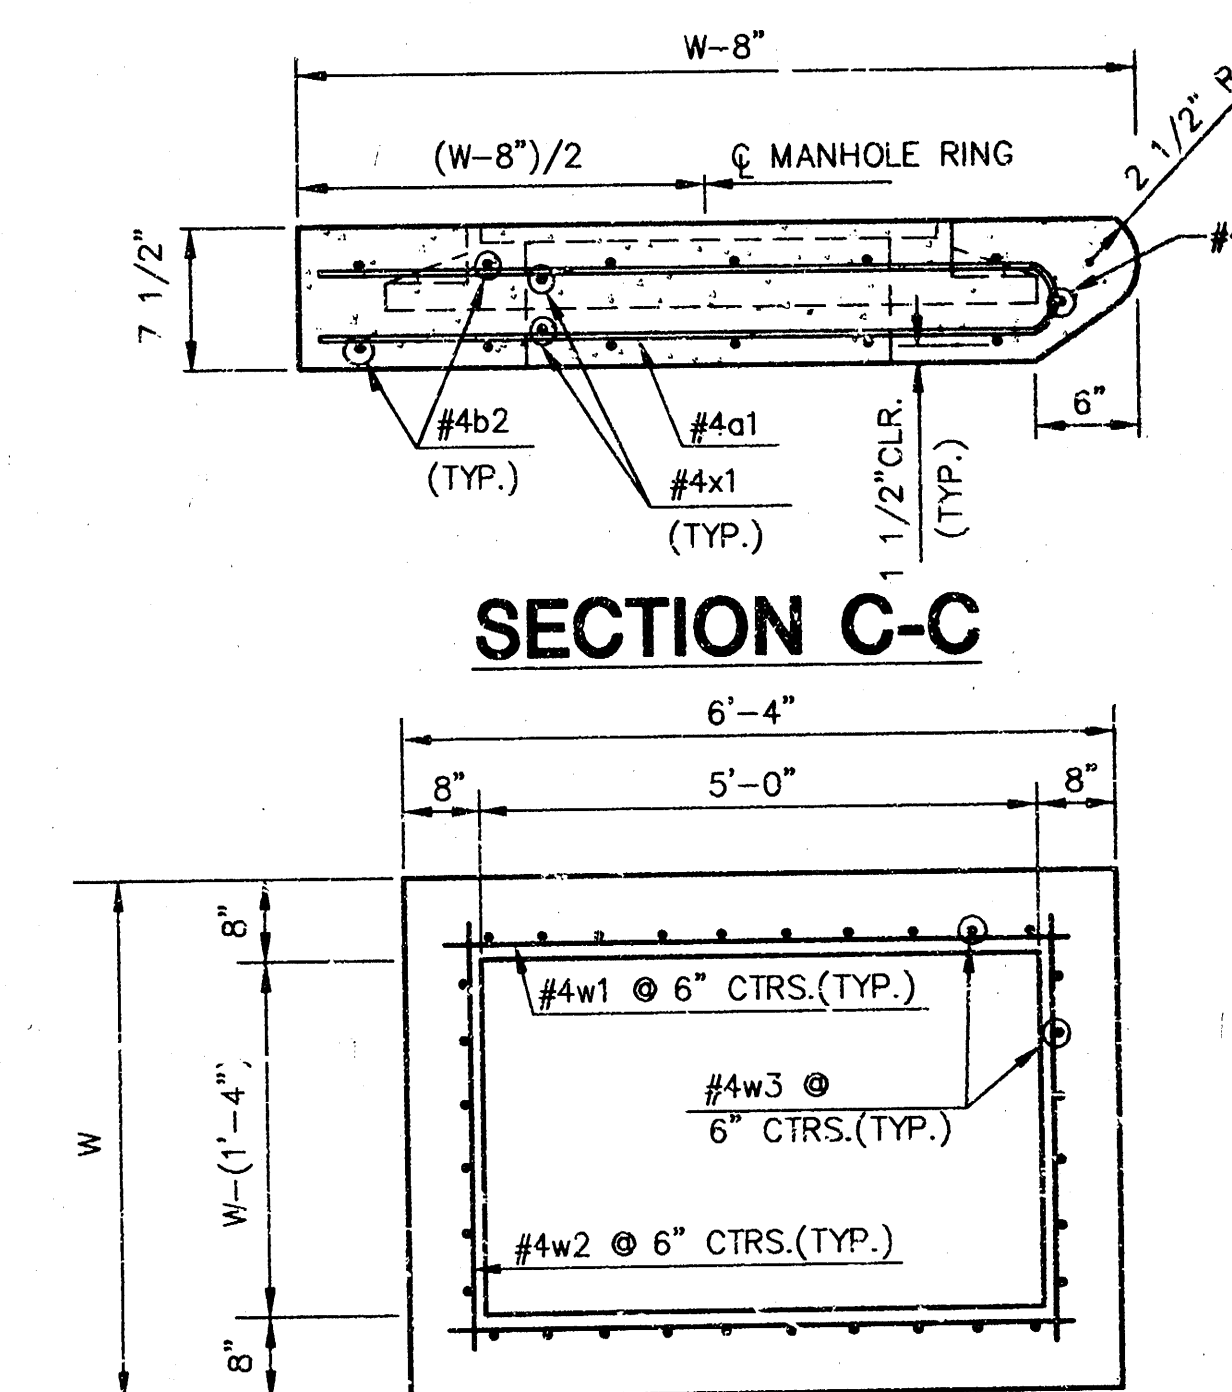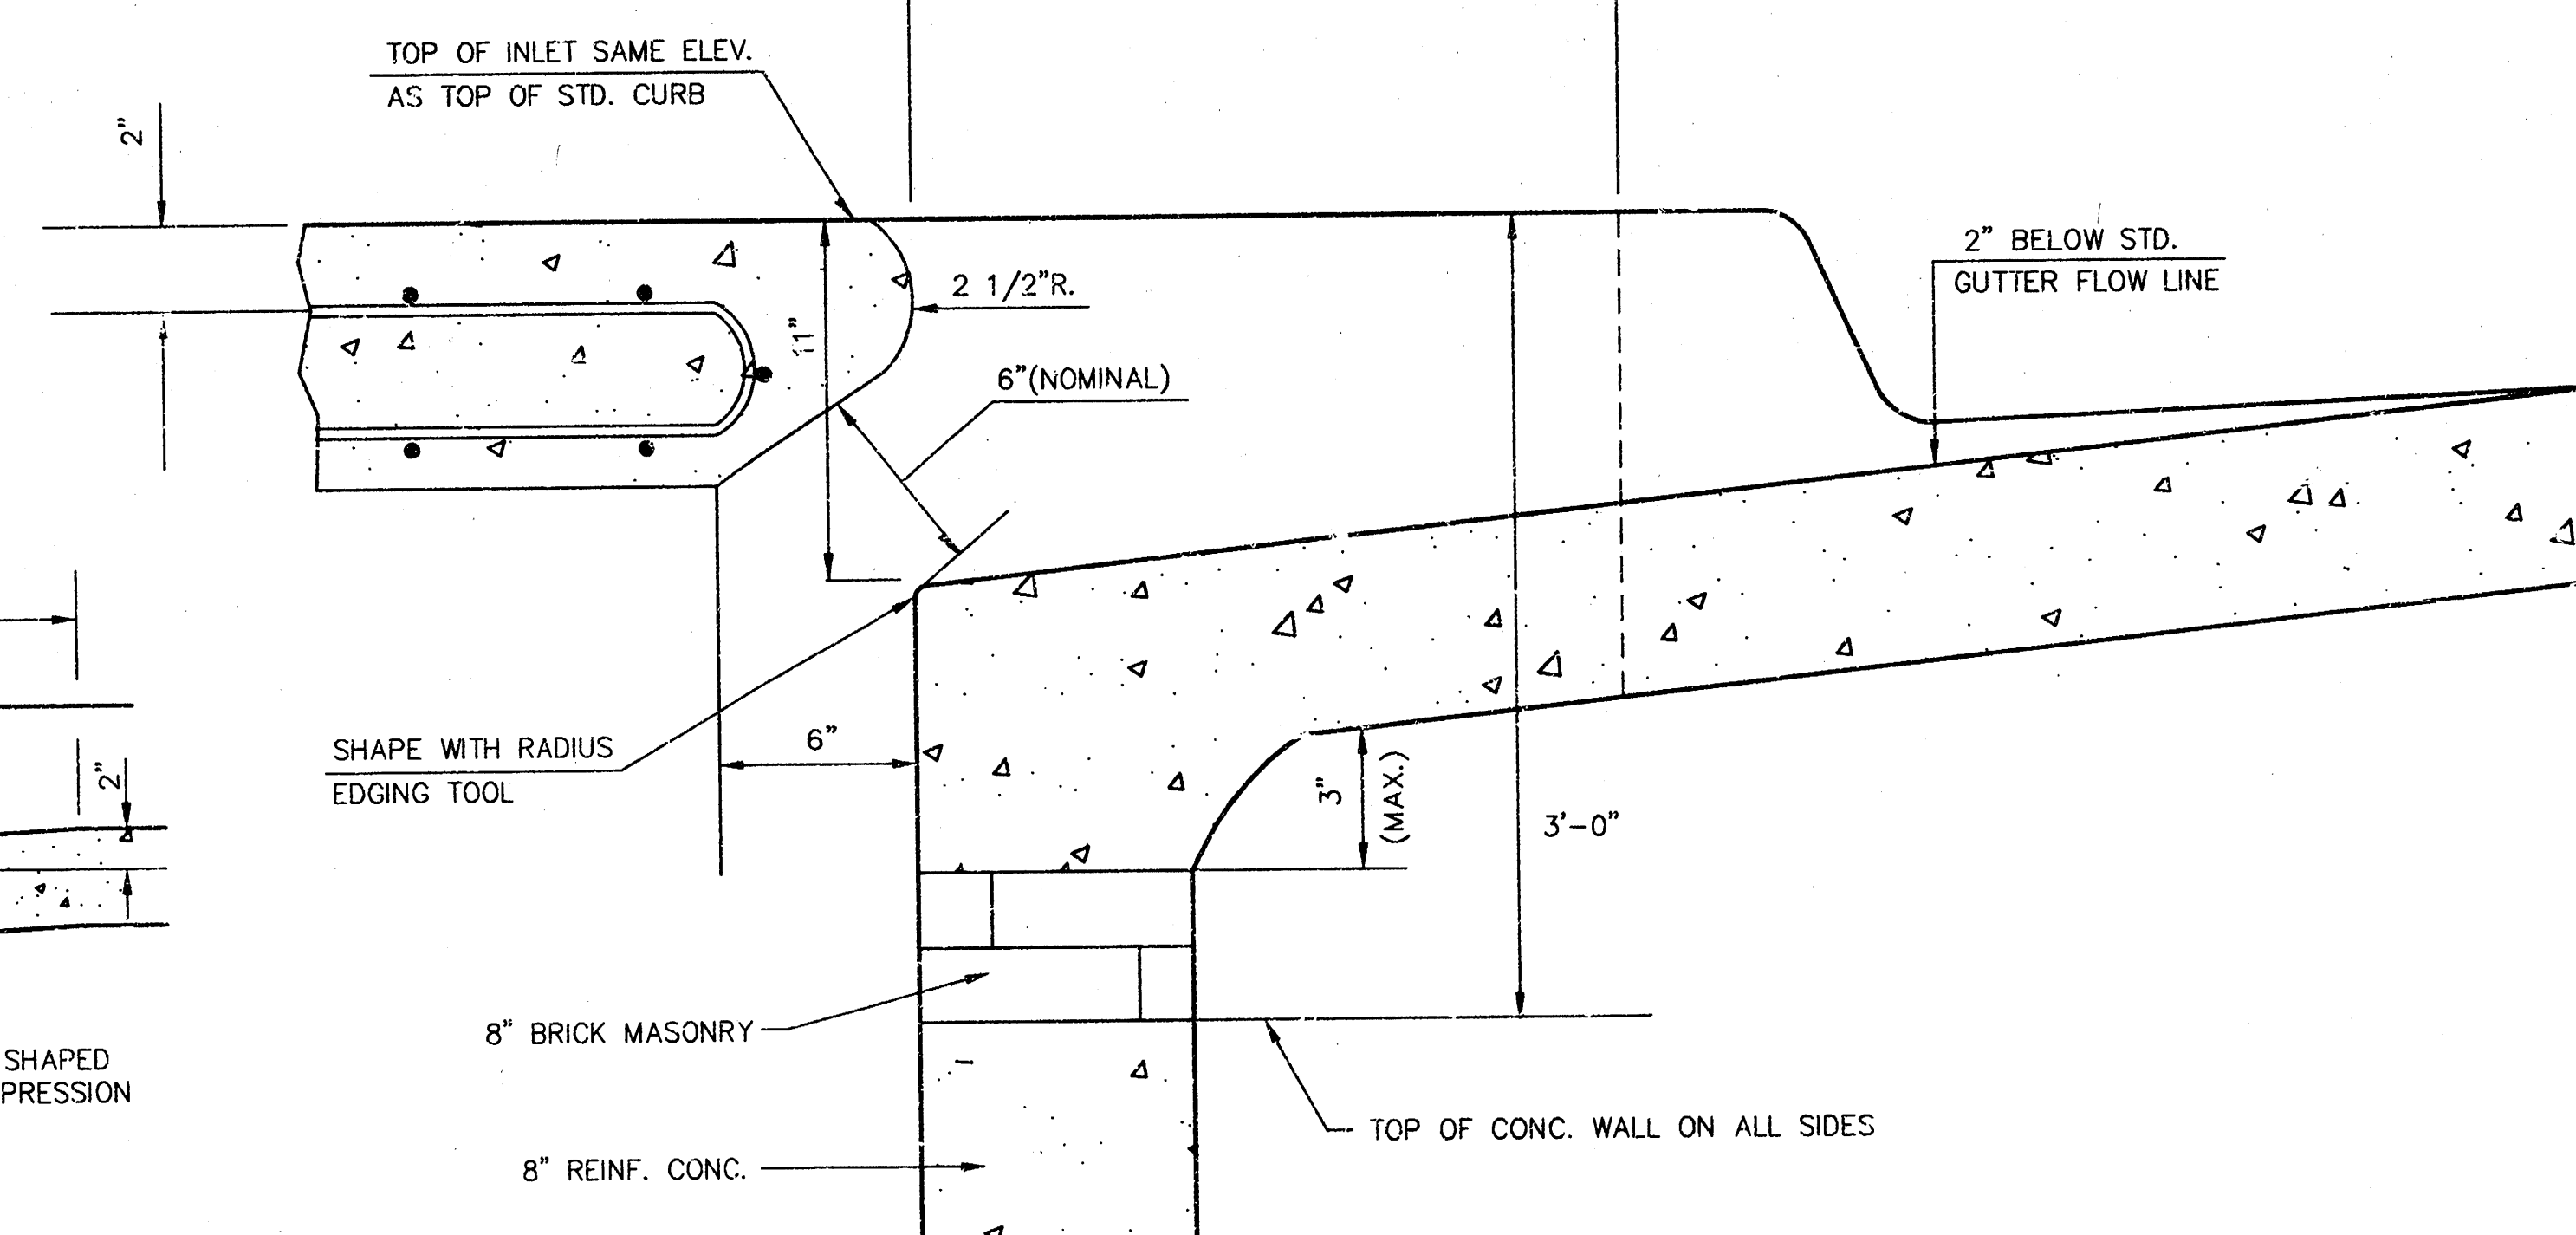

NOTE: CONTRACTOR SHALL HAVE THE OPTION OF CONSTRUCTING 8" BRICK MASONRY WALLS BETWEEN THE CONCRETE INLET BASE AND TOP ON THIS INLET WHEN W=6'-4" AND H=7'-0" OR LESS.

ADDITIONAL CURB AND GUTTER CONSTRUCTION NECESSARY TO CONNECT SET-BACK INLET TO PAVEMENT WILL BE PAID FOR AT THE UNIT PRICE BID FOR EACH INLET HOOKUP.

INLET INVERT SHALL BE SHAPED WITH 8 SACK SAND MIX CONCRETE TO
CREATE FLOW CHANNELS AND TO INCREASE HYDRAULIC EFFICIENCY SUCH
THAT THE INLET WILL BE SELF CLEANING BETWEEN ALL INLET AND/OR
OUTLET PIPES.

THE ENDS OF ALL PIPES INSTALLED IN INLETS SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF THE INLET WALL.

**NOTE: SLOPE OF INLET TOPS TO MATCH
SIDEWALK OR PARKING SLOPES WITHIN
LIMITS INDICATED

LIMITS OF GUTTER SHAPING &/OR
EDGE OF COMB. CURB & GUTTER

TOP OF INLET SAME ELEV.
AS TOP OF STD. CURB

SHAPE WITH RADIUS
EDGING TOOL8th BRICK MASONRY—8^o REINF. CONC. —

TOP OF CONC. WALL ON ALL SIDES

2" BELOW STD.
GUTTER FLOW LINE

REVISED: 2-16-89 C.O.W.

STANDARD TYPE 1A
CURB INLET
INLET OPENING=6"x5'-0"

JUNE 1984

CITY OF WICHITA, KANSAS

Design C.O.W.	Checked by	Checked by	Sheet 7 of 10
Drawn by	Date	Date June 1998	Job No. 97084dd2

Drawn by	Date	Date June 1998	Job No. 97084dd2
----------	------	----------------	------------------

Technical drawing of a rectangular plate. The top view shows a plate with a width of $23 \frac{1}{2}"$ and a height of $3 \frac{1}{8}"$. The plate features a series of vertical slots, with a typical spacing of $1 \frac{1}{2}"$ between them. The side view shows a cross-section of the plate, which is $2"$ thick. The total height of the plate is $23 \frac{1}{2}"$. The side view also shows a series of vertical slots, with a typical spacing of $1 \frac{1}{2}"$ between them. The side view also shows a series of vertical slots, with a typical spacing of $1 \frac{1}{2}"$ between them.

**DEETER #2433
(OR EQUAL)**

(REQUIRES ONE GRATE)
OPEN AREA 184 SQ. IN.
 1.28 SQ. FT.

Dimensions (Front View):

- Overall Width: $28 \frac{1}{2}"$
- Overall Height: $29 \frac{1}{4}"$
- Inner Width: $21 \frac{1}{4}"$
- Inner Height: $24 \frac{3}{4}"$
- Top Flange Thickness: $2 \frac{1}{4}"$
- Bottom Flange Thickness: $2 \frac{1}{4}"$
- Side Flange Thickness: $2 \frac{1}{4}"$

Dimensions (Side View):

- Overall Depth: $4"$
- Top Flange Thickness: $1 \frac{1}{2}"$
- Bottom Flange Thickness: $1 \frac{1}{2}"$
- Side Flange Thickness: $2"$

Technical drawing of a rectangular grate. The overall width is 52" and the overall height is 29 1/4". The inner opening is 48" wide and 29" high. The text "DEETER #2434 (OR EQUAL)" is centered in the opening, with "(REQUIRES TWO GRATES)" below it. The text "OPEN AREA" is underlined, followed by "368 SQ. IN." and "2.56 SQ. FT." below it. The drawing includes dimension lines and arrows indicating measurements.

52"

29 1/4"

48"

2"

2"

DEETER #2434 (OR EQUAL)

(REQUIRES TWO GRATES)

OPEN AREA 368 SQ. IN.
2.56 SQ. FT.

IF ASPHALT PAVEMENT, CONSTRUCTION LIMITS FOR CONCRETE TOP.

24 3/4"

2 1/4"

1 1/2"

1 1/2"

2 1/4"

18" TYP.

2" TYP.

NO.1 COMMON BRICK

FLOOR SHAPING (8 SACK SAND MIX)

VARIES



FLOOR SHAPING (8 SACK SAND MIX)

STD. CONC. PAVING MIX

3'-6"

NO 4 BARS @ 12" CTRS. BOTH WAYS

IF ASPHALT PAVEMENT, CONSTRUCTION LIMITS FOR CONCRETE TOP.

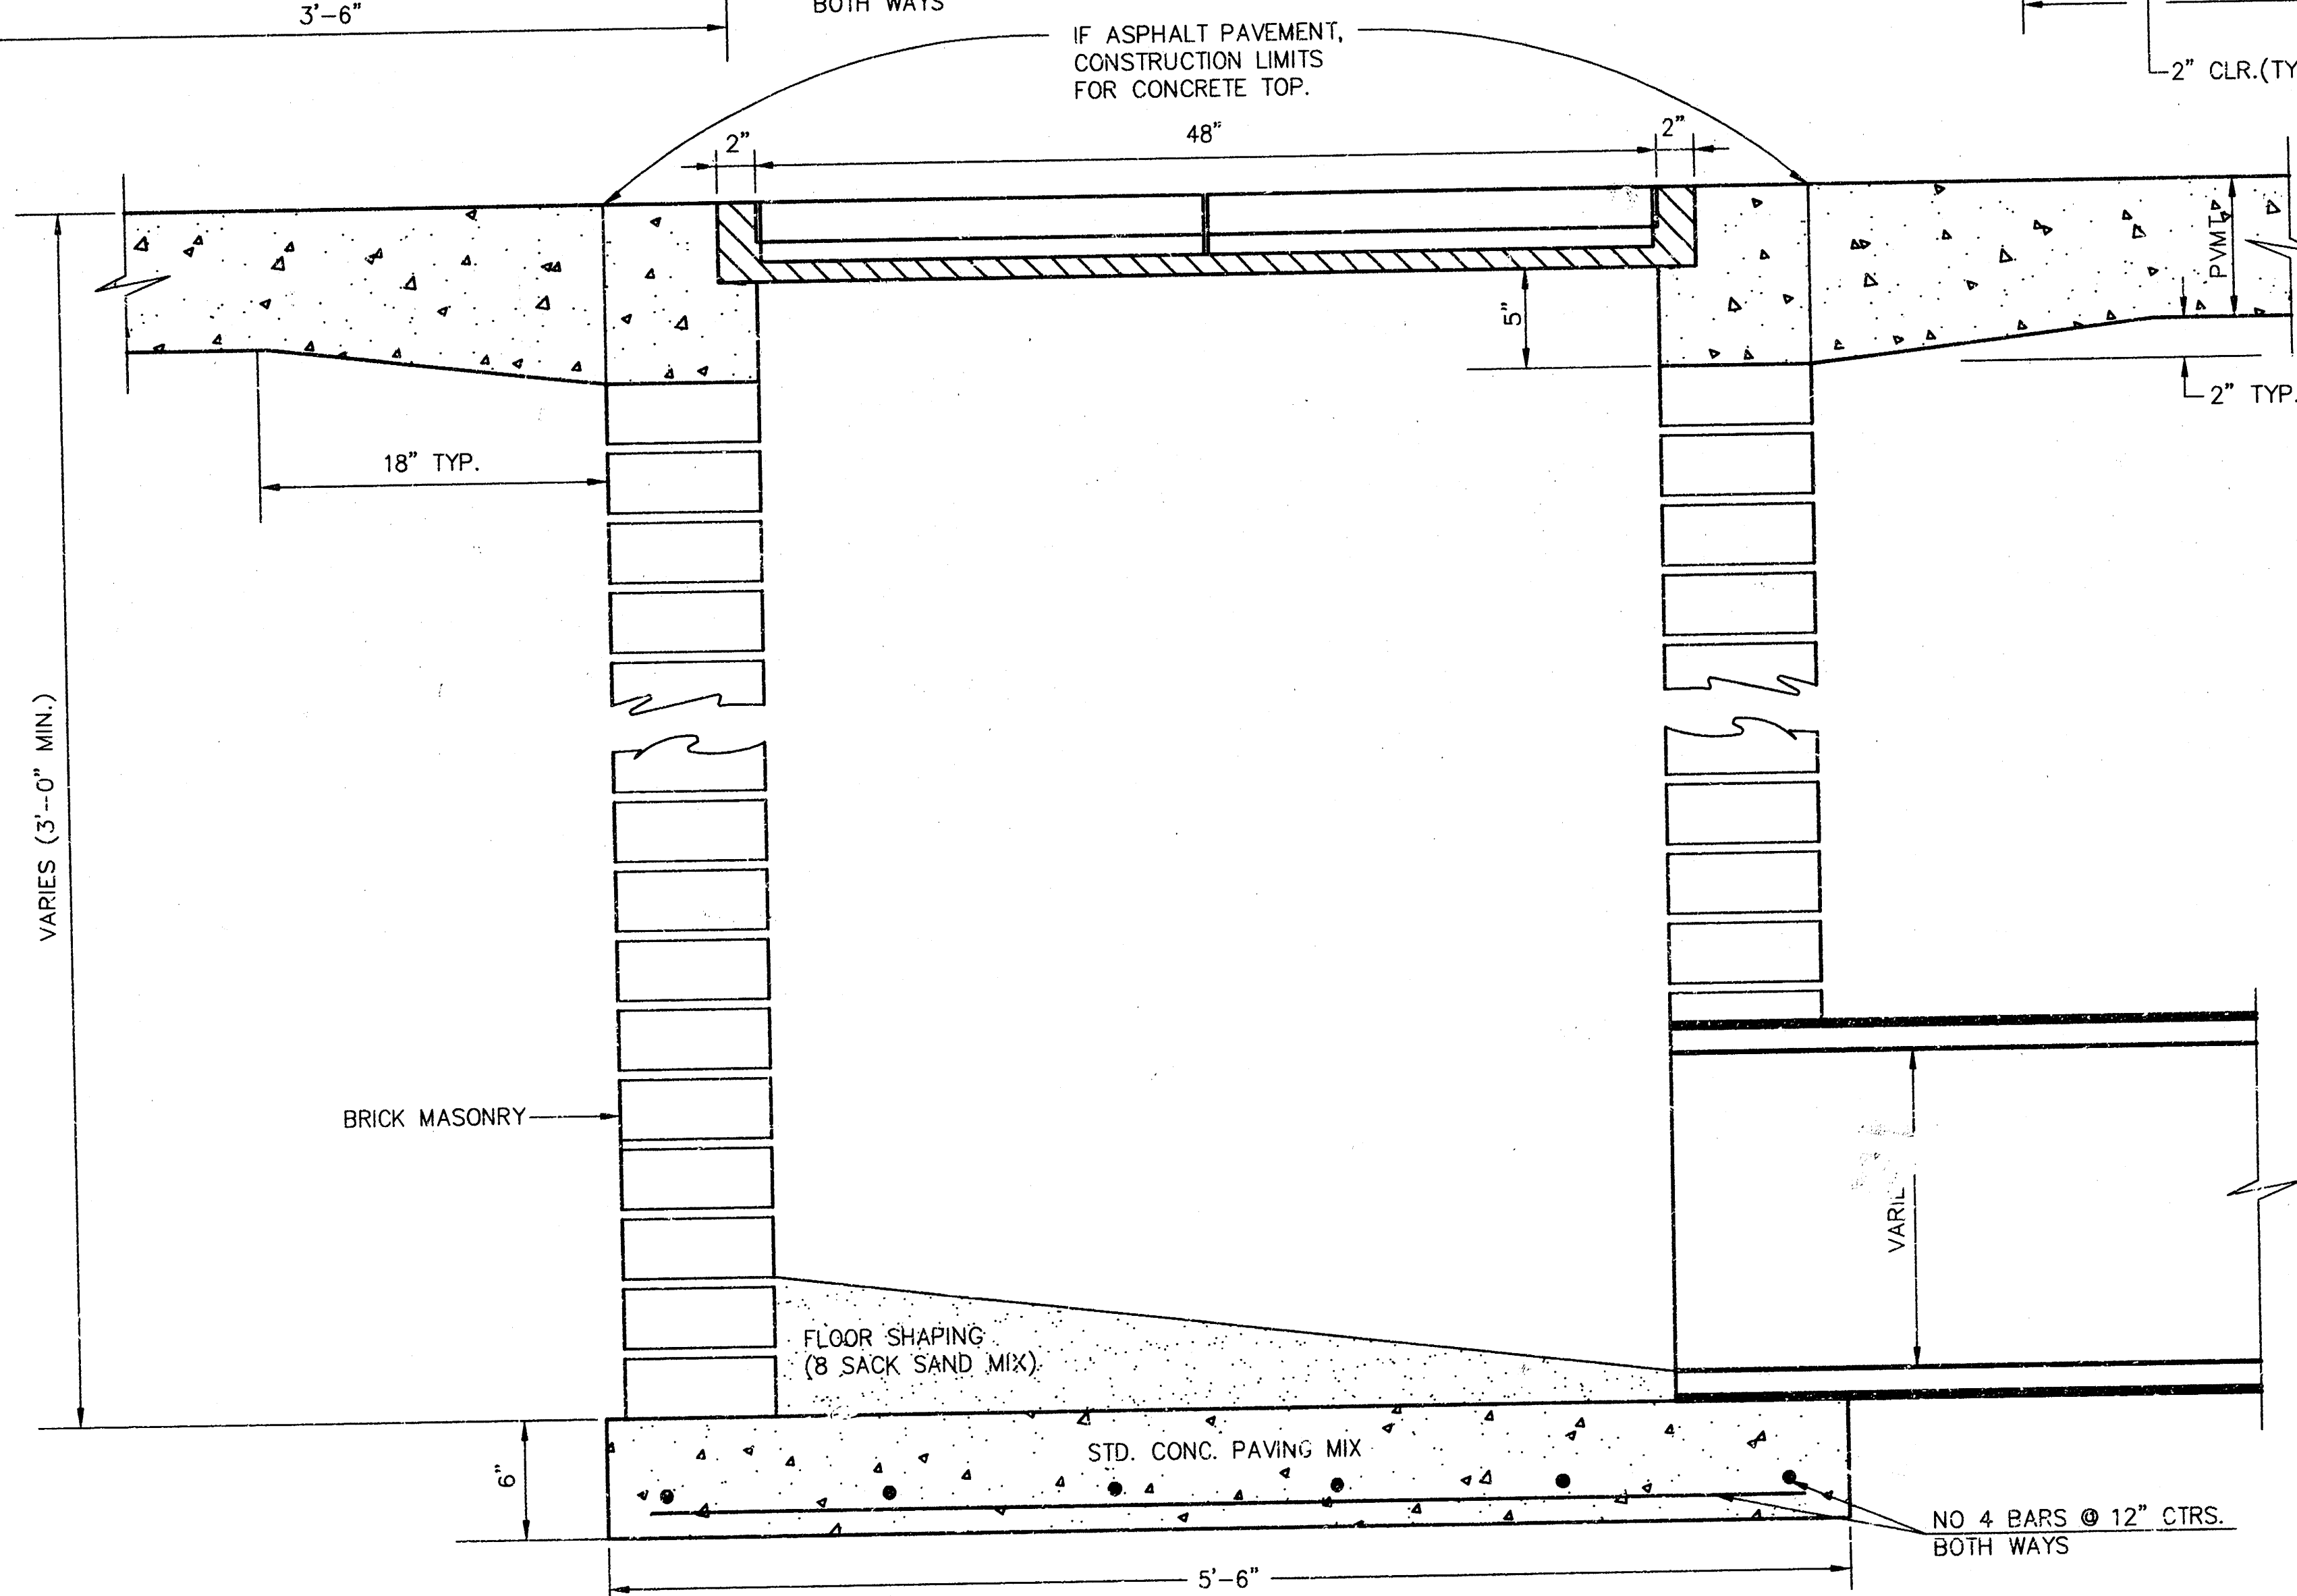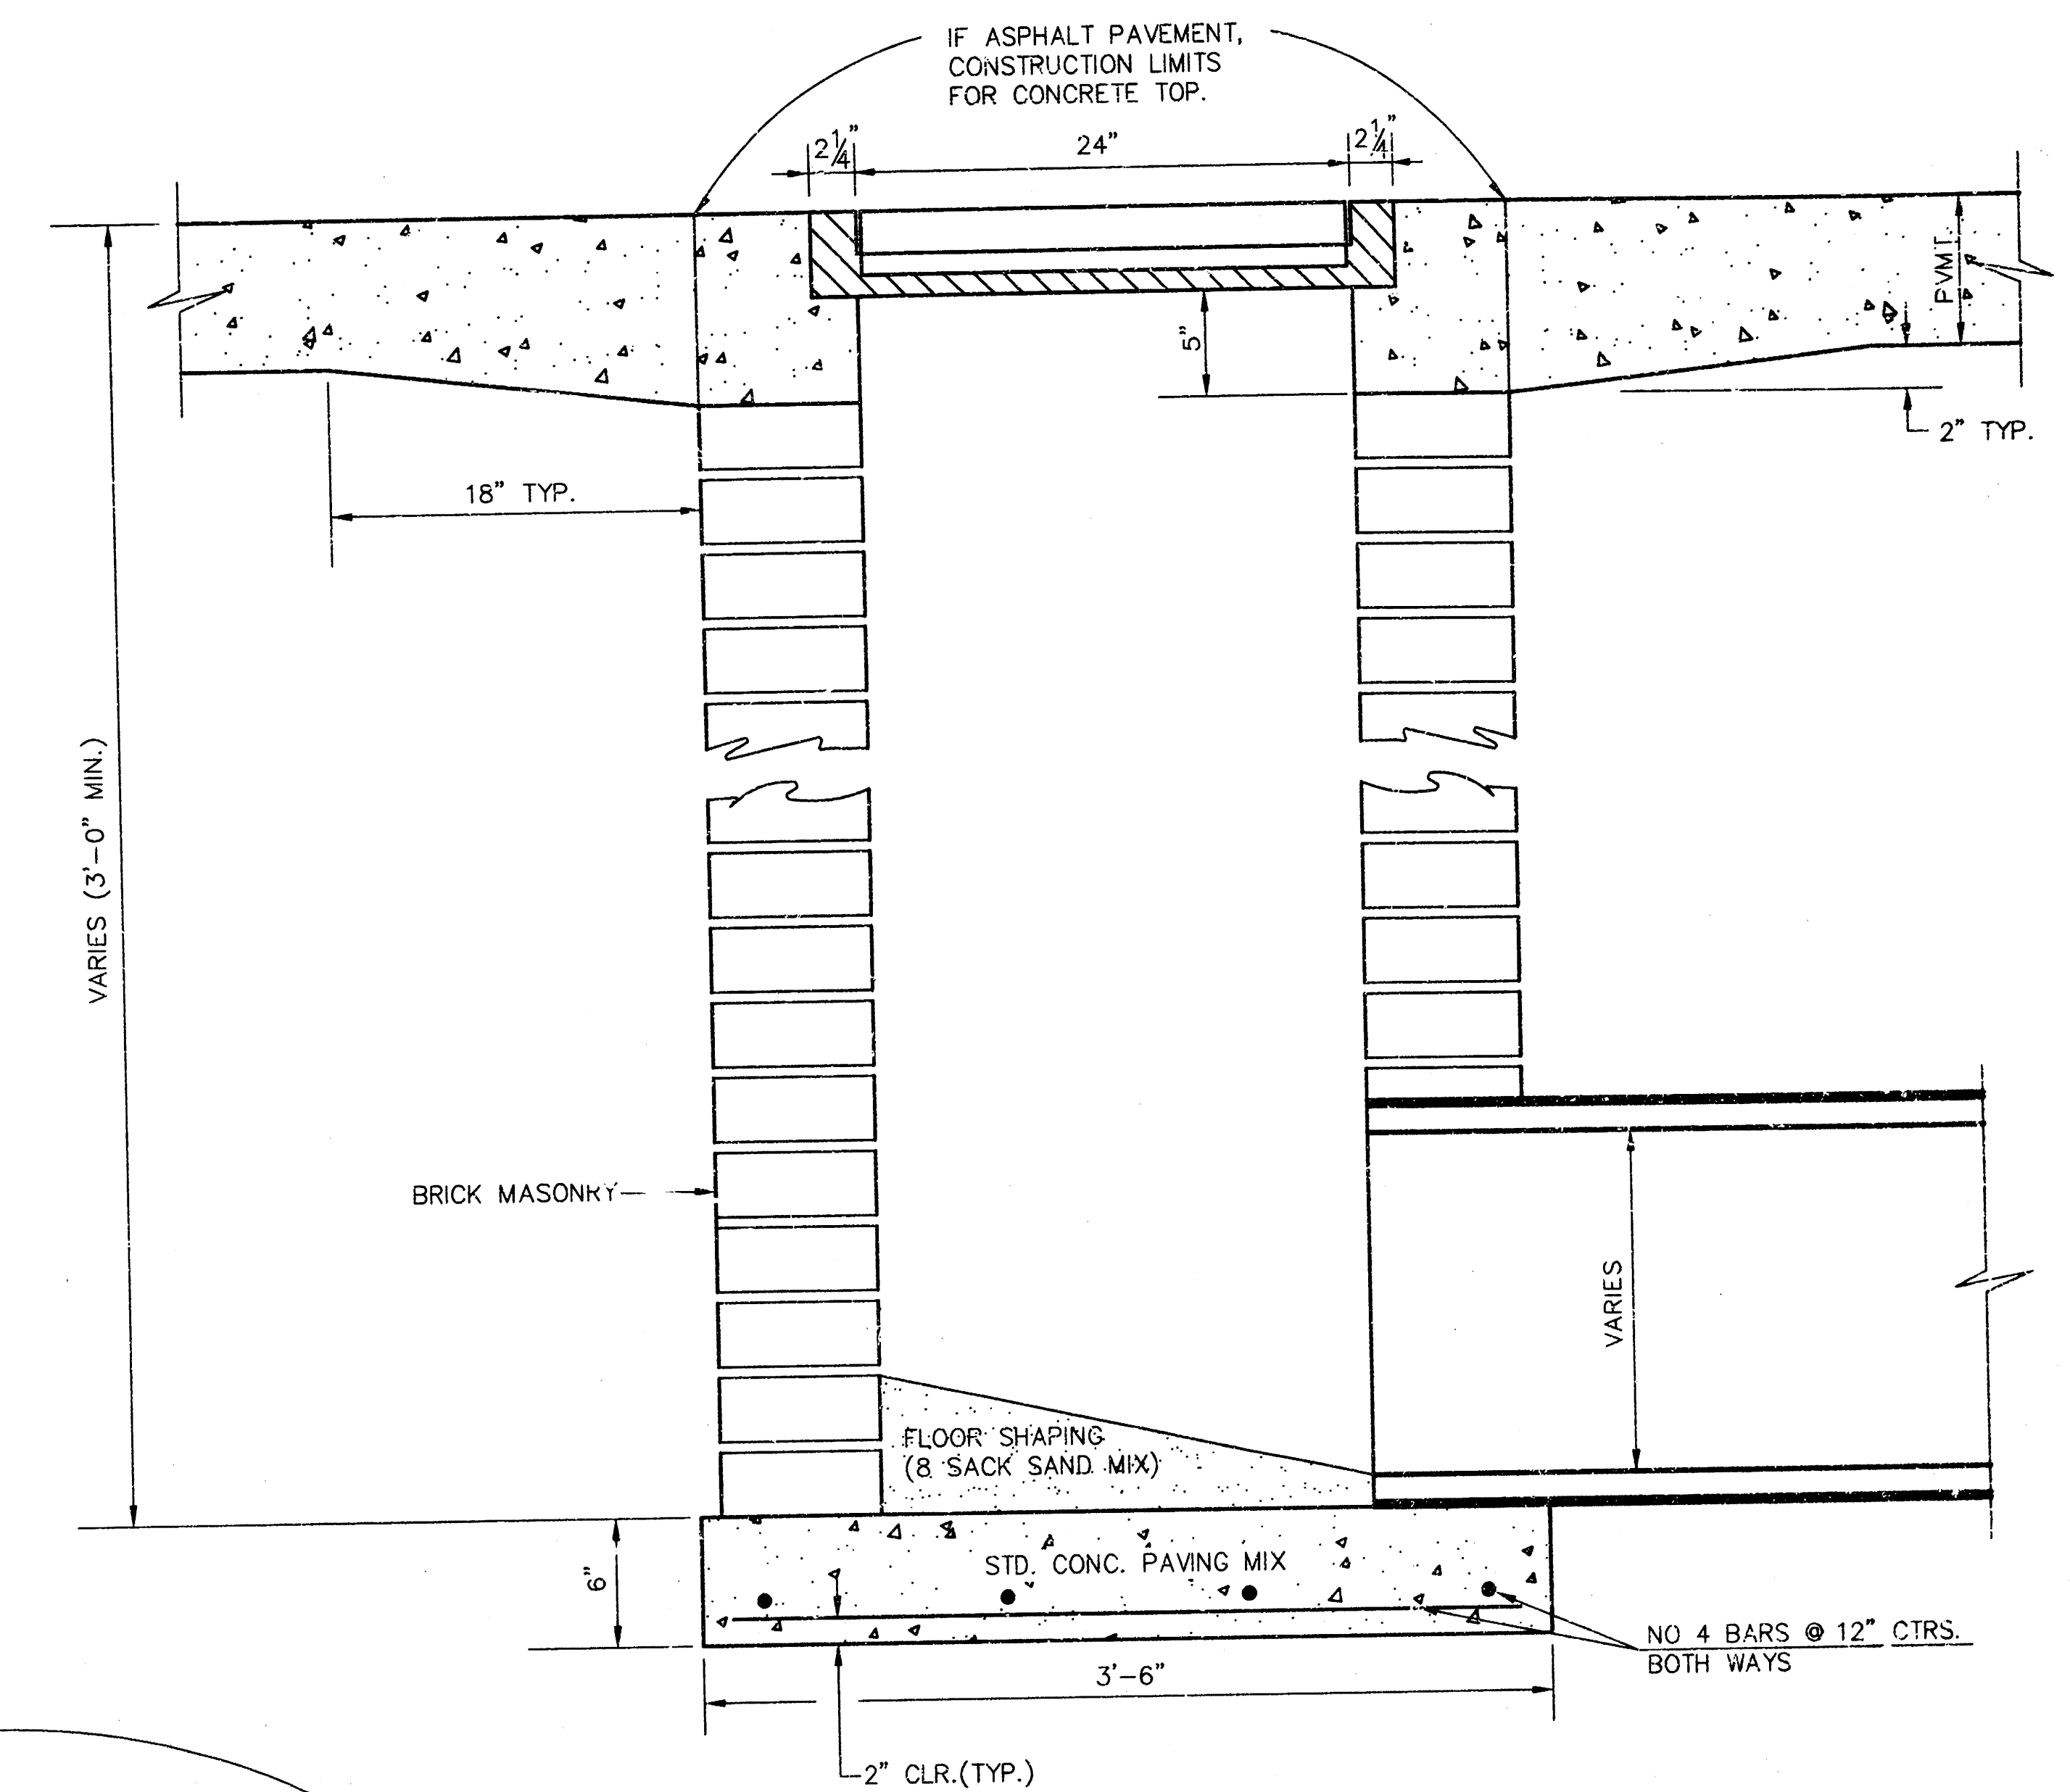


ORIFICE EQUATION		
$Q = C^* A * \sqrt{2gh}$		$C = 0.60$
h (DEPTH)	#2433 (SINGLE)	#2434 (DOUBLE)
0.1	1.95 cfs	3.89 cfs
0.2	2.75 cfs	5.50 cfs
0.3	3.37 cfs	6.74 cfs
0.4	3.89 cfs	7.78 cfs
0.5	4.35 cfs	8.70 cfs
0.6	4.77 cfs	9.53 cfs
0.7	5.15 cfs	10.30 cfs
0.8	5.50 cfs	11.01 cfs
0.9	5.84 cfs	11.67 cfs
1.0	6.15 cfs	12.30 cfs

REVISID: 5-8-90 JNJ


DROP INLET DETAILS

CITY OF WICHITA, KANSAS

Design C.O.W.	Checked by	Checked by	Sheet 8 of 10
Drawn by	Date	Date June 1998	Job No. 97084dd3

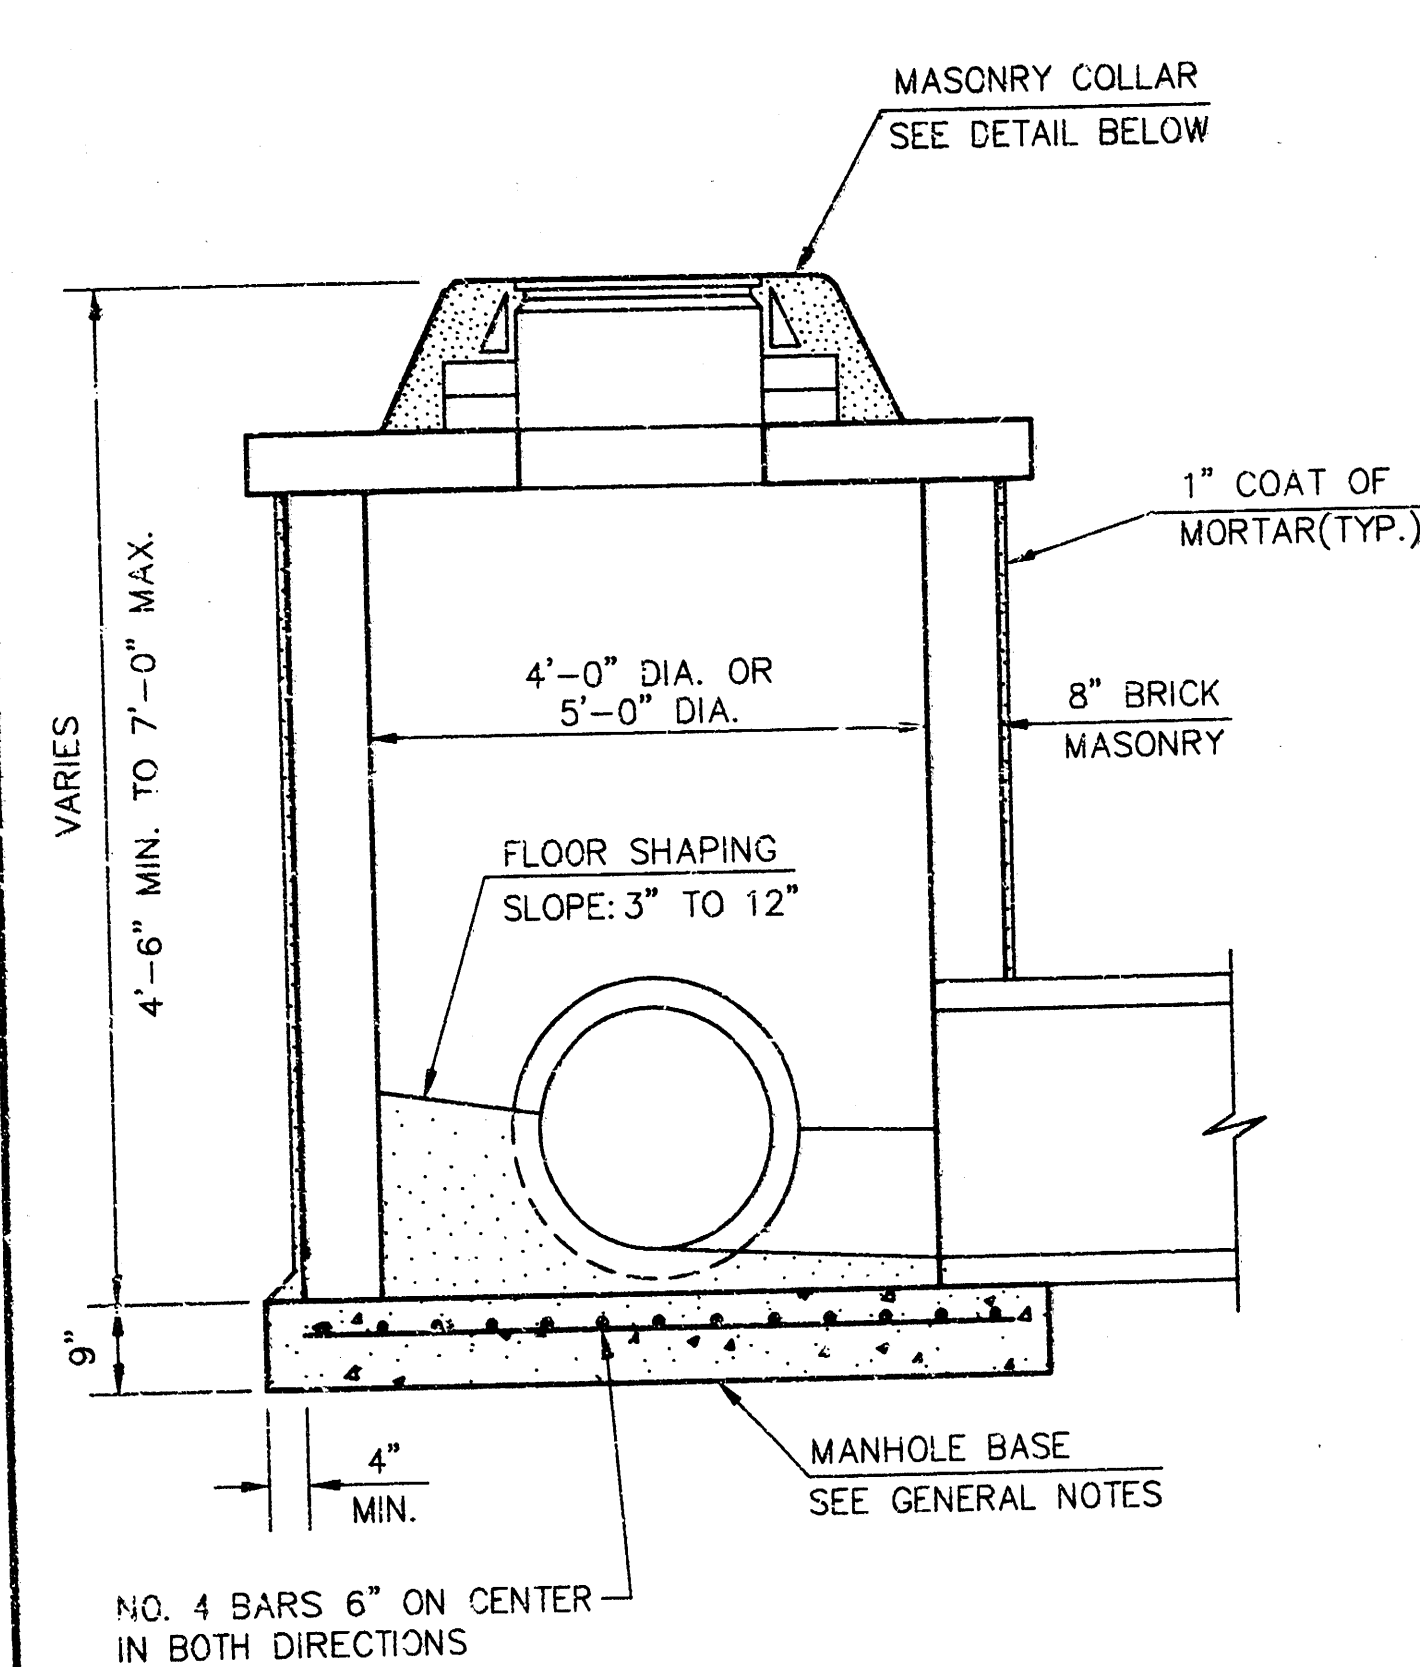


SHALLOW TYPE "A" MANHOLE

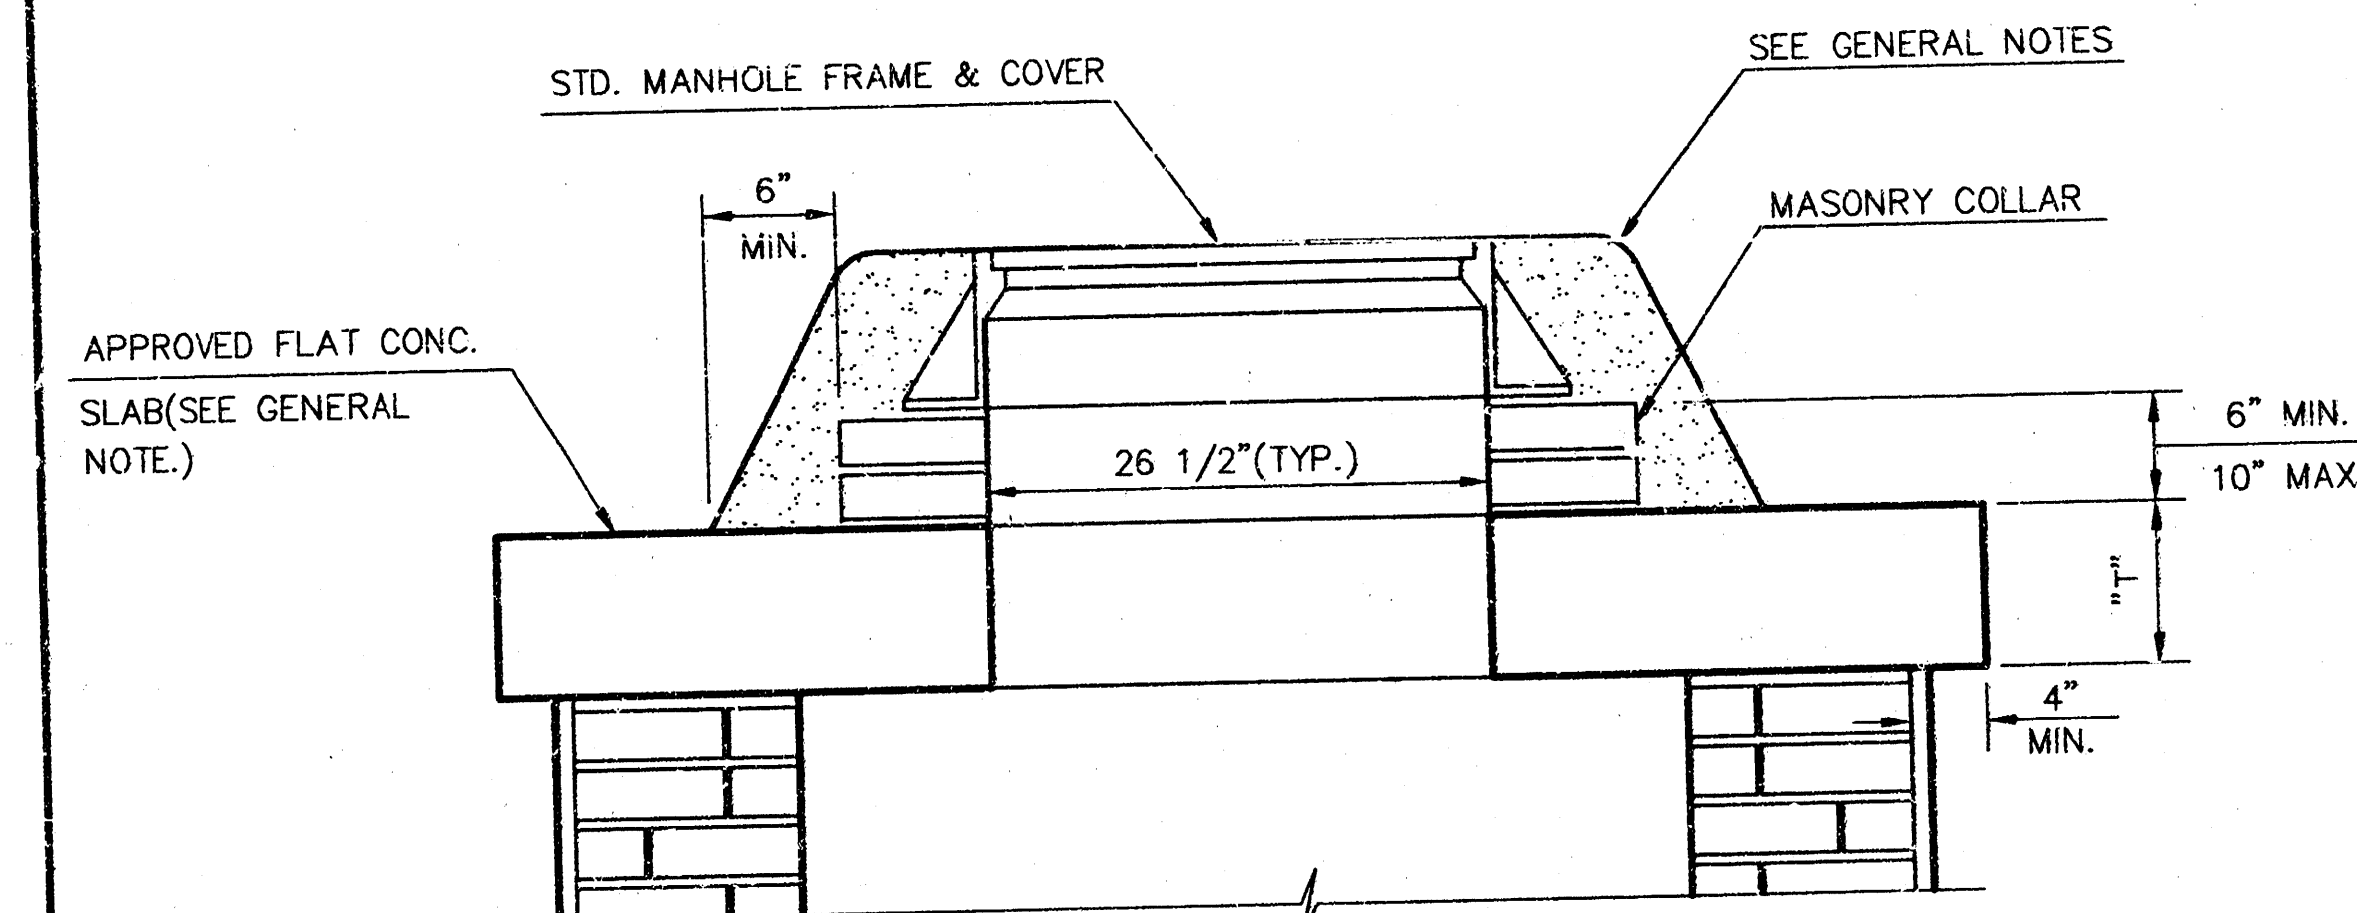


SHALLOW TYPE "B" MANHOLE


MASONRY COLLAR DETAIL

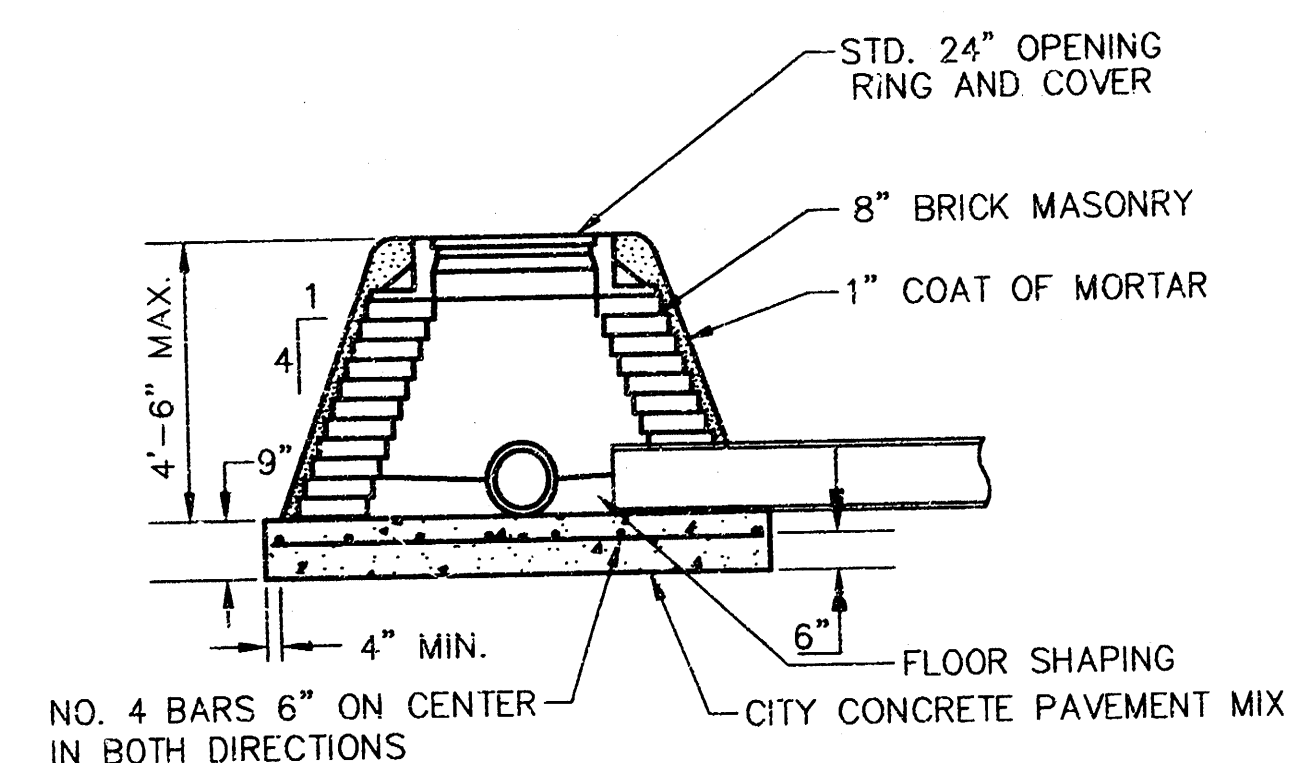


SPECIAL SHALLOW TYPE "A" MANHOLE

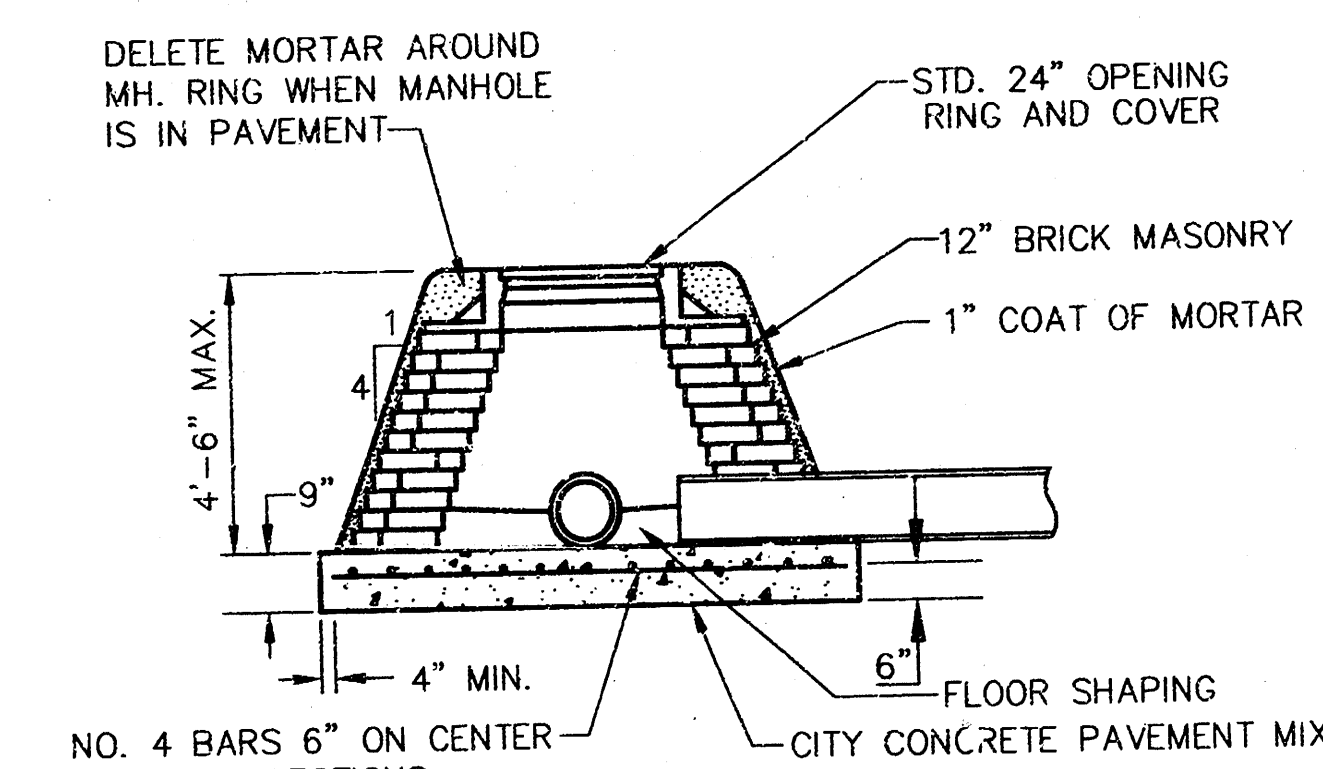

SPECIAL SHALLOW TYPE "B" MANHOLE

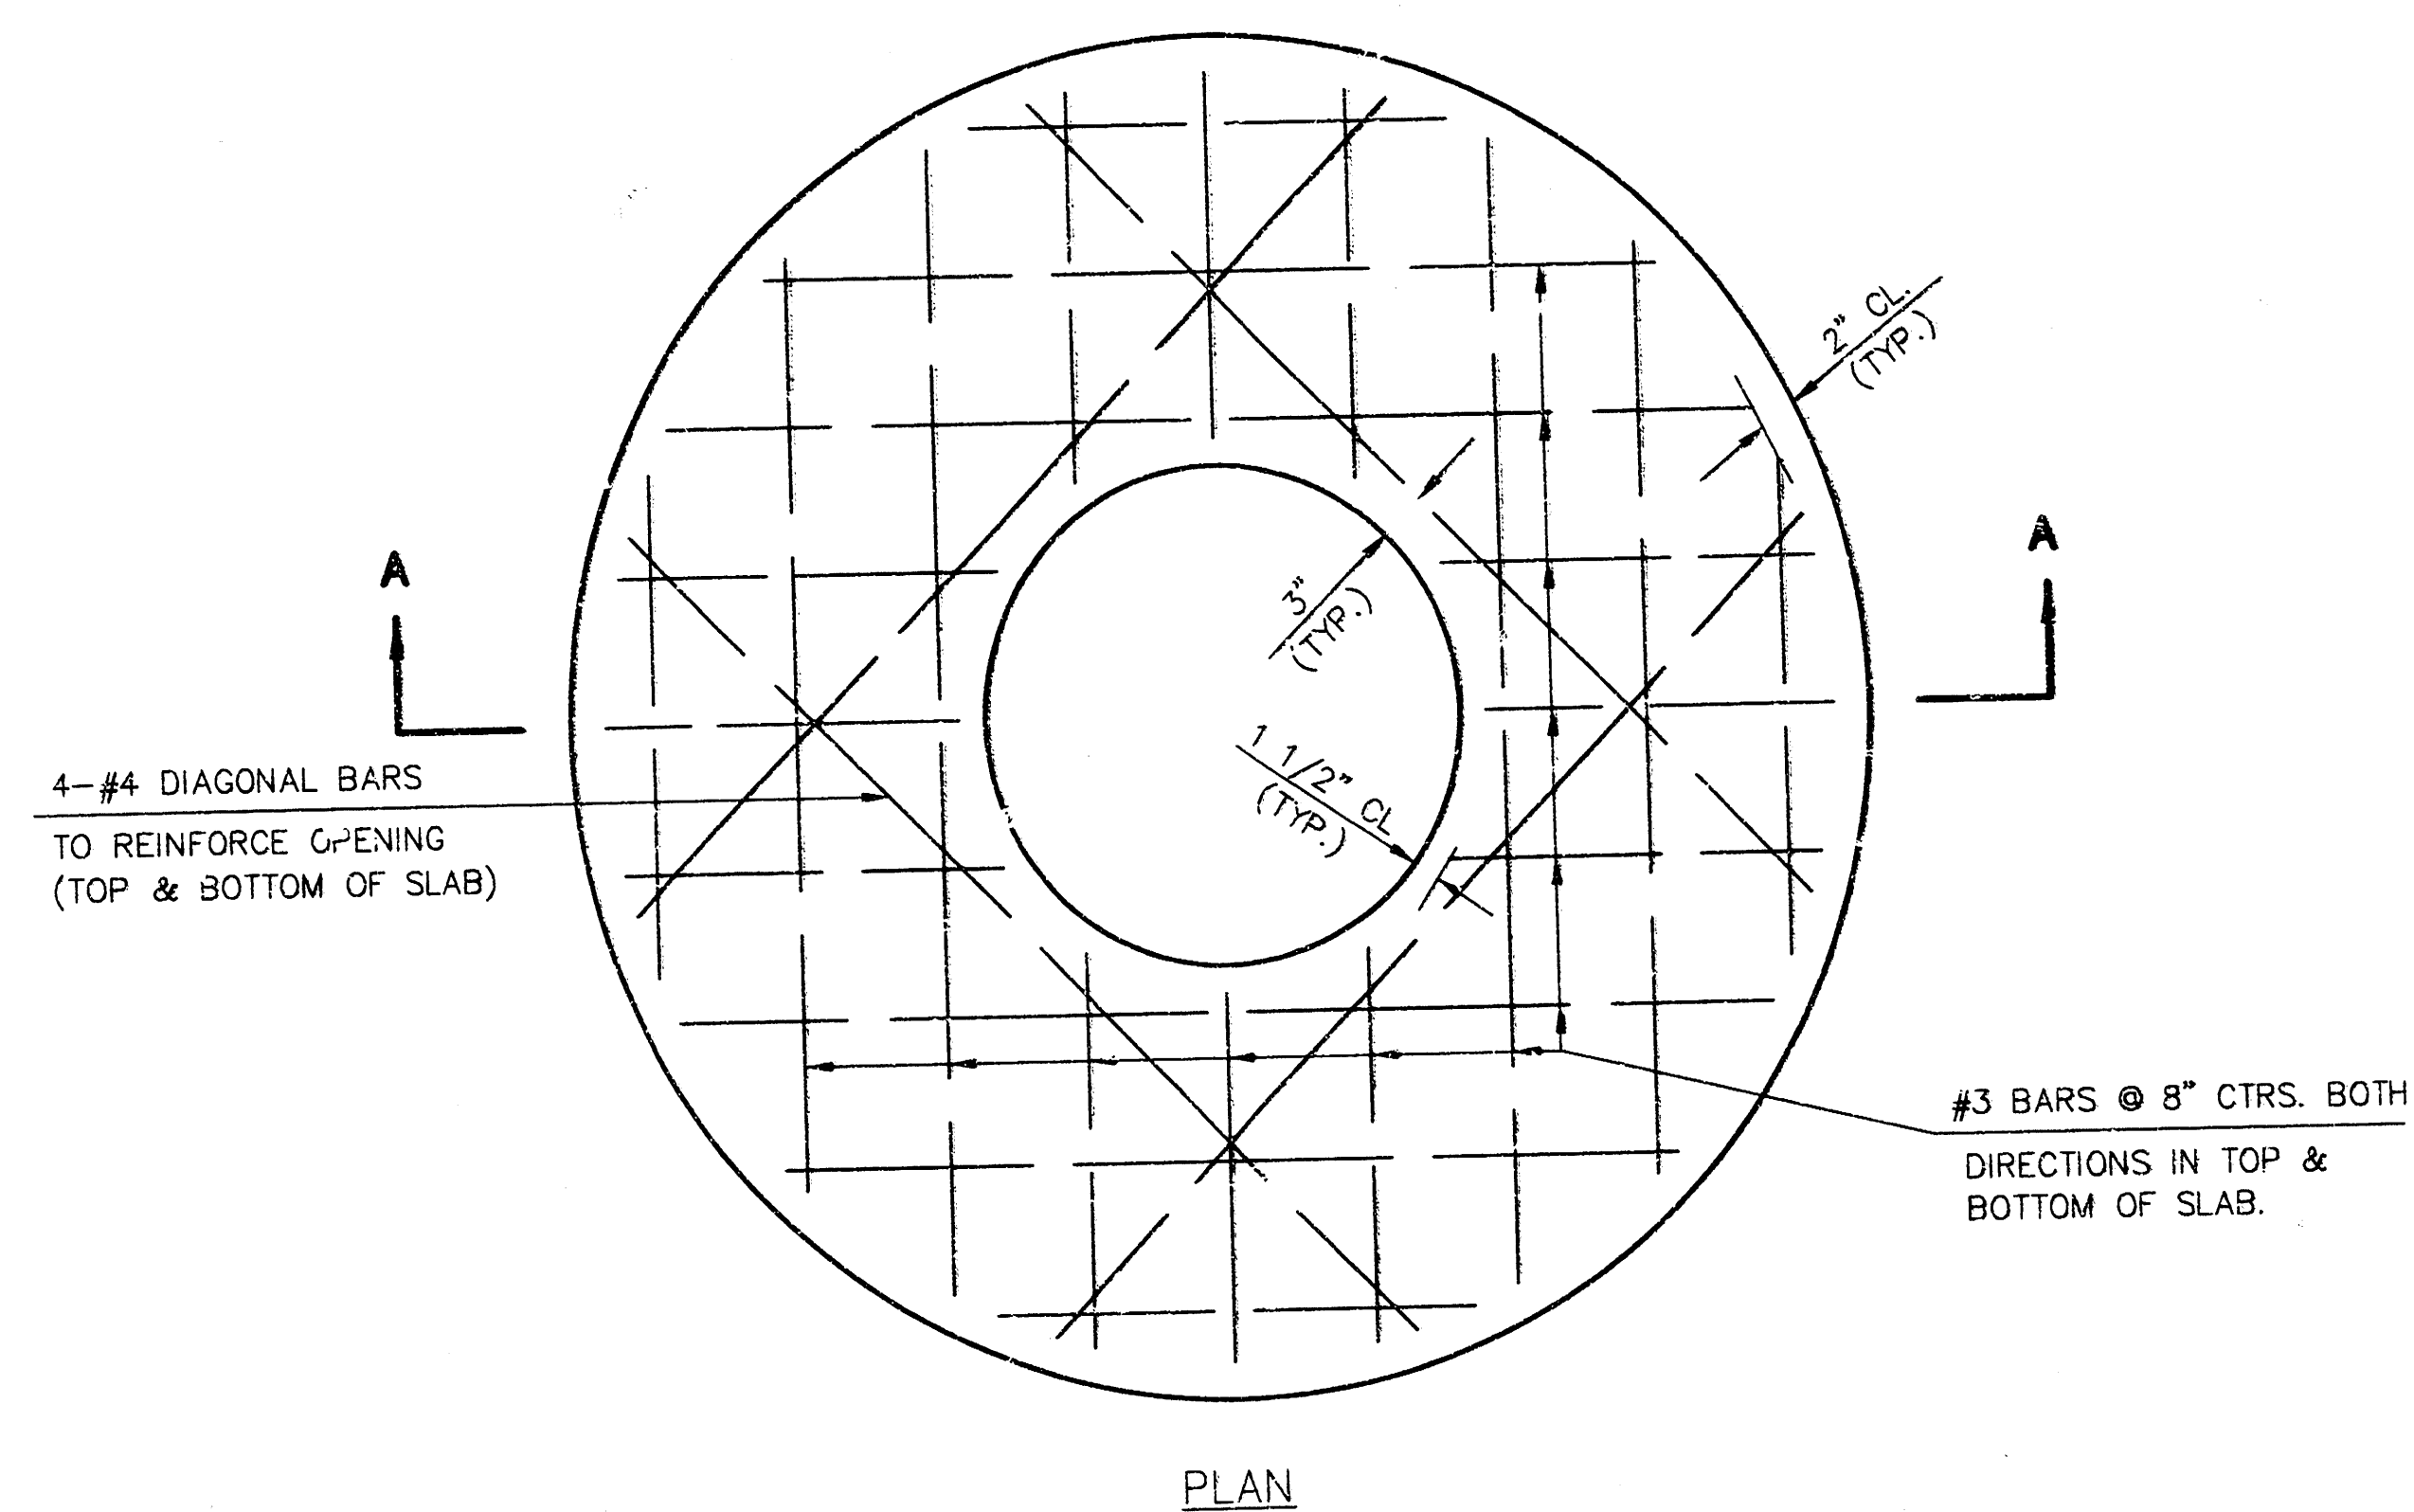

PLAN

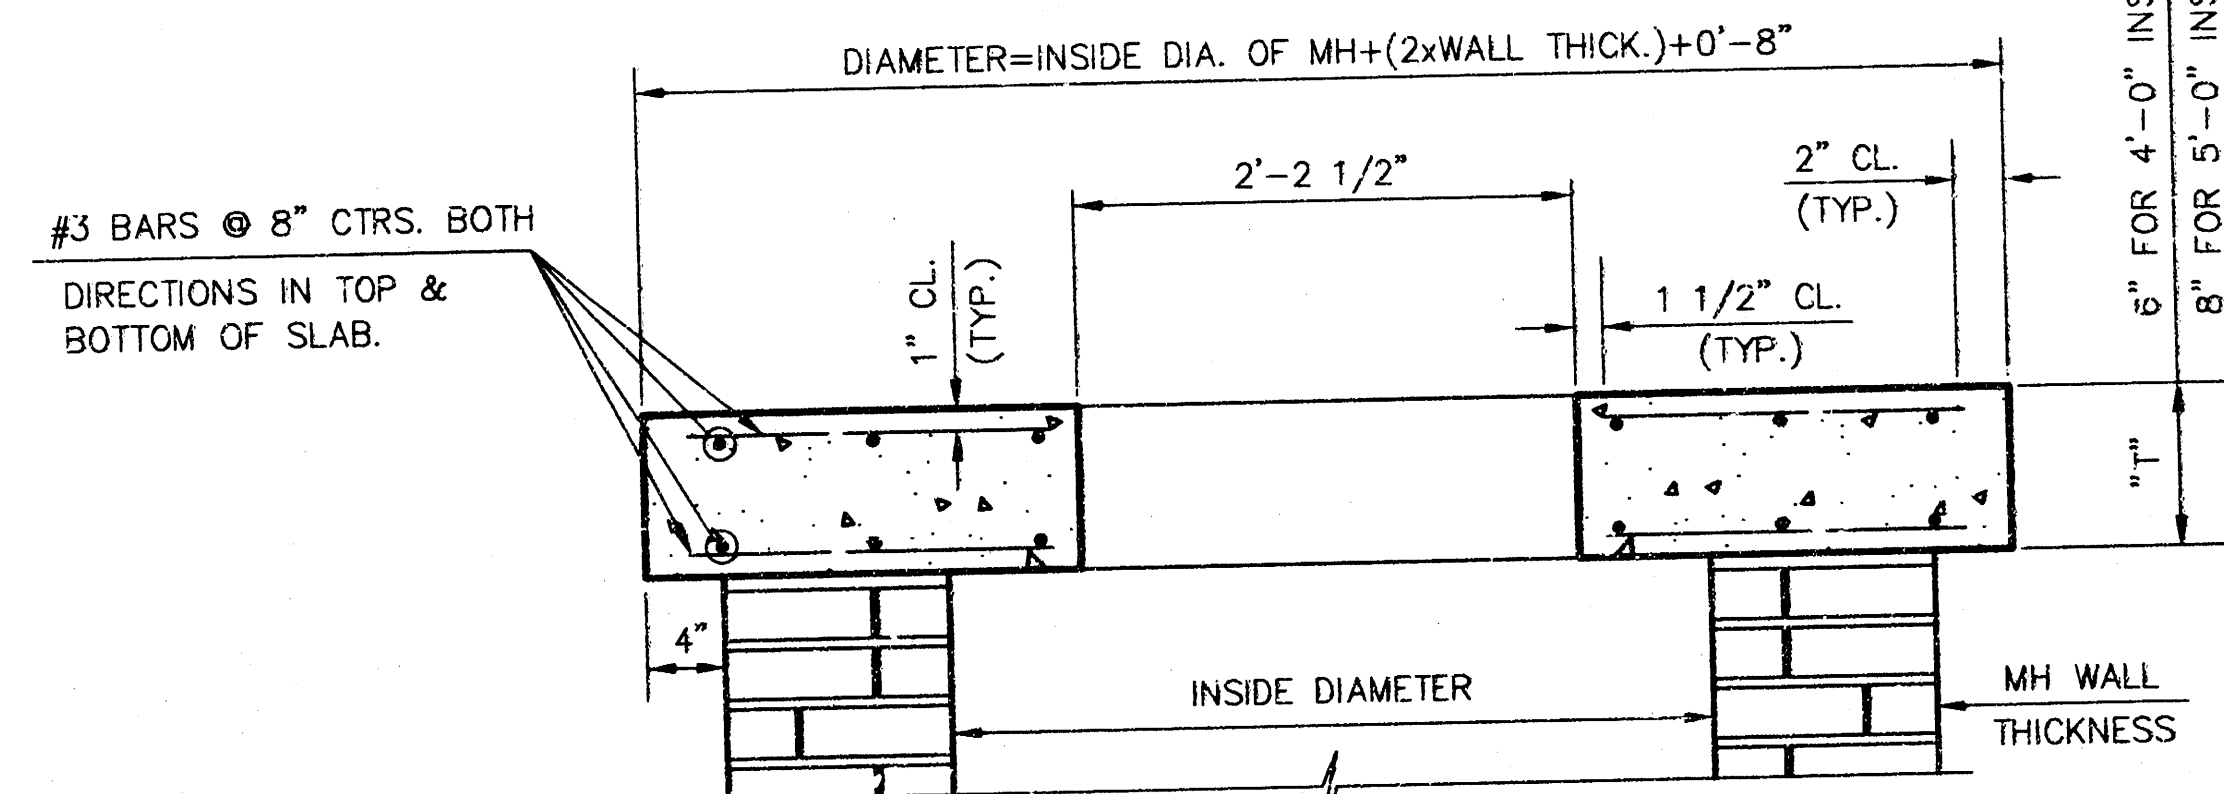

SECTION A-A

FLAT CONCRETE SLAB DETAILS

GENERAL NOTES

1. MORTAR USED IN MASONRY CONSTRUCTION SHALL CONTAIN 8 SACKS OF CEMENT PER CUBIC YARD. CONCRETE USED IN MANHOLE BASES SHALL CONFORM TO THE REQUIREMENTS OF CONCRETE FOR CONCRETE PAVEMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS USING CITY CONCRETE CEMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACED AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. TYPE "A" SHALLOW MANHOLES CAN BE USED ON SEWERS WHEN THE MANHOLE IS NOT LOCATED WITHIN PUBLIC STREET PAVEMENT. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE SMALLER THAN 24" SHALL HAVE AN INSIDE DIAMETER OF 4'. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE 24" OR LARGER SHALL HAVE AN INSIDE DIAMETER OF 5'. COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.
2. REINFORCING STEEL SHALL BE INSTALLED IN THE MANHOLE BASES AND SHALL CONSIST OF NO. 4 BARS PLACED ON 6" CENTERS IN BOTH DIRECTIONS. THE MANHOLE BASE REINFORCEMENT SHALL BE PLACED 6" ABOVE THE BOTTOM OF THE MANHOLE BASE. ALL COSTS FOR FURNISHING AND INSTALLING REINFORCING STEEL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
3. THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF-CLEANING AND FREE OF AREAS WHERE SOLIDS COULD BE DEPOSITED AS SEWAGE FLOWS THROUGH THE MANHOLE FROM ALL INLET PIPES TO THE OUTLET PIPE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE AS SHOWN BY THE DRAWINGS. MANHOLE FLOORS SHALL HAVE SLOPES OF 3 INCHES PER FOOT IN THE AREAS OUTSIDE OF THE FLOW CHANNELS SLOPED TOWARD THE FLOW CHANNELS. PIPES LAID THROUGH MANHOLES SHALL HAVE THE TOP HALF REMOVED TO NEAT LINES FOR THE FULL INSIDE DIAMETER OF THE MANHOLE. MANHOLE FLOORS SHALL THEN BE SHAPED AROUND THE BOTTOM HALF OF THE PIPE WHICH FORMS THE FLOW CHANNEL.
4. PIPES INSTALLED WITHIN THE EXCAVATION MADE FOR THE MANHOLE SHALL BE CRADLED WITH CONCRETE TO THE LIMITS OF THE MANHOLE EXCAVATION. WHEN CLAY PIPE IS USED, THE CRADLE SHALL EXTEND TO THE FIRST JOINT OUTSIDE THE MANHOLE. THE CRADLE SHALL BE TERMINATED AT THE CLAY PIPE JOINT IN A MANNER WHICH WILL MAINTAIN THE FLEXIBILITY OF THE JOINT. COST OF CRADLE WITHIN MANHOLE EXCAVATION OR TO CLAY PIPE JOINTS ADJACENT TO MANHOLE SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
5. MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWINGS.
6. THE CROWNS OF INFLOWING PIPES SHALL NEVER BE SET LOWER THAN THE CROWN OF THE OUTFLOWING PIPE.
7. STANDARD SHALLOW MANHOLES TYPE "A" AND "B" SHALL BE PAID FOR AT THE UNIT PRICE BID PER EACH FOR THE TYPE AND DIAMETER INDICATED. STANDARD SPECIAL SHALLOW MANHOLES TYPE "A" AND "B" SHALL BE PAID FOR AT THE UNIT PRICE BID PER EACH FOR THE TYPE INDICATED. ALL STANDARD SHALLOW MANHOLE DIAMETERS WILL BE 4' UNLESS INDICATED OTHERWISE.

STANDARD SHALLOW MANHOLES TYPE "A" AND TYPE "B"

CITY OF WICHITA, KANSAS

Design	C.O.W.	Checked by	Checked by	Sheet 9 of 10
Drawn by	Date	Date June 1998	Job No. 97084dd4	

je-03-01-03