



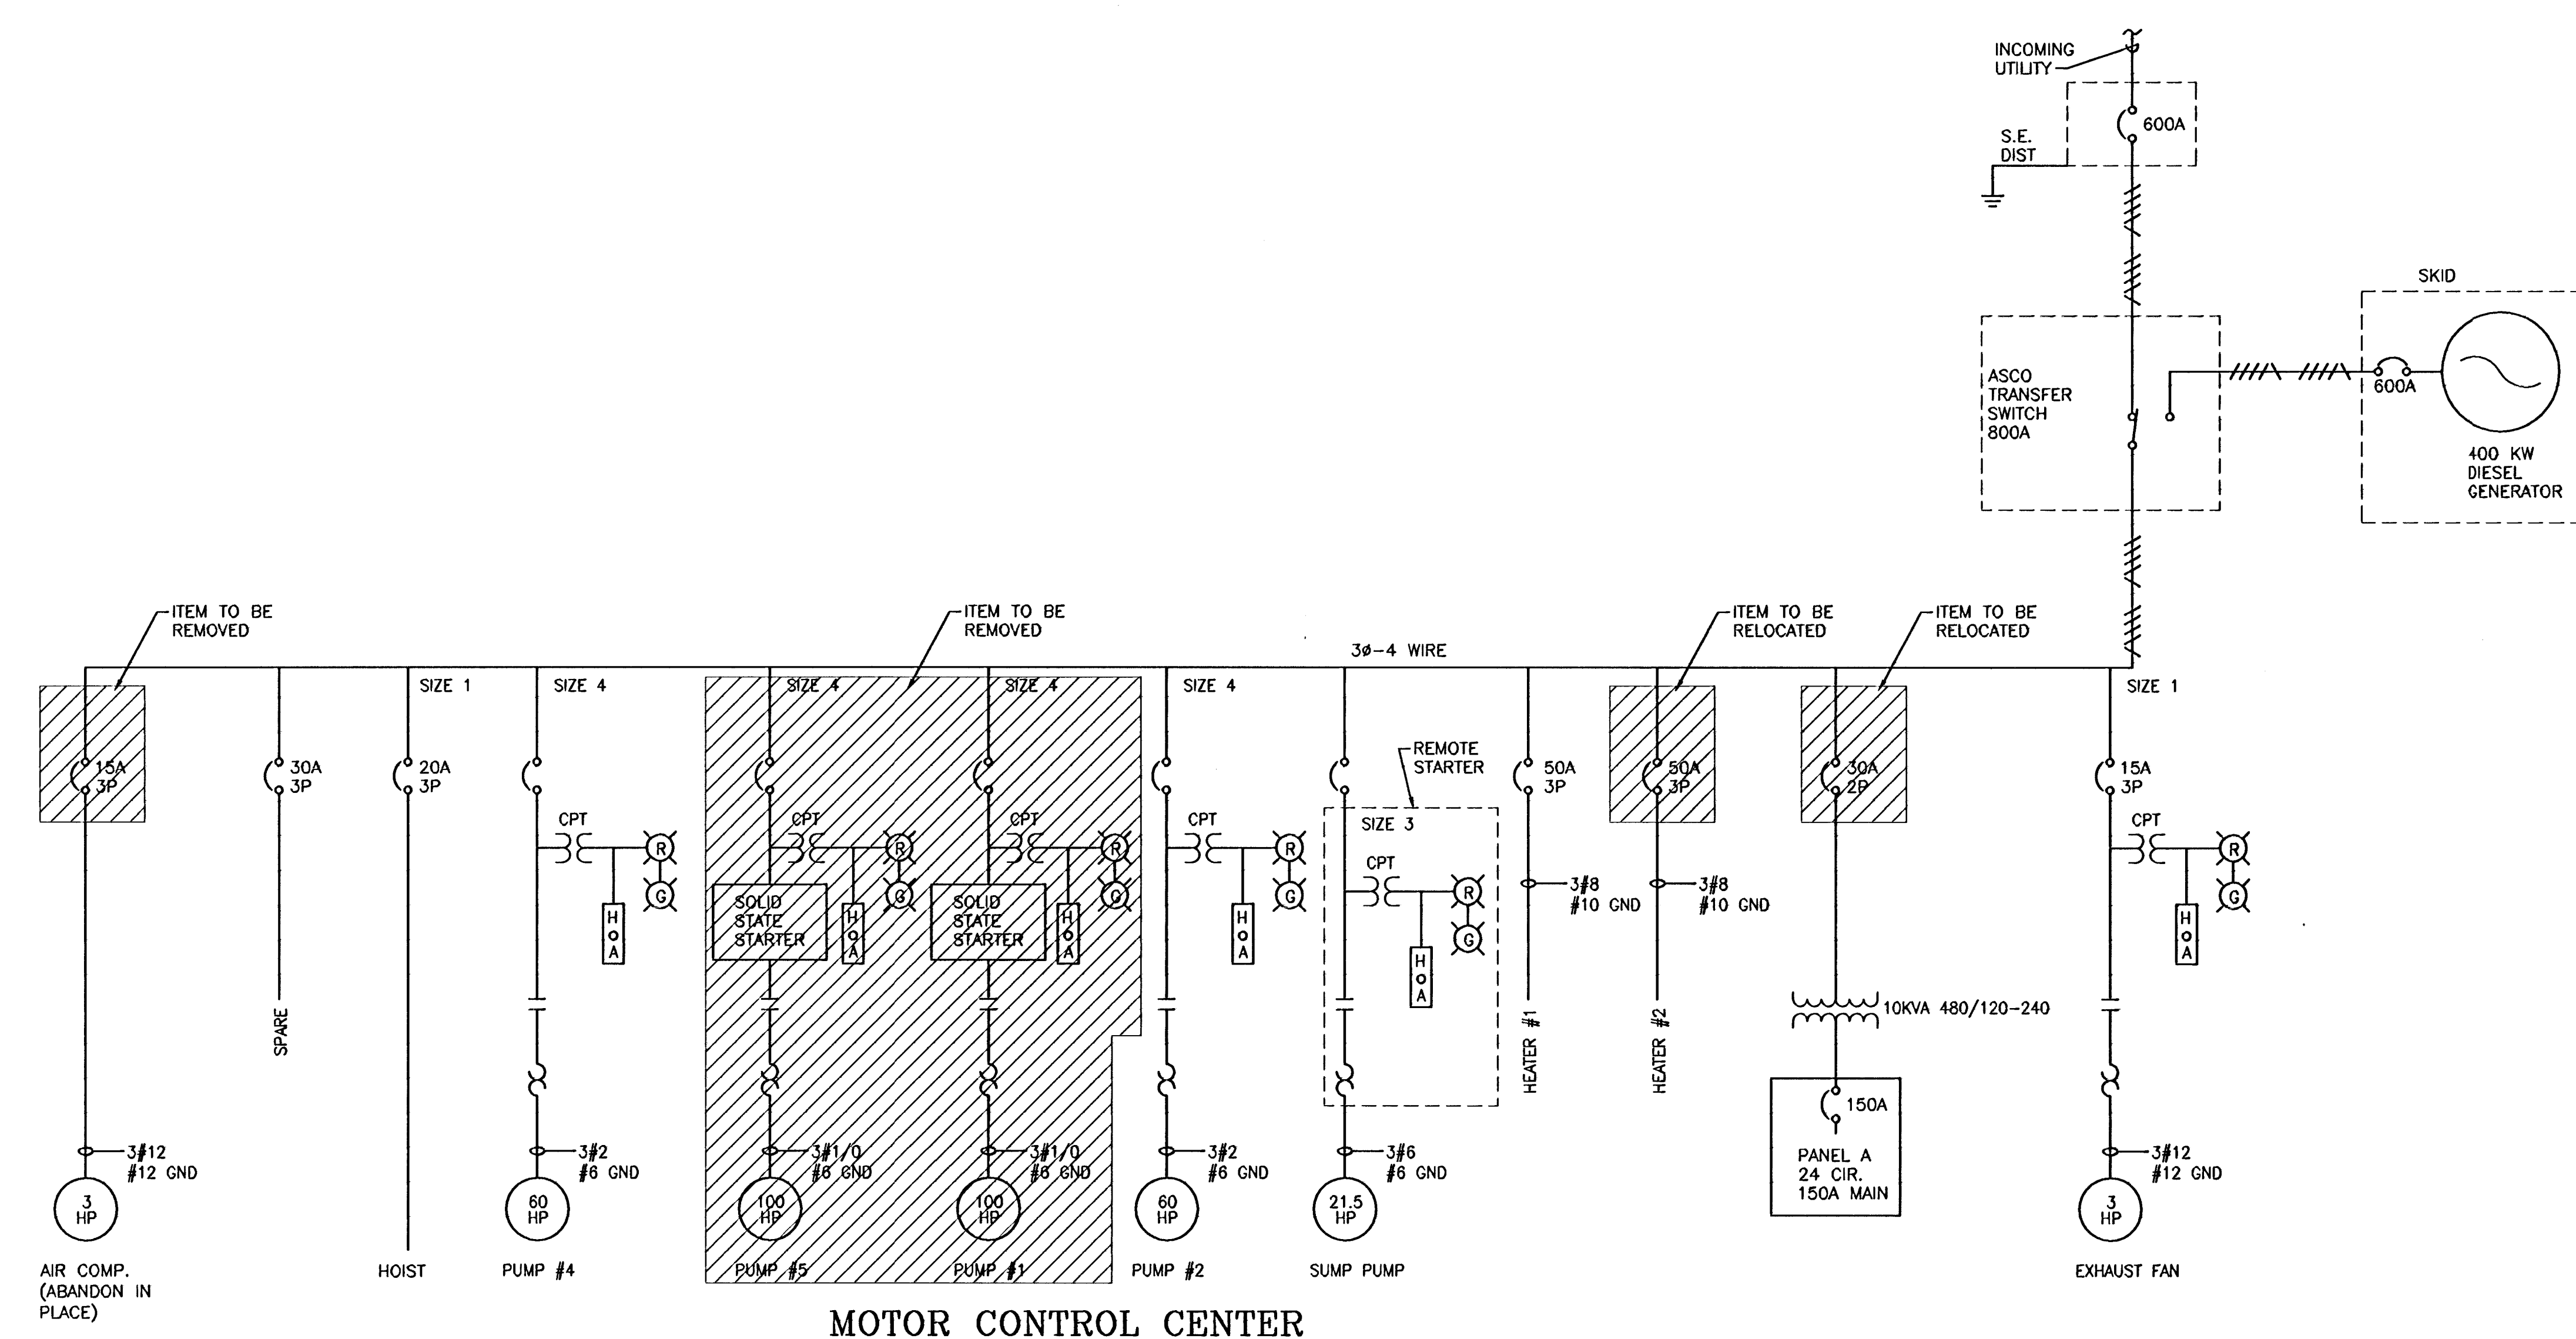


MOTOR CONTROL CENTER
SCALE: NONE

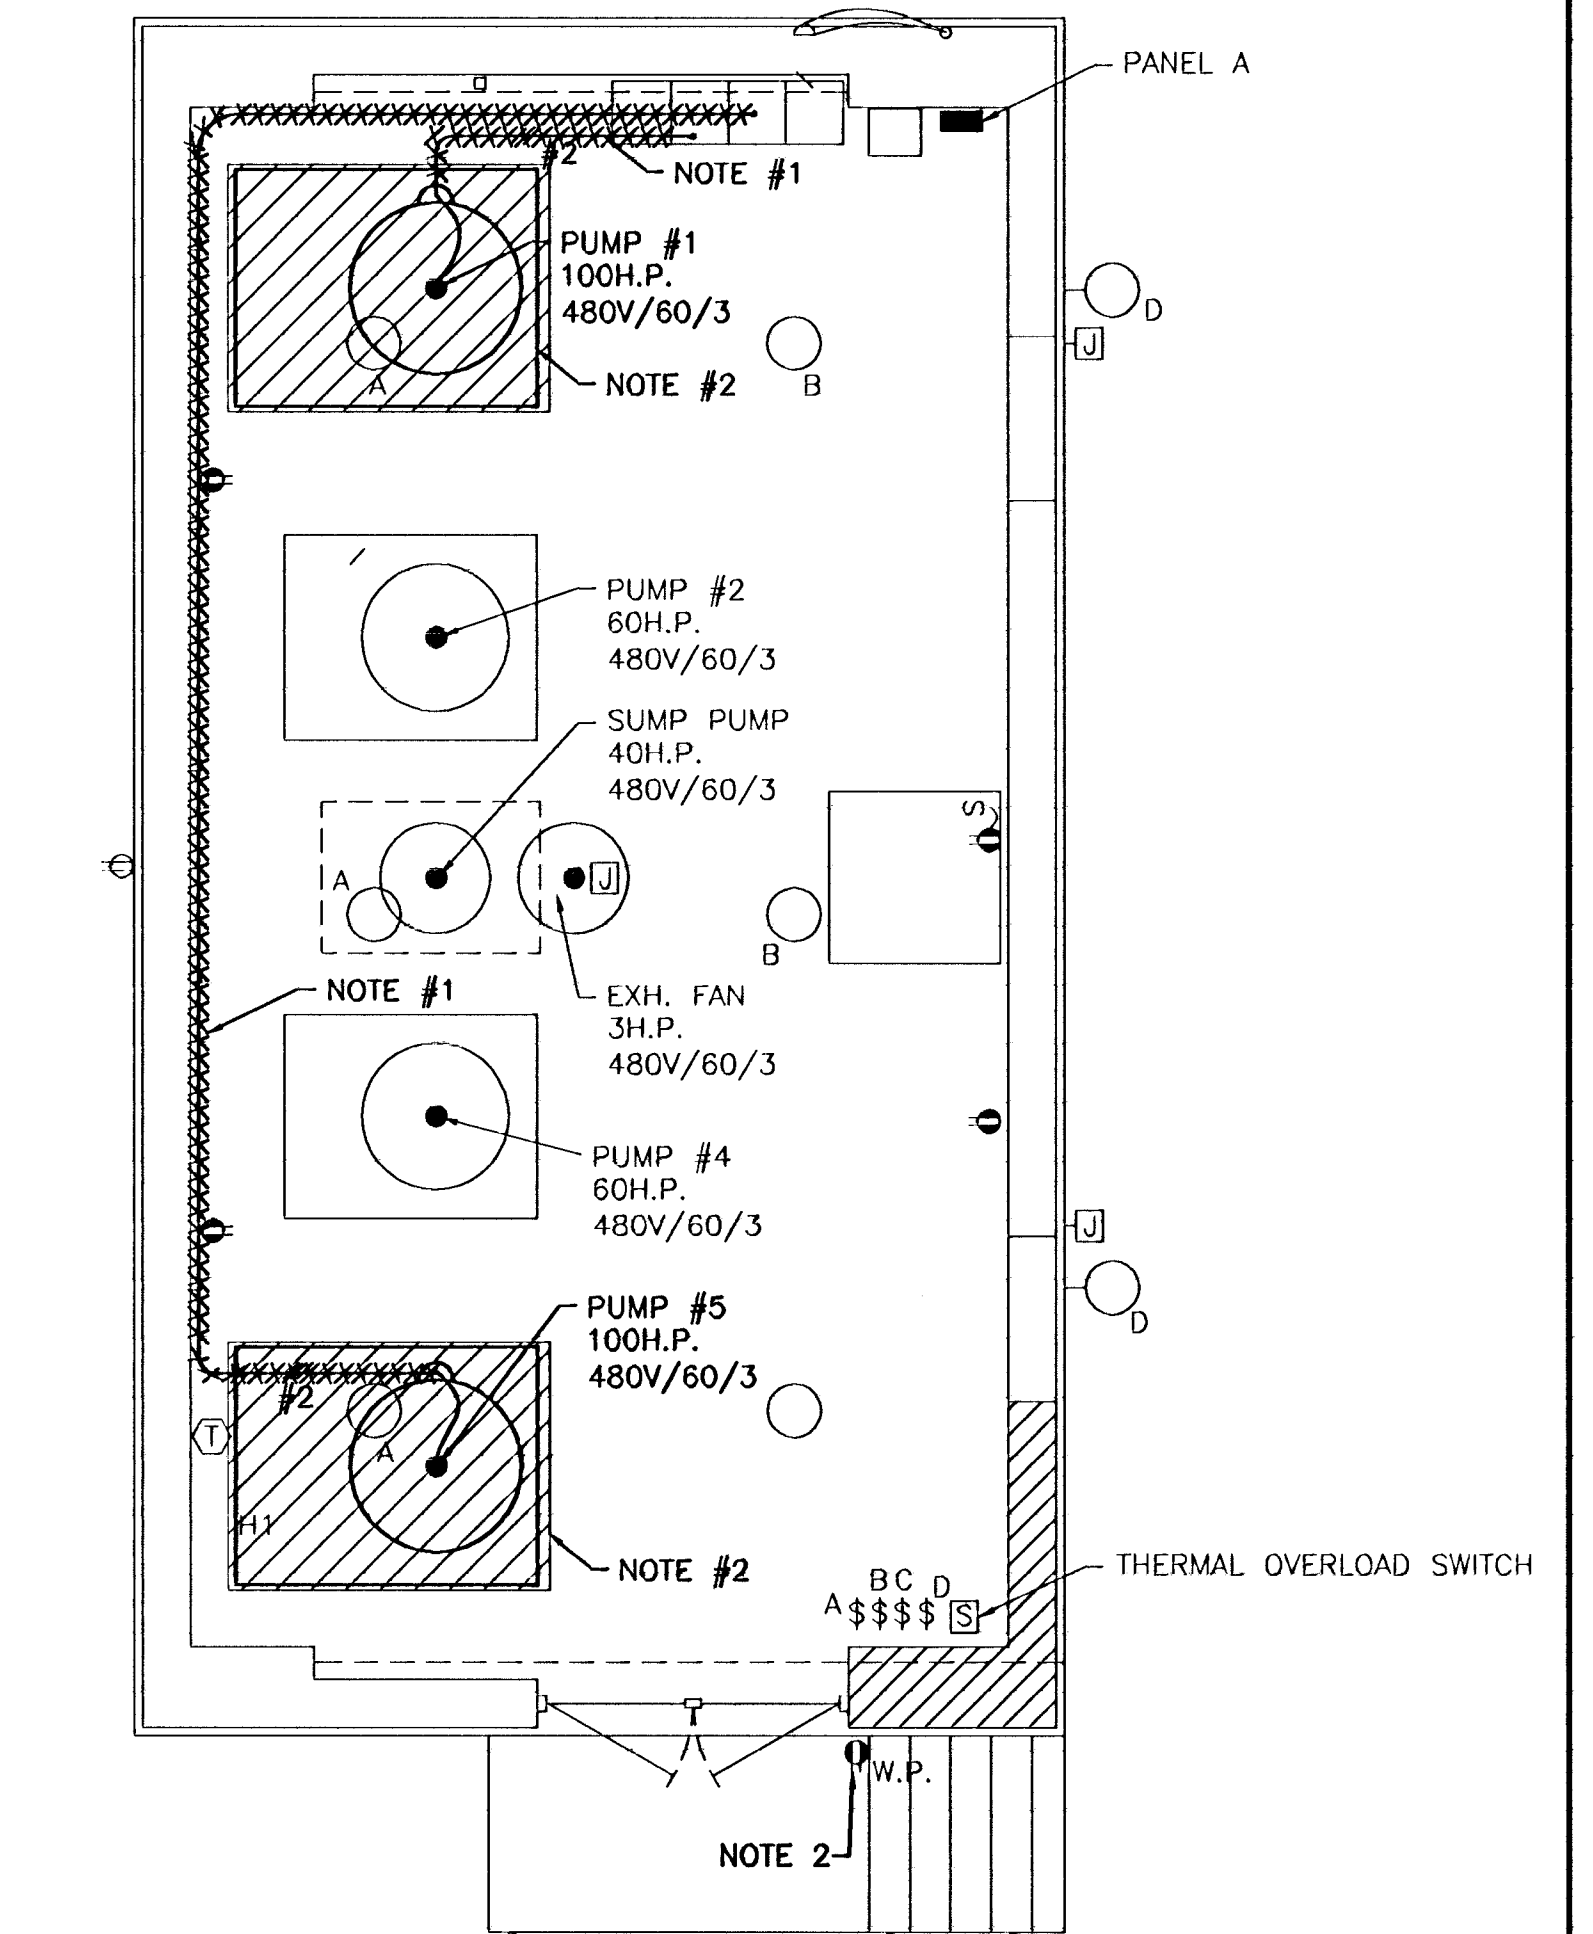

DEMO PLAN ABOVE GROUND
SCALE: 1/4" = 1'-0"

(A)	INCAND. LT.
(B)	INCAND. FLD. LT.
(C)	INCAND. LT.
\$	WALL SWITCH.
□	SPECIAL DEVICE (AS NOTED)
●	MOTOR
[J]	JUNCTION BOX
(T)	THERMOSTAT.
—	CONDUIT RUN W/2#12TW-1/2"C. MT. IN WALL OR CEILING
---	CONDUIT RUN (2) CIRCS. W/3#12TW-1/2"C. INSTALL IN SLAB.
W.P.	WEATHER PROOF
⊕	GROUND WELL - 3/4"-10FT COPPER GROUND ROD
⦿	DUPLEX GFCI 5MA-TRIP RECEPTACLE.

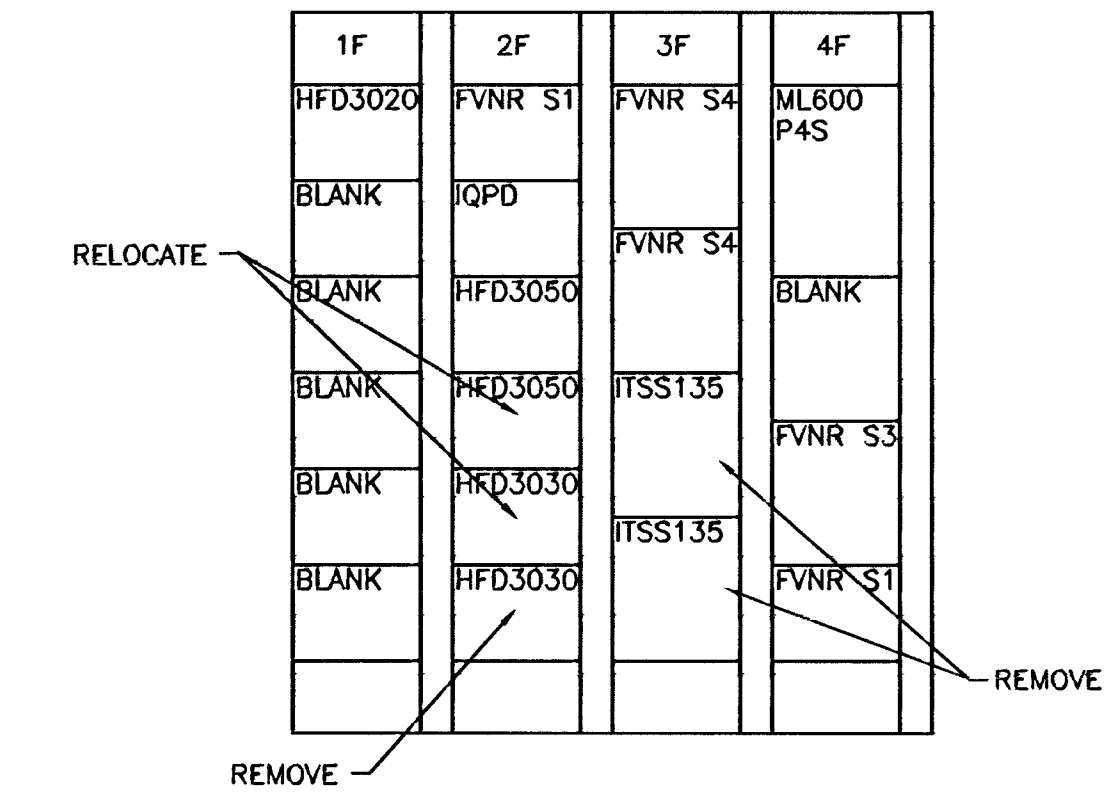

MCC ELEVATION
SCALE: NONE

- NOTES:
- CONTRACTOR SHALL REMOVE EXISTING WIRING ASSOCIATED WITH EXISTING SERVICE TO PUMPS 1 & 5.
 - REPLACE EXISTING PUMP MOTORS ON PUMP 1 & PUMP 5 WITH NEW 125 HP MOTORS.



MKEC
ENGINEERING CONSULTANTS
411 N. WEBB ROAD
WICHITA, KS. 67208
318-684-9600

CITY OF WICHITA, KANSAS
STORMWATER PUMP STATION NO. 1
REPLACE PUMP 1 & 5 MTRS & STARTERS

PROJECT NAME

ELECTRICAL (DEMOLITION)

SHEET TITLE

SLA	RES	SLA
DESIGN BY:	DRAWN BY:	CHECKED BY:
SEPTEMBER, 2002	02141	D1 / 1
DATE	DRAWING NAME	SHEET / OF