

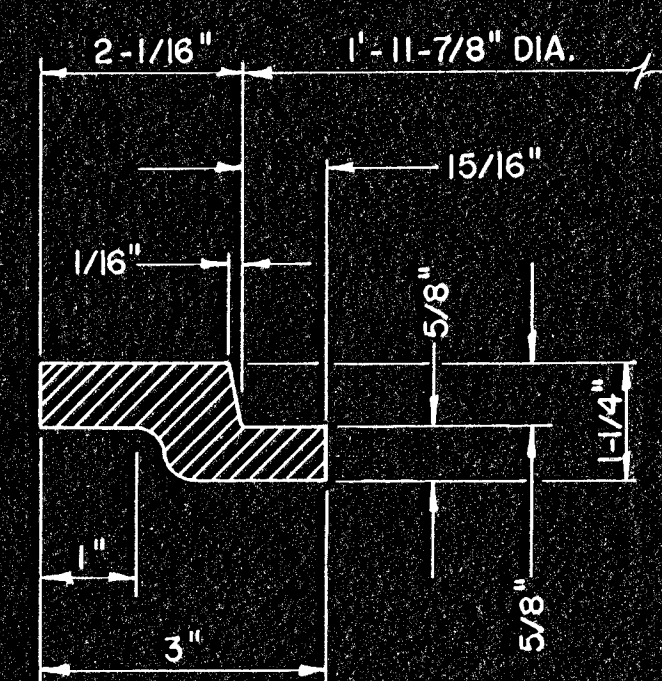
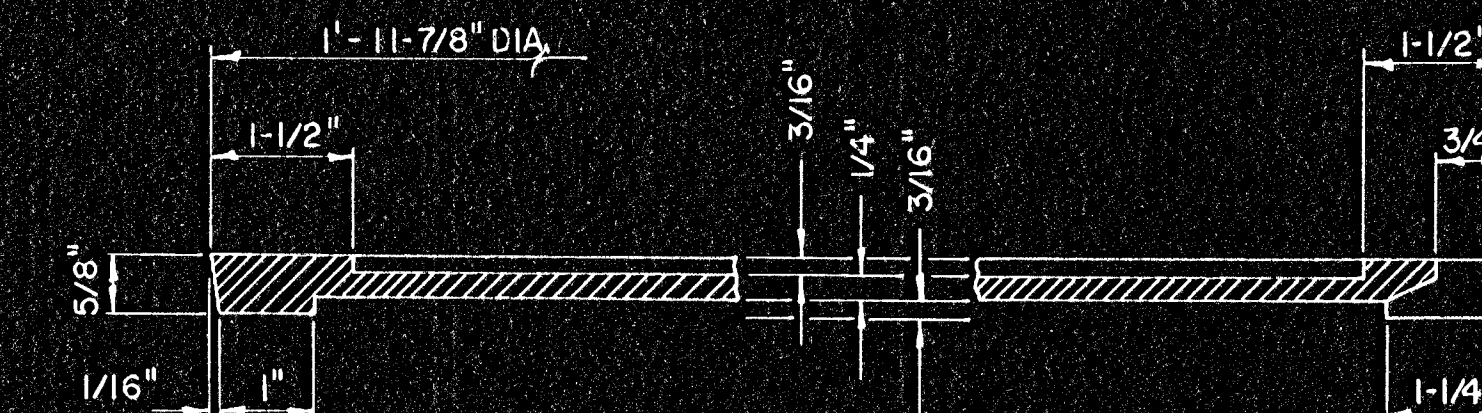


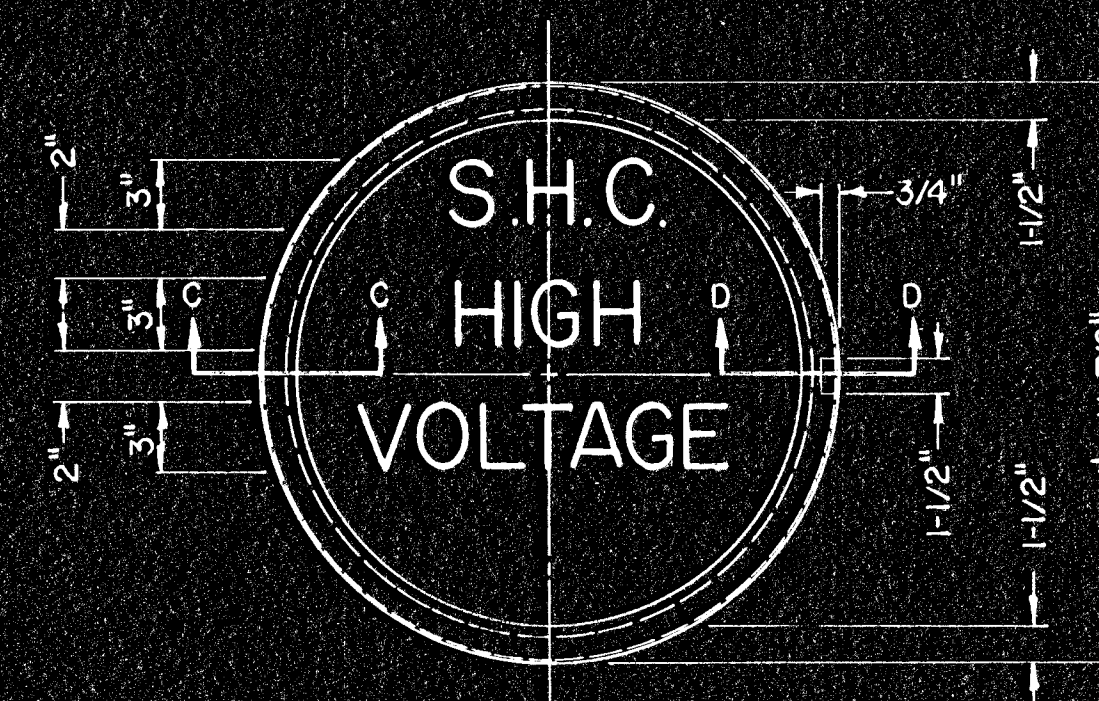

SECTION B-B
— RING —

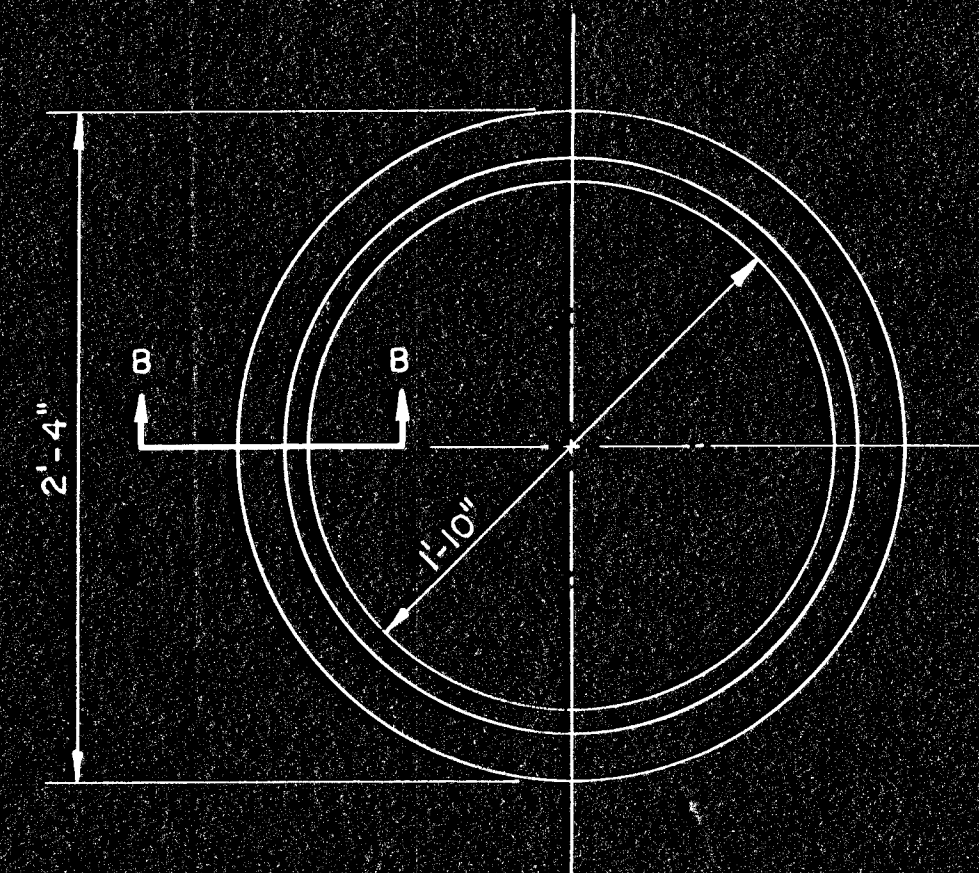


SECTION C-C
— COVER —

RING, SEE SECTION B-B

8 REINFORCING WIRE 3" C TO C
(AASHOM 170 CLASS III)

3" DIAMETER HOLES
POSITIONED AS REQUIRED

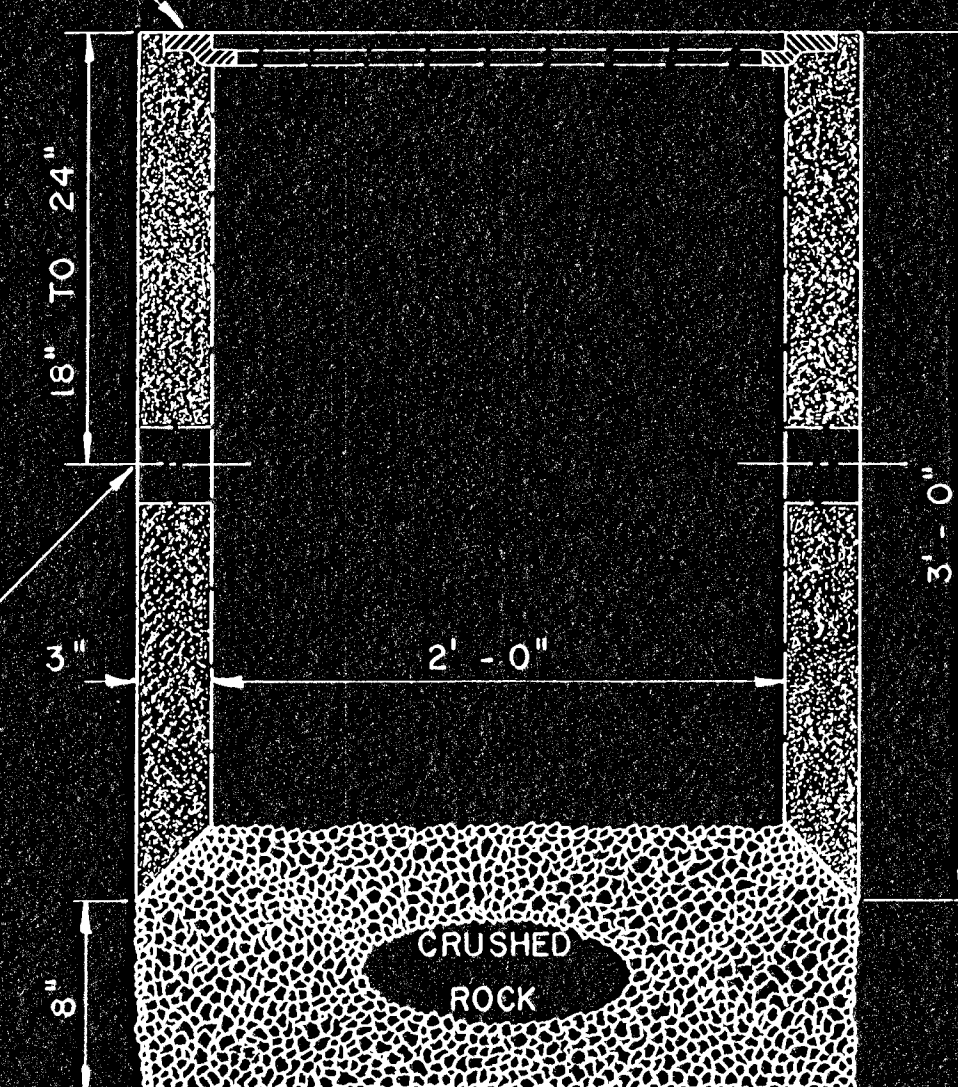

— PRE-CAST SERVICE BOX —

NOTE: THE PRE-CAST SERVICE BOXES AND ALL EXCAVATION, BACKFILLING AND INCIDENTALS NECESSARY TO COMPLETE THE WORK SHALL BE ON A PER EACH BASIS.

3 1/2" ELECTRIC CONDUIT (NON-METALLIC)					
KELLOGG ST.					
From Sta.	Distance Lt. or Rt.	To Sta.	Distance Lt. or Rt.	L.F.	Remark
26+00	3' Rt.	29+00	3' Rt.	300'	
29+00	3' Rt.	32+00	3' Rt.	300'	
32+00	3' Rt.	32+00	72' Lt.	75'	
71+00	3' Rt.	71+00	64' Rt.	61'	
71+00	3' Rt.	73+00	3' Rt.	200'	
65+00	Q	—	—	160'	Normal to Q
Total				1096	
2" ELECTRIC CONDUIT (NON-METALLIC)					
GROVE ST.					
45+32	60' Rt.	45+99	47' Rt.	67'	
53+11	48' Rt.	53+65	51' Rt.	54'	
Total				121'	

SERVICE BOX SUMMARY	
STATION	DISTANCE & SIDE
29+00	3' Rt.
71+00	3' Rt.

3					
2					
1					
NO.	DATE	REVISIONS	BY	APP'D	
STATE HIGHWAY COMMISSION OF KANSAS					
PRE-CAST SERVICE BOX DETAIL					
SHEET NO.	OF	SCALE	APP'D	QUANTITIES	TRACED
DESIGNED		1/16"			
DESIGN CK		1/16"		QUAN. CK.	TRACE CK.