

CONSTRUCTION PLANS
SANITARY SEWER EXTENSIONS
PAWNEE MESA ADDITION
TO


LATERAL 11, MAIN 13, SWI

INDEX CODE 742130

1. Existing utility lines and their location, as shown on the plans, represent the best information obtainable for design. The Contractor will be required to work around existing utilities in the right-of-way which do not conflict with proposed construction.
2. Rubble from the removal of miscellaneous structures and excess excavator which is to be wasted shall be disposed of on sites to be provided by the Contractor. These sites shall be approved by the Engineer as to suitability, appearance and site location. Locations that, in the opinion of the Engineer, will leave an unsightly appearance will not be approved.

All disposal sites must be approved by the Kansas Department of Health and Environment. Material either stockpiled or disposed of in a flood plain would require a Kansas State Board of Agriculture permit. Any material dumped in waters of the United States or wetlands is subject to U.S. Corps of Engineers permitting regulations. Any material buried or stockpiled beyond approved construction limits would require additional archeological investigations unless buried in a previously approved borrow location.

3. The Contractor shall be responsible for maintaining continuous flow of sewage through construction. Contractor's proposed method for maintaining sewage flow shall be approved by the Engineer. Cost of maintaining flow of sewage through construction will not be paid for directly and this cost shall be considered as subsidiary to the other pay items of the work.
4. The Contractor shall be responsible for preserving property irons. The Contractor will be required to re-establish any property irons which are damaged or destroyed by his construction operations. Such irons shall be re-established by a licensed land surveyor or a licensed professional engineer in accordance with state laws.
5. Trees and shrubs in public right-of-way which are in direct conflict with proposed new construction shall be removed by the Contractor with the Engineer's approval. Trees and shrubs which are not in direct conflict with the proposed new construction shall be saved and protected from damage.
6. Contractor shall vacuum test all manholes according to the City of Wichita standard specifications.
7. The Contractor shall grade the entire easement width along the line to match the finish grade elevations shown on the sewer line profile.
8. All disturbed areas shall have temporary grass seeding applied at a rate of 250 lbs./acre.




PLANS PREPARED
BY

Consulting Engineers
434 N. Oliver Suite 110 Wichita KS 67208 316/685-4114


TITLE SHEET	SHEET 1
LINE NO. 1	SHEET 2
LINE NO. 1	SHEET 3
TYPE "E" MANHOLE	SHEET 4
TYPE "C" MANHOLE	SHEET 5
PAWNEE MESA ADDITION PLAT	SHEET 6




(City of Wichita Datum)

1. City of Wichita Disc, 34' S. of Cl. Pawnee & 6' W. of Hedge Row S.
Elev. 145.50
2. "□" Cut in center of E. Hdwl. of drainage structure under Cret near NW corner of Lot 55, Block 12 Pawnee Mesa Addition
Elev. 144.28



SHEET 1 OF 6

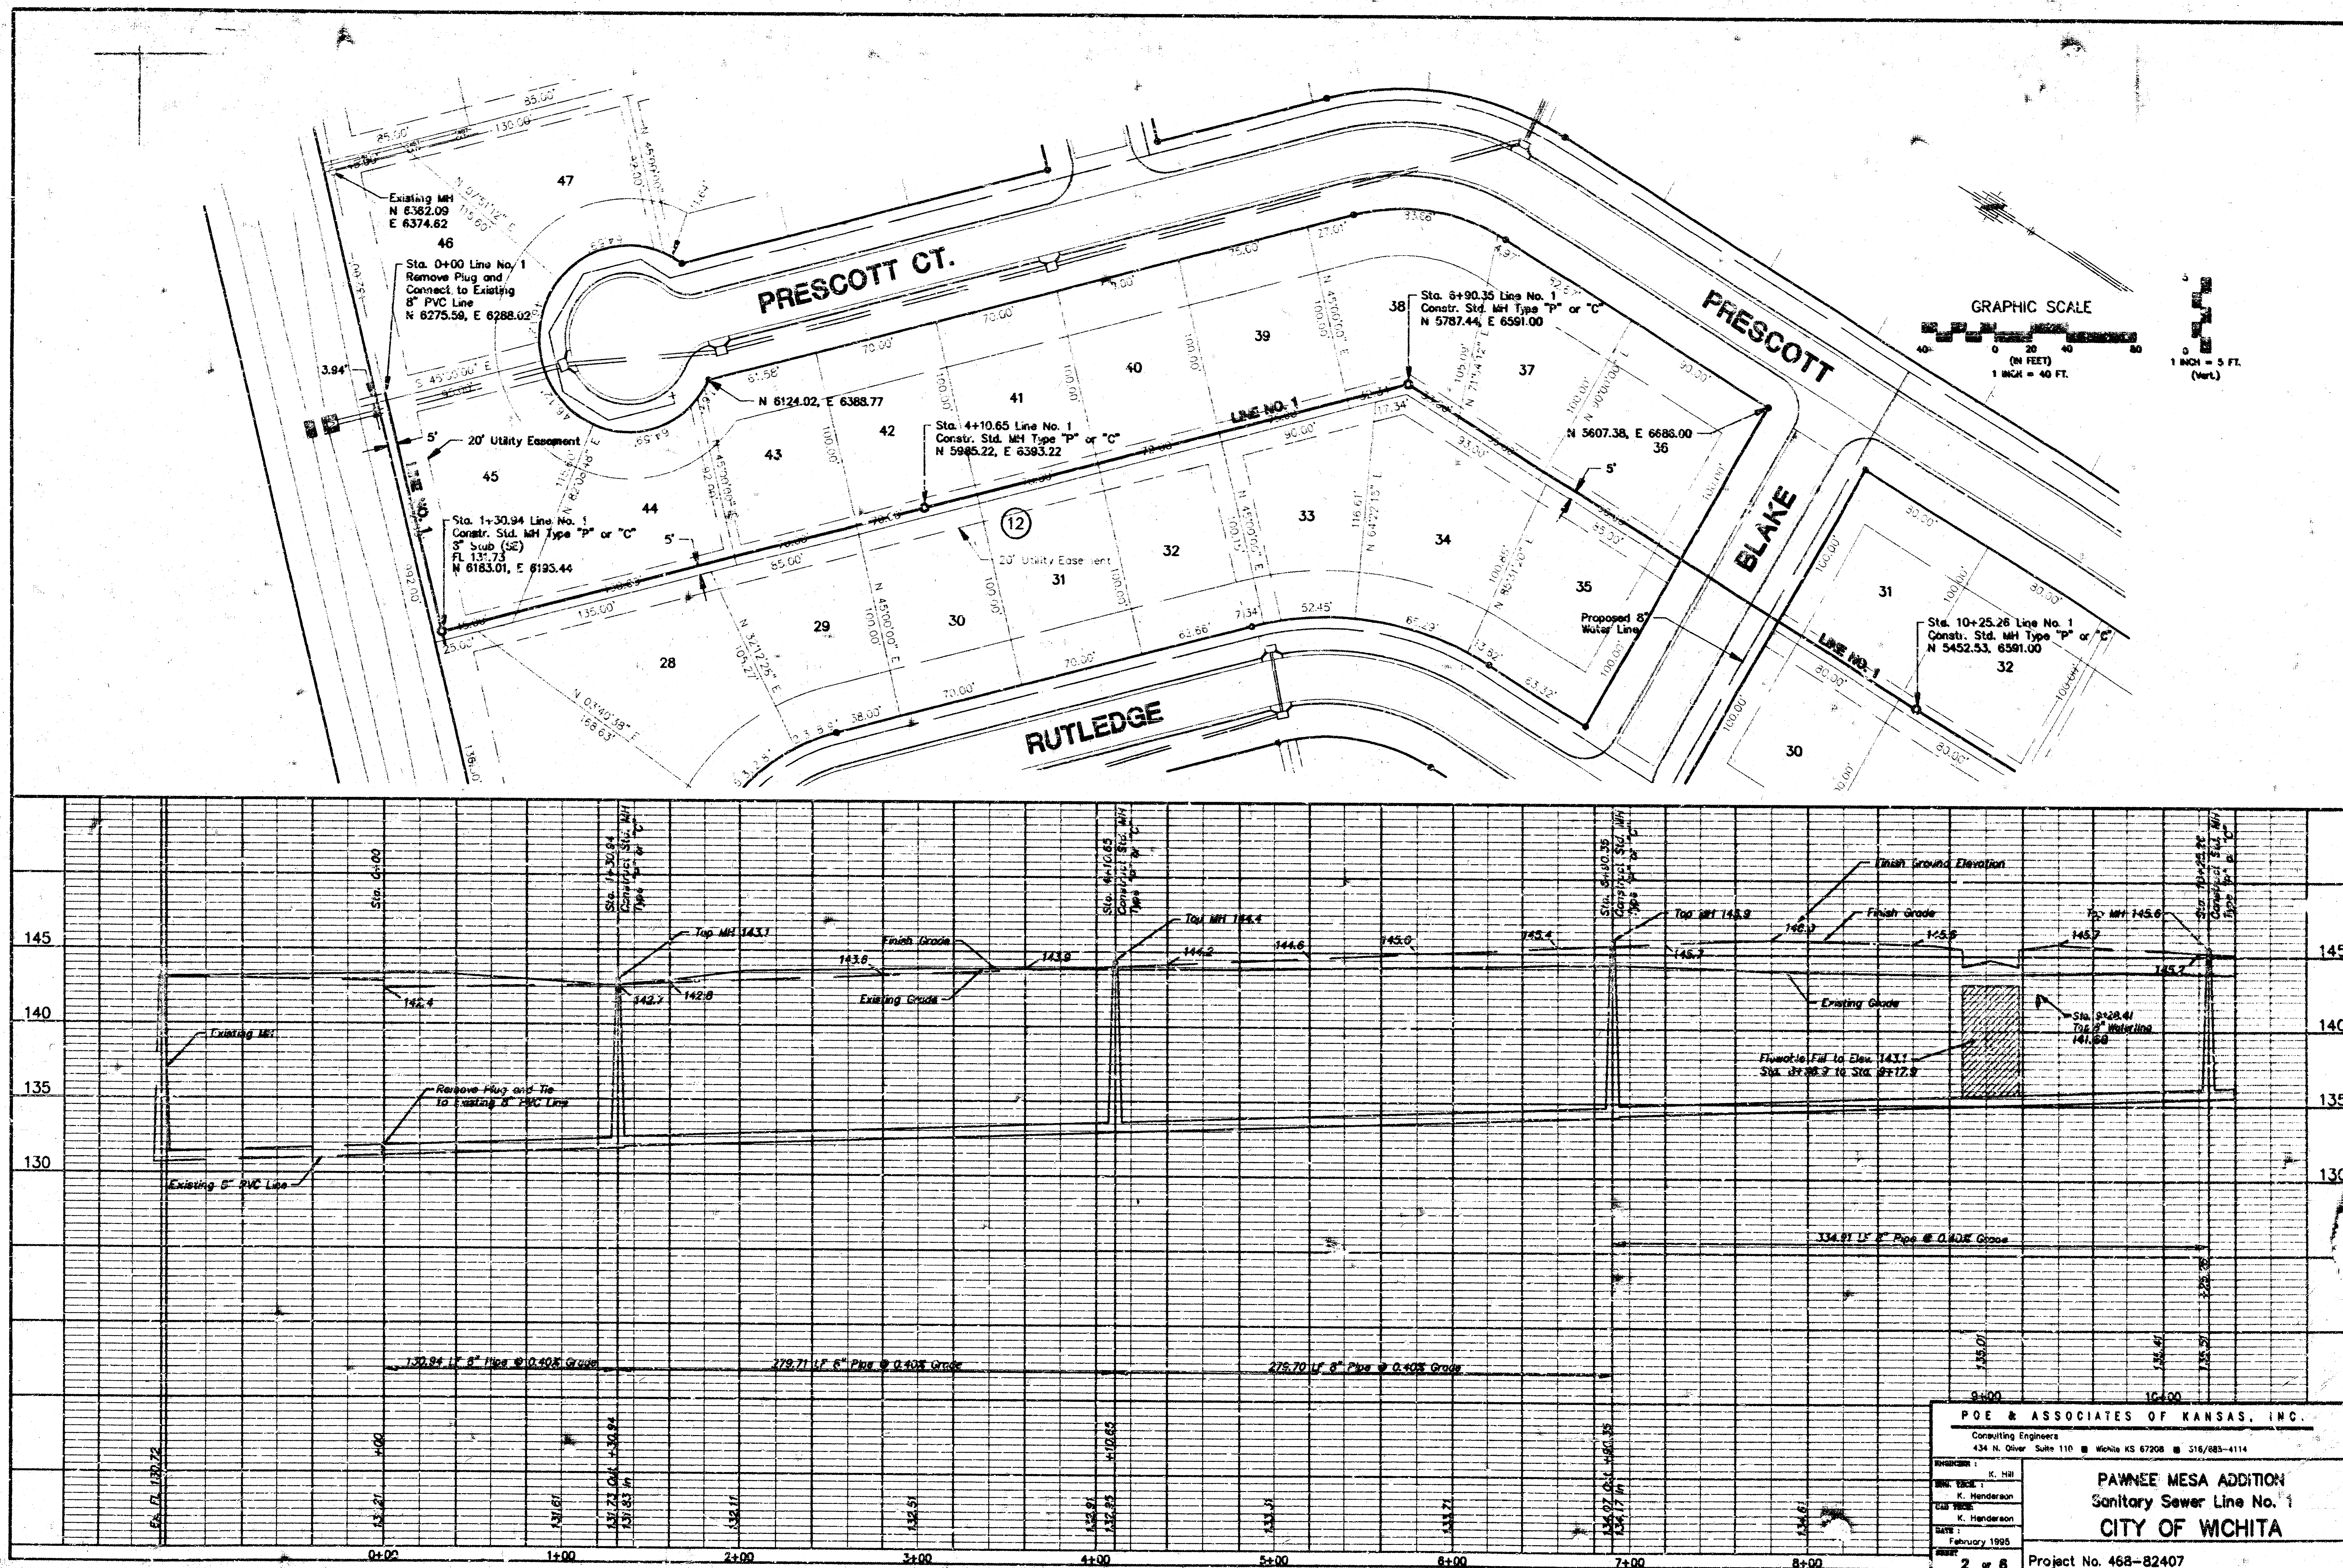

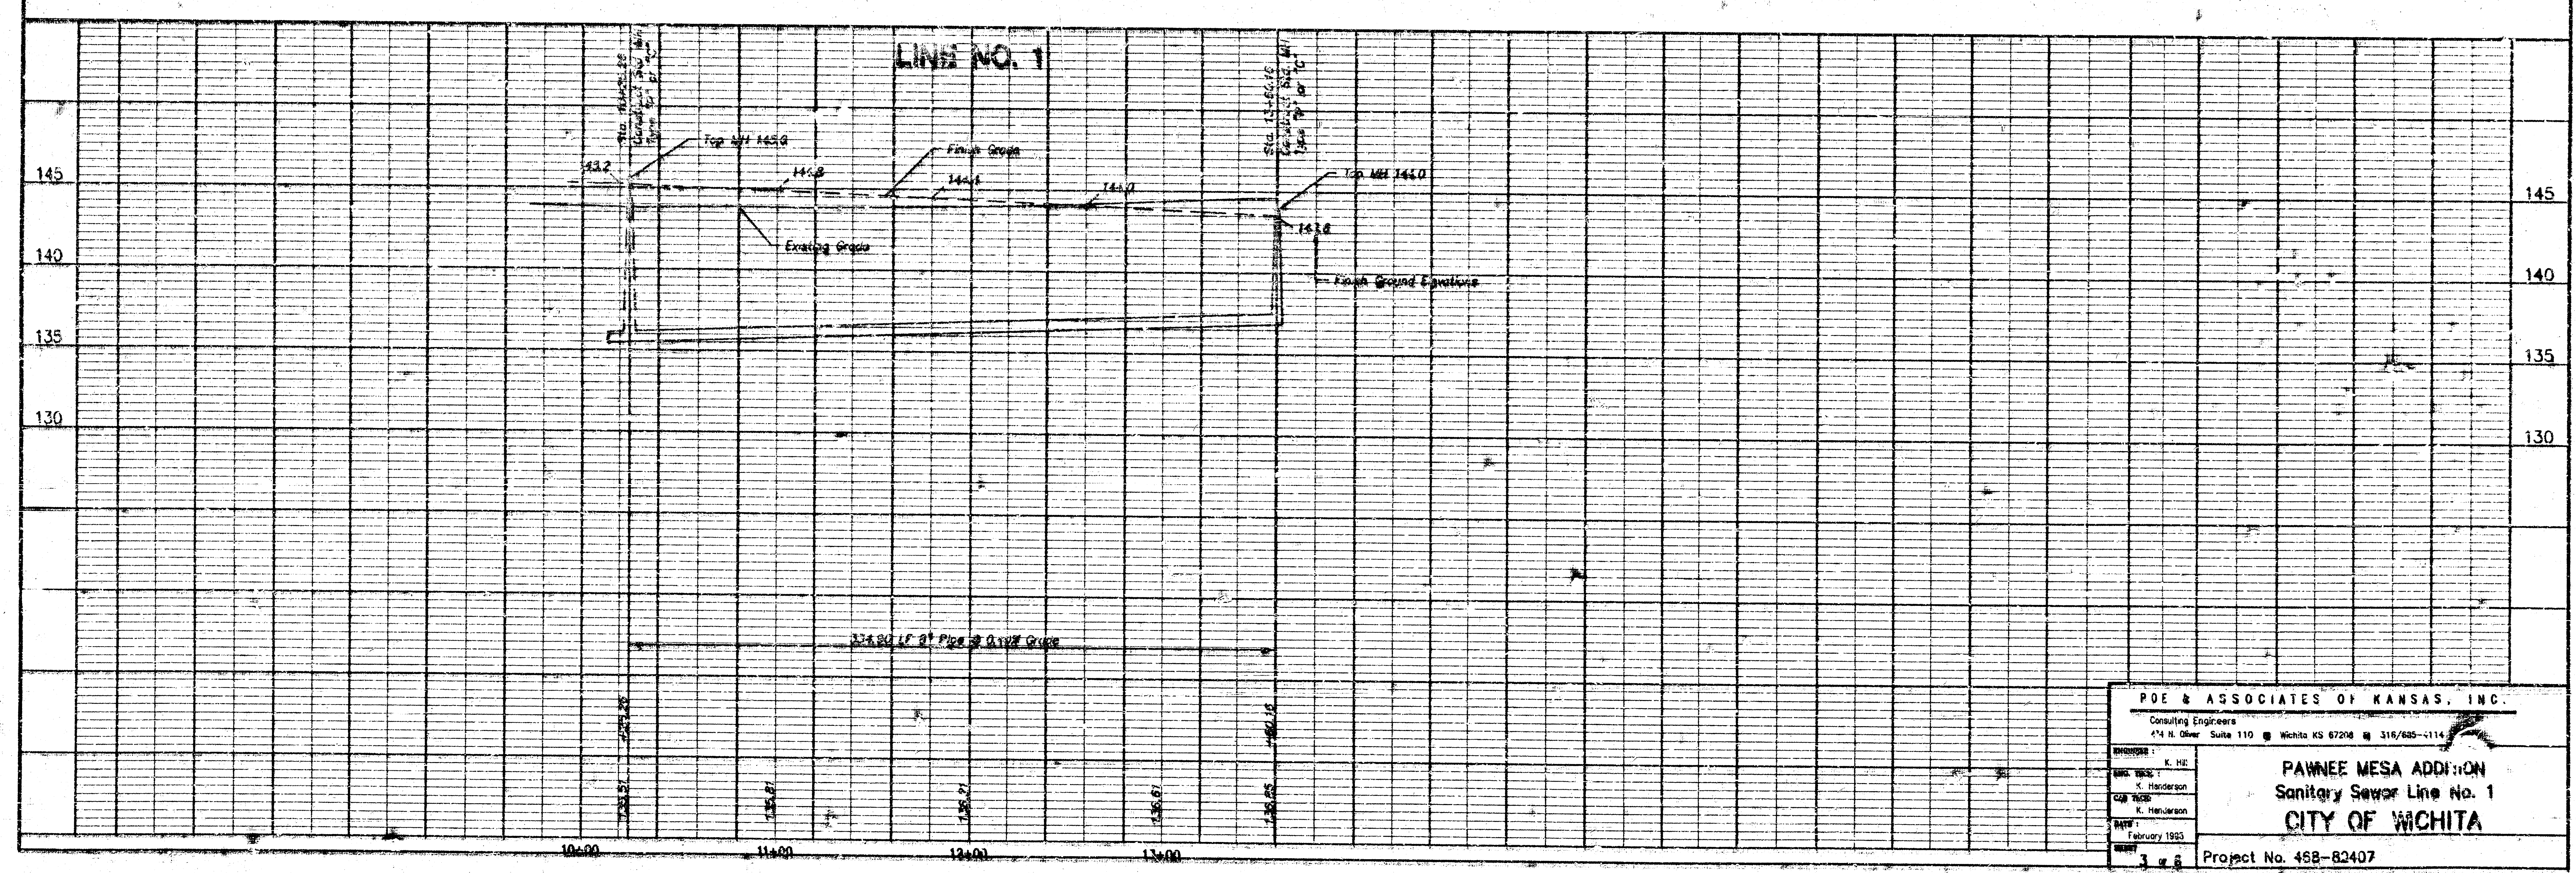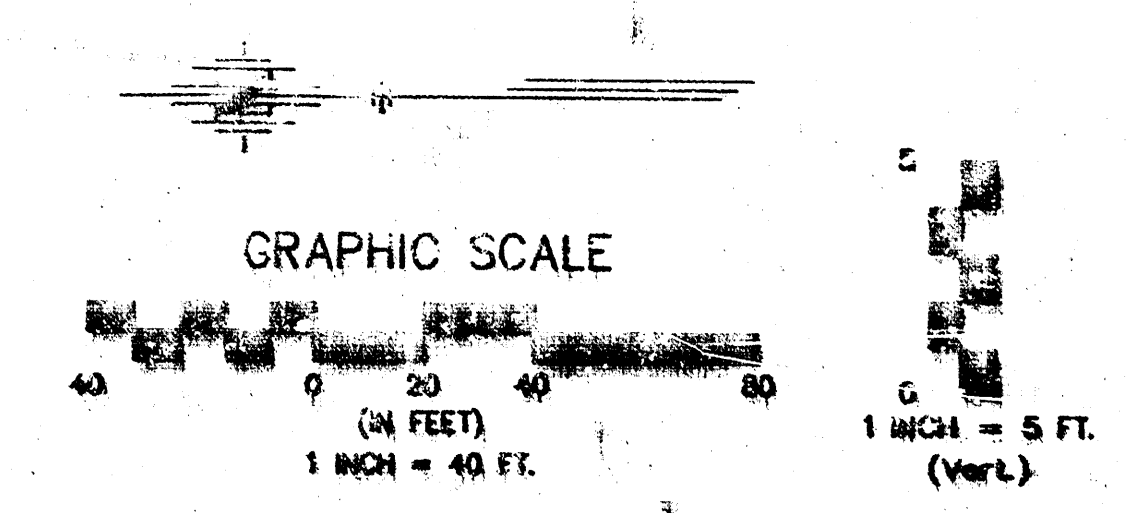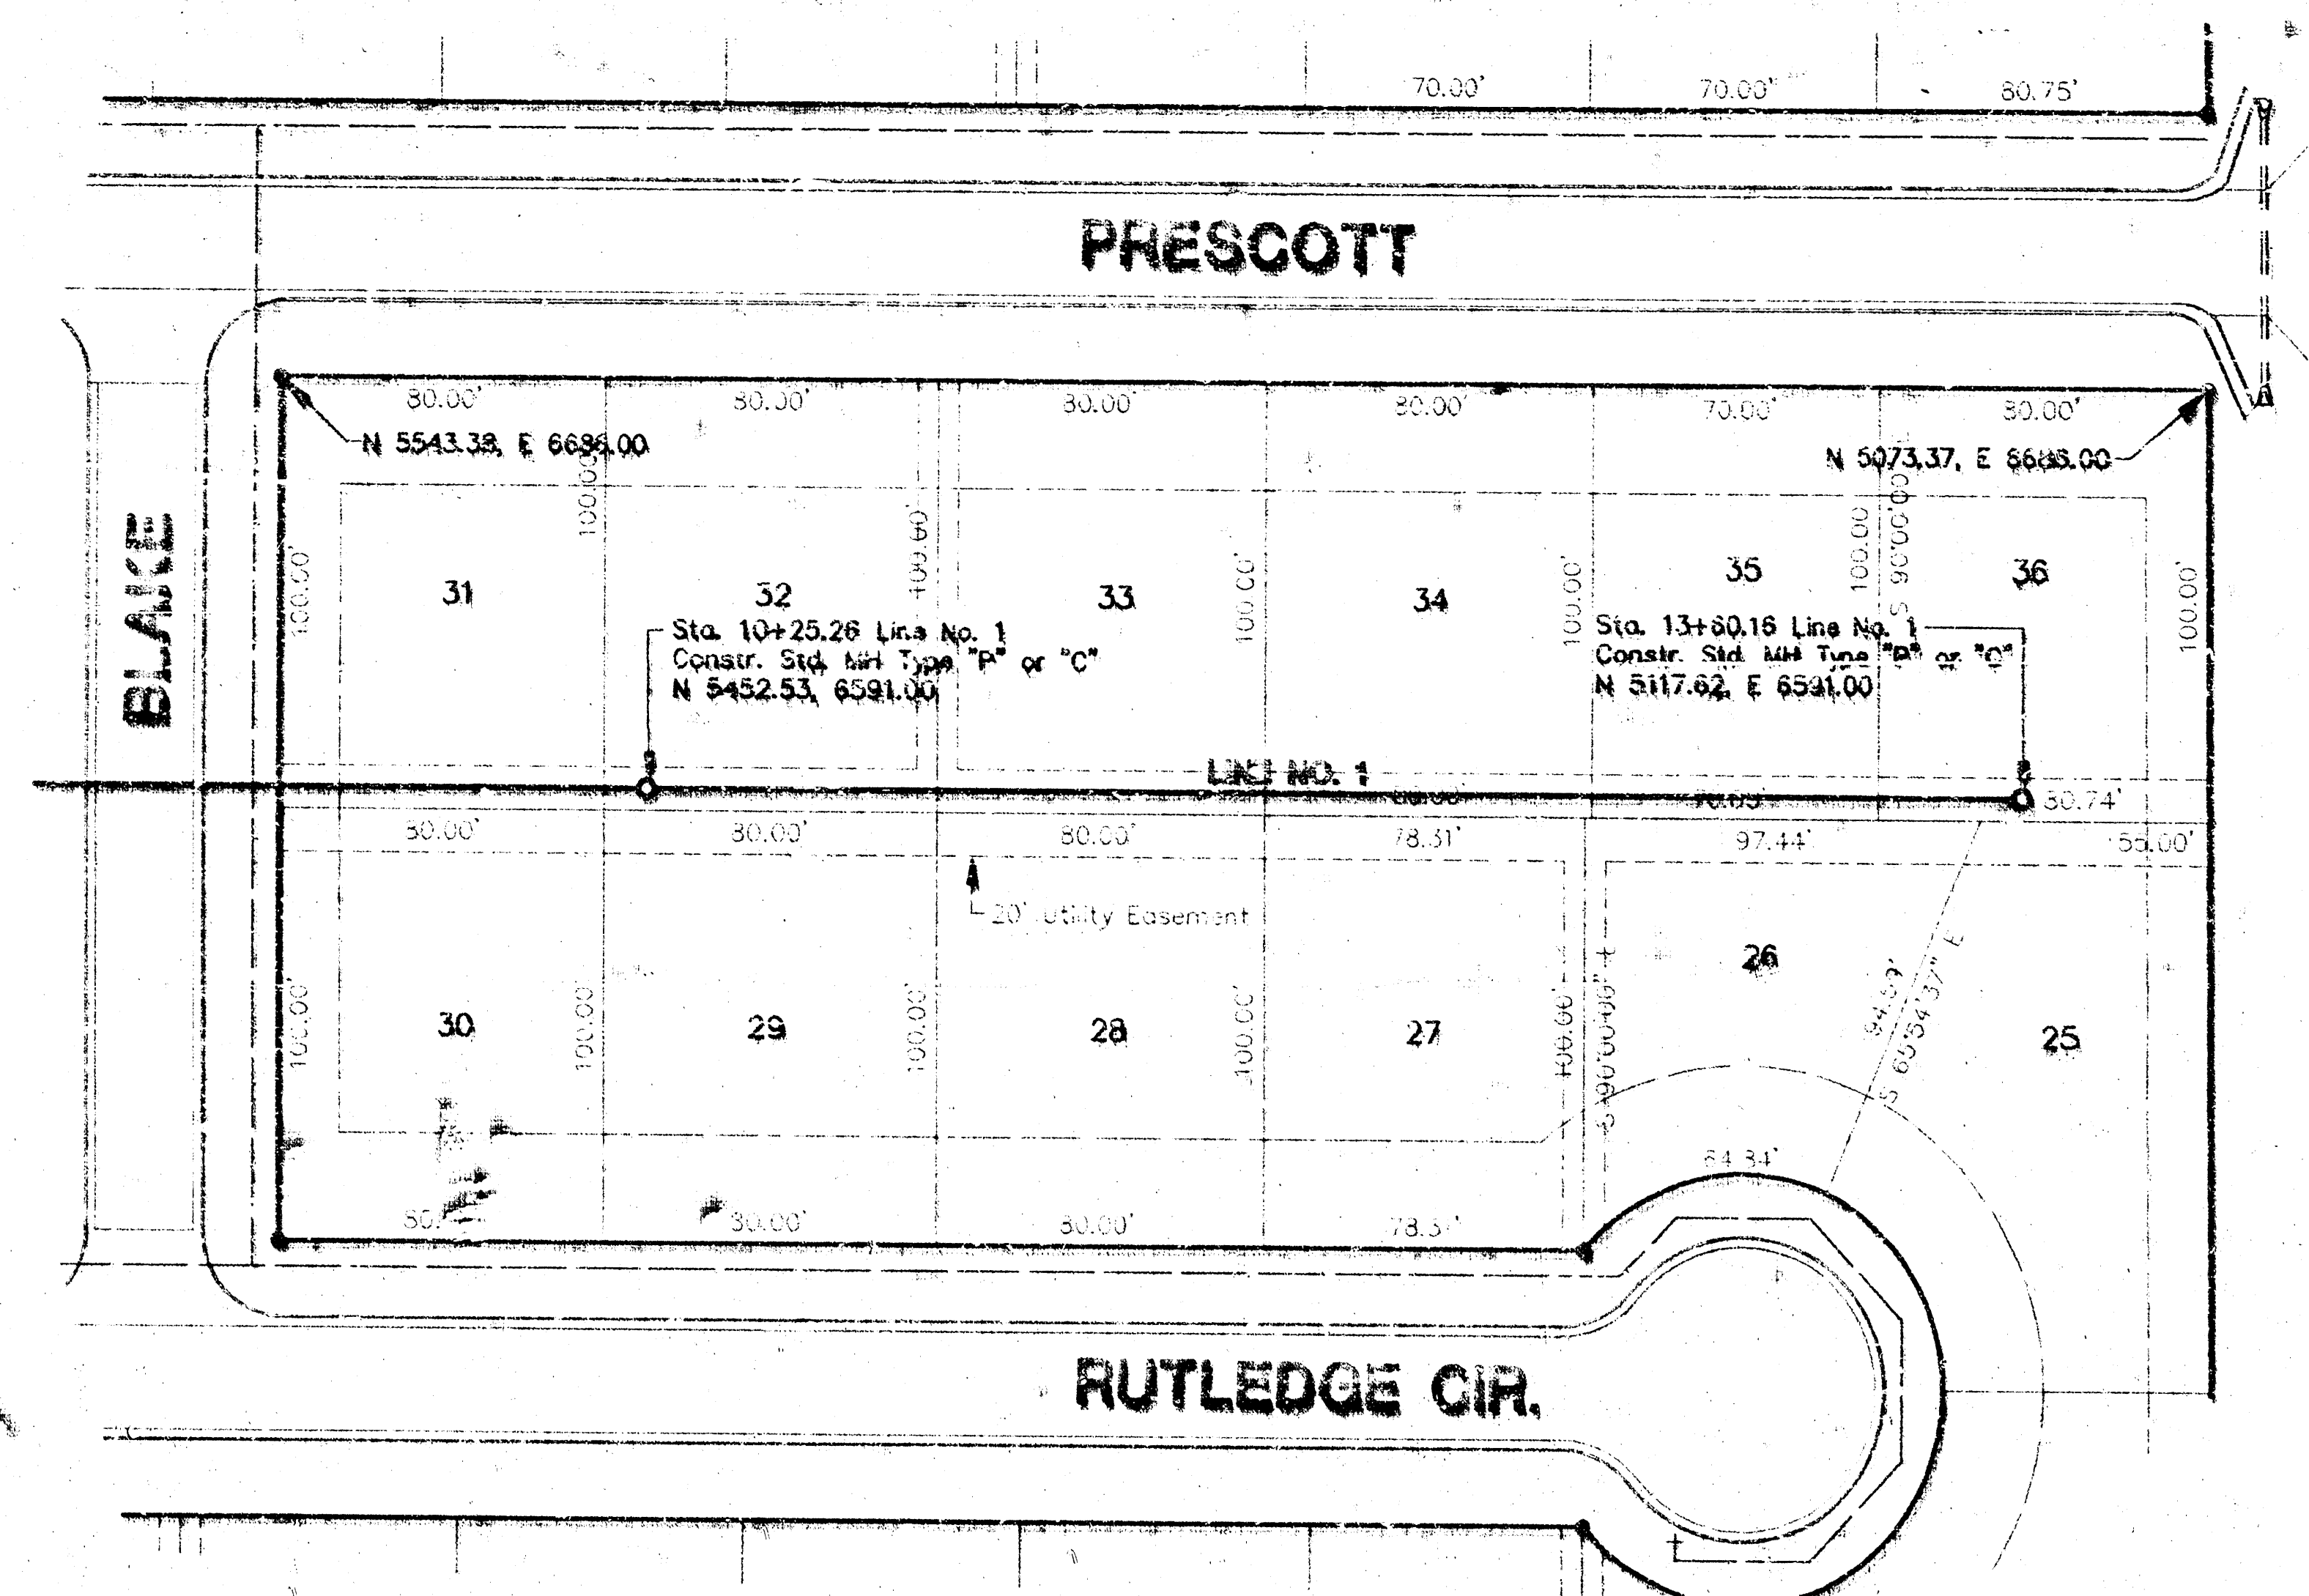

POE & ASSOCIATES OF KANSAS, INC.
 Consulting Engineers
 214 N. Oliver, Suite 110 • Wichita, KS 67208 • 316/625-1114

PROJECT: K. HE
 DATE: 1993
 BY: K. Henderson
 DATE: February 1993

**PAWNEE MESA ADDITION
 Sanitary Sewer Line No. 1
 CITY OF WICHITA**

3 of 6 Project No. 458-82407


B. MAPS/DCA/P.561/BAE Thu Feb 18 12:46:34 1993 JJB DENT - APP 5 4530C

SEWER APPURTENANCES DETAILS


ADOPTED AS STANDARD DESIGN

BY


CITY OF WICHITA

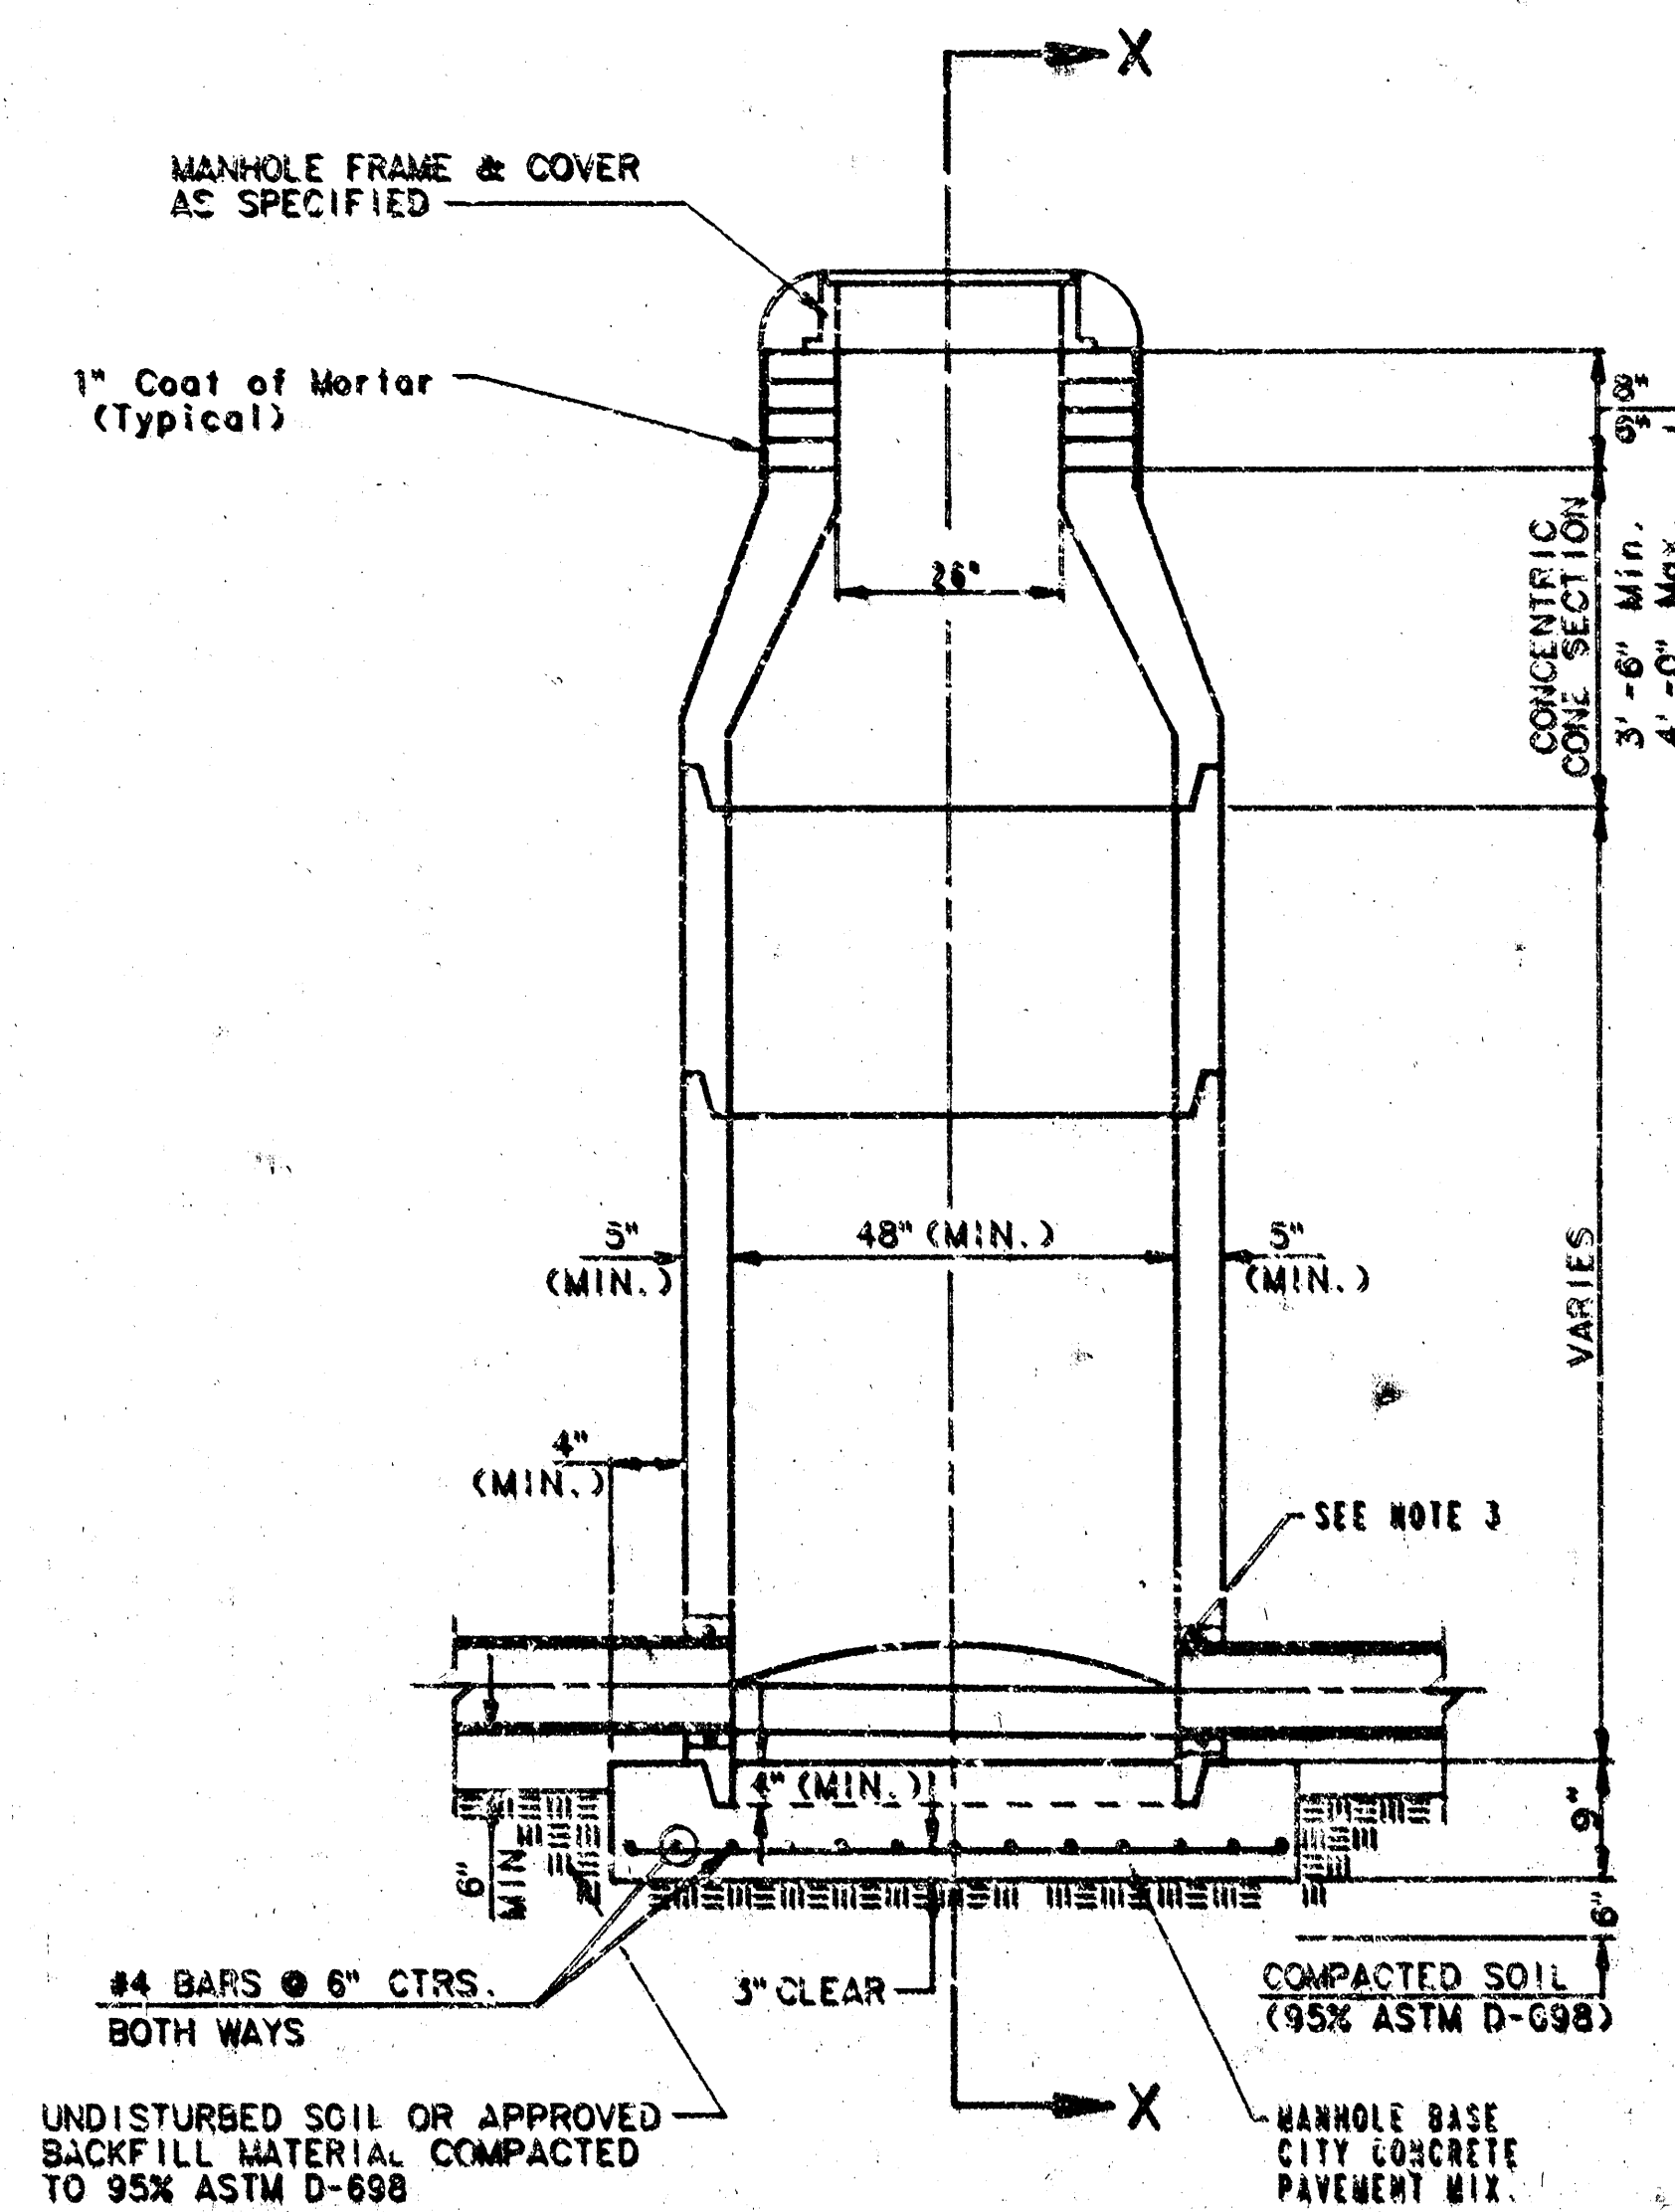


TYPE P
STANDARD MANHOLE

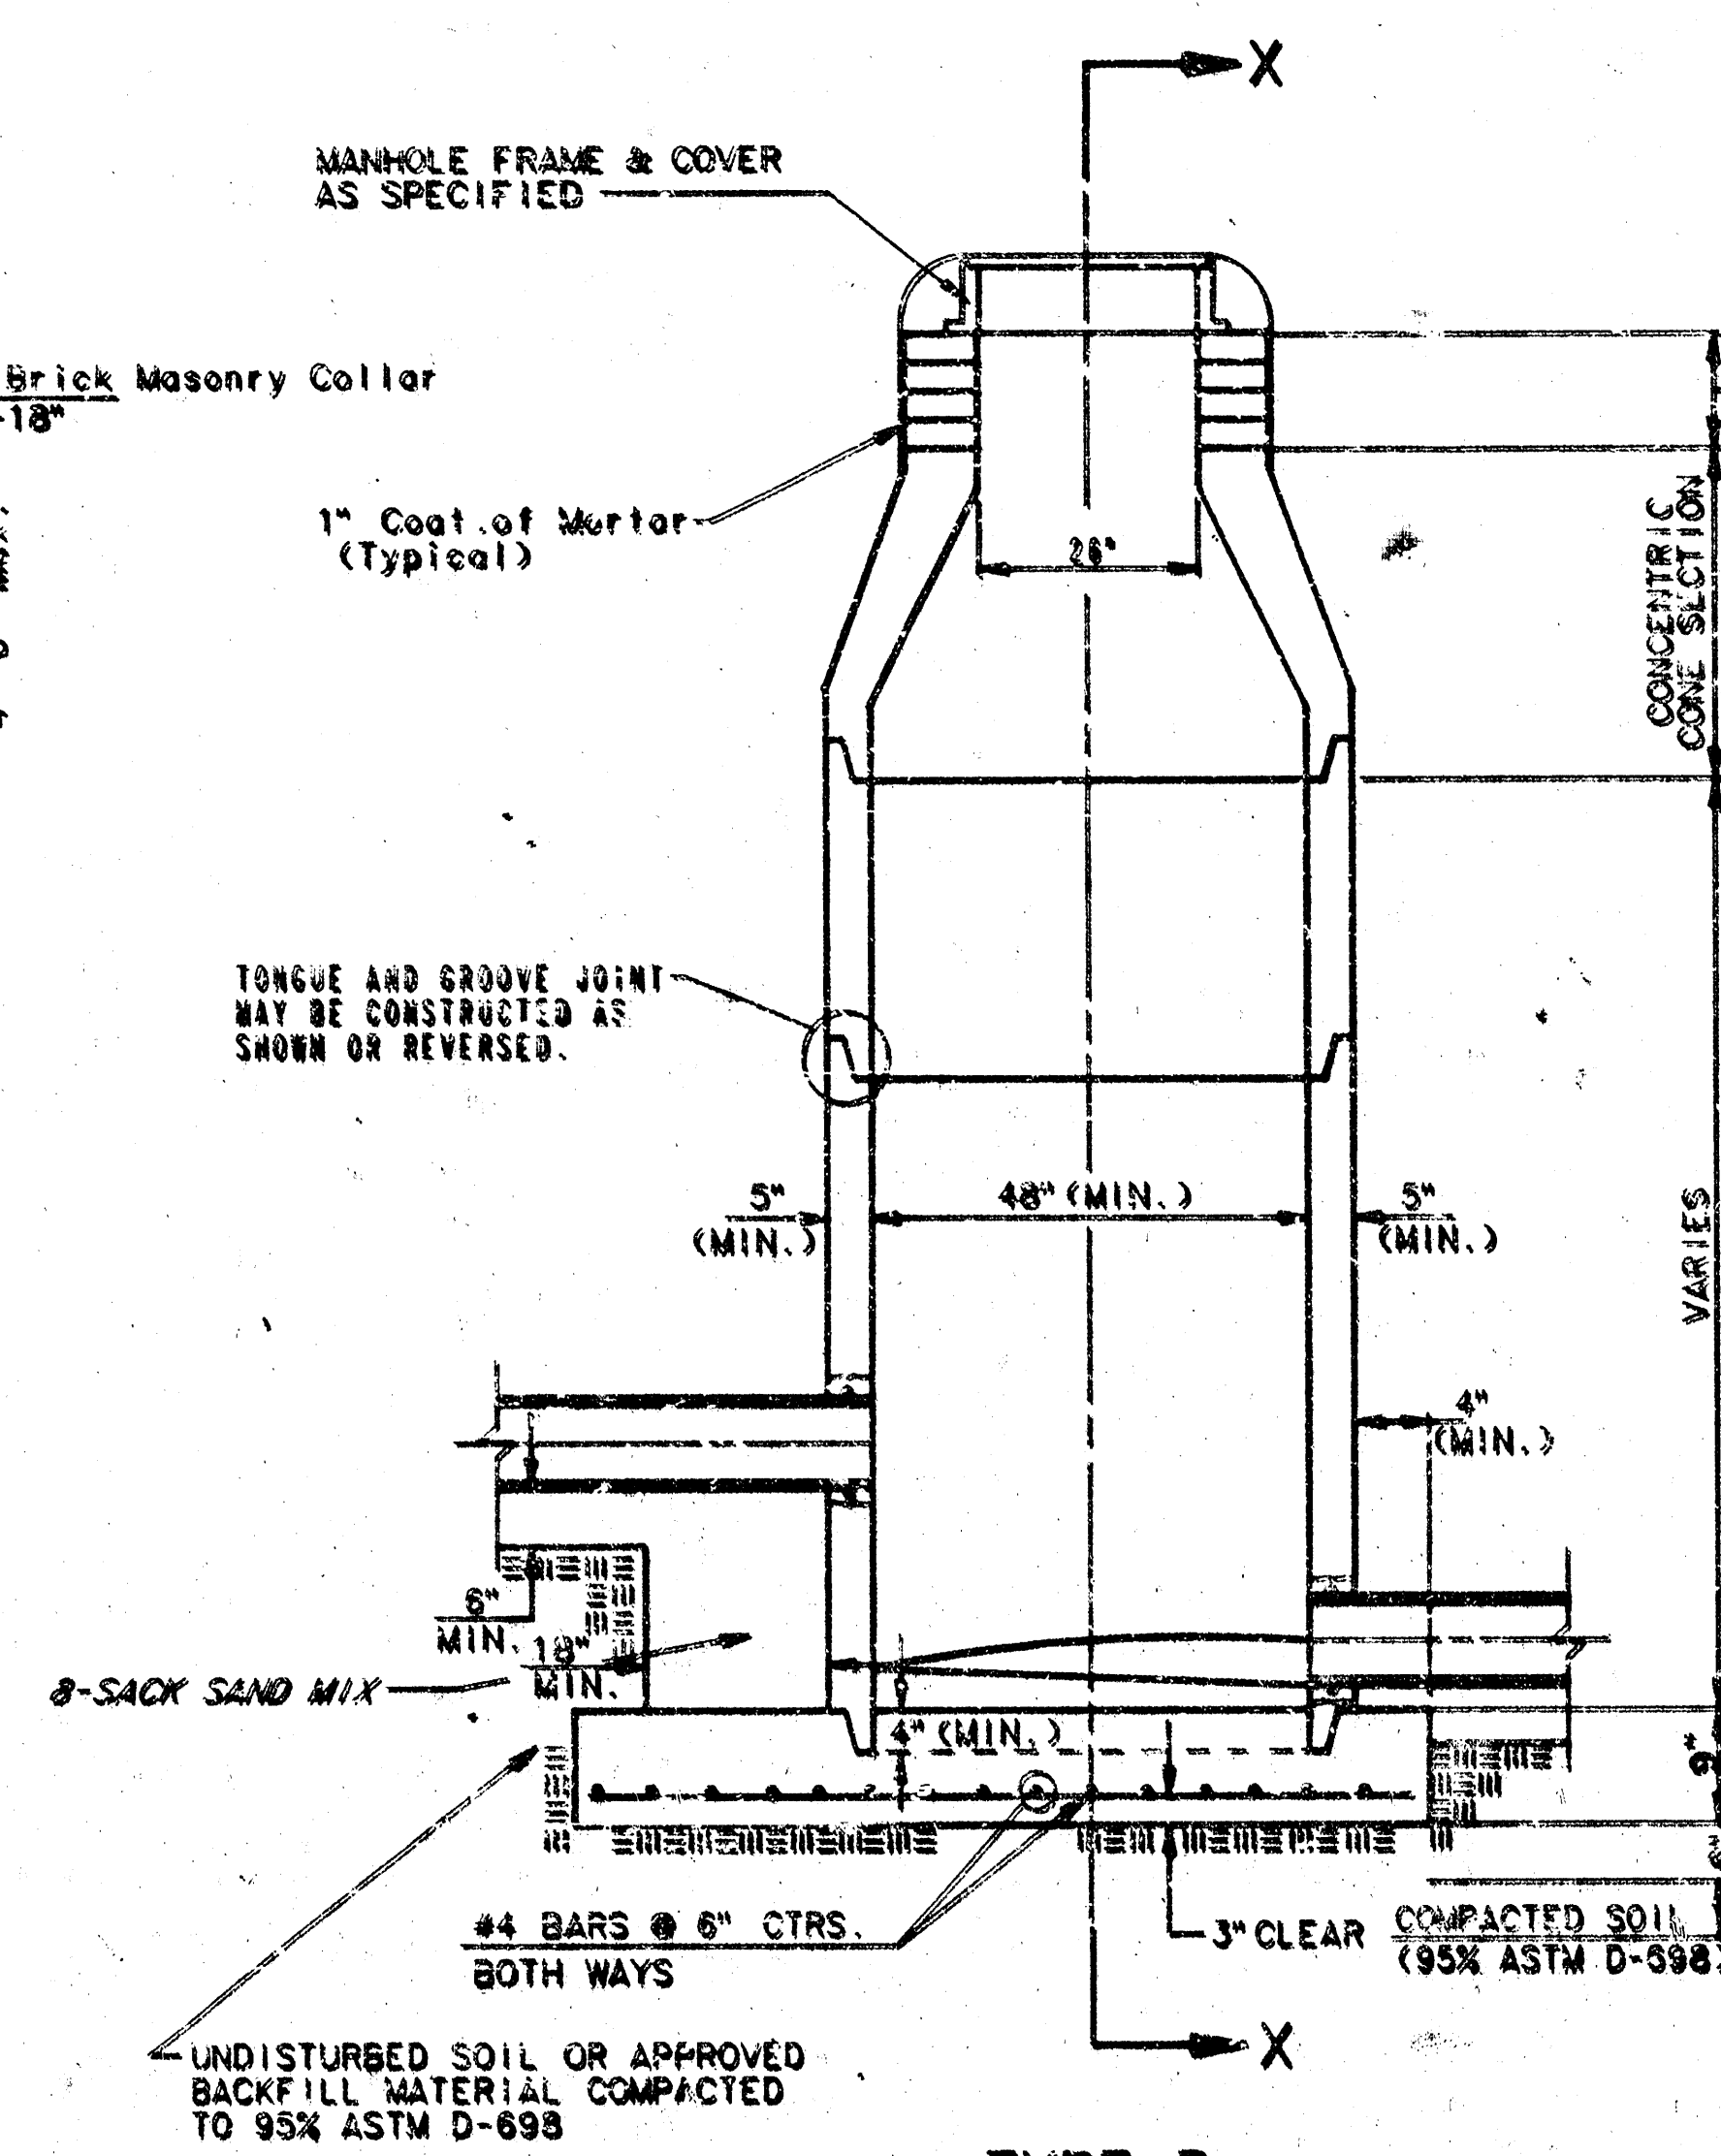

TYPE P
INSIDE DROP MANHOLE

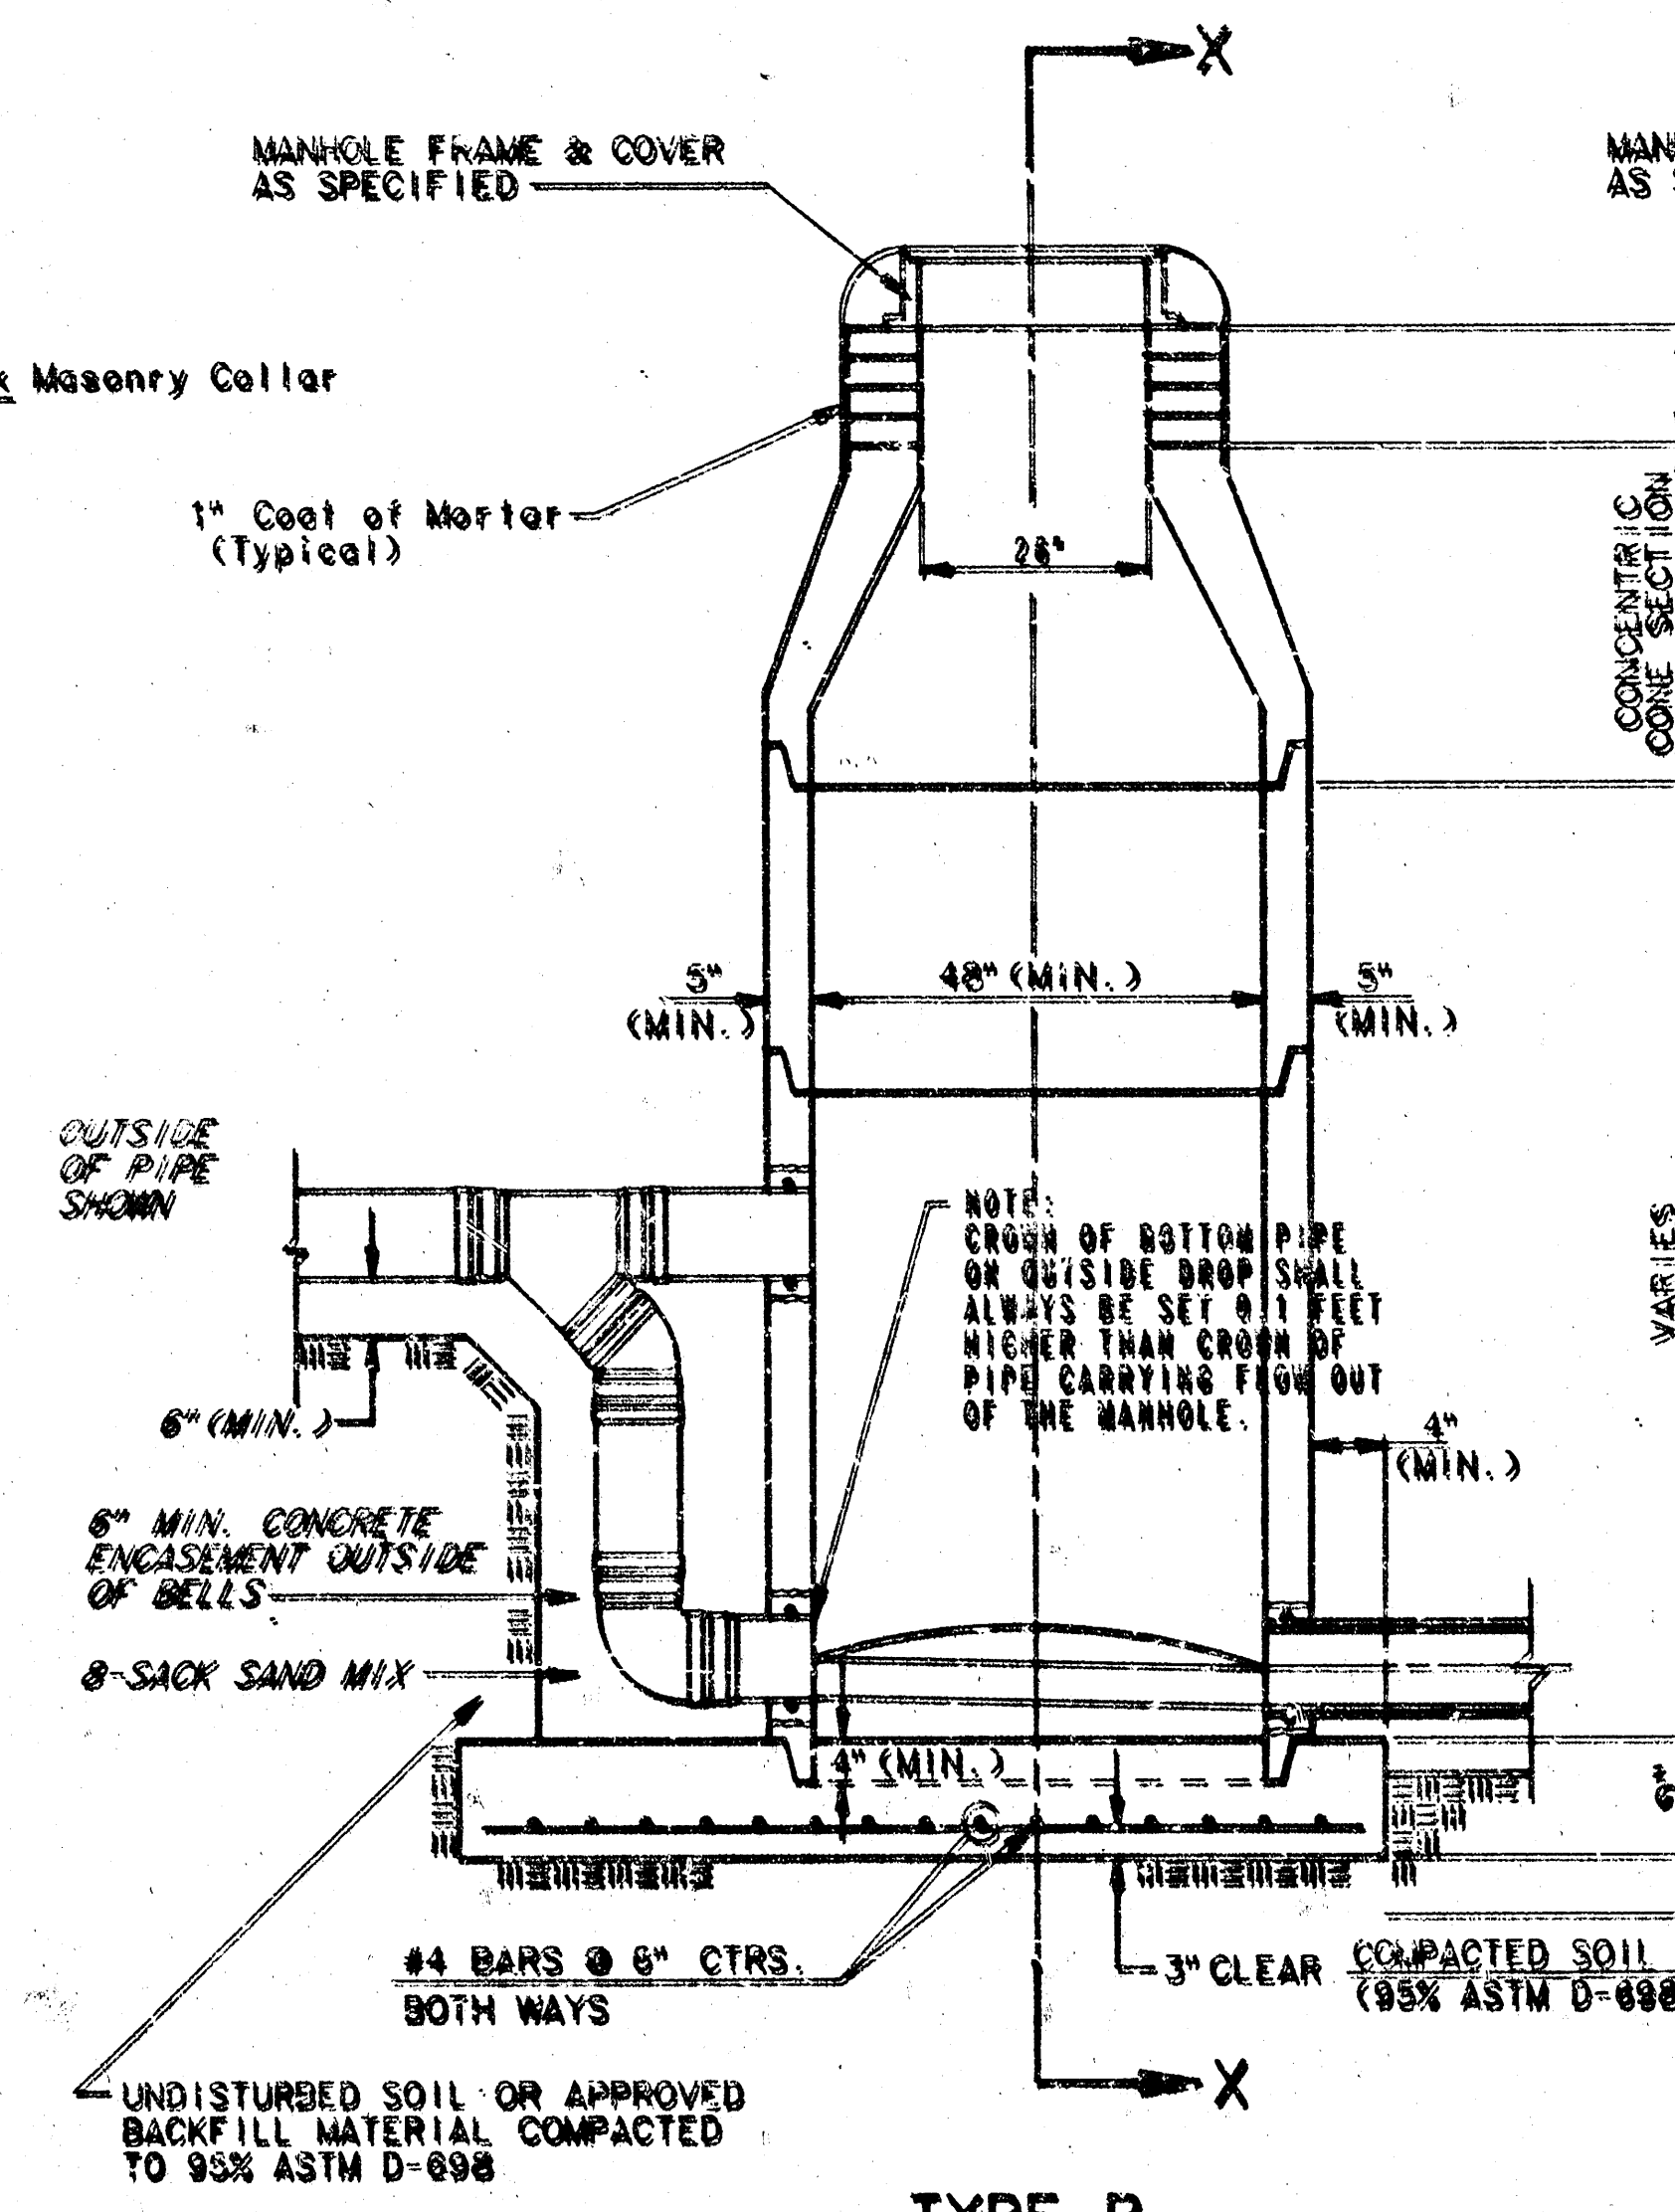

TYPE P
OUTSIDE DROP MANHOLE

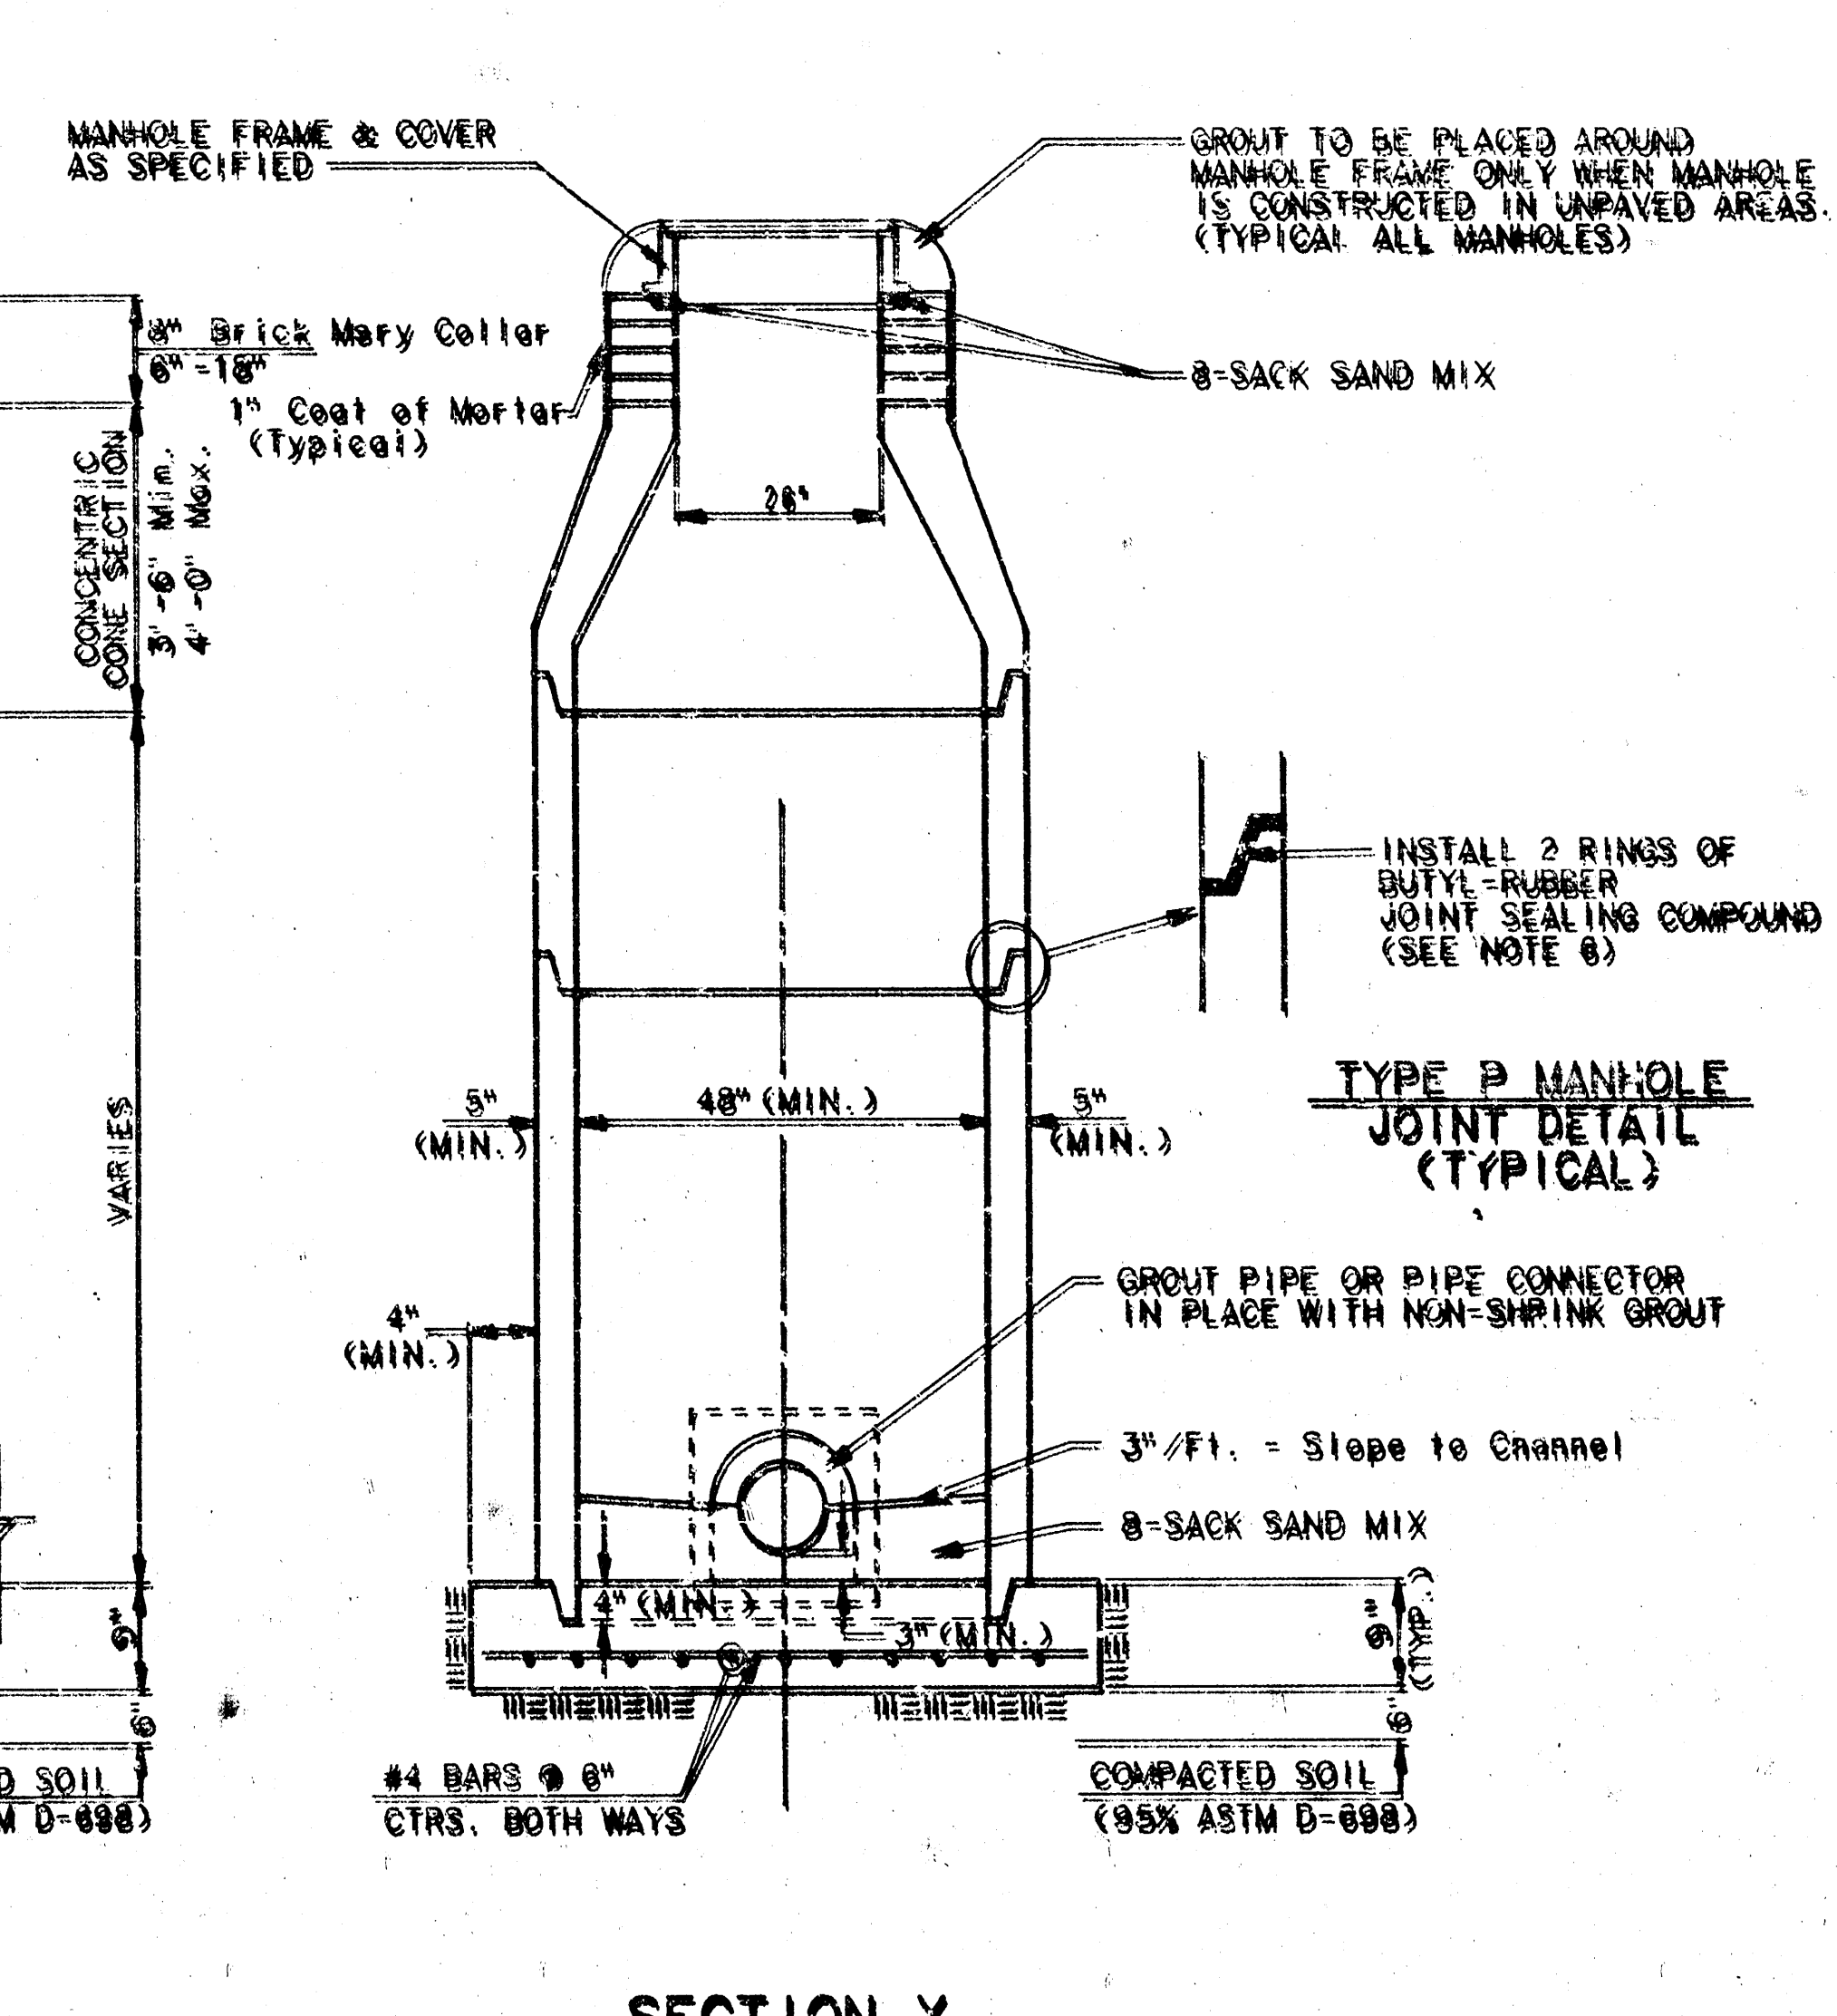

SECTION X
(TYPICAL)


GENERAL NOTES

PRECAST MANHOLE NOTES

1. ALL PRECAST CONCRETE MANHOLE SECTIONS SHALL CONFORM TO THE LATEST REVISION OF A.S.T.M. C476 AS MODIFIED BY THE SPECIFICATIONS.
2. NON-SHRINK GROUT SHALL BE NON-METALLIC TYPE.
3. APPROVED FLEXIBLE WATERSTOP GASKETS SHALL BE INSTALLED TO JOINT THE SEWER TO THE MANHOLE WALL WHEN A.S.S. COMPOSITE PIPE OR P.V.C. PIPE IS USED. FOR OTHER TYPES OF PIPE THE SEWER SHALL BE GROUTED IN PLACE WITH NON-SHRINK GROUT. THE SEWER PIPE SHALL BE SUPPORTED WITH CONCRETE ENCASUREMENT A MINIMUM OF 3 FEET FROM THE MANHOLE WALL AND TO THE FIRST JOINT FOR V.C.P. SUCH THAT THE JOINT REMAINS FLEXIBLE.
4. ALL INSIDE SURFACES OF THE CONCRETE MANHOLE WHICH WOULD BE EXPOSED TO SEWER GAS SHALL BE COATED WITH 2 COATS OF MISC. SERIES 66 HI-BUILD EPOXYLINE, DRY THICKNESS OF 8 MILS (MIN.).
5. EXTERIOR MANHOLE WALLS SHALL BE COATED WITH 1 COAT MOBILARMA 955 BITUMINOUS COATING.
6. JOINT SEALING COMPOUND SHALL BE KENT SEAL NO. 2 OR APPROVED EQUAL.
7. PRECAST MANHOLES SHALL BE SET AT LEAST 4 INCHES INTO THE MANHOLE BASE.
8. TOP OF MANHOLE FLOOR SLAB SHALL BE AT LEAST 3 INCHES BELOW THE FLOW LINE OF THE OUTLET PIPE TO INSURE SUFFICIENT MINIMUM THICKNESS OF SHAPED INVERT.
9. LIFTING HOLES SHALL BE FILLED WITH NON-SHRINK GROUT AND THE INTERIOR SURFACE COATED AS SPECIFIED.
10. MORTAR USED IN MASONRY CONSTRUCTION SHALL CONTAIN 8 SACKS OF CEMENT PER CUBIC YARD. CONCRETE USED IN MANHOLE BASES SHALL CONFORM TO THE REQUIREMENTS OF CONCRETE FOR CONCRETE PAYMENT CONSTRUCTION AS SPECIFIED IN THE CITY STANDARD PAVING SPECIFICATIONS USING CITY CONCRETE PAYMENT MIX WITHOUT AIR ENTRAINING ADMIXTURE. MORTAR SHALL BE PLACED AROUND THE MANHOLE RING AS SHOWN ON THE DRAWINGS WHEN MANHOLES ARE CONSTRUCTED IN UNPAVED AREAS. MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE SMALLER THAN 24" SHALL HAVE AN INSIDE DIAMETER OF 4". MANHOLES CONSTRUCTED WHERE PIPE SIZES ARE 24" OR LARGER SHALL HAVE AN INSIDE DIAMETER OF 5". COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATER TIGHT.

11. REINFORCING STEEL SHALL BE INSTALLED IN THE MANHOLE BASES AND SHALL CONSIST OF NO. 4 BARS PLACED ON 6" CENTERS IN BOTH DIRECTIONS. THE MANHOLE BASE REINFORCEMENT SHALL BE PLACED AT LEAST 3" ABOVE THE BOTTOM OF THE MANHOLE BASE. ALL COSTS FOR FURNISHING AND INSTALLING REINFORCING STEEL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
12. OPENINGS SHALL BE CUT INTO THE MANHOLE WALL WHEN OUTSIDE DROPS ARE CONSTRUCTED ON EXISTING MANHOLES. SUCH OPENINGS CUT INTO EXISTING MANHOLES SHALL BE AS SMALL AS PRACTICAL TO FACILITATE INSTALLING AND GROUTING THE NEW PIPE IN PLACE. WATERSTOP GASKETS SHALL BE USED WITH P.V.C. AND A.S.S. COMPOSITE PIPE. THE NEW PIPE SHALL BE GROUTED INTO THE OPENING USING AN APPROVED NONSHRINK GROUT FOR THE FULL MANHOLE WALL THICKNESS. THE EXTERIOR OF THE COMPLETED CONNECTION SHALL BE SEALED WITH AN APPROVED BITUMINOUS COATING SUCH THAT THE CONNECTION WILL BE WATER TIGHT. FLOOR OF MANHOLE SHALL BE MODIFIED TO FORM NEW FLOW CHANNEL FOR THE NEW CONNECTION AS INDICATED BY THE DRAWING. THIS WORK, INCLUDING MODIFICATION OF MANHOLE FLOOR SHALL BE PAID FOR AT THE UNIT PRICE BID FOR OUTSIDE DROP STACK CONSTRUCTED ON EXISTING MANHOLE.
13. THE FLOORS OF ALL MANHOLES SHALL BE SHAPED WITH FLOW CHANNELS SUCH THAT THE MANHOLES WILL BE SELF CLEANING AND FREE OF AREAS WHERE SOLIDS COULD BE DEPOSITED AS SEWAGE FLOWS THROUGH THE MANHOLE FROM ALL INLET PIPES TO THE OUTLET PIPE. FLOW CHANNELS SHALL BE FORMED TO MATCH THE BOTTOM HALVES OF THE INFLOWING PIPES AND THE OUTFLOWING PIPE AS SHOWN BY THE DRAWINGS EXCEPT FOR INSIDE DROP MANHOLES. FLOW CHANNELS FOR INSIDE DROP MANHOLES SHALL BE CONSTRUCTED AS INDICATED BY THE DRAWING. MANHOLE FLOORS SHALL HAVE SLOPE OF 1/4 INCHES PER FOOT IN THE AREAS OUTSIDE OF THE FLOW CHANNELS SLOPED TOWARD THE FLOW CHANNELS. PIPES LAID THROUGH MANHOLES SHALL HAVE THE TOP HALF REMOVED TO NEAR LINES FOR THE FULL INSIDE DIAMETER OF THE MANHOLE. MANHOLE FLOORS SHALL THEN BE SHAPED AROUND THE BOTTOM HALF OF THE PIPE WHICH FORMS THE FLOW CHANNEL.
14. PIPES INSTALLED WITHIN THE EXCAVATION MADE FOR THE MANHOLE SHALL BE CRADLED WITH CONCRETE TO THE LIMITS OF THE MANHOLE EXCAVATION. WHEN CLAY PIPE IS USED, THE CRADLE SHALL EXTEND TO THE FIRST JOINT OUTSIDE THE MANHOLE. THE CRADLE SHALL BE TERMINATED AT THE CLAY PIPE JOINT IN A MANNER WHICH WILL MAINTAIN THE FLEXIBILITY OF THE JOINT. COST OF CRADLE WITHIN MANHOLE EXCAVATION OR TO CLAY PIPE JOINTS ADJACENT TO MANHOLE SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.

15. MANHOLE COVER CASTINGS AND MANHOLE FRAME CASTINGS SHALL CONFORM TO THE REQUIREMENTS AS INDICATED IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD DETAIL DRAWING.
16. THE VERTICAL FREE FALL DROP INSIDE MANHOLES SHALL NOT EXCEED 2'. THE CROWNS OF INFLOWING PIPES SHALL NEVER BE SET LOWER THAN THE CROWN OF THE OUTFLOWING PIPE.
17. STANDARD MANHOLES AND STANDARD INSIDE DROP MANHOLES SHALL BE BID AS STANDARD MANHOLES FOR THE TYPE AND DIAMETER INDICATED. OUTSIDE DROP MANHOLES SHALL BE BID AS STANDARD OUTSIDE DROP MANHOLES FOR THE TYPE AND DIAMETER INDICATED. ALL MANHOLE DIAMETERS WILL BE 4' UNLESS INDICATED OTHERWISE.
18. A BRICK MASONRY COLLAR SHALL BE INSTALLED BETWEEN THE CAST IRON FRAME AND THE CONCENTRIC CONE. THE COLLAR WILL HAVE 6" WALLS AND A VERTICAL HEIGHT OF 6" MINIMUM AND 18" MAXIMUM. A 1" COAT OF MORTAR WILL BE PLASTERED ON THE OUTSIDE OF THE COLLAR.

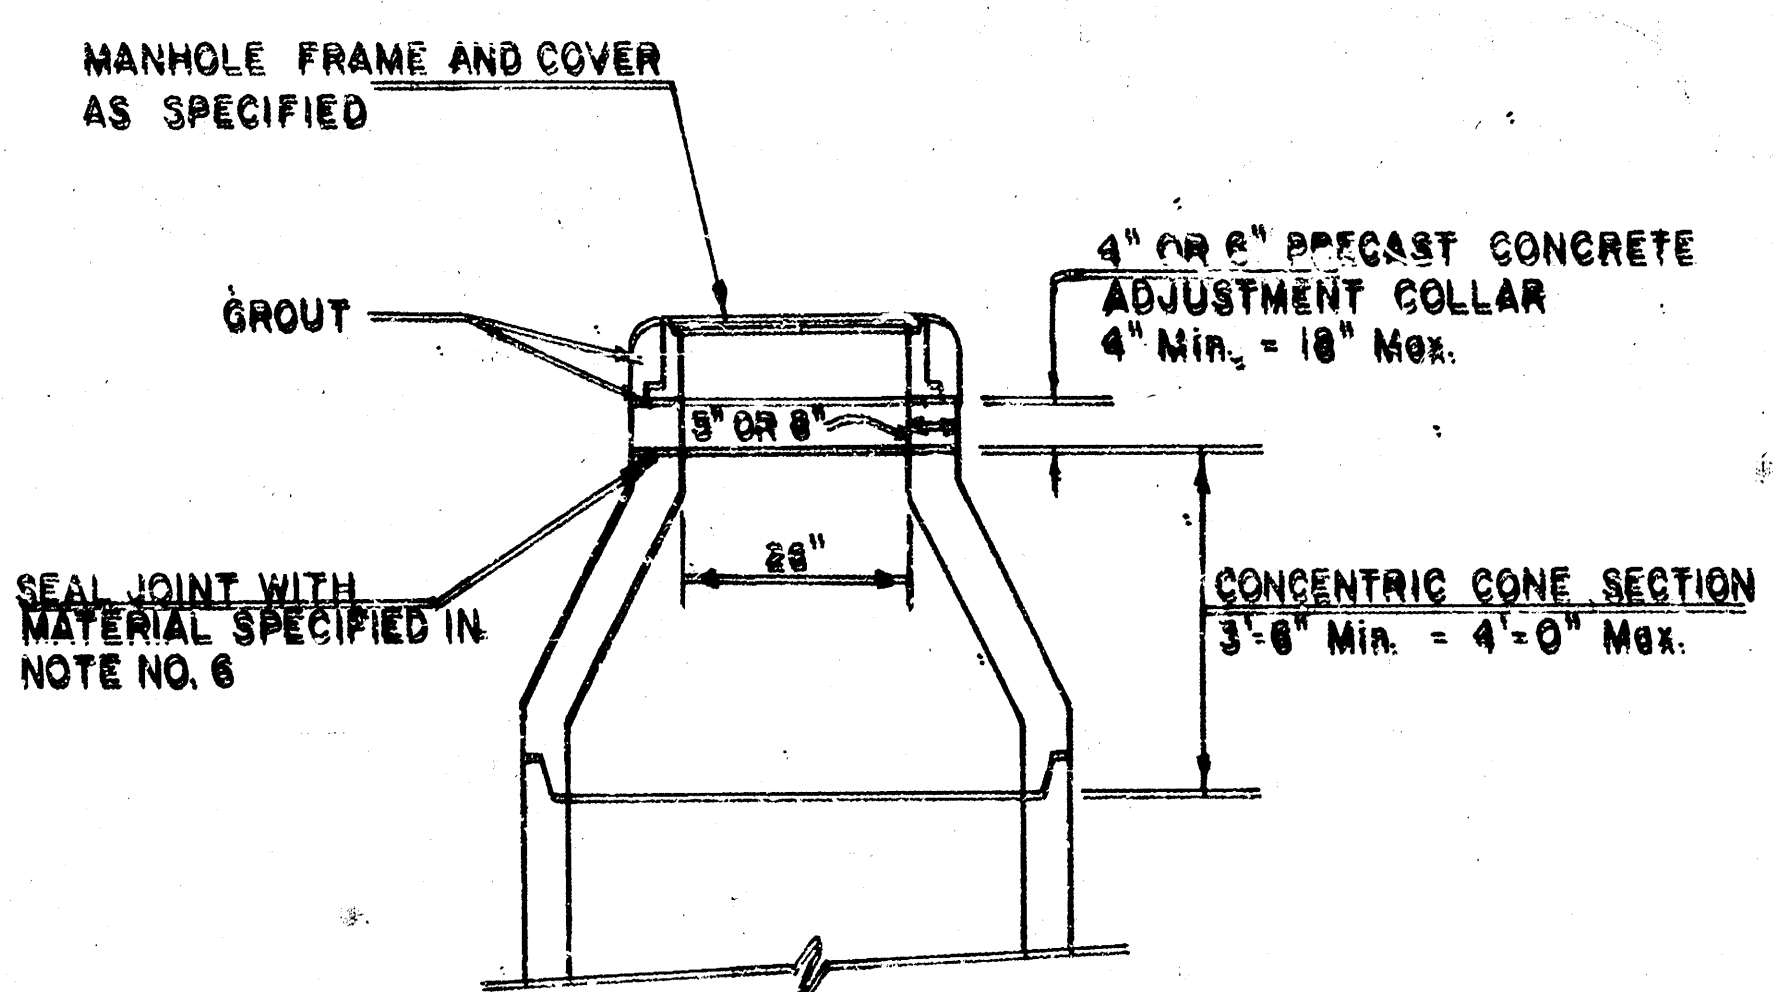

ALTERNATE CONSTRUCTION
IN UNPAVED AREAS

PROJ. NO. 488-82407
INDEX CODE 748130

NOTE NO. 18 REVISED JAN. 1991
Revised 3-21-89
Revised 8-10-88
Revised: June 12, 1995

City of Miami, Florida

RING AND LID AS SPECIFIED
 SEE GEN. NOTES
 8" BRICK MASONRY
 1" COAT OF PLASTER
 MANHOLE WALL
 GLETT CONC. PAVT. MIX
 NOTE: CROWN OF PIPE FLOWING IN SHALL NOT BE LOWER THAN CROWN OF PIPE FLOWING OUT
 FLOOR SLAB
 SLOPE: 1:10
 MANHOLE BASE
 GLETT CONC. PAVT. MIX

[illegible]

SEE REV. NOTES
 8" CONC. MASONRY
 1" COAT OF MORTAR
 26" 5/8"
 30" 1/2"
 8" MIN. IS MAX. BRICK MASONRY COLLAR
 30" MIN. - 48" MAX.
 VARIABLE
 3" MIN. H.
 4" MIN.
 SEE REV. NOTES
 8"
 5"
 3"
 2"
 1"
 1/2"
 1/4"
 1/8"
 1/16"
 1/32"
 1/64"
 1/128"
 1/256"
 1/512"
 1/1024"
 1/2048"
 1/4096"
 1/8192"
 1/16384"
 1/32768"
 1/65536"
 1/131072"
 1/262144"
 1/524288"
 1/1048576"
 1/2097152"
 1/4194304"
 1/8388608"
 1/16777216"
 1/33554432"
 1/67108864"
 1/134217728"
 1/268435456"
 1/536870912"
 1/1073741824"
 1/2147483648"
 1/4294967296"
 1/8589934592"
 1/17179869184"
 1/34359738368"
 1/68719476736"
 1/137438953472"
 1/274877906944"
 1/549755813888"
 1/1099511627776"
 1/2199023255552"
 1/4398046511104"
 1/8796093022208"
 1/17592186044416"
 1/35184372088832"
 1/70368744177664"
 1/140737488355328"
 1/281474976710656"
 1/562949953421312"
 1/1125899906842624"
 1/2251799813685248"
 1/4503599627370496"
 1/9007199254740992"
 1/18014398509481984"
 1/36028797018963968"
 1/72057594037927936"
 1/144115188075855872"
 1/288230376151711744"
 1/576460752303423488"
 1/1152921504606846976"
 1/2305843009213693952"
 1/4611686018427387904"
 1/9223372036854775808"
 1/18446744073709551616"
 1/36893488147419103232"
 1/73786976294838206464"
 1/147573952589676412928"
 1/295147905179352825856"
 1/590295810358705651712"
 1/1180591620717411303424"
 1/2361183241434822606848"
 1/4722366482869645213696"
 1/9444732965739290427392"
 1/18889465931478580854784"
 1/37778931862957161709568"
 1/75557863725914323419136"
 1/151115727451828646838272"
 1/302231454903657293676544"
 1/604462909807314587353088"
 1/1208925819614629174706176"
 1/2417851639229258349412352"
 1/4835703278458516698824704"
 1/9671406556917033397649408"
 1/19342813113834066795298816"
 1/38685626227668133590597632"
 1/77371252455336267181195264"
 1/154742504910672534362390528"
 1/309485009821345068724781056"
 1/618970019642690137449562112"
 1/1237940039285380274899124224"
 1/2475880078570760549798248448"
 1/4951760157141521099596496896"
 1/9903520314283042199192993792"
 1/19807040628566084398385987584"
 1/39614081257132168796771975168"
 1/79228162514264337593543950336"
 1/158456325028528675187087900672"
 1/316912650057057350374175801344"
 1/633825300114114700748351602688"
 1/1267650600228229401496703205376"
 1/2535301200456458802993406410752"
 1/5070602400912917605986812821504"
 1/10141204801825835211973625643008"
 1/20282409603651670423947251286016"
 1/40564819207303340847894502572032"
 1/81129638414606681695789005144064"
 1/162259276829213363391578010288128"
 1/324518553658426726783156020576256"
 1/649037107316853453566312041152512"
 1/1298074214633706907132624082305024"
 1/2596148429267413814265248164610048"
 1/5192296858534827628530496329220096"
 1/10384593717069655257060992658440192"
 1/20769187434139310514121985316880384"
 1/41538374868278621028243970633760768"
 1/83076749736557242056487941267521536"
 1/166153499473114484112975882535043072"
 1/332306998946228968225951765070086144"
 1/664613997892457936451903530140172288"
 1/1329227995784915872903807060280344576"
 1/2658455991569831745807614120560689152"
 1/5316911983139663491615228241121378304"
 1/10633823966279326983230456482242756608"
 1/21267647932558653966460912964485513216"
 1/42535295865117307932921825928971026432"
 1/85070591730234615865843651857942052864"
 1/170141183460469231731687303715884105728"
 1/340282366920938463463374607431768211456"
 1/680564733841876926926749214863536422912"
 1/1361129467683753853853498429727072845824"
 1/2722258935367507707706996859454145691648"
 1/5444517870735015415413993718908291383296"
 1/10889035741470030830827987437816582766592"
 1/21778071482940061661655974875633165533184"
 1/4355614296588012332331194975126633106636

- [illegible]

The drawing, MANHOLE FLOWS, shall have slopes of 3 inches per foot in the areas outside of the flow channels sloped toward the flow channels. Pipes laid through manhole shall have the top half removed to flat lines for the full inside diameter of the manhole. Manhole flows shall then be shaped around the bottom half of the pipe which is the flow channel.

- PIPES INSTALLED WITHIN THE EXCAVATION MADE FOR THE MANHOLE SHALL BE GRADED WITH CONCRETE TO THE LIMITS OF THE MANHOLE EXCAVATION. WHEN ANY OF THE PIPES ARE EXPOSED TO THE STREET OR TO THE EAST JOINT OUTSIDE THE MANHOLE, THE PAVEMENT SHALL BE TERMINATED AT THE CLAY PIPE JOINT. JOINTS WITHIN WHICH WILL MAINTAIN THE FLEXIBILITY OF THE JOINT. COST OF SHALL WITHIN MANHOLE EXCAVATION OR TO CLAY PIPE JOINT ADJACENT TO MANHOLE SHALL BE INCLUDED IN THE UNIT PRICE BID FOR THE MANHOLE.
- MANHOLE LIDS, SETTING AND MANHOLE FRAME CASINGS SHALL CONFORM TO THE REQUIREMENTS AS SET FORTH IN THE STANDARD SPECIFICATIONS AND AS SHOWN IN THE STANDARD LAYOUT DRAWING.
- FREE FALL DROP INSIDE MANHOLES SHALL NOT EXCEED 2'.
- IF THE DRAINAGE PIPE IS EXPOSED TO THE STREET, IT SHALL BE SET UNDER A CONCRETE CURB OR A CONCRETE PIPE.



STANDARD MANHOLE TYPE "A" AND STANDARD INSIDE DRAIN MANHOLE TYPE "B" SHALL BE EMPLOYED FOR THE TYPE AND DIAMETER INDICATED. EXCEPT FOR MANHOLE TYPE "C" SHALL BE AS STANDARD BUT FOR THE TYPE AND DIAMETER INDICATED. ALL MANHOLE JOINTS SHALL BE AS INDICATED OTHERWISE.

PAWNEE MESA ADD.
PROJ. NO. 468-82407
INDEX CODE 742130

NOTE NO. 7 REVISED JAN 1991

FINAL PLAT OF PAWNEE MESA ADDITION

AN ADDITION TO SEDGWICK COUNTY, KANSAS

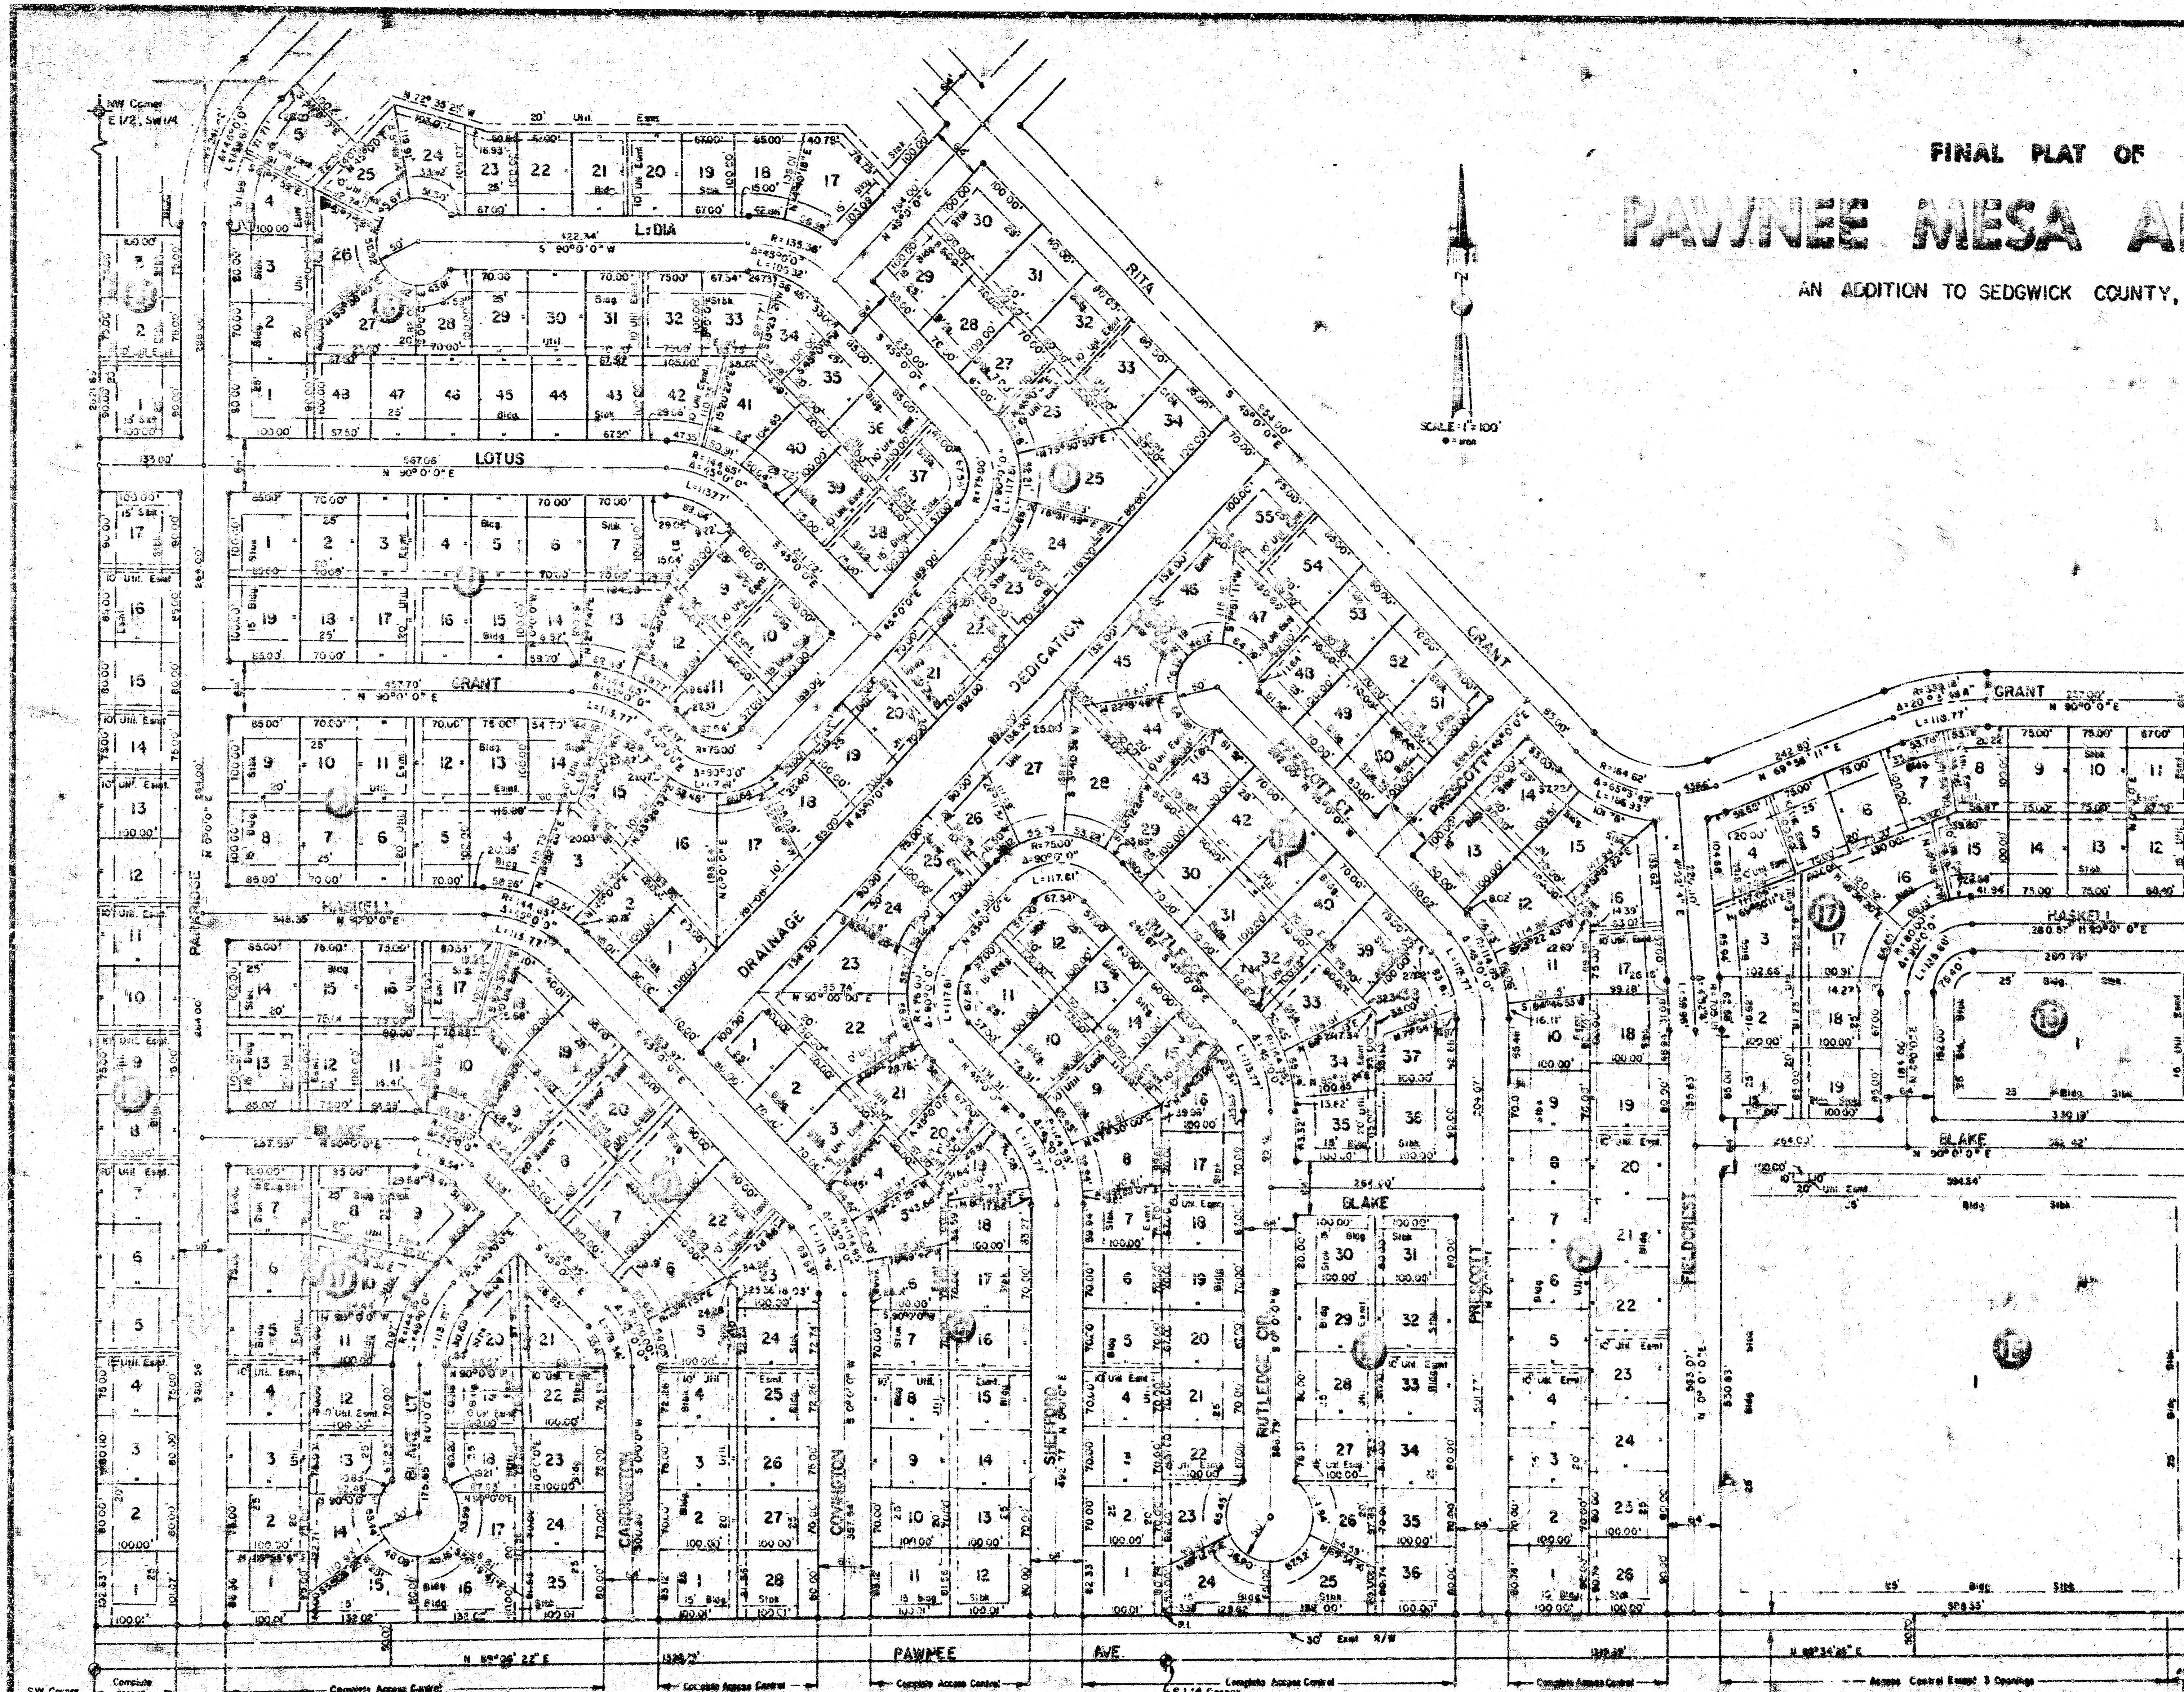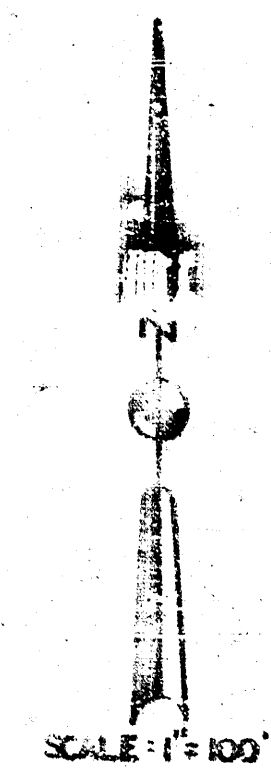

NE Corner
W 1/2, SE 1/4
Sec 31, T27S, R1W

This plat of "Pawnee Mesa Addition" has been submitted to and approved by the Wichita-Sedgewick County Metropolitan Area Planning Commission, Wichita, Kansas.

Dated this 25th day of January, 1980.

Wichita-Sedgewick County Metropolitan Area Planning Commission

Michael J. Sawha Chairman
Robert A. Lakin Secretary

This plat approved and all dedications shown hereon, if any, accepted by the City Commission of the City of Wichita, Kansas this 11th day of March, 1980.

Tom Canado Mayor

Donald C. Glick City Clerk

Entered on transfer record this 25th day of March, 1980.

Deborah A. White County Clerk

This plat approved and all dedications shown hereon, if any, accepted by the Board of County Commissioners of Sedgewick County, Kansas this 11th day of March, 1980.

Patrick Chairman

Scott Commissioner

Donald E. Grogg Commissioner

Attest: *Deborah A. White* County Clerk

State of Kansas, ss: #482954

County of Sedgewick,

This is to certify that this instrument was filed for record in the Register of Deeds Office at 2:00 PM on the 25th day of March, 1980.

Patricia A. McIntire Register of Deeds

Pat McIntire Deputy

30' Dedication

Complete Access Control

30' Dedication

Complete Access Control

SE Corner
W 1/2 SE 1/4
Sec 31, T27S, R1W

Pawnee Mesa Addition
Proj. No. 466-82407
Index Code 742130

6/8

14-8-3-8