

S.V.A. DWG. NAME: 2140e01.dwg; DATE: 01/20/03; TIME: 12:01

	Ruggles & Bohm, P.A. Engineering, Surveying, Land Planning		RB JOB 2088T
	224 North Main Wichita, Kansas 67203 www.rbkansas.com	(316) 264-8008 (316) 264-8821 fax E-mail: info@rbkansas.com	SHEET 61 OF 63

LIGHT FIXTURE SCHEDULE NOTES

BVA

- ① SEE SPECIFICATIONS FOR LAMP AND BALLAST TYPE. VERIFY LAMP COLOR WITH ARCHITECT PRIOR TO ORDERING.
- ② CONTACT ILLUMINATION SALES, (314)-245-2310 FOR ALL INFORMATION AND PRICING FOR THIS LIGHT FIXTURE AND POLE. LIGHT FIXTURE AND POLE TO MATCH EXISTING LIGHT FIXTURES CURRENTLY INSTALLED BY THE HYATT. NO RECEPTACLE REQUIRED. PROVIDE STANDARD BASE AS SHOWN. VERIFY ALL REQUIREMENTS PRIOR TO BID.

GRADE AFTER COMPLETION OF PROJECT.

GROUND TOP TO ALLOW FOR SETTLEMENT

4" WIDE PLASTIC MARKER WITH METAL BACKING "CAUTION - ELECTRIC LINE BURIED BELOW" (TWO REQUIRED)

UNDISTURBED EARTH

COMPACTED BACKFILL

PVC SCHEDULE 40 CONDUIT WITH CONDUCTORS FOR PLANS AND SPECIFICATIONS.

30" MINIMUM DEPTH FOR SECONDARY REPAIRS


GENERAL NOTES

SVA


1. VERIFY ALL EQUIPMENT LOCATIONS ON THE JOB PRIOR TO ROUGH-IN.
2. REFER TO RELATED ARCHITECTURAL, MECHANICAL, AND STRUCTURAL DRAWINGS FOR RELATED INFORMATION.
3. REFER TO THE SPECIFICATIONS FOR DATA NOT ON THE DRAWINGS.
4. COORDINATE OUTLET BOX LOCATIONS WITH MASONRY TO MINIMIZE CUTTING OF BRICK OR BLOCK.
5. ALL MOUNTING HEIGHTS TO BOTTOM OF ITEM UNLESS OTHERWISE NOTED.
6. ELECTRICAL CONTRACTOR TO VISIT JOBSITE PRIOR TO BID AND VERIFY ALL EXISTING CONDITIONS AND REQUIREMENTS.
7. CONDUIT RUN IN CONDUCTORS AS INDICATED, CONDUIT SIZE AS REQUIRED, CONDUIT RUN TO PANEL DEVICE SIZE AS INDICATED (AMP/FED), CIRCUIT WITHOUT INDICATION IS TO BE A 1P BREAKER.
8. A GROUND CONDUCTOR SIZED PER N.E.C. ARTICLE 250 IS REQUIRED IN ALL POWER, RECEPTACLE, AND LIGHTING CIRCUITS. GROUND CONDUCTORS ARE NOT SHOWN ON DRAWINGS.

ELECTRICAL SCHEDULES
LITTLE ARKANSAS RIVER
BICYCLE / PEDESTRIAN PATH

RB JOB 2088T	SHEET 61 OF 63
-----------------	-------------------------

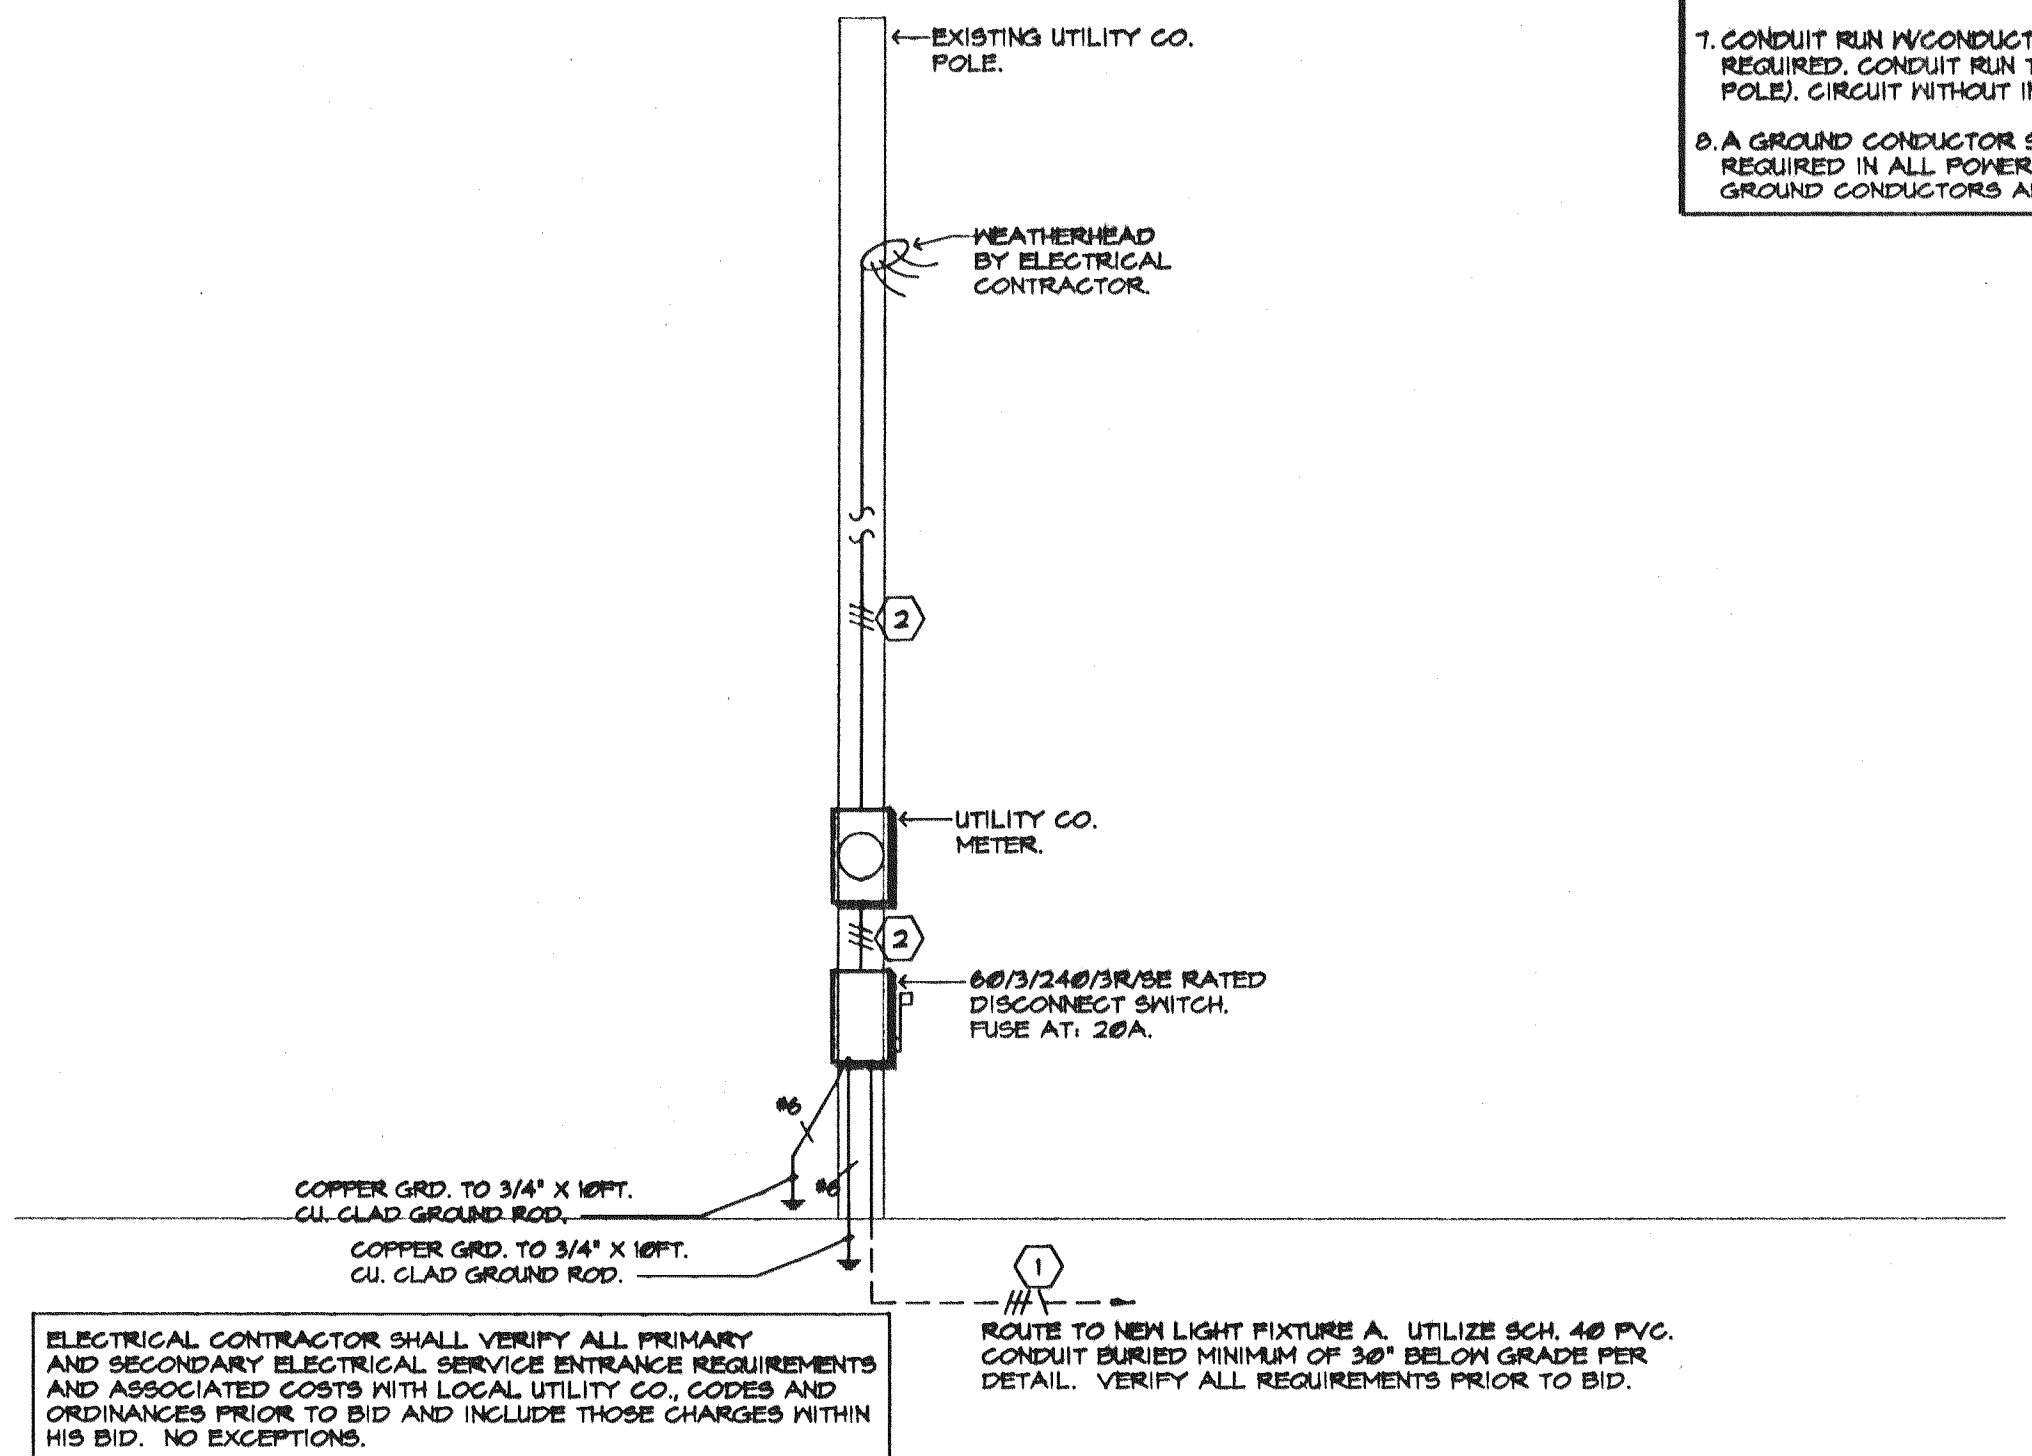

NEW ELECTRICAL SERVICE ENTRANCE RISER DIAGRAM
NO SCALE, TYPICAL OF TWO LOCATIONS. VOLTAGE: 120/240V, 1Ø, 3 WIRE

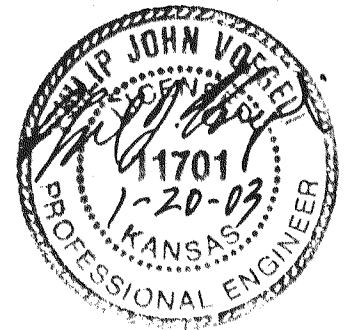

Stefan,
Albrecht
& Associates
Inc.

Electrical Engineering
and Design
349 S. Hydraulic
Wichita, Ks. 67211-1008
(316) 264-3051
FAX: (316) 264-3542

