


ALL SEWER SHALL BE BACKFILLED WITH NATIVE SOILS EXCEPT WHERE INDICATED DIFFERENTLY. STREET CROSSINGS SHALL BE BACKFILLED WITH SAND AND FLUSHED AND VIBRATED PER CITY SPECIFICATIONS. SUITABILITY OF EXCAVATED SAND FOR USE AS BACKFILL WILL BE DETERMINED BY THE ENGINEER.

CRUSHED ROCK TO BE USED AS TEMPORARY SURFACE IN ALL CASES WHERE PAVEMENT OR GRAVEL IS REMOVED AND TO FILL THE VOID LEFT BY EXISTING CULVERT REMOVAL AS NECESSARY FOR STORM SEWER CONSTRUCTION. BID ITEM IS SUBSIDIARY TO THE BID ITEM FOR THE STORM SEWER PIPE BEING INSTALLED.

CRUSHED ROCK IS TO BE UNIFORMLY GRADED FROM 1-1/2" MAXIMUM SIZE TO NOT MORE THAN 10% PASSING A NO. 200 SIEVE.

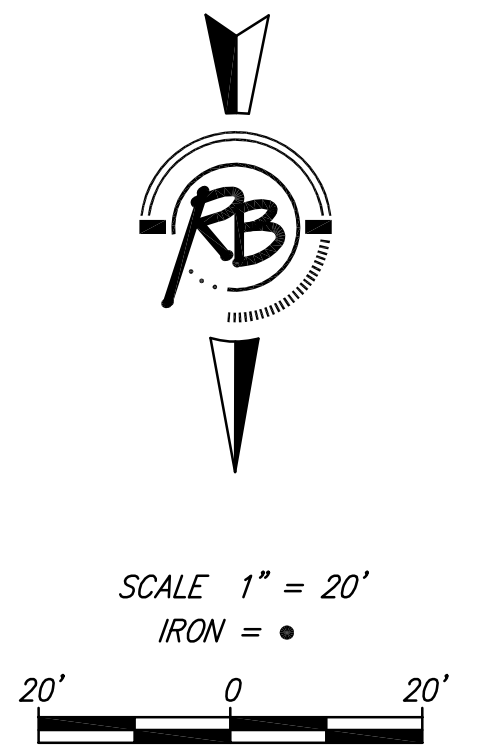

Ruggles & Bohm, P.A.
Engineering, Surveying, Land Planning
2000 Main Street
P.O. Box 4000
Sioux Falls, SD 57102
www.ruggles.com
E-mail: info@ruggles.com



DESIGN KWL
DRAWN RLS
REVIEW RLS
DATE Sept 24, 2008
UTILITY

PROJECT NUMBER 482-84648
DRAWING FILE Engineering Base

Pueblo, Mariposa & Sierra
Storm Drain Line 2
WICHITA KANSAS

RB JOB 3248T
SHEET 15
33

