



**NOTES**

1. Steel deck shall be fastened to building attachments to deliver a minimum of 200 lbs/ft. shear force. Manufacture shall specify a screw or weld pattern to meet this requirement. All roofing details to meet NRCA Standards.
2. All openings in roof to have 4"x4"x 5/16" frame set between steel trusses.

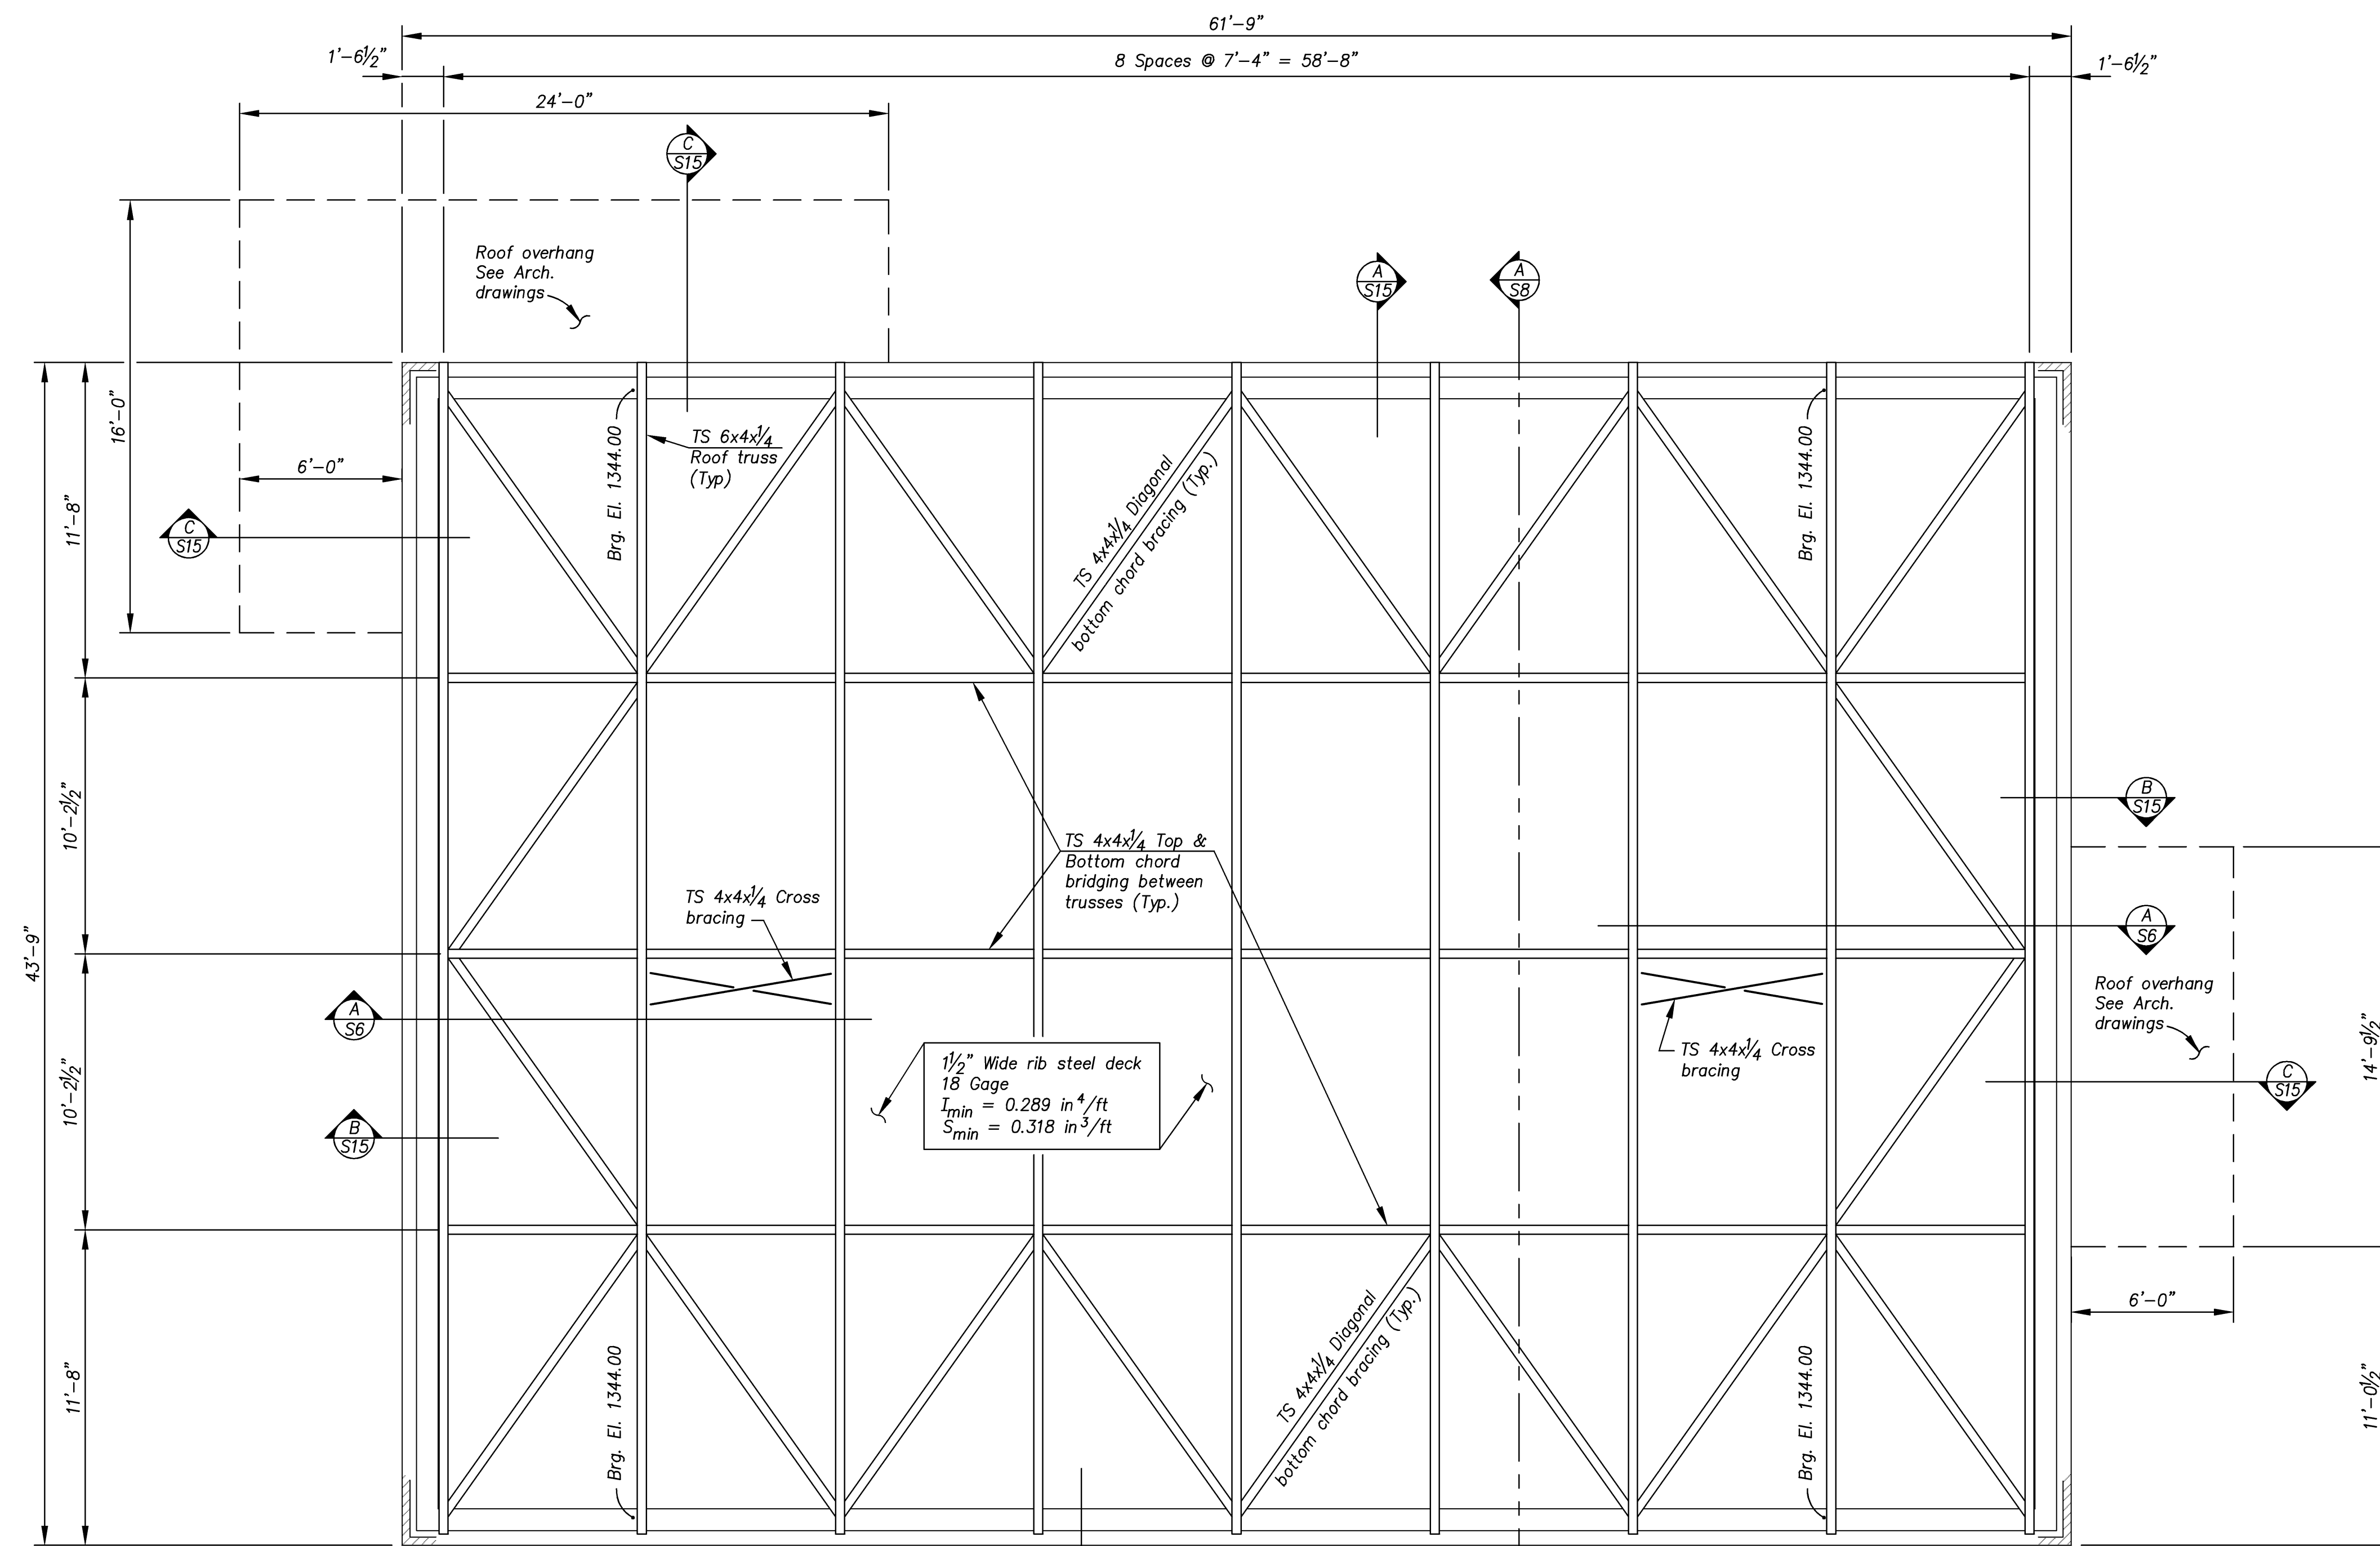


**ROOF FRAMING PLAN**

Scale: 1/4" = 1'-0"

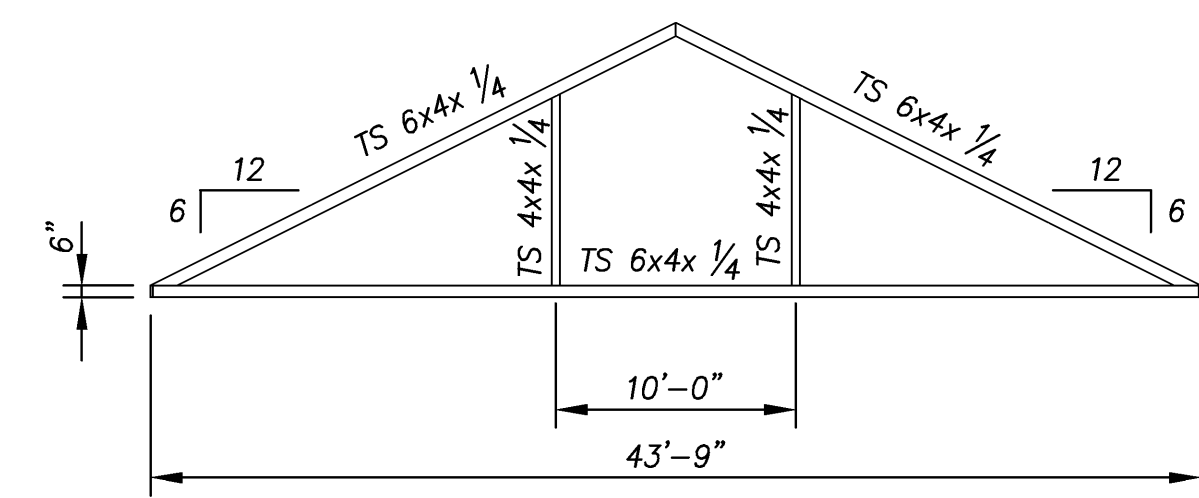


**END TRUSSES CONFIGURATION (2 Total)**

Scale: 1/8" = 1'-0"

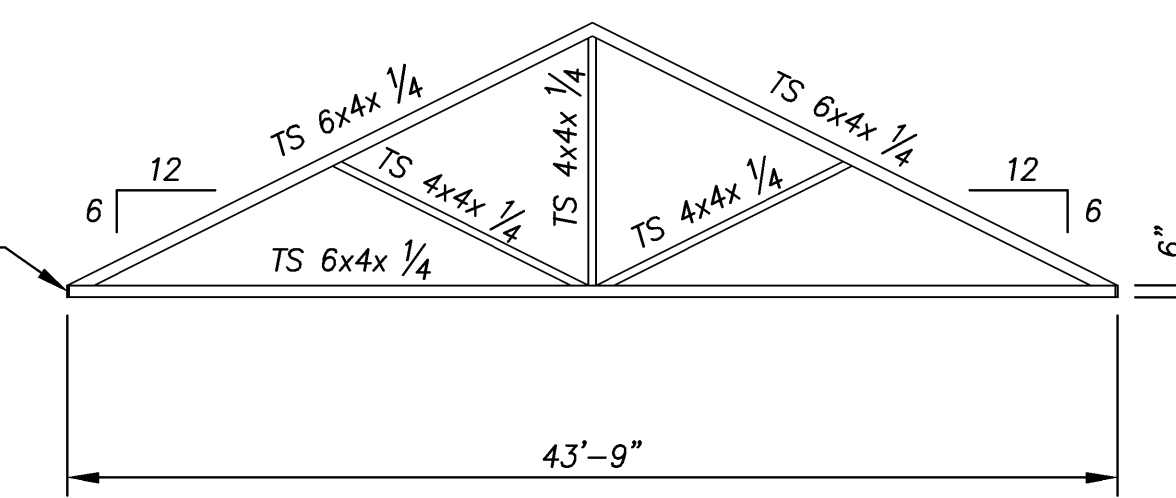

**INTERMEDIATE TRUSSES CONFIGURATION (7 Total)**

Scale: 1/8" = 1'-0"

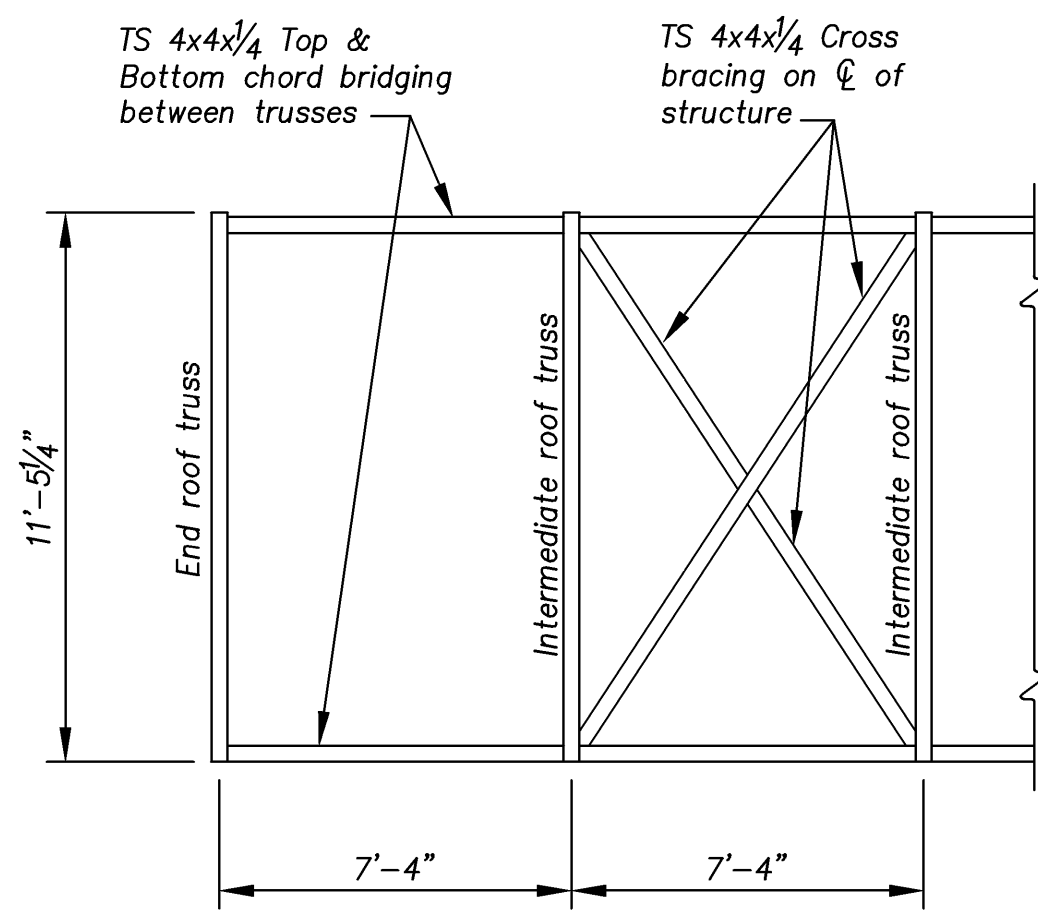

**SECTION A/S6**

1/4" = 1'-0"

CITY OF WICHITA, KANSAS		<b>CFS</b> Cook, Flatt & Strobel ENGINEERS, P.A.
PUMP STATION NO. 11		
STRUCTURAL		DESIGNED KMB
PUMP STATION		SCALE As Shown
ROOF FRAMING PLAN & DETAILS		DATE 10-30-09
		CHECKED
		SHEET S6 OF S17

J:\2008Proj\08527\DWG\Structural\2.dwg S6 Roof Plan 11/10/2009 - 1:50pm hpham