



TRENCH IN SOIL DETAIL
N.T.S.

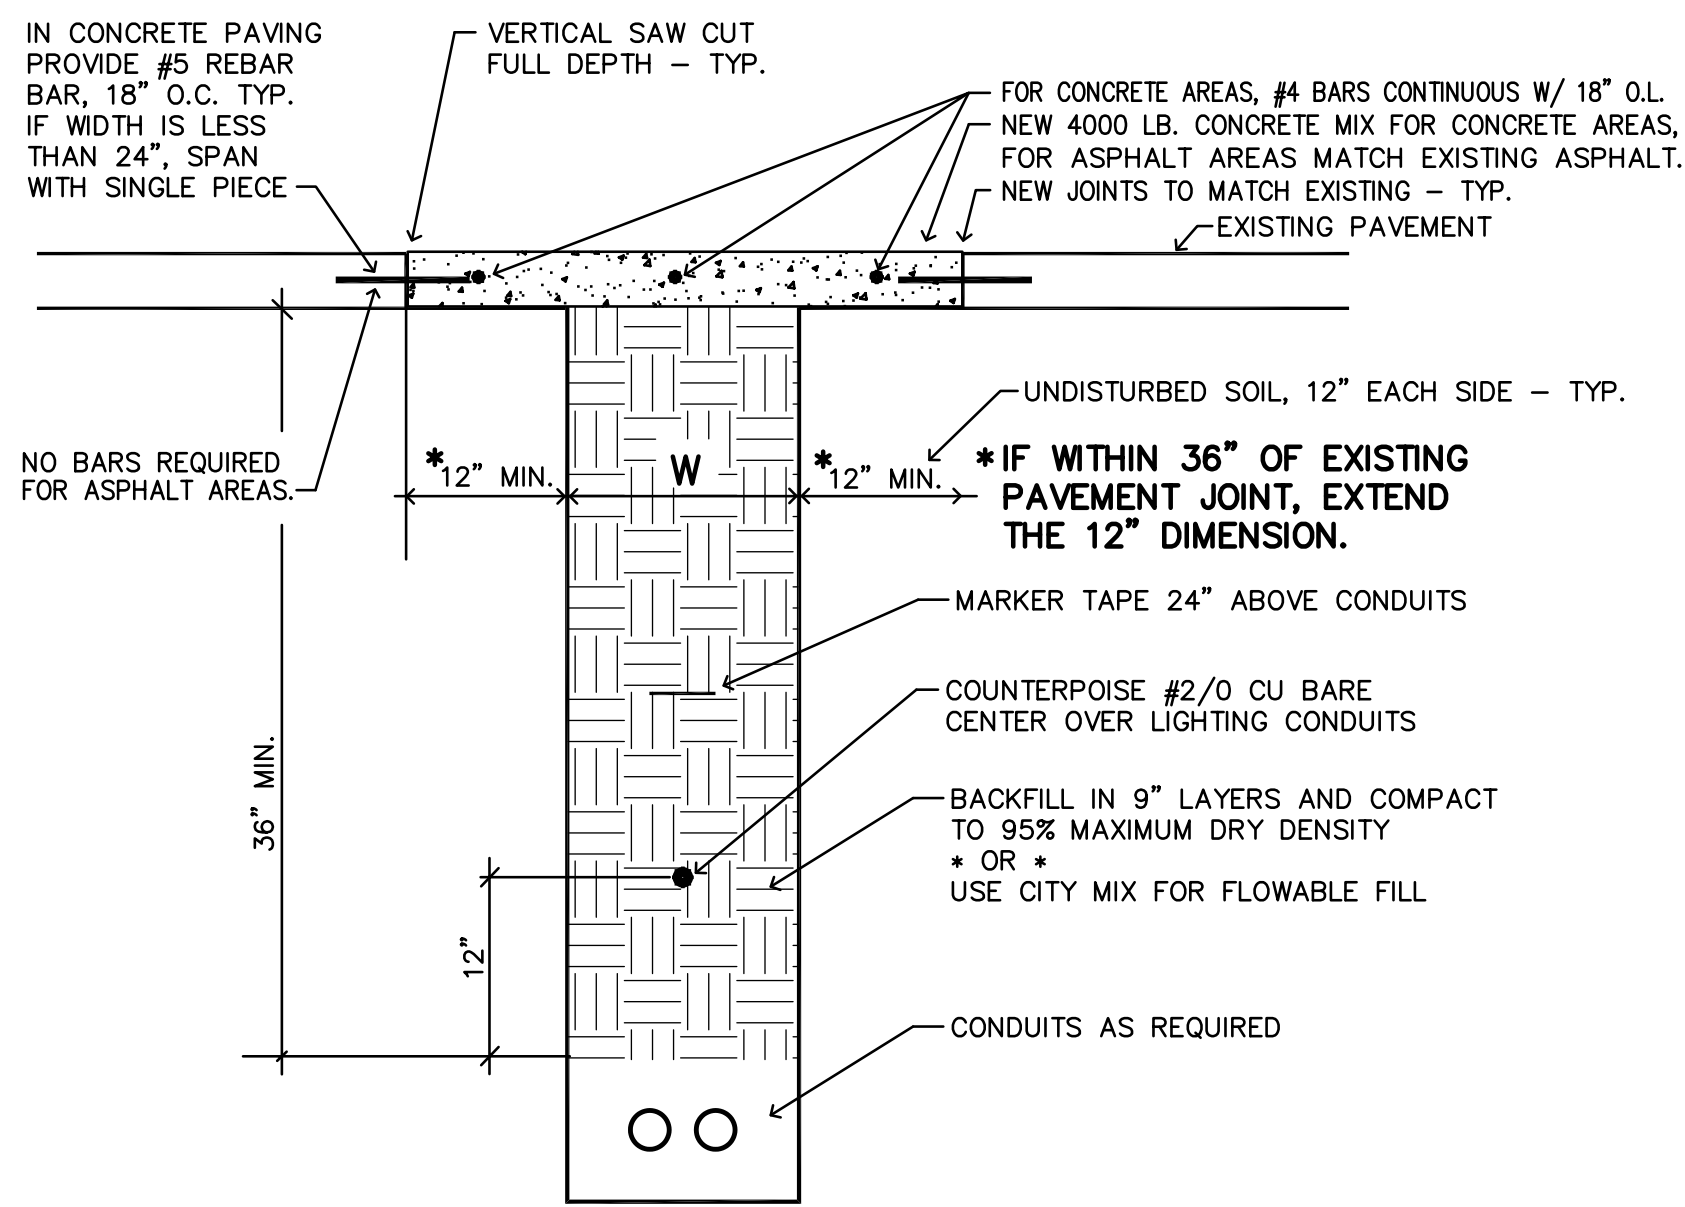


TRENCH BELOW PAVEMENT DETAIL
N.T.S.

PROVIDE PROTECTION OF EXISTING DECK WITH A 24" WIDE BOARDER OF 6mm CLEAR POLY FILM, TAPED ALL AROUND EDGES OF AREA TO BE REMOVED. PROVIDE SHEET OF 6mm CLEAR POLY FILM OVER THE CONCRETE, AFTER PLACEMENT, TO INSURE "WET" CURE. EXTEND FILM 6" BEYOND PATCH. ALLOW A 7 DAYS BEFORE REMOVAL.


PROVIDE #2 REBAR BAR, 2 PER SIDE BOTH WAYS - TYP. 3" MIN. EMBEDMENT DRILL 6" DEEP HOLE ON 1 SIDE TO ALLOW THE INSERTION OF REBAR, SHIFT TO CENTER OF THE NEW PATCH AREA- DRILL HOLES WITH 5/16" BIT (NO LARGER)

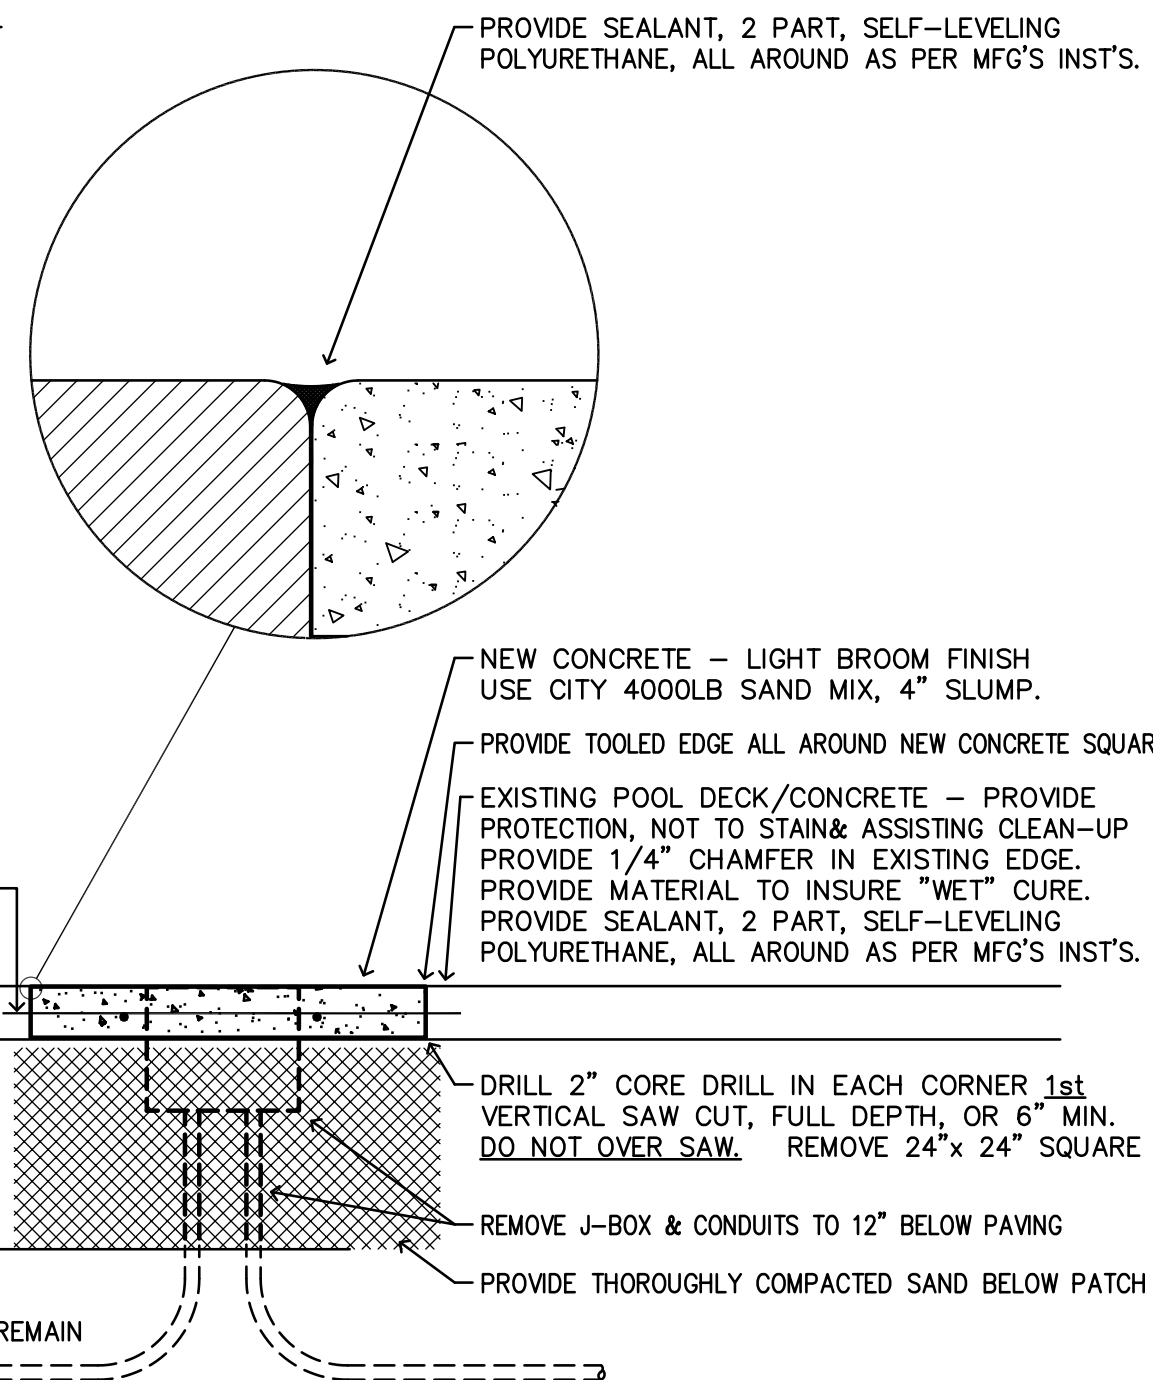


POOL DECK/CONCRETE PATCH DETAIL
TYPICAL FOR ALL BOXES &/OR POLES REMOVED

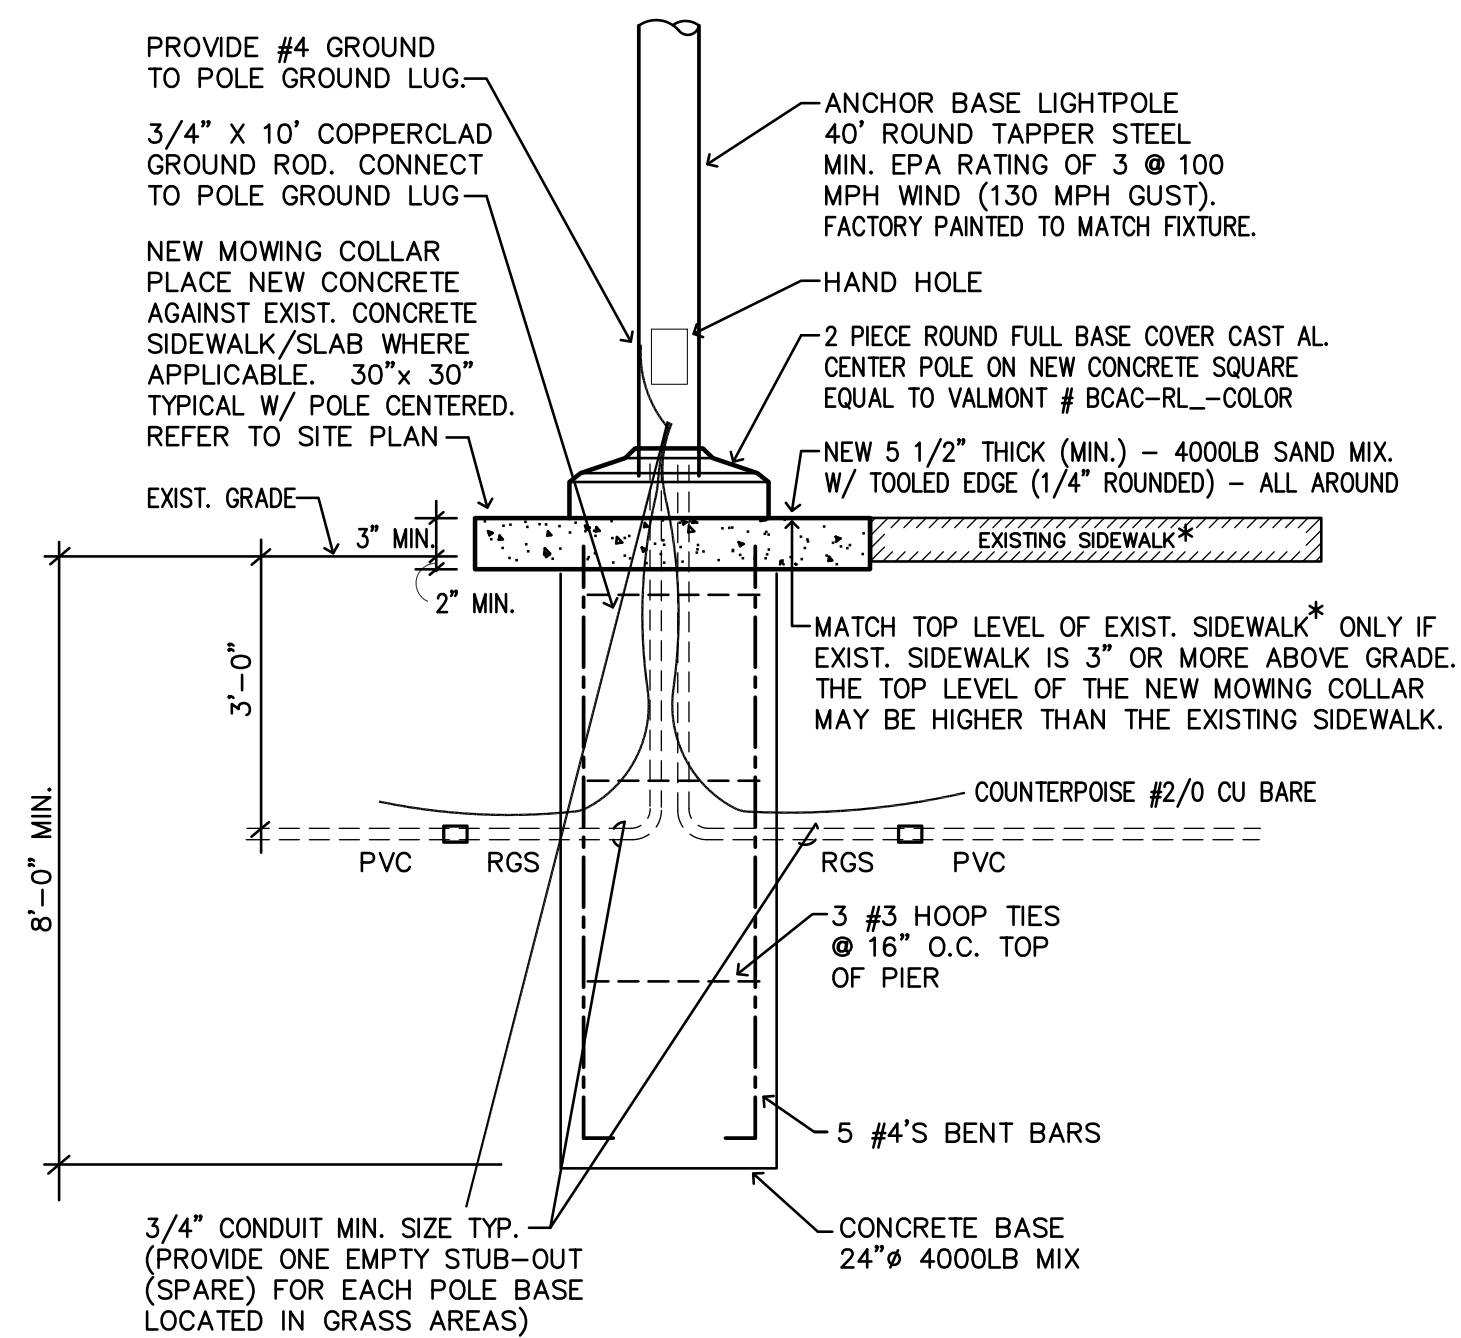

POLE 2 - BASE DETAIL
TYPICAL FOR FIXTURE: A

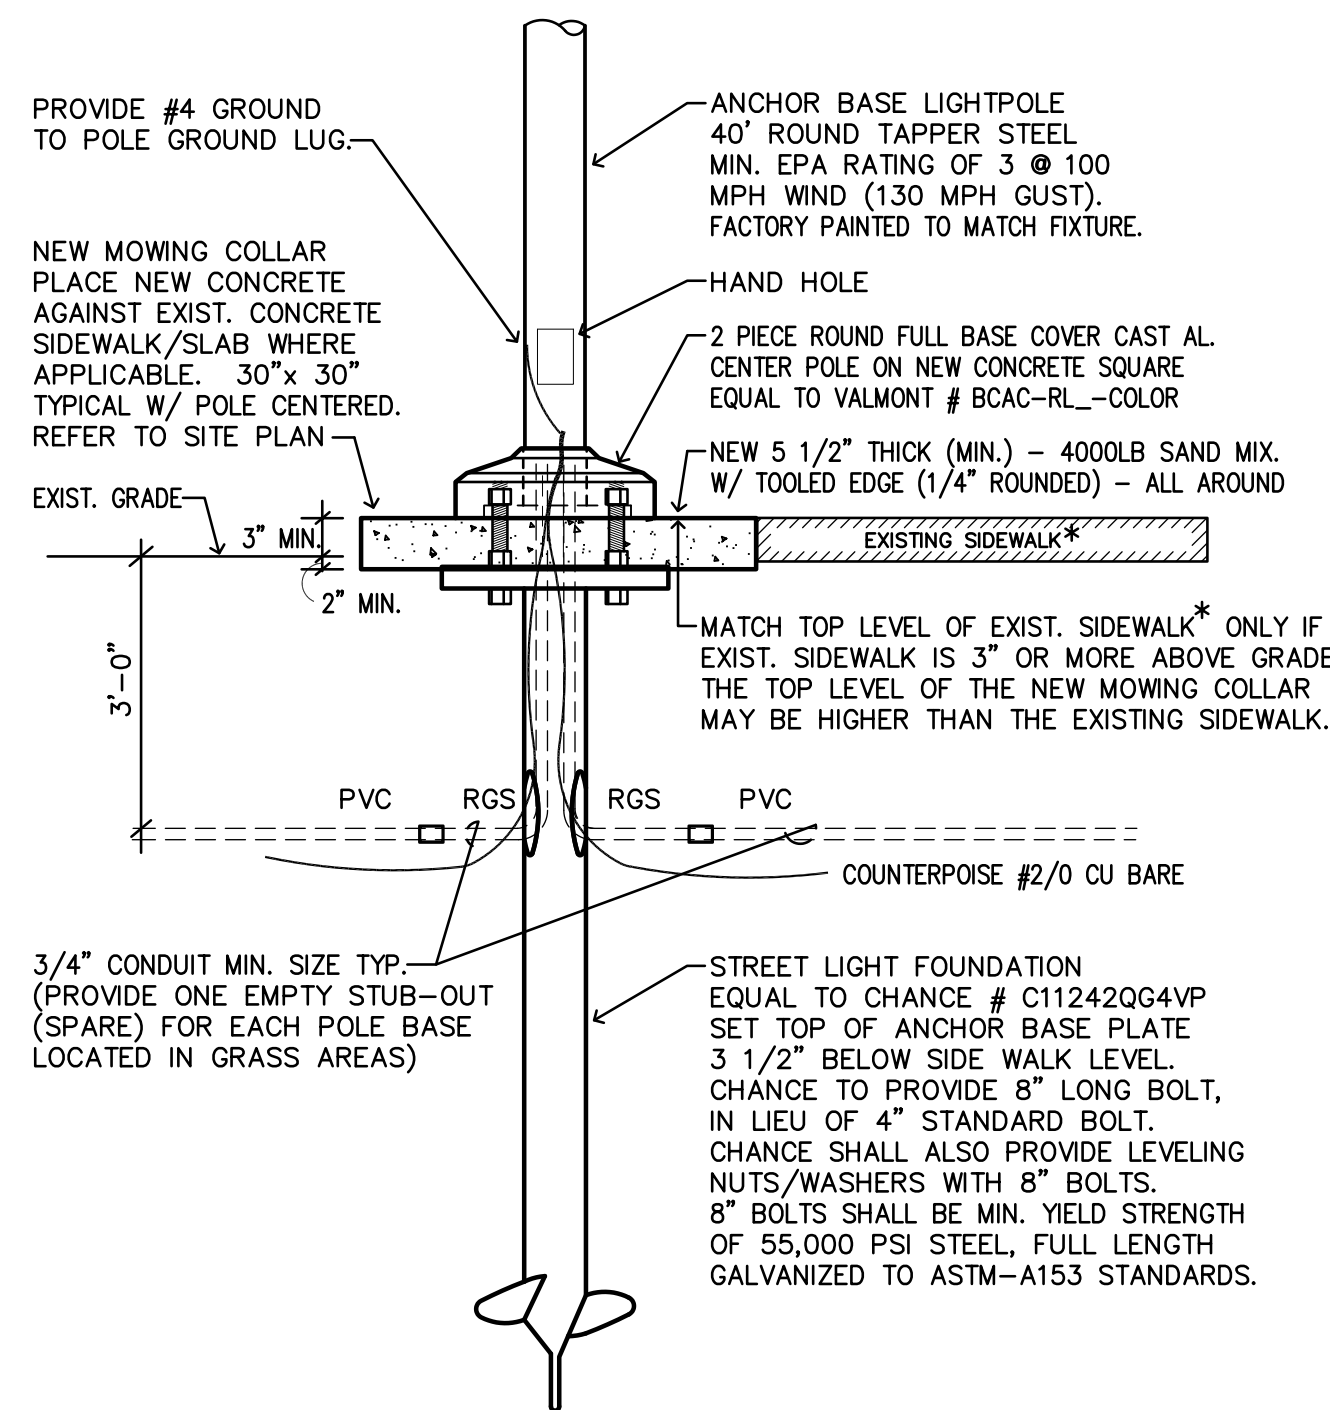

POLE 2 - BASE DETAIL
CONTRACTORS OPTION: USE SCREW-IN BASE FOR FIXTURE: A

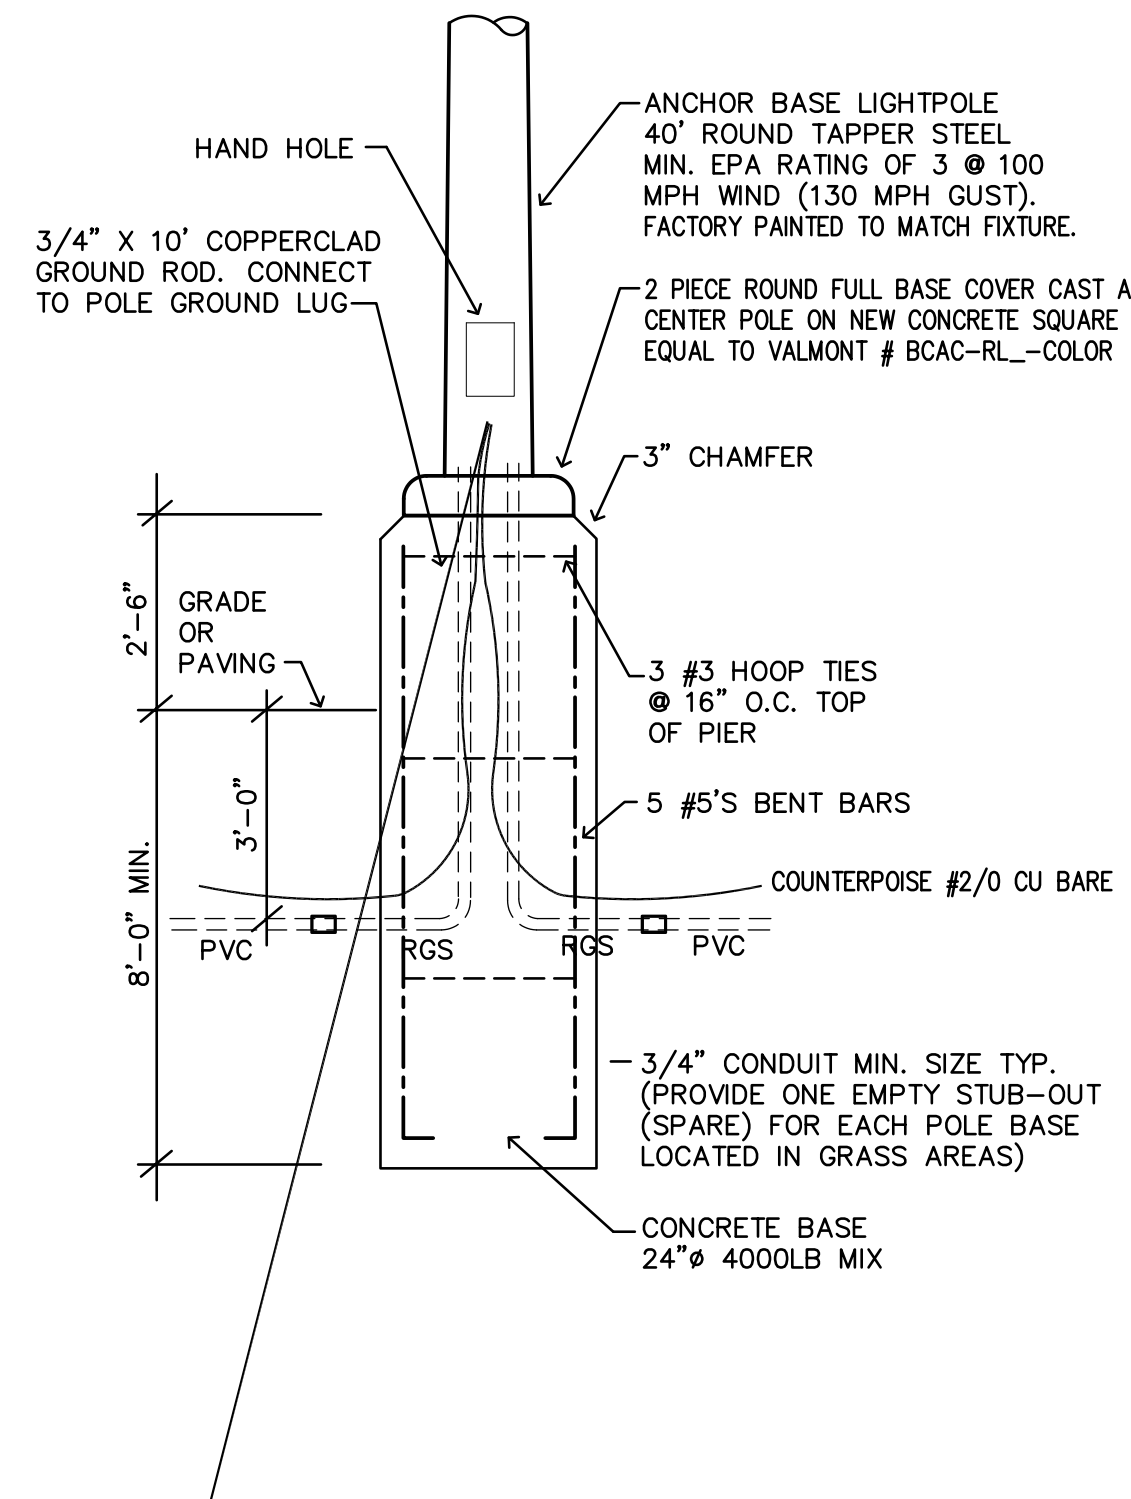

POLE 1 - BASE DETAIL
TYPICAL FOR FIXTURE: C

GENERAL NOTES

- THE INSTALLING CONTRACTOR IS RESPONSIBLE TO REVIEW ALL ARCHITECTURAL, STRUCTURAL, MECHANICAL PLANS AND SPECIFICATIONS/ADDENDA FOR ADDITIONAL INFORMATION AND/OR COORDINATION. ADDITIONAL ELECTRICAL REQUIREMENTS MAY BE INCLUDED IN THE ABOVE REFERENCED DOCUMENTS THAT THE E.C. IS RESPONSIBLE FOR PROVIDING AND/OR INSTALLING.
- REFER TO MECHANICAL PLANS AND SPECIFICATIONS FOR EXACT LOCATION OF MECHANICAL EQUIPMENT AND T-STAT LOCATIONS. FUSING OF MECHANICAL EQUIPMENT AS PER NAME PLATE DATA ON EQUIPMENT.
- ALL LINE VOLTAGE WIRING SHALL BE COPPER IN STEEL CONDUIT & STEEL BOXES, UNLESS SPECIFICALLY NOTED OTHERWISE. EACH CONDUIT CONTAINING LINE VOLTAGE SHALL CONTAIN A GREEN, INSULATED GROUND CONDUCTOR. THIN WALL CONDUIT SHALL NOT BE INSTALLED FOR EXTERIOR USE. ALL CONDUITS ROUTING SHALL BE INSTALLED PARALLEL AND PERPENDICULAR. ALL CONDUIT PENETRATIONS OF BUILDING WALLS SHALL BE SEALED/CALULKED WITH AN APPROPRIATELY MATERIAL, FIRE RATED.
- STRAIGHT RUNS UNDERGROUND / IN SLAB CONDUIT MAY BE SCHEDULE 40 PVC, 3/4" MINIMUM WITH STEEL ELLS, BENDS AND RISERS. ALL RISERS PENETRATING SLAB OR EXITING FROM EARTH SHALL BE RIGID STEEL. NO EXCEPTIONS.
- ALL RACEWAYS FOR BUILDING MOUNTED LIGHTING FIXTURES, SHALL BE ROUTED INSIDE THE BUILDING. EXTERIOR, EXPOSED RACEWAYS IS NOT ACCEPTABLE.
- VERIFY ALL OUTLET LOCATIONS ON JOB, PRIOR TO ROUGH-IN.
- EXTERIOR EXPOSED CONDUIT RUNS WILL NOT BE PERMITTED. (EXCEPT WHERE SPECIFICALLY NOTED ON PLAN OR SPECIFICALLY INDICATED & APPROVED IN WRITING.)
- ALL NEW CONDUIT INSTALLED INSIDE THE BUILDING SHALL BE SCH 80 PVC. ANY SCH 40 PVC FOUND INSTALLED INSIDE THE BUILDING, WILL BE REMOVED AND REPLACE WITH SCH 80 BY THE CONTRACTOR AT NO ADDITIONAL EXPENSE TO THE OWNER. ALL BUILDING PENETRATIONS SHALL BE MADE ±12" ABOVE GRADE. CONDUIT INSTALLED EXTERIOR AND EXPOSED, SHALL BE RGS (GAL. RIDGED STEEL). UNDERGROUND RUNS SHALL RISE UP WITH RGS AND GO INTO AN IRON LB. ON EXTERIOR OF BUILDING. EXPOSED INTERIOR AND EXTERIOR CONDUIT RUNS SHALL BE PARALLEL/PERPENDICULAR TO BUILDING STRUCTURE. REFER TO EACH SITE FOR ADDITIONAL ROUTING INFORMATION.
- RACEWAYS, OUTLET BOXES, PANELBOARDS, ETC. SHALL NOT UTILIZE PLASTIC ANCHORS FOR ATTACHMENT TO BUILDING ELEMENTS. PLASTIC ANCHORS WILL NOT BE PERMITTED FOR USE AT ANY LOCATION. EACH OUTLET BOX SHALL BE SECURED TO THE BUILDING STRUCTURE SUCH THAT THE ATTACHMENT WILL SAFELY SUPPORT A MINIMUM LOAD OF 50 POUNDS. ANCHORS SHALL BE STEEL SLEEVE EXPANSION TYPE, 1/4" MINIMUM.
- E.C. SHALL VISIT SITE TO DETERMINE: 1.) EXISTING CONDITIONS. 2.) THE EXTENT OF DEMOLITION. ANY CONFLICTS BETWEEN PLANS/SPECIFICATIONS AND ACTUAL EXISTING CONDITIONS THAT AFFECT CONSTRUCTABILITY, SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO BID. NO EXCEPTIONS.
- ALL PANELS SHALL BE PANELBOARD CONSTRUCTION WITH BOLT-IN CIRCUIT BREAKERS, COPPER BUS AND ISOLATED GROUND BUS. REFER TO THE PANEL SCHEDULES FOR ADDITIONAL INFORMATION. TANDEM STYLE BREAKERS ARE NOT ALLOWED, IF ADDITIONAL POLE SPACE IS REQUIRED, INFORM THE ENGINEER OF CONDITIONS PRIOR TO INSTALLATION.
- PROVIDE INTERMATIC # K1121 PHOTOCCELL AND INTERMATIC # ET70115C TIME CLOCK TO CONTROL EXTERIOR LIGHT FIXTURES. PHOTO CELL ON / TIME CLOCK OFF OPERATION.
- E.C. SHALL INCLUDE IN THE ELECTRICAL BID: ALL ASSOCIATED CHARGES FOR THE ELECTRICAL SERVICES FROM THE LOCAL UTILITIES. (POWER, TELEPHONE, CABLE TELEVISION, ETC.)
- ALL WORK SHALL COMPLY WITH LOCAL, STATE AND NATIONAL CODES. THE ELECTRICAL CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS, FEES, INSPECTIONS AND CERTIFICATES REQUIRED.
- THE ELECTRICAL CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, TOOLS, TRANSPORTATION, AND EQUIPMENT REQUIRED FOR THE COMPLETE, PROPER AND SUBSTANTIAL INSTALLATION OF ALL ELECTRICAL WORK INDICATED OR REQUIRED FOR A COMPLETE WORKING INSTALLATION OF ALL ELECTRICAL SYSTEMS.
- CONTRACTOR SHALL PROVIDE DIGITAL (jpg) PICTURES OF ALL WORK INCLUDED IN EACH PAY APPLICATION. PICTURES FOR UNDERGROUND WORK SHALL INCLUDE TAPE MEASURE TO INDICATE DEPTH. UNDERGROUND PICTURES SHALL ALSO SHOW ALL RGS-TO-PVC RISERS. PICTURES SHALL SHOW DEPTH OF ALL UTILITY CROSSINGS. PROVIDE A MINIMUM OF 15 PICTURES PER SITE. 2 PHOTOS PER POLE AND BUILDING RISER LOCATION ARE REQUIRED. #1 TO READ TAPE MEASURE, #2 THE SAME SHOT AT A WIDER ANGLE (SHOWING ENOUGH BACKGROUND) TO IDENTIFY SITE LOCATION.

SITE LIGHTING SCOPE OF WORK

- CONTRACTOR (E.C.) IS RESPONSIBLE FOR GETTING ALL UNDERGROUND UTILITIES FLAGGED. THIS INCLUDES, BUT IS NOT LIMITED TO THE FOLLOWING: GAS, ELECTRIC, TELEPHONE, CABLE, FIBER OPTIC CABLE, WATER, AND IRRIGATION LINES. THE CONTRACTOR SHALL COORDINATE WITH THE OWNER TO GET FLAGGED ANY OWNER INSTALLED UNDERGROUND UTILITIES.
- E.C. SHALL PROVIDE AND INSTALL NEW SITE LIGHTING, INCLUDING BUT NOT LIMITED TO POWER/CONTROL CONDUIT, TRENCH AND BACKFILL AS DIRECTED BY THE WORK AND THE CITY OF WICHITA ENGINEER. CONTRACTOR SHALL FULLY FAMILIARIZE HIMSELF WITH THE PLANS AND SPECIFICATIONS OF ALL NEW WORK UNDER THIS CONTRACT.
- E.C. SHALL HAVE THE NEW LIGHTING SYSTEM UP AND RUNNING, BEFORE ANY REMOVAL/DEMO OF EXISTING OPERATIONAL ELECTRICAL SYSTEMS AND/OR LIGHTING.
- E.C. SHALL REMOVE/DISPOSE THE EXISTING POLE/CONDUITS/LIGHTS INDICATED, OFF SITE. E.C. SHALL REMOVE ALL OF THE EXISTING CONCRETE POLE BASES, WHEN FOUND IN SOIL. REFER TO DETAIL FOUND THE REMOVAL OF POLES/CONDUITS IN POOL DECK AREA.
- E.C. SHALL RESTORE ALL AREAS OF TURF DISRUPTED BY THE CONSTRUCTION BACK TO THE ORIGINAL CONDITION. PHOTO'S OF ORIGINAL CONDITION ON FILE. THIS RESTORATION INCLUDES GRADING AND GRASS ESTABLISHMENT.
- ALL OF THE REQUIRED ELECTRICAL WORK IS NOT NECESSARILY SPECIFIED OR SHOWN ON PLANS: ALL REQUIREMENTS OF THE LIGHTING SYSTEM SHALL BE COORDINATED AND VERIFIED WITH THE EQUIPMENT SUPPLIER.
- THE COMPLETION OF ALL WORK REQUIRED BY THIS PLAN/SPEC SHALL BE AS PER THE TIME SCHEDULE PRESCRIBED IN THE PLAN/SPEC. CONTRACTOR IS RESPONSIBLE FOR ALL PLAN & SPEC SECTIONS OF THE CONSTRUCTION DOCUMENTS.